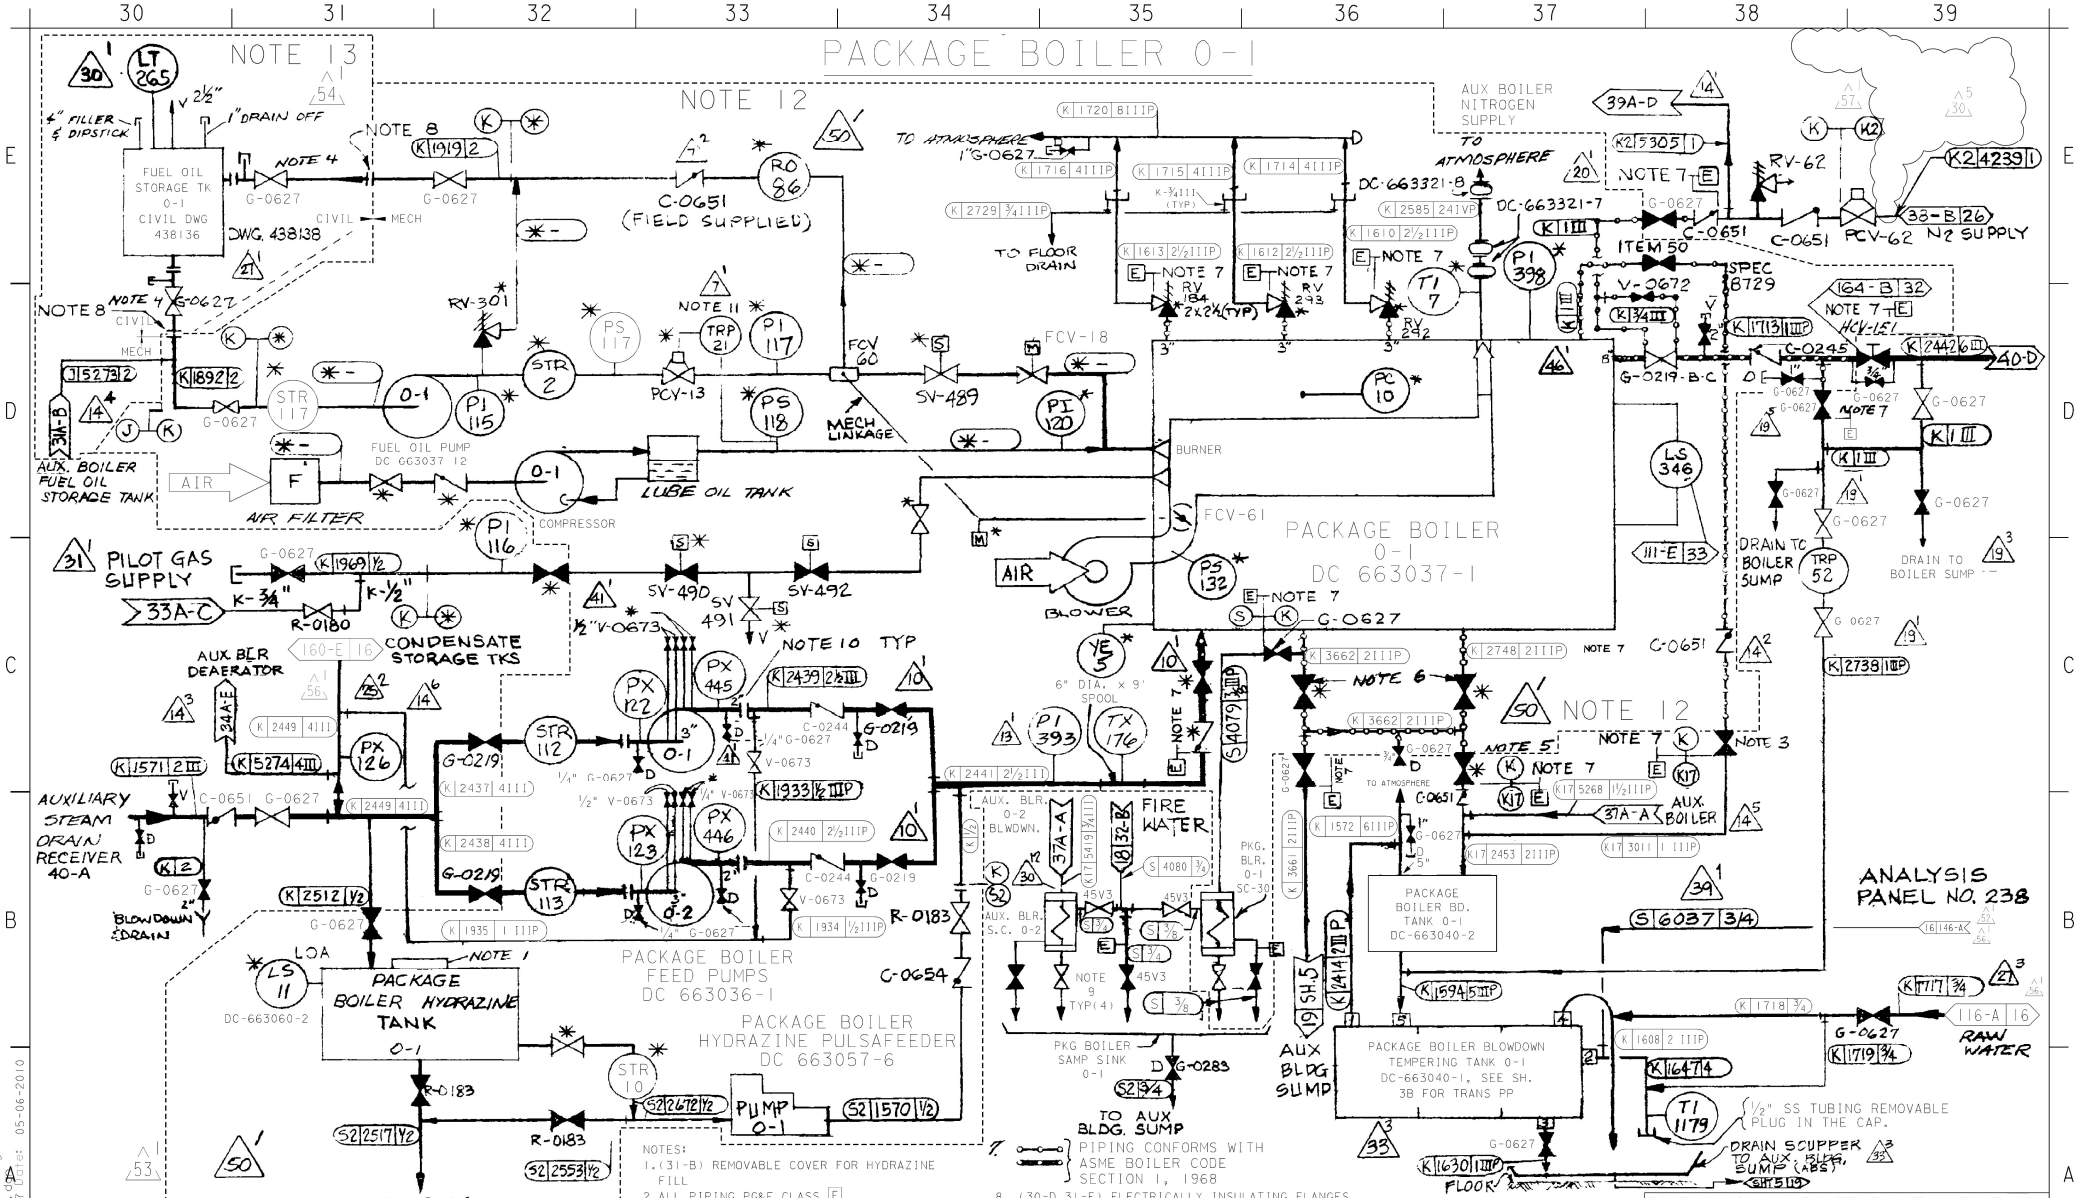
PACKAGE BOILER 0-1
NOTE 13
NOTE 12
FUEL OIL STORAGE TK 0-1 CIVIL DWG 438136
DWG. 438138
C-0651 (FIELD SUPPLIED)
AUX BOILER NITROGEN SUPPLY
TO ATMOSPHERE
TO FLOOR DRAIN
ITEM 50
SPEC 8729
N2 SUPPLY
AUX. BOILER FUEL OIL STORAGE TANK
FUEL OIL PUMP DC 663037 12
AIR FILTER
COMPRESSOR
LUBE OIL TANK
MECH LINKAGE
BURNER
PACKAGE BOILER 0-1 DC 663037-1
BLOWER
PILOT GAS SUPPLY
CONDENSATE STORAGE TKS
AUX BLR DEAERATOR
AUXILIARY STEAM
DRAIN RECEIVER 40-A
BLOWDOWN DRAIN
PACKAGE BOILER FEED PUMPS DC 663036-1
PACKAGE BOILER HYDRAZINE PULSAFEEDER DC 663057-6
PACKAGE BOILER HYDRAZINE TANK 0-1
PUMP 0-1
AUX BLDG SUMP
FIRE WATER
AUX. BLR. 0-2 BLWDWN.
AUX. BLR. S.C. 0-2
PKG. BLR. 0-1 SC-30
PKG BOILER SAMP SINK 0-1
TO AUX BLDG. SUMP
PACKAGE BOILER BD. TANK 0-1 DC-663040-2
PACKAGE BOILER BLOWDOWN TEMPERING TANK 0-1 DC-663040-1, SEE SH. 3B FOR TRANS PP
AUX BOILER
AUX BLDG SUMP
ANALYSIS PANEL NO. 238
RAW WATER
DRAIN TO BOILER SUMP
DRAIN SCUPPER TO AUX. BLDG. SUMP (ABS)
FLOOR
1/2" SS TUBING REMOVABLE PLUG IN THE CAP.
PIPING CONFORMS WITH ASME BOILER CODE SECTION 1, 1968
NOTES:
1. (31-B) REMOVABLE COVER FOR HYDRAZINE FILL
2. ALL PIPING PG&E CLASS E EXCEPT INSIDE DOTTED LINE
3. (38-C) 1" HANCOCK ANGLE VALVE NO. 5505
4. (30-E) SECOND GATE VALVE LOCATED NEAR TANK
5. (37-C) ITEM 15 DC-663037-2
6. (36-C) ITEM 14 DC-663037-2
8. (30-D, 31-E) ELECTRICALLY INSULATING FLANGES
9. (35-B) INSTRUMENT VALVE 45V1 OR EQUIVALENT (45V3)
10. 2" 300# FF FLANGES
11. TRAP USED TO INDICATE FAILURE OF PCV-13 DIAPHRAGM
12. ABANDONED IN PLACE
13. ABANDONED IN PLACE PER DCN DCO-EM-049122-00. TANKS FILLED WITH CONCRETE; PIPING RINSED, CUT, AND CAPPED.
DIABLO CANYON POWER PLANT - PG&E CO.
AUXILIARY STEAM SYSTEM
DRAWING 102006
SHEET 3
PAGE 0
REV 57
UNIT 1
05-06-2010 GN07 FxC2 KERSI J. DALAL MECHANICAL M 16690 3/31/2012 REVISED PER DFT-7*792
DATE DWN RE IV PROFESSIONAL ENGINEER PE DISC. PE# PE EXP.