
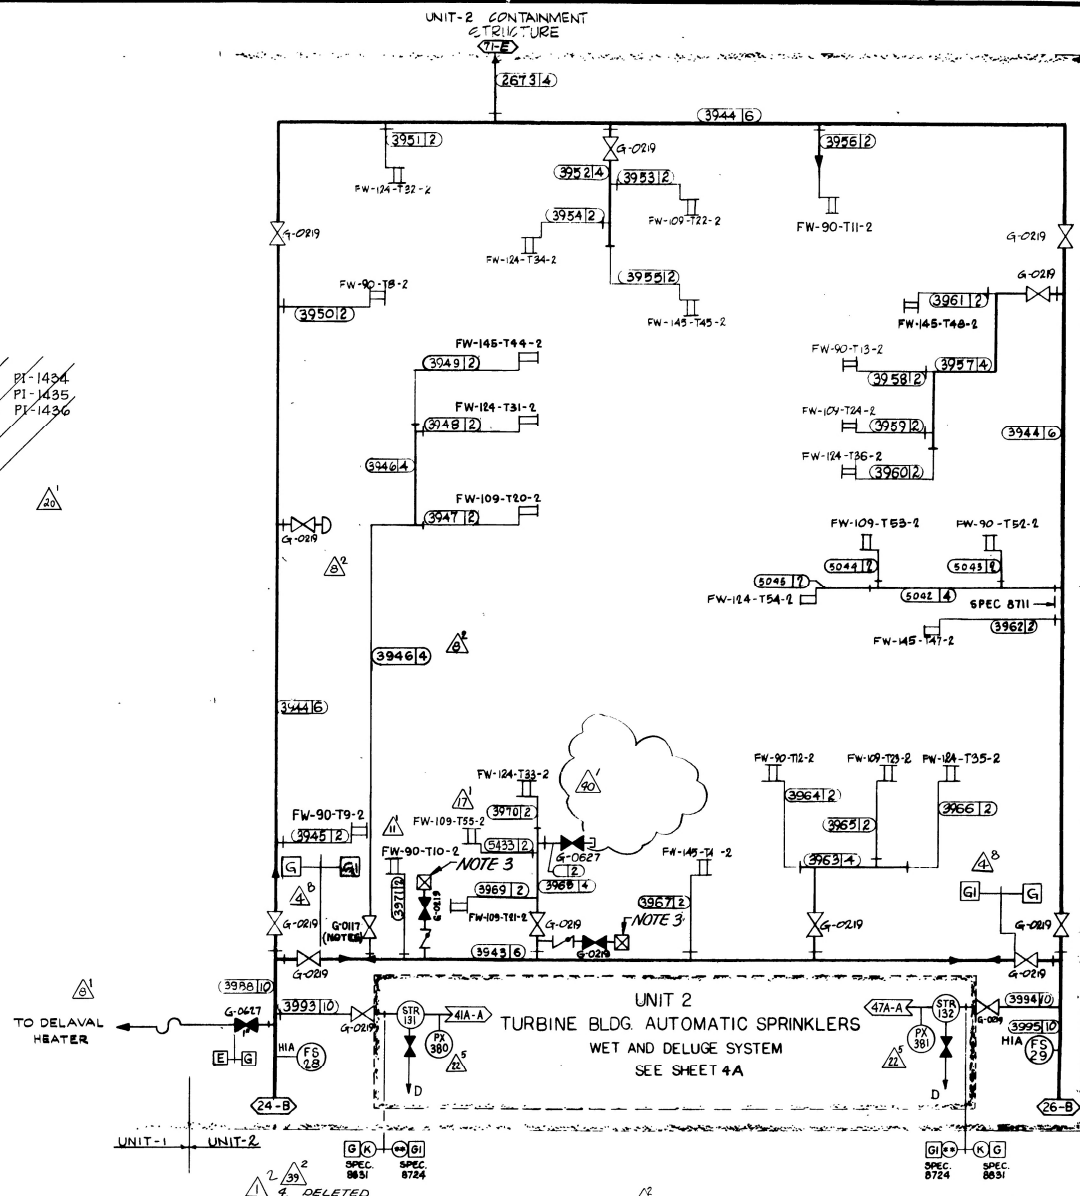


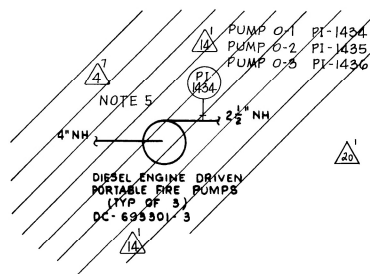

NOTES

1. ALL PIPING ON THIS SHEET IS UNDER SPEC. 8831 AND PG&E CLASS 'G' EXCEPT AS NOTED. UNLESS OTHERWISE NOTED, PIPING INSIDE TURBINE BUILDING IS SPEC 'K'.
2. PIPING WITH DOUBLE ASTERISKS ARE UNDER SPEC. 8724.

3. 2 1/2" NATIONAL HOSE THREADED CONNECTION (CAPPED) FOR PORTABLE DIESEL ENGINE DRIVEN FIRE PUMPS, SPEC. 8711. CHECK VALVES ARE LUNKENHEIMER MODEL NO. 157 3C. (46-B) (47-B)

TURBINE BUILDING

4. THE PORTABLE FIRE PUMPS ARE SEISMICALLY ANALYZED IN ACCORDANCE WITH DESIGN CRITERIA MEMORANDUM M-45.
5. THE VALVE IS PROVIDED WITH CHAIN OPERATOR FOR ACCESSIBILITY.

P. G. & E. CO.
SHEET 4 OF SHEETS

UNIT - 2
DRAWING NUMBER 108018
REVISION 40