


50 51 52 53 54 55 56 57 58 59

NOTES:

1. ☐ INDICATES PG&E PIPING CODE CLASS
2. * DENOTES MANUFACTURER SUPPLIED INSTRUMENTS & EQUIPMENT. IT IS ACCEPTABLE TO REPLACE MANUFACTURER SUPPLIED INSTRUMENT TUBING WITH PG&E SUPPLIED 5-SPEC STAINLESS STEEL TUBING
3. [] MANUFACTURER NUMBER IDENTIFICATION
4. ** PIPING TO BE INSTALLED UNDER SPEC.8711 & PROVIDED UNDER DC-663084-1 21/52-B,38
5. MOUNTED ON ENGINE CONTROL PANEL 28-C
6. DIESEL GENERATOR EXHAUST SILENCER SEISMICALLY QUALIFIED FOR HOSGRI CRITERIA. EQUIPMENT SUPPORTS FOR THE DIESEL GENERATOR EXHAUST SILENCER SEISMICALLY QUALIFIED IN ACCORDANCE WITH DESIGN CRITERIA MEMORANDUM W-72 25-C

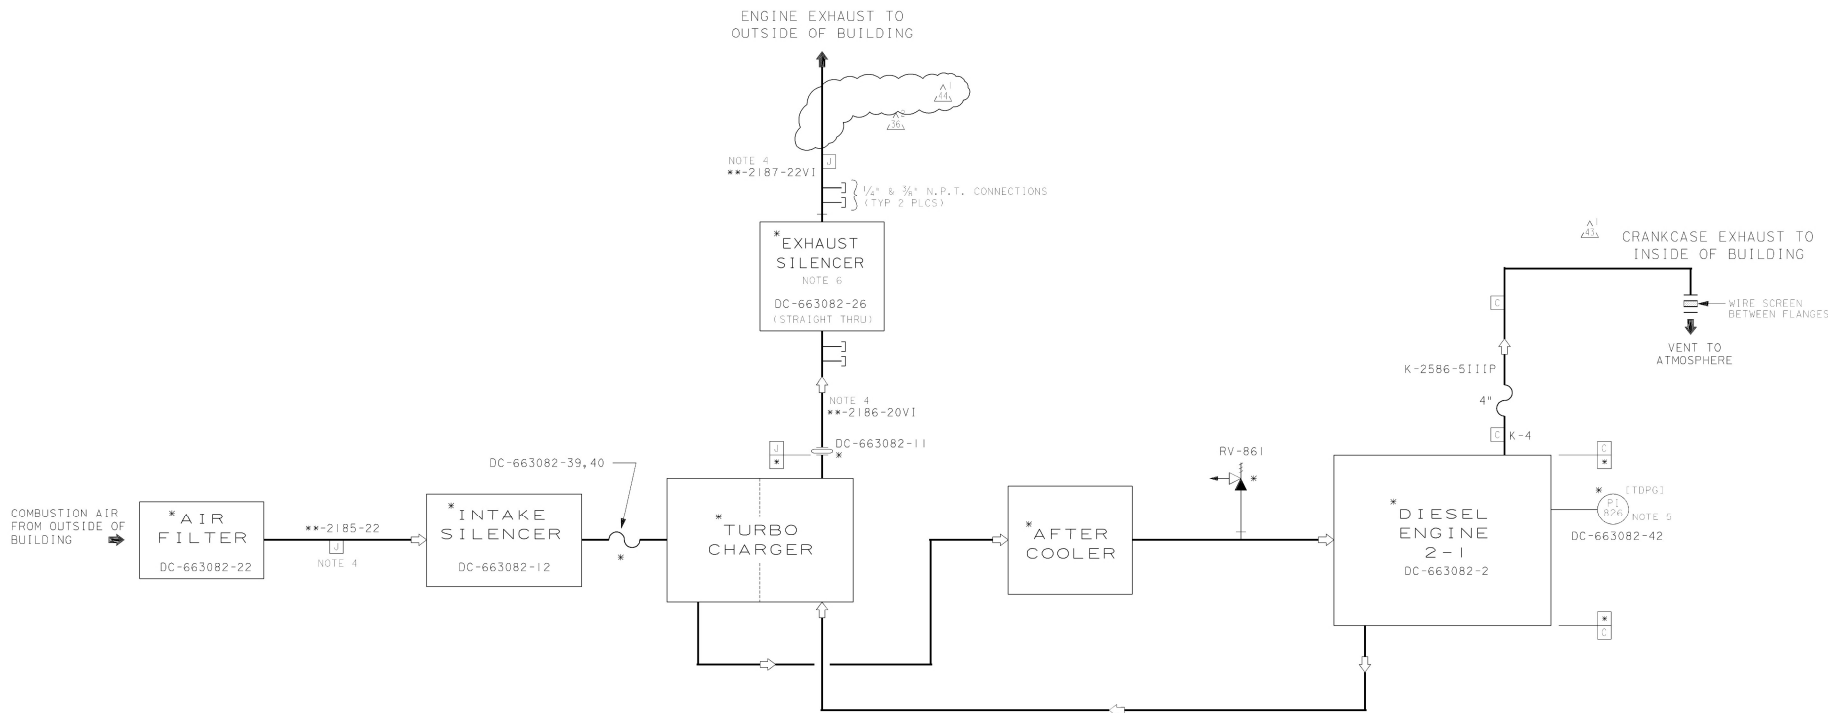

COMBUSTION AIR AND EXHAUST SYSTEM 2-1

UNIT 2

P G & E CO.		108021	REV.
SHEET 5	PAGE 0		44

12/17/03	AJL2	RMD1	-	KERSI J. DALAL	MECHANICAL	M 16690	3/31/2004	Revised per FCT 028077
DATE	DWN	RE	TV	PROFESSIONAL ENGINEER	PE DISC.	PE*	PE EXP.	