

Risk-Informing Materials Issues

Risk Informed Materials Assessment Project

Dan Widrevitz — Stephen Cumblidge
Technical Exchange Meeting
June 27, 2024

Topics

- Purpose and Applicability of RIMA Project
- Defense-in-Depth
- Safety Margin
- Risk Impacts (use of risk insights)
- Performance Monitoring
- Tier List
- Sampling Considerations
- Sampling Analysis

RIMA - Purpose

Risk-Informed Materials Assessment Project



A risk-informed materials engineering forward guidance development project


Leveraging the processes and guidance of RG 1.174, ADM-200, etc. to enable more efficient and effective reviews

Providing applicants and reviewers guidance in utilizing risk-informed decision making for non-integrated reviews

RIMA - Applicability

Target submittals:

LIC-206 Box 7 Type applications and reviews with non-integrated teams (e.g. materials engineers and counterparts only)

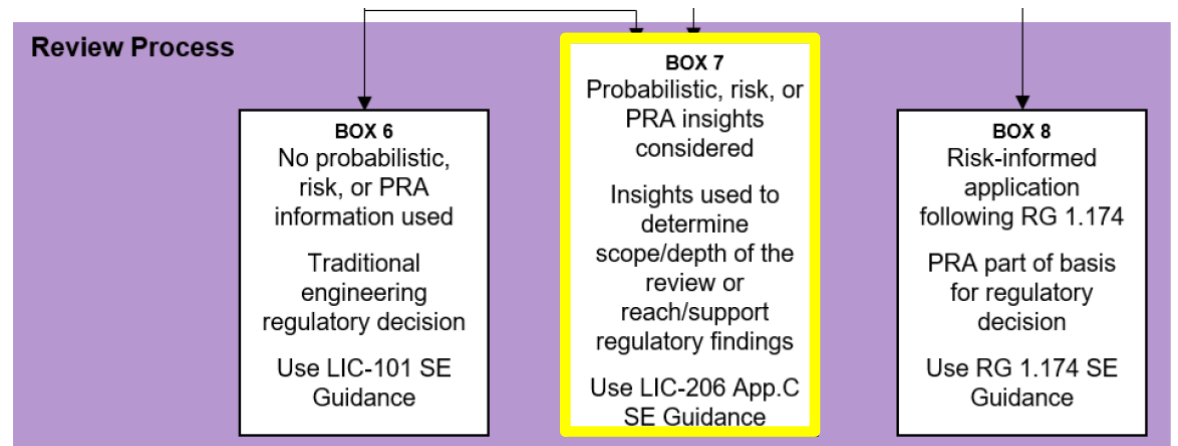

RIMA – Preliminary Concepts

Staff has been generating a preliminary set of RIMA concepts to support potential guidance document development

What it is (will be):

- Clearer/broader guidance in the language of materials engineers
- Applicant guidance to enable high quality submittals and efficient staff review

What it is not (will not be):

- New policy
- Deviation from RG 1.174

The following slides detail current preliminary concepts



RIMA – Defense in Depth

Further clarify the relationship between materials engineering topics and defense-in-depth considerations.


Typically, materials engineering reviews do not establish defense-in-depth characterizations, rather materials engineering supports commensurate level of assurance based on characterization.

Is treatment of subject systems commensurate with defense-in-depth functions of subject systems.

RIMA – Defense in Depth

Key consideration:

Is there enough “assurance”
from other four Principles of
RIDM to credit subject system for
defense in depth?

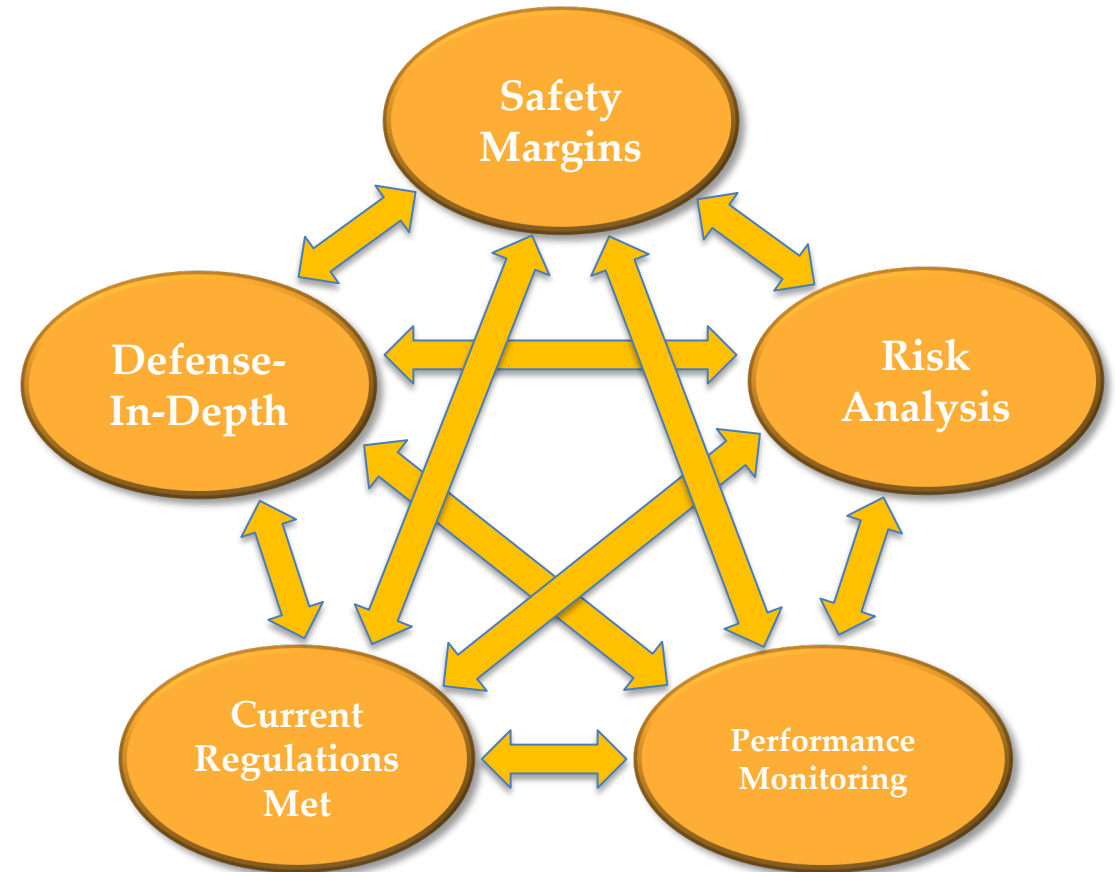


RIMA – Safety Margins

Further clarify the relationship between materials engineering topics and safety margin considerations.

Key consideration:

Are safety margins large enough, in concert with other Principles of RIDM, to manage uncertainties?

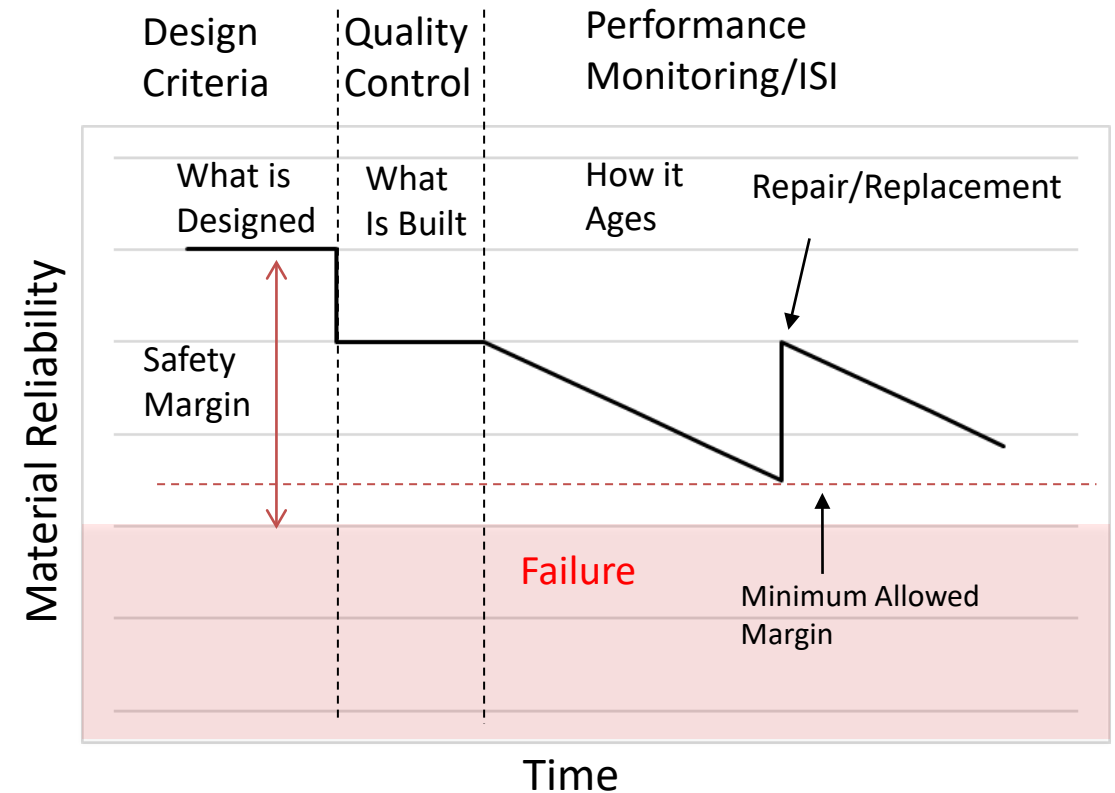

RIMA – Risk Impacts

Clarification and discussion of risk insights derived from qualitative or non-PRA modeling (e.g. PFM).

How insights related to one or more elements of the Risk Triplet (what can go wrong, how often, and what are the consequences) can be leveraged.

(More in a few slides)

RIMA – Risk Impacts

PFM is often a Risk Impact insight:

Risk Triplet

What can go wrong?

How often?

What are the consequences?

Frequency of potential initiating event
such as LOCA



RIMA – Performance Monitoring

Further clarify the relationship between materials engineering performance monitoring and the other Principles of RIDM.

Expanded discussion of performance monitoring and bathtub curb relationship.

Discussion of management of novel performance monitoring results.

RIMA – Performance Monitoring

Performance monitoring adequacy rests on several pillars.

How much monitoring?

What kind of monitoring?

How often?

Are there triggers for more or less monitoring within program?

Answers to these questions must be judged in context of other Principles of RIDM (e.g. how does subject system support defense-in-depth, etc.)



RIMA – Tier List


The materials staff wanted a risk ranking of important systems to help risk-inform materials reviews

The NRC Staff used the SPAR-Dash tool to rank important systems

For this work we have decided to focus on broad systems rather than components




Tier List – Fleetwide System Importance

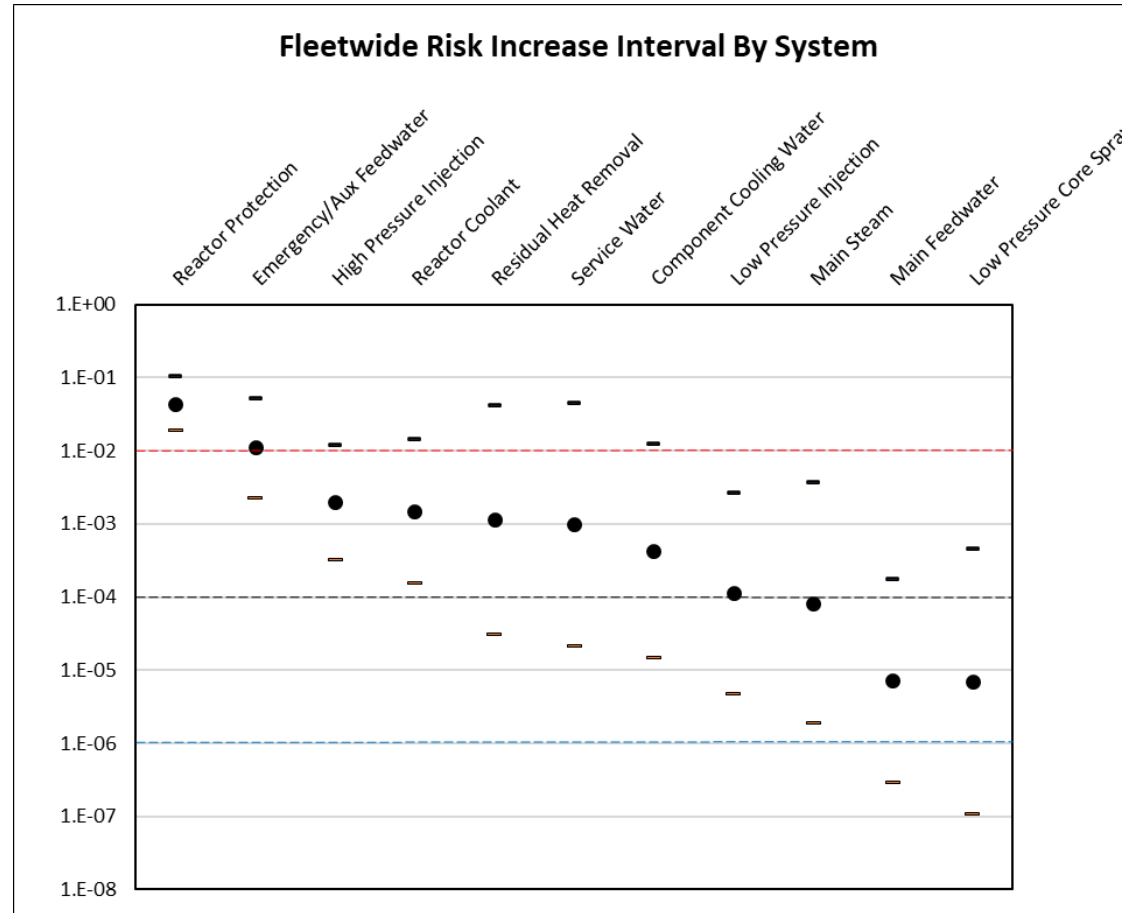


Tier List – PWR and BWR System Importance

PWR Risk Increase Interval By System

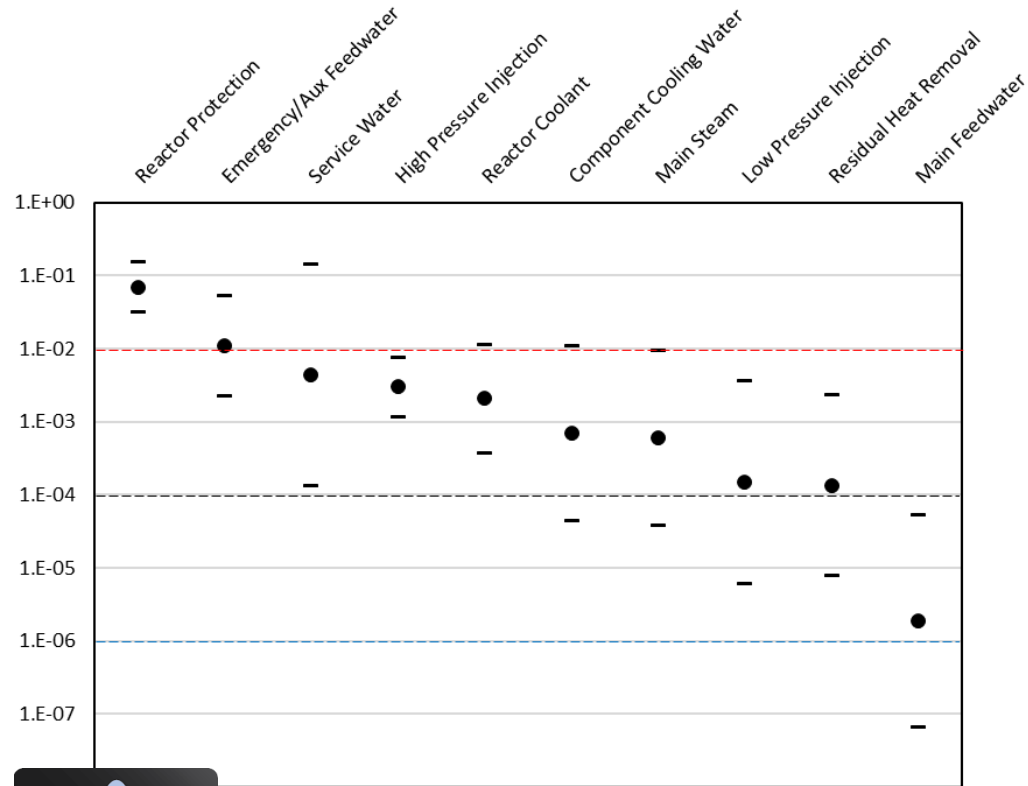

BWR Risk Increase Interval By System

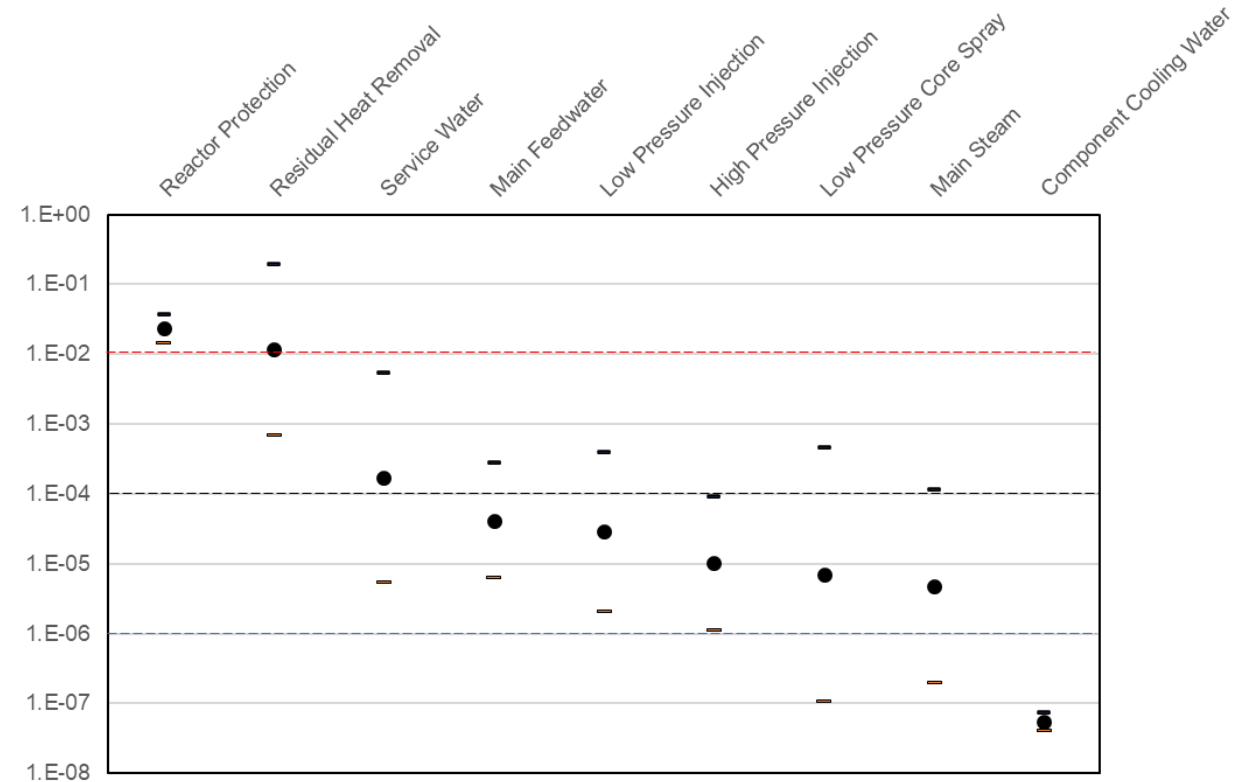

Tier List – Final Tier List

Fleetwide

| | |
|--------|-----------------------------------------------------------------------------------------------------------------|
| Tier X | Reactor Protection Emergency/Aux Feedwater |
| Tier 1 | High Pressure Injection Reactor Coolant Residual Heat Removal Service Water Component Cooling Water |
| Tier 2 | Low Pressure Injection Main Steam |
| Tier 3 | Main Feedwater Low Pressure Core Spray |

PWR

| | |
|--------|------------------------------------------------------------------------------------------------------|
| Tier X | Reactor Protection Emergency/Aux Feedwater |
| Tier 1 | Service Water High Pressure Injection Reactor Coolant Component Cooling Water Main Steam |
| Tier 2 | Low Pressure Injection Residual Heat Removal |
| Tier 3 | Main Feedwater |

BWR

| | |
|--------|---------------------------------------------------------------------------------------------|
| Tier X | Reactor Protection Residual Heat Removal |
| Tier 1 | Service Water |
| Tier 2 | Main Feedwater Low Pressure Injection |
| Tier 3 | High Pressure Injection Low Pressure Core Spray Main Steam Component Cooling Water |

Tier List – Takeaways

The Tier List is not directly applicable to individual plant reviews as there is large variability in risk significance from plant to plant for the same systems

The risk rankings are helpful to focus attention when looking at fleet-wide issues

The list is a tool to teach new staff about the importance of different systems



RIMA – Sampling Considerations

Expanded discussion of performance monitoring including framework to help identify target concepts supporting optimization of performance monitoring

Includes discussion of qualitative factors as well as a sample statistically driven sampling calculation

Leverage bathtub curve terminology to create common language for discussion



RIMA – Sampling Considerations

The following tables are initial thoughts regarding the impact of various considerations on necessary sampling.

✓ - Means a consideration likely indicates a particular column applies

↑ - Means a consideration increases emphasis

↓ - Means a consideration decreases emphasis

Color ↓ vs. ↓ implies a stronger or weaker association between a consideration and a particular column.

Sampling Considerations – Generic Life Stage

Generic life-stage determination table

| | Burn-in | Maturity | Wear-out |
|------------------------------------------|---------|----------|----------|
| Novel material, process, or design | ✓ | | |
| Novel repair | ✓ | | |
| Repair | ✓ | ✓ | |
| Novel degradation mechanism identified | ✓ | | ✓ |
| Novel degradation parameters (CGR, etc.) | ✓ | | ✓ |
| Degradation threatening function | | | ✓ |
| PSI only | ✓ | | |
| PSI + 1 interval of ISI | ✓ | | |
| PSI + more than 1 intervals of ISI | ✓ | ✓ | |

* Checks in multiple columns are “ors”

Sampling Considerations – Qualitative Factors

Qualitative factors affecting sampling intensity table

| | Component level sampling | Population Level sampling |
|---------------------------------------------------------|--------------------------|---------------------------|
| Burn-in | ✓ | ✓ |
| Maternity period | ✓ | ✓ |
| Wear-out | ✓ | ✓ |
| Safety related | ↑ | ↑ |
| RISC-2 (50.69 approved designation, system designation) | ↑ | ↑ |
| Consequence significant | ↑ | ↑ |
| Aging management program | ↑ | ↑ |
| Failure tolerant (LBB, etc.) | ↓ | |
| Low impact on other safety significant systems | ↓ | |
| Redundant | ↓ | |
| Isolable | ↓ | |

* Gray marks indicate that column should be considered but is not a priori necessary

Sampling Considerations – Emergent Events

Qualitative factors affecting sampling due to emerging events table

| | Component level sampling | Population level sampling | Site sampling expansion | Population sampling expansion |
|-----------------------------------------------------|--------------------------|---------------------------|-------------------------|-------------------------------|
| Site-specific event or chemistry issue | | ↑ | ↑ | |
| Novel indications identified at a single site | | | ↑ | ↑ |
| Novel indications identified at multiple sites | | | ↑ | ↑ |
| OE limitations (e.g. low coverages or other issues) | ↑ | ↑ | | |
| Extensive OE demonstrating no degradation | ↓ | ✓ | | |
| Extensive OE demonstrating limited degradation | ↓ | ✓ | | |
| Extensive OE demonstrating unmodeled degradation | ✓ | ✓ | ↑ | ↑ |
| Extensive OE demonstrating modeled degradation | ✓ | ✓ | | |

* Marks in multiple columns indicate row indicates multiple columns are applicable or should be considered

RIMA – Sampling Analysis

Quantitative sampling calculation can be derived from statistical calculations

For example, NRC staff leveraged this in support of review of PROMISE Code submittals

Detailed discussion of approach in PVP2023-105203, *Statistical Approach to Developing a Performance Monitoring Program*

Binomial Distribution

- The binomial distribution is frequently used to model the number of successes in a sample of size n drawn with replacement from a population of size N
- Can be used to find # of inspections needed to find a crack
- Only a function of the number of inspections and the % cracked
- Very easy to use (beware of limitations)

$$f(k, n, p) = \binom{n}{k} p^k (1 - p)^{n-k}$$

$$\binom{n}{k} = \frac{n!}{k! (n - k)!}$$

k = number of successes (cracks found)

n = number of trials (inspections)

p = probability of success on an individual trial
(% of population cracked)

If $k=0$ then this is the probability of no successes is:




$$f(n, p) = (1 - p)^n$$

and therefore, the probability of at least one success is:

$$1 - f(n, p)$$

Monte Carlo Analysis

- Same idea can be developed through a MC analysis
- Allows maximum flexibility in analysis
- Binomial response can be recreated

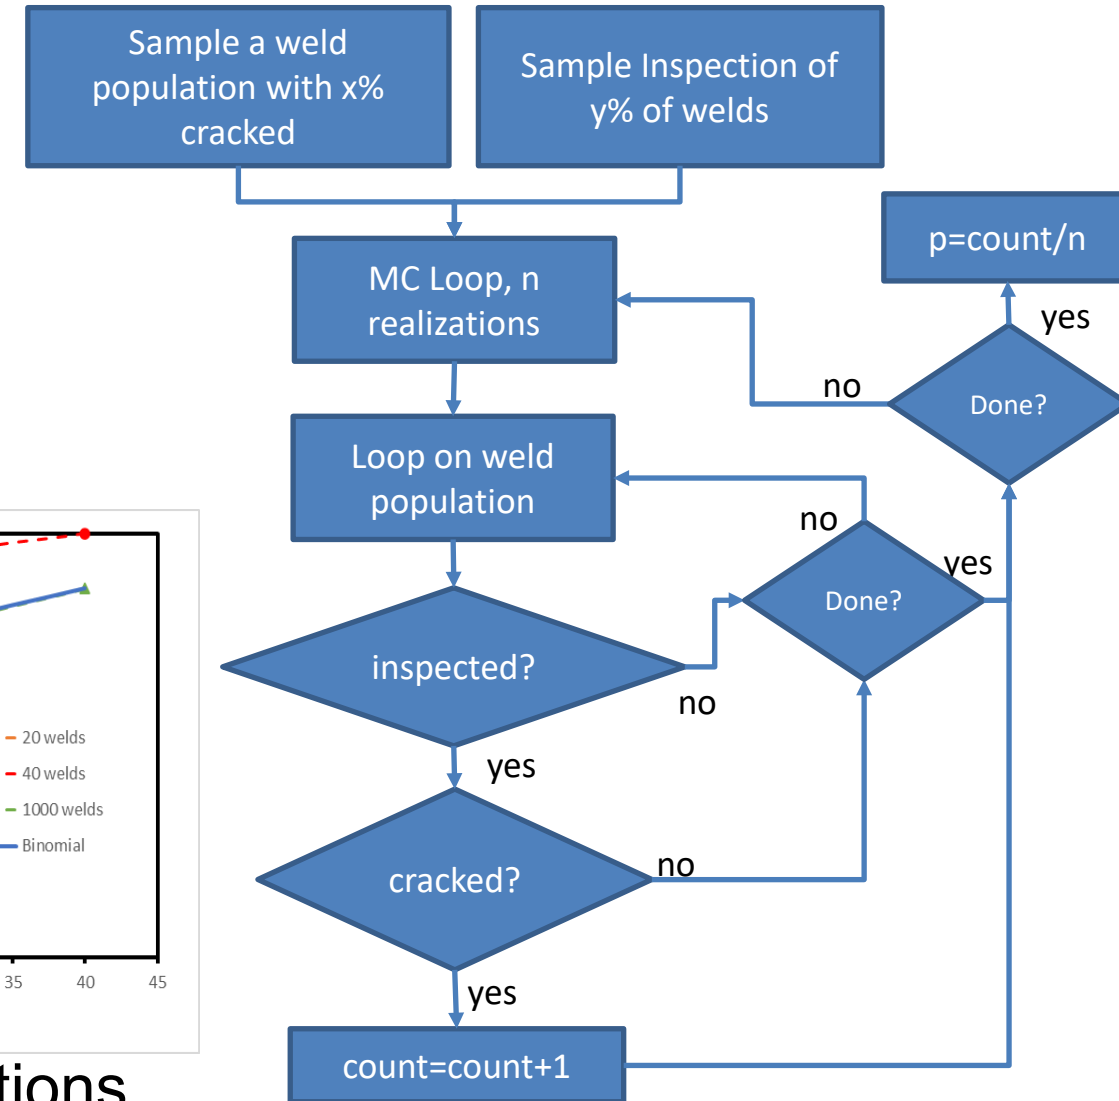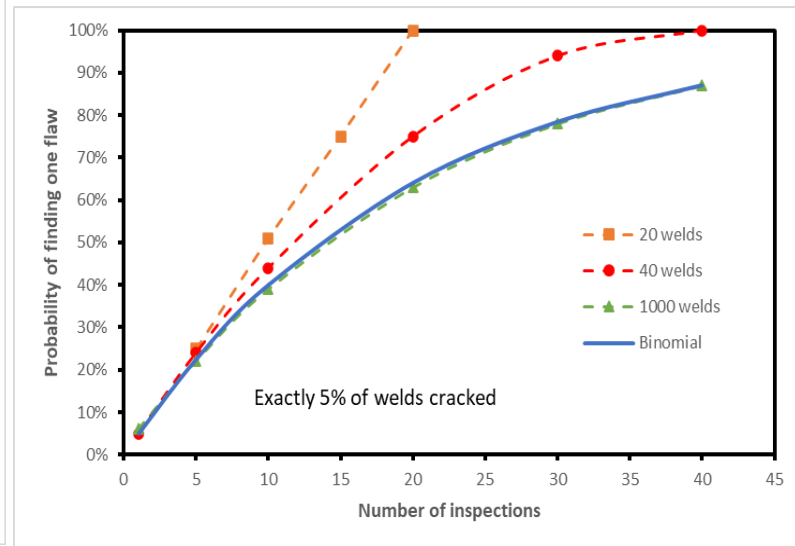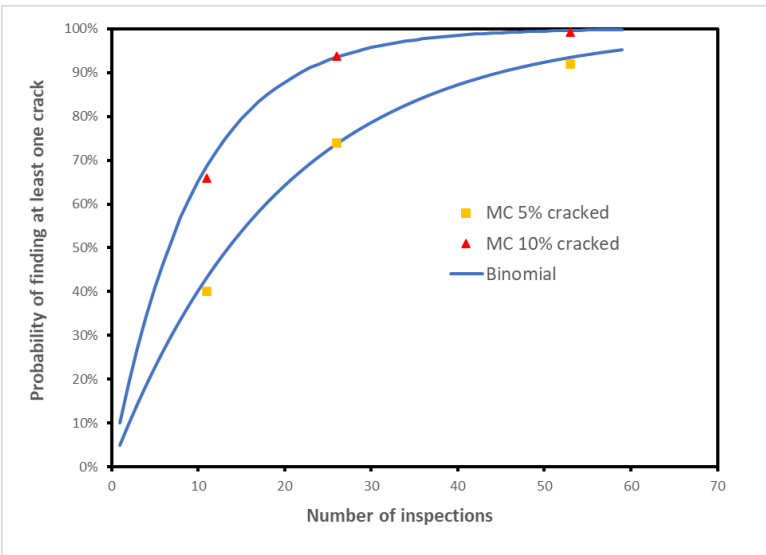

Large populations

For small populations

Sampling

Combining insights from Sampling Consideration slides with Sampling Analysis approaches allows for high quality proposals in performance monitoring space

Take Aways

RIMA Project aims to build forward from RG 1.174 and similar guidance in materials engineering specific language

Focus is on non-integrated (e.g. NRC materials engineer reviewer only) submittals

Guidance on all five Principles of RIDM to be translated and extended

Tier List and Sampling Considerations provide increased domain specific granularity of guidance

