

**PROPOSED APPENDIX B**

**APPROVED CONTENTS  
FOR THE MAGNASTOR SYSTEM**

**AMENDMENT NO. 8  
REVISION NO. 3**

## Appendix B Table of Contents

1.0	FUEL SPECIFICATIONS AND LOADING CONDITIONS.....	B1-1
2.0	FUEL TO BE STORED IN THE MAGNASTOR SYSTEM.....	B2-1

### List of Figures

Figure B2-1	Schematic of 37-Assembly PWR Basket.....	B2-13
Figure B2-2	Schematic of 37-Assembly PWR Basket Preferential Loading Patterns.....	B2-14
Figure B2-3	Schematic of DF Basket Assembly Configuration for PWR SNF with DFCs.....	B2-15
Figure B2-4	Schematic of 87-Assembly BWR Basket.....	B2-21
Figure B2-5	Schematic of 82-Assembly BWR Basket .....	B2-22
Figure B2-6	BWR Partial Length Fuel Rod Location Sketches.....	B2-23

### List of Tables

Table B2-1	TSC with PWR Fuel Limits .....	B2-2
Table B2-2	PWR Fuel Assembly Characteristics.....	B2-7
Table B2-3	Bounding PWR Fuel Assembly Loading Criteria .....	B2-8
Table B2-4	Bounding PWR Fuel Assembly Loading Criteria – Enrichment/Soluble Boron Limits .....	B2-9
Table B2-5	Additional SNF Assembly Cool Time Required to Load NONFUEL HARDWARE .....	B2-10
Table B2-6	Allowed BPAA/NSA Burnup and Cool Time Combinations.....	B2-11
Table B2-7	Allowed GTPD/NSA Burnup and Cool Time Combinations.....	B2-11
Table B2-8	PWR Fuel Preferential Loading Pattern Definitions.....	B2-12
Table B2-9	TSC with BWR Fuel Limits .....	B2-16
Table B2-10	BWR SNF Assembly Characteristics.....	B2-18
Table B2-11	BWR SNF Assembly Loading Criteria .....	B2-19
Table B2-12	BWR SNF Assembly Loading Criteria – Enrichment Limits for 87-Assembly and 82-Assembly Configurations.....	B2-20
Table B2-13	PWR Loading Table – Low SNF Assembly Average Burnup Enrichment Limits .....	B2-24
Table B2-14	BWR Loading Table – Low SNF Assembly Average Burnup Enrichment Limits .....	B2-24
Table B2-15	Loading Table for PWR Fuel – 959 W/Assembly .....	B2-25
Table B2-16	Loading Table for PWR Fuel – 911 W/Assembly .....	B2-30
Table B2-17	Loading Table for PWR Fuel – 1,200 W/Assembly .....	B2-38
Table B2-18	Loading Table for PWR Fuel – 1,140 W/Assembly .....	B2-43
Table B2-19	Loading Table for PWR Fuel – 922 W/Assembly .....	B2-51
Table B2-20	Loading Table for PWR Fuel – 876 W/Assembly .....	B2-56
Table B2-21	Loading Table for PWR Fuel – 800 W/Assembly .....	B2-64
Table B2-22	Loading Table for PWR Fuel – 760 W/Assembly .....	B2-69
Table B2-23	Loading Table for BWR Fuel – 379 W/Assembly .....	B2-77
Table B2-24	Loading Table for BWR Fuel – 360 W/Assembly .....	B2-82
Table B2-25	Loading Table for PWR Fuel – 959 W/Assembly – WE 14x14 Fuel.....	B2-90

**Appendix B**  
**Table of Contents (continued)**

Table B2-26	Loading Table for PWR Fuel – 513 W/Assembly – WE 14x14 Fuel.....	B2-93
Table B2-27	Loading Table for PWR Fuel – 1300 W/Assembly – WE 14x14 Fuel.....	B2-96
Table B2-28	Loading Table for PWR Fuel – 1800 W/Assembly – WE 14x14 Fuel.....	B2-99
Table B2-29	Loading Table for PWR Fuel – 830 W/Assembly – WE 14x14 Fuel.....	B2-102
Table B2-30	Loading Table for PWR Fuel – 487 W/Assembly – WE 14x14 Fuel.....	B2-105
Table B2-31	Loading Table for PWR Fuel – 1235 W/Assembly – WE 14x14 Fuel.....	B2-108
Table B2-32	Loading Table for PWR Fuel – 1710 W/Assembly – WE 14x14 Fuel.....	B2-111
Table B2-33	Loading Table for PWR Fuel – 788 W/Assembly – WE 14x14 Fuel.....	B2-114
Table B2-34	Loading Table for PWR Fuel – 513 W/Assembly – CE 16x16 Fuel .....	B2-117
Table B2-35	Loading Table for PWR Fuel – 1300 W/Assembly – CE 16x16 Fuel .....	B2-120
Table B2-36	Loading Table for PWR Fuel – 1800 W/Assembly – CE 16x16 Fuel .....	B2-123
Table B2-37	Loading Table for PWR Fuel – 830 W/Assembly – CE 16x16 Fuel .....	B2-126
Table B2-38	Loading Table for PWR Fuel – 487 W/Assembly – CE 16x16 Fuel .....	B2-129
Table B2-39	Loading Table for PWR Fuel – 1235 W/Assembly – CE 16x16 Fuel .....	B2-132
Table B2-40	Loading Table for PWR Fuel – 1710 W/Assembly – CE 16x16 Fuel .....	B2-135
Table B2-41	Loading Table for PWR Fuel – 788 W/Assembly – CE 16x16 Fuel .....	B2-138
Table B2-42	Low SNF Assembly Average Burnup Enrichment Limits for CE 16x16 Fuel Loaded via the PMTC .....	B2-141
Table B2-43	Loading Table for CE 16x16 Fuel Loaded via the PMTC .....	B2-141

## 1.0 FUEL SPECIFICATIONS AND LOADING CONDITIONS

---

The MAGNASTOR SYSTEM is designed to safely store up to 37 undamaged PWR fuel assemblies in the 37 PWR Basket Assembly or up to 87 undamaged BWR fuel assemblies in the 87 BWR Basket Assembly. The system is also designed to store up to 4 damaged fuel cans (DFCs) in the DF Basket Assembly. The DF Basket Assembly has a capacity of up to 37 undamaged PWR fuel assemblies including 4 DFC locations. DFCs may be placed in up to 4 of the DFC locations. Each DFC may contain an undamaged PWR fuel assembly, a damaged PWR fuel assembly, or PWR FUEL DEBRIS equivalent to one PWR fuel assembly. FUEL DEBRIS is included in the definition of DAMAGED FUEL (Appendix A, Section 1.1). PWR UNDAMAGED FUEL assemblies may be placed directly in the DFC locations of a DF Basket Assembly without the use of a DFC.

The system requires few operating controls. The principal controls and limits for MAGNASTOR are satisfied by the selection of fuel for storage that meets the Approved Contents presented in this section and in the tables for MAGNASTOR design basis spent fuels.

If any Fuel Specification or Loading Condition of this section is violated, the following actions shall be completed:

- The affected fuel assemblies shall be placed in a safe condition.
- Within 24 hours, notify the NRC Operations Center.
- Within 60 days, submit a special report that describes the cause of the violation and actions taken to restore or demonstrate compliance and prevent reoccurrence.

**2.0 FUEL TO BE STORED IN THE MAGNASTOR SYSTEM**

---

UNDAMAGED PWR FUEL ASSEMBLIES, DAMAGED PWR FUEL ASSEMBLIES, PWR FUEL DEBRIS (DAMAGED FUEL), UNDAMAGED BWR FUEL ASSEMBLIES and NONFUEL HARDWARE meeting the limits specified in Tables B2-1 through B2-43 may be stored in the MAGNASTOR SYSTEM.

**Table B2-1 TSC with PWR Fuel Limits**

I.	TSC with PWR Fuel Basket	
A.	Allowable Contents	
1.	Uranium PWR UNDAMAGED FUEL ASSEMBLIES listed in Tables B2-2 and B2-3 and meeting the following specifications:	
a.	Cladding Type:	Zirconium-based alloy.
b.	Enrichment, Post-irradiation Cooling Time and Average Assembly Burnup:	Generic maximum enrichment limits are shown in Table B2-2. The physical characteristics of the different PWR SNF ASSEMBLIES are defined in Table B2-3. The fuel type specific maximum enrichments as a function of neutron absorber sheet areal density at various minimum soluble boron levels are defined in Table B2-4. For variable enrichment SNF assemblies, maximum enrichments represent peak rod enrichments. Combined minimum enrichment, maximum SNF assembly average burnup and minimum cool time limits are shown generically in Tables B2-15 through B2-22 and specifically for WE 14x14 in Tables B2-25 through B2-33 and CE 16x16 in Tables B2-34 through B2-41. For SNF assembly average burnup levels below those shown in Tables B2-15 through B2-22, an SNF assembly minimum cool time is specified generically in Table B2-13, provided that the minimum initial SNF assembly average enrichment limits are applied. The minimum cool times for fuel in TSCs transferred via the PMTC are specified in Tables B2-42 and B2-43.
c.	Decay Heat Per SNF Assembly	
	1) Preferential Loading:	≤ 1,200 watts <sup>a</sup>
	2) Uniform Loading:	≤ 959 watts <sup>b</sup>
d.	Nominal Fresh Fuel Assembly Length (in.):	≤ 178.3
e.	Nominal Fresh Fuel Assembly Width (in.):	≤ 8.54
f.	Weight Per Storage Location (lbs.):	≤ 1,765, including SNF Assembly, NONFUEL HARDWARE and fuel spacers
g.	Total Canister Weight (lbs.):	≤ 62,160, including SNF Assemblies, NONFUEL HARDWARE and fuel spacers
B.	Quantity per TSC: Up to 37 PWR UNDAMAGED SNF ASSEMBLIES as shown in Figure B2-1.	

(continued)

<sup>a</sup> 1,800 Watts for the four-zone preferential loading with WE 14x14 and CE 16x16 fuel

<sup>b</sup> 811 Watts for the PMTC with CE 16x16 fuel only

**Table B2-1 TSC with PWR Fuel Limits (continued)**

- C. PWR UNDAMAGED SNF ASSEMBLIES may contain NONFUEL HARDWARE. SNF assembly lattices possessing less than the nominal number of undamaged fuel rods specified in Table B2-3 must contain solid filler rods that displace a volume equal to, or greater than, that of the fuel rod that the filler rod replaces. SNF assemblies may have stainless steel rods inserted to displace guide tube “dashpot” water. NONFUEL HARDWARE cool times shall be in accordance with Tables B2-5, B2-6, and B2-7. Alternatively, the <sup>60</sup>Co curie limits in Tables B2-6 and B2-7 may be used to establish site-specific NONFUEL HARDWARE constraints.
- D. Spacers may be used in a TSC to axially position SNF assemblies to facilitate handling and operations.
- E. Unenriched fuel assemblies and unirradiated (i.e., not inserted in-core) fuel assemblies are not authorized for loading. Low enriched, unenriched, and/or annular fuel pellet axial end blankets are permitted, provided that the nominal length of the blanket is not greater than six (6) inches.
- F. SNF may be loaded uniformly at a maximum heat load of 959 watts/assembly (Figure B2-1). Alternatively, a preferential loading pattern may be applied as described in Table B2-8 and Figure B2-2. TSCs to be transferred via the PMTC may be loaded at a maximum heat load of 811 watts/assembly.
- G. RCCs are restricted to fuel storage locations No. 11, 12, 13, 18, 19, 20, 25, 26 and 27 (Figure B2-1). Minimum RCC cool times are:

Minimum Cool Time (years)	Maximum Exposure (GWd/MTU)
10 <sup>a</sup>	180
14	270
20	360

- H. One Neutron Source, or Neutron Source Assembly (NSA) is permitted to be loaded in a TSC in fuel storage locations No. 11, 12, 13, 18, 19, 20, 25, 26, or 27 (Figure B2-1). Neutron source assemblies may contain source rods attached to hardware similar in configuration to guide tube plug devices (thimble plugs) and burnable absorbers, in addition to containing burnable poison rodlets and/or thimble plug rodlets. For NSAs containing absorber rodlets, the BPAA cool time and burnup/exposure or hardware <sup>60</sup>Co curie limit listed in Table B2-6 are applied to the neutron sources. NSAs having only thimble plug rodlets require the thimble plug restriction in Table B2-7 to be applied. Combination NSAs, containing both thimble plug and burnable absorber rodlets must apply the more limiting of the two minimum cool time/curie limit.
- I. Fuel assemblies may contain any number of unirradiated (i.e., not inserted in-core) nonfuel solid filler fuel replacement rods. Activated stainless steel rods are limited to 5 per assembly at a maximum burnup/exposure of 32.5 GWd/MTU. Fuel assemblies may contain an HFRA at a maximum burnup/exposure of 4.0 GWd/MTU and a minimum cool time of 16 years

(continued)

<sup>a</sup> 2.5 years for the WE 14x14 RCC in uniform and four-zone preferential loading and 5.0 years for the CE 16x16 RCC in uniform and four-zone preferential loading (footnote not applicable for PMTC payloads)

**Table B2-1 TSC with PWR Fuel Limits (continued)**

II. TSC with DF Basket Assembly	
A. Allowable Contents	
1. Uranium PWR UNDAMAGED SNF ASSEMBLIES and DAMAGED FUEL (PWR DAMAGED SNF ASSEMBLIES or PWR FUEL DEBRIS) listed in Tables B2-2 and B2-3 and meeting the following specifications:	
a. Cladding Type:	Zirconium-based alloy.
b. Enrichment, Post-irradiation Cooling Time and Average Assembly Burnup:	Generic maximum enrichment limits are shown in Table B2-2. The physical characteristics of the different PWR SNF ASSEMBLIES are defined in Table B2-3. The fuel type specific maximum enrichments as a function of neutron absorber sheet areal density at various minimum soluble boron levels are defined in Table B2-4. For variable enrichment SNF assemblies, maximum SNF enrichments represent peak rod enrichments. Combined minimum enrichment, maximum SNF assembly average burnup and minimum cool time limits are shown generically in Tables B2-15 through B2-22 and specifically for WE 14x14 in Tables B2-25 through B2-33 and CE 16x16 in Tables B2-34 through B2-41. For SNF assembly average burnup levels below those shown in Tables B2-15 through B2-22, an SNF assembly minimum cool time is specified generically in Table B2-13, provided that the minimum initial SNF assembly average enrichment limits are applied. The minimum cool times for fuel in TSCs transferred via the PMTC are specified in Tables B2-42 and B2-43.
c. Decay Heat Per SNF Assembly	
1). Preferential Loading:	≤ 1,200 watts <sup>a</sup>
2). Uniform Loading:	≤ 959 watts <sup>b</sup>
d. Nominal Fresh SNF Assy: Length (in)	≤ 178.3
e. Nominal Fresh SNF Assembly Width (in.):	≤ 8.54
f. Weight Per Storage location (lbs.)	≤ 1,765, including SNF Assembly, NONFUEL HARDWARE, DFC and fuel spacer
g. Total Canister Contents Weight (lbs.)	≤ 61,184, including SNF Assemblies, NONFUEL HARDWARE, DFCs and fuel spacers

(continued)

<sup>a</sup> 1,800 Watts for the four-zone preferential loading with WE 14x14 and CE 16x16 fuel

<sup>b</sup> 811 Watts for the PMTC with CE 16x16 fuel only

<sup>c</sup> Nominal TSC weight plus maximum contents ≤ 104,500 lbs.

**Table B2-1 TSC with PWR Fuel Limits (continued)**

- B. Quantity per TSC: Up to a total of 37 PWR UNDAMAGED SNF ASSEMBLIES including up to four (4) DFCs containing PWR UNDAMAGED SNF ASSEMBLIES, PWR DAMAGED SNF ASSEMBLIES, and/or PWR FUEL DEBRIS loaded in the DFC locations No. 4, 8, 30 and 34, as shown on Figure B2-3, for the DF Basket Assembly.
- C. The contents of a DFC must be less than, or equivalent to, one PWR UNDAMAGED SNF ASSEMBLY. PWR SNF ASSEMBLIES loaded in a DFC shall not contain NONFUEL HARDWARE with the exception of instrument tube tie components, guide tube anchors or similar devices, and steel inserts.
- D. PWR UNDAMAGED SNF ASSEMBLIES not loaded in a DFC may contain NONFUEL HARDWARE consistent with Table B2-5. SNF assembly lattices not containing the nominal number of fuel rods specified in Table B2-3 must contain solid filler rods that displace a volume equal to, or greater than, that of the fuel rod that the filler rod replaces. SNF assemblies may have stainless steel rods inserted to displace guide tube “dashpot” water. NONFUEL HARDWARE cool times shall be in accordance with Tables B2-5, B2-6, and B2-7. Alternatively, the <sup>60</sup>Co curie limits in Tables B2-6 and B2-7 may be used to establish site-specific NONFUEL HARDWARE constraints. Alternatively, the <sup>60</sup>Co curie limits in Tables B2-6 and B2-7 may be used to establish site-specific NONFUEL HARDWARE constraints.
- E. Spacers may be used in a TSC to axially position PWR UNDAMAGED SNF ASSEMBLIES, and DFCs to facilitate handling and operation.
- F. Unenriched fuel assemblies and unirradiated (i.e., not inserted in-core) fuel assemblies are not authorized for loading. Low enriched, unenriched, and/or annular fuel pellet axial end blankets are permitted, provided that the nominal length of the end blanket is not greater than six (6) inches.
- G. RCCs are restricted to fuel storage locations No. 11, 12, 13, 18, 19, 20, 25, 26 and 27 (Figure B2-3). Minimum RCC cool times are:

Minimum Cool Time (years)	Maximum Exposure (GWd/MTU)
10 <sup>a</sup>	180
14	270
20	360

(continued)

<sup>a</sup> 2.5 years for the WE 14x14 RCC in uniform and four-zone preferential loading and 5.0 years for the CE 16x16 RCC in uniform and four-zone preferential loading (footnote not applicable for PMTC payloads)

**Table B2-1 TSC with PWR Fuel Limits (continued)**

---

- H. One Neutron Source, or Neutron Source Assembly (NSA) is permitted to be loaded in a TSC in fuel storage locations No. 11, 12, 13, 18, 19, 20, 25, 26 or 27 (Figure B2-1). Neutron source assemblies may contain source rods attached to hardware similar in configuration to guide tube plug devices (thimble plugs) and burnable absorbers, in addition to containing burnable poison rodlets and/or thimble plug rodlets. For NSAs containing absorber rodlets, the BPAA cool time and burnup/exposure or hardware  $^{60}\text{Co}$  curie limit listed in Table B2-6 are applied to the neutron sources. NSAs having only thimble plug rodlets require the thimble plug restriction in Table B2-7 to be applied. Combination NSAs, containing both thimble plug and burnable absorber rodlets must apply the more limiting of the two minimum cool time/curie limit.
- I. Fuel assemblies may contain any number of unirradiated (i.e., not inserted in-core) nonfuel solid filler fuel replacement rods. Activated stainless steel rods are limited to 5 per assembly at a maximum burnup/exposure of 32.5 GWd/MTU.
- J. Fuel assemblies may contain an HFRA at a maximum burnup/exposure of 4.0 GWd/MTU and a minimum cool time of 16 years.

**Table B2-2 PWR Fuel Assembly Characteristics**

Characteristic	14x14	14x14	15x15	15x15	16x16	17x17
Max Initial Enrichment (wt % <sup>235</sup> U)	5.0	5.0	5.0	5.0	5.0	5.0
Min Initial Enrichment (wt % <sup>235</sup> U)	1.3	1.3	1.3	1.3	1.3	1.3
Number of Fuel Rods	176	179	204	208	236	264
Max Assembly Average Burnup (MWd/MTU)	60,000	60,000	60,000	60,000	60,000	60,000
Peak Average Rod Burnup (MWd/MTU)	62,500	62,500	62,500	62,500	62,500	62,500
Min Cool Time (years)	4	4 <sup>2</sup>	4	4	4	4
Max Weight (lb) per Storage Location	See Note 1	See Note 1	See Note 1	See Note 1	See Note 1	See Note 1
Max Decay Heat (Watts) per Preferential Storage Location	1,200	1,800	1,200	1,200	1,800	1,200

- All reported enrichment values are nominal preirradiation fabrication values.
- Maximum initial enrichment is based on a minimum soluble boron concentration in the spent fuel pool water. Required soluble boron content is fuel type and enrichment specific. Minimum soluble boron content varies between 1,500 and 2,500 ppm. Maximum initial enrichment represents the peak fuel rod enrichment for variably-enriched fuel assemblies.

**Notes:**

1. Maximum weight per storage location is as detailed in Table B2-1
2. Minimum cool time of 2.5 years for WE 14x14 PWR fuel for uniform and four-zone preferential loading

**Table B2-3 Bounding PWR Fuel Assembly Loading Criteria**

Assembly Type	No. of Fuel Rods	No. of Guide Tubes <sup>1</sup>	Geometry <sup>2</sup>					
			Max Pitch (inch)	Min Clad OD (inch)	Min Clad Thick. (inch)	Max Pellet OD (inch)	Max Active Length (inch)	Max Load (MTU)
BW15H1	208	17	0.568	0.43	0.0265	0.3686	144.0	0.4858
BW15H2	208	17	0.568	0.43	0.025	0.3735	144.0	0.4988
BW15H3	208	17	0.568	0.428	0.023	0.3742	144.0	0.5006
BW15H4	208	17	0.568	0.414	0.022	0.3622	144.0	0.4690
BW17H1	264	25	0.502	0.377	0.022	0.3252	144.0	0.4799
CE14H1	176	5	0.58	0.44	0.026	0.3805	137.0	0.4167
CE16H1	236	5	0.5063	0.382	0.025	0.3255	150.0	0.4463
WE14H1	179	17	0.556	0.40	0.0162	0.3674	145.2	0.4188
WE15H1	204	21	0.563	0.422	0.0242	0.3669	144.0	0.4720
WE15H2	204	21	0.563	0.417	0.0265	0.357	144.0	0.4469
WE17H1	264	25	0.496	0.372	0.0205	0.3232	144.0	0.4740
WE17H2	264	25	0.496	0.36	0.0225	0.3088	144.0	0.4327

<sup>1</sup> Combined number of guide and instrument tubes.

<sup>2</sup> Assembly characteristics represent cold, unirradiated, nominal configurations.

Note: Amendment No. 2 removed the enrichment/soluble boron limits from this table, along with the note pertaining to them. This information is now presented in Table B2-4.

**Table B2-4 Bounding PWR Fuel Assembly Loading Criteria –  
Enrichment/Soluble Boron Limits**

**TSC with Undamaged PWR Fuel Basket Assembly Max. Initial Enrichment ( wt % <sup>235</sup>U)**

Soluble Boron	Absorber <sup>a</sup> 0.036 <sup>10</sup> B g/cm <sup>2</sup>					Absorber <sup>a</sup> 0.030 <sup>10</sup> B g/cm <sup>2</sup>					Absorber <sup>a</sup> 0.027 <sup>10</sup> B g/cm <sup>2</sup>				
	1500 (ppm)	1750 (ppm)	2000 (ppm)	2250 (ppm)	2500 (ppm)	1500 (ppm)	1750 (ppm)	2000 (ppm)	2250 (ppm)	2500 (ppm)	1500 (ppm)	1750 (ppm)	2000 (ppm)	2250 (ppm)	2500 (ppm)
BW15H1	3.7%	4.1%	4.4%	4.7%	5.0%	3.6%	4.0%	4.2%	4.5%	4.8%	3.6%	3.9%	4.2%	4.5%	4.8%
BW15H2	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.5%	4.8%	3.6%	3.8%	4.1%	4.4%	4.7%
BW15H3	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.4%	4.7%	3.5%	3.8%	4.1%	4.4%	4.7%
BW15H4	3.8%	4.2%	4.5%	4.8%	5.0%	3.7%	4.1%	4.4%	4.7%	5.0%	3.7%	4.0%	4.3%	4.6%	5.0%
BW17H1	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.5%	4.8%	3.6%	3.9%	4.1%	4.5%	4.7%
CE14H1	4.5%	4.8%	5.0%	5.0%	5.0%	4.3%	4.7%	5.0%	5.0%	5.0%	4.3%	4.6%	5.0%	5.0%	5.0%
CE16H1	4.4%	4.8%	5.0%	5.0%	5.0%	4.3%	4.6%	5.0%	5.0%	5.0%	4.2%	4.6%	4.9%	5.0%	5.0%
WE14H1	4.7%	5.0%	5.0%	5.0%	5.0%	4.6%	5.0%	5.0%	5.0%	5.0%	4.5%	5.0%	5.0%	5.0%	5.0%
WE15H1	3.8%	4.2%	4.5%	4.8%	5.0%	3.7%	4.1%	4.4%	4.7%	5.0%	3.7%	4.0%	4.3%	4.6%	4.9%
WE15H2	4.0%	4.4%	4.7%	5.0%	5.0%	3.9%	4.2%	4.6%	4.9%	5.0%	3.8%	4.2%	4.5%	4.8%	5.0%
WE17H1	3.7%	4.1%	4.4%	4.7%	5.0%	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.5%	4.9%
WE17H2	4.0%	4.3%	4.7%	5.0%	5.0%	3.9%	4.3%	4.6%	4.9%	5.0%	3.8%	4.2%	4.5%	4.9%	5.0%

**TSC with Damaged PWR Fuel Basket Assembly Max. Initial Enrichment ( wt % <sup>235</sup>U)**

BW15H1	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.5%	4.7%	3.6%	3.8%	4.1%	4.4%	4.7%
BW15H2	3.6%	3.9%	4.2%	4.5%	4.8%	3.6%	3.8%	4.1%	4.4%	4.7%	3.5%	3.8%	4.1%	4.3%	4.6%
BW15H3	3.6%	3.9%	4.2%	4.5%	4.8%	3.5%	3.8%	4.1%	4.4%	4.6%	3.5%	3.8%	4.0%	4.3%	4.6%
BW15H4	3.8%	4.1%	4.4%	4.7%	5.0%	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.5%	4.8%
BW17H1	3.6%	3.9%	4.2%	4.5%	4.8%	3.6%	3.9%	4.1%	4.4%	4.7%	3.5%	3.8%	4.1%	4.4%	4.6%
CE14H1	4.4%	4.8%	5.0%	5.0%	5.0%	4.3%	4.7%	5.0%	5.0%	5.0%	4.3%	4.6%	4.9%	5.0%	5.0%
CE16H1	4.4%	4.7%	5.0%	5.0%	5.0%	4.2%	4.6%	5.0%	5.0%	5.0%	4.2%	4.5%	4.9%	5.0%	5.0%
WE14H1	4.6%	5.0%	5.0%	5.0%	5.0%	4.5%	5.0%	5.0%	5.0%	5.0%	4.5%	4.9%	5.0%	5.0%	5.0%
WE15H1	3.8%	4.1%	4.4%	4.7%	5.0%	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	4.0%	4.3%	4.6%	4.8%
WE15H2	3.9%	4.3%	4.6%	4.9%	5.0%	3.8%	4.2%	4.5%	4.8%	5.0%	3.8%	4.1%	4.4%	4.7%	5.0%
WE17H1	3.7%	4.0%	4.3%	4.6%	4.9%	3.6%	3.9%	4.2%	4.5%	4.8%	3.6%	3.9%	4.2%	4.5%	4.8%
WE17H2	3.9%	4.3%	4.6%	5.0%	5.0%	3.9%	4.2%	4.5%	4.9%	5.0%	3.8%	4.1%	4.5%	4.8%	5.0%

- Specified soluble boron concentrations are independent of whether an assembly contains a nonfuel insert.

<sup>a</sup> Borated aluminum neutron absorber sheet effective areal <sup>10</sup>B density.

**Table B2-5 Additional SNF Assembly Cool Time Required to Load NONFUEL HARDWARE**

Assy		Uniform	Three-Zone			Four-Zone			
			A	B	C	A	B1	B2	C
CE 14x14	BPAA/HFRA	--	--	--	--	--	--	--	--
	GTPD/NSA	--	--	--	--	--	--	--	--
	RCC	0.2	0.2	0.1	0.2	--	--	--	--
WE 14x14	BPAA/HFRA	0.5	0.5	0.2	0.7	1.4	0.1	0.1	0.7
	GTPD/NSA	0.1	0.1	0.1	0.1	0.2	0.1	0.1	0.1
	RCC <sup>1</sup>	0.7	2.3	0.7	4.1	2.2	0.2	0.1	1.0
WE 15x15	BPAA/HFRA	0.5	0.6	0.2	0.8	--	--	--	--
	GTPD/NSA	0.1	0.1	0.1	0.1	--	--	--	--
	RCC	3.1	3.4	1.5	4.5	--	--	--	--
B&W 15x15	BPAA/HFRA	0.1	0.1	0.1	0.1	--	--	--	--
	GTPD/NSA	0.1	0.1	0.1	0.1	--	--	--	--
	RCC	0.2	0.2	0.1	0.2	--	--	--	--
CE 16x16	BPAA/HFRA	--	--	--	--	--	--	--	--
	GTPD/NSA	--	--	--	--	--	--	--	--
	RCC <sup>2</sup>	0.4 <sup>3</sup>	0.2	0.1	0.3	0.8	0.1	0.1	0.4
WE 17x17	BPAA/HFRA	0.5	0.6	0.2	0.7	--	--	--	--
	GTPD/NSA	0.1	0.1	0.1	0.1	--	--	--	--
	RCC	2.9	3.3	1.4	4.3	--	--	--	--
B&W 17x17	BPAA/HFRA	0.1	0.1	0.1	0.1	--	--	--	--
	GTPD/NSA	0.1	0.1	0.1	0.1	--	--	--	--
	RCC	0.2	0.2	0.1	0.2	--	--	--	--

Note: Additional SNF assembly cooling time to be added to the minimum SNF assembly cool time based on SNF assembly initial enrichment and SNF assembly average burnup listed in Tables B2-15 through B2-22 and B2-25 through B2-43.

<sup>1</sup> WE14x14 Uniform and four-zone preferential are evaluated using RCC with 2.5-year minimum cool time

<sup>2</sup> CE16x16 Uniform and four-zone preferential are evaluated using RCC with 5-year minimum cool time

<sup>3</sup> 0.4 years for RCC in the PMTC (reduced storage location heat load). For all other cask types, 0.2 years for RCC with 10-year minimum cool time.

**Table B2-6 Allowed BPAA/NSA Burnup and Cool Time Combinations**

Maximum Burnup (GWd/MTU)	Minimum Cool Time (yrs)				
	WE 14×14	WE 15×15	B&W 15×15	WE 17×17	B&W 17×17
10	0.5	0.5	0.5	0.5	0.5
15	0.5	0.5	0.5	0.5	0.5
20	0.5	1.0	2.0	2.0	0.5
25	1.0	2.5	3.5	3.5	1.0
30	2.5	4.0	5.0	5.0	2.5
32.5	3.0	4.5	6.0	6.0	3.0
35	3.5	5.0	6.0	6.0	3.5
37.5	4.0	6.0	7.0	7.0	4.0
40	4.5	6.0	7.0	7.0	4.5
45	5.0	7.0	8.0	8.0	6.0
50	6.0	8.0	9.0	9.0	7.0
55	7.0	8.0	10.0	9.0	7.0
60	7.0	9.0	10.0	10.0	8.0
65	8.0	10.0	12.0	12.0	8.0
70	8.0	10.0	12.0	12.0	9.0
Max <sup>60</sup> Co Activity (Ci)	718	733	19	637	26

Note: Specified minimum cool times for BPRAs are independent of the required minimum cool times for the fuel assembly containing the BPRA.

**Table B2-7 Allowed GTPD/NSA Burnup and Cool Time Combinations**

Maximum Burnup (GWd/MTU)	Minimum Cool Time (yrs)				
	WE 14×14	WE 15×15	B&W 15×15	WE 17×17	B&W 17×17
45	2.0	3.5	7.0	5.0	6.0
90	6.0	7.0	10.0	9.0	10.0
135	7.0	9.0	12.0	10.0	12.0
180	8.0	9.0	14.0	12.0	12.0
<sup>60</sup> Co Activity (Ci)	63.5	64.1	56.9	64.0	63.6

Note: Specified minimum cool times for thimble plugs are independent of the required minimum cool times for the fuel assembly containing the thimble plug.

**Table B2-8 PWR Fuel Preferential Loading Pattern Definitions**

**Three-Zone**

<b>Zone Description (see Figure B2-2)</b>	<b>Designator</b>	<b>Maximum Heat Load (W/assy)</b>	<b># Assemblies</b>
Inner Zone	A	922	9
Middle Zone	B	1,200	12
Outer Zone	C	800	16

**Four-Zone**

<b>Zone Description (see Figure B2-2)</b>	<b>Designator</b>	<b>Maximum Heat Load (W/assy)</b>	<b># Assemblies</b>
Inner Zone	A	513	9
Middle Zone	B1	1,300	8
	B2	1,800	4
Outer Zone	C	830	16

Figure B2-1 Schematic of 37-Assembly PWR Basket




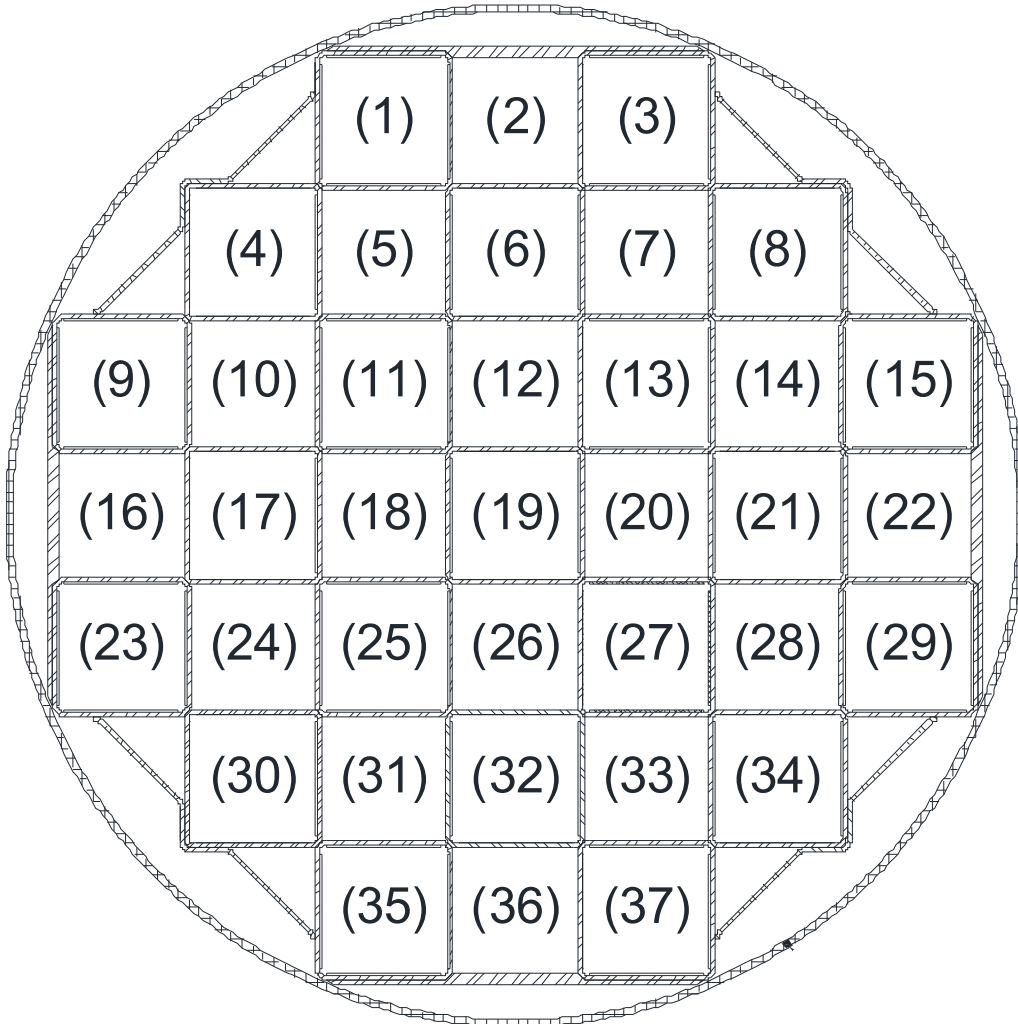


Figure B2-2 Schematic of 37-Assembly PWR Basket Preferential Loading Patterns

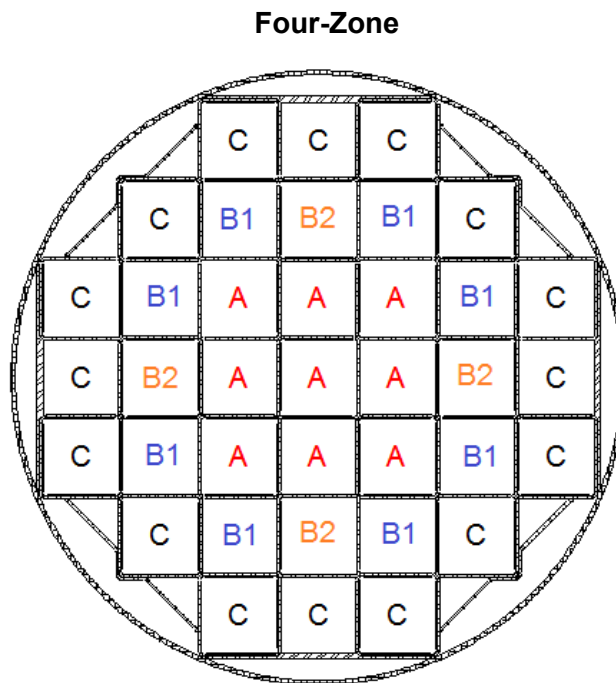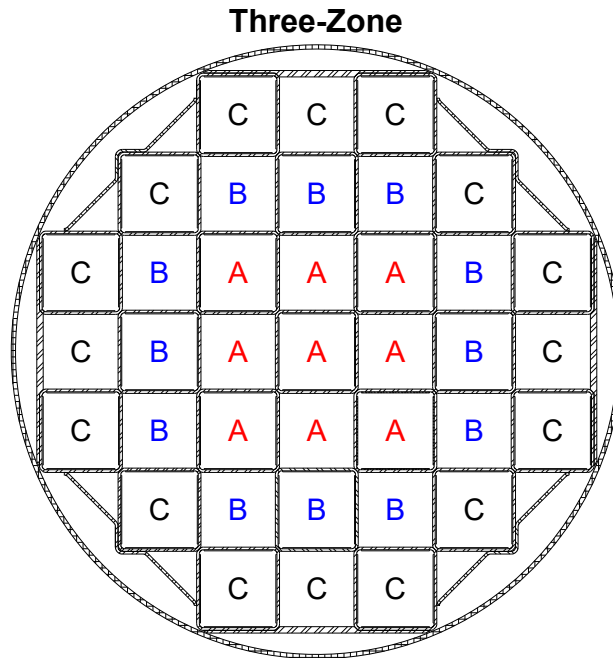

Refer to Table B2-8 for Maximum Heat Loads

Figure B2-3 Schematic of DF Basket Assembly Configuration for PWR SNF with DFCs

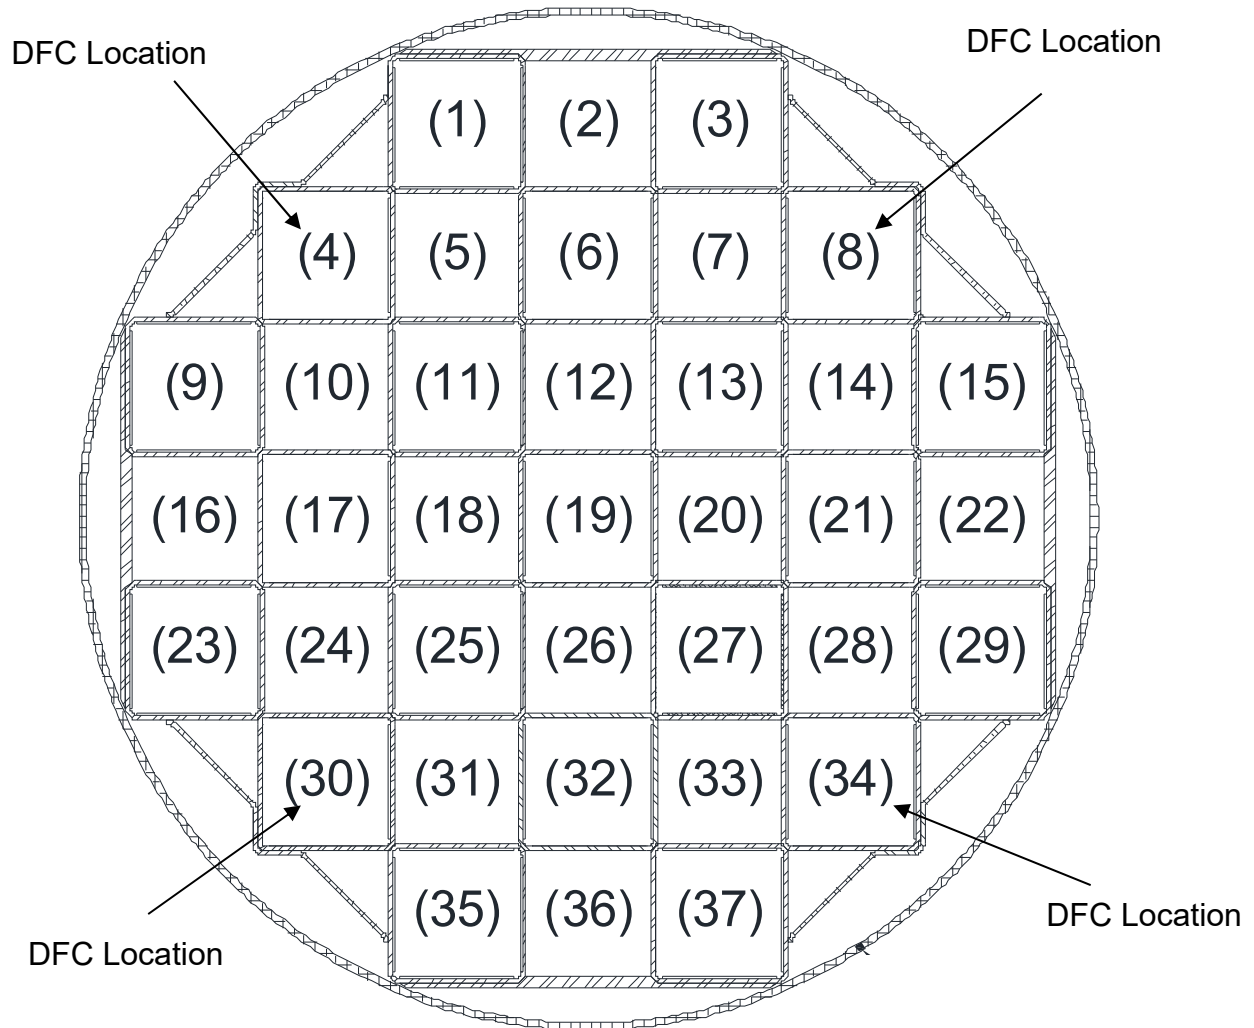

DFC designated locations may contain a loaded DFC or a PWR UNDAMAGED SNF ASSEMBLY.

**Table B2-9 TSC with BWR Fuel Limits**

- 
- I. BWR FUEL
- A. Allowable Contents
1. Uranium BWR UNDAMAGED FUEL assemblies listed in Tables B2-10 and B2-11 and meeting the following specifications:
    - a. Cladding Type: Zirconium-based alloy.
    - b. Enrichment: Post-irradiation Cooling Time and Assembly Average Burnup  
Generic maximum INITIAL PEAK PLANAR-AVERAGE ENRICHMENTS are shown in Table B2-10. The physical characteristics of the different BWR SNF ASSEMBLIES are defined in Table B2-11. Fuel type specific enrichment limits for the 87-assembly and 82-assembly BWR fuel basket configurations are defined in Table B2-12 as a function of neutron absorber areal density. Combined minimum enrichment, maximum SNF assembly average burnup and minimum cool time limits are shown in Table B2-23 and Table B2-24. For SNF assembly average burnup levels below those shown in Table B2-23 and Table B2-24, an SNF assembly minimum cool time is specified in Table B2-14, provided that the minimum initial SNF assembly average enrichment limits are applied.
    - c. Decay Heat per SNF Assembly:  $\leq 379$  watts
    - d. Nominal Fresh Fuel Design SNF Assembly Length (in.):  $\leq 176.2$
    - e. Nominal Fresh Fuel Design SNF Assembly Width (in.):  $\leq 5.52$
    - f. SNF Assembly Weight (lb):  $\leq 704$ , including channels
  - B. Quantity per TSC: Up to 87 BWR UNDAMAGED SNF ASSEMBLIES. With the exception of the designated nonfuel locations in the 82-assembly basket configuration, fuel storage locations not containing a fuel assembly shall have an empty fuel cell insert installed. Prior to use of the 86 and 82-assembly configurations, the cell fuel storage locations as noted and shown in Figures B2-4 and B2-5 must be physically blocked to prevent fuel assembly loading, respectively.

---

(continued)

**Table B2-9 TSC with BWR Fuel Limits (continued)**

- 
- C. BWR fuel assemblies may be unchanneled, or channeled with zirconium-based alloy channels.
  - D. BWR fuel assemblies with stainless steel channels are not authorized.
  - E. SNF Assembly lattices possessing less than the nominal number of undamaged fuel rods (see Table B2-11) must contain solid filler rods that displace a volume equal to, or greater than, that of the fuel rod that the filler rod replaces.
  - F. Spacers may be used in a TSC to axially position BWR SNF assemblies to facilitate handling.
  - G. Unirradiated (i.e., not inserted in-core) fuel assemblies are not authorized for loading. Unenriched axial blankets are permitted, provided that the nominal length of the blanket is not greater than six (6) inches.
  - H. Allowable SNF assembly locations for the 86-assembly fuel basket configuration is shown in Figure B2-4.
  - I. Allowable SNF assembly locations for the standard and alternate 82-assembly fuel basket configurations are shown in Figure B2-5.

**Table B2-10 BWR SNF Assembly Characteristics**

Characteristic	Fuel Class			
	7×7	8×8	9×9	10×10
Max Initial Enrichment (wt % <sup>235</sup> U)	4.5	4.5	4.5	4.5
Number of Fuel Rods	48/49	59/60/61/ 62/63/64	72/74 <sup>(a)</sup> /76/ 79/80	91 <sup>(a)</sup> /92 <sup>(a)</sup> / 96 <sup>(a)</sup> /100
Max Assembly Average Burnup (MWd/MTU)	60,000	60,000	60,000	60,000
Peak Average Rod Burnup (MWd/MTU)	62,500	62,500	62,500	62,500
Min Cool Time (years)	4	4	4	4
Min Average Enrichment (wt % <sup>235</sup> U)	0.7	0.7	0.7	0.7
Max Weight (lb) per Storage Location	704	704	704	704
Max Decay Heat (Watts) per Storage Location	379	379	379	379

- Each BWR fuel assembly may include a zirconium-based alloy channel.
- Assembly weight includes the weight of the channel.
- Maximum initial enrichment is the peak planar-average enrichment.
- Water rods may occupy more than one fuel lattice location. Fuel assembly to contain nominal number of water rods for the specific assembly design.
- All enrichment values are nominal preirradiation fabrication values.
- Spacers may be used to axially position fuel assemblies to facilitate handling.

---

<sup>(a)</sup> Assemblies may contain partial-length fuel rods.

**Table B2-11 BWR SNF Assembly Loading Criteria**

Assembly Type	Number of Fuel Rods	Number of Partial Length Rods <sup>1</sup>	Geometry <sup>3,4</sup>					Max Active Length (inch)	Max Loading (MTU)
			Max Pitch (inch)	Min Clad OD (inch)	Min Clad Thick. (inch)	Max Pellet OD (inch)			
B7_48A	48	N/A	0.7380	0.5700	0.03600	0.4900	144.0	0.1981	
B7_49A	49	N/A	0.7380	0.5630	0.03200	0.4880	146.0	0.2034	
B7_49B	49	N/A	0.7380	0.5630	0.03200	0.4910	150.0	0.2115	
B8_59A	59	N/A	0.6400	0.4930	0.03400	0.4160	150.0	0.1828	
B8_60A	60	N/A	0.6417	0.4840	0.03150	0.4110	150.0	0.1815	
B8_60B	60	N/A	0.6400	0.4830	0.03000	0.4140	150.0	0.1841	
B8_61B	61	N/A	0.6400	0.4830	0.03000	0.4140	150.0	0.1872	
B8_62A	62	N/A	0.6417	0.4830	0.02900	0.4160	150.0	0.1921	
B8_63A	63	N/A	0.6420	0.4840	0.02725	0.4195	150.0	0.1985	
B8_64A	64	N/A	0.6420	0.4840	0.02725	0.4195	150.0	0.2017	
B8_64B <sup>5</sup>	64	N/A	0.6090	0.4576	0.02900	0.3913	150.0	0.1755	
B9_72A	72	N/A	0.5720	0.4330	0.02600	0.3740	150.0	0.1803	
B9_74A	74 <sup>2</sup>	8	0.5720	0.4240	0.02390	0.3760	150.0	0.1873	
B9_76A	76	N/A	0.5720	0.4170	0.02090	0.3750	150.0	0.1914	
B9_79A	79	N/A	0.5720	0.4240	0.02390	0.3760	150.0	0.2000	
B9_80A	80	N/A	0.5720	0.4230	0.02950	0.3565	150.0	0.1821	
B10_91A	91 <sup>2</sup>	8	0.5100	0.3957	0.02385	0.3420	150.0	0.1906	
B10_92A	92 <sup>2</sup>	14	0.5100	0.4040	0.02600	0.3455	150.0	0.1966	
B10_96A <sup>5</sup>	96 <sup>2</sup>	12	0.4880	0.3780	0.02430	0.3224	150.0	0.1787	
B10_100A <sup>5</sup>	100	N/A	0.4880	0.3780	0.02430	0.3224	150.0	0.1861	

- <sup>1</sup> Location of the partial length rods is illustrated in Figure B2-6.
- <sup>2</sup> Assemblies may contain partial-length fuel rods.
- <sup>3</sup> Assembly characteristics represent cold, unirradiated, nominal configurations.
- <sup>4</sup> Maximum channel thickness allowed is 120 mils (nominal).
- <sup>5</sup> Composed of four subchannel clusters.

Note: Amendment No. 2 removed the enrichment/soluble boron limits from this table. This information is now presented in Table B2-12.

**Table B2-12 BWR SNF Assembly Loading Criteria – Enrichment Limits for 87-Assembly and 82-Assembly Configurations**

	Max. Initial Enrichment <sup>a</sup> ( wt % <sup>235</sup> U)					
	Absorber <sup>b</sup> 0.027 <sup>10</sup> B g/cm <sup>2</sup>		Absorber 0.0225 <sup>10</sup> B g/cm <sup>2</sup>		Absorber 0.02 <sup>10</sup> B g/cm <sup>2</sup>	
	87-Assy Basket	82-Assy Basket	87-Assy Basket	82-Assy Basket	87-Assy Basket	82-Assy Basket
B7_48A	4.0%	4.5%	3.7%	4.5%	3.6%	4.4%
B7_49A	3.8%	4.5%	3.6%	4.4%	3.5%	4.3%
B7_49B	3.8%	4.5%	3.6%	4.4%	3.5%	4.2%
B8_59A	3.9%	4.5%	3.7%	4.5%	3.6%	4.3%
B8_60A	3.8%	4.5%	3.7%	4.4%	3.5%	4.2%
B8_60B	3.8%	4.5%	3.6%	4.3%	3.5%	4.2%
B8_61B	3.8%	4.5%	3.6%	4.3%	3.5%	4.2%
B8_62A	3.8%	4.5%	3.6%	4.3%	3.5%	4.1%
B8_63A	3.8%	4.5%	3.6%	4.3%	3.4%	4.2%
B8_64A	3.8%	4.5%	3.6%	4.3%	3.5%	4.2%
B8_64B	3.6%	4.3%	3.4%	4.1%	3.3%	4.0%
B9_72A	3.8%	4.5%	3.6%	4.3%	3.4%	4.1%
B9_74A	3.7% <sup>c</sup>	4.3%	3.4%	4.1%	3.4%	4.0%
B9_76A	3.5%	4.2%	3.4%	4.0%	3.3%	3.9%
B9_79A	3.7%	4.4%	3.4%	4.2%	3.3%	4.0%
B9_80A	3.8%	4.5%	3.6%	4.3%	3.5%	4.2%
B10_91A	3.7%	4.5% <sup>d</sup>	3.6%	4.3%	3.5%	4.1%
B10_92A	3.8%	4.5% <sup>d</sup>	3.6%	4.3%	3.5%	4.1%
B10_96A	3.7%	4.3%	3.5%	4.1%	3.4%	4.0%
B10_100A	3.6%	4.4%	3.5%	4.1%	3.4%	4.0%


<sup>a</sup> Maximum planar average.

<sup>b</sup> Borated aluminum neutron absorber sheet effective areal <sup>10</sup>B density.

<sup>c</sup> 3.85% in the 86-assembly basket configuration


<sup>d</sup> 4.55% in the alternate 82-assembly basket configuration

**Figure B2-4 Schematic of 87-Assembly BWR Basket**

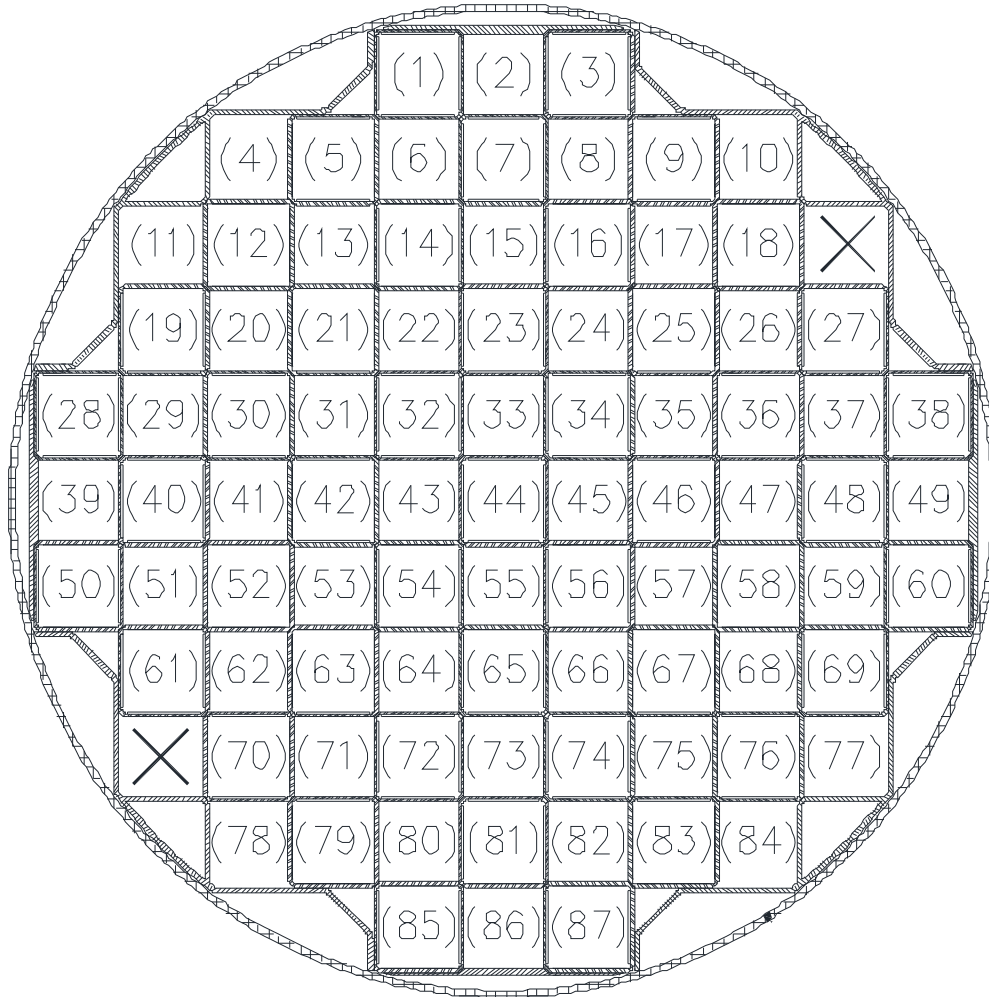


Note – Cell location 44 must have an empty fuel cell insert installed in order to use the 86-assembly configuration.

Figure B2-5 Schematic of 82-Assembly BWR Basket

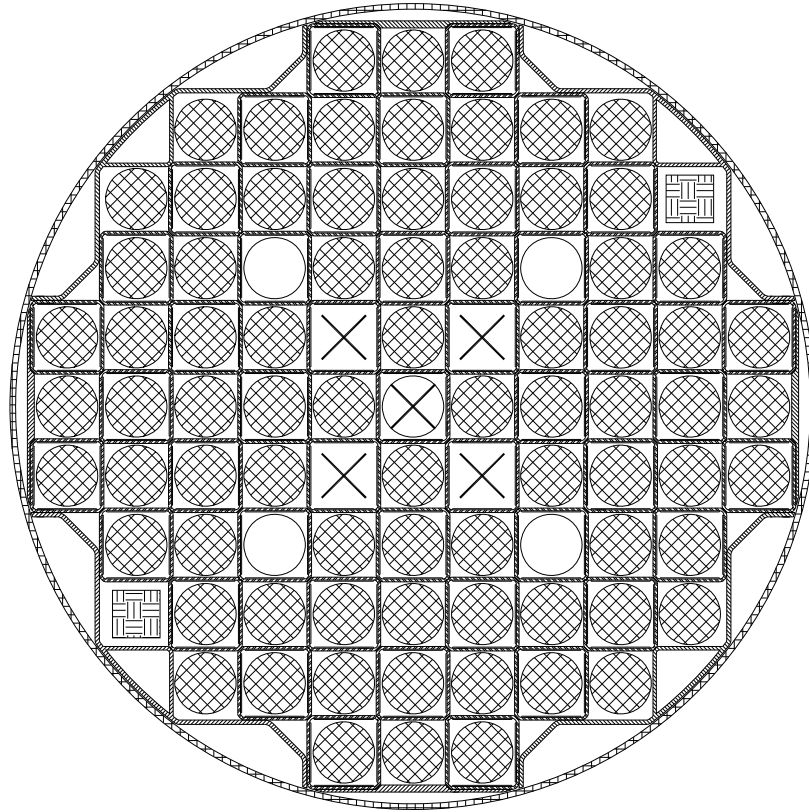


 = Fuel Assembly Locations

 = Vent/Drain Port Locations

 = Designated Nonfuel Locations for  
Standard 82-Assembly Config


 = Designated Nonfuel Locations for  
Alternate 82-Assembly Config

**Figure B2-6 BWR Partial Length Fuel Rod Location Sketches**

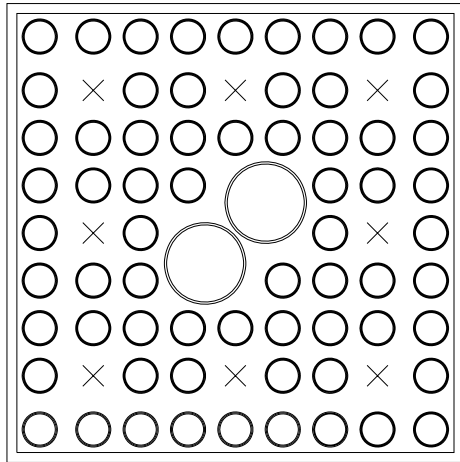


○ = Fuel Rod Location  
× = Partial Rod Location

*B9\_74A 8 Partial Length Rods*

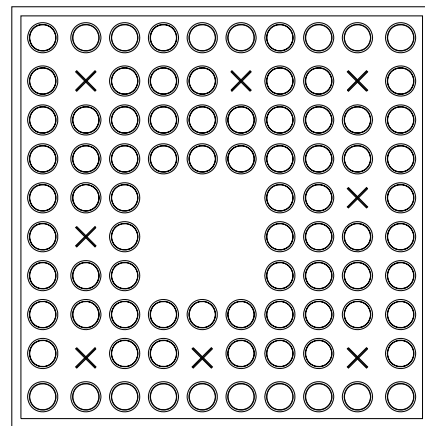


○ = Fuel Rod Location  
× = Partial Rod Location

*B10\_91A 8 Partial Length Rods*

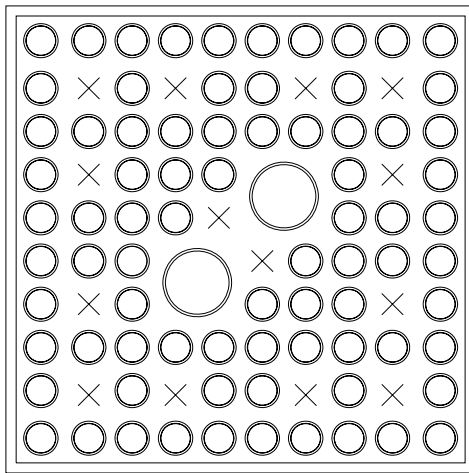

○ = Fuel Rod Location  
× = Partial Rod Location

*B10\_92A 14 Partial Length Rods*

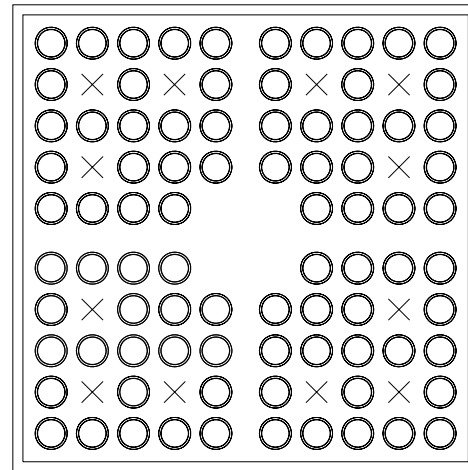

○ = Fuel Rod Location  
× = Partial Rod Location

*B10\_96A 12 Partial Length Rods*

**Table B2-13 PWR Loading Table – Low SNF Assembly Average Burnup Enrichment Limits**

Max. Assembly Avg. Burnup (MWd/MTU)	Min. Assembly Avg. Initial Enrichment (wt% <sup>235</sup> U)	Minimum Cool Time (yrs)			
		959 W	800 W	922 W	1,200 W
Heat Load per Assy	--				
10,000	1.3	4.0	4.0	4.0	4.0
15,000	1.5	4.0	4.0	4.0	4.0
20,000	1.7	4.0	4.0	4.0	4.0
25,000	1.9	4.0	4.3	4.0	4.0
30,000	2.1	4.4	5.2	4.5	4.0

**Table B2-14 BWR Loading Table – Low SNF Assembly Average Burnup Enrichment Limits**

Max. Assembly Avg. Burnup (MWd/MTU)	Min. Assembly Avg. Initial Enrichment (wt% <sup>235</sup> U)	Minimum Cool Time (yrs)
5,000	0.7	4.0
10,000	1.3	4.0
15,000	1.5	4.0
20,000	1.7	4.0
25,000	1.9	4.0
30,000	2.1	4.3

**Table B2-15 Loading Table for PWR Fuel – 959 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	30 < Assembly Average Burnup ≤ 32.5 GWd/MTU Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	4.1	4.1	4.6	4.7	4.4	4.7	4.7
2.3 ≤ E < 2.5	4.0	4.1	4.5	4.7	4.4	4.6	4.6
2.5 ≤ E < 2.7	4.0	4.0	4.5	4.6	4.3	4.6	4.6
2.7 ≤ E < 2.9	4.0	4.0	4.5	4.5	4.3	4.5	4.5
2.9 ≤ E < 3.1	4.0	4.0	4.4	4.5	4.2	4.5	4.5
3.1 ≤ E < 3.3	4.0	4.0	4.4	4.5	4.2	4.5	4.5
3.3 ≤ E < 3.5	4.0	4.0	4.3	4.4	4.2	4.4	4.4
3.5 ≤ E < 3.7	4.0	4.0	4.3	4.4	4.1	4.4	4.4
3.7 ≤ E < 3.9	4.0	4.0	4.3	4.4	4.1	4.4	4.4
3.9 ≤ E < 4.1	4.0	4.0	4.2	4.3	4.0	4.3	4.3
4.1 ≤ E < 4.3	4.0	4.0	4.2	4.3	4.0	4.3	4.3
4.3 ≤ E < 4.5	4.0	4.0	4.2	4.3	4.0	4.3	4.3
4.5 ≤ E < 4.7	4.0	4.0	4.1	4.2	4.0	4.2	4.2
4.7 ≤ E < 4.9	4.0	4.0	4.1	4.2	4.0	4.2	4.2
E ≥ 4.9	4.0	4.0	4.1	4.2	4.0	4.2	4.2
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	32.5 < Assembly Average Burnup ≤ 35 GWd/MTU Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.3	4.4	5.0	5.1	4.7	5.0	5.0
2.5 ≤ E < 2.7	4.3	4.4	4.9	5.0	4.7	5.0	5.0
2.7 ≤ E < 2.9	4.2	4.3	4.8	5.0	4.6	4.9	4.9
2.9 ≤ E < 3.1	4.2	4.3	4.8	4.9	4.6	4.9	4.9
3.1 ≤ E < 3.3	4.1	4.2	4.7	4.9	4.5	4.8	4.8
3.3 ≤ E < 3.5	4.1	4.2	4.7	4.8	4.5	4.8	4.8
3.5 ≤ E < 3.7	4.1	4.1	4.6	4.8	4.4	4.7	4.7
3.7 ≤ E < 3.9	4.0	4.1	4.6	4.7	4.4	4.7	4.7
3.9 ≤ E < 4.1	4.0	4.1	4.6	4.7	4.4	4.7	4.7
4.1 ≤ E < 4.3	4.0	4.0	4.5	4.7	4.3	4.6	4.6
4.3 ≤ E < 4.5	4.0	4.0	4.5	4.6	4.3	4.6	4.6
4.5 ≤ E < 4.7	4.0	4.0	4.5	4.6	4.3	4.6	4.6
4.7 ≤ E < 4.9	4.0	4.0	4.4	4.6	4.3	4.5	4.5
E ≥ 4.9	4.0	4.0	4.4	4.5	4.2	4.5	4.5

**Table B2-15 Loading Table for PWR Fuel – 959 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	35 < Assembly Average Burnup ≤ 37.5 GWd/MTU Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.7	4.8	5.5	5.7	5.2	5.6	5.6
2.5 ≤ E < 2.7	4.6	4.7	5.4	5.6	5.1	5.5	5.5
2.7 ≤ E < 2.9	4.6	4.7	5.3	5.5	5.0	5.4	5.4
2.9 ≤ E < 3.1	4.5	4.6	5.3	5.4	5.0	5.4	5.4
3.1 ≤ E < 3.3	4.5	4.5	5.2	5.4	4.9	5.3	5.3
3.3 ≤ E < 3.5	4.4	4.5	5.1	5.3	4.9	5.2	5.2
3.5 ≤ E < 3.7	4.4	4.5	5.0	5.2	4.8	5.2	5.2
3.7 ≤ E < 3.9	4.3	4.4	5.0	5.2	4.8	5.1	5.1
3.9 ≤ E < 4.1	4.3	4.4	5.0	5.1	4.7	5.1	5.1
4.1 ≤ E < 4.3	4.3	4.4	4.9	5.1	4.7	5.0	5.0
4.3 ≤ E < 4.5	4.2	4.3	4.9	5.0	4.7	5.0	5.0
4.5 ≤ E < 4.7	4.2	4.3	4.9	5.0	4.6	5.0	5.0
4.7 ≤ E < 4.9	4.2	4.3	4.8	5.0	4.6	4.9	4.9
E ≥ 4.9	4.1	4.2	4.8	4.9	4.5	4.9	4.9

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	37.5 < Assembly Average Burnup ≤ 40 GWd/MTU Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.0	5.2	5.9	6.1	5.6	6.0	6.0
2.7 ≤ E < 2.9	5.0	5.1	5.9	6.0	5.5	5.9	5.9
2.9 ≤ E < 3.1	4.9	5.0	5.8	6.0	5.5	5.9	5.9
3.1 ≤ E < 3.3	4.9	4.9	5.7	5.9	5.4	5.8	5.8
3.3 ≤ E < 3.5	4.8	4.9	5.7	5.8	5.3	5.7	5.7
3.5 ≤ E < 3.7	4.7	4.8	5.6	5.8	5.2	5.7	5.7
3.7 ≤ E < 3.9	4.7	4.8	5.5	5.7	5.2	5.6	5.6
3.9 ≤ E < 4.1	4.6	4.8	5.5	5.7	5.1	5.6	5.6
4.1 ≤ E < 4.3	4.6	4.7	5.4	5.6	5.1	5.5	5.5
4.3 ≤ E < 4.5	4.5	4.7	5.4	5.6	5.0	5.5	5.5
4.5 ≤ E < 4.7	4.5	4.6	5.3	5.5	5.0	5.4	5.4
4.7 ≤ E < 4.9	4.5	4.6	5.3	5.5	5.0	5.4	5.4
E ≥ 4.9	4.5	4.5	5.2	5.4	4.9	5.4	5.4

**Table B2-15 Loading Table for PWR Fuel – 959 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	40 < Assembly Average Burnup ≤ 41 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.3	5.4	6.2	6.4	5.8	6.3	6.3
2.7 ≤ E < 2.9	5.2	5.3	6.1	6.3	5.7	6.2	6.2
2.9 ≤ E < 3.1	5.1	5.2	6.0	6.2	5.7	6.1	6.1
3.1 ≤ E < 3.3	5.0	5.1	5.9	6.1	5.6	6.0	6.0
3.3 ≤ E < 3.5	4.9	5.1	5.9	6.0	5.5	5.9	5.9
3.5 ≤ E < 3.7	4.9	5.0	5.8	6.0	5.5	5.9	5.9
3.7 ≤ E < 3.9	4.8	4.9	5.7	5.9	5.4	5.8	5.8
3.9 ≤ E < 4.1	4.8	4.9	5.7	5.9	5.3	5.8	5.8
4.1 ≤ E < 4.3	4.7	4.9	5.6	5.8	5.3	5.7	5.7
4.3 ≤ E < 4.5	4.7	4.8	5.6	5.8	5.2	5.7	5.7
4.5 ≤ E < 4.7	4.7	4.8	5.5	5.7	5.2	5.6	5.6
4.7 ≤ E < 4.9	4.6	4.7	5.5	5.7	5.1	5.6	5.6
E ≥ 4.9	4.6	4.7	5.5	5.6	5.1	5.6	5.6
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	41 < Assembly Average Burnup ≤ 42 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.5	5.6	6.5	6.7	6.0	6.6	6.6
2.7 ≤ E < 2.9	5.4	5.5	6.4	6.6	5.9	6.5	6.5
2.9 ≤ E < 3.1	5.3	5.4	6.3	6.5	5.9	6.4	6.4
3.1 ≤ E < 3.3	5.2	5.3	6.2	6.4	5.8	6.3	6.3
3.3 ≤ E < 3.5	5.1	5.3	6.1	6.3	5.7	6.2	6.2
3.5 ≤ E < 3.7	5.0	5.2	6.0	6.2	5.7	6.1	6.1
3.7 ≤ E < 3.9	5.0	5.1	5.9	6.2	5.6	6.0	6.0
3.9 ≤ E < 4.1	4.9	5.1	5.9	6.1	5.5	6.0	6.0
4.1 ≤ E < 4.3	4.9	5.0	5.8	6.0	5.5	5.9	5.9
4.3 ≤ E < 4.5	4.9	5.0	5.8	6.0	5.4	5.9	5.9
4.5 ≤ E < 4.7	4.8	4.9	5.7	5.9	5.4	5.8	5.8
4.7 ≤ E < 4.9	4.8	4.9	5.7	5.9	5.3	5.8	5.8
E ≥ 4.9	4.7	4.9	5.7	5.9	5.3	5.8	5.8

**Table B2-15 Loading Table for PWR Fuel – 959 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	42 < Assembly Average Burnup ≤ 43 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.7	5.8	6.8	7.0	6.3	6.9	6.9
2.7 ≤ E < 2.9	5.6	5.7	6.7	6.9	6.2	6.8	6.8
2.9 ≤ E < 3.1	5.5	5.6	6.6	6.8	6.0	6.7	6.7
3.1 ≤ E < 3.3	5.4	5.6	6.5	6.7	6.0	6.6	6.6
3.3 ≤ E < 3.5	5.3	5.5	6.4	6.6	5.9	6.5	6.5
3.5 ≤ E < 3.7	5.3	5.4	6.3	6.5	5.9	6.4	6.4
3.7 ≤ E < 3.9	5.2	5.3	6.2	6.5	5.8	6.3	6.3
3.9 ≤ E < 4.1	5.1	5.3	6.1	6.4	5.7	6.2	6.2
4.1 ≤ E < 4.3	5.0	5.2	6.0	6.3	5.7	6.2	6.1
4.3 ≤ E < 4.5	5.0	5.2	6.0	6.2	5.6	6.1	6.1
4.5 ≤ E < 4.7	5.0	5.1	5.9	6.2	5.6	6.0	6.0
4.7 ≤ E < 4.9	4.9	5.0	5.9	6.1	5.5	6.0	6.0
E ≥ 4.9	4.9	5.0	5.8	6.0	5.5	6.0	5.9
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	43 < Assembly Average Burnup ≤ 44 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.9	6.0	7.1	7.4	6.6	7.2	7.2
2.7 ≤ E < 2.9	5.8	5.9	7.0	7.3	6.5	7.0	7.0
2.9 ≤ E < 3.1	5.7	5.8	6.9	7.1	6.4	6.9	6.9
3.1 ≤ E < 3.3	5.6	5.8	6.8	7.0	6.2	6.8	6.8
3.3 ≤ E < 3.5	5.5	5.7	6.7	6.9	6.1	6.8	6.7
3.5 ≤ E < 3.7	5.5	5.6	6.6	6.8	6.0	6.7	6.7
3.7 ≤ E < 3.9	5.4	5.6	6.5	6.8	6.0	6.6	6.6
3.9 ≤ E < 4.1	5.3	5.5	6.4	6.7	5.9	6.5	6.5
4.1 ≤ E < 4.3	5.3	5.4	6.3	6.6	5.9	6.4	6.4
4.3 ≤ E < 4.5	5.2	5.4	6.2	6.5	5.8	6.4	6.4
4.5 ≤ E < 4.7	5.1	5.3	6.2	6.5	5.8	6.3	6.3
4.7 ≤ E < 4.9	5.1	5.3	6.1	6.4	5.7	6.2	6.2
E ≥ 4.9	5.0	5.2	6.0	6.3	5.7	6.2	6.2

**Table B2-15 Loading Table for PWR Fuel – 959 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	44 < Assembly Average Burnup ≤ 45 GWd/MTU Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	6.0	6.2	7.3	7.7	6.7	7.4	7.4
2.9 ≤ E < 3.1	5.9	6.0	7.2	7.6	6.6	7.3	7.3
3.1 ≤ E < 3.3	5.8	6.0	7.0	7.4	6.5	7.2	7.1
3.3 ≤ E < 3.5	5.7	5.9	6.9	7.3	6.4	7.0	7.0
3.5 ≤ E < 3.7	5.7	5.8	6.8	7.2	6.3	6.9	6.9
3.7 ≤ E < 3.9	5.6	5.8	6.8	7.0	6.2	6.9	6.9
3.9 ≤ E < 4.1	5.5	5.7	6.7	7.0	6.2	6.8	6.8
4.1 ≤ E < 4.3	5.5	5.6	6.6	6.9	6.1	6.7	6.7
4.3 ≤ E < 4.5	5.4	5.6	6.5	6.8	6.0	6.7	6.6
4.5 ≤ E < 4.7	5.3	5.5	6.5	6.7	6.0	6.6	6.6
4.7 ≤ E < 4.9	5.3	5.5	6.4	6.7	5.9	6.5	6.5
E ≥ 4.9	5.2	5.4	6.3	6.6	5.9	6.5	6.5

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	45 < Assembly Average Burnup ≤ 46 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	6.7	6.9	8.5	9.0	7.7	8.6	8.6
2.9 ≤ E < 3.1	6.6	6.8	8.3	8.8	7.5	8.4	8.4
3.1 ≤ E < 3.3	6.5	6.7	8.1	8.6	7.4	8.2	8.2
3.3 ≤ E < 3.5	6.4	6.6	8.0	8.5	7.3	8.1	8.1
3.5 ≤ E < 3.7	6.3	6.5	7.8	8.3	7.1	8.0	7.9
3.7 ≤ E < 3.9	6.2	6.4	7.7	8.2	7.0	7.8	7.8
3.9 ≤ E < 4.1	6.1	6.3	7.6	8.0	6.9	7.7	7.7
4.1 ≤ E < 4.3	6.0	6.2	7.5	7.9	6.9	7.7	7.6
4.3 ≤ E < 4.5	6.0	6.2	7.4	7.8	6.8	7.6	7.6
4.5 ≤ E < 4.7	5.9	6.1	7.3	7.8	6.7	7.5	7.5
4.7 ≤ E < 4.9	5.9	6.0	7.2	7.7	6.7	7.4	7.4
E ≥ 4.9	5.8	6.0	7.2	7.6	6.6	7.3	7.3

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	46 < Assembly Average Burnup ≤ 47 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.0	7.3	9.0	9.6	8.0	9.1	9.1
2.9 ≤ E < 3.1	6.9	7.1	8.8	9.4	7.9	8.9	8.9
3.1 ≤ E < 3.3	6.8	7.0	8.6	9.2	7.8	8.7	8.7
3.3 ≤ E < 3.5	6.7	6.9	8.4	9.0	7.6	8.6	8.6
3.5 ≤ E < 3.7	6.6	6.8	8.3	8.8	7.5	8.4	8.4
3.7 ≤ E < 3.9	6.5	6.7	8.1	8.7	7.4	8.3	8.3
3.9 ≤ E < 4.1	6.4	6.6	8.0	8.5	7.3	8.1	8.1
4.1 ≤ E < 4.3	6.3	6.5	7.9	8.4	7.2	8.0	8.0
4.3 ≤ E < 4.5	6.2	6.5	7.8	8.3	7.1	7.9	7.9
4.5 ≤ E < 4.7	6.1	6.4	7.7	8.2	7.0	7.9	7.8
4.7 ≤ E < 4.9	6.0	6.3	7.6	8.1	6.9	7.8	7.8
E ≥ 4.9	6.0	6.2	7.6	8.0	6.9	7.7	7.7
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	47 < Assembly Average Burnup ≤ 48 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.4	7.7	9.6	10.3	8.6	9.7	9.7
2.9 ≤ E < 3.1	7.2	7.6	9.4	10.0	8.4	9.5	9.5
3.1 ≤ E < 3.3	7.1	7.4	9.1	9.8	8.2	9.3	9.3
3.3 ≤ E < 3.5	7.0	7.2	8.9	9.6	8.0	9.1	9.0
3.5 ≤ E < 3.7	6.9	7.1	8.8	9.4	7.9	8.9	8.9
3.7 ≤ E < 3.9	6.7	7.0	8.6	9.2	7.8	8.8	8.7
3.9 ≤ E < 4.1	6.7	6.9	8.5	9.0	7.6	8.6	8.6
4.1 ≤ E < 4.3	6.6	6.8	8.4	8.9	7.6	8.5	8.5
4.3 ≤ E < 4.5	6.5	6.7	8.2	8.8	7.4	8.4	8.4
4.5 ≤ E < 4.7	6.4	6.7	8.1	8.7	7.4	8.3	8.3
4.7 ≤ E < 4.9	6.3	6.6	8.0	8.6	7.3	8.2	8.2
E ≥ 4.9	6.2	6.5	7.9	8.5	7.2	8.1	8.1

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	48 < Assembly Average Burnup ≤ 49 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.8	8.1	10.2	11.1	9.0	10.4	10.4
2.9 ≤ E < 3.1	7.6	7.9	10.0	10.8	8.8	10.1	10.1
3.1 ≤ E < 3.3	7.5	7.8	9.7	10.5	8.6	9.9	9.8
3.3 ≤ E < 3.5	7.3	7.6	9.5	10.2	8.5	9.7	9.6
3.5 ≤ E < 3.7	7.2	7.5	9.3	10.0	8.3	9.5	9.4
3.7 ≤ E < 3.9	7.0	7.4	9.1	9.8	8.2	9.3	9.3
3.9 ≤ E < 4.1	6.9	7.2	9.0	9.6	8.0	9.1	9.1
4.1 ≤ E < 4.3	6.8	7.1	8.8	9.5	7.9	9.0	9.0
4.3 ≤ E < 4.5	6.8	7.0	8.7	9.3	7.8	8.9	8.9
4.5 ≤ E < 4.7	6.7	6.9	8.6	9.2	7.7	8.8	8.7
4.7 ≤ E < 4.9	6.6	6.9	8.5	9.1	7.6	8.7	8.6
E ≥ 4.9	6.5	6.8	8.4	9.0	7.6	8.6	8.5
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	49 < Assembly Average Burnup ≤ 50 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	8.0	8.3	10.7	11.6	9.4	10.9	10.9
3.1 ≤ E < 3.3	7.8	8.1	10.4	11.3	9.1	10.6	10.6
3.3 ≤ E < 3.5	7.7	7.9	10.1	11.0	9.0	10.3	10.3
3.5 ≤ E < 3.7	7.5	7.8	9.9	10.8	8.8	10.0	10.0
3.7 ≤ E < 3.9	7.4	7.6	9.7	10.5	8.6	9.9	9.9
3.9 ≤ E < 4.1	7.3	7.5	9.5	10.3	8.5	9.7	9.7
4.1 ≤ E < 4.3	7.1	7.4	9.4	10.1	8.3	9.6	9.5
4.3 ≤ E < 4.5	7.0	7.3	9.2	9.9	8.2	9.4	9.4
4.5 ≤ E < 4.7	6.9	7.2	9.1	9.8	8.1	9.3	9.2
4.7 ≤ E < 4.9	6.9	7.1	9.0	9.6	8.0	9.1	9.1
E ≥ 4.9	6.8	7.0	8.9	9.5	7.9	9.0	9.0

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	50 < Assembly Average Burnup ≤ 51 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	8.3	8.7	11.5	12.3	10.0	11.6	11.6
3.1 ≤ E < 3.3	8.0	8.5	11.2	12.0	9.8	11.3	11.3
3.3 ≤ E < 3.5	7.9	8.3	10.9	11.7	9.5	11.1	11.1
3.5 ≤ E < 3.7	7.8	8.1	10.6	11.5	9.3	10.8	10.8
3.7 ≤ E < 3.9	7.6	8.0	10.4	11.3	9.1	10.6	10.6
3.9 ≤ E < 4.1	7.5	7.9	10.1	11.1	9.0	10.4	10.4
4.1 ≤ E < 4.3	7.4	7.8	10.0	10.9	8.8	10.2	10.1
4.3 ≤ E < 4.5	7.3	7.6	9.8	10.6	8.7	10.0	10.0
4.5 ≤ E < 4.7	7.1	7.5	9.7	10.5	8.6	9.8	9.8
4.7 ≤ E < 4.9	7.0	7.4	9.5	10.3	8.5	9.7	9.7
E ≥ 4.9	7.0	7.3	9.4	10.1	8.3	9.6	9.6
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	51 < Assembly Average Burnup ≤ 52 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	8.8	9.3	12.2	13.0	10.7	12.4	12.4
3.1 ≤ E < 3.3	8.5	9.0	11.9	12.6	10.4	12.1	12.0
3.3 ≤ E < 3.5	8.3	8.8	11.6	12.3	10.1	11.8	11.8
3.5 ≤ E < 3.7	8.1	8.6	11.4	11.9	9.9	11.6	11.5
3.7 ≤ E < 3.9	8.0	8.5	11.1	11.7	9.7	11.3	11.3
3.9 ≤ E < 4.1	7.9	8.3	10.9	11.5	9.5	11.1	11.1
4.1 ≤ E < 4.3	7.7	8.1	10.7	11.3	9.3	10.9	10.9
4.3 ≤ E < 4.5	7.6	8.0	10.5	11.1	9.2	10.7	10.7
4.5 ≤ E < 4.7	7.5	7.9	10.3	11.0	9.0	10.5	10.5
4.7 ≤ E < 4.9	7.4	7.8	10.1	10.8	8.9	10.3	10.3
E ≥ 4.9	7.3	7.7	10.0	10.6	8.8	10.2	10.2

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	52 < Assembly Average Burnup ≤ 53 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	9.3	9.8	12.8	13.8	11.4	13.3	13.3
3.1 ≤ E < 3.3	9.0	9.6	12.4	13.5	11.2	13.0	13.0
3.3 ≤ E < 3.5	8.8	9.3	12.1	13.2	10.9	12.6	12.6
3.5 ≤ E < 3.7	8.6	9.1	11.8	12.8	10.6	12.3	12.3
3.7 ≤ E < 3.9	8.4	9.0	11.5	12.6	10.3	12.0	12.0
3.9 ≤ E < 4.1	8.2	8.8	11.3	12.3	10.1	11.8	11.8
4.1 ≤ E < 4.3	8.1	8.6	11.1	12.0	9.9	11.6	11.6
4.3 ≤ E < 4.5	8.0	8.5	10.9	11.8	9.7	11.4	11.4
4.5 ≤ E < 4.7	7.9	8.3	10.7	11.7	9.6	11.2	11.2
4.7 ≤ E < 4.9	7.8	8.2	10.6	11.5	9.4	11.1	11.0
E ≥ 4.9	7.7	8.1	10.4	11.3	9.3	10.9	10.9
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	53 < Assembly Average Burnup ≤ 54 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	9.8	10.5	13.6	14.9	12.2	14.2	14.2
3.1 ≤ E < 3.3	9.6	10.2	13.3	14.4	11.8	13.8	13.8
3.3 ≤ E < 3.5	9.3	9.9	12.9	14.0	11.6	13.5	13.5
3.5 ≤ E < 3.7	9.1	9.7	12.6	13.7	11.3	13.2	13.2
3.7 ≤ E < 3.9	8.9	9.5	12.3	13.4	11.0	12.9	12.9
3.9 ≤ E < 4.1	8.7	9.3	12.0	13.2	10.8	12.6	12.6
4.1 ≤ E < 4.3	8.6	9.1	11.8	12.9	10.6	12.4	12.4
4.3 ≤ E < 4.5	8.4	8.9	11.6	12.6	10.4	12.1	12.1
4.5 ≤ E < 4.7	8.3	8.8	11.4	12.4	10.1	11.9	11.9
4.7 ≤ E < 4.9	8.1	8.7	11.3	12.2	10.0	11.8	11.7
E ≥ 4.9	8.0	8.8	11.1	12.0	9.9	11.6	11.6

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	54 < Assembly Average Burnup ≤ 55 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	10.1	10.9	14.1	15.4	12.7	14.8	14.8
3.3 ≤ E < 3.5	9.9	10.6	13.8	15.0	12.3	14.4	14.4
3.5 ≤ E < 3.7	9.6	10.3	13.5	14.7	12.0	14.0	14.0
3.7 ≤ E < 3.9	9.4	10.1	13.1	14.3	11.8	13.8	13.8
3.9 ≤ E < 4.1	9.2	9.8	12.9	14.0	11.5	13.5	13.5
4.1 ≤ E < 4.3	9.0	9.7	12.6	13.8	11.3	13.3	13.2
4.3 ≤ E < 4.5	8.9	9.5	12.3	13.5	11.1	13.0	13.0
4.5 ≤ E < 4.7	8.7	9.3	12.1	13.3	10.9	12.8	12.7
4.7 ≤ E < 4.9	8.6	9.1	11.9	13.1	10.7	12.6	12.5
E ≥ 4.9	8.5	9.0	11.7	12.9	10.5	12.3	12.3
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	55 < Assembly Average Burnup ≤ 56 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	10.9	11.6	15.1	16.5	13.1	15.8	15.8
3.3 ≤ E < 3.5	10.5	11.3	14.7	16.0	12.8	15.4	15.4
3.5 ≤ E < 3.7	10.2	11.0	14.3	15.7	12.4	15.1	15.0
3.7 ≤ E < 3.9	9.9	10.8	14.0	15.3	12.1	14.7	14.7
3.9 ≤ E < 4.1	9.7	10.5	13.7	15.0	11.9	14.4	14.4
4.1 ≤ E < 4.3	9.5	10.2	13.4	14.7	11.7	14.1	14.1
4.3 ≤ E < 4.5	9.3	10.0	13.2	14.5	11.4	13.8	13.8
4.5 ≤ E < 4.7	9.2	9.9	12.9	14.2	11.2	13.6	13.6
4.7 ≤ E < 4.9	9.0	9.7	12.7	13.9	11.1	13.4	13.4
E ≥ 4.9	8.9	9.5	12.5	13.8	10.9	13.2	13.2

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	56 < Assembly Average Burnup ≤ 57 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	11.5	12.3	16.0	17.4	14.0	16.8	16.8
3.3 ≤ E < 3.5	11.2	12.0	15.6	17.1	13.6	16.4	16.4
3.5 ≤ E < 3.7	10.9	11.7	15.3	16.7	13.3	16.0	16.0
3.7 ≤ E < 3.9	10.6	11.4	14.9	16.3	13.0	15.7	15.6
3.9 ≤ E < 4.1	10.3	11.2	14.6	16.0	12.6	15.4	15.3
4.1 ≤ E < 4.3	10.1	10.9	14.2	15.7	12.4	15.1	15.1
4.3 ≤ E < 4.5	9.9	10.7	14.0	15.4	12.1	14.8	14.8
4.5 ≤ E < 4.7	9.7	10.5	13.8	15.2	11.9	14.5	14.5
4.7 ≤ E < 4.9	9.5	10.3	13.6	14.9	11.7	14.2	14.2
E ≥ 4.9	9.4	10.1	13.4	14.7	11.5	14.0	14.0
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	57 < Assembly Average Burnup ≤ 58 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	12.2	13.2	17.0	18.5	14.9	17.8	17.7
3.3 ≤ E < 3.5	11.9	12.8	16.7	18.1	14.5	17.4	17.4
3.5 ≤ E < 3.7	11.6	12.4	16.2	17.7	14.1	17.0	17.0
3.7 ≤ E < 3.9	11.3	12.1	15.9	17.3	13.8	16.7	16.6
3.9 ≤ E < 4.1	11.0	11.9	15.6	17.0	13.5	16.3	16.3
4.1 ≤ E < 4.3	10.7	11.6	15.3	16.7	13.2	16.0	16.0
4.3 ≤ E < 4.5	10.5	11.4	15.0	16.4	12.9	15.7	15.7
4.5 ≤ E < 4.7	10.3	11.2	14.7	16.1	12.7	15.5	15.4
4.7 ≤ E < 4.9	10.0	10.9	14.4	15.8	12.4	15.2	15.2
E ≥ 4.9	9.9	10.8	14.2	15.6	12.2	15.0	14.9

**Table B2-16 Loading Table for PWR Fuel – 911 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	58 < Assembly Average Burnup ≤ 59 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	13.0	14.0	18.0	19.5	15.8	18.8	18.8
3.3 ≤ E < 3.5	12.6	13.6	17.6	19.1	15.4	18.4	18.4
3.5 ≤ E < 3.7	12.2	13.3	17.2	18.7	15.0	18.0	18.0
3.7 ≤ E < 3.9	11.9	12.9	16.9	18.3	14.6	17.7	17.7
3.9 ≤ E < 4.1	11.6	12.6	16.5	18.0	14.3	17.4	17.3
4.1 ≤ E < 4.3	11.4	12.3	16.2	17.7	14.0	17.0	17.0
4.3 ≤ E < 4.5	11.1	12.0	15.9	17.4	13.7	16.7	16.7
4.5 ≤ E < 4.7	10.9	11.8	15.6	17.1	13.5	16.4	16.4
4.7 ≤ E < 4.9	10.7	11.6	15.4	16.8	13.2	16.1	16.1
E ≥ 4.9	10.5	11.4	15.1	16.6	13.0	15.9	15.9
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	59 < Assembly Average Burnup ≤ 60 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	-	-	-	-	-	-	-
3.3 ≤ E < 3.5	13.4	14.4	18.6	20.1	16.3	19.0	19.0
3.5 ≤ E < 3.7	13.0	14.1	18.2	19.7	15.9	18.6	18.5
3.7 ≤ E < 3.9	12.7	13.7	17.8	19.4	15.5	18.2	18.1
3.9 ≤ E < 4.1	12.3	13.4	17.5	19.0	15.2	17.9	17.8
4.1 ≤ E < 4.3	12.0	13.1	17.1	18.7	14.9	17.5	17.5
4.3 ≤ E < 4.5	11.8	12.8	16.8	18.4	14.6	17.2	17.2
4.5 ≤ E < 4.7	11.6	12.6	16.5	18.0	14.3	16.9	16.9
4.7 ≤ E < 4.9	11.3	12.3	16.2	17.8	14.0	16.6	16.6
E ≥ 4.9	11.2	12.1	16.0	17.6	13.8	16.4	16.3

**Table B2-17 Loading Table for PWR Fuel – 1,200 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	30 < Assembly Average Burnup ≤ 32.5 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	4.0	4.0	4.0	4.0	4.0	4.0	4.0
2.3 ≤ E < 2.5	4.0	4.0	4.0	4.0	4.0	4.0	4.0
2.5 ≤ E < 2.7	4.0	4.0	4.0	4.0	4.0	4.0	4.0
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	32.5 < Assembly Average Burnup ≤ 35 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.0	4.0	4.0	4.1	4.0	4.1	4.1
2.5 ≤ E < 2.7	4.0	4.0	4.0	4.1	4.0	4.0	4.0
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0

**Table B2-17 Loading Table for PWR Fuel – 1,200 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	35 < Assembly Average Burnup ≤ 37.5 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.0	4.0	4.3	4.4	4.2	4.4	4.4
2.5 ≤ E < 2.7	4.0	4.0	4.3	4.4	4.1	4.4	4.4
2.7 ≤ E < 2.9	4.0	4.0	4.2	4.3	4.1	4.3	4.3
2.9 ≤ E < 3.1	4.0	4.0	4.2	4.3	4.0	4.3	4.3
3.1 ≤ E < 3.3	4.0	4.0	4.1	4.2	4.0	4.2	4.2
3.3 ≤ E < 3.5	4.0	4.0	4.1	4.2	4.0	4.2	4.2
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.2	4.0	4.2	4.2
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.1	4.0	4.1	4.1
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.1	4.0	4.1	4.1
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0	4.0

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	37.5 < Assembly Average Burnup ≤ 40 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	4.0	4.1	4.6	4.8	4.4	4.7	4.7
2.7 ≤ E < 2.9	4.0	4.0	4.6	4.7	4.4	4.7	4.7
2.9 ≤ E < 3.1	4.0	4.0	4.5	4.6	4.3	4.6	4.6
3.1 ≤ E < 3.3	4.0	4.0	4.5	4.6	4.3	4.5	4.5
3.3 ≤ E < 3.5	4.0	4.0	4.4	4.5	4.2	4.5	4.5
3.5 ≤ E < 3.7	4.0	4.0	4.4	4.5	4.2	4.5	4.4
3.7 ≤ E < 3.9	4.0	4.0	4.3	4.4	4.1	4.4	4.4
3.9 ≤ E < 4.1	4.0	4.0	4.3	4.4	4.1	4.4	4.4
4.1 ≤ E < 4.3	4.0	4.0	4.2	4.3	4.1	4.3	4.3
4.3 ≤ E < 4.5	4.0	4.0	4.2	4.3	4.0	4.3	4.3
4.5 ≤ E < 4.7	4.0	4.0	4.2	4.3	4.0	4.3	4.3
4.7 ≤ E < 4.9	4.0	4.0	4.1	4.3	4.0	4.3	4.3
E ≥ 4.9	4.0	4.0	4.1	4.2	4.0	4.2	4.2

**Table B2-17 Loading Table for PWR Fuel – 1,200 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	40 < Assembly Average Burnup ≤ 41 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	4.2	4.2	4.8	4.9	4.5	4.9	4.9
2.7 ≤ E < 2.9	4.1	4.2	4.7	4.8	4.5	4.8	4.8
2.9 ≤ E < 3.1	4.0	4.1	4.7	4.8	4.4	4.8	4.7
3.1 ≤ E < 3.3	4.0	4.1	4.6	4.7	4.4	4.7	4.7
3.3 ≤ E < 3.5	4.0	4.0	4.5	4.7	4.4	4.6	4.6
3.5 ≤ E < 3.7	4.0	4.0	4.5	4.6	4.3	4.6	4.6
3.7 ≤ E < 3.9	4.0	4.0	4.4	4.5	4.2	4.5	4.5
3.9 ≤ E < 4.1	4.0	4.0	4.4	4.5	4.2	4.5	4.5
4.1 ≤ E < 4.3	4.0	4.0	4.4	4.5	4.2	4.5	4.5
4.3 ≤ E < 4.5	4.0	4.0	4.3	4.4	4.1	4.4	4.4
4.5 ≤ E < 4.7	4.0	4.0	4.3	4.4	4.1	4.4	4.4
4.7 ≤ E < 4.9	4.0	4.0	4.3	4.4	4.1	4.4	4.4
E ≥ 4.9	4.0	4.0	4.2	4.3	4.0	4.4	4.3

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	41 < Assembly Average Burnup ≤ 42 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	4.3	4.4	4.9	5.1	4.7	5.0	5.0
2.7 ≤ E < 2.9	4.2	4.3	4.9	5.0	4.6	5.0	5.0
2.9 ≤ E < 3.1	4.2	4.2	4.8	4.9	4.6	4.9	4.9
3.1 ≤ E < 3.3	4.1	4.2	4.7	4.9	4.5	4.8	4.8
3.3 ≤ E < 3.5	4.0	4.1	4.7	4.8	4.5	4.8	4.8
3.5 ≤ E < 3.7	4.0	4.1	4.6	4.8	4.4	4.7	4.7
3.7 ≤ E < 3.9	4.0	4.1	4.6	4.7	4.4	4.7	4.7
3.9 ≤ E < 4.1	4.0	4.0	4.5	4.6	4.3	4.6	4.6
4.1 ≤ E < 4.3	4.0	4.0	4.5	4.6	4.3	4.6	4.6
4.3 ≤ E < 4.5	4.0	4.0	4.4	4.6	4.3	4.5	4.5
4.5 ≤ E < 4.7	4.0	4.0	4.4	4.5	4.2	4.5	4.5
4.7 ≤ E < 4.9	4.0	4.0	4.4	4.5	4.2	4.5	4.5
E ≥ 4.9	4.0	4.0	4.3	4.5	4.2	4.5	4.5

**Table B2-17 Loading Table for PWR Fuel – 1,200 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	42 < Assembly Average Burnup ≤ 43 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	4.4	4.5	5.1	5.3	4.9	5.2	5.2
2.7 ≤ E < 2.9	4.4	4.4	5.0	5.2	4.8	5.1	5.1
2.9 ≤ E < 3.1	4.3	4.4	5.0	5.1	4.7	5.0	5.0
3.1 ≤ E < 3.3	4.2	4.3	4.9	5.0	4.7	5.0	5.0
3.3 ≤ E < 3.5	4.2	4.3	4.8	5.0	4.6	4.9	4.9
3.5 ≤ E < 3.7	4.1	4.2	4.8	4.9	4.5	4.9	4.9
3.7 ≤ E < 3.9	4.1	4.2	4.7	4.9	4.5	4.8	4.8
3.9 ≤ E < 4.1	4.0	4.1	4.7	4.8	4.4	4.8	4.8
4.1 ≤ E < 4.3	4.0	4.1	4.6	4.8	4.4	4.7	4.7
4.3 ≤ E < 4.5	4.0	4.0	4.6	4.7	4.4	4.7	4.7
4.5 ≤ E < 4.7	4.0	4.0	4.5	4.7	4.3	4.7	4.6
4.7 ≤ E < 4.9	4.0	4.0	4.5	4.6	4.3	4.6	4.6
E ≥ 4.9	4.0	4.0	4.4	4.6	4.3	4.6	4.5
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	43 < Assembly Average Burnup ≤ 44 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	4.5	4.6	5.3	5.5	5.0	5.4	5.4
2.7 ≤ E < 2.9	4.5	4.6	5.2	5.4	4.9	5.3	5.3
2.9 ≤ E < 3.1	4.4	4.5	5.1	5.3	4.9	5.2	5.2
3.1 ≤ E < 3.3	4.4	4.4	5.0	5.2	4.8	5.2	5.2
3.3 ≤ E < 3.5	4.3	4.4	5.0	5.1	4.7	5.1	5.1
3.5 ≤ E < 3.7	4.2	4.3	4.9	5.1	4.7	5.0	5.0
3.7 ≤ E < 3.9	4.2	4.3	4.9	5.0	4.6	5.0	5.0
3.9 ≤ E < 4.1	4.1	4.3	4.8	5.0	4.6	4.9	4.9
4.1 ≤ E < 4.3	4.1	4.2	4.8	4.9	4.5	4.9	4.9
4.3 ≤ E < 4.5	4.1	4.2	4.7	4.9	4.5	4.8	4.8
4.5 ≤ E < 4.7	4.0	4.2	4.7	4.8	4.5	4.8	4.8
4.7 ≤ E < 4.9	4.0	4.1	4.6	4.8	4.4	4.8	4.7
E ≥ 4.9	4.0	4.1	4.6	4.8	4.4	4.7	4.7

**Table B2-17 Loading Table for PWR Fuel – 1,200 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	44 < Assembly Average Burnup ≤ 45 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	4.6	4.7	5.4	5.6	5.1	5.5	5.5
2.9 ≤ E < 3.1	4.5	4.6	5.3	5.5	5.0	5.4	5.4
3.1 ≤ E < 3.3	4.5	4.6	5.2	5.4	4.9	5.4	5.4
3.3 ≤ E < 3.5	4.4	4.5	5.2	5.4	4.9	5.3	5.3
3.5 ≤ E < 3.7	4.4	4.5	5.1	5.3	4.8	5.2	5.2
3.7 ≤ E < 3.9	4.3	4.4	5.0	5.2	4.8	5.1	5.1
3.9 ≤ E < 4.1	4.3	4.4	5.0	5.1	4.7	5.1	5.1
4.1 ≤ E < 4.3	4.2	4.3	4.9	5.1	4.7	5.0	5.0
4.3 ≤ E < 4.5	4.2	4.3	4.9	5.0	4.6	5.0	5.0
4.5 ≤ E < 4.7	4.1	4.2	4.8	5.0	4.6	4.9	4.9
4.7 ≤ E < 4.9	4.1	4.2	4.8	4.9	4.5	4.9	4.9
E ≥ 4.9	4.0	4.2	4.7	4.9	4.5	4.9	4.8

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	45 < Assembly Average Burnup ≤ 46 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	5.0	5.2	6.0	6.2	5.6	6.0	6.0
2.9 ≤ E < 3.1	5.0	5.1	5.9	6.0	5.5	6.0	6.0
3.1 ≤ E < 3.3	4.9	5.0	5.8	6.0	5.5	5.9	5.9
3.3 ≤ E < 3.5	4.8	4.9	5.7	5.9	5.4	5.8	5.8
3.5 ≤ E < 3.7	4.8	4.9	5.6	5.8	5.3	5.7	5.7
3.7 ≤ E < 3.9	4.7	4.8	5.6	5.8	5.2	5.7	5.7
3.9 ≤ E < 4.1	4.6	4.8	5.5	5.7	5.1	5.6	5.6
4.1 ≤ E < 4.3	4.6	4.7	5.4	5.6	5.1	5.5	5.6
4.3 ≤ E < 4.5	4.5	4.6	5.4	5.6	5.0	5.5	5.5
4.5 ≤ E < 4.7	4.5	4.6	5.3	5.5	5.0	5.4	5.4
4.7 ≤ E < 4.9	4.4	4.6	5.3	5.5	4.9	5.4	5.4
E ≥ 4.9	4.4	4.5	5.2	5.4	4.9	5.4	5.3

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	46 < Assembly Average Burnup ≤ 47 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	5.2	5.4	6.2	6.5	5.8	6.3	6.3
2.9 ≤ E < 3.1	5.1	5.3	6.1	6.4	5.7	6.2	6.2
3.1 ≤ E < 3.3	5.0	5.2	6.0	6.2	5.6	6.1	6.1
3.3 ≤ E < 3.5	5.0	5.1	5.9	6.1	5.6	6.0	6.0
3.5 ≤ E < 3.7	4.9	5.0	5.8	6.0	5.5	5.9	5.9
3.7 ≤ E < 3.9	4.8	5.0	5.8	6.0	5.4	5.9	5.9
3.9 ≤ E < 4.1	4.8	4.9	5.7	5.9	5.3	5.8	5.8
4.1 ≤ E < 4.3	4.7	4.8	5.6	5.8	5.3	5.8	5.7
4.3 ≤ E < 4.5	4.7	4.8	5.6	5.8	5.2	5.7	5.7
4.5 ≤ E < 4.7	4.6	4.7	5.5	5.7	5.2	5.6	5.6
4.7 ≤ E < 4.9	4.6	4.7	5.5	5.7	5.1	5.6	5.6
E ≥ 4.9	4.5	4.7	5.4	5.6	5.0	5.5	5.5
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	47 < Assembly Average Burnup ≤ 48 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	5.4	5.6	6.5	6.8	6.0	6.6	6.6
2.9 ≤ E < 3.1	5.3	5.5	6.4	6.6	5.9	6.5	6.5
3.1 ≤ E < 3.3	5.2	5.4	6.2	6.5	5.8	6.4	6.4
3.3 ≤ E < 3.5	5.1	5.3	6.1	6.4	5.8	6.2	6.2
3.5 ≤ E < 3.7	5.0	5.2	6.0	6.3	5.7	6.2	6.1
3.7 ≤ E < 3.9	5.0	5.1	5.9	6.2	5.6	6.0	6.0
3.9 ≤ E < 4.1	4.9	5.0	5.9	6.1	5.5	6.0	6.0
4.1 ≤ E < 4.3	4.9	5.0	5.8	6.0	5.5	5.9	5.9
4.3 ≤ E < 4.5	4.8	4.9	5.8	6.0	5.4	5.9	5.9
4.5 ≤ E < 4.7	4.8	4.9	5.7	5.9	5.3	5.8	5.8
4.7 ≤ E < 4.9	4.7	4.9	5.7	5.8	5.3	5.8	5.8
E ≥ 4.9	4.7	4.8	5.6	5.8	5.2	5.7	5.7

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	48 < Assembly Average Burnup ≤ 49 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	5.6	5.8	6.8	7.0	6.3	6.9	6.9
2.9 ≤ E < 3.1	5.5	5.7	6.7	6.9	6.1	6.8	6.7
3.1 ≤ E < 3.3	5.4	5.6	6.5	6.8	6.0	6.6	6.6
3.3 ≤ E < 3.5	5.3	5.5	6.4	6.7	5.9	6.5	6.5
3.5 ≤ E < 3.7	5.2	5.4	6.3	6.6	5.9	6.4	6.4
3.7 ≤ E < 3.9	5.2	5.3	6.2	6.5	5.8	6.3	6.3
3.9 ≤ E < 4.1	5.1	5.2	6.1	6.4	5.7	6.2	6.2
4.1 ≤ E < 4.3	5.0	5.2	6.0	6.3	5.7	6.1	6.1
4.3 ≤ E < 4.5	5.0	5.1	5.9	6.2	5.6	6.0	6.0
4.5 ≤ E < 4.7	4.9	5.0	5.9	6.1	5.5	6.0	6.0
4.7 ≤ E < 4.9	4.8	5.0	5.8	6.0	5.5	5.9	5.9
E ≥ 4.9	4.8	4.9	5.8	6.0	5.4	5.9	5.9
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	49 < Assembly Average Burnup ≤ 50 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	5.7	5.8	6.9	7.3	6.4	7.0	7.0
3.1 ≤ E < 3.3	5.6	5.7	6.8	7.1	6.3	6.9	6.9
3.3 ≤ E < 3.5	5.5	5.6	6.7	7.0	6.2	6.8	6.8
3.5 ≤ E < 3.7	5.4	5.5	6.6	6.9	6.0	6.7	6.7
3.7 ≤ E < 3.9	5.4	5.5	6.5	6.8	6.0	6.6	6.6
3.9 ≤ E < 4.1	5.3	5.4	6.4	6.7	5.9	6.5	6.5
4.1 ≤ E < 4.3	5.2	5.3	6.3	6.6	5.8	6.4	6.4
4.3 ≤ E < 4.5	5.1	5.2	6.2	6.5	5.8	6.3	6.3
4.5 ≤ E < 4.7	5.0	5.2	6.1	6.4	5.7	6.2	6.2
4.7 ≤ E < 4.9	5.0	5.1	6.0	6.3	5.7	6.2	6.2
E ≥ 4.9	4.9	5.0	6.0	6.2	5.6	6.1	6.1

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	50 < Assembly Average Burnup ≤ 51 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	5.8	6.0	7.3	7.6	6.7	7.4	7.4
3.1 ≤ E < 3.3	5.8	5.9	7.1	7.5	6.6	7.2	7.2
3.3 ≤ E < 3.5	5.7	5.8	7.0	7.3	6.4	7.1	7.0
3.5 ≤ E < 3.7	5.6	5.7	6.8	7.2	6.3	6.9	6.9
3.7 ≤ E < 3.9	5.5	5.7	6.7	7.0	6.2	6.9	6.8
3.9 ≤ E < 4.1	5.4	5.6	6.6	6.9	6.1	6.8	6.8
4.1 ≤ E < 4.3	5.3	5.5	6.5	6.8	6.0	6.7	6.7
4.3 ≤ E < 4.5	5.2	5.4	6.4	6.8	6.0	6.6	6.6
4.5 ≤ E < 4.7	5.2	5.4	6.4	6.7	5.9	6.5	6.5
4.7 ≤ E < 4.9	5.1	5.3	6.3	6.6	5.8	6.4	6.4
E ≥ 4.9	5.0	5.2	6.2	6.5	5.8	6.4	6.3
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	51 < Assembly Average Burnup ≤ 52 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	6.0	6.3	7.6	7.9	6.9	7.7	7.7
3.1 ≤ E < 3.3	5.9	6.1	7.5	7.7	6.8	7.6	7.6
3.3 ≤ E < 3.5	5.8	6.0	7.3	7.6	6.7	7.4	7.4
3.5 ≤ E < 3.7	5.8	5.9	7.1	7.4	6.6	7.3	7.3
3.7 ≤ E < 3.9	5.7	5.9	7.0	7.3	6.5	7.1	7.1
3.9 ≤ E < 4.1	5.6	5.8	6.9	7.1	6.4	7.0	7.0
4.1 ≤ E < 4.3	5.5	5.7	6.8	7.0	6.3	6.9	6.9
4.3 ≤ E < 4.5	5.4	5.6	6.7	6.9	6.2	6.8	6.8
4.5 ≤ E < 4.7	5.4	5.6	6.6	6.8	6.1	6.8	6.8
4.7 ≤ E < 4.9	5.3	5.5	6.5	6.8	6.0	6.7	6.7
E ≥ 4.9	5.2	5.4	6.5	6.7	6.0	6.6	6.6

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	52 < Assembly Average Burnup ≤ 53 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	6.3	6.5	7.9	8.3	7.3	8.1	8.1
3.1 ≤ E < 3.3	6.2	6.4	7.7	8.1	7.1	7.9	7.9
3.3 ≤ E < 3.5	6.0	6.3	7.5	7.9	7.0	7.8	7.8
3.5 ≤ E < 3.7	5.9	6.1	7.4	7.8	6.9	7.6	7.6
3.7 ≤ E < 3.9	5.8	6.1	7.2	7.6	6.7	7.5	7.5
3.9 ≤ E < 4.1	5.8	6.0	7.1	7.5	6.6	7.4	7.3
4.1 ≤ E < 4.3	5.7	5.9	7.0	7.4	6.5	7.2	7.2
4.3 ≤ E < 4.5	5.6	5.8	6.9	7.2	6.4	7.1	7.1
4.5 ≤ E < 4.7	5.5	5.7	6.8	7.1	6.4	7.0	7.0
4.7 ≤ E < 4.9	5.5	5.7	6.7	7.0	6.3	6.9	6.9
E ≥ 4.9	5.4	5.6	6.6	6.9	6.2	6.9	6.9
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	53 < Assembly Average Burnup ≤ 54 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	6.6	6.8	8.3	8.8	7.6	8.6	8.6
3.1 ≤ E < 3.3	6.4	6.7	8.0	8.6	7.5	8.3	8.3
3.3 ≤ E < 3.5	6.3	6.5	7.9	8.3	7.3	8.2	8.1
3.5 ≤ E < 3.7	6.1	6.4	7.7	8.1	7.1	8.0	8.0
3.7 ≤ E < 3.9	6.0	6.3	7.6	8.0	7.0	7.9	7.8
3.9 ≤ E < 4.1	5.9	6.2	7.4	7.8	6.9	7.7	7.7
4.1 ≤ E < 4.3	5.9	6.1	7.3	7.7	6.8	7.6	7.6
4.3 ≤ E < 4.5	5.8	6.0	7.2	7.6	6.7	7.5	7.5
4.5 ≤ E < 4.7	5.7	5.9	7.0	7.5	6.6	7.4	7.3
4.7 ≤ E < 4.9	5.7	5.9	7.0	7.4	6.5	7.2	7.2
E ≥ 4.9	5.6	5.9	6.9	7.3	6.4	7.1	7.1

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	54 < Assembly Average Burnup ≤ 55 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	6.7	6.9	8.5	9.0	7.8	8.8	8.8
3.3 ≤ E < 3.5	6.6	6.8	8.3	8.8	7.6	8.6	8.6
3.5 ≤ E < 3.7	6.4	6.7	8.1	8.6	7.5	8.4	8.4
3.7 ≤ E < 3.9	6.3	6.6	7.9	8.4	7.3	8.2	8.2
3.9 ≤ E < 4.1	6.2	6.5	7.8	8.2	7.2	8.0	8.0
4.1 ≤ E < 4.3	6.1	6.3	7.6	8.1	7.0	7.9	7.9
4.3 ≤ E < 4.5	6.0	6.2	7.5	7.9	7.0	7.8	7.8
4.5 ≤ E < 4.7	5.9	6.1	7.4	7.8	6.9	7.7	7.7
4.7 ≤ E < 4.9	5.9	6.0	7.3	7.7	6.8	7.6	7.6
E ≥ 4.9	5.8	6.0	7.2	7.6	6.7	7.5	7.5
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	55 < Assembly Average Burnup ≤ 56 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	6.9	7.3	8.9	9.6	8.0	9.3	9.3
3.3 ≤ E < 3.5	6.8	7.1	8.7	9.3	7.8	9.0	9.0
3.5 ≤ E < 3.7	6.7	6.9	8.5	9.1	7.7	8.8	8.9
3.7 ≤ E < 3.9	6.6	6.8	8.3	8.9	7.5	8.7	8.7
3.9 ≤ E < 4.1	6.4	6.7	8.1	8.7	7.4	8.5	8.5
4.1 ≤ E < 4.3	6.3	6.6	8.0	8.5	7.2	8.3	8.3
4.3 ≤ E < 4.5	6.2	6.5	7.9	8.4	7.1	8.2	8.1
4.5 ≤ E < 4.7	6.1	6.4	7.7	8.2	7.0	8.0	8.0
4.7 ≤ E < 4.9	6.0	6.3	7.6	8.1	6.9	7.9	7.9
E ≥ 4.9	6.0	6.2	7.5	8.0	6.8	7.8	7.8

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	56 < Assembly Average Burnup ≤ 57 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	7.3	7.6	9.4	10.1	8.4	9.8	9.8
3.3 ≤ E < 3.5	7.1	7.4	9.2	9.9	8.2	9.6	9.6
3.5 ≤ E < 3.7	6.9	7.3	9.0	9.6	8.0	9.4	9.3
3.7 ≤ E < 3.9	6.8	7.1	8.8	9.4	7.9	9.1	9.1
3.9 ≤ E < 4.1	6.7	7.0	8.6	9.2	7.7	8.9	8.9
4.1 ≤ E < 4.3	6.6	6.9	8.4	9.0	7.6	8.8	8.8
4.3 ≤ E < 4.5	6.5	6.8	8.2	8.8	7.5	8.6	8.6
4.5 ≤ E < 4.7	6.4	6.7	8.1	8.7	7.3	8.5	8.4
4.7 ≤ E < 4.9	6.3	6.6	8.0	8.5	7.2	8.3	8.3
E ≥ 4.9	6.2	6.5	7.8	8.4	7.1	8.2	8.2
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	57 < Assembly Average Burnup ≤ 58 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	7.6	8.0	10.0	10.8	8.9	10.5	10.4
3.3 ≤ E < 3.5	7.4	7.8	9.7	10.5	8.7	10.2	10.1
3.5 ≤ E < 3.7	7.2	7.6	9.5	10.2	8.4	9.9	9.9
3.7 ≤ E < 3.9	7.1	7.5	9.3	9.9	8.2	9.7	9.6
3.9 ≤ E < 4.1	6.9	7.3	9.0	9.7	8.1	9.5	9.4
4.1 ≤ E < 4.3	6.8	7.1	8.8	9.5	7.9	9.2	9.2
4.3 ≤ E < 4.5	6.7	7.0	8.7	9.3	7.8	9.0	9.0
4.5 ≤ E < 4.7	6.6	6.9	8.5	9.1	7.7	8.9	8.9
4.7 ≤ E < 4.9	6.5	6.8	8.4	8.9	7.5	8.7	8.7
E ≥ 4.9	6.4	6.7	8.2	8.8	7.4	8.6	8.6

**Table B2-18 Loading Table for PWR Fuel – 1,140 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	58 < Assembly Average Burnup ≤ 59 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	7.9	8.4	10.7	11.5	9.4	11.1	11.1
3.3 ≤ E < 3.5	7.8	8.2	10.3	11.2	9.1	10.8	10.8
3.5 ≤ E < 3.7	7.6	8.0	10.0	10.9	8.9	10.5	10.5
3.7 ≤ E < 3.9	7.4	7.8	9.8	10.6	8.7	10.2	10.2
3.9 ≤ E < 4.1	7.2	7.6	9.5	10.3	8.5	10.0	9.9
4.1 ≤ E < 4.3	7.1	7.5	9.3	10.0	8.3	9.8	9.7
4.3 ≤ E < 4.5	7.0	7.3	9.1	9.8	8.1	9.6	9.5
4.5 ≤ E < 4.7	6.9	7.2	8.9	9.6	8.0	9.4	9.4
4.7 ≤ E < 4.9	6.8	7.1	8.8	9.5	7.9	9.2	9.2
E ≥ 4.9	6.7	7.0	8.7	9.3	7.8	9.0	9.0
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	59 < Assembly Average Burnup ≤ 60 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	-	-	-	-	-	-	-
3.3 ≤ E < 3.5	8.1	8.6	11.0	11.8	9.6	11.2	11.2
3.5 ≤ E < 3.7	7.9	8.4	10.7	11.5	9.4	10.9	10.8
3.7 ≤ E < 3.9	7.7	8.2	10.3	11.2	9.1	10.6	10.5
3.9 ≤ E < 4.1	7.6	8.0	10.1	11.0	8.9	10.3	10.3
4.1 ≤ E < 4.3	7.4	7.8	9.8	10.7	8.7	10.0	10.0
4.3 ≤ E < 4.5	7.3	7.7	9.6	10.4	8.5	9.8	9.8
4.5 ≤ E < 4.7	7.1	7.6	9.4	10.2	8.4	9.7	9.6
4.7 ≤ E < 4.9	7.0	7.4	9.2	10.0	8.2	9.5	9.4
E ≥ 4.9	6.9	7.3	9.1	9.8	8.1	9.3	9.3

**Table B2-19 Loading Table for PWR Fuel – 922 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	30 < Assembly Average Burnup ≤ 32.5 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	4.2	4.3	4.8	4.9	4.6	4.9	4.9
2.3 ≤ E < 2.5	4.2	4.2	4.7	4.8	4.5	4.8	4.8
2.5 ≤ E < 2.7	4.1	4.2	4.7	4.8	4.5	4.8	4.8
2.7 ≤ E < 2.9	4.1	4.1	4.6	4.7	4.4	4.7	4.7
2.9 ≤ E < 3.1	4.0	4.1	4.6	4.7	4.4	4.7	4.7
3.1 ≤ E < 3.3	4.0	4.0	4.5	4.6	4.3	4.6	4.6
3.3 ≤ E < 3.5	4.0	4.0	4.5	4.6	4.3	4.6	4.6
3.5 ≤ E < 3.7	4.0	4.0	4.5	4.5	4.3	4.5	4.5
3.7 ≤ E < 3.9	4.0	4.0	4.4	4.5	4.2	4.5	4.5
3.9 ≤ E < 4.1	4.0	4.0	4.4	4.5	4.2	4.5	4.5
4.1 ≤ E < 4.3	4.0	4.0	4.4	4.5	4.2	4.4	4.4
4.3 ≤ E < 4.5	4.0	4.0	4.3	4.4	4.2	4.4	4.4
4.5 ≤ E < 4.7	4.0	4.0	4.3	4.4	4.1	4.4	4.4
4.7 ≤ E < 4.9	4.0	4.0	4.3	4.4	4.1	4.4	4.4
E ≥ 4.9	4.0	4.0	4.3	4.4	4.1	4.4	4.4

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	32.5 < Assembly Average Burnup ≤ 35 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.5	4.6	5.2	5.3	4.9	5.3	5.3
2.5 ≤ E < 2.7	4.4	4.5	5.1	5.3	4.9	5.2	5.2
2.7 ≤ E < 2.9	4.4	4.5	5.0	5.2	4.8	5.1	5.1
2.9 ≤ E < 3.1	4.4	4.4	5.0	5.1	4.8	5.1	5.1
3.1 ≤ E < 3.3	4.3	4.4	4.9	5.0	4.7	5.0	5.0
3.3 ≤ E < 3.5	4.3	4.3	4.9	5.0	4.7	5.0	5.0
3.5 ≤ E < 3.7	4.2	4.3	4.8	5.0	4.6	4.9	4.9
3.7 ≤ E < 3.9	4.2	4.3	4.8	4.9	4.6	4.9	4.9
3.9 ≤ E < 4.1	4.1	4.2	4.8	4.9	4.5	4.9	4.9
4.1 ≤ E < 4.3	4.1	4.2	4.7	4.9	4.5	4.8	4.8
4.3 ≤ E < 4.5	4.1	4.2	4.7	4.8	4.5	4.8	4.8
4.5 ≤ E < 4.7	4.0	4.1	4.7	4.8	4.5	4.8	4.8
4.7 ≤ E < 4.9	4.0	4.1	4.6	4.8	4.4	4.7	4.7
E ≥ 4.9	4.0	4.1	4.6	4.7	4.4	4.7	4.7

**Table B2-19 Loading Table for PWR Fuel – 922 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	35 < Assembly Average Burnup ≤ 37.5 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.9	5.0	5.7	5.9	5.4	5.8	5.8
2.5 ≤ E < 2.7	4.8	4.9	5.7	5.8	5.3	5.7	5.7
2.7 ≤ E < 2.9	4.8	4.9	5.6	5.8	5.3	5.7	5.7
2.9 ≤ E < 3.1	4.7	4.8	5.5	5.7	5.2	5.6	5.6
3.1 ≤ E < 3.3	4.6	4.7	5.4	5.6	5.1	5.5	5.5
3.3 ≤ E < 3.5	4.6	4.7	5.4	5.6	5.0	5.5	5.5
3.5 ≤ E < 3.7	4.5	4.6	5.3	5.5	5.0	5.4	5.4
3.7 ≤ E < 3.9	4.5	4.6	5.3	5.4	5.0	5.4	5.4
3.9 ≤ E < 4.1	4.5	4.6	5.2	5.4	4.9	5.3	5.3
4.1 ≤ E < 4.3	4.4	4.5	5.2	5.4	4.9	5.3	5.3
4.3 ≤ E < 4.5	4.4	4.5	5.1	5.3	4.9	5.2	5.2
4.5 ≤ E < 4.7	4.4	4.5	5.1	5.3	4.8	5.2	5.2
4.7 ≤ E < 4.9	4.3	4.4	5.0	5.2	4.8	5.2	5.2
E ≥ 4.9	4.3	4.4	5.0	5.2	4.8	5.1	5.1
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	37.5 < Assembly Average Burnup ≤ 40 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.3	5.4	6.2	6.5	5.9	6.3	6.3
2.7 ≤ E < 2.9	5.2	5.3	6.1	6.4	5.8	6.2	6.2
2.9 ≤ E < 3.1	5.1	5.3	6.0	6.3	5.7	6.1	6.1
3.1 ≤ E < 3.3	5.0	5.2	6.0	6.2	5.6	6.0	6.0
3.3 ≤ E < 3.5	5.0	5.1	5.9	6.1	5.6	6.0	6.0
3.5 ≤ E < 3.7	4.9	5.0	5.9	6.0	5.5	5.9	5.9
3.7 ≤ E < 3.9	4.9	5.0	5.8	6.0	5.5	5.9	5.9
3.9 ≤ E < 4.1	4.8	5.0	5.7	5.9	5.4	5.8	5.8
4.1 ≤ E < 4.3	4.8	4.9	5.7	5.9	5.4	5.8	5.8
4.3 ≤ E < 4.5	4.8	4.9	5.7	5.8	5.3	5.8	5.7
4.5 ≤ E < 4.7	4.7	4.8	5.6	5.8	5.3	5.7	5.7
4.7 ≤ E < 4.9	4.7	4.8	5.6	5.8	5.2	5.7	5.7
E ≥ 4.9	4.6	4.8	5.5	5.7	5.2	5.6	5.6

**Table B2-19 Loading Table for PWR Fuel – 922 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	40 < Assembly Average Burnup ≤ 41 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.5	5.6	6.6	6.8	6.0	6.6	6.6
2.7 ≤ E < 2.9	5.4	5.6	6.4	6.7	6.0	6.5	6.5
2.9 ≤ E < 3.1	5.3	5.5	6.3	6.6	5.9	6.4	6.4
3.1 ≤ E < 3.3	5.3	5.4	6.2	6.5	5.8	6.3	6.3
3.3 ≤ E < 3.5	5.2	5.3	6.1	6.4	5.8	6.3	6.2
3.5 ≤ E < 3.7	5.1	5.3	6.1	6.3	5.7	6.2	6.2
3.7 ≤ E < 3.9	5.0	5.2	6.0	6.2	5.7	6.1	6.1
3.9 ≤ E < 4.1	5.0	5.1	5.9	6.2	5.6	6.0	6.0
4.1 ≤ E < 4.3	5.0	5.1	5.9	6.1	5.6	6.0	6.0
4.3 ≤ E < 4.5	4.9	5.0	5.9	6.0	5.5	5.9	5.9
4.5 ≤ E < 4.7	4.9	5.0	5.8	6.0	5.5	5.9	5.9
4.7 ≤ E < 4.9	4.8	5.0	5.8	6.0	5.4	5.9	5.9
E ≥ 4.9	4.8	4.9	5.7	5.9	5.4	5.8	5.8
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	41 < Assembly Average Burnup ≤ 42 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.7	5.9	6.9	7.1	6.4	6.9	6.9
2.7 ≤ E < 2.9	5.6	5.8	6.7	7.0	6.2	6.8	6.8
2.9 ≤ E < 3.1	5.6	5.7	6.6	6.9	6.1	6.7	6.7
3.1 ≤ E < 3.3	5.5	5.6	6.5	6.8	6.0	6.6	6.6
3.3 ≤ E < 3.5	5.4	5.5	6.4	6.7	6.0	6.6	6.5
3.5 ≤ E < 3.7	5.3	5.5	6.4	6.6	5.9	6.5	6.5
3.7 ≤ E < 3.9	5.3	5.4	6.3	6.6	5.9	6.4	6.4
3.9 ≤ E < 4.1	5.2	5.4	6.2	6.5	5.8	6.3	6.3
4.1 ≤ E < 4.3	5.1	5.3	6.1	6.4	5.8	6.3	6.2
4.3 ≤ E < 4.5	5.1	5.2	6.0	6.3	5.7	6.2	6.2
4.5 ≤ E < 4.7	5.0	5.2	6.0	6.3	5.7	6.1	6.1
4.7 ≤ E < 4.9	5.0	5.1	6.0	6.2	5.6	6.1	6.1
E ≥ 4.9	4.9	5.1	5.9	6.2	5.6	6.0	6.0

**Table B2-19 Loading Table for PWR Fuel – 922 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	42 < Assembly Average Burnup ≤ 43 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.9	6.1	7.2	7.5	6.7	7.3	7.3
2.7 ≤ E < 2.9	5.8	6.0	7.0	7.4	6.5	7.1	7.1
2.9 ≤ E < 3.1	5.8	5.9	6.9	7.3	6.4	7.0	7.0
3.1 ≤ E < 3.3	5.7	5.8	6.8	7.1	6.3	6.9	6.9
3.3 ≤ E < 3.5	5.6	5.8	6.7	7.0	6.2	6.8	6.8
3.5 ≤ E < 3.7	5.5	5.7	6.7	6.9	6.1	6.8	6.7
3.7 ≤ E < 3.9	5.5	5.6	6.6	6.8	6.1	6.7	6.7
3.9 ≤ E < 4.1	5.4	5.6	6.5	6.8	6.0	6.6	6.6
4.1 ≤ E < 4.3	5.3	5.5	6.4	6.7	6.0	6.5	6.5
4.3 ≤ E < 4.5	5.3	5.5	6.4	6.6	5.9	6.5	6.5
4.5 ≤ E < 4.7	5.2	5.4	6.3	6.6	5.9	6.4	6.4
4.7 ≤ E < 4.9	5.2	5.3	6.2	6.5	5.8	6.4	6.4
E ≥ 4.9	5.1	5.3	6.2	6.5	5.8	6.3	6.3
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	43 < Assembly Average Burnup ≤ 44 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.2	6.4	7.6	8.0	6.9	7.7	7.7
2.7 ≤ E < 2.9	6.0	6.2	7.4	7.8	6.8	7.5	7.5
2.9 ≤ E < 3.1	6.0	6.1	7.3	7.7	6.7	7.4	7.4
3.1 ≤ E < 3.3	5.9	6.0	7.2	7.5	6.6	7.3	7.3
3.3 ≤ E < 3.5	5.8	6.0	7.0	7.4	6.5	7.1	7.1
3.5 ≤ E < 3.7	5.8	5.9	6.9	7.3	6.4	7.0	7.0
3.7 ≤ E < 3.9	5.7	5.8	6.9	7.2	6.3	7.0	7.0
3.9 ≤ E < 4.1	5.6	5.8	6.8	7.1	6.3	6.9	6.9
4.1 ≤ E < 4.3	5.5	5.7	6.7	7.0	6.2	6.8	6.8
4.3 ≤ E < 4.5	5.5	5.7	6.7	6.9	6.1	6.8	6.8
4.5 ≤ E < 4.7	5.4	5.6	6.6	6.9	6.0	6.7	6.7
4.7 ≤ E < 4.9	5.4	5.6	6.5	6.8	6.0	6.6	6.6
E ≥ 4.9	5.3	5.5	6.5	6.8	6.0	6.6	6.6

**Table B2-19 Loading Table for PWR Fuel – 922 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	44 < Assembly Average Burnup ≤ 45 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	6.3	6.6	7.8	8.3	7.1	7.9	7.9
2.9 ≤ E < 3.1	6.2	6.4	7.7	8.1	7.0	7.8	7.8
3.1 ≤ E < 3.3	6.1	6.3	7.6	7.9	6.9	7.7	7.7
3.3 ≤ E < 3.5	6.0	6.2	7.4	7.8	6.8	7.5	7.5
3.5 ≤ E < 3.7	5.9	6.1	7.3	7.7	6.7	7.4	7.4
3.7 ≤ E < 3.9	5.9	6.0	7.2	7.6	6.6	7.3	7.3
3.9 ≤ E < 4.1	5.8	6.0	7.1	7.5	6.6	7.2	7.2
4.1 ≤ E < 4.3	5.7	5.9	7.0	7.4	6.5	7.1	7.1
4.3 ≤ E < 4.5	5.7	5.9	6.9	7.3	6.4	7.0	7.0
4.5 ≤ E < 4.7	5.6	5.8	6.9	7.2	6.3	7.0	7.0
4.7 ≤ E < 4.9	5.6	5.8	6.8	7.1	6.3	6.9	6.9
E ≥ 4.9	5.5	5.7	6.7	7.0	6.2	6.9	6.9

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	45 < Assembly Average Burnup ≤ 46 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.1	7.4	9.2	9.8	8.2	9.3	9.3
2.9 ≤ E < 3.1	7.0	7.3	9.0	9.6	8.0	9.1	9.0
3.1 ≤ E < 3.3	6.9	7.1	8.8	9.4	7.9	8.9	8.9
3.3 ≤ E < 3.5	6.8	7.0	8.6	9.1	7.8	8.7	8.7
3.5 ≤ E < 3.7	6.7	6.9	8.5	9.0	7.6	8.6	8.6
3.7 ≤ E < 3.9	6.6	6.8	8.3	8.9	7.5	8.5	8.4
3.9 ≤ E < 4.1	6.5	6.7	8.2	8.7	7.4	8.3	8.3
4.1 ≤ E < 4.3	6.4	6.6	8.1	8.6	7.3	8.2	8.2
4.3 ≤ E < 4.5	6.3	6.6	8.0	8.5	7.2	8.1	8.1
4.5 ≤ E < 4.7	6.2	6.5	7.9	8.4	7.2	8.0	8.0
4.7 ≤ E < 4.9	6.2	6.4	7.8	8.3	7.1	8.0	7.9
E ≥ 4.9	6.1	6.4	7.7	8.2	7.0	7.9	7.9

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	46 < Assembly Average Burnup ≤ 47 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.5	7.8	9.8	10.5	8.7	9.9	9.9
2.9 ≤ E < 3.1	7.4	7.7	9.6	10.3	8.5	9.7	9.7
3.1 ≤ E < 3.3	7.2	7.5	9.3	10.0	8.3	9.5	9.5
3.3 ≤ E < 3.5	7.1	7.4	9.1	9.8	8.1	9.3	9.3
3.5 ≤ E < 3.7	7.0	7.2	9.0	9.6	8.0	9.1	9.1
3.7 ≤ E < 3.9	6.9	7.1	8.8	9.4	7.9	9.0	8.9
3.9 ≤ E < 4.1	6.8	7.0	8.7	9.3	7.8	8.8	8.8
4.1 ≤ E < 4.3	6.7	6.9	8.6	9.1	7.7	8.7	8.7
4.3 ≤ E < 4.5	6.6	6.9	8.4	9.0	7.6	8.6	8.6
4.5 ≤ E < 4.7	6.5	6.8	8.3	8.9	7.5	8.5	8.5
4.7 ≤ E < 4.9	6.5	6.7	8.2	8.8	7.5	8.4	8.4
E ≥ 4.9	6.4	6.7	8.1	8.7	7.4	8.3	8.3
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	47 < Assembly Average Burnup ≤ 48 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.9	8.3	10.5	11.3	9.2	10.7	10.6
2.9 ≤ E < 3.1	7.7	8.1	10.2	11.1	9.0	10.4	10.3
3.1 ≤ E < 3.3	7.6	7.9	10.0	10.8	8.8	10.1	10.1
3.3 ≤ E < 3.5	7.4	7.8	9.7	10.5	8.7	9.9	9.9
3.5 ≤ E < 3.7	7.3	7.6	9.6	10.3	8.5	9.7	9.7
3.7 ≤ E < 3.9	7.2	7.5	9.4	10.1	8.4	9.5	9.5
3.9 ≤ E < 4.1	7.0	7.4	9.2	9.9	8.2	9.4	9.4
4.1 ≤ E < 4.3	7.0	7.3	9.0	9.7	8.1	9.2	9.2
4.3 ≤ E < 4.5	6.9	7.2	8.9	9.6	8.0	9.1	9.1
4.5 ≤ E < 4.7	6.8	7.1	8.8	9.5	7.9	9.0	9.0
4.7 ≤ E < 4.9	6.7	7.0	8.7	9.4	7.8	8.9	8.9
E ≥ 4.9	6.7	6.9	8.6	9.2	7.7	8.8	8.8

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	48 < Assembly Average Burnup ≤ 49 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	8.4	8.8	11.3	12.1	9.9	11.4	11.4
2.9 ≤ E < 3.1	8.2	8.6	11.0	11.8	9.6	11.1	11.1
3.1 ≤ E < 3.3	8.0	8.4	10.7	11.6	9.4	10.9	10.8
3.3 ≤ E < 3.5	7.8	8.2	10.4	11.3	9.2	10.6	10.6
3.5 ≤ E < 3.7	7.7	8.0	10.2	11.1	9.0	10.4	10.4
3.7 ≤ E < 3.9	7.6	7.9	10.0	10.8	8.8	10.2	10.1
3.9 ≤ E < 4.1	7.4	7.8	9.8	10.6	8.7	10.0	9.9
4.1 ≤ E < 4.3	7.3	7.7	9.7	10.4	8.6	9.8	9.8
4.3 ≤ E < 4.5	7.2	7.6	9.5	10.3	8.4	9.7	9.7
4.5 ≤ E < 4.7	7.1	7.5	9.4	10.1	8.3	9.6	9.5
4.7 ≤ E < 4.9	7.0	7.4	9.2	10.0	8.2	9.4	9.4
E ≥ 4.9	6.9	7.3	9.1	9.8	8.1	9.3	9.3
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	49 < Assembly Average Burnup ≤ 50 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	8.7	8.9	11.8	12.7	10.2	11.9	11.9
3.1 ≤ E < 3.3	8.4	8.7	11.5	12.4	10.0	11.7	11.6
3.3 ≤ E < 3.5	8.2	8.5	11.2	12.1	9.8	11.4	11.4
3.5 ≤ E < 3.7	8.1	8.4	11.0	11.8	9.6	11.2	11.1
3.7 ≤ E < 3.9	7.9	8.2	10.7	11.6	9.4	10.9	10.9
3.9 ≤ E < 4.1	7.8	8.0	10.5	11.4	9.2	10.7	10.7
4.1 ≤ E < 4.3	7.7	7.9	10.3	11.2	9.0	10.5	10.5
4.3 ≤ E < 4.5	7.6	7.8	10.1	11.0	8.9	10.4	10.3
4.5 ≤ E < 4.7	7.5	7.7	9.9	10.9	8.8	10.2	10.1
4.7 ≤ E < 4.9	7.4	7.6	9.8	10.7	8.7	10.0	10.0
E ≥ 4.9	7.3	7.6	9.7	10.5	8.6	9.9	9.9

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	50 < Assembly Average Burnup ≤ 51 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	8.9	9.5	12.6	13.7	11.0	12.8	12.8
3.1 ≤ E < 3.3	8.7	9.3	12.2	13.3	10.7	12.5	12.4
3.3 ≤ E < 3.5	8.5	9.0	11.9	13.0	10.5	12.1	12.1
3.5 ≤ E < 3.7	8.4	8.8	11.7	12.7	10.2	11.9	11.9
3.7 ≤ E < 3.9	8.2	8.7	11.5	12.4	10.0	11.7	11.6
3.9 ≤ E < 4.1	8.0	8.5	11.2	12.2	9.8	11.5	11.4
4.1 ≤ E < 4.3	7.9	8.4	11.0	11.9	9.6	11.3	11.2
4.3 ≤ E < 4.5	7.8	8.2	10.9	11.8	9.5	11.1	11.0
4.5 ≤ E < 4.7	7.7	8.1	10.7	11.6	9.3	10.9	10.9
4.7 ≤ E < 4.9	7.6	8.0	10.5	11.4	9.2	10.8	10.7
E ≥ 4.9	7.5	7.9	10.4	11.3	9.1	10.6	10.6
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	51 < Assembly Average Burnup ≤ 52 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	9.5	10.1	13.5	14.3	11.7	13.7	13.7
3.1 ≤ E < 3.3	9.2	9.8	13.2	13.9	11.5	13.4	13.4
3.3 ≤ E < 3.5	9.0	9.6	12.8	13.6	11.2	13.1	13.0
3.5 ≤ E < 3.7	8.8	9.4	12.5	13.3	10.9	12.8	12.7
3.7 ≤ E < 3.9	8.7	9.2	12.2	13.0	10.7	12.5	12.4
3.9 ≤ E < 4.1	8.5	9.0	12.0	12.8	10.4	12.2	12.2
4.1 ≤ E < 4.3	8.3	8.9	11.8	12.5	10.2	12.0	11.9
4.3 ≤ E < 4.5	8.2	8.7	11.6	12.3	10.0	11.8	11.8
4.5 ≤ E < 4.7	8.1	8.6	11.4	12.1	9.9	11.6	11.6
4.7 ≤ E < 4.9	8.0	8.5	11.2	11.9	9.8	11.5	11.5
E ≥ 4.9	7.9	8.3	11.1	11.8	9.6	11.3	11.3

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	52 < Assembly Average Burnup ≤ 53 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	10.1	10.9	14.0	15.3	12.6	14.7	14.7
3.1 ≤ E < 3.3	9.8	10.5	13.7	14.9	12.2	14.3	14.3
3.3 ≤ E < 3.5	9.6	10.2	13.4	14.6	11.9	14.0	13.9
3.5 ≤ E < 3.7	9.3	10.0	13.1	14.2	11.6	13.7	13.6
3.7 ≤ E < 3.9	9.1	9.9	12.8	13.9	11.4	13.4	13.3
3.9 ≤ E < 4.1	8.9	9.6	12.5	13.7	11.2	13.1	13.1
4.1 ≤ E < 4.3	8.8	9.4	12.2	13.4	11.0	12.9	12.8
4.3 ≤ E < 4.5	8.7	9.2	12.0	13.2	10.8	12.6	12.6
4.5 ≤ E < 4.7	8.5	9.0	11.8	13.0	10.6	12.4	12.4
4.7 ≤ E < 4.9	8.4	8.9	11.7	12.8	10.4	12.2	12.2
E ≥ 4.9	8.3	8.8	11.5	12.6	10.2	12.0	12.0
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	53 < Assembly Average Burnup ≤ 54 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	10.8	11.6	15.1	16.4	13.5	15.7	15.6
3.1 ≤ E < 3.3	10.5	11.3	14.6	15.9	13.1	15.3	15.3
3.3 ≤ E < 3.5	10.1	11.0	14.2	15.6	12.7	14.9	14.9
3.5 ≤ E < 3.7	9.9	10.7	13.9	15.2	12.4	14.6	14.6
3.7 ≤ E < 3.9	9.7	10.4	13.6	14.9	12.1	14.3	14.2
3.9 ≤ E < 4.1	9.5	10.2	13.4	14.6	11.9	14.0	14.0
4.1 ≤ E < 4.3	9.3	9.9	13.1	14.3	11.7	13.7	13.7
4.3 ≤ E < 4.5	9.1	9.8	12.9	14.0	11.5	13.5	13.5
4.5 ≤ E < 4.7	9.0	9.6	12.6	13.8	11.3	13.3	13.3
4.7 ≤ E < 4.9	8.8	9.5	12.4	13.6	11.1	13.1	13.1
E ≥ 4.9	8.7	9.6	12.2	13.4	10.9	12.9	12.9

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	54 < Assembly Average Burnup ≤ 55 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	11.2	12.0	15.6	17.0	13.9	16.3	16.3
3.3 ≤ E < 3.5	10.9	11.7	15.2	16.6	13.6	15.9	15.9
3.5 ≤ E < 3.7	10.6	11.4	14.9	16.2	13.3	15.6	15.6
3.7 ≤ E < 3.9	10.3	11.2	14.5	15.9	13.0	15.3	15.3
3.9 ≤ E < 4.1	10.0	10.9	14.2	15.6	12.7	15.0	14.9
4.1 ≤ E < 4.3	9.9	10.7	13.9	15.3	12.4	14.7	14.6
4.3 ≤ E < 4.5	9.7	10.5	13.7	15.1	12.2	14.4	14.4
4.5 ≤ E < 4.7	9.5	10.2	13.5	14.8	12.0	14.1	14.1
4.7 ≤ E < 4.9	9.3	10.0	13.3	14.6	11.8	13.9	13.9
E ≥ 4.9	9.2	9.9	13.1	14.3	11.6	13.8	13.7
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	55 < Assembly Average Burnup ≤ 56 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	11.9	12.8	16.6	18.1	14.5	17.4	17.3
3.3 ≤ E < 3.5	11.5	12.5	16.2	17.6	14.1	17.0	16.9
3.5 ≤ E < 3.7	11.3	12.1	15.8	17.3	13.7	16.6	16.6
3.7 ≤ E < 3.9	11.0	11.8	15.5	17.0	13.4	16.3	16.2
3.9 ≤ E < 4.1	10.7	11.6	15.2	16.6	13.2	15.9	15.9
4.1 ≤ E < 4.3	10.5	11.3	14.9	16.3	12.9	15.7	15.6
4.3 ≤ E < 4.5	10.2	11.1	14.6	16.0	12.6	15.4	15.3
4.5 ≤ E < 4.7	10.0	10.9	14.3	15.8	12.4	15.2	15.1
4.7 ≤ E < 4.9	9.9	10.7	14.1	15.6	12.2	14.9	14.9
E ≥ 4.9	9.7	10.5	13.9	15.3	12.0	14.7	14.6

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	56 < Assembly Average Burnup ≤ 57 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	12.6	13.6	17.6	19.1	15.5	18.4	18.4
3.3 ≤ E < 3.5	12.3	13.3	17.2	18.7	15.0	18.0	18.0
3.5 ≤ E < 3.7	11.9	13.0	16.8	18.4	14.6	17.7	17.6
3.7 ≤ E < 3.9	11.7	12.6	16.5	18.0	14.3	17.3	17.3
3.9 ≤ E < 4.1	11.4	12.3	16.1	17.7	14.0	17.0	17.0
4.1 ≤ E < 4.3	11.2	12.0	15.8	17.4	13.7	16.7	16.7
4.3 ≤ E < 4.5	10.9	11.8	15.5	17.1	13.5	16.4	16.4
4.5 ≤ E < 4.7	10.7	11.6	15.3	16.8	13.2	16.1	16.1
4.7 ≤ E < 4.9	10.5	11.4	15.1	16.6	13.0	15.8	15.8
E ≥ 4.9	10.3	11.2	14.8	16.3	12.8	15.7	15.6
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	57 < Assembly Average Burnup ≤ 58 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	13.5	14.5	18.7	20.1	16.4	19.5	19.4
3.3 ≤ E < 3.5	13.1	14.1	18.3	19.8	15.9	19.1	19.0
3.5 ≤ E < 3.7	12.7	13.8	17.9	19.4	15.6	18.7	18.7
3.7 ≤ E < 3.9	12.4	13.4	17.5	19.0	15.3	18.4	18.3
3.9 ≤ E < 4.1	12.1	13.1	17.2	18.7	14.9	18.0	18.0
4.1 ≤ E < 4.3	11.8	12.9	16.9	18.4	14.6	17.7	17.7
4.3 ≤ E < 4.5	11.6	12.6	16.5	18.1	14.3	17.4	17.4
4.5 ≤ E < 4.7	11.4	12.3	16.3	17.8	14.0	17.2	17.1
4.7 ≤ E < 4.9	11.1	12.1	16.0	17.5	13.8	16.9	16.8
E ≥ 4.9	11.0	11.9	15.8	17.3	13.6	16.7	16.6

**Table B2-20 Loading Table for PWR Fuel – 876 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	58 < Assembly Average Burnup ≤ 59 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	14.3	15.4	19.7	21.2	17.4	20.5	20.5
3.3 ≤ E < 3.5	13.9	15.0	19.3	20.8	16.9	20.1	20.1
3.5 ≤ E < 3.7	13.5	14.7	18.9	20.4	16.6	19.8	19.7
3.7 ≤ E < 3.9	13.2	14.3	18.5	20.1	16.1	19.4	19.4
3.9 ≤ E < 4.1	12.9	14.0	18.2	19.7	15.8	19.1	19.0
4.1 ≤ E < 4.3	12.6	13.7	17.8	19.4	15.5	18.8	18.7
4.3 ≤ E < 4.5	12.2	13.4	17.6	19.1	15.2	18.4	18.4
4.5 ≤ E < 4.7	12.0	13.1	17.3	18.9	14.9	18.2	18.1
4.7 ≤ E < 4.9	11.8	12.9	17.0	18.6	14.7	17.9	17.8
E ≥ 4.9	11.6	12.7	16.8	18.4	14.5	17.6	17.6
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	59 < Assembly Average Burnup ≤ 60 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	-	-	-	-	-	-	-
3.3 ≤ E < 3.5	14.7	15.9	20.2	21.9	17.9	20.7	20.6
3.5 ≤ E < 3.7	14.3	15.6	19.9	21.5	17.5	20.3	20.2
3.7 ≤ E < 3.9	13.9	15.2	19.5	21.1	17.1	19.9	19.9
3.9 ≤ E < 4.1	13.6	14.9	19.2	20.8	16.8	19.6	19.5
4.1 ≤ E < 4.3	13.3	14.5	18.8	20.5	16.4	19.3	19.2
4.3 ≤ E < 4.5	13.1	14.2	18.5	20.2	16.1	18.9	18.9
4.5 ≤ E < 4.7	12.8	13.9	18.2	19.9	15.8	18.7	18.6
4.7 ≤ E < 4.9	12.5	13.7	18.0	19.6	15.6	18.4	18.3
E ≥ 4.9	12.3	13.5	17.7	19.4	15.4	18.2	18.1

**Table B2-21 Loading Table for PWR Fuel – 800 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	30 < Assembly Average Burnup ≤ 32.5 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	4.8	4.9	5.6	5.7	5.2	5.6	5.6
2.3 ≤ E < 2.5	4.7	4.8	5.5	5.7	5.2	5.6	5.6
2.5 ≤ E < 2.7	4.7	4.8	5.4	5.6	5.1	5.5	5.5
2.7 ≤ E < 2.9	4.6	4.7	5.4	5.5	5.0	5.5	5.5
2.9 ≤ E < 3.1	4.6	4.7	5.3	5.5	5.0	5.4	5.4
3.1 ≤ E < 3.3	4.5	4.6	5.3	5.4	5.0	5.3	5.3
3.3 ≤ E < 3.5	4.5	4.6	5.2	5.4	4.9	5.3	5.3
3.5 ≤ E < 3.7	4.5	4.5	5.1	5.3	4.9	5.2	5.2
3.7 ≤ E < 3.9	4.4	4.5	5.1	5.3	4.8	5.2	5.2
3.9 ≤ E < 4.1	4.4	4.5	5.0	5.2	4.8	5.2	5.1
4.1 ≤ E < 4.3	4.4	4.4	5.0	5.2	4.8	5.1	5.1
4.3 ≤ E < 4.5	4.3	4.4	5.0	5.1	4.8	5.1	5.1
4.5 ≤ E < 4.7	4.3	4.4	5.0	5.1	4.7	5.0	5.0
4.7 ≤ E < 4.9	4.3	4.4	4.9	5.1	4.7	5.0	5.0
E ≥ 4.9	4.3	4.3	4.9	5.0	4.7	5.0	5.0
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	32.5 < Assembly Average Burnup ≤ 35 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	5.2	5.3	6.0	6.3	5.7	6.1	6.1
2.5 ≤ E < 2.7	5.1	5.2	6.0	6.2	5.7	6.0	6.0
2.7 ≤ E < 2.9	5.0	5.2	5.9	6.1	5.6	6.0	6.0
2.9 ≤ E < 3.1	5.0	5.1	5.9	6.0	5.5	5.9	5.9
3.1 ≤ E < 3.3	4.9	5.0	5.8	6.0	5.5	5.9	5.9
3.3 ≤ E < 3.5	4.9	5.0	5.8	5.9	5.4	5.8	5.8
3.5 ≤ E < 3.7	4.9	4.9	5.7	5.9	5.4	5.8	5.8
3.7 ≤ E < 3.9	4.8	4.9	5.7	5.8	5.3	5.8	5.8
3.9 ≤ E < 4.1	4.8	4.9	5.6	5.8	5.3	5.7	5.7
4.1 ≤ E < 4.3	4.7	4.8	5.6	5.8	5.2	5.7	5.7
4.3 ≤ E < 4.5	4.7	4.8	5.5	5.7	5.2	5.6	5.6
4.5 ≤ E < 4.7	4.7	4.8	5.5	5.7	5.2	5.6	5.6
4.7 ≤ E < 4.9	4.6	4.7	5.5	5.7	5.1	5.6	5.6
E ≥ 4.9	4.6	4.7	5.4	5.6	5.1	5.5	5.5

**Table B2-21 Loading Table for PWR Fuel – 800 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	35 < Assembly Average Burnup ≤ 37.5 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	5.8	5.9	6.9	7.1	6.4	6.9	6.9
2.5 ≤ E < 2.7	5.7	5.8	6.8	7.0	6.3	6.8	6.8
2.7 ≤ E < 2.9	5.6	5.7	6.7	6.9	6.2	6.7	6.7
2.9 ≤ E < 3.1	5.5	5.7	6.6	6.8	6.1	6.7	6.7
3.1 ≤ E < 3.3	5.5	5.6	6.5	6.8	6.0	6.6	6.6
3.3 ≤ E < 3.5	5.4	5.5	6.4	6.7	6.0	6.5	6.5
3.5 ≤ E < 3.7	5.3	5.5	6.3	6.6	5.9	6.5	6.4
3.7 ≤ E < 3.9	5.3	5.4	6.3	6.5	5.9	6.4	6.4
3.9 ≤ E < 4.1	5.2	5.4	6.2	6.5	5.8	6.3	6.3
4.1 ≤ E < 4.3	5.2	5.3	6.1	6.4	5.8	6.3	6.3
4.3 ≤ E < 4.5	5.1	5.3	6.1	6.4	5.7	6.2	6.2
4.5 ≤ E < 4.7	5.1	5.2	6.0	6.3	5.7	6.2	6.2
4.7 ≤ E < 4.9	5.0	5.2	6.0	6.3	5.7	6.1	6.1
E ≥ 4.9	5.0	5.1	6.0	6.2	5.6	6.1	6.1
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	37.5 < Assembly Average Burnup ≤ 40 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.3	6.5	7.7	8.1	7.0	7.8	7.8
2.7 ≤ E < 2.9	6.2	6.4	7.6	8.0	6.9	7.7	7.7
2.9 ≤ E < 3.1	6.1	6.3	7.5	7.8	6.9	7.6	7.6
3.1 ≤ E < 3.3	6.0	6.2	7.4	7.7	6.8	7.4	7.4
3.3 ≤ E < 3.5	5.9	6.1	7.2	7.6	6.7	7.3	7.3
3.5 ≤ E < 3.7	5.9	6.0	7.1	7.5	6.6	7.3	7.2
3.7 ≤ E < 3.9	5.8	6.0	7.1	7.4	6.5	7.2	7.1
3.9 ≤ E < 4.1	5.8	5.9	7.0	7.4	6.5	7.1	7.1
4.1 ≤ E < 4.3	5.7	5.9	6.9	7.3	6.4	7.0	7.0
4.3 ≤ E < 4.5	5.7	5.8	6.9	7.2	6.4	7.0	7.0
4.5 ≤ E < 4.7	5.6	5.8	6.8	7.1	6.3	6.9	6.9
4.7 ≤ E < 4.9	5.6	5.7	6.8	7.1	6.3	6.9	6.9
E ≥ 4.9	5.5	5.7	6.7	7.0	6.2	6.8	6.8

**Table B2-21 Loading Table for PWR Fuel – 800 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	40 < Assembly Average Burnup ≤ 41 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.6	6.8	8.2	8.7	7.4	8.3	8.3
2.7 ≤ E < 2.9	6.5	6.7	8.0	8.5	7.3	8.1	8.1
2.9 ≤ E < 3.1	6.4	6.6	7.9	8.3	7.2	8.0	8.0
3.1 ≤ E < 3.3	6.3	6.5	7.8	8.2	7.1	7.9	7.9
3.3 ≤ E < 3.5	6.2	6.4	7.7	8.0	7.0	7.8	7.8
3.5 ≤ E < 3.7	6.1	6.3	7.6	8.0	6.9	7.7	7.7
3.7 ≤ E < 3.9	6.0	6.2	7.5	7.9	6.8	7.6	7.6
3.9 ≤ E < 4.1	6.0	6.1	7.4	7.8	6.8	7.5	7.5
4.1 ≤ E < 4.3	5.9	6.1	7.3	7.7	6.7	7.4	7.4
4.3 ≤ E < 4.5	5.9	6.0	7.2	7.6	6.7	7.4	7.3
4.5 ≤ E < 4.7	5.8	6.0	7.1	7.6	6.6	7.3	7.3
4.7 ≤ E < 4.9	5.8	5.9	7.1	7.5	6.6	7.2	7.2
E ≥ 4.9	5.7	5.9	7.0	7.4	6.5	7.2	7.2
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	41 < Assembly Average Burnup ≤ 42 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.9	7.1	8.7	9.3	7.8	8.8	8.8
2.7 ≤ E < 2.9	6.8	7.0	8.6	9.0	7.7	8.6	8.6
2.9 ≤ E < 3.1	6.7	6.9	8.4	8.9	7.6	8.5	8.5
3.1 ≤ E < 3.3	6.6	6.8	8.2	8.7	7.5	8.3	8.3
3.3 ≤ E < 3.5	6.5	6.7	8.1	8.6	7.3	8.2	8.2
3.5 ≤ E < 3.7	6.4	6.6	8.0	8.5	7.2	8.1	8.1
3.7 ≤ E < 3.9	6.3	6.5	7.9	8.3	7.1	8.0	8.0
3.9 ≤ E < 4.1	6.2	6.5	7.8	8.2	7.1	7.9	7.9
4.1 ≤ E < 4.3	6.1	6.4	7.7	8.1	7.0	7.8	7.8
4.3 ≤ E < 4.5	6.1	6.3	7.6	8.0	6.9	7.8	7.7
4.5 ≤ E < 4.7	6.0	6.3	7.6	8.0	6.9	7.7	7.7
4.7 ≤ E < 4.9	6.0	6.2	7.5	7.9	6.8	7.6	7.6
E ≥ 4.9	5.9	6.1	7.4	7.8	6.8	7.6	7.6

**Table B2-21 Loading Table for PWR Fuel – 800 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	42 < Assembly Average Burnup ≤ 43 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	7.3	7.5	9.3	9.9	8.3	9.4	9.4
2.7 ≤ E < 2.9	7.1	7.4	9.1	9.7	8.1	9.2	9.2
2.9 ≤ E < 3.1	7.0	7.2	8.9	9.5	8.0	9.0	9.0
3.1 ≤ E < 3.3	6.9	7.1	8.8	9.3	7.9	8.9	8.8
3.3 ≤ E < 3.5	6.8	7.0	8.6	9.2	7.8	8.7	8.7
3.5 ≤ E < 3.7	6.7	6.9	8.5	9.0	7.7	8.6	8.6
3.7 ≤ E < 3.9	6.6	6.8	8.4	8.9	7.6	8.5	8.5
3.9 ≤ E < 4.1	6.5	6.8	8.2	8.8	7.5	8.4	8.4
4.1 ≤ E < 4.3	6.5	6.7	8.1	8.7	7.4	8.3	8.3
4.3 ≤ E < 4.5	6.4	6.6	8.0	8.6	7.3	8.2	8.2
4.5 ≤ E < 4.7	6.3	6.6	8.0	8.5	7.2	8.1	8.1
4.7 ≤ E < 4.9	6.2	6.5	7.9	8.4	7.2	8.0	8.0
E ≥ 4.9	6.2	6.4	7.8	8.3	7.1	8.0	8.0
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	43 < Assembly Average Burnup ≤ 44 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	7.7	8.0	10.0	10.8	8.8	10.0	10.1
2.7 ≤ E < 2.9	7.5	7.8	9.7	10.5	8.7	9.9	9.8
2.9 ≤ E < 3.1	7.4	7.7	9.5	10.2	8.5	9.7	9.6
3.1 ≤ E < 3.3	7.2	7.5	9.3	10.0	8.3	9.5	9.4
3.3 ≤ E < 3.5	7.1	7.4	9.2	9.8	8.2	9.3	9.3
3.5 ≤ E < 3.7	7.1	7.3	9.0	9.7	8.0	9.1	9.1
3.7 ≤ E < 3.9	6.9	7.2	8.9	9.5	8.0	9.0	9.0
3.9 ≤ E < 4.1	6.8	7.1	8.8	9.4	7.9	8.9	8.9
4.1 ≤ E < 4.3	6.7	7.0	8.7	9.2	7.8	8.8	8.8
4.3 ≤ E < 4.5	6.7	6.9	8.5	9.1	7.7	8.7	8.7
4.5 ≤ E < 4.7	6.6	6.9	8.5	9.0	7.6	8.6	8.6
4.7 ≤ E < 4.9	6.6	6.8	8.4	8.9	7.6	8.5	8.5
E ≥ 4.9	6.5	6.8	8.3	8.9	7.5	8.5	8.4

**Table B2-21 Loading Table for PWR Fuel – 800 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	44 < Assembly Average Burnup ≤ 45 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.9	8.2	10.5	11.4	9.2	10.6	10.6
2.9 ≤ E < 3.1	7.8	8.1	10.2	11.1	9.0	10.4	10.4
3.1 ≤ E < 3.3	7.6	7.9	10.0	10.8	8.8	10.1	10.1
3.3 ≤ E < 3.5	7.5	7.8	9.8	10.6	8.7	9.9	9.9
3.5 ≤ E < 3.7	7.3	7.7	9.6	10.4	8.6	9.8	9.8
3.7 ≤ E < 3.9	7.2	7.6	9.5	10.2	8.4	9.6	9.6
3.9 ≤ E < 4.1	7.1	7.5	9.3	10.0	8.3	9.5	9.5
4.1 ≤ E < 4.3	7.0	7.4	9.2	9.9	8.2	9.4	9.3
4.3 ≤ E < 4.5	7.0	7.3	9.1	9.8	8.1	9.2	9.2
4.5 ≤ E < 4.7	6.9	7.2	9.0	9.7	8.0	9.1	9.1
4.7 ≤ E < 4.9	6.8	7.1	8.9	9.6	7.9	9.0	9.0
E ≥ 4.9	6.8	7.0	8.8	9.5	7.9	9.0	8.9

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	45 < Assembly Average Burnup ≤ 46 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	9.2	9.8	12.8	13.9	11.2	13.0	13.0
2.9 ≤ E < 3.1	9.0	9.6	12.5	13.6	10.9	12.7	12.7
3.1 ≤ E < 3.3	8.9	9.4	12.1	13.3	10.6	12.4	12.4
3.3 ≤ E < 3.5	8.7	9.1	11.9	13.0	10.4	12.1	12.1
3.5 ≤ E < 3.7	8.6	9.0	11.8	12.8	10.2	11.9	11.9
3.7 ≤ E < 3.9	8.4	8.8	11.6	12.5	10.0	11.8	11.7
3.9 ≤ E < 4.1	8.3	8.7	11.4	12.3	9.9	11.6	11.5
4.1 ≤ E < 4.3	8.1	8.6	11.2	12.2	9.7	11.4	11.4
4.3 ≤ E < 4.5	8.0	8.5	11.1	12.0	9.6	11.3	11.3
4.5 ≤ E < 4.7	7.9	8.4	10.9	11.9	9.5	11.2	11.1
4.7 ≤ E < 4.9	7.9	8.3	10.8	11.7	9.4	11.0	11.0
E ≥ 4.9	7.8	8.2	10.7	11.6	9.3	10.9	10.9

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	46 < Assembly Average Burnup ≤ 47 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	9.9	10.6	13.8	15.0	12.0	13.9	13.9
2.9 ≤ E < 3.1	9.7	10.3	13.5	14.7	11.7	13.7	13.7
3.1 ≤ E < 3.3	9.4	10.0	13.2	14.4	11.4	13.4	13.4
3.3 ≤ E < 3.5	9.2	9.8	12.9	14.0	11.2	13.1	13.1
3.5 ≤ E < 3.7	9.0	9.6	12.7	13.8	11.0	12.9	12.8
3.7 ≤ E < 3.9	8.9	9.4	12.4	13.6	10.8	12.6	12.6
3.9 ≤ E < 4.1	8.8	9.3	12.2	13.4	10.6	12.5	12.4
4.1 ≤ E < 4.3	8.6	9.1	12.0	13.2	10.4	12.2	12.2
4.3 ≤ E < 4.5	8.5	9.0	11.8	13.0	10.3	12.1	12.0
4.5 ≤ E < 4.7	8.4	8.9	11.7	12.8	10.1	11.9	11.9
4.7 ≤ E < 4.9	8.3	8.8	11.6	12.7	10.0	11.8	11.8
E ≥ 4.9	8.2	8.7	11.5	12.5	9.9	11.7	11.7
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	47 < Assembly Average Burnup ≤ 48 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	10.6	11.4	14.9	16.1	12.9	15.1	15.1
2.9 ≤ E < 3.1	10.4	11.1	14.5	15.8	12.5	14.7	14.7
3.1 ≤ E < 3.3	10.0	10.8	14.1	15.5	12.2	14.4	14.4
3.3 ≤ E < 3.5	9.9	10.5	13.9	15.2	12.0	14.1	14.0
3.5 ≤ E < 3.7	9.6	10.3	13.6	14.9	11.8	13.8	13.8
3.7 ≤ E < 3.9	9.5	10.1	13.4	14.6	11.6	13.6	13.6
3.9 ≤ E < 4.1	9.3	9.9	13.2	14.4	11.4	13.4	13.4
4.1 ≤ E < 4.3	9.1	9.8	13.0	14.1	11.2	13.2	13.2
4.3 ≤ E < 4.5	9.0	9.6	12.8	14.0	11.1	13.0	13.0
4.5 ≤ E < 4.7	8.9	9.5	12.6	13.8	10.9	12.9	12.8
4.7 ≤ E < 4.9	8.8	9.3	12.4	13.6	10.8	12.7	12.7
E ≥ 4.9	8.7	9.2	12.3	13.5	10.7	12.5	12.5

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	48 < Assembly Average Burnup ≤ 49 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	11.4	12.2	16.0	17.3	13.9	16.2	16.2
2.9 ≤ E < 3.1	11.1	11.8	15.6	17.0	13.5	15.8	15.8
3.1 ≤ E < 3.3	10.8	11.6	15.3	16.6	13.2	15.5	15.5
3.3 ≤ E < 3.5	10.6	11.3	14.9	16.3	12.9	15.2	15.2
3.5 ≤ E < 3.7	10.3	11.1	14.7	16.0	12.7	14.9	14.9
3.7 ≤ E < 3.9	10.1	10.9	14.4	15.7	12.4	14.6	14.6
3.9 ≤ E < 4.1	9.9	10.7	14.1	15.5	12.1	14.4	14.4
4.1 ≤ E < 4.3	9.7	10.4	13.9	15.2	12.0	14.1	14.1
4.3 ≤ E < 4.5	9.6	10.2	13.7	15.0	11.8	13.9	13.9
4.5 ≤ E < 4.7	9.5	10.1	13.5	14.9	11.7	13.8	13.8
4.7 ≤ E < 4.9	9.3	9.9	13.4	14.6	11.5	13.6	13.6
E ≥ 4.9	9.2	9.8	13.2	14.5	11.4	13.5	13.5
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	49 < Assembly Average Burnup ≤ 50 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	11.9	12.4	16.8	18.2	14.5	17.0	17.0
3.1 ≤ E < 3.3	11.6	12.1	16.4	17.8	14.1	16.6	16.6
3.3 ≤ E < 3.5	11.3	11.8	16.0	17.5	13.8	16.3	16.2
3.5 ≤ E < 3.7	11.1	11.6	15.7	17.2	13.6	16.0	16.0
3.7 ≤ E < 3.9	10.8	11.4	15.5	16.9	13.3	15.7	15.7
3.9 ≤ E < 4.1	10.6	11.2	15.2	16.6	13.1	15.5	15.5
4.1 ≤ E < 4.3	10.4	11.0	14.9	16.3	12.9	15.3	15.2
4.3 ≤ E < 4.5	10.2	10.8	14.7	16.1	12.7	15.0	15.0
4.5 ≤ E < 4.7	10.1	10.6	14.5	15.9	12.5	14.9	14.8
4.7 ≤ E < 4.9	9.9	10.5	14.3	15.7	12.3	14.6	14.6
E ≥ 4.9	9.8	10.3	14.1	15.5	12.2	14.5	14.5

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	50 < Assembly Average Burnup ≤ 51 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	12.4	13.4	17.8	19.3	15.6	18.1	18.1
3.1 ≤ E < 3.3	12.1	13.1	17.5	19.0	15.2	17.8	17.8
3.3 ≤ E < 3.5	11.8	12.7	17.2	18.7	14.9	17.4	17.4
3.5 ≤ E < 3.7	11.5	12.4	16.8	18.3	14.5	17.2	17.1
3.7 ≤ E < 3.9	11.3	12.1	16.5	18.0	14.3	16.9	16.8
3.9 ≤ E < 4.1	11.1	11.9	16.2	17.7	14.0	16.6	16.5
4.1 ≤ E < 4.3	10.9	11.7	16.0	17.5	13.8	16.3	16.3
4.3 ≤ E < 4.5	10.7	11.5	15.8	17.3	13.6	16.1	16.0
4.5 ≤ E < 4.7	10.5	11.4	15.5	17.1	13.4	15.8	15.9
4.7 ≤ E < 4.9	10.4	11.2	15.3	16.8	13.2	15.7	15.7
E ≥ 4.9	10.2	11.1	15.2	16.7	13.1	15.5	15.5
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	51 < Assembly Average Burnup ≤ 52 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	13.3	14.3	19.0	20.1	16.7	19.4	19.3
3.1 ≤ E < 3.3	12.9	14.0	18.6	19.7	16.3	19.0	18.9
3.3 ≤ E < 3.5	12.6	13.6	18.2	19.4	15.9	18.6	18.6
3.5 ≤ E < 3.7	12.3	13.3	17.9	19.1	15.6	18.3	18.3
3.7 ≤ E < 3.9	12.0	13.1	17.6	18.8	15.3	18.0	17.9
3.9 ≤ E < 4.1	11.8	12.8	17.4	18.5	15.0	17.7	17.7
4.1 ≤ E < 4.3	11.6	12.5	17.1	18.2	14.8	17.5	17.4
4.3 ≤ E < 4.5	11.4	12.3	16.8	18.0	14.5	17.3	17.2
4.5 ≤ E < 4.7	11.2	12.1	16.6	17.7	14.4	17.0	17.0
4.7 ≤ E < 4.9	11.1	11.9	16.4	17.5	14.1	16.8	16.8
E ≥ 4.9	10.9	11.8	16.2	17.4	13.9	16.6	16.5

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	52 < Assembly Average Burnup ≤ 53 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	14.2	15.3	19.7	21.3	17.8	20.5	20.5
3.1 ≤ E < 3.3	13.8	15.0	19.3	20.9	17.4	20.1	20.1
3.3 ≤ E < 3.5	13.5	14.6	18.9	20.6	17.1	19.8	19.7
3.5 ≤ E < 3.7	13.1	14.3	18.6	20.3	16.7	19.5	19.4
3.7 ≤ E < 3.9	12.9	14.2	18.3	19.9	16.4	19.2	19.1
3.9 ≤ E < 4.1	12.6	13.7	18.0	19.6	16.0	18.9	18.8
4.1 ≤ E < 4.3	12.3	13.5	17.7	19.4	15.8	18.6	18.5
4.3 ≤ E < 4.5	12.1	13.2	17.5	19.1	15.6	18.4	18.3
4.5 ≤ E < 4.7	11.9	13.0	17.3	18.8	15.3	18.2	18.1
4.7 ≤ E < 4.9	11.8	12.8	17.0	18.7	15.2	17.9	17.8
E ≥ 4.9	11.6	12.6	16.9	18.5	14.9	17.7	17.7
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	53 < Assembly Average Burnup ≤ 54 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	15.2	16.4	20.9	22.5	18.9	21.7	21.6
3.1 ≤ E < 3.3	14.8	16.0	20.4	22.1	18.5	21.3	21.3
3.3 ≤ E < 3.5	14.4	15.6	20.0	21.8	18.1	21.0	20.9
3.5 ≤ E < 3.7	14.0	15.2	19.7	21.4	17.7	20.6	20.6
3.7 ≤ E < 3.9	13.7	14.9	19.4	21.1	17.4	20.3	20.3
3.9 ≤ E < 4.1	13.4	14.6	19.1	20.8	17.2	20.1	20.0
4.1 ≤ E < 4.3	13.2	14.4	18.9	20.5	16.9	19.8	19.7
4.3 ≤ E < 4.5	12.9	14.1	18.6	20.3	16.6	19.5	19.5
4.5 ≤ E < 4.7	12.7	13.9	18.3	20.1	16.4	19.3	19.2
4.7 ≤ E < 4.9	12.5	13.6	18.1	19.8	16.1	19.0	19.0
E ≥ 4.9	12.4	13.9	17.9	19.6	15.9	18.8	18.8

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	54 < Assembly Average Burnup ≤ 55 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	15.7	17.1	21.6	23.2	19.6	22.5	22.4
3.3 ≤ E < 3.5	15.4	17.7	21.2	22.9	19.2	22.1	22.1
3.5 ≤ E < 3.7	15.0	16.3	20.9	22.6	18.9	21.8	21.8
3.7 ≤ E < 3.9	14.6	16.0	20.6	22.2	18.5	21.5	21.5
3.9 ≤ E < 4.1	14.4	15.7	20.2	21.9	18.3	21.2	21.2
4.1 ≤ E < 4.3	14.1	15.4	19.9	21.7	18.0	20.9	20.9
4.3 ≤ E < 4.5	13.8	15.1	19.7	21.4	17.7	20.7	20.6
4.5 ≤ E < 4.7	13.6	14.9	19.4	21.2	17.5	20.5	20.4
4.7 ≤ E < 4.9	13.4	14.6	19.2	21.0	17.2	20.2	20.1
E ≥ 4.9	13.2	14.4	19.0	20.7	17.0	19.9	19.9
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	55 < Assembly Average Burnup ≤ 56 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	16.8	18.1	22.7	24.4	20.2	23.6	23.6
3.3 ≤ E < 3.5	16.3	17.7	22.4	24.1	19.8	23.3	23.3
3.5 ≤ E < 3.7	15.9	17.3	21.9	23.7	19.5	23.0	22.9
3.7 ≤ E < 3.9	15.6	17.0	21.7	23.4	19.2	22.6	22.6
3.9 ≤ E < 4.1	15.3	16.7	21.4	23.1	18.8	22.4	22.3
4.1 ≤ E < 4.3	15.0	16.4	21.0	22.9	18.5	22.1	22.0
4.3 ≤ E < 4.5	14.8	16.1	20.8	22.6	18.3	21.8	21.8
4.5 ≤ E < 4.7	14.5	15.8	20.5	22.4	17.9	21.6	21.5
4.7 ≤ E < 4.9	14.3	15.6	20.3	22.2	17.8	21.3	21.3
E ≥ 4.9	14.0	15.4	20.0	21.9	17.6	21.1	21.1

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	56 < Assembly Average Burnup ≤ 57 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	17.7	19.2	23.8	25.6	21.3	24.7	24.7
3.3 ≤ E < 3.5	17.3	18.8	23.4	25.2	20.9	24.4	24.4
3.5 ≤ E < 3.7	16.9	18.4	23.1	24.9	20.5	24.0	24.0
3.7 ≤ E < 3.9	16.6	18.1	22.7	24.6	20.2	23.7	23.7
3.9 ≤ E < 4.1	16.2	17.7	22.4	24.3	19.9	23.5	23.5
4.1 ≤ E < 4.3	15.9	17.4	22.2	24.0	19.6	23.2	23.2
4.3 ≤ E < 4.5	15.7	17.1	21.9	23.8	19.3	23.0	22.9
4.5 ≤ E < 4.7	15.4	16.8	21.6	23.5	19.1	22.7	22.6
4.7 ≤ E < 4.9	15.2	16.6	21.4	23.3	18.8	22.5	22.4
E ≥ 4.9	15.0	16.4	21.2	23.0	18.6	22.2	22.2
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	57 < Assembly Average Burnup ≤ 58 GWd/MTU Minimum Cooling Time (years)						
	CE	WE	WE	B&W	CE	WE	B&W
	14×14	14×14	15×15	15×15	16×16	17×17	17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	18.8	20.2	24.9	26.7	22.3	25.8	25.8
3.3 ≤ E < 3.5	18.3	19.9	24.6	26.3	22.0	25.5	25.5
3.5 ≤ E < 3.7	17.9	19.5	24.2	26.0	21.6	25.2	25.2
3.7 ≤ E < 3.9	17.6	19.1	23.9	25.7	21.3	24.9	24.8
3.9 ≤ E < 4.1	17.3	18.8	23.6	25.4	20.9	24.6	24.6
4.1 ≤ E < 4.3	16.9	18.4	23.3	25.1	20.6	24.4	24.3
4.3 ≤ E < 4.5	16.6	18.1	23.0	24.9	20.4	24.1	24.0
4.5 ≤ E < 4.7	16.3	17.9	22.8	24.6	20.0	23.8	23.8
4.7 ≤ E < 4.9	16.1	17.6	22.5	24.4	19.9	23.6	23.6
E ≥ 4.9	15.8	17.4	22.3	24.2	19.7	23.4	23.3

**Table B2-22 Loading Table for PWR Fuel – 760 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	58 < Assembly Average Burnup ≤ 59 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	19.8	21.3	25.9	27.7	23.4	26.9	26.9
3.3 ≤ E < 3.5	19.3	20.9	25.6	27.4	23.0	26.7	26.6
3.5 ≤ E < 3.7	18.9	20.5	25.3	27.1	22.7	26.3	26.2
3.7 ≤ E < 3.9	18.6	20.2	24.9	26.8	22.3	26.0	25.9
3.9 ≤ E < 4.1	18.2	19.8	24.6	26.5	22.0	25.7	25.7
4.1 ≤ E < 4.3	17.9	19.5	24.3	26.2	21.7	25.5	25.4
4.3 ≤ E < 4.5	17.6	19.2	24.1	26.0	21.4	25.2	25.2
4.5 ≤ E < 4.7	17.3	18.9	23.9	25.8	21.2	25.0	24.9
4.7 ≤ E < 4.9	17.1	18.7	23.6	25.5	20.9	24.7	24.7
E ≥ 4.9	16.8	18.4	23.4	25.3	20.7	24.5	24.4
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	59 < Assembly Average Burnup ≤ 60 GWd/MTU						
	Minimum Cooling Time (years)						
	CE 14×14	WE 14×14	WE 15×15	B&W 15×15	CE 16×16	WE 17×17	B&W 17×17
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	-	-	-	-	-	-	-
3.3 ≤ E < 3.5	20.3	22.0	26.7	28.4	24.1	27.2	27.1
3.5 ≤ E < 3.7	20.0	21.5	26.4	28.1	23.7	26.8	26.7
3.7 ≤ E < 3.9	19.6	21.2	26.0	27.8	23.4	26.5	26.5
3.9 ≤ E < 4.1	19.3	20.8	25.7	27.6	23.1	26.2	26.2
4.1 ≤ E < 4.3	18.9	20.5	25.4	27.3	22.7	26.0	25.9
4.3 ≤ E < 4.5	18.6	20.2	25.2	27.1	22.5	25.7	25.6
4.5 ≤ E < 4.7	18.3	20.0	24.9	26.8	22.2	25.5	25.4
4.7 ≤ E < 4.9	18.0	19.7	24.7	26.6	22.0	25.2	25.2
E ≥ 4.9	17.7	19.5	24.4	26.4	21.7	25.0	24.9

**Table B2-23 Loading Table for BWR Fuel – 379 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	30 < Assembly Average Burnup ≤ 32.5 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	4.3	4.6	4.0	4.5	4.0	4.5	4.4
2.3 ≤ E < 2.5	4.2	4.6	4.0	4.5	4.0	4.4	4.4
2.5 ≤ E < 2.7	4.2	4.5	4.0	4.4	4.0	4.4	4.3
2.7 ≤ E < 2.9	4.1	4.5	4.0	4.4	4.0	4.3	4.3
2.9 ≤ E < 3.1	4.1	4.4	4.0	4.3	4.0	4.3	4.2
3.1 ≤ E < 3.3	4.0	4.4	4.0	4.3	4.0	4.2	4.2
3.3 ≤ E < 3.5	4.0	4.3	4.0	4.2	4.0	4.2	4.1
3.5 ≤ E < 3.7	4.0	4.3	4.0	4.2	4.0	4.2	4.1
3.7 ≤ E < 3.9	4.0	4.3	4.0	4.2	4.0	4.1	4.0
3.9 ≤ E < 4.1	4.0	4.2	4.0	4.1	4.0	4.1	4.0
4.1 ≤ E < 4.3	4.0	4.2	4.0	4.1	4.0	4.1	4.0
4.3 ≤ E < 4.5	4.0	4.2	4.0	4.1	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.1	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.1	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.1	4.0	4.0	4.0	4.0	4.0

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	32.5 < Assembly Average Burnup ≤ 35 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.7	5.0	4.3	4.9	4.0	4.9	4.8
2.5 ≤ E < 2.7	4.6	4.9	4.3	4.8	4.0	4.8	4.7
2.7 ≤ E < 2.9	4.5	4.9	4.2	4.8	4.0	4.7	4.6
2.9 ≤ E < 3.1	4.5	4.8	4.2	4.7	4.0	4.7	4.6
3.1 ≤ E < 3.3	4.4	4.8	4.1	4.7	4.0	4.6	4.5
3.3 ≤ E < 3.5	4.4	4.7	4.0	4.6	4.0	4.6	4.5
3.5 ≤ E < 3.7	4.3	4.7	4.0	4.6	4.0	4.5	4.5
3.7 ≤ E < 3.9	4.3	4.6	4.0	4.5	4.0	4.5	4.4
3.9 ≤ E < 4.1	4.2	4.6	4.0	4.5	4.0	4.5	4.4
4.1 ≤ E < 4.3	4.2	4.5	4.0	4.5	4.0	4.4	4.3
4.3 ≤ E < 4.5	4.2	4.5	4.0	4.4	4.0	4.4	4.3
4.5 ≤ E < 4.7	4.1	4.5	4.0	4.4	4.0	4.4	4.3
4.7 ≤ E < 4.9	4.1	4.5	4.0	4.4	4.0	4.3	4.2
E ≥ 4.9	4.1	4.4	4.0	4.3	4.0	4.3	4.2

**Table B2-23 Loading Table for BWR Fuel – 379 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	35 < Assembly Average Burnup ≤ 37.5 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/4-6
	7×7	7×7	8×8	8×8	9×9	9×9	10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	5.2	5.6	4.7	5.4	4.4	5.4	5.2
2.5 ≤ E < 2.7	5.1	5.5	4.7	5.3	4.3	5.3	5.2
2.7 ≤ E < 2.9	5.0	5.4	4.6	5.3	4.3	5.2	5.1
2.9 ≤ E < 3.1	4.9	5.4	4.5	5.2	4.2	5.1	5.0
3.1 ≤ E < 3.3	4.9	5.3	4.5	5.1	4.1	5.1	4.9
3.3 ≤ E < 3.5	4.8	5.2	4.4	5.0	4.1	5.0	4.9
3.5 ≤ E < 3.7	4.8	5.1	4.4	5.0	4.0	4.9	4.8
3.7 ≤ E < 3.9	4.7	5.1	4.3	4.9	4.0	4.9	4.8
3.9 ≤ E < 4.1	4.6	5.0	4.3	4.9	4.0	4.9	4.7
4.1 ≤ E < 4.3	4.6	5.0	4.3	4.9	4.0	4.8	4.7
4.3 ≤ E < 4.5	4.6	4.9	4.2	4.8	4.0	4.8	4.7
4.5 ≤ E < 4.7	4.5	4.9	4.2	4.8	4.0	4.7	4.6
4.7 ≤ E < 4.9	4.5	4.9	4.1	4.7	4.0	4.7	4.6
E ≥ 4.9	4.5	4.9	4.1	4.7	4.0	4.7	4.6
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	37.5 < Assembly Average Burnup ≤ 40 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/4-6
	7×7	7×7	8×8	8×8	9×9	9×9	10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	5.7	6.1	5.2	5.9	4.7	5.9	5.7
2.7 ≤ E < 2.9	5.6	6.0	5.1	5.8	4.6	5.8	5.7
2.9 ≤ E < 3.1	5.5	5.9	5.0	5.8	4.6	5.7	5.6
3.1 ≤ E < 3.3	5.5	5.9	4.9	5.7	4.5	5.6	5.5
3.3 ≤ E < 3.5	5.4	5.8	4.9	5.6	4.4	5.6	5.4
3.5 ≤ E < 3.7	5.3	5.7	4.8	5.6	4.4	5.5	5.4
3.7 ≤ E < 3.9	5.2	5.7	4.7	5.5	4.3	5.4	5.3
3.9 ≤ E < 4.1	5.2	5.6	4.7	5.4	4.3	5.4	5.2
4.1 ≤ E < 4.3	5.1	5.6	4.6	5.4	4.3	5.3	5.2
4.3 ≤ E < 4.5	5.0	5.5	4.6	5.3	4.2	5.3	5.1
4.5 ≤ E < 4.7	5.0	5.5	4.5	5.3	4.2	5.2	5.0
4.7 ≤ E < 4.9	5.0	5.4	4.5	5.2	4.1	5.2	5.0
E ≥ 4.9	4.9	5.4	4.5	5.2	4.1	5.1	5.0

**Table B2-23 Loading Table for BWR Fuel – 379 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	40 < Assembly Average Burnup ≤ 41 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/4-6
	7×7	7×7	8×8	8×8	9×9	9×9	10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.0	6.5	5.4	6.2	4.9	6.1	6.0
2.7 ≤ E < 2.9	5.9	6.4	5.3	6.1	4.8	6.0	5.9
2.9 ≤ E < 3.1	5.8	6.2	5.2	6.0	4.7	5.9	5.8
3.1 ≤ E < 3.3	5.7	6.1	5.1	5.9	4.7	5.9	5.7
3.3 ≤ E < 3.5	5.6	6.0	5.0	5.9	4.6	5.8	5.6
3.5 ≤ E < 3.7	5.5	6.0	5.0	5.8	4.5	5.7	5.6
3.7 ≤ E < 3.9	5.5	5.9	4.9	5.7	4.5	5.7	5.5
3.9 ≤ E < 4.1	5.4	5.9	4.9	5.7	4.4	5.6	5.5
4.1 ≤ E < 4.3	5.3	5.8	4.8	5.6	4.4	5.5	5.4
4.3 ≤ E < 4.5	5.3	5.8	4.8	5.6	4.4	5.5	5.3
4.5 ≤ E < 4.7	5.2	5.7	4.7	5.5	4.3	5.4	5.3
4.7 ≤ E < 4.9	5.2	5.7	4.7	5.5	4.3	5.4	5.2
E ≥ 4.9	5.1	5.6	4.6	5.4	4.2	5.4	5.2

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	41 < Assembly Average Burnup ≤ 42 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/2-3	BWR/4-6	BWR/4-6
	7×7	7×7	8×8	8×8	9×9	9×9	10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.3	6.8	5.6	6.5	5.1	6.4	6.2
2.7 ≤ E < 2.9	6.2	6.7	5.5	6.4	5.0	6.3	6.1
2.9 ≤ E < 3.1	6.0	6.6	5.5	6.3	4.9	6.2	6.0
3.1 ≤ E < 3.3	6.0	6.5	5.4	6.2	4.8	6.1	5.9
3.3 ≤ E < 3.5	5.9	6.4	5.3	6.1	4.8	6.0	5.9
3.5 ≤ E < 3.7	5.8	6.3	5.2	6.0	4.7	5.9	5.8
3.7 ≤ E < 3.9	5.7	6.2	5.1	5.9	4.6	5.9	5.7
3.9 ≤ E < 4.1	5.6	6.1	5.0	5.9	4.6	5.8	5.7
4.1 ≤ E < 4.3	5.6	6.0	5.0	5.8	4.5	5.8	5.6
4.3 ≤ E < 4.5	5.5	6.0	4.9	5.8	4.5	5.7	5.6
4.5 ≤ E < 4.7	5.5	5.9	4.9	5.7	4.5	5.7	5.5
4.7 ≤ E < 4.9	5.4	5.9	4.9	5.7	4.4	5.6	5.5
E ≥ 4.9	5.4	5.8	4.8	5.6	4.4	5.6	5.4

**Table B2-23 Loading Table for BWR Fuel – 379 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	42 < Assembly Average Burnup ≤ 43 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	6.6	7.1	5.9	6.8	5.3	6.8	6.6
2.7 ≤ E < 2.9	6.5	7.0	5.8	6.7	5.2	6.6	6.4
2.9 ≤ E < 3.1	6.4	6.9	5.7	6.6	5.1	6.5	6.3
3.1 ≤ E < 3.3	6.3	6.8	5.6	6.5	5.0	6.4	6.2
3.3 ≤ E < 3.5	6.1	6.7	5.5	6.4	4.9	6.3	6.1
3.5 ≤ E < 3.7	6.0	6.6	5.4	6.3	4.9	6.2	6.0
3.7 ≤ E < 3.9	6.0	6.5	5.4	6.2	4.8	6.1	5.9
3.9 ≤ E < 4.1	5.9	6.4	5.3	6.1	4.8	6.0	5.9
4.1 ≤ E < 4.3	5.8	6.3	5.2	6.0	4.7	6.0	5.8
4.3 ≤ E < 4.5	5.8	6.3	5.1	6.0	4.6	5.9	5.8
4.5 ≤ E < 4.7	5.7	6.2	5.1	6.0	4.6	5.9	5.7
4.7 ≤ E < 4.9	5.7	6.1	5.0	5.9	4.6	5.9	5.7
E ≥ 4.9	5.6	6.1	5.0	5.9	4.5	5.8	5.6

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	43 < Assembly Average Burnup ≤ 44 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	7.0	7.6	6.1	7.2	5.5	7.1	6.9
2.7 ≤ E < 2.9	6.8	7.4	6.0	7.0	5.4	6.9	6.7
2.9 ≤ E < 3.1	6.7	7.3	5.9	6.9	5.3	6.8	6.6
3.1 ≤ E < 3.3	6.6	7.1	5.8	6.8	5.2	6.7	6.5
3.3 ≤ E < 3.5	6.5	7.0	5.7	6.7	5.1	6.6	6.4
3.5 ≤ E < 3.7	6.4	6.9	5.7	6.6	5.0	6.5	6.3
3.7 ≤ E < 3.9	6.3	6.8	5.6	6.5	5.0	6.5	6.2
3.9 ≤ E < 4.1	6.2	6.7	5.5	6.4	4.9	6.4	6.1
4.1 ≤ E < 4.3	6.1	6.7	5.5	6.4	4.9	6.3	6.0
4.3 ≤ E < 4.5	6.0	6.6	5.4	6.3	4.8	6.2	6.0
4.5 ≤ E < 4.7	5.9	6.5	5.3	6.2	4.8	6.1	5.9
4.7 ≤ E < 4.9	5.9	6.5	5.3	6.2	4.7	6.1	5.9
E ≥ 4.9	5.8	6.4	5.2	6.1	4.7	6.0	5.9

**Table B2-23 Loading Table for BWR Fuel – 379 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	44 < Assembly Average Burnup ≤ 45 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	7.2	7.9	6.3	7.5	5.6	7.4	7.1
2.9 ≤ E < 3.1	7.0	7.7	6.2	7.3	5.5	7.2	6.9
3.1 ≤ E < 3.3	6.9	7.6	6.1	7.1	5.4	7.0	6.8
3.3 ≤ E < 3.5	6.8	7.4	6.0	7.0	5.4	6.9	6.7
3.5 ≤ E < 3.7	6.7	7.3	5.9	6.9	5.3	6.9	6.6
3.7 ≤ E < 3.9	6.6	7.2	5.8	6.8	5.2	6.8	6.5
3.9 ≤ E < 4.1	6.5	7.1	5.8	6.8	5.1	6.7	6.4
4.1 ≤ E < 4.3	6.4	7.0	5.7	6.7	5.0	6.6	6.3
4.3 ≤ E < 4.5	6.3	6.9	5.6	6.6	5.0	6.5	6.3
4.5 ≤ E < 4.7	6.3	6.8	5.6	6.5	4.9	6.4	6.2
4.7 ≤ E < 4.9	6.2	6.8	5.5	6.5	4.9	6.4	6.1
E ≥ 4.9	6.1	6.7	5.4	6.4	4.8	6.3	6.1

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	45 < Assembly Average Burnup ≤ 46 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	8.5	9.3	7.3	8.8	6.3	8.6	8.2
2.9 ≤ E < 3.1	8.3	9.0	7.1	8.6	6.2	8.4	8.0
3.1 ≤ E < 3.3	8.1	8.9	7.0	8.4	6.0	8.2	7.9
3.3 ≤ E < 3.5	8.0	8.8	6.8	8.2	6.0	8.0	7.7
3.5 ≤ E < 3.7	7.9	8.6	6.7	8.0	5.9	7.9	7.6
3.7 ≤ E < 3.9	7.7	8.4	6.7	7.9	5.8	7.8	7.5
3.9 ≤ E < 4.1	7.6	8.3	6.6	7.8	5.8	7.7	7.4
4.1 ≤ E < 4.3	7.5	8.2	6.5	7.7	5.7	7.6	7.3
4.3 ≤ E < 4.5	7.4	8.1	6.4	7.6	5.6	7.5	7.2
4.5 ≤ E < 4.7	7.3	8.0	6.3	7.6	5.6	7.4	7.1
4.7 ≤ E < 4.9	7.2	7.9	6.2	7.5	5.5	7.4	7.0
E ≥ 4.9	7.1	7.8	6.1	7.4	5.4	7.3	7.0

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	46 < Assembly Average Burnup ≤ 47 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	9.1	10.0	7.7	9.3	6.7	9.2	8.7
2.9 ≤ E < 3.1	8.9	9.8	7.5	9.1	6.5	8.9	8.5
3.1 ≤ E < 3.3	8.7	9.5	7.4	8.9	6.4	8.8	8.3
3.3 ≤ E < 3.5	8.5	9.3	7.2	8.7	6.2	8.6	8.2
3.5 ≤ E < 3.7	8.3	9.1	7.0	8.6	6.1	8.4	8.0
3.7 ≤ E < 3.9	8.2	9.0	7.0	8.4	6.0	8.3	7.9
3.9 ≤ E < 4.1	8.0	8.8	6.9	8.3	6.0	8.1	7.8
4.1 ≤ E < 4.3	7.9	8.7	6.8	8.2	5.9	8.0	7.7
4.3 ≤ E < 4.5	7.8	8.6	6.7	8.1	5.8	7.9	7.6
4.5 ≤ E < 4.7	7.7	8.5	6.6	8.0	5.8	7.9	7.5
4.7 ≤ E < 4.9	7.6	8.4	6.5	7.9	5.7	7.8	7.4
E ≥ 4.9	7.5	8.3	6.5	7.8	5.7	7.7	7.4

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	47 < Assembly Average Burnup ≤ 48 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	9.8	10.7	8.2	9.9	6.9	9.8	9.3
2.9 ≤ E < 3.1	9.6	10.5	8.0	9.7	6.8	9.5	9.1
3.1 ≤ E < 3.3	9.3	10.2	7.8	9.5	6.7	9.3	8.9
3.3 ≤ E < 3.5	9.1	9.9	7.7	9.3	6.6	9.2	8.7
3.5 ≤ E < 3.7	8.9	9.7	7.5	9.1	6.5	9.0	8.5
3.7 ≤ E < 3.9	8.7	9.6	7.4	8.9	6.3	8.8	8.4
3.9 ≤ E < 4.1	8.6	9.4	7.2	8.8	6.2	8.7	8.2
4.1 ≤ E < 4.3	8.4	9.3	7.1	8.7	6.1	8.6	8.1
4.3 ≤ E < 4.5	8.3	9.1	7.0	8.6	6.0	8.4	8.0
4.5 ≤ E < 4.7	8.1	9.0	6.9	8.5	6.0	8.3	7.9
4.7 ≤ E < 4.9	8.0	8.9	6.9	8.3	5.9	8.2	7.8
E ≥ 4.9	7.9	8.8	6.8	8.2	5.9	8.1	7.8

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	48 < Assembly Average Burnup ≤ 49 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	10.5	11.6	8.7	10.8	7.3	10.6	9.9
2.9 ≤ E < 3.1	10.2	11.3	8.5	10.4	7.1	10.2	9.7
3.1 ≤ E < 3.3	10.0	11.0	8.3	10.1	7.0	9.9	9.4
3.3 ≤ E < 3.5	9.7	10.7	8.1	9.9	6.9	9.8	9.2
3.5 ≤ E < 3.7	9.5	10.5	7.9	9.7	6.8	9.6	9.0
3.7 ≤ E < 3.9	9.3	10.3	7.8	9.5	6.7	9.4	8.9
3.9 ≤ E < 4.1	9.1	10.1	7.7	9.4	6.5	9.2	8.7
4.1 ≤ E < 4.3	9.0	9.9	7.5	9.2	6.4	9.0	8.6
4.3 ≤ E < 4.5	8.8	9.7	7.4	9.1	6.3	8.9	8.5
4.5 ≤ E < 4.7	8.7	9.6	7.3	8.9	6.3	8.8	8.4
4.7 ≤ E < 4.9	8.6	9.5	7.2	8.9	6.2	8.7	8.3
E ≥ 4.9	8.5	9.3	7.1	8.8	6.1	8.6	8.2
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	49 < Assembly Average Burnup ≤ 50 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	11.0	12.0	9.0	11.2	7.6	11.0	10.3
3.1 ≤ E < 3.3	10.7	11.7	8.8	10.9	7.4	10.7	10.1
3.3 ≤ E < 3.5	10.4	11.5	8.6	10.7	7.2	10.4	9.8
3.5 ≤ E < 3.7	10.2	11.3	8.4	10.4	7.0	10.2	9.7
3.7 ≤ E < 3.9	10.0	11.0	8.2	10.2	7.0	10.0	9.5
3.9 ≤ E < 4.1	9.7	10.8	8.0	10.0	6.8	9.8	9.3
4.1 ≤ E < 4.3	9.6	10.6	7.9	9.8	6.7	9.7	9.1
4.3 ≤ E < 4.5	9.4	10.4	7.8	9.7	6.7	9.5	9.0
4.5 ≤ E < 4.7	9.3	10.2	7.7	9.5	6.6	9.4	8.9
4.7 ≤ E < 4.9	9.1	10.1	7.6	9.4	6.5	9.2	8.7
E ≥ 4.9	9.0	10.0	7.5	9.3	6.4	9.1	8.6

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	50 < Assembly Average Burnup ≤ 51 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	11.8	12.9	9.6	12.0	8.0	11.8	11.1
3.1 ≤ E < 3.3	11.5	12.6	9.4	11.7	7.8	11.5	10.9
3.3 ≤ E < 3.5	11.2	12.3	9.1	11.5	7.6	11.2	10.6
3.5 ≤ E < 3.7	10.9	11.9	8.9	11.1	7.5	11.0	10.3
3.7 ≤ E < 3.9	10.7	11.8	8.7	10.9	7.3	10.7	10.0
3.9 ≤ E < 4.1	10.4	11.6	8.6	10.7	7.2	10.5	9.9
4.1 ≤ E < 4.3	10.3	11.3	8.4	10.5	7.0	10.3	9.7
4.3 ≤ E < 4.5	10.0	11.2	8.3	10.4	7.0	10.1	9.6
4.5 ≤ E < 4.7	9.9	11.0	8.1	10.1	6.8	9.9	9.4
4.7 ≤ E < 4.9	9.8	10.9	8.0	10.0	6.8	9.8	9.3
E ≥ 4.9	9.6	10.7	7.9	9.9	6.7	9.7	9.1
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	51 < Assembly Average Burnup ≤ 52 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	12.7	13.9	10.3	12.9	8.4	12.6	11.9
3.1 ≤ E < 3.3	12.3	13.4	10.0	12.5	8.2	12.3	11.6
3.3 ≤ E < 3.5	11.9	13.2	9.8	12.1	8.0	11.9	11.3
3.5 ≤ E < 3.7	11.7	12.9	9.5	11.9	7.9	11.7	11.0
3.7 ≤ E < 3.9	11.5	12.6	9.3	11.7	7.7	11.4	10.8
3.9 ≤ E < 4.1	11.2	12.4	9.1	11.5	7.6	11.3	10.5
4.1 ≤ E < 4.3	11.0	12.1	8.9	11.3	7.4	11.0	10.3
4.3 ≤ E < 4.5	10.8	11.8	8.8	11.1	7.3	10.9	10.2
4.5 ≤ E < 4.7	10.6	11.7	8.7	10.9	7.2	10.7	10.0
4.7 ≤ E < 4.9	10.5	11.6	8.5	10.7	7.1	10.5	9.9
E ≥ 4.9	10.2	11.4	8.4	10.6	7.0	10.4	9.8

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	52 < Assembly Average Burnup ≤ 53 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	13.6	14.8	11.0	13.7	8.9	13.4	12.7
3.1 ≤ E < 3.3	13.2	14.5	10.7	13.3	8.7	13.1	12.4
3.3 ≤ E < 3.5	12.8	14.1	10.4	13.0	8.5	12.8	12.0
3.5 ≤ E < 3.7	12.6	13.8	10.1	12.7	8.3	12.5	11.8
3.7 ≤ E < 3.9	12.2	13.5	9.8	12.4	8.1	12.2	11.5
3.9 ≤ E < 4.1	11.9	13.2	9.7	12.2	7.9	12.0	11.3
4.1 ≤ E < 4.3	11.7	13.0	9.5	12.0	7.8	11.8	11.1
4.3 ≤ E < 4.5	11.6	12.7	9.3	11.8	7.7	11.5	10.9
4.5 ≤ E < 4.7	11.4	12.5	9.2	11.6	7.6	11.4	10.7
4.7 ≤ E < 4.9	11.2	12.4	9.0	11.5	7.5	11.3	10.5
E ≥ 4.9	11.0	12.1	8.9	11.3	7.4	11.1	10.4
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	53 < Assembly Average Burnup ≤ 54 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	14.5	15.8	11.8	14.6	9.5	14.4	13.6
3.1 ≤ E < 3.3	14.1	15.4	11.4	14.3	9.2	14.0	13.2
3.3 ≤ E < 3.5	13.8	15.1	11.1	13.9	8.9	13.6	12.8
3.5 ≤ E < 3.7	13.4	14.7	10.9	13.6	8.7	13.4	12.6
3.7 ≤ E < 3.9	13.1	14.4	10.6	13.3	8.6	13.1	12.2
3.9 ≤ E < 4.1	12.9	14.1	10.4	13.1	8.4	12.8	12.0
4.1 ≤ E < 4.3	12.6	13.9	10.1	12.8	8.2	12.5	11.8
4.3 ≤ E < 4.5	12.4	13.6	9.9	12.6	8.1	12.3	11.6
4.5 ≤ E < 4.7	12.1	13.4	9.7	12.3	7.9	12.1	11.4
4.7 ≤ E < 4.9	11.9	13.2	9.6	12.2	7.9	11.9	11.2
E ≥ 4.9	11.7	13.1	9.4	12.0	7.8	11.7	11.1

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	54 < Assembly Average Burnup ≤ 55 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	15.0	16.4	12.1	15.2	9.8	14.9	14.1
3.3 ≤ E < 3.5	14.7	16.0	11.9	14.9	9.5	14.6	13.7
3.5 ≤ E < 3.7	14.3	15.7	11.5	14.5	9.3	14.2	13.4
3.7 ≤ E < 3.9	13.9	15.4	11.3	14.2	9.0	13.9	13.1
3.9 ≤ E < 4.1	13.6	15.1	11.1	13.9	8.9	13.6	12.8
4.1 ≤ E < 4.3	13.3	14.7	10.8	13.6	8.7	13.4	12.5
4.3 ≤ E < 4.5	13.1	14.5	10.5	13.4	8.5	13.1	12.3
4.5 ≤ E < 4.7	12.9	14.3	10.4	13.2	8.4	13.0	12.1
4.7 ≤ E < 4.9	12.8	14.1	10.2	13.0	8.3	12.8	11.9
E ≥ 4.9	12.5	13.9	10.0	12.8	8.1	12.5	11.7
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	55 < Assembly Average Burnup ≤ 56 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	15.8	17.5	13.1	16.2	10.4	15.9	15.0
3.3 ≤ E < 3.5	15.5	17.1	12.7	15.8	10.1	15.5	14.6
3.5 ≤ E < 3.7	15.1	16.7	12.3	15.5	9.9	15.2	14.3
3.7 ≤ E < 3.9	14.7	16.3	12.0	15.1	9.7	14.8	13.9
3.9 ≤ E < 4.1	14.4	16.0	11.8	14.9	9.4	14.6	13.6
4.1 ≤ E < 4.3	14.0	15.7	11.5	14.5	9.2	14.3	13.4
4.3 ≤ E < 4.5	13.8	15.4	11.3	14.3	9.0	14.0	13.1
4.5 ≤ E < 4.7	13.7	15.2	11.1	14.1	8.8	13.8	12.9
4.7 ≤ E < 4.9	13.4	15.0	10.9	13.9	8.7	13.7	12.8
E ≥ 4.9	13.3	14.8	10.7	13.7	8.6	13.4	12.5

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	56 < Assembly Average Burnup ≤ 57 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	16.8	18.4	13.8	17.2	11.1	16.9	16.0
3.3 ≤ E < 3.5	16.5	18.1	13.5	16.8	10.9	16.4	15.5
3.5 ≤ E < 3.7	16.0	17.7	13.1	16.4	10.5	16.2	15.2
3.7 ≤ E < 3.9	15.7	17.3	12.9	16.1	10.2	15.7	14.8
3.9 ≤ E < 4.1	15.4	17.1	12.5	15.8	10.0	15.4	14.5
4.1 ≤ E < 4.3	15.1	16.8	12.2	15.4	9.8	15.2	14.3
4.3 ≤ E < 4.5	14.8	16.4	12.0	15.2	9.6	14.8	14.0
4.5 ≤ E < 4.7	14.6	16.2	11.8	15.0	9.4	14.7	13.8
4.7 ≤ E < 4.9	14.3	15.9	11.6	14.7	9.2	14.4	13.5
E ≥ 4.9	14.0	15.7	11.4	14.5	9.0	14.3	13.4
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	57 < Assembly Average Burnup ≤ 58 GWd/MTU Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	17.8	19.5	14.8	18.2	11.8	17.8	16.8
3.3 ≤ E < 3.5	17.3	19.1	14.4	17.7	11.5	17.5	16.5
3.5 ≤ E < 3.7	17.0	18.7	14.0	17.4	11.2	17.1	16.1
3.7 ≤ E < 3.9	16.6	18.3	13.6	17.0	10.9	16.8	15.7
3.9 ≤ E < 4.1	16.3	17.9	13.3	16.7	10.6	16.4	15.4
4.1 ≤ E < 4.3	15.9	17.7	13.1	16.3	10.3	16.1	15.1
4.3 ≤ E < 4.5	15.7	17.4	12.8	16.1	10.1	15.8	14.8
4.5 ≤ E < 4.7	15.5	17.1	12.5	15.9	9.9	15.5	14.6
4.7 ≤ E < 4.9	15.2	16.9	12.3	15.6	9.8	15.3	14.4
E ≥ 4.9	15.0	16.7	12.1	15.4	9.6	15.1	14.2

**Table B2-24 Loading Table for BWR Fuel – 360 W/Assembly (continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	58 < Assembly Average Burnup ≤ 59 GWd/MTU						
	Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	18.7	20.4	15.7	19.2	12.6	18.9	17.8
3.3 ≤ E < 3.5	18.4	20.0	15.2	18.8	12.2	18.4	17.4
3.5 ≤ E < 3.7	18.0	19.7	14.9	18.4	11.9	18.1	17.1
3.7 ≤ E < 3.9	17.6	19.3	14.5	18.1	11.6	17.7	16.7
3.9 ≤ E < 4.1	17.2	18.9	14.1	17.7	11.2	17.3	16.3
4.1 ≤ E < 4.3	16.9	18.7	13.8	17.4	11.0	17.1	16.1
4.3 ≤ E < 4.5	16.6	18.4	13.6	17.1	10.8	16.8	15.7
4.5 ≤ E < 4.7	16.4	18.0	13.3	16.9	10.6	16.5	15.5
4.7 ≤ E < 4.9	16.1	17.8	13.1	16.6	10.3	16.2	15.3
E ≥ 4.9	15.9	17.6	12.9	16.3	10.2	15.9	15.1
Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	59 < Assembly Average Burnup ≤ 60 GWd/MTU						
	Minimum Cooling Time (years)						
	BWR/2-3 7×7	BWR/4-6 7×7	BWR/2-3 8×8	BWR/4-6 8×8	BWR/2-3 9×9	BWR/4-6 9×9	BWR/4-6 10×10
2.1 ≤ E < 2.3	-	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-	-
2.9 ≤ E < 3.1	-	-	-	-	-	-	-
3.1 ≤ E < 3.3	-	-	-	-	-	-	-
3.3 ≤ E < 3.5	19.3	21.0	16.0	19.7	12.9	19.5	18.4
3.5 ≤ E < 3.7	18.9	20.7	15.6	19.3	12.7	19.1	17.9
3.7 ≤ E < 3.9	18.6	20.3	15.2	19.0	12.3	18.7	17.7
3.9 ≤ E < 4.1	18.2	19.9	14.9	18.7	11.9	18.3	17.3
4.1 ≤ E < 4.3	17.9	19.7	14.5	18.3	11.6	17.9	17.0
4.3 ≤ E < 4.5	17.6	19.4	14.2	18.1	11.4	17.7	16.6
4.5 ≤ E < 4.7	17.3	19.1	14.0	17.7	11.2	17.5	16.4
4.7 ≤ E < 4.9	17.1	18.8	13.8	17.6	11.0	17.2	16.1
E ≥ 4.9	16.9	18.6	13.6	17.3	10.8	16.9	15.9

**Table B2-25 Loading Table for PWR Fuel – 959 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10 < B ≤15	15 < B ≤20	20 < B ≤25	25 < B ≤30	30 < B ≤32.5
1.3 ≤ E < 1.5	2.5	-	-	-	-	-
1.5 ≤ E < 1.7	2.5	2.5	-	-	-	-
1.7 ≤ E < 1.9	2.5	2.5	2.9	-	-	-
1.9 ≤ E < 2.1	2.5	2.5	2.9	3.4	-	-
2.1 ≤ E < 2.3	2.5	2.5	2.8	3.3	3.9	4.1
2.3 ≤ E < 2.5	2.5	2.5	2.8	3.3	3.8	4.1
2.5 ≤ E < 2.7	2.5	2.5	2.8	3.3	3.8	4.0
2.7 ≤ E < 2.9	2.5	2.5	2.8	3.2	3.7	4.0
2.9 ≤ E < 3.1	2.5	2.5	2.7	3.2	3.7	3.9
3.1 ≤ E < 3.3	2.5	2.5	2.7	3.2	3.7	3.9
3.3 ≤ E < 3.5	2.5	2.5	2.7	3.2	3.6	3.9
3.5 ≤ E < 3.7	2.5	2.5	2.7	3.1	3.6	3.8
3.7 ≤ E < 3.9	2.5	2.5	2.7	3.1	3.6	3.8
3.9 ≤ E < 4.1	2.5	2.5	2.6	3.1	3.6	3.8
4.1 ≤ E < 4.3	2.5	2.5	2.6	3.1	3.5	3.8
4.3 ≤ E < 4.5	2.5	2.5	2.6	3.0	3.5	3.7
4.5 ≤ E < 4.7	2.5	2.5	2.6	3.0	3.5	3.7
4.7 ≤ E < 4.9	2.5	2.5	2.6	3.0	3.5	3.7
E ≥ 4.9	2.5	2.5	2.6	3.0	3.5	3.7

**Table B2-25 Loading Table for PWR Fuel – 959 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.4	4.8	-	-	-	-
2.5 ≤ E < 2.7	4.4	4.7	5.2	5.4	5.6	5.8
2.7 ≤ E < 2.9	4.3	4.7	5.1	5.3	5.5	5.7
2.9 ≤ E < 3.1	4.3	4.6	5.0	5.2	5.4	5.6
3.1 ≤ E < 3.3	4.2	4.5	4.9	5.1	5.3	5.6
3.3 ≤ E < 3.5	4.2	4.5	4.9	5.1	5.3	5.5
3.5 ≤ E < 3.7	4.1	4.5	4.8	5.0	5.2	5.4
3.7 ≤ E < 3.9	4.1	4.4	4.8	4.9	5.1	5.3
3.9 ≤ E < 4.1	4.1	4.4	4.8	4.9	5.1	5.3
4.1 ≤ E < 4.3	4.0	4.4	4.7	4.9	5.0	5.2
4.3 ≤ E < 4.5	4.0	4.3	4.7	4.8	5.0	5.2
4.5 ≤ E < 4.7	4.0	4.3	4.6	4.8	4.9	5.1
4.7 ≤ E < 4.9	4.0	4.3	4.6	4.7	4.9	5.0
E ≥ 4.9	3.9	4.2	4.5	4.7	4.9	5.0

**Table B2-25 Loading Table for PWR Fuel – 959 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45 <sup>a</sup>
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	6.0	-
2.7 ≤ E < 2.9	5.9	6.2
2.9 ≤ E < 3.1	5.8	6.0
3.1 ≤ E < 3.3	5.8	6.0
3.3 ≤ E < 3.5	5.7	5.9
3.5 ≤ E < 3.7	5.6	5.8
3.7 ≤ E < 3.9	5.6	5.8
3.9 ≤ E < 4.1	5.5	5.7
4.1 ≤ E < 4.3	5.4	5.6
4.3 ≤ E < 4.5	5.4	5.6
4.5 ≤ E < 4.7	5.3	5.5
4.7 ≤ E < 4.9	5.3	5.5
E ≥ 4.9	5.2	5.4

---

<sup>a</sup> Cool times for burnup over 45 GWd/MTU are in Table B2-16

**Table B2-26 Loading Table for PWR Fuel – 513 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10< B ≤15	15< B ≤20	20< B ≤25	25< B ≤30	30< B ≤32.5
1.3 ≤ E < 1.5	2.9	-	-	-	-	-
1.5 ≤ E < 1.7	2.9	3.8	-	-	-	-
1.7 ≤ E < 1.9	2.9	3.7	4.5	-	-	-
1.9 ≤ E < 2.1	2.9	3.7	4.5	5.7	-	-
2.1 ≤ E < 2.3	2.8	3.7	4.5	5.7	7.5	8.9
2.3 ≤ E < 2.5	2.8	3.6	4.4	5.6	7.4	8.8
2.5 ≤ E < 2.7	2.8	3.6	4.4	5.6	7.3	8.6
2.7 ≤ E < 2.9	2.8	3.6	4.4	5.5	7.2	8.5
2.9 ≤ E < 3.1	2.8	3.5	4.4	5.5	7.1	8.5
3.1 ≤ E < 3.3	2.8	3.5	4.3	5.5	7.1	8.4
3.3 ≤ E < 3.5	2.8	3.5	4.3	5.4	7.0	8.3
3.5 ≤ E < 3.7	2.7	3.5	4.3	5.4	7.0	8.2
3.7 ≤ E < 3.9	2.7	3.5	4.3	5.4	7.0	8.1
3.9 ≤ E < 4.1	2.7	3.5	4.3	5.3	6.9	8.1
4.1 ≤ E < 4.3	2.7	3.5	4.2	5.3	6.9	8.0
4.3 ≤ E < 4.5	2.7	3.5	4.2	5.3	6.8	8.0
4.5 ≤ E < 4.7	2.7	3.5	4.2	5.2	6.8	7.9
4.7 ≤ E < 4.9	2.7	3.4	4.2	5.2	6.8	7.9
E ≥ 4.9	2.7	3.4	4.2	5.2	6.8	7.9

**Table B2-26 Loading Table for PWR Fuel – 513 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	10.9	13.7	-	-	-	-
2.5 ≤ E < 2.7	10.7	13.5	16.9	18.2	19.7	21.2
2.7 ≤ E < 2.9	10.5	13.3	16.5	18.0	19.4	20.8
2.9 ≤ E < 3.1	10.4	13.1	16.3	17.7	19.2	20.6
3.1 ≤ E < 3.3	10.2	12.8	16.0	17.5	18.9	20.4
3.3 ≤ E < 3.5	10.1	12.7	15.9	17.2	18.7	20.1
3.5 ≤ E < 3.7	10.0	12.5	15.6	17.0	18.4	19.9
3.7 ≤ E < 3.9	9.9	12.4	15.5	16.8	18.2	19.6
3.9 ≤ E < 4.1	9.8	12.3	15.3	16.7	18.0	19.5
4.1 ≤ E < 4.3	9.8	12.1	15.2	16.5	17.9	19.3
4.3 ≤ E < 4.5	9.7	12.0	15.1	16.3	17.7	19.2
4.5 ≤ E < 4.7	9.7	11.9	15.0	16.2	17.6	19.0
4.7 ≤ E < 4.9	9.6	11.9	14.9	16.1	17.5	18.8
E ≥ 4.9	9.5	11.8	14.8	16.0	17.3	18.7

**Table B2-26 Loading Table for PWR Fuel – 513 W/Assembly – WE 14x14 Fuel**  
(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	22.7	-
2.7 ≤ E < 2.9	22.3	23.8
2.9 ≤ E < 3.1	22.1	23.5
3.1 ≤ E < 3.3	21.8	23.2
3.3 ≤ E < 3.5	21.6	22.9
3.5 ≤ E < 3.7	21.3	22.7
3.7 ≤ E < 3.9	21.1	22.5
3.9 ≤ E < 4.1	20.9	22.3
4.1 ≤ E < 4.3	20.8	22.1
4.3 ≤ E < 4.5	20.6	21.9
4.5 ≤ E < 4.7	20.4	21.8
4.7 ≤ E < 4.9	20.3	21.6
E ≥ 4.9	20.1	21.5

**Table B2-27 Loading Table for PWR Fuel – 1300 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10< B ≤15	15< B ≤20	20< B ≤25	25< B ≤30	30< B ≤32.5
1.3 ≤ E < 1.5	2.5	-	-	-	-	-
1.5 ≤ E < 1.7	2.5	2.5	-	-	-	-
1.7 ≤ E < 1.9	2.5	2.5	2.5	-	-	-
1.9 ≤ E < 2.1	2.5	2.5	2.5	2.7	-	-
2.1 ≤ E < 2.3	2.5	2.5	2.5	2.6	3.0	3.2
2.3 ≤ E < 2.5	2.5	2.5	2.5	2.6	3.0	3.2
2.5 ≤ E < 2.7	2.5	2.5	2.5	2.6	3.0	3.1
2.7 ≤ E < 2.9	2.5	2.5	2.5	2.6	2.9	3.1
2.9 ≤ E < 3.1	2.5	2.5	2.5	2.5	2.9	3.0
3.1 ≤ E < 3.3	2.5	2.5	2.5	2.5	2.9	3.0
3.3 ≤ E < 3.5	2.5	2.5	2.5	2.5	2.9	3.0
3.5 ≤ E < 3.7	2.5	2.5	2.5	2.5	2.8	3.0
3.7 ≤ E < 3.9	2.5	2.5	2.5	2.5	2.8	3.0
3.9 ≤ E < 4.1	2.5	2.5	2.5	2.5	2.8	2.9
4.1 ≤ E < 4.3	2.5	2.5	2.5	2.5	2.8	2.9
4.3 ≤ E < 4.5	2.5	2.5	2.5	2.5	2.8	2.9
4.5 ≤ E < 4.7	2.5	2.5	2.5	2.5	2.7	2.9
4.7 ≤ E < 4.9	2.5	2.5	2.5	2.5	2.7	2.9
E ≥ 4.9	2.5	2.5	2.5	2.5	2.7	2.8

**Table B2-27 Loading Table for PWR Fuel – 1300 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	3.4	3.6	-	-	-	-
2.5 ≤ E < 2.7	3.3	3.6	3.8	3.9	4.0	4.1
2.7 ≤ E < 2.9	3.3	3.5	3.8	3.9	4.0	4.1
2.9 ≤ E < 3.1	3.3	3.5	3.7	3.8	3.9	4.0
3.1 ≤ E < 3.3	3.2	3.4	3.7	3.8	3.9	4.0
3.3 ≤ E < 3.5	3.2	3.4	3.6	3.7	3.8	3.9
3.5 ≤ E < 3.7	3.2	3.4	3.6	3.7	3.8	3.9
3.7 ≤ E < 3.9	3.1	3.4	3.6	3.6	3.8	3.9
3.9 ≤ E < 4.1	3.1	3.3	3.5	3.6	3.7	3.8
4.1 ≤ E < 4.3	3.1	3.3	3.5	3.6	3.7	3.8
4.3 ≤ E < 4.5	3.0	3.3	3.5	3.6	3.6	3.8
4.5 ≤ E < 4.7	3.0	3.2	3.4	3.5	3.6	3.7
4.7 ≤ E < 4.9	3.0	3.2	3.4	3.5	3.6	3.7
E ≥ 4.9	3.0	3.2	3.4	3.5	3.5	3.7

**Table B2-27 Loading Table for PWR Fuel – 1300 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	4.3	-
2.7 ≤ E < 2.9	4.2	4.3
2.9 ≤ E < 3.1	4.2	4.3
3.1 ≤ E < 3.3	4.1	4.2
3.3 ≤ E < 3.5	4.0	4.2
3.5 ≤ E < 3.7	4.0	4.1
3.7 ≤ E < 3.9	4.0	4.0
3.9 ≤ E < 4.1	3.9	4.0
4.1 ≤ E < 4.3	3.9	4.0
4.3 ≤ E < 4.5	3.8	3.9
4.5 ≤ E < 4.7	3.9	3.9
4.7 ≤ E < 4.9	3.8	3.9
E ≥ 4.9	3.8	3.8

**Table B2-28 Loading Table for PWR Fuel – 1800 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10< B ≤15	15< B ≤20	20< B ≤25	25< B ≤30	30< B ≤32.5
1.3 ≤ E < 1.5	2.5	-	-	-	-	-
1.5 ≤ E < 1.7	2.5	2.5	-	-	-	-
1.7 ≤ E < 1.9	2.5	2.5	2.5	-	-	-
1.9 ≤ E < 2.1	2.5	2.5	2.5	2.5	-	-
2.1 ≤ E < 2.3	2.5	2.5	2.5	2.5	2.5	2.5
2.3 ≤ E < 2.5	2.5	2.5	2.5	2.5	2.5	2.5
2.5 ≤ E < 2.7	2.5	2.5	2.5	2.5	2.5	2.5
2.7 ≤ E < 2.9	2.5	2.5	2.5	2.5	2.5	2.5
2.9 ≤ E < 3.1	2.5	2.5	2.5	2.5	2.5	2.5
3.1 ≤ E < 3.3	2.5	2.5	2.5	2.5	2.5	2.5
3.3 ≤ E < 3.5	2.5	2.5	2.5	2.5	2.5	2.5
3.5 ≤ E < 3.7	2.5	2.5	2.5	2.5	2.5	2.5
3.7 ≤ E < 3.9	2.5	2.5	2.5	2.5	2.5	2.5
3.9 ≤ E < 4.1	2.5	2.5	2.5	2.5	2.5	2.5
4.1 ≤ E < 4.3	2.5	2.5	2.5	2.5	2.5	2.5
4.3 ≤ E < 4.5	2.5	2.5	2.5	2.5	2.5	2.5
4.5 ≤ E < 4.7	2.5	2.5	2.5	2.5	2.5	2.5
4.7 ≤ E < 4.9	2.5	2.5	2.5	2.5	2.5	2.5
E ≥ 4.9	2.5	2.5	2.5	2.5	2.5	2.5

**Table B2-28 Loading Table for PWR Fuel – 1800 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	2.6	2.7	-	-	-	-
2.5 ≤ E < 2.7	2.5	2.7	2.9	2.9	3.0	3.1
2.7 ≤ E < 2.9	2.5	2.7	2.8	2.9	3.0	3.0
2.9 ≤ E < 3.1	2.5	2.6	2.8	2.9	2.9	3.0
3.1 ≤ E < 3.3	2.5	2.6	2.8	2.8	2.9	3.0
3.3 ≤ E < 3.5	2.5	2.6	2.7	2.8	2.9	2.9
3.5 ≤ E < 3.7	2.5	2.5	2.7	2.8	2.8	2.9
3.7 ≤ E < 3.9	2.5	2.5	2.7	2.7	2.8	2.9
3.9 ≤ E < 4.1	2.5	2.5	2.6	2.7	2.8	2.8
4.1 ≤ E < 4.3	2.5	2.5	2.6	2.7	2.8	2.8
4.3 ≤ E < 4.5	2.5	2.5	2.6	2.7	2.7	2.8
4.5 ≤ E < 4.7	2.5	2.5	2.6	2.6	2.7	2.8
4.7 ≤ E < 4.9	2.5	2.5	2.5	2.6	2.7	2.7
E ≥ 4.9	2.5	2.5	2.5	2.6	2.6	2.7

**Table B2-28 Loading Table for PWR Fuel – 1800 W/Assembly – WE 14x14 Fuel**  
(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	3.1	-
2.7 ≤ E < 2.9	3.1	3.2
2.9 ≤ E < 3.1	3.1	3.1
3.1 ≤ E < 3.3	3.0	3.1
3.3 ≤ E < 3.5	3.0	3.1
3.5 ≤ E < 3.7	3.0	3.0
3.7 ≤ E < 3.9	2.9	3.0
3.9 ≤ E < 4.1	2.9	3.0
4.1 ≤ E < 4.3	2.9	2.9
4.3 ≤ E < 4.5	2.8	2.9
4.5 ≤ E < 4.7	2.9	2.9
4.7 ≤ E < 4.9	2.8	2.9
E ≥ 4.9	2.8	2.8

**Table B2-29 Loading Table for PWR Fuel – 830 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10< B ≤15	15< B ≤20	20< B ≤25	25< B ≤30	30< B ≤32.5
1.3 ≤ E < 1.5	2.5	-	-	-	-	-
1.5 ≤ E < 1.7	2.5	2.7	-	-	-	-
1.7 ≤ E < 1.9	2.5	2.7	3.2	-	-	-
1.9 ≤ E < 2.1	2.5	2.7	3.2	3.8	-	-
2.1 ≤ E < 2.3	2.5	2.6	3.1	3.7	4.4	4.7
2.3 ≤ E < 2.5	2.5	2.6	3.1	3.7	4.3	4.6
2.5 ≤ E < 2.7	2.5	2.6	3.1	3.6	4.3	4.6
2.7 ≤ E < 2.9	2.5	2.6	3.0	3.6	4.2	4.5
2.9 ≤ E < 3.1	2.5	2.5	3.0	3.6	4.2	4.5
3.1 ≤ E < 3.3	2.5	2.5	3.0	3.5	4.2	4.5
3.3 ≤ E < 3.5	2.5	2.5	3.0	3.5	4.1	4.4
3.5 ≤ E < 3.7	2.5	2.5	3.0	3.5	4.1	4.4
3.7 ≤ E < 3.9	2.5	2.5	3.0	3.5	4.0	4.4
3.9 ≤ E < 4.1	2.5	2.5	2.9	3.5	4.0	4.3
4.1 ≤ E < 4.3	2.5	2.5	2.9	3.4	4.0	4.3
4.3 ≤ E < 4.5	2.5	2.5	2.9	3.4	4.0	4.3
4.5 ≤ E < 4.7	2.5	2.5	2.9	3.4	4.0	4.2
4.7 ≤ E < 4.9	2.5	2.5	2.9	3.4	3.9	4.2
E ≥ 4.9	2.5	2.5	2.9	3.4	3.9	4.2

**Table B2-29 Loading Table for PWR Fuel – 830 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	5.1	5.6	-	-	-	-
2.5 ≤ E < 2.7	5.0	5.6	6.1	6.4	6.8	7.1
2.7 ≤ E < 2.9	5.0	5.5	6.0	6.3	6.6	6.9
2.9 ≤ E < 3.1	4.9	5.4	6.0	6.2	6.5	6.8
3.1 ≤ E < 3.3	4.9	5.4	5.9	6.1	6.4	6.7
3.3 ≤ E < 3.5	4.8	5.3	5.8	6.0	6.3	6.6
3.5 ≤ E < 3.7	4.8	5.2	5.8	6.0	6.3	6.6
3.7 ≤ E < 3.9	4.7	5.2	5.7	5.9	6.2	6.5
3.9 ≤ E < 4.1	4.7	5.1	5.7	5.9	6.1	6.4
4.1 ≤ E < 4.3	4.6	5.1	5.6	5.8	6.0	6.3
4.3 ≤ E < 4.5	4.6	5.0	5.6	5.8	6.0	6.2
4.5 ≤ E < 4.7	4.6	5.0	5.5	5.7	5.9	6.2
4.7 ≤ E < 4.9	4.5	5.0	5.5	5.7	5.9	6.1
E ≥ 4.9	4.5	4.9	5.4	5.6	5.9	6.0

**Table B2-29 Loading Table for PWR Fuel – 830 W/Assembly – WE 14x14 Fuel**  
(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	7.5	-
2.7 ≤ E < 2.9	7.3	7.7
2.9 ≤ E < 3.1	7.2	7.6
3.1 ≤ E < 3.3	7.0	7.5
3.3 ≤ E < 3.5	6.9	7.3
3.5 ≤ E < 3.7	6.8	7.2
3.7 ≤ E < 3.9	6.8	7.1
3.9 ≤ E < 4.1	6.7	7.0
4.1 ≤ E < 4.3	6.6	6.9
4.3 ≤ E < 4.5	6.6	6.8
4.5 ≤ E < 4.7	6.5	6.8
4.7 ≤ E < 4.9	6.4	6.7
E ≥ 4.9	6.4	6.7

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-30 Loading Table for PWR Fuel – 487 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	27.9	29.3	30.7	32.0	-	-
2.9 ≤ E < 3.1	27.6	29.0	30.4	31.8	32.7	33.9
3.1 ≤ E < 3.3	27.4	28.8	30.2	31.6	32.4	33.7
3.3 ≤ E < 3.5	27.1	28.5	30.0	31.4	32.2	33.6
3.5 ≤ E < 3.7	26.9	28.3	29.7	31.1	32.0	33.3
3.7 ≤ E < 3.9	26.7	28.1	29.5	30.9	31.8	33.1
3.9 ≤ E < 4.1	26.6	27.9	29.4	30.8	31.6	32.9
4.1 ≤ E < 4.3	26.3	27.8	29.2	30.6	31.4	33.5
4.3 ≤ E < 4.5	26.1	27.5	29.0	30.3	31.2	32.6
4.5 ≤ E < 4.7	26.0	27.4	28.8	30.2	31.1	32.4
4.7 ≤ E < 4.9	25.9	27.3	28.6	30.1	30.9	32.3
E ≥ 4.9	25.8	27.1	28.5	30.0	30.8	32.1

**Table B2-30 Loading Table for PWR Fuel – 487 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	51< B ≤52	52< B ≤53	53< B ≤54	54< B ≤55	55< B ≤56	56< B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	35.2	36.4	37.7	-	-	-
3.1 ≤ E < 3.3	35.0	36.2	37.4	38.8	39.8	41.0
3.3 ≤ E < 3.5	34.8	36.0	37.2	38.5	39.6	40.9
3.5 ≤ E < 3.7	34.5	35.9	37.1	38.4	39.5	40.7
3.7 ≤ E < 3.9	34.3	35.6	36.9	38.2	39.4	40.5
3.9 ≤ E < 4.1	34.2	35.4	36.7	38.1	39.2	40.4
4.1 ≤ E < 4.3	34.1	35.2	36.6	37.9	39.2	40.2
4.3 ≤ E < 4.5	33.9	35.2	36.4	37.7	39.0	40.2
4.5 ≤ E < 4.7	33.7	35.0	36.3	37.6	38.8	40.0
4.7 ≤ E < 4.9	33.5	34.8	36.1	37.4	38.7	39.8
E ≥ 4.9	33.4	34.7	35.9	37.3	38.6	39.7

**Table B2-30 Loading Table for PWR Fuel – 487 W/Assembly – WE 14x14 Fuel**

(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	42.1	43.3	-
3.3 ≤ E < 3.5	42.0	43.1	44.1
3.5 ≤ E < 3.7	41.9	43.0	44.1
3.7 ≤ E < 3.9	41.7	42.9	43.9
3.9 ≤ E < 4.1	41.6	42.7	43.8
4.1 ≤ E < 4.3	41.5	42.6	43.7
4.3 ≤ E < 4.5	41.3	42.5	43.6
4.5 ≤ E < 4.7	41.2	42.4	43.5
4.7 ≤ E < 4.9	41.0	42.3	43.4
E ≥ 4.9	40.9	42.1	43.3

**Table B2-31 Loading Table for PWR Fuel – 1235 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	4.7	4.9	5.0	5.2	-	-
2.9 ≤ E < 3.1	4.6	4.8	4.9	5.1	5.2	5.4
3.1 ≤ E < 3.3	4.6	4.7	4.9	5.0	5.1	5.3
3.3 ≤ E < 3.5	4.5	4.6	4.8	4.9	5.0	5.2
3.5 ≤ E < 3.7	4.5	4.6	4.7	4.9	5.0	5.2
3.7 ≤ E < 3.9	4.4	4.5	4.7	4.8	4.9	5.1
3.9 ≤ E < 4.1	4.4	4.5	4.6	4.8	4.9	5.0
4.1 ≤ E < 4.3	4.3	4.4	4.5	4.7	4.8	4.9
4.3 ≤ E < 4.5	4.3	4.4	4.5	4.6	4.8	4.9
4.5 ≤ E < 4.7	4.2	4.3	4.5	4.6	4.7	4.8
4.7 ≤ E < 4.9	4.2	4.3	4.4	4.6	4.7	4.8
E ≥ 4.9	4.1	4.3	4.4	4.5	4.6	4.7

**Table B2-31 Loading Table for PWR Fuel – 1235 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	51< B ≤52	52< B ≤53	53< B ≤54	54< B ≤55	55< B ≤56	56< B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	5.6	5.8	6.0	-	-	-
3.1 ≤ E < 3.3	5.5	5.7	5.9	6.1	6.4	6.7
3.3 ≤ E < 3.5	5.4	5.6	5.8	6.0	6.3	6.5
3.5 ≤ E < 3.7	5.4	5.5	5.7	5.9	6.1	6.4
3.7 ≤ E < 3.9	5.3	5.5	5.6	5.8	6.0	6.3
3.9 ≤ E < 4.1	5.2	5.4	5.6	5.8	5.9	6.1
4.1 ≤ E < 4.3	5.1	5.3	5.5	5.7	5.9	6.0
4.3 ≤ E < 4.5	5.0	5.2	5.4	5.6	5.8	6.0
4.5 ≤ E < 4.7	5.0	5.1	5.3	5.5	5.7	5.9
4.7 ≤ E < 4.9	4.9	5.1	5.3	5.5	5.6	5.8
E ≥ 4.9	4.9	5.0	5.3	5.4	5.6	5.7

**Table B2-31 Loading Table for PWR Fuel – 1235 W/Assembly – WE 14x14 Fuel**

(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	6.9	7.2	-
3.3 ≤ E < 3.5	6.8	7.0	7.4
3.5 ≤ E < 3.7	6.7	6.9	7.2
3.7 ≤ E < 3.9	6.5	6.8	7.0
3.9 ≤ E < 4.1	6.4	6.7	6.9
4.1 ≤ E < 4.3	6.3	6.5	6.8
4.3 ≤ E < 4.5	6.2	6.4	6.7
4.5 ≤ E < 4.7	6.1	6.3	6.6
4.7 ≤ E < 4.9	6.0	6.2	6.5
E ≥ 4.9	5.9	6.1	6.4

**Table B2-32 Loading Table for PWR Fuel – 1710 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	3.4	3.5	3.6	3.7	-	-
2.9 ≤ E < 3.1	3.4	3.5	3.5	3.6	3.7	3.8
3.1 ≤ E < 3.3	3.3	3.4	3.5	3.6	3.6	3.7
3.3 ≤ E < 3.5	3.3	3.4	3.4	3.5	3.6	3.7
3.5 ≤ E < 3.7	3.3	3.3	3.4	3.5	3.5	3.6
3.7 ≤ E < 3.9	3.2	3.3	3.4	3.4	3.5	3.6
3.9 ≤ E < 4.1	3.2	3.3	3.3	3.4	3.5	3.5
4.1 ≤ E < 4.3	3.1	3.2	3.3	3.4	3.4	3.5
4.3 ≤ E < 4.5	3.1	3.2	3.3	3.3	3.4	3.5
4.5 ≤ E < 4.7	3.1	3.2	3.2	3.3	3.4	3.4
4.7 ≤ E < 4.9	3.0	3.1	3.2	3.3	3.4	3.4
E ≥ 4.9	3.0	3.1	3.2	3.2	3.3	3.4

**Table B2-32 Loading Table for PWR Fuel – 1710 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	51< B ≤52	52< B ≤53	53< B ≤54	54< B ≤55	55< B ≤56	56< B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	3.9	4.0	4.0	-	-	-
3.1 ≤ E < 3.3	3.8	3.9	4.0	4.1	4.2	4.3
3.3 ≤ E < 3.5	3.8	3.9	4.0	4.0	4.2	4.3
3.5 ≤ E < 3.7	3.7	3.8	3.9	4.0	4.1	4.2
3.7 ≤ E < 3.9	3.7	3.8	3.8	3.9	4.0	4.2
3.9 ≤ E < 4.1	3.6	3.7	3.8	3.9	4.0	4.1
4.1 ≤ E < 4.3	3.6	3.7	3.8	3.8	3.9	4.0
4.3 ≤ E < 4.5	3.5	3.6	3.7	3.8	3.9	4.0
4.5 ≤ E < 4.7	3.5	3.6	3.7	3.8	3.9	3.9
4.7 ≤ E < 4.9	3.5	3.5	3.6	3.7	3.8	3.9
E ≥ 4.9	3.4	3.5	3.6	3.7	3.8	3.9

**Table B2-32 Loading Table for PWR Fuel – 1710 W/Assembly – WE 14x14 Fuel**

(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	4.4	4.6	-
3.3 ≤ E < 3.5	4.4	4.5	4.6
3.5 ≤ E < 3.7	4.3	4.4	4.5
3.7 ≤ E < 3.9	4.3	4.4	4.5
3.9 ≤ E < 4.1	4.2	4.3	4.4
4.1 ≤ E < 4.3	4.1	4.2	4.3
4.3 ≤ E < 4.5	4.1	4.2	4.3
4.5 ≤ E < 4.7	4.0	4.1	4.2
4.7 ≤ E < 4.9	4.0	4.1	4.2
E ≥ 4.9	3.9	4.0	4.1

**Table B2-33 Loading Table for PWR Fuel – 788 W/Assembly – WE 14x14 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	9.0	9.7	10.4	11.2	-	-
2.9 ≤ E < 3.1	8.9	9.5	10.1	10.9	11.4	12.2
3.1 ≤ E < 3.3	8.7	9.2	9.9	10.6	11.1	11.9
3.3 ≤ E < 3.5	8.5	9.0	9.7	10.3	10.9	11.6
3.5 ≤ E < 3.7	8.4	8.9	9.5	10.1	10.6	11.4
3.7 ≤ E < 3.9	8.2	8.7	9.3	9.9	10.4	11.1
3.9 ≤ E < 4.1	8.1	8.6	9.1	9.7	10.2	10.9
4.1 ≤ E < 4.3	8.0	8.5	9.0	9.5	10.0	10.7
4.3 ≤ E < 4.5	7.9	8.4	8.8	9.4	9.8	10.5
4.5 ≤ E < 4.7	7.8	8.2	8.7	9.3	9.7	10.3
4.7 ≤ E < 4.9	7.7	8.1	8.6	9.1	9.5	10.2
E ≥ 4.9	7.6	8.0	8.5	9.0	9.4	10.0

**Table B2-33 Loading Table for PWR Fuel – 788 W/Assembly – WE 14x14 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU					
	51< B ≤52	52< B ≤53	53< B ≤54	54< B ≤55	55< B ≤56	56< B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	13.1	14.0	15.0	-	-	-
3.1 ≤ E < 3.3	12.8	13.6	14.6	15.6	16.6	17.7
3.3 ≤ E < 3.5	12.4	13.3	14.2	15.3	16.2	17.3
3.5 ≤ E < 3.7	12.1	13.0	13.9	14.9	15.9	16.9
3.7 ≤ E < 3.9	11.9	13.0	13.6	14.6	15.5	16.5
3.9 ≤ E < 4.1	11.6	12.5	13.3	14.2	15.2	16.2
4.1 ≤ E < 4.3	11.4	12.2	13.1	13.9	14.9	15.9
4.3 ≤ E < 4.5	11.3	11.9	12.8	13.7	14.7	15.6
4.5 ≤ E < 4.7	11.1	11.8	12.6	13.5	14.4	15.3
4.7 ≤ E < 4.9	10.9	11.6	12.4	13.3	14.1	15.1
E ≥ 4.9	10.7	11.5	12.6	13.1	13.9	14.8

**Table B2-33 Loading Table for PWR Fuel – 788 W/Assembly – WE 14x14 Fuel**

(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	WE 14x14 Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	18.7	19.7	-
3.3 ≤ E < 3.5	18.2	19.3	20.4
3.5 ≤ E < 3.7	17.9	18.9	19.9
3.7 ≤ E < 3.9	17.5	18.6	19.6
3.9 ≤ E < 4.1	17.2	18.2	19.2
4.1 ≤ E < 4.3	16.9	17.9	18.9
4.3 ≤ E < 4.5	16.6	17.6	18.6
4.5 ≤ E < 4.7	16.3	17.3	18.3
4.7 ≤ E < 4.9	16.0	17.0	18.0
E ≥ 4.9	15.8	16.8	17.8

**Table B2-34 Loading Table for PWR Fuel – 513 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10 < B ≤15	15 < B ≤20	20 < B ≤25	25 < B ≤30	30 < B ≤32.5
1.3 ≤ E < 1.5	4.0	-	-	-	-	-
1.5 ≤ E < 1.7	4.0	4.0	-	-	-	-
1.7 ≤ E < 1.9	4.0	4.0	4.9	-	-	-
1.9 ≤ E < 2.1	4.0	4.0	4.8	6.1	-	-
2.1 ≤ E < 2.3	4.0	4.0	4.8	6.0	8.2	10.0
2.3 ≤ E < 2.5	4.0	4.0	4.7	6.0	8.1	9.9
2.5 ≤ E < 2.7	4.0	4.0	4.7	6.0	8.1	9.8
2.7 ≤ E < 2.9	4.0	4.0	4.7	5.9	8.0	9.7
2.9 ≤ E < 3.1	4.0	4.0	4.6	5.9	7.9	9.6
3.1 ≤ E < 3.3	4.0	4.0	4.6	5.9	7.9	9.5
3.3 ≤ E < 3.5	4.0	4.0	4.6	5.8	7.9	9.4
3.5 ≤ E < 3.7	4.0	4.0	4.6	5.8	7.8	9.4
3.7 ≤ E < 3.9	4.0	4.0	4.5	5.8	7.8	9.3
3.9 ≤ E < 4.1	4.0	4.0	4.5	5.8	7.7	9.2
4.1 ≤ E < 4.3	4.0	4.0	4.5	5.8	7.7	9.2
4.3 ≤ E < 4.5	4.0	4.0	4.5	5.7	7.7	9.2
4.5 ≤ E < 4.7	4.0	4.0	4.5	5.7	7.6	9.1
4.7 ≤ E < 4.9	4.0	4.0	4.5	5.7	7.6	9.1
E ≥ 4.9	4.0	4.0	4.5	5.7	7.6	9.0

**Table B2-34 Loading Table for PWR Fuel – 513 W/Assembly – CE 16x16 Fuel**  
(Continued)

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	12.5	15.8	-	-	-	-
2.5 ≤ E < 2.7	12.3	15.6	19.2	20.7	22.2	23.7
2.7 ≤ E < 2.9	12.1	15.4	19.0	20.5	22.0	23.4
2.9 ≤ E < 3.1	12.0	15.2	18.8	20.2	21.7	23.2
3.1 ≤ E < 3.3	11.9	15.0	18.5	19.9	21.5	23.0
3.3 ≤ E < 3.5	11.8	14.8	18.4	19.8	21.3	22.8
3.5 ≤ E < 3.7	11.7	14.7	18.2	19.7	21.1	22.5
3.7 ≤ E < 3.9	11.7	14.6	18.0	19.5	20.9	22.3
3.9 ≤ E < 4.1	11.6	14.5	17.9	19.3	20.8	22.2
4.1 ≤ E < 4.3	11.5	14.4	17.8	19.2	20.7	22.1
4.3 ≤ E < 4.5	11.4	14.3	17.7	19.1	20.5	21.9
4.5 ≤ E < 4.7	11.4	14.3	17.6	19.0	20.4	21.8
4.7 ≤ E < 4.9	11.4	14.2	17.5	18.9	20.3	21.7
E ≥ 4.9	11.3	14.1	17.4	18.8	20.2	21.6

**Table B2-34 Loading Table for PWR Fuel – 513 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	25.1	-
2.7 ≤ E < 2.9	24.8	26.3
2.9 ≤ E < 3.1	24.6	26.1
3.1 ≤ E < 3.3	24.4	25.8
3.3 ≤ E < 3.5	24.2	25.6
3.5 ≤ E < 3.7	24.0	25.4
3.7 ≤ E < 3.9	23.8	25.3
3.9 ≤ E < 4.1	23.7	25.0
4.1 ≤ E < 4.3	23.6	24.9
4.3 ≤ E < 4.5	23.4	24.8
4.5 ≤ E < 4.7	23.2	24.6
4.7 ≤ E < 4.9	23.1	24.5
E ≥ 4.9	23.0	24.4

**Table B2-35 Loading Table for PWR Fuel – 1300 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10 < B ≤15	15 < B ≤20	20 < B ≤25	25 < B ≤30	30 < B ≤32.5
1.3 ≤ E < 1.5	4.0	-	-	-	-	-
1.5 ≤ E < 1.7	4.0	4.0	-	-	-	-
1.7 ≤ E < 1.9	4.0	4.0	4.0	-	-	-
1.9 ≤ E < 2.1	4.0	4.0	4.0	4.0	-	-
2.1 ≤ E < 2.3	4.0	4.0	4.0	4.0	4.0	4.0
2.3 ≤ E < 2.5	4.0	4.0	4.0	4.0	4.0	4.0
2.5 ≤ E < 2.7	4.0	4.0	4.0	4.0	4.0	4.0
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	4.0	4.0
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.0	4.0
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.0	4.0
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0

**Table B2-35 Loading Table for PWR Fuel – 1300 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.0	4.0	-	-	-	-
2.5 ≤ E < 2.7	4.0	4.0	4.1	4.2	4.3	4.5
2.7 ≤ E < 2.9	4.0	4.0	4.1	4.2	4.3	4.4
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.1	4.2	4.4
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.1	4.2	4.3
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.1	4.3
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.1	4.2
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.2
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.1
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.1
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0

**Table B2-35 Loading Table for PWR Fuel – 1300 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	4.6	-
2.7 ≤ E < 2.9	4.5	4.7
2.9 ≤ E < 3.1	4.5	4.6
3.1 ≤ E < 3.3	4.4	4.5
3.3 ≤ E < 3.5	4.4	4.5
3.5 ≤ E < 3.7	4.3	4.4
3.7 ≤ E < 3.9	4.3	4.4
3.9 ≤ E < 4.1	4.2	4.3
4.1 ≤ E < 4.3	4.2	4.3
4.3 ≤ E < 4.5	4.2	4.3
4.5 ≤ E < 4.7	4.1	4.2
4.7 ≤ E < 4.9	4.1	4.2
E ≥ 4.9	4.0	4.2

**Table B2-36 Loading Table for PWR Fuel – 1800 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10 < B ≤15	15 < B ≤20	20 < B ≤25	25 < B ≤30	30 < B ≤32.5
1.3 ≤ E < 1.5	4.0	-	-	-	-	-
1.5 ≤ E < 1.7	4.0	4.0	-	-	-	-
1.7 ≤ E < 1.9	4.0	4.0	4.0	-	-	-
1.9 ≤ E < 2.1	4.0	4.0	4.0	4.0	-	-
2.1 ≤ E < 2.3	4.0	4.0	4.0	4.0	4.0	4.0
2.3 ≤ E < 2.5	4.0	4.0	4.0	4.0	4.0	4.0
2.5 ≤ E < 2.7	4.0	4.0	4.0	4.0	4.0	4.0
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	4.0	4.0
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.0	4.0
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.0	4.0
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0

**Table B2-36 Loading Table for PWR Fuel – 1800 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.0	4.0	-	-	-	-
2.5 ≤ E < 2.7	4.0	4.0	4.0	4.0	4.0	4.0
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	4.0	4.0
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.0	4.0
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.0	4.0
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0

**Table B2-36 Loading Table for PWR Fuel – 1800 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	4.0	-
2.7 ≤ E < 2.9	4.0	4.0
2.9 ≤ E < 3.1	4.0	4.0
3.1 ≤ E < 3.3	4.0	4.0
3.3 ≤ E < 3.5	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0
E ≥ 4.9	4.0	4.0

**Table B2-37 Loading Table for PWR Fuel – 830 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	B ≤10	10 < B ≤15	15 < B ≤20	20 < B ≤25	25 < B ≤30	30 < B ≤32.5
1.3 ≤ E < 1.5	4.0	-	-	-	-	-
1.5 ≤ E < 1.7	4.0	4.0	-	-	-	-
1.7 ≤ E < 1.9	4.0	4.0	4.0	-	-	-
1.9 ≤ E < 2.1	4.0	4.0	4.0	4.0	-	-
2.1 ≤ E < 2.3	4.0	4.0	4.0	4.0	4.7	5.0
2.3 ≤ E < 2.5	4.0	4.0	4.0	4.0	4.6	5.0
2.5 ≤ E < 2.7	4.0	4.0	4.0	4.0	4.6	4.9
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	4.5	4.9
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.5	4.8
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.4	4.8
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.4	4.7
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.4	4.7
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.4	4.7
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.3	4.6
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.3	4.6
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.3	4.6
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.3	4.5
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.2	4.5
E ≥ 4.9	4.0	4.0	4.0	4.0	4.2	4.5

**Table B2-37 Loading Table for PWR Fuel – 830 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	32.5 < B ≤35	35 < B ≤37.5	37.5 < B ≤40	40 < B ≤41	41 < B ≤42	42 < B ≤43
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	5.5	6.0	-	-	-	-
2.5 ≤ E < 2.7	5.4	6.0	6.7	7.0	7.4	7.8
2.7 ≤ E < 2.9	5.4	5.9	6.6	6.9	7.2	7.7
2.9 ≤ E < 3.1	5.3	5.8	6.5	6.8	7.1	7.5
3.1 ≤ E < 3.3	5.2	5.8	6.4	6.7	7.0	7.4
3.3 ≤ E < 3.5	5.2	5.7	6.3	6.6	6.9	7.3
3.5 ≤ E < 3.7	5.1	5.7	6.3	6.6	6.8	7.2
3.7 ≤ E < 3.9	5.1	5.6	6.2	6.5	6.8	7.1
3.9 ≤ E < 4.1	5.0	5.6	6.1	6.4	6.7	7.0
4.1 ≤ E < 4.3	5.0	5.5	6.0	6.4	6.7	6.9
4.3 ≤ E < 4.5	5.0	5.5	6.0	6.3	6.6	6.9
4.5 ≤ E < 4.7	4.9	5.5	6.0	6.2	6.5	6.8
4.7 ≤ E < 4.9	4.9	5.4	5.9	6.2	6.5	6.8
E ≥ 4.9	4.9	5.4	5.9	6.1	6.4	6.7

**Table B2-37 Loading Table for PWR Fuel – 830 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU	
	43 < B ≤44	44 < B ≤45
1.3 ≤ E < 1.5	-	-
1.5 ≤ E < 1.7	-	-
1.7 ≤ E < 1.9	-	-
1.9 ≤ E < 2.1	-	-
2.1 ≤ E < 2.3	-	-
2.3 ≤ E < 2.5	-	-
2.5 ≤ E < 2.7	8.2	-
2.7 ≤ E < 2.9	8.0	8.6
2.9 ≤ E < 3.1	7.9	8.4
3.1 ≤ E < 3.3	7.8	8.2
3.3 ≤ E < 3.5	7.7	8.1
3.5 ≤ E < 3.7	7.6	8.0
3.7 ≤ E < 3.9	7.5	7.9
3.9 ≤ E < 4.1	7.4	7.8
4.1 ≤ E < 4.3	7.3	7.7
4.3 ≤ E < 4.5	7.2	7.6
4.5 ≤ E < 4.7	7.1	7.5
4.7 ≤ E < 4.9	7.0	7.4
E ≥ 4.9	7.0	7.4

**Note:** For fuel assembly average burnup greater than 45 GWd/MTU, cool time tables have been revised to account for a 5% margin in heat load.

**Table B2-38 Loading Table for PWR Fuel – 487 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	30.4	31.8	33.2	34.5	-	-
2.9 ≤ E < 3.1	30.1	31.6	32.9	34.3	35.5	36.8
3.1 ≤ E < 3.3	30.0	31.4	32.7	34.1	35.4	36.7
3.3 ≤ E < 3.5	29.8	31.2	32.6	33.9	35.2	36.6
3.5 ≤ E < 3.7	29.6	31.1	32.5	33.8	35.1	36.3
3.7 ≤ E < 3.9	29.4	30.8	32.3	33.6	34.9	36.3
3.9 ≤ E < 4.1	29.3	30.7	32.1	33.5	34.7	36.1
4.1 ≤ E < 4.3	29.1	30.6	32.0	33.4	34.6	35.9
4.3 ≤ E < 4.5	29.0	30.4	31.9	33.2	34.5	35.9
4.5 ≤ E < 4.7	28.9	30.2	31.7	33.1	34.4	35.7
4.7 ≤ E < 4.9	28.8	30.2	31.5	33.0	34.3	35.6
E ≥ 4.9	28.7	30.1	31.4	32.8	34.2	35.4

**Table B2-38 Loading Table for PWR Fuel – 487 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	51 < B ≤52	52 < B ≤53	53 < B ≤54	54 < B ≤55	55 < B ≤56	56 < B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	38.1	39.3	40.5	-	-	-
3.1 ≤ E < 3.3	38.0	39.2	40.3	41.5	42.1	43.1
3.3 ≤ E < 3.5	37.8	39.1	40.2	41.4	41.9	43.1
3.5 ≤ E < 3.7	37.6	38.9	40.0	41.2	41.8	42.9
3.7 ≤ E < 3.9	37.6	38.7	39.9	41.1	41.7	42.8
3.9 ≤ E < 4.1	37.4	38.7	39.8	41.1	41.6	42.7
4.1 ≤ E < 4.3	37.3	38.6	39.7	40.9	41.4	42.6
4.3 ≤ E < 4.5	37.2	38.4	39.6	40.9	41.3	42.5
4.5 ≤ E < 4.7	37.0	38.2	39.4	40.8	41.2	42.4
4.7 ≤ E < 4.9	36.9	38.2	39.5	40.7	41.0	42.3
E ≥ 4.9	36.8	38.0	39.3	40.5	40.9	42.1

**Table B2-38 Loading Table for PWR Fuel – 487 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	44.3	45.3	-
3.3 ≤ E < 3.5	44.1	45.2	46.2
3.5 ≤ E < 3.7	44.0	45.1	46.2
3.7 ≤ E < 3.9	43.9	44.9	46.1
3.9 ≤ E < 4.1	43.8	44.9	46.0
4.1 ≤ E < 4.3	43.7	44.8	45.8
4.3 ≤ E < 4.5	43.7	44.7	45.8
4.5 ≤ E < 4.7	43.5	44.6	45.7
4.7 ≤ E < 4.9	43.4	44.5	45.7
E ≥ 4.9	43.4	44.4	45.6

**Table B2-39 Loading Table for PWR Fuel – 1235 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	5.1	5.3	5.5	5.7	-	-
2.9 ≤ E < 3.1	5.0	5.2	5.4	5.6	5.8	6.0
3.1 ≤ E < 3.3	4.9	5.1	5.3	5.5	5.7	5.9
3.3 ≤ E < 3.5	4.9	5.0	5.2	5.4	5.6	5.8
3.5 ≤ E < 3.7	4.8	5.0	5.1	5.3	5.5	5.7
3.7 ≤ E < 3.9	4.8	4.9	5.0	5.2	5.4	5.6
3.9 ≤ E < 4.1	4.7	4.9	5.0	5.2	5.4	5.6
4.1 ≤ E < 4.3	4.7	4.8	4.9	5.1	5.3	5.5
4.3 ≤ E < 4.5	4.6	4.8	4.9	5.0	5.2	5.4
4.5 ≤ E < 4.7	4.5	4.7	4.8	5.0	5.1	5.3
4.7 ≤ E < 4.9	4.5	4.7	4.8	4.9	5.1	5.3
E ≥ 4.9	4.5	4.6	4.8	4.9	5.0	5.2

**Table B2-39 Loading Table for PWR Fuel – 1235 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	51< B ≤52	52< B ≤53	53< B ≤54	54< B ≤55	55< B ≤56	56< B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	6.2	6.5	6.7	-	-	-
3.1 ≤ E < 3.3	6.1	6.3	6.6	6.8	7.0	7.3
3.3 ≤ E < 3.5	6.0	6.2	6.5	6.7	6.9	7.1
3.5 ≤ E < 3.7	5.9	6.1	6.3	6.6	6.7	7.0
3.7 ≤ E < 3.9	5.8	6.0	6.2	6.5	6.6	6.9
3.9 ≤ E < 4.1	5.7	5.9	6.1	6.4	6.5	6.8
4.1 ≤ E < 4.3	5.7	5.8	6.0	6.3	6.4	6.7
4.3 ≤ E < 4.5	5.6	5.8	5.9	6.2	6.3	6.6
4.5 ≤ E < 4.7	5.5	5.7	5.9	6.0	6.2	6.4
4.7 ≤ E < 4.9	5.5	5.6	5.8	6.0	6.1	6.4
E ≥ 4.9	5.4	5.6	5.8	5.9	6.0	6.3

**Table B2-39 Loading Table for PWR Fuel – 1235 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	7.7	8.0	-
3.3 ≤ E < 3.5	7.5	7.8	8.2
3.5 ≤ E < 3.7	7.3	7.6	8.0
3.7 ≤ E < 3.9	7.1	7.5	7.8
3.9 ≤ E < 4.1	7.0	7.3	7.7
4.1 ≤ E < 4.3	6.9	7.2	7.5
4.3 ≤ E < 4.5	6.8	7.0	7.4
4.5 ≤ E < 4.7	6.7	6.9	7.2
4.7 ≤ E < 4.9	6.6	6.9	7.1
E ≥ 4.9	6.5	6.8	7.0

**Table B2-40 Loading Table for PWR Fuel – 1710 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	45 < B ≤46	46 < B ≤47	47 < B ≤48	48 < B ≤49	49 < B ≤50	50 < B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	4.0	4.0	4.0	4.0	-	-
2.9 ≤ E < 3.1	4.0	4.0	4.0	4.0	4.0	4.1
3.1 ≤ E < 3.3	4.0	4.0	4.0	4.0	4.0	4.1
3.3 ≤ E < 3.5	4.0	4.0	4.0	4.0	4.0	4.0
3.5 ≤ E < 3.7	4.0	4.0	4.0	4.0	4.0	4.0
3.7 ≤ E < 3.9	4.0	4.0	4.0	4.0	4.0	4.0
3.9 ≤ E < 4.1	4.0	4.0	4.0	4.0	4.0	4.0
4.1 ≤ E < 4.3	4.0	4.0	4.0	4.0	4.0	4.0
4.3 ≤ E < 4.5	4.0	4.0	4.0	4.0	4.0	4.0
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.0	4.0	4.0
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.0	4.0
E ≥ 4.9	4.0	4.0	4.0	4.0	4.0	4.0

**Table B2-40 Loading Table for PWR Fuel – 1710 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	51 < B ≤52	52 < B ≤53	53 < B ≤54	54 < B ≤55	55 < B ≤56	56 < B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	4.2	4.4	4.5	-	-	-
3.1 ≤ E < 3.3	4.2	4.3	4.4	4.5	4.6	4.7
3.3 ≤ E < 3.5	4.1	4.2	4.3	4.4	4.5	4.6
3.5 ≤ E < 3.7	4.0	4.2	4.3	4.4	4.5	4.6
3.7 ≤ E < 3.9	4.0	4.1	4.2	4.3	4.4	4.5
3.9 ≤ E < 4.1	4.0	4.1	4.2	4.3	4.3	4.4
4.1 ≤ E < 4.3	4.0	4.0	4.1	4.2	4.3	4.4
4.3 ≤ E < 4.5	4.0	4.0	4.1	4.2	4.2	4.3
4.5 ≤ E < 4.7	4.0	4.0	4.0	4.1	4.2	4.3
4.7 ≤ E < 4.9	4.0	4.0	4.0	4.0	4.1	4.2
E ≥ 4.9	4.0	4.0	4.0	4.0	4.1	4.2

**Table B2-40 Loading Table for PWR Fuel – 1710 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	4.9	5.0	-
3.3 ≤ E < 3.5	4.8	4.9	5.0
3.5 ≤ E < 3.7	4.7	4.8	5.0
3.7 ≤ E < 3.9	4.6	4.8	4.9
3.9 ≤ E < 4.1	4.5	4.7	4.8
4.1 ≤ E < 4.3	4.5	4.6	4.7
4.3 ≤ E < 4.5	4.4	4.5	4.7
4.5 ≤ E < 4.7	4.4	4.5	4.6
4.7 ≤ E < 4.9	4.3	4.4	4.5
E ≥ 4.9	4.3	4.4	4.5

**Table B2-41 Loading Table for PWR Fuel – 788 W/Assembly – CE 16x16 Fuel**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	45< B ≤46	46< B ≤47	47< B ≤48	48< B ≤49	49< B ≤50	50< B ≤51
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	10.2	11.0	11.8	12.7	-	-
2.9 ≤ E < 3.1	9.9	10.7	11.5	12.3	13.3	14.2
3.1 ≤ E < 3.3	9.8	10.5	11.2	12.0	12.9	13.9
3.3 ≤ E < 3.5	9.6	10.2	11.0	11.8	12.6	13.6
3.5 ≤ E < 3.7	9.4	10.0	10.8	11.6	12.4	13.3
3.7 ≤ E < 3.9	9.2	9.8	10.6	11.3	12.0	13.0
3.9 ≤ E < 4.1	9.1	9.7	10.4	11.1	11.9	12.8
4.1 ≤ E < 4.3	9.0	9.5	10.2	11.0	11.7	12.5
4.3 ≤ E < 4.5	8.9	9.4	10.0	10.8	11.5	12.3
4.5 ≤ E < 4.7	8.8	9.3	9.9	10.6	11.4	12.1
4.7 ≤ E < 4.9	8.7	9.2	9.8	10.5	11.2	12.0
E ≥ 4.9	8.6	9.1	9.7	10.3	11.1	11.8

**Table B2-41 Loading Table for PWR Fuel – 788 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU					
	51< B ≤52	52< B ≤53	53< B ≤54	54< B ≤55	55< B ≤56	56< B ≤57
1.3 ≤ E < 1.5	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-
2.1 ≤ E < 2.3	-	-	-	-	-	-
2.3 ≤ E < 2.5	-	-	-	-	-	-
2.5 ≤ E < 2.7	-	-	-	-	-	-
2.7 ≤ E < 2.9	-	-	-	-	-	-
2.9 ≤ E < 3.1	15.2	16.3	17.4	-	-	-
3.1 ≤ E < 3.3	14.9	15.9	17.0	18.0	18.7	19.7
3.3 ≤ E < 3.5	14.6	15.6	16.6	17.7	18.2	19.3
3.5 ≤ E < 3.7	14.2	15.2	16.3	17.3	17.9	19.0
3.7 ≤ E < 3.9	13.9	14.9	15.9	17.0	17.5	18.6
3.9 ≤ E < 4.1	13.7	14.6	15.6	16.7	17.2	18.2
4.1 ≤ E < 4.3	13.4	14.3	15.4	16.4	16.9	18.0
4.3 ≤ E < 4.5	13.2	14.1	15.1	16.1	16.7	17.7
4.5 ≤ E < 4.7	13.0	13.9	14.9	15.8	16.4	17.4
4.7 ≤ E < 4.9	12.8	13.7	14.7	15.7	16.1	17.2
E ≥ 4.9	12.7	13.5	14.5	15.4	16.0	17.0

**Table B2-41 Loading Table for PWR Fuel – 788 W/Assembly – CE 16x16 Fuel  
(Continued)**

Initial Assembly Avg. Enrichment wt % <sup>235</sup> U (E)	Assembly Average Burnup (B) GWd/MTU		
	57 < B ≤58	58 < B ≤59	59 < B ≤60
1.3 ≤ E < 1.5	-	-	-
1.5 ≤ E < 1.7	-	-	-
1.7 ≤ E < 1.9	-	-	-
1.9 ≤ E < 2.1	-	-	-
2.1 ≤ E < 2.3	-	-	-
2.3 ≤ E < 2.5	-	-	-
2.5 ≤ E < 2.7	-	-	-
2.7 ≤ E < 2.9	-	-	-
2.9 ≤ E < 3.1	-	-	-
3.1 ≤ E < 3.3	20.8	21.8	-
3.3 ≤ E < 3.5	20.4	21.4	22.5
3.5 ≤ E < 3.7	20.0	21.1	22.1
3.7 ≤ E < 3.9	19.7	20.7	21.7
3.9 ≤ E < 4.1	19.3	20.3	21.4
4.1 ≤ E < 4.3	19.0	20.0	21.1
4.3 ≤ E < 4.5	18.7	19.7	20.8
4.5 ≤ E < 4.7	18.4	19.5	20.5
4.7 ≤ E < 4.9	18.2	19.2	20.2
E ≥ 4.9	17.9	19.0	20.0

**Table B2-42 Low SNF Assembly Average Burnup Enrichment Limits for CE 16x16 Fuel Loaded via the PMTC**

Max. Assembly Avg. Burnup (MWd/MTU)	Min. Assembly Avg. Initial Enrichment (wt% <sup>235</sup> U)	Minimum Cool Time (yrs)
10,000	1.3	4.0
15,000	1.5	4.0
20,000	1.7	4.0
25,000	1.9	4.1

**Table B2-43 Loading Table for CE 16x16 Fuel Loaded via the PMTC**

Initial Assembly Avg. Enrichment (wt% <sup>235</sup> U)	Assembly Average Burnup (GWd/MTU)						
	25 < B ≤ 30	30 < B ≤ 35	35 < B ≤ 40	40 < B ≤ 45	45 < B ≤ 50	50 < B ≤ 55	55 < B ≤ 60
	Minimum Cooling Time (years)						
1.3 ≤ E < 1.5	-	-	-	-	-	-	-
1.5 ≤ E < 1.7	-	-	-	-	-	-	-
1.7 ≤ E < 1.9	-	-	-	-	-	-	-
1.9 ≤ E < 2.1	-	-	-	-	-	-	-
2.1 ≤ E < 2.3	4.8	-	-	-	-	-	-
2.3 ≤ E < 2.5	4.7	5.7	-	-	-	-	-
2.5 ≤ E < 2.7	4.7	5.6	6.9	-	-	-	-
2.7 ≤ E < 2.9	4.6	5.5	6.8	8.9	-	-	-
2.9 ≤ E < 3.1	4.6	5.5	6.7	8.8	14.0	-	-
3.1 ≤ E < 3.3	4.5	5.4	6.6	8.6	13.7	19.0	-
3.3 ≤ E < 3.5	4.5	5.3	6.6	8.5	13.4	18.7	23.5
3.5 ≤ E < 3.7	4.5	5.3	6.5	8.3	13.1	18.2	23.1
3.7 ≤ E < 3.9	4.4	5.2	6.4	8.2	12.9	17.9	22.7
3.9 ≤ E < 4.1	4.4	5.2	6.3	8.1	12.6	17.7	22.4
4.1 ≤ E < 4.3	4.4	5.2	6.3	8.0	12.4	17.4	22.1
4.3 ≤ E < 4.5	4.4	5.1	6.2	7.9	12.2	17.1	21.8
4.5 ≤ E < 4.7	4.3	5.1	6.2	7.8	12.0	16.8	21.5
4.7 ≤ E < 4.9	4.3	5.0	6.1	7.8	11.9	16.6	21.3
E ≥ 4.9	4.3	5.0	6.1	7.7	11.8	16.4	21.1

- The minimum cool times for heat loads of 811 W/assy for assembly average burnups less than 45 GWd/MTU and heat loads of 770 W/Assy for burnups greater than 45 GWd/MTU