



Joshua J. Toben
Manager, Regulatory and Emergency Preparedness
Arkansas Nuclear One
Tel 479-858-3135

OCAN2026-00002

10 CFR 50.36a

April 16, 2026

ATTN: Document Control Desk
U. S. Nuclear Regulatory Commission
Washington, DC 20555-0001

Subject: Radioactive Effluent Release Report for the 2025 Calendar Year

Arkansas Nuclear One – Unit 1 and Unit 2
NRC Docket No. 50-313 and 50-368
Renewed Facility Operating License Nos. DPR-51 and NPF-6

Arkansas Nuclear One, Units 1 and 2 (ANO-1 and ANO-2) Technical Specifications (TSs) 5.6.3 and 6.6.3, respectively, require the submittal of a Radioactive Effluent Release Report annually. These same TSs allow a single submission to be made for ANO. The submittal shall combine sections common to both units. The submittal shall specify the releases of radioactive material from each unit. The information which fulfills this reporting requirement for ANO-1 and ANO-2 for the 2025 calendar year is enclosed.

ANO-1 TS 5.6.3 and ANO-2 TS 6.6.3 require this report to be submitted prior to May 1 of each year in accordance with 10 CFR 50.36a. 10 CFR 50.36a(a)(2) requires that the time between submissions must be no longer than 12 months.


The enclosure to this letter contains the Radioactive Effluent Release Report for the 2025 calendar year. Liquid and gaseous release data show that the dose from both ANO-1 and ANO-2 was considerably below the ANO Offsite Dose Calculation Manual (ODCM) limits. The data reveals that radioactive effluents had an overall minimal dose contribution to the surrounding environment.

There were no changes to the ODCM nor the Process Control Program in 2025; therefore, these documents are not included in this letter.

This letter contains no new regulatory commitments.

Should you have any questions or require additional information regarding this report, please contact Josh Toben, Manager, Regulatory and Emergency Preparedness, ANO, at (479) 858-3135.

Sincerely,

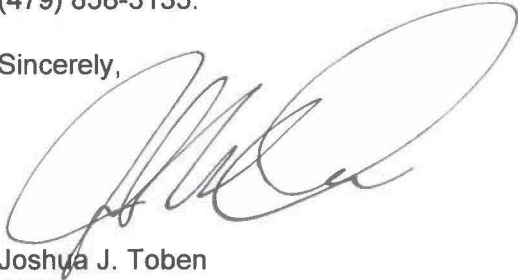A handwritten signature in black ink, appearing to read 'Joshua J. Toben', written over a large, light-colored oval shape.

Joshua J. Toben
JJT/cgm

Enclosure: 2025 Annual Radioactive Effluent Release Report

cc: NRC Region IV Regional Administrator
NRC Senior Resident Inspector – Arkansas Nuclear One
NRC Project Manager – Arkansas Nuclear One
Designated Arkansas State Official

ENCLOSURE

0CAN2026-00002

2025 Annual Radioactive Effluent Release Report

38 Pages



2025

Annual Radioactive Effluent Release Report

Document Number: 0CAN2026-00002

TABLE OF CONTENTS

- 1.0 LIST OF ACRONYMS AND DEFINITIONS 3
- 2.0 EXECUTIVE SUMMARY 5
 - 2.1 Comparison to Regulatory Limits 6
- 3.0 INTRODUCTION..... 9
 - 3.1 About Nuclear Power 9
 - 3.2 About Radiation Dose 11
 - 3.3 About Dose Calculation..... 13
- 4.0 DOSE ASSESSMENT FOR PLANT OPERATIONS..... 15
 - 4.1 Regulatory Limits..... 15
 - 4.2 Regulatory Limits for Gaseous Effluent Doses:..... 15
 - 4.3 Regulatory Limits for Liquid Effluent Doses 16
 - 4.4 40 CFR 190 Regulatory Dose Limits for a Member of the Public..... 17
 - 4.5 Onsite Doses (Within Site Boundary)..... 17
- 5.0 SUPPLEMENTAL INFORMATION 18
 - 5.1 Gaseous Batch Releases 18
 - 5.2 Gaseous Continuous Releases..... 18
 - 5.3 Liquid Batch Releases..... 19
 - 5.4 Liquid Continuous Releases..... 19
 - 5.5 Abnormal Releases 19
 - 5.6 Land Use Census Changes 20
 - 5.7 Meteorological Data 20
 - 5.8 Effluent Radiation Monitors Out of Service Greater Than 30 Days..... 20
 - 5.9 Offsite Dose Calculation Manual (ODCM) Changes 20
 - 5.10 Process Control Program (PCP) Changes..... 21
 - 5.11 Radioactive Waste Treatment System Changes..... 21
 - 5.12 Other Supplemental Information 21
- 6.0 NEI 07-07 ONSITE RADIOLOGICAL GROUNDWATER MONITORING PROGRAM..... 22
 - 6.1 Voluntary Notification 23
- 7.0 BIBLIOGRAPHY 24

TABLES

- Table 1, Arkansas Nuclear One Unit 1 Dose Summary..... 6
- Table 2, Arkansas Nuclear One Unit 2 Dose Summary..... 7
- Table 3, Total Annual Offsite-Dose Comparison to 40 CFR 190 Limits for ANO..... 8
- Table 4, Onsite Doses (Within Site Boundary) 17
- Table 5, Groundwater Protection Program Monitoring Well Sample Schedule 22
- Table 6, Groundwater Protection Program Monitoring Well Tritium Results 23
- Table 7, Gaseous Effluents Summation of All Releases Unit 1 25
- Table 8, Gaseous Effluents – Ground Level Release Batch Mode Unit 1 26
- Table 9, Gaseous Effluents Summation of All Releases Unit 2 27

Table 10, Gaseous Effluents – Ground Level Release Batch Mode Unit 228

Table 11, Liquid Effluents – Summation of All Releases Unit 1.....29

Table 12, Batch Mode Liquid Effluents Unit 1.....30

Table 13, Liquid Effluents – Summation of All Releases Unit 2.....31

Table 14, Batch Mode Liquid Effluents Unit 2.....32

Table 15, Continuous Mode Liquid Effluents Unit 2.....32

Table 16, Types of Solid Waste Summary ANO Site.....33

Table 17, Major Nuclides ANO Site33

Table 18, Solid Waste Disposition ANO Site34

Table 19, Irradiated Fuel Shipments Disposition ANO Site35

Table 20, Percentage of Each Wind Speed/Direction.....36

Table 21, Classification of Atmospheric Stability37

FIGURES

Figure 1, Pressurized Water Reactor (PWR) [1].....9

Figure 2, Boiling Water Reactor (BWR) [2]..... 10

Figure 3, Sources of Radiation Exposure (NCRP Report No. 160) [3] 11

Figure 4, Potential exposure pathways to Members of the Public due to Plant Operations [6] 13

ATTACHMENTS

Attachment 1, ARERR Release Summary Tables (RG-1.21 Tables).....25

Attachment 2, Solid Waste Information.....33

Attachment 3, Meteorological Data.....36

Company: Entergy

Plant: Arkansas Nuclear One

1.0 LIST OF ACRONYMS AND DEFINITIONS

1. Alpha Particle (α): A charged particle emitted from the nucleus of an atom having a mass and charge equal in magnitude of a helium nucleus.
2. BWR: Boiling Water Reactor
3. Composite Sample: A series of single collected portions (aliquots) analyzed as one sample. The aliquots making up the sample are collected at time intervals that are very short compared to the composite period.
4. Control: A sampling station in a location not likely to be affected by plant effluents due to its distance and/or direction from the Plant.
5. Counting Error: An estimate of the two-sigma uncertainty associated with the sample results based on total counts accumulated.
6. Curie (Ci): A measure of radioactivity; equal to 3.7×10^{10} disintegrations per second, or 2.22×10^{12} disintegrations per minute.
7. Direct Radiation Monitoring: The measurement of radiation dose at various distances from the plant is assessed using thermoluminescent dosimeters (TLDs), optically stimulated luminescent dosimeters (OSLDs), and/or pressurized ionization chambers.
8. Grab Sample: A single discrete sample drawn at one point in time.
9. Indicator: A sampling location that is potentially affected by plant effluents due to its proximity and/or direction from the plant.
10. Ingestion Pathway: The ingestion pathway includes milk, fish, drinking water and garden produce. Also sampled (under special circumstances) are other media such as vegetation or animal products when additional information about particular radionuclides is needed.
11. ISFSI: Independent Spent Fuel Storage Installation
12. LLD: Lower Limit of Detection. An *a priori* measure of the detection capability of a radiochemistry measurement based on instrument setup, calibration, background, decay time, and sample volume. An LLD is expressed as an activity concentration. The MDA is used for reporting results. LLD are specified by a regulator, such as the NRC and are typically listed in the ODCM.
13. MDA: Minimum Detectable Activity. For radiochemistry instruments, the MDA is the *a posteriori* minimum concentration that a counting system detects. The smallest concentration or activity of radioactive material in a sample that will yield a net count above instrument background and that is detected with 95% probability, with only 5% probability of falsely concluding that a blank observation represents a true signal.

Company: Entergy**Plant: Arkansas Nuclear One**

14. MDC: Minimum Detectable Concentration. Essentially synonymous with MDA for the purposes of radiological monitoring.
15. Mean: The sum of all of the values in a distribution divided by the number of values in the distribution, synonymous with average.
16. Microcurie (μCi): 3.7×10^4 disintegrations per second, or 2.22×10^6 disintegrations per minute.
17. millirem (mrem): 1/1000 rem; a unit of radiation dose equivalent in tissue.
18. Milliroentgen (mR): 1/1000 Roentgen; a unit of exposure to X- or gamma radiation.
19. N/A: Not Applicable
20. NEI: Nuclear Energy Institute
21. NRC: Nuclear Regulatory Commission
22. ODCM: Offsite Dose Calculation Manual
23. OSLD: Optically Stimulated Luminescence Dosimeter
24. Protected Area: A 10 CFR 73 security term is an area encompassed by physical barriers and to which access is controlled for security purposes. The fenced area immediately surrounding the plant and around ISFSI are commonly classified by the licensee as "Protected areas." Access to the protected area requires a security badge or escort.
25. PWR: Pressurized Water Reactor
26. REC: Radiological Effluent Control
27. REMP: Radiological Environmental Monitoring Program
28. Restricted Area: A 10 CFR 20 defined term where access to which is limited by the licensee for the purpose of protecting individuals against undue risks from exposure to radiation and radioactive materials.
29. TEDE: Total Effective Dose Equivalent (TEDE) means the sum of the effective dose equivalent (for external exposures) and the committed effective dose equivalent (for internal exposures).
30. TLD: Thermoluminescent Dosimeter
31. TRM: Technical Requirements Manual
32. TS: Technical Specification

33. Unrestricted Area: An area, access to which is neither limited nor controlled by the licensee.

2.0 EXECUTIVE SUMMARY

Arkansas Nuclear One (ANO) Radiological Effluent Control (REC) Program was established to limit the quantities of radioactive material that may be released based on calculated radiation doses or dose rates. Dose to Members of the Public due to radioactive materials released from the plant is limited by Technical Specifications, 10 CFR 20, and by 40 CFR 190. Operational doses to the public during 2025 were calculated to be within the limits required by regulation and compared to other sources of radiation dose and pose no health hazard. These doses are summarized and compared to the regulatory limits in Section 2.1 Comparison to Regulatory Limits below.

The Annual Radioactive Effluent Release Report (ARERR) is published per REC requirements and provides data related to plant operation, including: quantities of radioactive materials released in liquid and gaseous effluents; radiation doses to members of the public; solid radioactive waste shipped offsite for processing or direct disposal; and other information as required by site licensing documents.

In 2025, the gaseous effluent dose assessments for locations from the Land Use Census showed that the critical receptor for Arkansas Nuclear One is a child, due to pathways of inhalation, at site boundary (0.65 miles). The maximum Annual Organ Dose calculated for this receptor was $3.50E-02^1$ mrem due to routine gaseous releases, to the lungs. Overall the largest contributor was to organ bone from Carbon-14 contributions yielding a bone dose of $2.33E+00^2$ mrem.

The maximum dose calculated to any organ due to radioactive liquid effluents was $1.80E-02^3$ mrem, for adult liver due to consuming fish.

Solid radioactive waste shipped offsite for processing or direct disposal included 1.42 Curies and 406 cubic meters, shipped in 16 shipments.

In addition to monitoring radioactive effluents, ANO has a Radiological Environmental Monitoring Program (REMP) that monitors for levels of radiation and radioactive materials in the local environment. Data from the REMP is published in the Annual Radiological Environmental Operating Report (AREOR).

¹ mrem value is a summation of Unit 1 and Unit 2 max organ (ITP) dose to the lungs via gaseous pathway.

² mrem value is a summation of Unit 1 and Unit 2 bone dose via the gaseous pathway.

³ mrem value is a summation of Unit 1 and Unit 2 max organ dose to the liver via liquid pathway.

2.1 Comparison to Regulatory Limits

During 2025 all solid, liquid, and gaseous radioactive effluents from Arkansas Nuclear One were well below regulatory limits, as summarized in Table 1, Table 2, and Table 3.

Table 1, Arkansas Nuclear One Unit 1 Dose Summary⁴

		Quarter 1	Quarter 2	Quarter 3	Quarter 4	Annual
Liquid Effluent Dose Limit, Total Body	Limit	1.5 mrem	1.5 mrem	1.5 mrem	1.5 mrem	3 mrem
	Total Body Dose	9.30E-04	4.86E-04	3.54E-03	8.09E-03	1.30E-02
	% of Limit	6.20E-02	3.24E-02	2.36E-01	5.39E-01	4.35E-01
Liquid Effluent Dose Limit, Any Organ	Limit	5 mrem	5 mrem	5 mrem	5 mrem	10 mrem
	Max Organ Dose	1.28E-03	6.08E-04	4.66E-03	1.09E-02	1.74E-02
	% of Limit	2.56E-02	1.22E-02	9.33E-02	2.17E-01	1.74E-01
Gaseous Effluent Dose Limit, Gamma Air (Noble Gas)	Limit	5 mrad	5 mrad	5 mrad	5 mrad	10 mrad
	Gamma Air Dose	0.00E+00	1.05E-06	3.72E-03	2.07E-03	5.79E-03
	% of Limit	0.00E+00	2.10E-05	7.45E-02	4.14E-02	5.79E-02
Gaseous Effluent Dose Limit, Beta Air (Noble Gas)	Limit	10 mrad	10 mrad	10 mrad	10 mrad	20 mrad
	Beta Air Dose	0.00E+00	1.19E-04	1.11E-02	6.61E-03	1.78E-02
	% of Limit	0.00E+00	1.19E-03	1.11E-01	6.61E-02	8.90E-02
Gaseous Effluent Organ Dose Limit (Iodine, Tritium, Particulates with > 8-day half-life)	Limit	7.5 mrem	7.5 mrem	7.5 mrem	7.5 mrem	15 mrem
	Max Organ Dose	3.71E-03	3.09E-03	2.94E-03	5.49E-03	1.52E-02
	% of Limit	4.95E-02	4.12E-02	3.92E-02	7.33E-02	1.02E-01

⁴ Table 1 demonstrates compliance with 10 CFR Part 50, App. I Limits.

Table 2, Arkansas Nuclear One Unit 2 Dose Summary⁵

		Quarter 1	Quarter 2	Quarter 3	Quarter 4	Annual
Liquid Effluent Dose Limit, Total Body	Limit	1.5 mrem	1.5 mrem	1.5 mrem	1.5 mrem	3 mrem
	Total Body Dose	7.30E-05	1.24E-04	1.04E-04	2.59E-04	5.60E-04
	% of Limit	4.87E-03	8.26E-03	6.94E-03	1.73E-02	1.87E-02
Liquid Effluent Dose Limit, Any Organ	Limit	5 mrem	5 mrem	5 mrem	5 mrem	10 mrem
	Max Organ Dose	7.28E-05	1.24E-04	1.06E-04	2.75E-04	5.77E-04
	% of Limit	1.46E-03	2.48E-03	2.12E-03	5.49E-03	5.77E-03
Gaseous Effluent Dose Limit, Gamma Air (Noble Gas)	Limit	5 mrad	5 mrad	5 mrad	5 mrad	10 mrad
	Gamma Air Dose	0.00E+00	1.05E-08	4.13E-04	1.05E-04	5.18E-04
	% of Limit	0.00E+00	2.09E-07	8.26E-03	2.10E-03	5.18E-03
Gaseous Effluent Dose Limit, Beta Air (Noble Gas)	Limit	10 mrad	10 mrad	10 mrad	10 mrad	20 mrad
	Beta Air Dose	0.00E+00	3.11E-08	1.23E-03	3.12E-04	1.54E-03
	% of Limit	0.00E+00	3.11E-07	1.23E-02	3.12E-03	7.70E-03
Gaseous Effluent Organ Dose Limit (Iodine, Tritium, Particulates with > 8-day half-life)	Limit	7.5 mrem	7.5 mrem	7.5 mrem	7.5 mrem	15 mrem
	Max Organ Dose	2.66E-03	4.62E-03	6.42E-03	6.08E-03	1.98E-02
	% of Limit	3.54E-02	6.16E-02	8.56E-02	8.10E-02	1.32E-01

⁵ Table 2 demonstrates compliance with 10 CFR Part 50, App. I Limits.

Table 3, Total Annual Offsite-Dose Comparison to 40 CFR 190 Limits for ANO⁶

	Whole Body	Thyroid	Max Other Organ
Gaseous - Unit 1 ⁷	1.52E-02	1.52E-02	1.52E-02
Gaseous - Unit 2 ⁶	1.97E-02	1.97E-02	1.98E-02
Carbon-14 - Unit 1	1.83E-01	1.83E-01	9.24E-01
Carbon-14 - Unit 2	2.79E-01	2.79E-01	1.41E+00
Liquid - Unit 1	1.30E-02	8.57E-04	1.74E-02
Liquid - Unit 2	5.60E-04	5.20E-04	5.77E-04
Direct Shine ⁸	ND	ND	ND
Total Site Dose	5.10E-01	4.98E-01	2.39E+00
Limit	25 mrem	75 mrem	25 mrem
% of Limit	2.04	0.66	9.55

⁶ Table 3 is a summation of Units to show compliance with 40 CFR Part 190 Limits.

⁷ Gaseous dose values in Table 3 include organ dose from Noble Gas, Iodine, Tritium, and particulates.

⁸ Doses were less than 1 mrem/yr after adjusting for occupancy and distance and are reported as "ND" IAW ANSI/HPS N13.37-2014.

3.0 INTRODUCTION

3.1 About Nuclear Power

Commercial nuclear power plants are generally classified as either Boiling Water Reactors (BWRs) or Pressurized Water Reactors (PWRs), based on their design. A BWR includes a single coolant system where water used as reactor coolant boils as it passes through the core and the steam generated is used to turn the turbine generator for power production. A PWR, in contrast, includes two separate water systems: radioactive reactor coolant and a secondary system. Reactor coolant is maintained under high pressure, preventing boiling. The high-pressure coolant is passed through a heat exchanger called a steam generator where the secondary system water is boiled, and the steam is used to turn the turbine generator for power production.

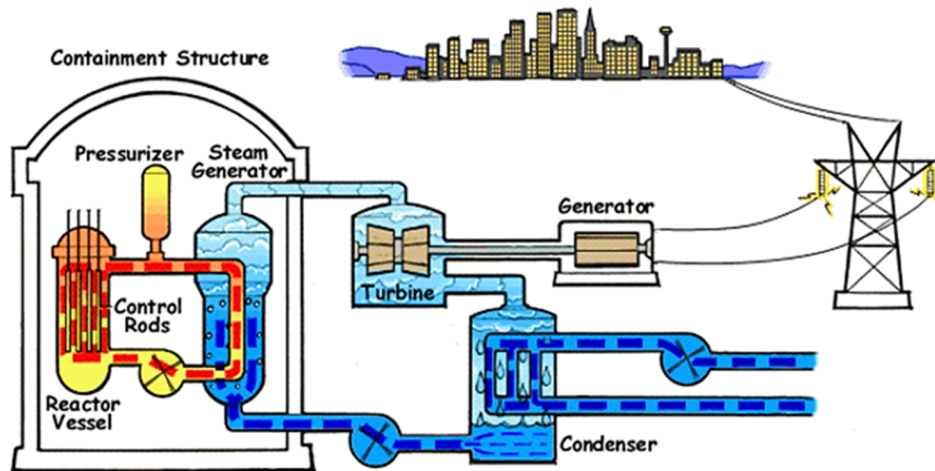


Figure 1, Pressurized Water Reactor (PWR) [1]

3.1 (Continued)

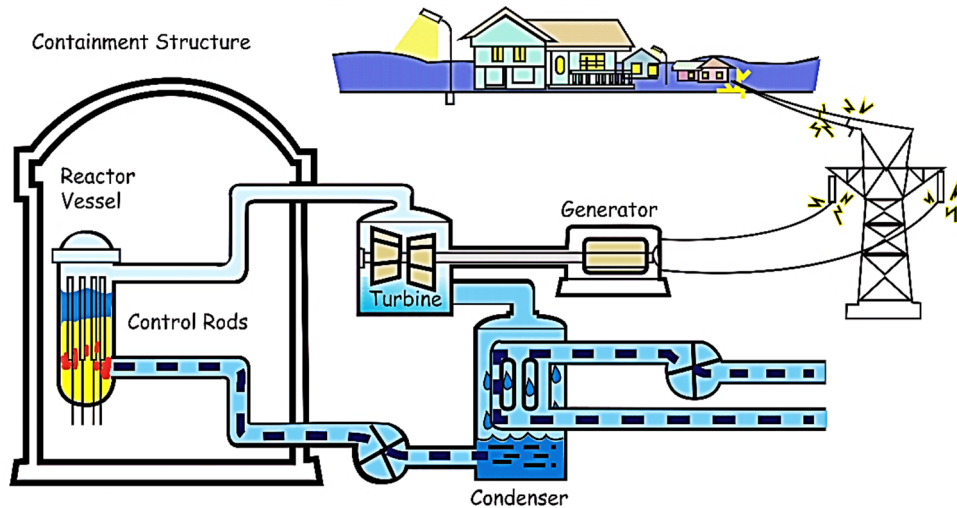


Figure 2, Boiling Water Reactor (BWR) [2]

Electricity is generated by a nuclear power plant similarly to the way that electricity is generated at other conventional types of power plants, such as those powered by coal or natural gas. Water is boiled to generate steam; the steam turns a turbine that is attached to a generator and the steam is condensed back into water to be returned to the boiler. What makes nuclear power different from these other types of power plants is that the heat is generated by fission and decay reactions occurring within and around the core containing fissionable uranium (U-235).

Nuclear fission occurs when certain nuclides (primarily U-233, U-235, or Pu-239) absorb a neutron and break into several smaller nuclides (called fission products) as well as producing some additional neutrons.

Fission results in production of radioactive materials including gases and solids that must be contained to prevent release or treated prior to release. These effluents are generally treated by filtration and/or hold-up prior to release. Releases are generally monitored by sampling and by continuously indicating radiation monitors. The effluent release data is used to calculate doses in order to ensure that dose to the public due to plant operation remains within required limits.

Company: Entergy

Plant: Arkansas Nuclear One

3.2 About Radiation Dose

Ionizing radiation, including alpha, beta, and gamma radiation from radioactive decay, has enough energy to break chemical bonds in tissues and result in damage to tissue or genetic material. The amount of ionization that will be generated by a given exposure to ionizing radiation is quantified as dose. Radiation dose is generally reported in units of millirem (mrem) in the US.

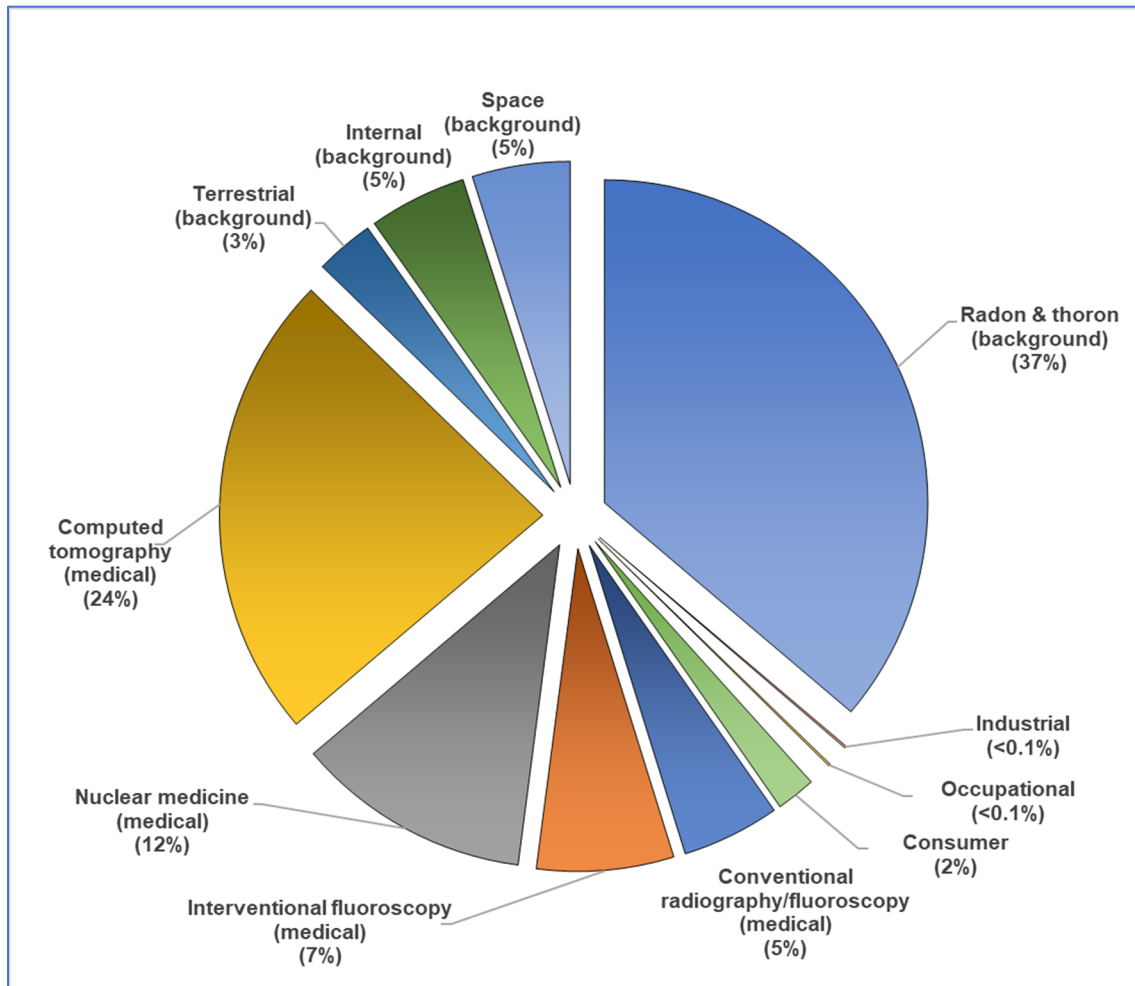


Figure 3, Sources of Radiation Exposure (NCRP Report No. 160) [3]

Annual Radioactive Effluent Release Report	YEAR: 2025	Page 12 of 37
Company: Entergy	Plant: Arkansas Nuclear One	

3.2 (Continued)

The National Council on Radiation Protection (NCRP) has evaluated the population dose for the US and determined that the average individual is exposed to approximately 620 mrem per year [3]. There are many sources for radiation dose, ranging from natural background sources to medical procedures, air travel, and industrial processes. Approximately half (310 mrem) of the average exposure is due to natural sources of radiation including exposure to radon, cosmic radiation, and internal radiation and terrestrial due to naturally occurring radionuclides. The remaining 310 mrem of exposure is due to man-made sources of exposure, with the most significant contributors being medical (48% of total mrem per year) due to radiation used in various types of medical scans and treatments. Of the remaining 2% of dose, most is due to consumer activities such as air travel, smoking cigarettes, and building materials. A small fraction of this 2% is due to industrial activities including generation of nuclear power.

Readers that are curious about common sources and effects of radiation dose that they may encounter can find excellent sources of information from the Health Physics Society, including the Radiation Fact Sheets [4], and from the US Nuclear Regulatory Commission website [5].

3.3 About Dose Calculation

Concentrations of radioactive material in the environment resulting from plant operations are very small and it is not possible to determine doses directly using measured activities of environmental samples. To overcome this, dose calculations based on measured activities of effluent streams are used to model the dose impact for Members of the Public due to plant operation and effluents. There are several mechanisms that can result in dose to Members of the Public, including: Ingestion of radionuclides in food or water; Inhalation of radionuclides in air; Immersion in a plume of noble gases; and Direct Radiation from the ground, the plant or from an elevated plume.

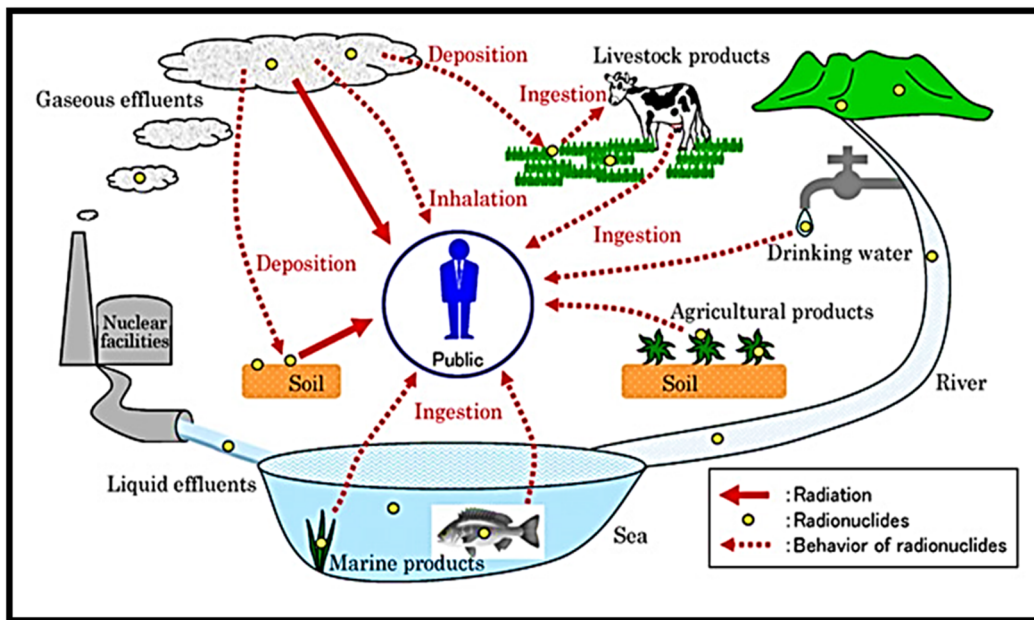


Figure 4, Potential exposure pathways to Members of the Public due to Plant Operations [6]

Each plant has an Offsite Dose Calculation Manual (ODCM) that specifies the methodology used to obtain the doses in the Dose Assessment section of this report. The dose assessment methodology in the ODCM is based on NRC Regulatory Guide 1.109 [7] and NUREG-0133 [8]. Doses are calculated by determining what the nuclide concentration will be in air, water, on the ground, or in food products based on plant effluent releases. Release points are continuously monitored to quantify what concentrations of nuclides are being released. For gaseous releases meteorological data is used to determine how much of the released activity will be present at a given location outside of the plant either deposited onto the ground or in gaseous form. Intake patterns and nuclide bio-concentration factors are used to determine how much activity will be transferred into animal milk or meat. Finally, human ingestion factors and dose factors are used to determine how much activity will be consumed and how much dose the consumer will receive. Inhalation dose is calculated by determining the concentration of nuclides and how much air is breathed by the individual.

Annual Radioactive Effluent Release Report	YEAR: 2025	Page 14 of 37
Company: Entergy	Plant: Arkansas Nuclear One	

3.3 (Continued)

For liquid releases, dilution and mixing factors are used to model the environmental concentrations in water. Drinking water pathways are modeled by determining the concentration of nuclides in the water at the point where the drinking water is sourced (e.g., taken from wells, rivers, or lakes). Fish and invertebrate pathways are determined by using concentration at the release point, bioaccumulation factors for the fish or invertebrate and an estimate of the quantity of fish consumed.

Each year a Land Use Census is performed to determine what potential dose pathways currently exist within a five-mile radius around the plant, the area most affected by plant operations. The Annual Land Use Census identifies the locations of vegetable gardens, nearest residences, milk animals and meat animals. The data from the census is used to determine who is the likely to be most exposed to radiation dose as a result of plant operation.

There is significant uncertainty in dose calculation results, due to modeling dispersion of material released and bioaccumulation factors, as well as assumptions associated with consumption and land-use patterns. Even with these sources of uncertainty, the calculations do provide a reasonable estimate of the order of magnitude of the exposure. Conservative assumptions are made in the calculation inputs such as the number of various foods and water consumed, the amount of air inhaled, and the amount of direct radiation exposure from the ground or plume, such that the actual dose received are likely lower than the calculated dose. Even with the built-in conservatism, doses calculated for the maximum exposed individual due to plant operation are a very small fraction of the annual dose that is received due to other sources. The calculated doses due to plant effluents, along with REMP results, serve to provide assurance that radioactive effluents releases are not exceeding safety standards for the environment or people living near the plant.

Company: Entergy**Plant: Arkansas Nuclear One**

4.0 DOSE ASSESSMENT FOR PLANT OPERATIONS

4.1 Regulatory Limits

Regulatory limits are detailed in station licensing documents such as the plant Technical Specifications and the Offsite Dose Calculation Manual (ODCM). These documents contain the limits to which ANO must adhere. ANO drives to maintain the philosophy to keep dose “as low as is reasonably achievable” (ALARA) and actions are taken to reduce the amount of radiation released to the environment. Liquid and gaseous release data show that the dose from ANO is well below the ODCM limits. The instantaneous concentration of liquid radioactive material released shall be limited to ten times the concentration specified in 10 CFR 20, Appendix B, Table 2, Column 2, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the total concentration released shall be limited to 2.0×10^{-4} microcuries/ml.

The annual whole body, skin and organ dose was computed using the 2025 source term using the dose calculation methodology provided in the ODCM. The calculated doses due to gaseous effluents are used to demonstrate compliance with offsite dose limits are presented in Table 1, Arkansas Nuclear One Unit 1 Dose Summary, Table 2, Arkansas Nuclear One Unit 2 Dose Summary, and Table 3, Total Annual Offsite-Dose Comparison to 40 CFR 190 Limits for ANO.

4.2 Regulatory Limits for Gaseous Effluent Doses:

1. Fission and activation gases:
 - a. Noble gases dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the site boundary shall be limited to the following:
 - 1) Less than or equal to 500 mrem/year to the total body
 - 2) Less than or equal to 3000 mrem/year to the skin
 - b. Noble gas air dose due to noble gases released in gaseous effluents, from each reactor unit to areas at and beyond the site boundary shall be limited to the following:
 - 1) Quarterly
 - a) Less than or equal to 5 mrad gamma
 - b) Less than or equal to 10 mrad beta
 - 2) Yearly
 - a) Less than or equal to 10 mrad gamma
 - b) Less than or equal to 20 mrad beta

Company: Entergy**Plant: Arkansas Nuclear One**

4.2 (Continued)

2. Iodine, tritium, and all radionuclides in particulate form with half-lives greater than 8 days.
 - a. The dose rate for iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released from the site to areas at and beyond the site boundary shall be limited to the following:
 - 1) Less than or equal to 1500 mrem/yr to any organ
 - b. The dose to a MEMBER OF THE PUBLIC from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 DAYS in gaseous effluents released, from each reactor unit to areas at and beyond the site boundary shall be limited to the following:
 - 1) Quarterly
 - a) Less than or equal to 7.5 mrem to any organ
 - 2) Yearly
 - a) Less than or equal to 15 mrem to any organ

4.3 Regulatory Limits for Liquid Effluent Doses

1. The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each reactor unit to unrestricted areas shall be limited to the following:
 - a. Quarterly
 - 1) Less than or equal to 1.5 mrem total body
 - 2) Less than or equal to 5 mrem critical organ
 - b. Yearly
 - 1) Less than or equal to 3 mrem total body
 - 2) Less than or equal to 10 mrem critical organ

4.4 40 CFR 190 Regulatory Dose Limits for a Member of the Public

1. Total Dose (40 CFR 190)
 - a. The annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC in the unrestricted area due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to the following:
 - 1) Less than or equal to 25 mrem, Total Body or any Organ except Thyroid.
 - 2) Less than or equal to 75 mrem, Thyroid.

4.5 Onsite Doses (Within Site Boundary)

ANO classifies individuals within the site boundary as either occupationally exposed individuals or members of the public. This section evaluates dose to non-occupationally exposed workers and members of the public that may be onsite for various reasons. The report must include any other information as may be required by the Commission to estimate maximum potential annual radiation doses to the public resulting from effluent releases as required by 10 CFR 50.36a(a)(2). While within controlled or restricted areas, the limits from Sections 4.1 through 4.4 do not apply; however, 10 CFR 20.1301 dose limit of 100 mrem per year TEDE and dose rate limit of 2 mrem per hour from external sources continue to apply. Occupancy times within the controlled areas are generally sufficiently low to compensate for increase in the atmospheric dispersion factor above the site boundary. Groups of concern include adult ingestion of fish, ground plane and inhalation dose at the discharge canal during recreational fishing activities. Use of a conservative assumption of 67 hours/year spent inside the site boundary by these groups conservatively represents the most-exposed individual. Additionally, dose to operators of hay baling equipment during the growing season for ground plane and inhalation. Use of a conservative assumption of 320 hours/year spent inside the site boundary represents the most exposed individuals. (Reference: ANO ODCM Section 3.6)

Table 4, Onsite Doses (Within Site Boundary)

Location	Sector	Occupancy (hrs.)	Approx. Distance (Meters)	X/Q s/m ³	Total Body Dose (mrem)			Total (mrem)
					Noble Gas	Iodine, Particulate, C-14 & H-3	Liquid	
Discharge Canal	South	67	100	1.6E-4	2.25E-04	3.04E-02	1.36E-02	4.42E-02
Hay Activities	East	320	805	1.2E-5	8.07E-05	1.09E-02	N/A	1.10E-02

Company: Entergy**Plant: Arkansas Nuclear One****5.0 SUPPLEMENTAL INFORMATION****5.1 Gaseous Batch Releases**5.1.1 ANO Unit 1

Number of batch releases	119	
Total time period for a batch release	9.98E+05	minutes
Maximum time period for a batch release	1.08E+04	minutes
Average time period for a batch release	8.39E+03	minutes
Minimum time period for a batch release	6.30E+01	minutes

5.1.2 ANO Unit 2

Number of batch releases	121	
Total time period for a batch release	1.04E+06	minutes
Maximum time period for a batch release	1.06E+04	minutes
Average time period for a batch release	8.59E+03	minutes
Minimum time period for a batch release	6.50E+01	minutes

5.2 Gaseous Continuous Releases5.2.1 ANO Unit 1:

There were zero continuous releases.

5.2.2 ANO Unit 2:

There were zero continuous releases.

5.3 Liquid Batch Releases

5.3.1 ANO Unit 1

Number of batch releases	79	
Total time period for a batch release	2.24E+04	minutes
Maximum time period for a batch release	7.47E+02	minutes
Average time period for a batch release	2.83E+02	minutes
Minimum time period for a batch release	8.40E+01	minutes

5.3.2 ANO Unit 2

Number of batch releases	9	
Total time period for a batch release	3.83E+03	minutes
Maximum time period for a batch release	5.17E+02	minutes
Average time period for a batch release	4.25E+02	minutes
Minimum time period for a batch release	2.42E+02	minutes

5.4 Liquid Continuous Releases

5.4.1 ANO Unit 1:

There were zero continuous releases.

5.4.2 ANO Unit 2:

Number of continuous releases	5	
Total time period for a continuous release	3.30E+04	minutes
Maximum time period for a continuous release	1.02E+04	minutes
Average time period for a continuous tch release	6.60E+03	minutes
Minimum time period for a continuous release	1.50E+03	minutes

5.5 Abnormal Releases

5.5.1 Gaseous Abnormal Releases ANO Unit 1

There were zero abnormal releases for ANO Unit 1.

5.5.2 Gaseous Abnormal Releases ANO Unit 2

There were zero abnormal releases for ANO Unit 2.

5.5.3 Liquid Abnormal Releases ANO Unit 1

There were zero abnormal releases for ANO Unit 1.

5.5.4 Liquid Abnormal Releases ANO Unit 2

There were zero abnormal releases for ANO Unit 2.

5.6 Land Use Census Changes

There was one change to receptor locations or routes of exposure as a result of the 2025 land use census. ANO utilized onsite land for harvesting hay to supply food to cattle. This required updates to ODCM Rev 033 to include the meat pathway for dose considerations. Additional dose received inside the site boundary has also been updated to reflect this change. Updated REMP sampling locations to include sampling of hay and meat products.

Change Description	Change Date	Changes to Receptor	Receptor Location	Sample Media Changes/Availability	Routes of Exposure
Hay Bailing Activities	3/11/26	Adult	East	Hay / Meat	Ingestion

5.7 Meteorological Data

ANO did not meet the required 90% data accumulation requirement and JFDs are held onsite and are available for review upon request.

A summary of JFD is included within Attachment 3, Meteorological Data.

Hours of Missing Data	Date(s) of Missing Data	Description of Missing Data Event
2901	4/4/2026 – 7/31/2026	MET Tower Blown Resistor (CR-ANO-C-2025-00748 & CR-ANO-C-2026-00136)

5.8 Effluent Radiation Monitors Out of Service Greater Than 30 Days

There were zero effluent radiation monitors out of service greater than 30 days.

5.9 Offsite Dose Calculation Manual (ODCM) Changes

There were zero ODCM changes in 2025.

5.10 Process Control Program (PCP) Changes

There were zero revisions to EN-RW-105, "Process Control Program" in 2025.

5.11 Radioactive Waste Treatment System Changes

There were zero changes to the radioactive waste treatment systems for either liquid or gases in 2025.

5.12 Other Supplemental Information

5.12.1 Outside Tanks

There were zero outside tanks utilized in 2025 for radioactive effluents.

5.12.2 Carbon-14

Carbon-14 (C-14) is a naturally occurring radionuclide with a 5,730-year half-life. Nuclear weapons testing in the 1950s and 1960s significantly increased the amount of C-14 in the atmosphere. Nuclear power plants also produce C-14, but the amount is infinitesimal compared to what has been distributed in the environment due to weapons testing and what is produced by natural cosmic ray interactions.

In accordance with Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactive Material in Liquid and Gaseous Effluents and Solid Waste," the NRC recommended re-evaluating "principal radionuclides" and reporting C-14 as appropriate. Carbon-14 production and release estimates were calculated using active core coolant mass, average neutron flux by energy and reactor coolant nitrogen concentrations to determine Carbon-14 generation based upon an effective full power year.

The estimated generation for Arkansas Nuclear One Unit 1 during 2025 was 7.49 Curies.

The estimated generation for Arkansas Nuclear One Unit 2 during 2025 was 11.45 Curies.

Public dose estimates were performed using methodology from the ODCM which is based on Regulatory Guide 1.109 methodology. C-14 dose is included in dose calculation results in Table 3, Total Annual Offsite-Dose Comparison to 40 CFR 190 Limits for ANO.

5.12.3 Errata/Corrections to Previous ARERRs

There are no errata to be submitted with the 2025 ARERR.

6.0 NEI 07-07 ONSITE RADIOLOGICAL GROUNDWATER MONITORING PROGRAM

Arkansas Nuclear One has developed a Groundwater Protection Initiative (GPI) program in accordance with NEI 07-07, Industry Ground Water Protection Initiative – Final Guidance Document [9]. The purpose of the GPI is to ensure timely detection and an effective response to situations involving inadvertent radiological releases to groundwater in order to prevent migration of licensed radioactive material off-site and to quantify impacts on decommissioning. During 2025, ANO collected and analyzed groundwater samples in accordance with the requirements of ANO’s GPI Program.

This section is included in this report to communicate results of NEI 07-07 Radiological Groundwater Monitoring Program. Monitoring wells installed as part of GPI program are sampled and analyzed as summarized in Table 5, Groundwater Protection Program Monitoring Well Sample Schedule. In addition to reporting results from NEI 07-07 monitoring wells, voluntary communications to offsite governmental agencies for onsite leaks or spills per NEI 07-07 Objective 2.2 are also reported as part of this report. It is important to note, samples and results taken in support of NEI 07-07 groundwater monitoring program are not part of the Radiological Environmental Monitoring Program (REMP) but should be reported as part of ARERR.

Table 5, Groundwater Protection Program Monitoring Well Sample Schedule

Well Name	Tritium	Gamma	HTD ⁹
MW-02	Annual	Annual	Upon request
MW-03	Annual	Annual	Upon request
MW-04	Annual	Annual	Upon request
MW-05	Annual	Annual	Upon request
MW-06	Annual	Annual	Upon request
MW-07	Annual	Annual	Upon request
MW-08	Annual	Annual	Upon request
MW-09	Annual	Annual	Upon request
MW-10	Quarterly	Quarterly	Upon request
MW-12	Quarterly	Quarterly	Upon request
MW-14	Quarterly	Quarterly	Upon request
MW-15	Annual	Annual	Upon request
MW-17	Quarterly	Quarterly	Upon request
MW-19	Quarterly	Quarterly	Upon request
MW-20	Quarterly	Quarterly	Upon request
MW-102	Annual	Annual	Upon request
MW-104	Annual	Annual	Upon request

⁹ Hard-to-detects are only performed when positive detections for tritium and gamma are present.

Radiological Groundwater Monitoring Program tritium results are summarized in Table 6, Groundwater Protection Program Monitoring Well Tritium Results. There were zero positive detections for hard-to-detect nuclides and gammas.

Table 6, Groundwater Protection Program Monitoring Well Tritium Results

Well Name	Number of Positive Detections	Number of Analyses	Average Concentration ¹⁰ (pCi/L)	Maximum Concentration (pCi/L)
MW-02	0	1	-	< 332
MW-03	0	1	-	< 293
MW-04	0	1	-	< 332
MW-05	0	1	-	< 332
MW-06	0	1	-	< 323
MW-07	0	1	-	< 324
MW-08	0	1	-	< 329
MW-09	0	1	-	< 323
MW-10	0	4	-	< 391
MW-12	0	4	-	< 383
MW-14	0	4	-	< 392
MW-15	0	1	-	< 326
MW-17	4	4	1406	2460
MW-19	0	4	-	< 388
MW-20 ¹¹	5	5	5916	8470
MW-102	0	1	-	< 322
MW-104	0	1	-	< 320

6.1 Voluntary Notification

During 2025, Arkansas Nuclear One did not make any voluntary NEI 07-07 notification to State/Local officials, NRC, and NEI due to any spill or leak events .

¹⁰ Results <MDA should not be included in the average concentration calculation.

¹¹ MW-20 was installed in 2024 to monitor BWST spill (Reference CR-ANO- 1-2024-01020).

Annual Radioactive Effluent Release Report	YEAR: 2025	Page 24 of 37
Company: Entergy	Plant: Arkansas Nuclear One	

7.0 BIBLIOGRAPHY

- [1] Nuclear Regulatory Commission, 30 June 2015. [Online]. Available: <http://www.nrc.gov/reading-rm/basic-ref/students/animated-pwr.html>. [Accessed October 2020].
- [2] Nuclear Regulatory Commission, 25 June 2015. [Online]. Available: <http://www.nrc.gov/reading-rm/basic-ref/students/animated-bwr.html>. [Accessed October 2020].
- [3] "NCRP Report No. 160 - Ionizing Radiation Exposure of the Population of the United States," National Council on Radiation Protection and Measurements, Bethesda, MD, 2009.
- [4] Health Physics Society, [Online]. Available: <http://hps.org/hpspublications/radiationfactsheets.html>. [Accessed 2020].
- [5] "NRC Resource Page," [Online]. Available: <http://www.nrc.gov/about-nrc/radiation.html>. [Accessed 10 November 2020].
- [6] "Japan Atomic Energy Agency," 06 November 2020. [Online]. Available: https://www.jaea.go.jp/english/04/ntokai/houkan/houkan_02.html.
- [7] "Regulatory Guide 1.109 - Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Demonstrating Compliance with 10 CFR Part 50, Appendix I," Nuclear Regulatory Commission, October, 1977.
- [8] "NUREG-0133 - Preparation of Effluent Technical Specifications for Nuclear Power Plants," Nuclear Regulatory Commission, 1987.
- [9] "NEI 07-07 - Industry Ground Water Protection Initiative — Final Guidance Document, Rev. 1," Nuclear Energy Institute, Washington, D.C., 2019.
- [10] "10 CFR 50 - Domestic Licensing of Production and Utilization Facilities," US Nuclear Regulatory Commission, Washington, DC.
- [11] "40 CFR 190 - Environmental Radiation Protection Standards for Nuclear Power Operation," US Environmental Protection Agency, Washington, DC.
- [12] "10 CFR 20 - Standards for Protection Against Radiation," US Nuclear Regulatory Commission, Washington, DC.
- [13] "40 CFR 141 - National Primary Drinking Water Regulations," US Environmental Protection Agency, Washington, DC..
- [14] "NUREG-0324 - XOQDOQ, Program for the Meteorological Evaluation of Routine Effluent Releases at Nuclear Power Stations," Nuclear Regulatory Commission, September, 1977.
- [15] "NUREG-1301 - Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Pressurized Water Reactors," Nuclear Regulatory Commission, April 1991.
- [16] "NUREG-1302 - Offsite Dose Calculation Manual Guidance: Standard Radiological Effluent Controls for Boiling Water Reactors," Nuclear Regulatory Commission, April 1991.
- [17] "Regulatory Guide 4.13 - Performance, Testing, and Procedural Specifications for Thermoluminescence Dosimetry: Environmental Applications, Revision 2," Nuclear Regulatory Commission, June, 2019.
- [18] "Regulatory Guide 4.15 - Quality Assurance for Radiological Monitoring Programs (Inception through Normal Operations to License Termination) -- Effluent Streams and the Environment," Nuclear Regulatory Commission, July, 2007.

Attachment 1, ARERR Release Summary Tables (RG-1.21 Tables)

1.0 GASEOUS EFFLUENTS – UNIT 1

Table 7, Gaseous Effluents Summation of All Releases Unit 1 ¹²

A.	Fission & Activation Gases	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Est. Total Error %
1.	Total Release	Ci	0.00E+00	9.62E-02	1.66E+01	9.42E+00	24
2.	Average release rate for the period	μCi/sec	0.00E+00	1.22E-02	2.11E+00	1.19E+00	
B. Iodine							
1.	Total Iodine – 131	Ci	0.00E+00	0.00E+00	0.00E+00	7.25E-07	20
2.	Average release rate for the period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	9.20E-08	
C. Particulates							
1.	Particulates with half-lives > 8 days	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	22
2.	Average release rate for the period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
D. Tritium							
1.	Total Release	Ci	4.31E+00	3.59E+00	3.42E+00	6.39E+00	21
2.	Average release rate for the period	μCi/sec	5.47E-01	4.55E-01	4.33E-01	8.11E-01	
E. Gross Alpha							
1.	Total Release	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	31
2.	Average release rate for the period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	
F. Carbon-14							
1.	Total Release	Ci	2.11E+00	2.13E+00	2.01E+00	1.24E+00	
2.	Average release rate for the period	μCi/sec	2.77E-01	2.76E-01	2.59E-01	1.59E-01	

¹² % of limit is provided in Table 1, Arkansas Nuclear One Unit 1 Dose Summary

Company: Entergy

Plant: Arkansas Nuclear One

Table 8, Gaseous Effluents – Ground Level Release Batch Mode Unit 1

Radionuclide Released	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for year
Fission Gases						
Argon (Ar)-41	Ci	0.00E+00	0.00E+00	0.00E+00	4.62E-05	4.62E-05
Krypton (Kr)-85	Ci	0.00E+00	9.62E-02	0.00E+00	4.96E-01	5.92E-01
Xenon (Xe)-131m	Ci	0.00E+00	0.00E+00	0.00E+00	8.97E-04	8.97E-04
Xe-133	Ci	0.00E+00	0.00E+00	1.66E+01	8.85E+00	2.55E+01
Xe-135	Ci	0.00E+00	0.00E+00	0.00E+00	6.58E-02	6.58E-02
Total For Period	Ci	0.00E+00	9.62E-02	1.66E+01	9.42E+00	2.61E+01
Iodines						
Iodine (I)-131	Ci	0.00E+00	0.00E+00	0.00E+00	7.25E-07	7.25E-07
Total For Period	Ci	0.00E+00	0.00E+00	0.00E+00	7.25E-07	7.25E-07
Particulates						
None	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total for Period	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Tritium						
Tritium (H)-3	Ci	4.31E+00	3.59E+00	3.42E+00	6.39E+00	1.77E+01
Gross Alpha						
Alpha	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Carbon-14						
Carbon-14	Ci	2.11E+00	2.13E+00	2.01E+00	1.24E+00	7.49E+00

Company: Entergy

Plant: Arkansas Nuclear One

2.0 GASEOUS EFFLUENTS – UNIT 2Table 9, Gaseous Effluents Summation of All Releases Unit 2 ¹³

A.	Fission & Activation Gases	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Est. Total Error %
1.	Total Release	Ci	0.00E+00	4.67E-05	1.84E+00	4.69E-01	24
2.	Average release rate for the period	μCi/sec	0.00E+00	5.93E-06	2.34E-01	5.95E-02	

B.	Iodine						
1.	Total Iodine – 131	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	20
2.	Average release rate for the period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	

C.	Particulates						
1.	Particulates with half-lives > 8 days	Ci	5.06E-06	0.00E+00	0.00E+00	8.89E-06	22
2.	Average release rate for the period	μCi/sec	6.42E-07	0.00E+00	0.00E+00	1.13E-06	

D.	Tritium						
1.	Total Release	Ci	3.01E+00	5.38E+00	7.46E+00	6.90E+00	21
2.	Average release rate for the period	μCi/sec	3.82E-01	6.82E-01	9.47E-01	8.75E-01	

E.	Gross Alpha						
1.	Total Release	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	31
2.	Average release rate for the period	μCi/sec	0.00E+00	0.00E+00	0.00E+00	0.00E+00	

F.	Carbon-14						
1.	Total Release	Ci	2.76E+00	2.88E+00	2.90E+00	2.90E+00	
2.	Average release rate for the period	μCi/sec	3.62E-01	3.73E-01	3.73E-01	3.73E-01	

¹³ % of limit is provided in Table 2, Arkansas Nuclear One Unit 2 Dose Summary

Company: Entergy

Plant: Arkansas Nuclear One

Table 10, Gaseous Effluents – Ground Level Release Batch Mode Unit 2

Radionuclide Released	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for year
Fission Gases						
Xe-133	Ci	0.00E+00	4.67E-05	1.84E+00	4.69E-01	2.31E+00
Total For Period	Ci	0.00E+00	4.67E-05	1.84E+00	4.69E-01	2.31E+00
Iodines						
None	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total for Period	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Particulates						
Manganese (Mn)-54	Ci	0.00E+00	0.00E+00	0.00E+00	5.93E-07	5.93E-07
Cobalt (Co)-58	Ci	8.15E-07	0.00E+00	0.00E+00	0.00E+00	8.15E-07
Co-60	Ci	3.63E-06	0.00E+00	0.00E+00	8.30E-06	1.19E-05
Niobium (Nb)-95	Ci	6.14E-07	0.00E+00	0.00E+00	0.00E+00	6.14E-07
Total For Period	Ci	5.06E-06	0.00E+00	0.00E+00	8.89E-06	1.40E-05
Tritium						
H-3	Ci	3.01E+00	5.38E+00	7.46E+00	6.90E+00	2.27E+01
Gross Alpha						
Alpha	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Carbon-14						
C-14	Ci	2.76E+00	2.88E+00	2.90E+00	2.90E+00	1.15E+01

Company: Entergy

Plant: Arkansas Nuclear One

3.0 LIQUID EFFLUENTS – Unit 1

Table 11, Liquid Effluents – Summation of All Releases Unit 1¹⁴

A.	Fission & Activation Products	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Est. Total Error %
1.	Total Release	Ci	2.94E-03	5.03E-03	8.48E-03	3.11E-02	21
2.	Average diluted concentration	μCi/mL	1.12E-11	1.54E-11	2.36E-11	1.15E-10	

B.	Tritium						
1.	Total Release	Ci	1.02E+02	1.19E+02	2.55E+02	6.44E+01	12
2.	Average diluted concentration	μCi/mL	3.88E-07	3.64E-07	7.08E-07	2.38E-07	

C.	Dissolved & Entrained Gases						
1.	Total Release	Ci	7.10E-03	7.23E-03	1.52E-01	4.14E-01	22
2.	Average diluted concentration	μCi/mL	2.70E-11	2.21E-11	4.23E-10	1.53E-09	

D.	Gross Alpha Activity						
1.	Total Release	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	27

E.	Volume of Waste Released (prior to dilution)	Liters				
			5.14E+05	5.58E+05	1.59E+06	1.59E+06

F.	Volume of Dilution Water Used During Period	Liters				
			2.63E+11	3.27E+11	3.60E+11	2.71E+11

¹⁴ % of limit is provided in Table 1, Arkansas Nuclear One Unit 1 Dose Summary

Company: Entergy

Plant: Arkansas Nuclear One

Table 12, Batch Mode Liquid Effluents Unit 1

Radionuclide Released	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for year
Fission and Activation Products						
Sodium (Na)-24	Ci	0.00E+00	0.00E+00	0.00E+00	3.18E-05	3.18E-05
Chromium (Cr)-51	Ci	0.00E+00	0.00E+00	1.64E-04	2.13E-04	3.77E-04
Mn-54	Ci	9.76E-06	0.00E+00	3.34E-05	4.98E-04	5.41E-04
Iron (Fe)-55	Ci	0.00E+00	2.18E-03	0.00E+00	0.00E+00	2.18E-03
Fe-59	Ci	0.00E+00	0.00E+00	1.01E-05	0.00E+00	1.01E-05
Co-58	Ci	2.59E-04	6.50E-05	7.39E-04	1.57E-02	1.68E-02
Co-60	Ci	4.01E-04	1.69E-04	1.12E-03	4.68E-03	6.37E-03
Nickel (Ni)-63	Ci	9.15E-04	1.82E-03	0.00E+00	0.00E+00	2.74E-03
Strontium (Sr)-85	Ci	1.16E-05	3.30E-06	6.34E-06	2.33E-05	4.45E-05
Sr-92	Ci	0.00E+00	0.00E+00	3.70E-06	0.00E+00	3.70E-06
Zirconium (Zr)-95	Ci	8.75E-06	0.00E+00	1.50E-04	9.41E-05	2.52E-04
Nb-95	Ci	3.19E-05	0.00E+00	2.97E-04	1.48E-04	4.77E-04
Nb-97	Ci	3.68E-06	9.17E-07	7.44E-06	0.00E+00	1.20E-05
Ruthenium (Ru)-105	Ci	0.00E+00	0.00E+00	0.00E+00	7.96E-06	7.96E-06
Silver (Ag)-110m	Ci	3.69E-06	9.26E-07	1.53E-05	0.00E+00	1.99E-05
Antimony (Sb)-122	Ci	1.25E-06	0.00E+00	0.00E+00	0.00E+00	1.25E-06
Sb-124	Ci	8.43E-06	1.33E-04	1.72E-05	3.73E-04	5.31E-04
Sb-125	Ci	1.04E-05	2.06E-04	5.05E-05	4.98E-04	7.65E-04
Cesium (Cs)-134	Ci	1.78E-04	1.78E-04	2.48E-03	3.89E-03	6.73E-03
Cs-136	Ci	3.13E-06	0.00E+00	0.00E+00	0.00E+00	3.13E-06
Cs-137	Ci	1.09E-03	2.77E-04	3.38E-03	4.86E-03	9.60E-03
Cs-138	Ci	0.00E+00	0.00E+00	0.00E+00	5.72E-06	5.72E-06
Total For Period	Ci	2.94E-03	5.03E-03	8.48E-03	3.11E-02	4.75E-02
Tritium						
H-3	Ci	1.02E+02	1.19E+02	2.55E+02	6.44E+01	5.40E+02
Gross Alpha						
Alpha	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Entrained Gases						
Kr-85	Ci	2.68E-03	7.63E-04	1.46E-03	5.37E-03	1.03E-02
Xe-131m	Ci	0.00E+00	0.00E+00	1.89E-03	8.49E-03	1.04E-02
Xe-133m	Ci	0.00E+00	1.27E-06	6.27E-04	2.88E-03	3.51E-03
Xe-133	Ci	4.42E-03	6.47E-03	1.48E-01	3.97E-01	5.56E-01
Xe-135	Ci	0.00E+00	0.00E+00	1.41E-04	1.96E-04	3.38E-04
Total For Period	Ci	7.10E-03	7.23E-03	1.52E-01	4.14E-01	5.80E-01

Company: Entergy

Plant: Arkansas Nuclear One

4.0 LIQUID EFFLUENTS – Unit 2

Table 13, Liquid Effluents – Summation of All Releases Unit 2¹⁵

A.	Fission & Activation Products	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Est. Total Error %
1.	Total Release	Ci	1.18E-04	8.33E-05	3.49E-05	1.76E-04	21
2.	Average diluted concentration	μCi/mL	4.47E-13	2.55E-13	9.71E-14	6.49E-13	

B.	Tritium						
1.	Total Release	Ci	3.91E+01	7.47E+01	7.39E+01	1.14E+02	12
2.	Average diluted concentration	μCi/mL	1.49E-07	2.29E-07	2.05E-07	4.20E-07	

C.	Dissolved & Entrained Gases						
1.	Total Release	Ci	5.69E-05	1.18E-04	1.44E-03	4.05E-04	22
2.	Average diluted concentration	μCi/mL	2.16E-13	3.63E-13	4.00E-12	1.49E-12	

D.	Gross Alpha Activity						
1.	Total Release	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	27

E.	Volume of Waste Released (prior to dilution)	Liters	1.74E+05	1.82E+05	2.23E+05	2.11E+07

F.	Volume of Dilution Water Used During Period	Liters	2.63E+11	3.27E+11	3.60E+11	2.71E+11

¹⁵ % of limit is provided in Table 2, Arkansas Nuclear One Unit 2 Dose Summary

Table 14, Batch Mode Liquid Effluents Unit 2

Radionuclide Released	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for year
Fission and Activation Products						
Mn-54	Ci	0.00E+00	5.58E-06	0.00E+00	0.00E+00	5.58E-06
Co-58	Ci	5.70E-05	3.08E-05	6.86E-06	2.37E-05	1.18E-04
Co-60	Ci	6.07E-05	4.69E-05	2.04E-05	9.84E-05	2.27E-04
Nb-95	Ci	0.00E+00	0.00E+00	0.00E+00	3.67E-06	3.67E-06
Cs-134	Ci	0.00E+00	0.00E+00	0.00E+00	8.87E-06	8.87E-06
Cs-137	Ci	0.00E+00	0.00E+00	7.62E-06	4.10E-05	4.86E-05
Total For Period	Ci	1.18E-04	8.33E-05	3.49E-05	1.76E-04	4.12E-04
Tritium						
H-3	Ci	3.91E+01	7.47E+01	7.39E+01	1.14E+02	3.01E+02
Gross Alpha						
Alpha	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Entrained Gases						
Xe-133	Ci	5.69E-05	1.18E-04	1.44E-03	4.05E-04	2.02E-03
Total For Period	Ci	5.69E-05	1.18E-04	1.44E-03	4.05E-04	2.02E-03

Table 15, Continuous Mode Liquid Effluents Unit 2

Radionuclide Released	Units	Quarter 1	Quarter 2	Quarter 3	Quarter 4	Total for year
Fission and Activation Products						
None	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total For Period	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Tritium						
H-3	Ci	0.00E+00	0.00E+00	0.00E+00	8.04E-02	8.04E-02
Gross Alpha						
Alpha	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Entrained Gases						
None	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total For Period	Ci	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Attachment 2, Solid Waste Information

5.0 SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (NOT IRRADIATED FUEL)

Table 16, Types of Solid Waste Summary ANO Site

Types of Waste	Total Volume (m ³)	Total Activity (Ci)	Est. Total Error (%)
a. Spent resins, filter sludges, evaporator bottoms, etc.	5.40E+01	5.45E-02	25
b. Dry compressible waste, contaminated equip, etc.	3.52E+02	1.36E+00	25
c. Irradiated components, control rods, etc.	0.00E+00	0.00E+00	-
d. Other (describe)	0.00E+00	0.00E+00	-

6.0 ESTIMATE OF MAJOR NUCLIDE COMPOSITION (BY WASTE TYPE) ONLY >1% ARE REPORTED.

Table 17, Major Nuclides ANO Site

Major Nuclide Composition	%	Curies
a. Spent resins, filter sludges, evaporator bottoms, etc.		
C-14	2.32	1.27E-03
Cr-51	9.88	5.39E-03
Fe-55	13.83	7.55E-03
Co-58	5.33	2.91E-03
Co-60	14.29	7.80E-03
Ni-63	39.89	2.18E-02
Zr-95	1.09	5.94E-04
Nb-95	1.61	8.78E-04
Cs-137	8.05	4.39E-03

Table 17, Major Nuclides ANO Site

b. Dry compressible waste, contaminated equip, etc.		
C-14	2.38	3.25E-02
Cr-51	8.57	1.17E-01
Fe-55	13.99	1.90E-01
Co-58	5.43	7.40E-02
Co-60	14.68	2.00E-01
Ni-63	40.48	5.51E-01
Zr-95	1.09	1.48E-02
Nb-95	1.62	2.21E-02
Cs-137	8.14	1.11E-01
c. Irradiated components, control rods, etc.	-	-
None		
d. Other (describe)		
None	-	-

7.0 SOLID WASTE DISPOSITION

Table 18, Solid Waste Disposition ANO Site

Number of Shipments	Mode of Transportation	Destination
7	Hittman Transport (Highway)	Bear Creek Operations
6	Hittman Transport (Highway)	Energy Solutions (Memphis)
2	Landstar (Highway)	Bear Creek Operations
1	Landstar (Highway)	Energy Solutions (Memphis)

Company: Entergy**Plant: Arkansas Nuclear One****8.0 IRRADIATED FUEL DISPOSITION**

Table 19, Irradiated Fuel Shipments Disposition ANO Site

Number of Shipments	Mode of Transportation	Destination
0	-	-

Attachment 3, Meteorological Data

1.0 METEOROLOGICAL DATA SUMMARY

1.1 Joint Frequency Distributions

1. Period of Record: 2025
2. Stability Class: All
 - a. Periods of calm (hours): 30
 - b. Hours of missing data: 2901
 - c. Meteorological data are reported in percentage of total for all stability classes.
3. Elevation: 57 m

Table 20, Percentage of Each Wind Speed/Direction

Wind Speed (mph)									
Wind Direction	0 – 2	2 – 4	4 – 6	6- 8	8 – 10	10 – 15	15 - 20	>20	Total
N	0.34	0.27	0.26	0.26	0.19	0.18	0.02	0.01	1.55
NNE	0.27	0.48	0.32	0.32	0.17	0.14	0.15	0.00	1.85
NE	0.30	0.63	0.78	0.48	0.31	0.16	0.06	0.01	2.72
ENE	0.15	1.10	1.83	1.13	0.50	0.23	0.01	0.00	4.94
E	0.30	0.99	2.56	2.28	1.27	1.16	0.17	0.00	8.73
ESE	0.27	1.17	3.10	3.01	1.44	1.51	0.18	0.00	10.69
SE	0.25	1.27	1.56	1.40	0.87	0.58	0.03	0.00	5.97
SSE	0.23	0.63	1.17	0.95	0.66	0.55	0.01	0.00	4.20
S	0.31	0.40	0.55	0.86	0.54	0.47	0.14	0.01	3.26
SSW	0.31	0.29	0.44	0.54	0.30	0.37	0.09	0.00	2.33
SW	0.24	0.26	0.29	0.21	0.19	0.17	0.03	0.02	1.41
WSW	0.27	0.59	0.35	0.37	0.14	0.17	0.05	0.02	1.96
W	0.25	0.73	0.82	0.29	0.30	0.14	0.05	0.19	2.76
WNW	0.33	0.82	1.22	1.06	1.05	1.81	0.87	0.43	7.60
NW	0.23	0.54	0.44	0.34	0.88	1.49	0.63	0.14	4.69
NNW	0.13	0.42	0.31	0.37	0.26	0.66	0.06	0.02	2.22
Total	4.18	10.59	16.01	13.85	9.06	9.79	2.54	0.87	66.9

1.2 Stability classTable 21, Classification of Atmospheric Stability¹⁶

Stability Condition	Pasquill Categories	Percentage
Extremely Unstable	A	0.25
Moderately Stable	B	0.00
Slightly Unstable	C	0.00
Neutral	D	7.41
Slightly Stable	E	71.78
Moderately Stable	F	17.60
Extremely Stable	G	2.96

¹⁶ Stability Class (Delta T) percentages are based on the total available data.