



April 27, 2026
NOC-AE-26004158
10 CFR 50.36
STI: 35862281

ATTN: Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

South Texas Project
Units 1 and 2
Docket Nos. STN 50-498 and STN 50-499
South Texas Project Electric Generating Station
2025 Annual Environmental Operating Report

Pursuant to the South Texas Project Environmental Protection Plan (Non-radiological) and Technical Specification 6.9.1.3, the STP Nuclear Operating Company provides the enclosed South Texas Project Electric Generating Station 2025 Annual Environmental Operating Report.

There are no commitments in this letter.

If there are any questions about this report, please contact Zachary Dibbern at (361) 972-4336 or me at (361) 972-4045.

Jonah B. Morgan
Manager, Health Physics

Enclosure: South Texas Project Electric Generating Station 2025 Annual Environmental Operating Report

cc:

Regional Administrator, Region IV
U.S. Nuclear Regulatory Commission
1600 E. Lamar Boulevard
Arlington, TX 76011-4511



2025 ANNUAL ENVIRONMENTAL OPERATING REPORT



TABLE OF CONTENTS

CHAPTER ONE

EXECUTIVE SUMMARY 1-1

CHAPTER TWO

SITE AND AREA DESCRIPTION 2-1

The Plant Site 2-2
The Area 2-3

CHAPTER THREE

NON-RADIOLOGICAL ENVIRONMENTAL INTRODUCTION AND SUMMARY 3-1

CHAPTER FOUR

NON-RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT 4-1

Environmental Conditions 4-2
Aquatic and Ecological Monitoring 4-2
Water Quality Management 4-3
Air Quality Management 4-7
Non-radioactive Waste Management 4-8
Chemical Control and Management 4-8
Environmental Protection Plan Status 4-10

CHAPTER FIVE

RADIOLOGICAL ENVIRONMENTAL INTRODUCTION AND SUMMARY 5-1

CHAPTER SIX

RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT 6-1

Program Description 6-2
Airborne Pathway 6-6
Direct Exposure Pathway 6-6
Sediment Samples 6-8
Waterborne Pathway 6-10
NEI Groundwater Protection Initiative 6-14
Land Use Census 6-16
Quality Assurance 6-16
Program Deviations 6-18
Radiological Environmental Monitoring Program Analysis Summary 6-18

FIGURES

Figure 2-1: Plant Water Systems 2-4
Figure 4-1: 2025 Non-radioactive Waste Management 4-9
Figure 4-2: 2025 Non-radioactive Waste Generation 4-9
Figure 4-3: Hazardous Waste Shipped Historical Comparison 4-10
Figure 6-1: Radiological Environmental Monitoring Program **Designated Sample Location Map** 6-3
Figure 6-2: Radiological Environmental Monitoring Program **Onsite Sample Location Map** 6-4
Figure 6-3: Radiological Environmental Monitoring Program **Zone Location Map** 6-5
Figure 6-4: Historical Comparison of Average Quarterly Beta Activity from Indicator and Control Air Samples 6-6
Figure 6-5: Environmental Dosimeter Comparisons 6-8
Figure 6-6: Historical Comparison of Cobalt-60 in Main Cooling Reservoir Sediment 6-9
Figure 6-7: Calculated Cumulative Curies of Cobalt-60 in the Main Cooling Reservoir 6-9

Figure 6-8: Historical Comparison of Tritium Added to and Remaining in the Main Cooling Reservoir. 6-10
Figure 6-9: Historical Comparison of Tritium Activity in Reservoir Relief Wells 6-11
Figure 6-10: Historical Comparison of Tritium Activity in Surface Water 6-12
Figure 6-11: Historical Comparison of Tritium Activity in Shallow Aquifer Ground Water 6-13
Figure 6-12: Tritium Activity in Shallow Ground Water West of the Main Cooling Reservoir 6-13
Figure 6-13: NEI Ground Water Protection Initiative. 6-14
Figure 6-14: STP Protected Area Ground Water Monitoring Wells 6-14
Figure 6-15: 2025 Radiological Laboratory Quality Assurance Program Performance 6-17
Figure 6-16: Duplicate & Split Agreement of Environmental Samples in 2025 6-17

CHART

Chart 1: ANSI/HPS N13.37 STP Environmental Dosimetry Results 6-22


TABLES

Table 1: Radiological Environmental Monitoring Program 6-24 to 6-26
Table 2: Sample Media and Location Descriptions 6-26 to 6-32
Table 3: 2025 Radiological Environmental Monitoring Program Analysis Summary 6-33 to 6-42

2025 ANNUAL ENVIRONMENTAL OPERATING REPORT


The 2025 Annual Environmental Operating Report for the South Texas Project Electric Generating Station combines in one report the requirements for the Annual Environmental Operating Report (Non-radiological) found in Appendix B to the renewed Facility Operating License No. NPF-76 and No. NPF-80 and the requirements for the Annual Radiological Environmental Operating Report found in Part A of the station's Offsite Dose Calculation Manual.

Authored by:




Laura Stoicescu, CHP
Consulting Health Physicist, Health Physics Division

Authored by:



Robert Nies
Environmental Supervisor, Regulatory Affairs

Technical Review:



Edmond Hardcastle Jr.
Staff Environmental Radiological Services Specialist Health
Physics Division

Approved by:



Jonah Morgan
Manager, Health Physics Division

Completed in accordance with Technical Specifications for United States Nuclear Regulatory Commission Renewed License
No. NPF-76 and No. NPF-80 | April 2025





MESSAGE FROM THE PRESIDENT AND CEO



For more than three decades, STP has proudly delivered safe, carbon-free energy to power homes and businesses while honoring the natural beauty of Matagorda County. This region is a treasure—home to diverse ecosystems and wildlife, and recognized nationwide for its extraordinary variety of migratory birds. We take great pride in operating in a place where nature thrives.

Our commitment to environmental stewardship is unwavering. We understand that the land, water, and air we share are precious resources, and we work every day to protect them. Transparency remains at the heart of that commitment. We believe that open communication builds trust, and this report is one way we demonstrate that promise.

Thank you for allowing us to be part of this community and for trusting us as your neighbor. We look forward to continuing our role as a responsible energy provider and a dedicated steward of the environment for generations to come.

Chuck Kharrl
President, CEO & CNO
STP Nuclear Operating Company



EXECUTIVE SUMMARY

The South Texas Project Electric Generating Station (South Texas Project) continues to operate with no adverse effect on the population or the environment. The dose equivalent for people living in the area remains at less than one millirem per year. Environmental programs at the site monitor known and predictable relationships between the operation of the South Texas Project and the surrounding area. These monitoring programs verify that the operation of the South Texas Project has no impact offsite and is well below state and federal regulations and guidelines. These programs are verified by the State of Texas through collection and analysis of samples and placement of the State's monitoring dosimeters and other onsite and offsite inspections.

This report describes the environmental monitoring programs, non-radiological and radiological, conducted at the South Texas Project during 2025. Included in this report are the Environmental Protection Plan Status, the results of the Radiological Environmental Monitoring Program, and the Land Use Census.

Non-radiological environmental monitoring is performed each year as part of the station's overall Environmental Protection Plan which is intended to provide for protection of non-radiological environmental parameters during station operations.

Non-radiological monitoring encompasses, as a minimum, water quality, air quality, waste generation and minimization, and local aquatic and terrestrial ecological conditions. In 2025, non-radiological monitoring by the station confirmed that the South Texas Project's efforts to respect and protect local environmental conditions were successful. The operation of South Texas Project continued to provide



Photo courtesy of Greg McMullin

high-quality habitat areas for a variety of flora and fauna and continued to have no indications of negative non-radiological impacts to local environmental conditions.

The environment within a 15-mile radius of the South Texas Project is routinely monitored for radiation and radioactivity. Sampling locations are selected using weather, land use, and water use information. Two types of sampling



Photo courtesy of Gary Parkey

locations are used. The first type, Control Stations, are located in areas that are beyond the measurable influence of the South Texas Project or any other nuclear facility. The sample results from these stations are used to explain radiation from sources other than the South Texas Project.

Measurements performed are divided into four categories, or pathways

Indicator Stations are the second type of station. The samples from these stations measure any radiation contributed to the environment that could be caused by the South Texas Project. Indicator Stations are located in areas close to the South Texas Project where any plant releases would be detected.

Prior to initial operation of the South Texas Project, samples were collected and analyzed to determine the amount of radioactivity present in the area. These results are used as a “preoperational baseline.” Results from the Indicator Stations are compared to both current control sample results and the pre-operational baseline values to determine if changes in radioactivity levels are attributable to station operations or other

causes such as previous nuclear weapons testing programs and natural variations.

Radioactivity levels in the South Texas Project’s environment frequently fall below the minimum detection capabilities of state-of-the-art scientific instruments. Samples with radiation levels that cannot be detected are below the Lower Limits of Detection. The United States Nuclear Regulatory Commission requires that equipment used for radiological monitoring must be able to detect specified minimum limits for certain types of samples. This ensures that radiation measurements are sufficiently sensitive to detecting small changes in the environment. The United States Nuclear Regulatory Commission also has a required reporting level. Licensed nuclear facilities must prepare a special report and increase their sampling if any measured radiation level is equal to or greater than this reporting level. No sample from the South Texas Project has ever reached or exceeded this reporting level. Measurements performed are divided into four categories, or pathways, based upon how the results may affect the public. Airborne, waterborne, ingestion, and direct radiation are the four pathways that are sampled. Each pathway is described on page 1-4.

The South Texas Project continues to operate with no adverse effect on the



Photo courtesy of Karl Villa

population or the environment. The dose equivalent for people living in the area is maintained at less than one millirem per year. Environmental programs at the site monitor known and predictable relationships between the operation of the South Texas Project and the surrounding area. These monitoring programs verify that the operation of the South Texas Project has no impact offsite and is well within state and federal regulations and guidelines. These programs are verified by United States Nuclear Regulatory Commission inspections and the State of Texas through collection and analysis of samples and state radiation monitoring dosimeters.

Sampling locations are selected using weather, land use, and water use.



Photo courtesy of Greg McMullin

EACH OF THE FOUR PATHWAYS

THE AIRBORNE PATHWAY

is sampled in areas around the South Texas Project by measuring the levels of radioactive iodine and particulate radioactivity on air filters. The 2025 airborne results were similar to pre-operational levels detecting only naturally occurring radioactive material unrelated to the operation of the South Texas Project.



Photo courtesy of Laura Stoicescu

THE WATERBORNE PATHWAY

includes samples taken from surface water, groundwater, and drinking water. Also included in this pathway are sediment samples taken from the Main Cooling Reservoir and the Colorado River. Tritium was the only man-made nuclide consistently detected in water samples and was measured in the shallow aquifer, the Main Cooling Reservoir, ditches, and sloughs consistent with the South Texas Project Main Cooling Reservoir operating design. The levels of tritium found were near or lower than the concentration of tritium in the Main Cooling Reservoir. Additional onsite wells have been sampled to map tritium migration. The average tritium level in the Main Cooling Reservoir remained relatively constant throughout 2025. Tritium levels remain well below United States Nuclear Regulatory Commission reporting limits and within United States Environmental Protection Agency drinking water standards.

Previously detected plant-related nuclides, such as cobalt-60 and cesium-137, were detected in the reservoir sediment at designated sample locations at very low concentrations. Additional samples had detectable cesium-137 which is normally present in the environment and is consistent with pre-operational concentrations. Onsite sediment samples continue to occasionally indicate traces of plant-related nuclides such as cobalt-60. Offsite sediment samples continue to show no radioactivity from the South Texas Project. In summary, the station produced no detectable waterborne effects offsite.

THE INGESTION PATHWAY

includes broadleaf vegetation, agricultural products, and food products. Naturally occurring nuclides were detected at average environmental levels in the samples. The data indicated there were no man-made nuclides detected in these types of samples.



THE DIRECT EXPOSURE PATHWAY

measures environmental radiation doses using thermoluminescent dosimeters. These results are consistent with the readings from previous years and pre-operational measurements indicating no effect from South Texas Project operations.



Photo courtesy of Randy Maus



SITE AND AREA DESCRIPTION

The South Texas Project is located on 12,220 acres in Matagorda County, Texas, approximately 15 miles southwest of Bay City along the west bank of the Colorado River. The South Texas Project is owned by Constellation Energy, City of Austin, and City Public Service Board of San Antonio as tenants in common. Houston Lighting & Power Company was the original project manager of the South Texas Project and was responsible for the engineering, design, licensing, construction, startup, and initial commercial operation of the two-unit facility. In 1997, the STP Nuclear Operating Company assumed operational control of the South Texas Project and responsibility for implementation of associated environmental programs.

The South Texas Project has two Westinghouse pressurized water reactors. The rated core thermal power of each unit is 3,853 megawatts thermal (MWt). Each unit was originally designed for a net electrical power output of 1,250 megawatts electric (MWe). Unit 1 received

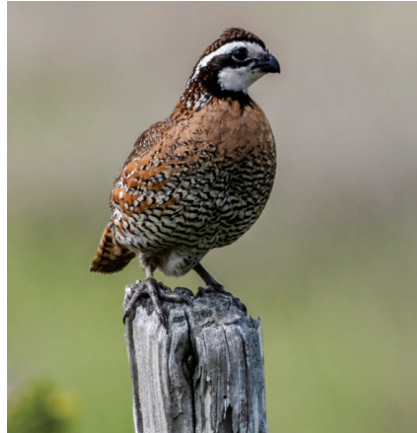


Photo courtesy of Greg McMullin

a low-power testing license on August 21, 1987, achieved initial criticality on March 8, 1988, and was declared commercially operational on August 25, 1988. Unit 2 received a low-power testing license on December 16, 1988, achieved initial criticality on March 12, 1989, and was declared commercially operational on June 19, 1989. On September 28, 2017, the United States Nuclear Regulatory Commission approved the South Texas Project's request to extend the operating

licenses an additional twenty years through 2047 and 2048.

The combined units currently produce enough electricity to serve more than two million homes and businesses throughout Texas. With approximately 1,000 baseline employees, the STP Nuclear Operating Company is the largest employer and source of revenue for Matagorda County. Nuclear energy continues to provide long-term cost stability and promote energy independence. It is our nation's largest source of carbon-free energy. As we work collectively to secure our state's long-term energy future, nuclear energy will continue to play an important role as a safe and reliable supply of clean baseload electricity.

THE PLANT SITE

Sixty-five of the total 12,220 acres at the South Texas Project are occupied by the two current power plants. Plant facilities include a 7,000-acre main cooling reservoir and a 47-acre essential cooling pond. Many smaller bodies of water onsite include wetlands, Kelly Lake, drainage ditches, sloughs, and depressions. Much of the land east of the cooling reservoir is leased for cattle grazing. Approximately 1,700 acres remain in a more natural state as a lowland habitat. A 110-acre wetland habitat area was established in 1996 on previously unused land located northeast



Photo courtesy of Greg McMullin

of the power plants. The area surrounding the South Texas Project is characterized by coastal plain with farmland and pasture predominating. Local relief of the area is

A 110-acre wetland habitat area was established in 1996 on previously unused land

characterized by flat land, approximately 23 feet above sea level.

THE AREA

Matagorda County's economy is based primarily on ranching, farming, oil and natural gas production and refinement, petrochemical production, electricity

generation, and commercial fishing and fisheries. The area within 10 miles of the site is generally rural and characterized as farmland, which is primarily pastureland used for livestock ranching. Although the surrounding area is heavily cultivated, significant amounts of woodlands, thicket, brush, fields, marsh, and open water exist to support wildlife. The area lies in the southern region of the central flyway and is host to an abundance of migratory birds. The local estuary environments provide the necessary habitat for a variety of fish types to complete their life cycles. The area also affords opportunity for recreational hunting and fishing.

The South Texas Project is home to many species of animals. Inhabitants include American alligators, a variety of birds, and

several hundred deer. In winter, literally hundreds of thousands of waterfowl, principally migratory geese as well as white pelicans, have found that the plant's 7,000-acre cooling reservoir provides a good resting place during their migrations. The climate of the region is subtropical maritime, with continental influence. It is characterized by short, mild winters and long, hot, and humid summers. Rainfall normally ranges from about two inches per month in February peaking to about four to five inches per month in May, June, September, and October. The prevailing wind direction is from the south-southeast, shifting to north-northeast for short intervals during the winter months.



Photo courtesy of Greg McMullin

PLANT WATER SYSTEMS

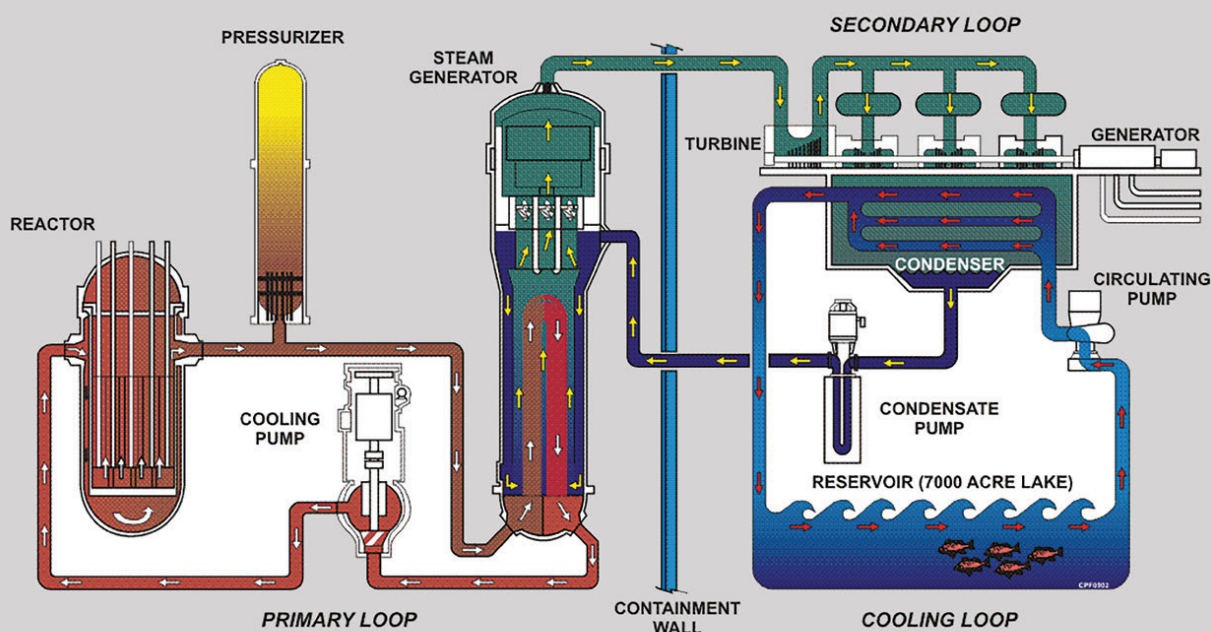


Figure 2-1

HOW THE SOUTH TEXAS PROJECT WORKS

Fossil-fueled and nuclear-powered steam generating plants operate on the same principle. Fuel is used to produce heat to convert water into high-pressure steam. The steam is directed through a turbine to turn a generator. In a fossil fuel plant, either coal, lignite, oil, or natural gas is burned in a boiler to produce the heat. In a nuclear plant, the reactor replaces the boiler and the “fissioning” or splitting of uranium atoms inside the reactor produces the heat.

The fuel for a nuclear reactor is uranium. It is formed into cylindrical ceramic pellets, each about the size of the end of your little finger. One pellet has the energy potential of about a ton of coal. Millions of these pellets are stacked in fuel rods that are arranged into assemblies that make up the core of the reactor. The use of uranium allows us to conserve natural gas, oil, and coal and to avoid the associated production of greenhouse gases. The fission process and generation of usable heat begins in a nuclear reactor

when control rods in the core are withdrawn. In pressurized water reactors, like those at the South Texas Project, the fuel rods heat water circulating in sealed, stainless-steel piping that passes through large heat exchangers called steam generators. The water in the reactor is under pressure to prevent boiling. This is why the South Texas Project’s Units 1 and 2 reactors are called “pressurized water reactors.”

This hot, pressurized water heats a separate supply of water in the steam generators to produce steam that is directed through the blades of a turbine generator to produce electricity. The steam is then fed to a condenser where a separate supply of cooling water from the Main Cooling Reservoir condenses it back into water that is then pumped back to the steam generator for reuse. A diagram of the plant water systems is shown in Figure 2-1.

In addition to its safety systems, the South Texas Project has many built-in physical barriers designed to prevent the release of radioactive materials in

the unlikely event of an accident. The most visible ones are the 200-foot tall, domed containment buildings with steel reinforced concrete walls four feet thick. Inside each of these massive structures, two more concrete walls provide another 11 feet of radiation shielding. The reactor vessel itself has steel walls six inches thick, and the fuel pellets inside it are sheathed in hardened metal tubes.

Nuclear energy has one of the lowest impacts on the environment. It is the most eco-efficient energy source because it produces the most electricity in relation to its minimal environmental impact.¹ Nuclear power plants generate approximately 50 percent of the carbon-free electricity generated in the United States. Additional information on nuclear energy and the environment can be found on the website maintained by the Nuclear Energy Institute at www.nei.org.

¹ Nuclear Energy Institute. *Nuclear Energy Fast Facts*; October 2022. As viewed at https://nei.org/resources/resources-archive?type=fact_sheet.



NON-RADIOLOGICAL ENVIRONMENTAL

INTRODUCTION AND SUMMARY

Non-radiological environmental conditions and performance at the South Texas Project during 2025 remained satisfactory and demonstrated that the South Texas Project continued to operate in an environmentally responsible manner during the year. The South Texas Project achieved and maintained high standards of environmental performance and compliance throughout 2025.

The South Texas Project is committed to the production of electricity in a safe, reliable, and economical manner using nuclear energy. The station's programs, policies, and business plan objectives also incorporate a commitment to environmental protection and management. The station's commitment to sound environmental management in 2025 is illustrated below.

Everyone at the South Texas Project has a responsibility to protect the environment. Commitment to environmental safety is an integral component of the South Texas

Project operating policy and core values. This responsibility reaches further than mere compliance with laws and regulations to encompass the integration of sound environmental practices into our daily operational and business decisions.

The people at the South Texas Project understand the need to balance economic, operational, and environmental issues for the benefit of the station and the public. We recognize our responsibility to hold ourselves to the highest principles of environmental stewardship.

THE STATION'S COMMITMENT TO SOUND ENVIRONMENTAL MANAGEMENT IN 2025 WAS HIGHLIGHTED BY:

- Successful TCEQ (Texas Commission on Environmental Quality) inspection of Wastewater Program area with no findings or violations.

- Continued support of community activities such as the annual Matagorda County Household Hazardous Waste Collection Day.

- Zero Reportable Events or Notices of Violation.

- Successful renewal of TPDES (Texas Pollutant Discharge Elimination System) permit.



Photo courtesy of Karl Villa

Photo courtesy of Gary Parkey



OPERATING REPORT

This section describes the South Texas Project's non-radiological environmental program performance and environmental conditions for 2025. The STP Nuclear Operating Company employees closely monitor environmental conditions at the South Texas Project. Constellation Energy Corporation provided support and technical assistance to the South Texas Project for most of 2025.

ENVIRONMENTAL CONDITIONS

The Texas Commission on Environmental Quality rated the South Texas Project as a high performer in 2023 based on the station's environmental compliance record. Facilities, such as the South Texas Project, are classified by the state as a high, satisfactory, or unsatisfactory performers based on compliance history. The state's classification of the South Texas Project as a high performer was based on the station's environmental performance over the last five-year period.

During the period of this report, the station continued to promote "green" initiatives including the recycling of paper, plastics, and aluminum by site employees. The station also continued to support various bird counts and surveys in 2025 sponsored by federal and state agencies and volunteer organizations such as the annual National Audubon Society Christmas Bird Count and the United States Fish and Wildlife Service's Colonial Waterbird Survey.



Photo courtesy of Laura Stoicescu

AQUATIC & ECOLOGICAL MONITORING

The location of the South Texas Project falls within the Texas Land Resource Area designation as coastal prairie and can be divided into two broad ecological areas—bottomland and upland areas—based on topography, soils, and vegetation. The bottomland lowland habitat is a swampy, marshy area that provides an important



Photo courtesy of Greg McMullin

habitat for birds and other wildlife and occupies approximately 1,700 acres of the site near the Colorado River. An upland spoil containment area, originally constructed in 1972 by the United States Army Corps of Engineers, is included in this area. In addition, a 110-acre wetland

The South Texas Project is located on the state-sponsored Great Texas Coastal Birding Trail

habitat area that attracts a variety of bird groups and other wildlife was established in 1996 on previously unused land located northeast of the power plants. The remaining area of the site offers diverse habitats for mammals and several types of birds. The South Texas Project regularly monitors the site's environment for changing conditions. Ecological conditions onsite in 2025 remained generally unchanged and stable.

The South Texas Project is located on the state-sponsored Great Texas Coastal Birding Trail that spans the entire Texas Gulf Coast from Brownsville to the Louisiana border. Matagorda County, in which the South Texas Project is located, consistently ranks at or near the top of the National Audubon Society's Annual Christmas Bird Count for the number of species identified. Many bird species have been observed visiting the wetland habitat and elsewhere onsite. These include the bald eagle, white-faced ibis, and brown pelican. Additional migratory and resident bird species such as a variety of ducks, geese, turkey, and pelicans (both brown and white) have been observed during informal surveys of the site's diverse natural and man-made habitats. Intensive bird nesting continues throughout the lowland habitat, particularly in a heron rookery around the perimeter of Kelly Lake and on the internal dikes of the Main Cooling Reservoir at the South Texas Project. The South Texas Project continues to provide vital habitat for more than an estimated 125 species of wintering and resident birds.

The South Texas Project continues to monitor important wildlife species to detect population changes. Informal



Photo courtesy of Greg McMullin

observations continue to indicate that the site provides high-quality habitat in which a wide range of animals thrive. The site continues to attract extensive wildlife



Photo courtesy of William Sharpe

populations, offering a refuge for resident species as well as seasonal migrants. The lowland habitat located between the Colorado River and the east bank of the Main Cooling Reservoir offers a significant source of water year-round. These natural resource areas, in concert with numerous additional wetland and grassland areas, offer the key ingredients necessary to sustain the extensive wildlife population at the South Texas Project.

WATER QUALITY MANAGEMENT

Water is an essential component in electricity production, and electric utilities must comply with extensive federal, state, and local water regulations. These regulations govern virtually every aspect of business operations at the South Texas Project. Water usage, wastewater treatment onsite and certain maintenance and repair activities are regulated under the Safe Drinking Water Act, the Federal Clean Water Act, and the Texas Water Quality Act. Collectively, these Acts safeguard public drinking water supplies and maintaining the integrity of state and federal waters. Regulating agencies that administer these requirements include the United States Army Corps of Engineers, the United States Environmental Protection Agency, the Texas Commission on Environmental Quality, the Texas General Land Office, the Lower Colorado River Authority, and the Coastal Plains Groundwater Conservation District.

The South Texas Project uses both surface water and groundwater for station purposes. Consistent with the station's environmental principles promoting efficient water

usage and conservation, surface and groundwater usage is carefully managed to conserve this important resource. Groundwater is pumped from deep aquifer wells to provide onsite drinking water for station personnel, to replenish the Essential Cooling Pond, and for other industrial purposes onsite. Water from the Main Cooling Reservoir and the Essential Cooling Pond is used as cooling water for plant operations. Water from the Colorado River replenishes the Main Cooling Reservoir via intermittent diversion periods. Surface water diverted to the Main Cooling Reservoir from the Colorado River accounted for approximately 8% of the water used at the South Texas Project in 2025. Information regarding water use in Texas can be found on the website maintained by the Texas Water Development Board at www.twdb.texas.gov.

Most of the water used by the South Texas Project is needed to condense steam and provide cooling for plant generating systems. The majority of this water is drawn from and returned to the station's Main Cooling Reservoir. The Main Cooling Reservoir is a 7,000-acre, above grade, off-channel reservoir capable of impounding 202,600 acre-feet of water at its maximum level. Water is diverted intermittently from the adjacent Colorado River to replenish the Main Cooling Reservoir. In addition, the Essential Cooling Pond, a 47-acre, below



Photo courtesy of Greg McMullin

grade, off channel reservoir that supplies water to cool crucial plant components, is capable of impounding 388 acre-feet of water. Various water rights permits, contractual agreements, and compliance documents authorize the South Texas Project to maintain these reservoirs, impound water diverted from the Colorado River, and to circulate, divert, and use water from the reservoirs for industrial purposes to operate the plant. These authorizations also limit the amount and rate of diversion from the Colorado River to protect downstream environmental

flow requirements for bays and estuaries. The South Texas Project diverted 7,752 acre-feet in 2025 from the Colorado River for Main Cooling Reservoir fill operations while preserving adequate freshwater flow conditions for downstream bay and estuarine ecosystems. Approximately 1,909 acre-feet of the water used by the station was withdrawn from onsite groundwater sources in 2025.

Existing federal and state water quality standards are implemented and enforced through the Texas Pollutant Discharge Elimination System (TPDES) permit program to restore and maintain the state's waters. Under this permit program, the South Texas Project monitors, records, and reports wastewater pollutant types and quantities to ensure that the South Texas Project meets the stringent levels set in the permit. The TPDES permit was renewed in 2025. A monthly monitoring report is submitted to the Texas Commission on Environmental Quality for wastewater discharges. Reports identifying groundwater use, surface water use, and water conservation are submitted annually to the Texas Water Development Board. Reports of surface water diversion and consumptive use are submitted to the Texas Commission on Environmental Quality and the Lower Colorado River Authority. An annual groundwater use report is also submitted to the Coastal



Photo courtesy of Greg McMullin

Plains Groundwater Conservation District in accordance with groundwater district requirements.

Wastewater generated at the South Texas Project is processed and discharged to the onsite Main Cooling Reservoir to be re-used by the station as cooling

The legislation required the Texas Water Development Board to create a statewide water plan

water for plant systems. No water was discharged from the Main Cooling Reservoir in 2025 other than from the relief wells that are part of the reservoir embankment stabilization system. No aquatic monitoring was required to be conducted at the site in 2025 by the United States Environmental Protection Agency or the Texas Commission on Environmental

Quality. Wastewater discharges met state and federal water quality standards during the year, while conserving and maximizing efficient water usage at the South Texas Project. In addition to the wastewater discharge permit program, the Federal Clean Water Act, as amended, requires permits for storm water discharges associated with industrial activity. The South Texas Project's Storm Water Pollution Prevention Plan ensures that potential pollution sources at the site are evaluated and that appropriate measures are selected and implemented to prevent or control the discharge of pollutants in storm water runoff. This plan is a document that is revised whenever there is a change in design, construction, operation, or maintenance that has a significant effect on the potential for the discharge of pollutants from the station. The station's Multi-Sector General Permit for storm water discharges was renewed in 2021.



Photo courtesy of Karl Villa

Following a severe drought in 1996, the Texas Legislature recognized the need to address a wide range of state water resource management issues. In 1997, the Texas Senate drafted legislation known as Senate Bill 1 to address these issues and to develop a comprehensive state water policy. The legislation required the Texas Water Development Board to create a statewide water plan that emphasizes regional planning. Sixteen planning regions were created, each tasked to prepare a plan for the orderly development, management, and conservation of water resources. The South Texas Project was chosen to represent the interests of electric generating utilities for water-planning Region K, encompassing the lower Colorado River Basin. A state water plan is prepared by the Texas Water Development Board every five years based on the regional water plans. The regional water plans are revised each planning cycle based on updated population and water demand projections, water supply analyses, and water management strategies for a water planning horizon out to the year 2070. In September 2025, the water plan adopted by the Region K water planning group was submitted to the Texas Water Development Board and was approved in 2026. The South Texas Project continues to actively participate in the Lower Colorado Regional Water Planning Group to identify strategies to meet future water supply demand projections for the region and to update the existing plan accordingly. Additional information regarding regional water planning in Texas can be found on the website maintained by the Texas Water Development Board at www.twdb.texas.gov.

Senate Bill 1 also required groundwater conservation districts to develop



Photo courtesy of Karl Villa

groundwater management plans with estimates on the availability of groundwater in the district, details of how the district would manage groundwater, and management goals for the district. The water planning and management provisions were further clarified in 2001 with the enactment of Senate Bill 2. Accordingly, the Coastal Plains Groundwater Conservation District, encompassing Matagorda County, was confirmed by local election in late 2001. The purpose of the district is to manage and protect the groundwater resources of the district. The South Texas Project groundwater wells are registered with the Coastal Plains Groundwater Conservation District. Operating permits for the groundwater wells were renewed in January 2023, as required.

A state water plan is prepared by the Texas Water Development Board every five years based on regional water plans every three years. Station personnel continue to monitor onsite groundwater usage according to the requirements of District rules. Additional information regarding the Coastal Plains Groundwater Conservation District can be found on

its website at www.coastalplainsgcd.com. In 2007, in further recognition of the importance of water conservation to meet future demands in the state, Senate Bill 3, enacted by the Texas Legislature, created a stakeholder-driven process for the development of environmental flows. Environmental flows are the amount of water necessary for a river, estuary, or other freshwater system to maintain its health and productivity.

The law established a process to develop environmental flow regime recommendations for each major river basin in Texas. The process tasked a team of stakeholders from each area of the state, working with a science team, to develop a set of recommendations to the Texas Commission on Environmental Quality and to perform ongoing periodic reviews of the recommendations. The South Texas Project participated as a member of the stakeholder committee that included the Colorado River and Matagorda Bay. The environmental flow standards set flow levels at various points in rivers and streams to protect water in the rivers and estuaries along the coast. The existing South Texas Project right to

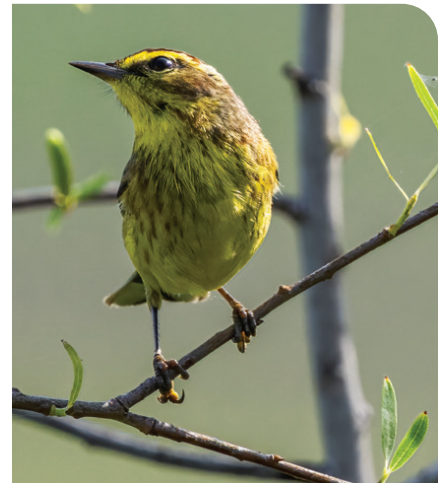


Photo courtesy of Greg McMullin

divert surface water was not impacted by this legislation. Additional information regarding environmental flows can be found at www.tceq.texas.gov/permitting/water_rights/wr_technical-resources/eflows.

In 2025, the Texas Commission on Environmental Quality began revising the Lower Colorado River Authority Water Management Plan. The Lower Colorado River Authority Water Management Plan determines how water is allocated from the Highland Lakes (specifically Lakes Travis



Photo courtesy of Greg McMullin

and Buchanan) to meet the needs of water users, including the South Texas Project, during water supply shortages. The process started in 2025, and in 2026 the Lower Colorado River Authority plans to submit an updated Water Management Plan to the Texas Commission on Environmental

The environmental flow standards set flow levels at various points in rivers and streams

Quality for approval. The South Texas Project participated in the development of the revision for presentation to and approval by the Texas Commission on Environmental Quality. Stakeholders included representatives from cities, industry, lake area businesses and

residents, environmental interests, and agriculture. Additional information on the Lower Colorado River Authority Water Management Plan can be found at www.lcra.org.

In 1999, the South Texas Project implemented a station Water Conservation Plan in accordance with state water use regulations. The purpose of the Water Conservation Plan is to identify and establish principles, practices, and standards to effectively conserve and efficiently use available ground and surface water supplies and meet historical and projected average industrial water demand. Annual implementation reports are submitted to the Texas Water Development Board and the plan is updated every five years. The station re-submitted a revised plan to the Texas Water Development Board in 2024. Managers and staff at the South Texas Project understand



Photo courtesy of Cristina Armas

the water resources of the state are a critical natural resource requiring careful management and conservation to preserve water quality and availability. Accordingly, the station continues to support efforts focusing on the efficient use and conservation of water resources.

AIR QUALITY MANAGEMENT

Air emission sources at the South Texas Project fall under the scope of air pollution regulations promulgated under the Texas Clean Air Act, the Federal Clean Air Act and numerous associated amendments. The purpose of these regulations is to protect air resources from pollution by controlling or abating air pollution and harmful emissions. Although nuclear generation of electricity is a form of zero-emission clean energy, the South Texas Project uses small amounts of fossil fuel for backup and emergency equipment. Regulated emission sources at the South Texas Project includes fossil-fueled emergency generators and fire pumps, fire-fighting training, and other minor maintenance equipment and activities.

The station is registered under Texas Commission on Environmental Quality Permit By Rule Registration No. 154767. This permit by rule registration grants the station the authority to operate identified emission sources in accordance with applicable permit and regulatory requirements.

In 2025, the South Texas Project had no reportable air emissions events and no violations.

Unlike conventional electrical generating stations, nuclear power plants do not burn fossil fuel to produce electricity. Therefore, the South Texas Project produces



Photo courtesy of Cristina Armas

virtually no greenhouse gases or other air pollutants that are the typical byproducts of industrial power production processes. The use of emissions free nuclear power is a significant contributor to the preservation of our community's clean air resources.

NON-RADIOACTIVE WASTE MANAGEMENT

Solid waste management procedures for hazardous and non-hazardous wastes generated at the South Texas Project ensure that wastes are properly dispositioned in accordance with applicable federal, state, and local environmental and health regulations. By regulatory definition, solid waste includes solid, semi-solid, liquid, and gaseous waste material. The Texas Commission on Environmental Quality, which administers the Texas Solid Waste Disposal Act and the federal Resource Conservation and Recovery Act program, is the primary agency regulating non-radioactive wastes generated at the South Texas Project. The Texas Commission on Environmental Quality regulates the collection, handling, storage, and disposal of solid wastes, including hazardous wastes. The transportation of waste materials is regulated by the United States Department of Transportation.

The South Texas Project is classified as a small quantity generator of industrial solid wastes. Texas Commission on Environmental Quality regulations require industrial solid wastes generated at the South Texas Project to be identified to the Commission. These are listed in the Texas Commission on

Environmental Quality Notice of Registration for the South Texas Project. The registration is revised whenever there is a change in waste management practices at the site. Hazardous waste and Class I non-hazardous waste handling and disposal activities are summarized and documented in a waste summary report for the South Texas Project that is submitted annually to the Texas Commission on Environmental Quality. The South Texas Project five-year Source Reduction and Waste Minimization plan for hazardous waste was last updated and the associated executive summary was submitted to the Texas Commission on Environmental Quality in 2024.

Hazardous waste accumulation at the South Texas Project in 2025 was limited to a maximum holding period of 180 days. The Resource Conservation and Recovery Act and Texas Solid Waste Disposal Act also requires the use of proper storage and shipping containers, labels, manifests, reports, personnel training, a spill control plan, and an accident contingency plan. South Texas Project personnel routinely inspect areas throughout the site to ensure wastes are not stored or accumulated inappropriately.

South Texas Project policies and regulations encourage the recycling, recovery, or reuse of waste, when possible, to reduce the amount of waste generated or disposed of in landfills. Approximately 54 percent of the industrial non-radioactive waste generated in 2025 at the South Texas Project was recycled or processed for reuse (Reference Figure 4-1). Used oil, diesel fuels, electro-hydraulic fluid, and used oil filters were sent to a recycling



Photo courtesy of Greg McMullin

vendor for reprocessing. Empty polyethylene drums are returned, when possible, to the original manufacturer for reuse.

The use of emissions free nuclear power is a significant contributor to the preservation of our community's clean air resources to the original manufacturer for reuse. In addition, the station supports recycling programs for cardboard, paper, aluminum, printer cartridges and plastic. Approximately 26.72 tons of scrap metal were removed from the station for recycle in 2025. The South Texas Project continues to explore new areas where recycling may be expanded or initiated.

Non-radioactive solid waste that cannot be shipped for recycling is shipped for disposal.

Municipal type trash is transported to an offsite landfill. Hazardous waste accounts for only a small portion of the waste generated at the South Texas Project. Minimization and reduction of hazardous waste generation where feasible remains an important goal. Changes in the amount of hazardous waste shipped each year generally reflect differences in operation and maintenance activities. Successful waste minimization and source reduction efforts by employees have allowed the South Texas Project to remain classified as a small-quantity waste generator since 2004 (Reference Figures 4-2 and 4-3).

CHEMICAL CONTROL AND MANAGEMENT

The station's Integrated Spill Contingency Plan for the South Texas Project, last updated and re-certified in 2024, consolidates multiple federal and state requirements into one plan. The plan is implemented through standard site operating procedures and guidelines. The South Texas Project uses standard operating procedures, policies, and programs to minimize the generation of waste materials,



Photo courtesy of Karl Villa

2025 Nonradioactive Waste Management

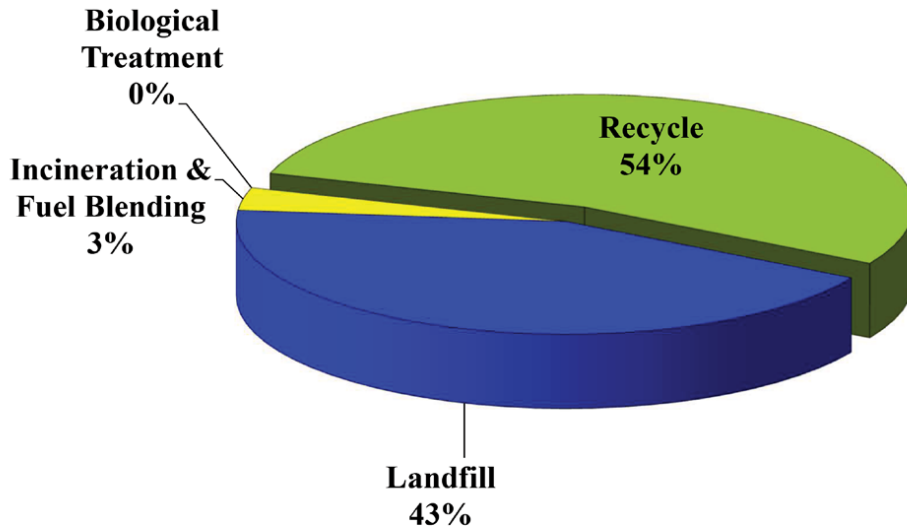


Figure 4-1

2025 Nonradioactive Waste Generation

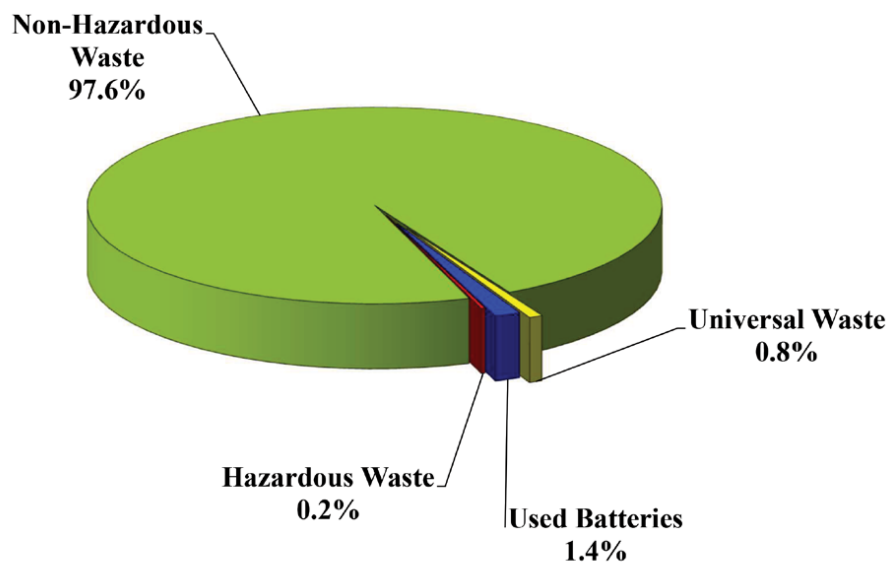


Figure 4-2

control chemical use, and prevent spills. The South Texas Project also evaluates chemicals and products prior to their approval for use at the station. Site procedures that implement the station's Integrated Spill Contingency Plan and the station's Chemical Control Program address the evaluation, storage, use, labeling, spill control, and disposal requirements of chemicals. These guidelines also assist in reducing waste generation, ensuring proper packaging for disposal, and mitigating the consequences of inadvertent spillage.

The South Texas Project emphasizes awareness training for spill prevention and maintains readiness to respond should a spill occur. Spill response team members receive annual refresher training in hazardous material incident response. The South Texas Project had zero reportable spills in 2025.

ENVIRONMENTAL PROTECTION PLAN STATUS

The South Texas Project's Environmental Protection Plan was issued in March of 1989 to protect non-radiological environmental monitoring parameters during operation of the nuclear plants. This report reviews



Photo courtesy of Karl Villa

Environmental Protection Plan non-compliances, if any, identified in 2025 and the associated corrective actions taken to prevent recurrence. Potential non-conformities are promptly addressed to maintain operations in compliance with plan requirements.

Plant personnel use a condition reporting process to document these conditions and track corrective actions to completion. Internal assessments, reviews and inspections are also used to ensure compliance. Events that require notifications to federal, state, or local

agencies are reported in accordance with the applicable reporting requirements. The United States Nuclear Regulatory Commission is provided with a copy of any such reports at the time they are submitted to the cognizant agency. If a non-routine event occurs and a report is not required by another agency, then a 30-day report to the United States Nuclear Regulatory Commission is required by the Environmental Protection Plan. No such 30-day or other non-routine event report was required in 2025.



Figure 4-3



RADIOLOGICAL ENVIRONMENTAL

INTRODUCTION & SUMMARY

The Radiological Environmental Monitoring Program is designed to evaluate the radiological impact of the South Texas Project on the environment by collecting and analyzing samples for low levels of radioactivity. Measurements of samples from the different pathways indicate that there continues to be no adverse effect offsite from the operation of the South Texas Project.

Only tritium and naturally occurring radioactive material were identified in the offsite environmental samples in 2025. Samples of fish and meat collected and analyzed showed no South Texas Project related nuclides were present. Water samples from the onsite drinking water supply from the deep aquifer and from offsite sampling stations on the Colorado River show only natural background radioactivity. The station also monitors for radioactivity in onsite sediment from the Main Cooling Reservoir and ditches. Measurements of direct radiation onsite and offsite indicated no federal dose limits were exceeded.

Tritium is a radioactive isotope of hydrogen that is produced in the reactor and cannot be removed from effluents released to the Main Cooling Reservoir because it is part of the water molecule.

Due to the design of the Main Cooling Reservoir, the presence of tritium in various sloughs and ditches onsite and the shallow aquifer is expected. Tritium has been detected in these types of samples and the concentrations remain below the United States Environmental Protection Agency drinking water limits.



Photo courtesy of Greg McMullin

A sampling program was developed to monitor the tritium in the immediate area around the plant for long term trending. Wells are sampled either semi-annually, annually, or once every five years, depending on location and the amount of tritium present. The tritium concentration remained below the United States Environmental Protection Agency drinking water limits in 2025 and within the design basis of the South Texas Project.

Analyses of the data collected from the implementation of the Radiological Environmental Monitoring Program indicates that the operation of the South Texas Project has no adverse radiological impact.

NON-ROUTINE REPORT REVIEWS

This annual report also reviews non-routine reports submitted by plant personnel and any activities that involved a potentially significant unreviewed environmental question. A proposed change, test or experiment is considered to present an unreviewed environmental question if it concerns:

- A matter that may result in a significant increase in any adverse environmental impact previously evaluated in the Final Environmental Statement related to the operation of South Texas Project, Units 1 and 2 (Docket Nos. 50-498 and 50-499), environmental impact appraisals, or in any decisions of the

Atomic Safety and Licensing Board.

- A significant change in effluents or power level.
- A matter not previously reviewed and evaluated in the documents specified in (1) above, that may have a significant adverse environmental impact.

No unreviewed environmental questions were identified in 2025.



OPERATING REPORT

The South Texas Project initiated a comprehensive pre-operational Radiological Environmental Monitoring Program in July 1985. That program terminated on March 7, 1988, when the operational program was implemented. The data from the pre-operational monitoring program form the baseline against which operational changes are measured.

Program Description

Analyses of the environmental pathways require that samples be taken from water, air, and land environments. These samples are obtained to evaluate potential radiation exposure to people.

Sample types are based on established pathways and experience gained at other nuclear facilities. Sample locations were determined after considering site meteorology, site hydrology, local demography, and land use. Sampling locations are further evaluated and modified according to field and analysis experience. Table 1 at the end of this section lists the required sampling locations and frequency of collection. Additional discretionary samples were also collected.

Sampling locations consist of Indicator Stations and Control Stations. Indicator Stations are locations on or off the site that may be influenced by plant discharges during plant operation. Control Stations are located beyond the measurable influence of the South Texas

Project. Although most samples analyzed are accompanied by a control sample, it should be noted that this practice is not always possible or meaningful with all sample types. Fluctuations in the concentration of radionuclides and direct radiation exposure at Indicator Stations are evaluated in relation to historical data and against the Control Stations. Indicator Stations are compared with characteristics identified during the pre-operational program to monitor for radiological effects from plant operation.

Two sample identification methods are used in the program. Figures 6-1 and 6-2 are maps that identify permanent sample stations. Descriptions of sample stations shown on Figures 6-1 and 6-2 are found in Table 2. Table 2 also includes supplemental sampling locations and medium types that may be used for additional information. Figure 6-3 illustrates zones that may be used to complement permanent, numbered sample stations.

Continued on p.6-6

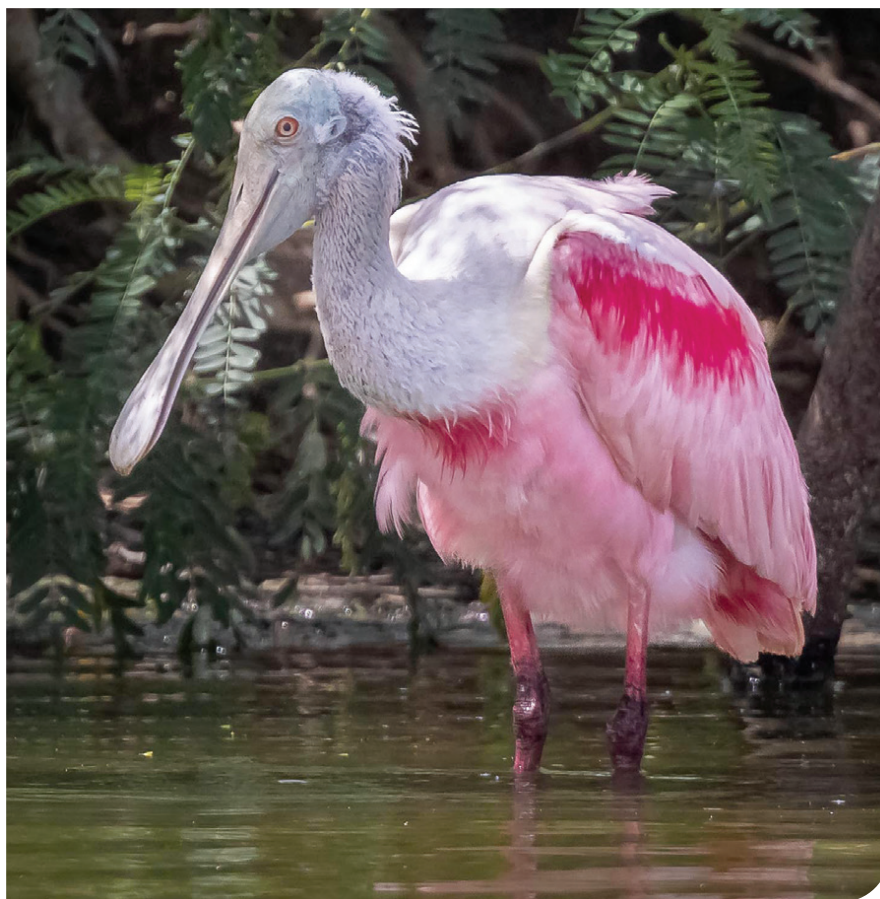


Photo courtesy of Gary Parkey

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ONSITE SAMPLE LOCATION MAP


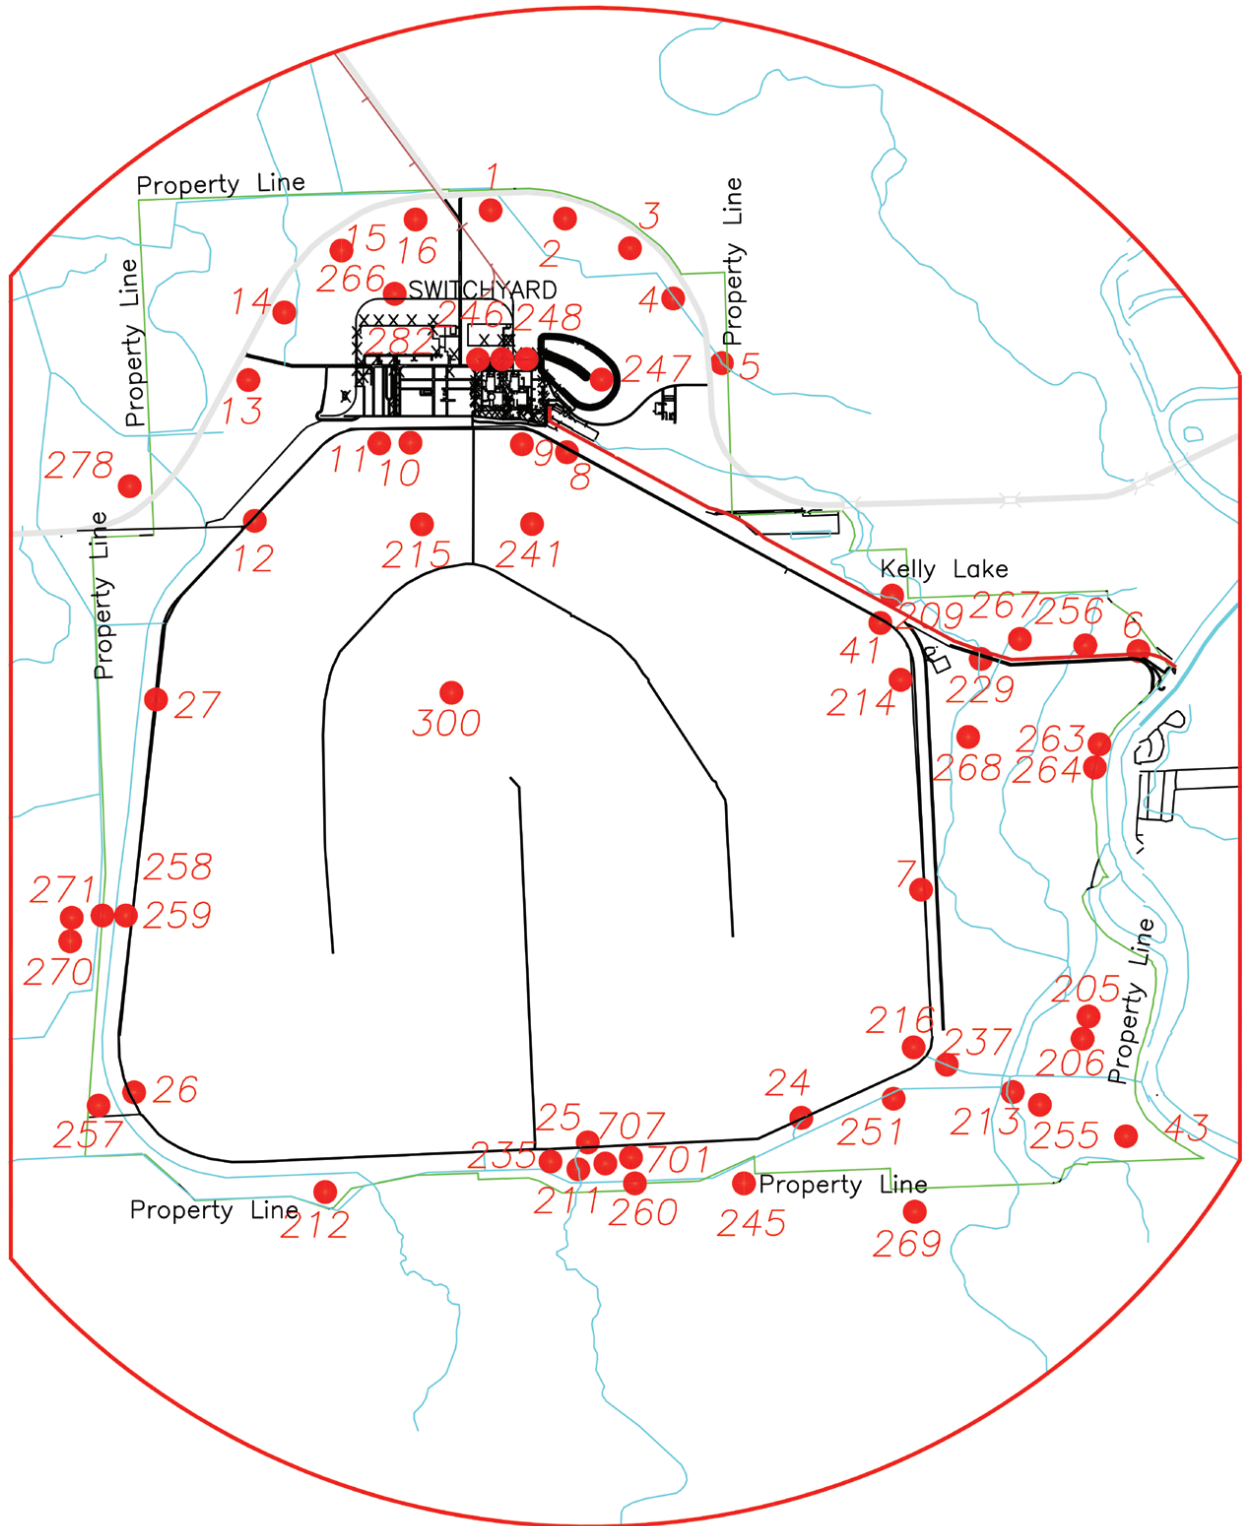


Figure 6-2

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ZONE LOCATION MAP

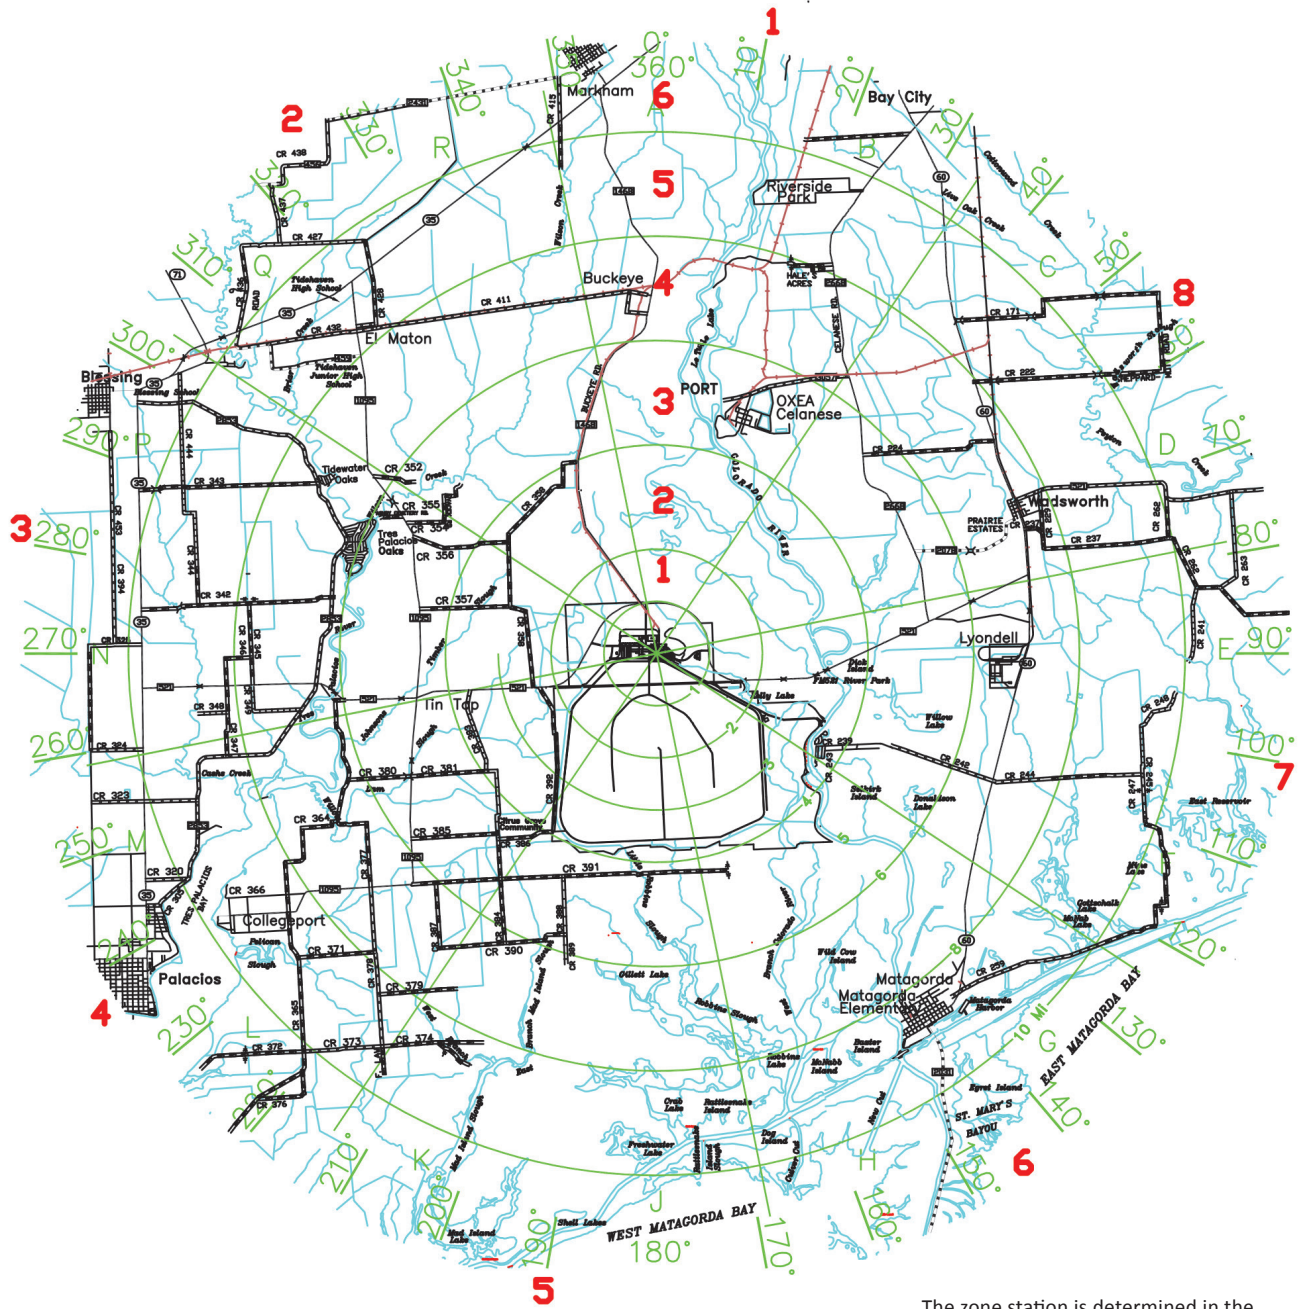

The zone station is determined in the following manner:

- The first character of the station number "Z" to identify it as a zone station.
- The second character is the direction coordinate No. 1-8.
- The third character is the distance from the site No. 1-6.

Figure 6-3

Environmental samples from areas surrounding the South Texas Project continue to indicate no radiological effects from plant operation. Measured values from offsite indicator sample stations continue to trend

Measured values from offsite indicator sample stations continue to trend with the Control Stations

with the Control Stations. Measurements from onsite indicator samples continued to fluctuate within normal historical ranges.

AIRBORNE PATHWAY

Average quarterly air particulate sample beta radiation activity from three onsite Indicator Stations and a single control station have been compared historically from 2001 through 2025 (see Figure 6-4). The average of the onsite indicators trends closely with the offsite control values. The comparison illustrates that plant operations are not having an impact on air particulate activity even at the Sensitive Indicator Stations (#1, #15, and #16). These stations are located near the site boundary downwind from the plant, based on the prevailing wind direction in the north,

northwest, and north-northwest. The beta activity measured in the air particulate samples is from naturally occurring radioactive material. Gamma radiation analyses are performed on quarterly composites of the weekly air particulate samples to determine if any activity is from the South Texas Project. The gamma analyses revealed no radioactivity from the South Texas Project.

DIRECT EXPOSURE PATHWAY

Direct gamma exposure is monitored in the environment using beryllium oxide optically stimulated luminescence dosimeters (BeOSL) located at 40 locations around the site. The natural direct gamma exposure varies according to location because of differences in the natural radioactive materials in the soil, soil moisture content, and other factors. Figure 6-5 compares the amount of direct gamma exposure measured at the plant from the first quarter of 2001 using three different types of stations. The South Texas Project started using a vendor for offsite processing of the dosimeters for environmental measurement of direct radiation during the third and fourth quarter of 2014 initially using thermoluminescent dosimeters (TLDs) and

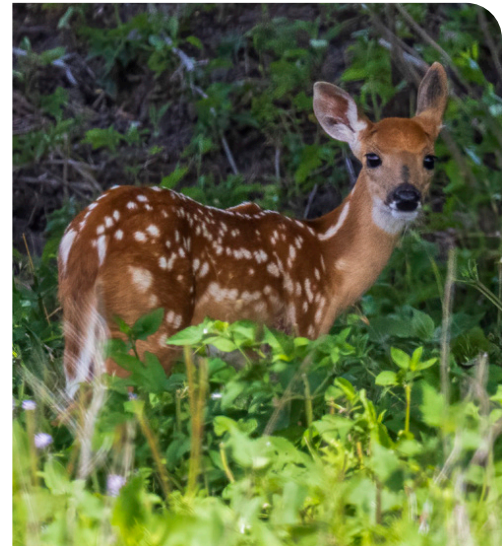


Photo courtesy of Greg McMullin

then incorporated BeOSL in 2024 through 2025. The Control Stations, Stations #23 and #37, are greater than 10 miles from the site in the minimal wind direction. The prevailing wind direction was into the northwest sector. The Sensitive Indicator Stations are one-mile NW, NNW, and N from the plants on FM 521 at Stations #15, #16 and #1 respectively. The Indicator Stations are the remainder of the required monitoring stations. A summary of these results is documented in Chart 1 per the

Continued on p.6-8

Historical Comparison of Average Quarterly Beta Activity from Indicator and Control Air Samples 2001-2025

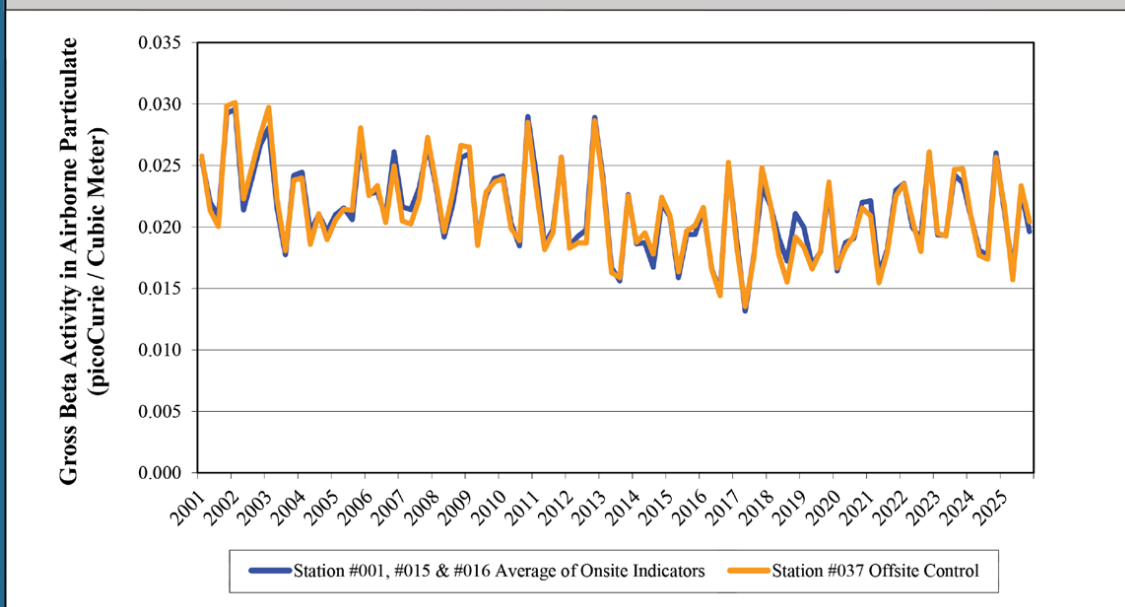


Figure 6-4



American National Standard Institute (ANSI) and Health Physics Society (HPS) per ANSI/HPS N13.37 Environmental Dosimetry- Criteria for System Design and Implementation.

The values plotted are the averages for all the stations according to type

The values plotted are the averages for all the stations according to type. The average of the Control Stations is higher than the other stations because Station #23 is in an area that has slightly higher natural background radiation. The trends of Figure 6-5 show that South Texas Project are not contributing to the direct radiation in the offsite environment.

SEDIMENT SAMPLES

The cobalt-60 inventory in the reservoir has decreased since 1992 because of radioactive decay and installed equipment to reduce radioactive effluents. Although the total activity of cobalt-60 has decreased over time, an inventory of cobalt-60 is still in the reservoir as seen occasionally at Stations #215 and #216. In 2025, cobalt-60 was identified in three out of four Main Cooling Reservoir



Photo courtesy of Greg McMullin

sediment samples taken, all results were less than the reporting levels at those locations due to nonuniform distribution in the reservoir bottom sediment. Figure 6-7 demonstrates the calculated decline in the total amount of cobalt-60 in the reservoir. Bottom sediment samples are taken from the Main Cooling Reservoir each year. A study was performed in 2010 to locate the distribution and concentrations of cobalt-60 and cesium-137 in the Reservoir. Although no cobalt-60 was

detected from 2007 through 2010 at Stations #215 and #216, the concentration of cobalt-60 is not uniformly distributed in the reservoir sediment and some cobalt-60 remains. Figure 6-6 and Figure 6-7 show the results from the plant-produced cobalt-60 from the Main Cooling Reservoir.

Cobalt-60 was not identified in any other sediment sample outside the Main Cooling Reservoir in 2025.

Continued on p.6-9

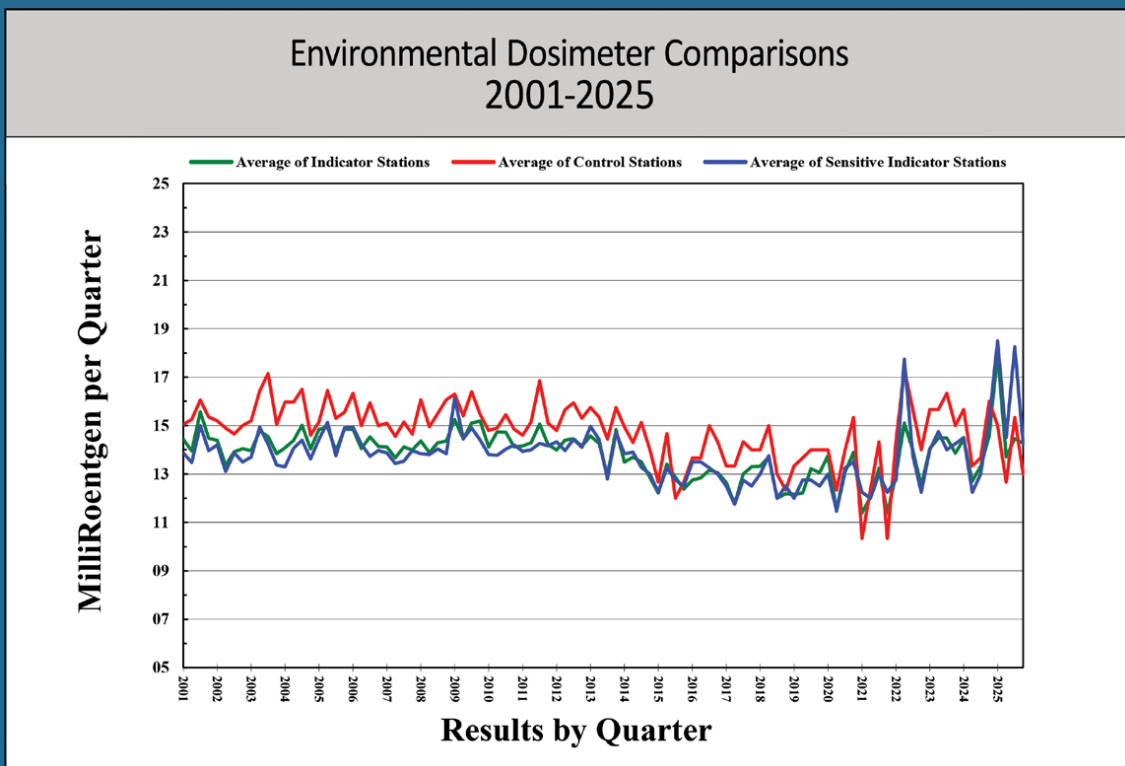


Figure 6-5

Photo courtesy of Cristina Armas

Historical Comparison of Cobalt-60 in the Main Cooling Reservoir Sediment 2001-2025


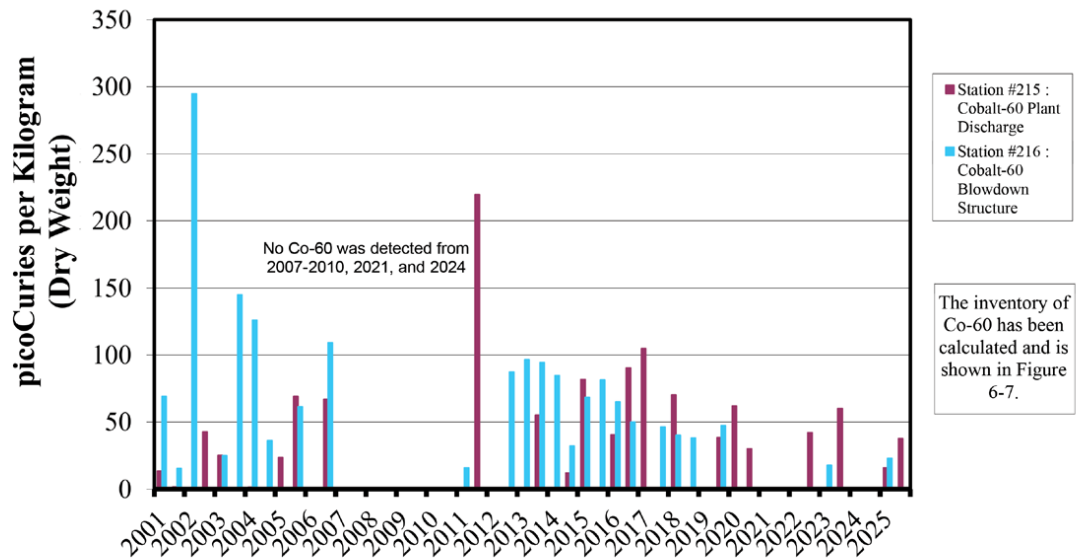


Figure 6-6

Calculated Cumulative Curies of Cobalt-60 in the Main Cooling Reservoir 2001-2025

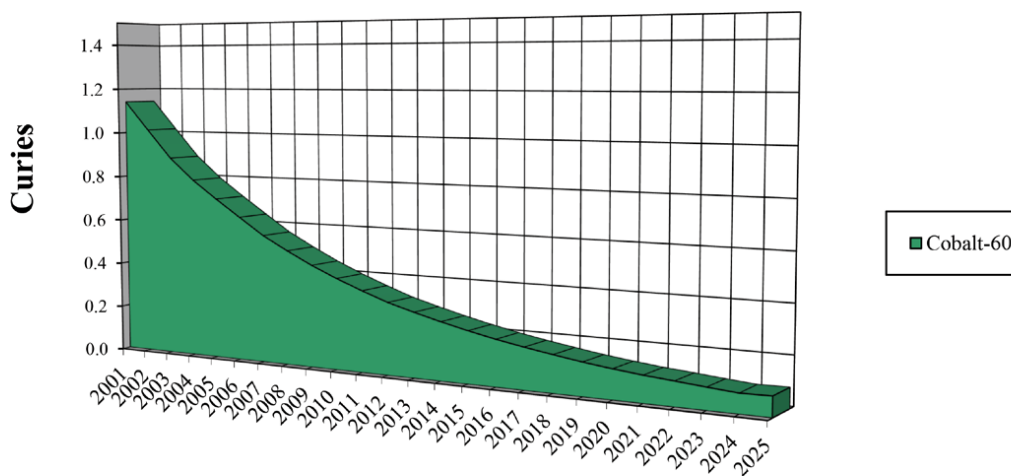

ASSUMPTIONS:

1. Radioactive decay is the only mechanism for removal from the Main Cooling Reservoir.
2. The initial time for calculating the remaining radioactivity is July 1 of the year released.

Figure 6-7

Cesium-137 was measured in four out of four bottom sediment samples from Stations #215 and #216 in the Main Cooling Reservoir in 2025. The highest measurement was 89.6 pCi/kg at Station #216 and 40.4 pCi/kg at Station #215. Cesium-137 is often found in environmental media including soil and sediment as residual radio active material resulting from above ground nuclear weapons testing conducted in the 1950's and 1960's. Soil and sediment samples taken in 1986 and 1987 prior to operation of the South Texas Project contained cesium-137 from

weapons testing. The average pre-operational cesium-137 concentration was 118 pCi/kg in soil and sediment samples, and the highest sample concentration was 383 pCi/kg. Cesium-137 activities measured at Station #215 and #216 in 2025 were consistent with previously detected radioactivity due to sampling non-homogeneous media and are consistent with pre-operational concentrations reduced by 30 years of radioactive decay. Results remained considerably less than reportable levels.



Photo courtesy of Karl Villa



Photo courtesy of Greg McMullin

WATERBORNE PATHWAY

Tritium has been detected in the shallow aquifer on the south side of the Main Cooling Reservoir since 1999. Models used when licensing the site predicted tritium in the shallow aquifer. These models were validated with additional studies in 2013. A site conceptual model, initially developed in 2008 and updated in 2014, 2018 and 2023, validated the original predictions of the site hydrology study. The revision in 2018 included the Independent Spent Fuel Storage Installation Project construction.

Tritium is a radioactive isotope of hydrogen and is produced in the reactors during plant operation. Wastewater is treated to remove impurities before release, but tritium cannot

be removed because it is chemically part of the water molecule. Some of the tritium is released into the atmosphere and the remainder is released into the Main Cooling Reservoir. The tritium escapes from the Main Cooling Reservoir by evaporation, movement into the shallow aquifer, and by percolation from the relief wells which are a part of the reservoir embankment's stabilization system. Figure 6-8 shows the amount of tritium released to the Main Cooling Reservoir each year and the amount present during the last quarter of each year.

The concentration of tritium in the Main Cooling Reservoir was relatively stable in 2025. The amount of tritium measured in the

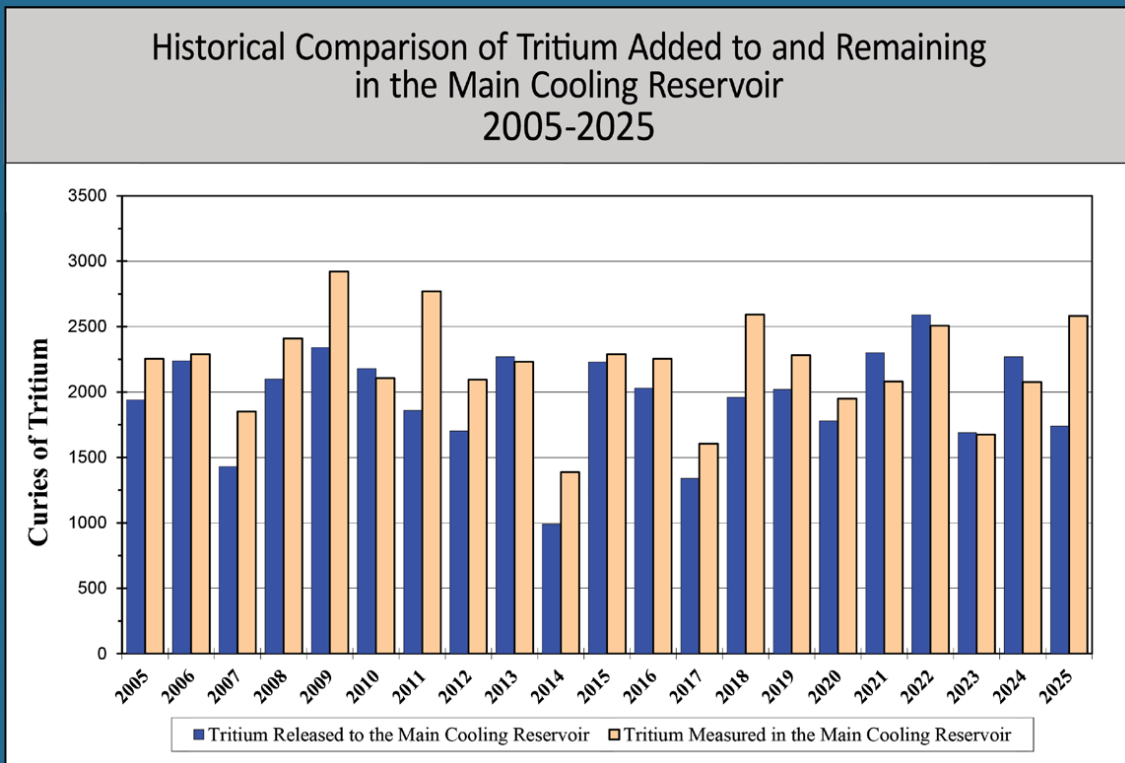


Figure 6-8



Photo courtesy of Gary Parkey

Main Cooling Reservoir was consistent with the amount usually released to the reservoir. The amount of rainfall and reservoir makeup from the Colorado River influences the concentration of tritium in the Main Cooling Reservoir and the shallow aquifer surrounding it. Tritium enters the sloughs and ditches of the site as runoff from the relief wells that surround the reservoir. In 2025, tritium levels remained consistent with historical values in the relief wells as shown in Figure 6-9. Sampling of Main Cooling Reservoir relief

well #701 has been discontinued due to no water flow at that location. Another existing Main Cooling Reservoir relief well #707, is now used as a representative substitute for sampling the relief well water from the Main Cooling Reservoir. Station #707 is just west of the discontinued relief well #701 on the south side of the Main Cooling Reservoir. Due to different flow rates of water through the relief wells, the base concentration is slightly higher at relief well #707 compared to #701. The highest 2025 sample from relief well #707 indicated approximately 5,777 pCi/kg, which is less than required reporting levels.

The tritium concentrations in eight surface water sample locations from 2001 through 2025 are shown in Figure 6-10. The specific sample point locations can be found in Table 2. Tritium levels in the onsite sloughs and ditches vary with the concentration in the reservoir and the amount of rainfall received. The average tritium concentration in the relief well, sloughs, and ditches is less than the reservoir because the water is diluted as it migrates through the reservoir relief well system. In 2025, four of twelve required surface water sample locations tested positive for tritium. All test results were below the United States Environmental Protection Agency drinking water limit of 20,000 pCi/kg.

Rainwater was collected and analyzed during 2025 to determine if the tritium from the reservoir precipitated in the local area. Tritium was not measured in any of the rainwater samples offsite.

Tritium was identified in the shallow (i.e., ten to thirty feet deep) aquifer test wells at Station #235 approximately seventy-five yards south of the reservoir embankment

The amount of rainfall and reservoir makeup from the Colorado River influences the concentration

base during 1999. Starting in 2000, samples were collected from the shallow aquifer well at Station #251 south of the Main Cooling Reservoir. The tritium results from these two shallow aquifer wells are shown in Figure 6-11. In 2025, the concentration of tritium at Station #235 was consistent with values over the past years. The highest Tritium levels continued to remain below the United States Environmental Protection Agency drinking water limit concentration for wells in the owner-controlled area was 5,350 pCi/kg in 2025 at Station #251. Tritium levels continued to

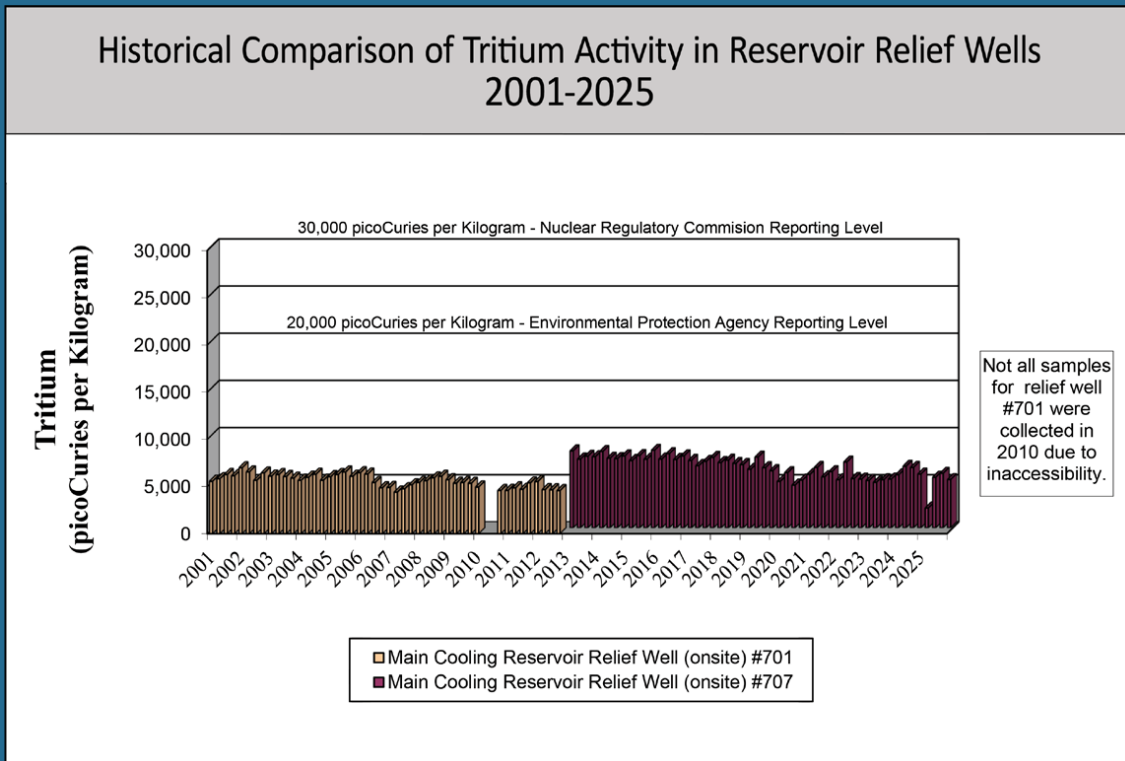


Figure 6-9

remain below the United States Environmental Protection Agency drinking water limit (20,000 pCi/kg).

Shallow aquifer tritium concentrations have remained near the concentrations found in the relief wells. Wells at Stations #258 and #259 on the west side of the site boundary have been sampled since 2006. Wells at Stations #270 and #271 were installed during the last quarter of 2008. The sample results are shown in Figure 6-12. The well at Station #271, located adjacent to site property on a county road easement directly west of the Main Cooling Reservoir, indicated its highest concentration for 2025 at 702 pCi/kg. In 2025, a maximum value of 4,420 pCi/kg was identified for onsite test wells in the protected area at Station # 903. Tritium levels continued to remain below the United States Environmental Protection Agency drinking water limit (20,000 pCi/kg).

Tritium has not been detected in the deep aquifer that is the source of drinking water for the local communities and homes. These measurements follow the hydro-logical model described in the original license basis and the updated site conceptual model discussed earlier in this section.

The drinking water onsite is pumped from



Photo courtesy of Karl Villa

deep aquifer wells and is collected monthly and composited quarterly to verify tritium is not present. The South Texas Project does not use water from the reservoir, shallow aquifers, or other surface water for drinking. If the water with the highest tritium concentration that leaves the site was used for drinking, the maximum dose to an individual would be less than one millirem in a year. This dose is insignificant compared to the

approximately 620 millirem the public receives a year from natural radioactivity in the environment and the radiation received from medical procedures.³

Other samples are collected and analyzed in addition to those required by our licensing documents or internal procedures. These samples are collected to give additional assurance that the public and the environment

Continued on p.6-14

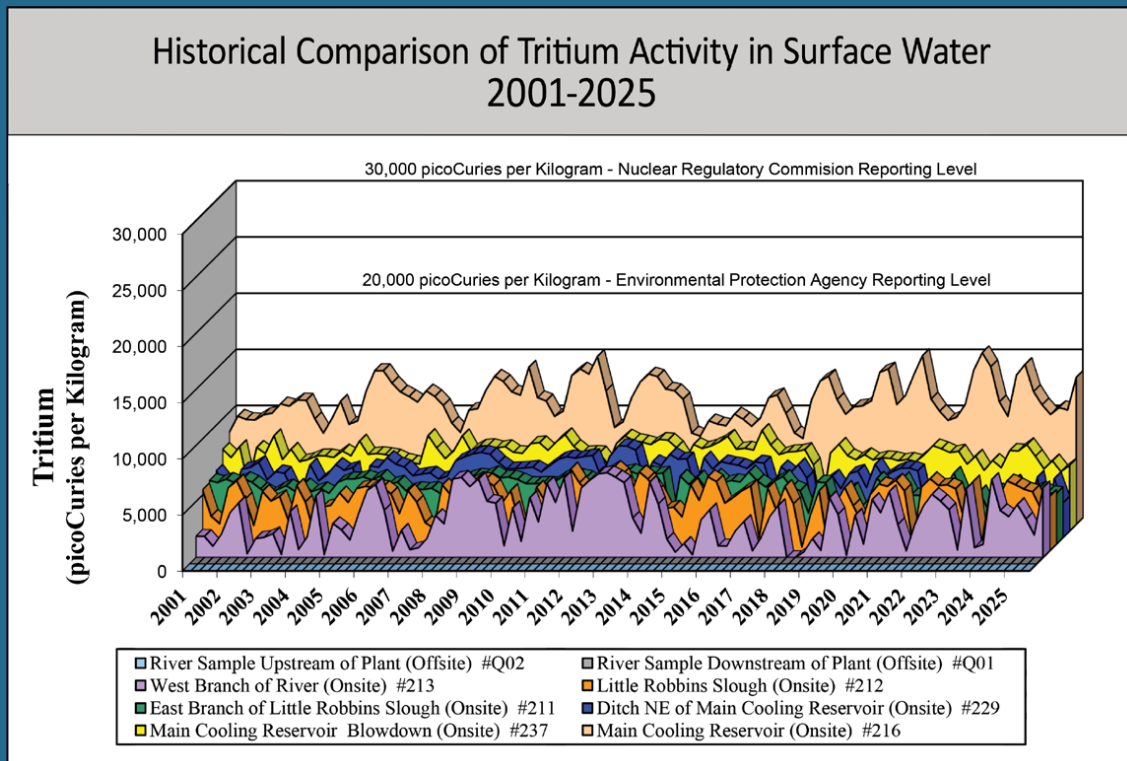


Figure 6-10

Historical Comparison of Tritium Activity in Shallow Aquifer Ground Water 2001-2025

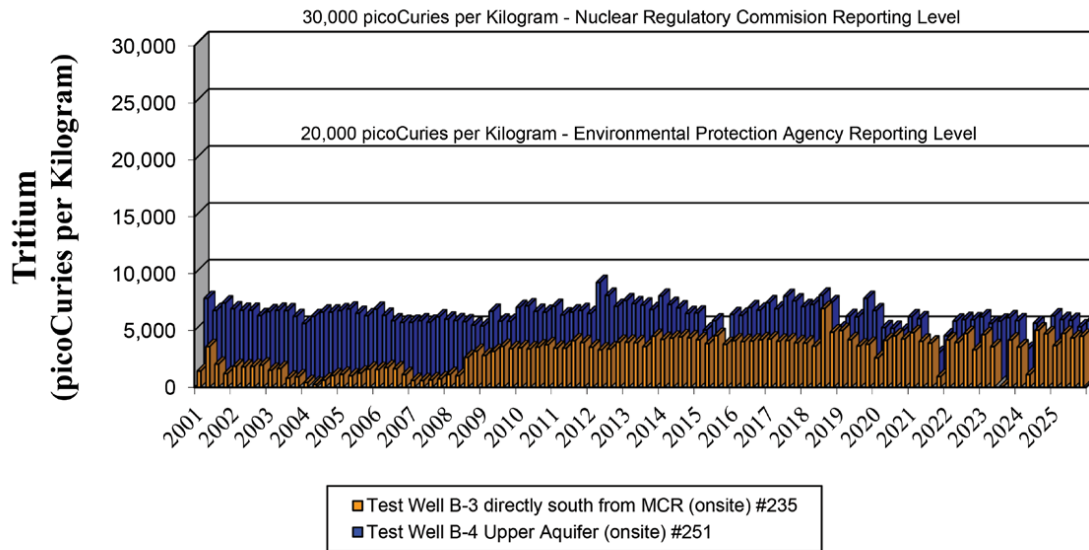


Figure 6-11

Tritium Activity in Shallow Ground Water West of the Main Cooling Reservoir 2006-2025

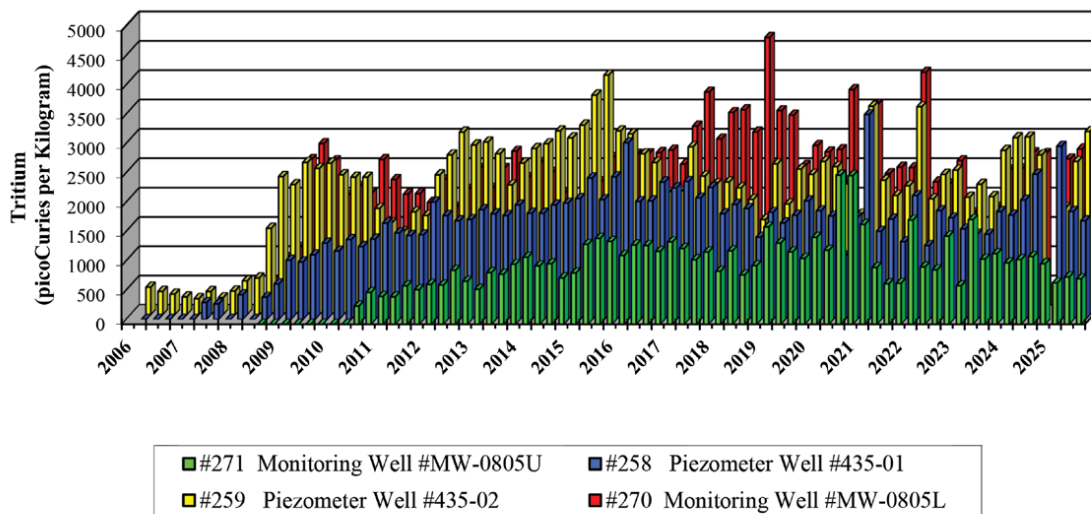


Figure 6-12



Photo courtesy of Greg McMullin

are protected from any adverse effects from the plant. These samples include pasture grass, sediment samples, rainwater, shallow aquifer well, water from various ditches and sloughs onsite, direct radiation, and air samples near communities or other areas of interest. The results of these analyses indicate that plant operation has no health impact offsite and is well within state and federal regulations and guidelines.

³NCRP (2006). *National Council on Radiation Protection and Measurements, Ionizing Radiation Exposure of the Population of the United States*, (Bethesda, Maryland), NCRP Report No. 160.

NEI GROUNDWATER PROTECTION INITIATIVE

In 2007, the Nuclear Energy Institute (NEI) established a standard for monitoring and reporting radioactive isotopes in groundwater entitled NEI Groundwater Protection Initiative, NEI 07-07. The station implemented the recommendations of this industry standard and has broadened the ground-water monitoring program to include additional samples collected near the plants. Some of the positive results of this broadened monitoring program reflect tritium associated with the Main Cooling Reservoir.

Wells near the plants are sampled semi-annually, annually, or once every five years depending on the concentration of tritium anticipated and the location of the wells. Wells with high concentrations are sampled more frequent over a five-year period which follow STP procedure requirements. Figure 6-13 contains the 2025 results

for wells that were sampled along with the historical highs measured prior to 2025 for each station since sampling began in 2006. Their locations are shown in Figure 6-14.

Two wells sampled annually (Stations #807 and #808) are adjacent to where a pipe was damaged and repaired several years ago. The Tritium concentration at these two wells

Continued on p.6-16

NEI GROUND WATER PROTECTION INITIATIVE

Sample station (well)	2025 Measurements (pCi/Kg)	Historical Interest (pCi/Kg)
842	3402	1880
844	395	426
901	0	399
902	0	513
903	4200	445
904	4300	1027
905	539	576

Note: All measurements are reported in pCi/kg for increased accuracy and are equivalent to pCi/L for reporting purposes.

Figure 6-13

STP PROTECTED AREA GROUND WATER MONITORING WELLS

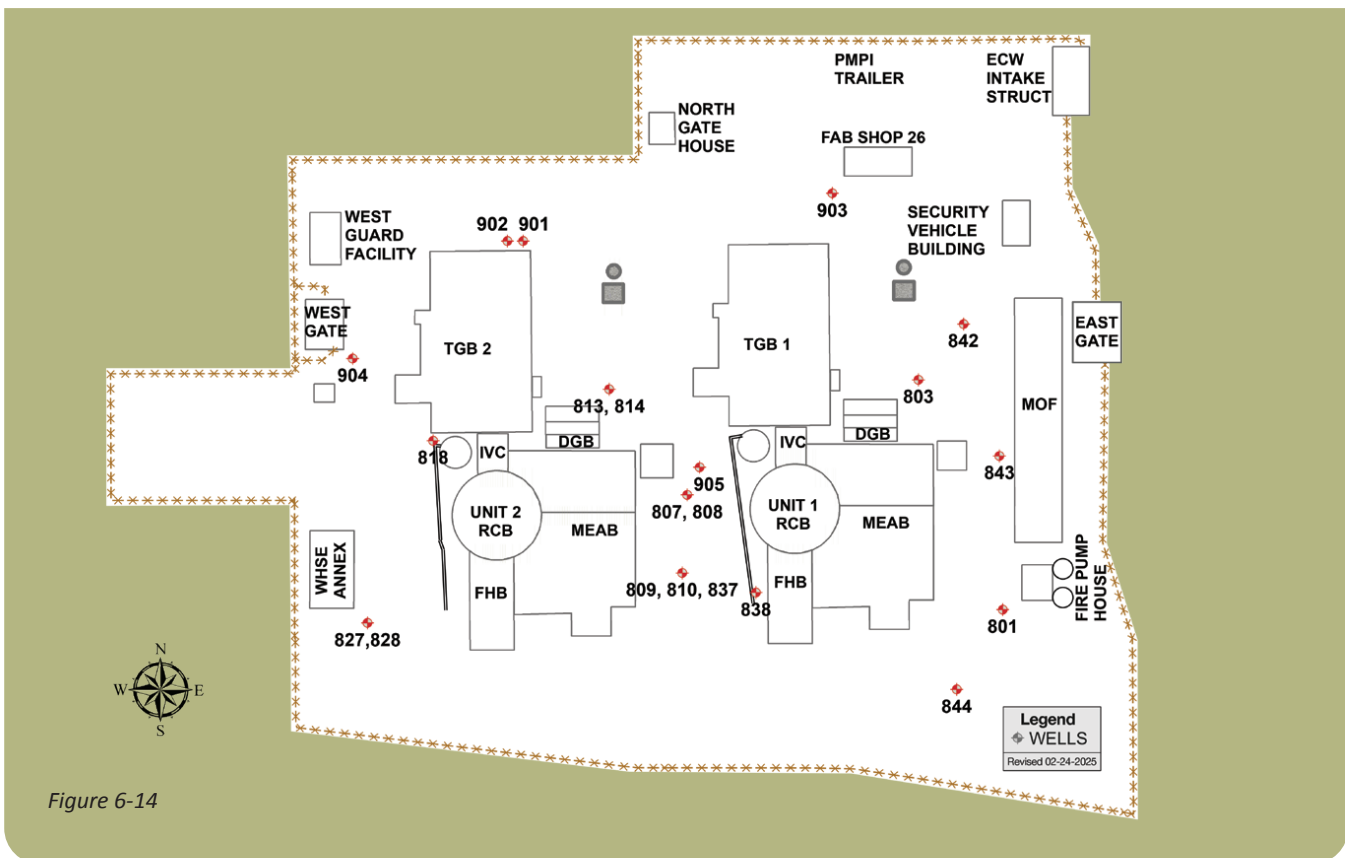


Figure 6-14



continued to decrease as expected in 2025. Station #809 tritium concentrations were related to the previously referenced pipe and subsequent repair. All the wells sampled in 2025 that had detectable tritium are influenced by groundwater originating in the Main Cooling Reservoir. Their concentrations remain in the range of groundwater tritium concentrations associated with the Main Cooling Reservoir. All the 2025 measurements of tritium in groundwater are a small fraction of the United States Environmental Protection Agency drinking water limit (20,000 pCi/kg).

During 2012, steam traps for the auxiliary steam system that could potentially contain trace amounts of tritium were modified to re-direct the condensed steam or liquid water to the Main Cooling Reservoir. Information regarding the steam traps and subsequent response was documented in the station's condition reporting process.

This evaluation identified no new effluent release pathways and no impact to the drinking water or the health and safety of the public.

By the end of 2014, the majority of the protected area wells had undergone a modification to enhance the protection of the structural integrity of the water well casing used for sampling the upper aquifer. The modifications were completed in 2016 with continued improvements. Five new groundwater wells were installed inside the protected area at STP to help model the

hydrological contour in the upper and lower shallow aquifer. These wells numbered from 901 through 905 were selected in different locations and depths.

In 2025, there were two occurrences where less than a few gallons of secondary system water system contacted the ground onsite through a steam leak. This occurrence did not result in impact to the public or the environment. No discharge occurred offsite or to groundwater that may be used as a source of drinking water. Where applicable, the water was quickly recovered, recaptured, and clean up completed with no impact to groundwater.

LAND USE CENSUS

The Annual Land Use Census is performed to determine if any changes have occurred in the location of residents and the use



Photo courtesy of Christie Dement

of the land within five miles of the South Texas Project. The information is used to determine whether any changes are needed in the Radiological Environmental Monitoring Program. The census is performed by contacting local government agencies that provide the information.

In addition, a survey is performed to verify the nearest residents within five miles of the South Texas Project generating units in each of 16 sectors. The results of the survey indicated no changes for 2025. The eleven sectors that have residents within five miles and the distance to the nearest residence in each sector are listed at left.

LAND USE CENSUS 11 SECTORS

SECTOR	DISTANCE (MILES)	LOCATION
ENE	4.5	CR 232 (Ryman Rd.)
ESE	3.5	Selkirk Dr.
SE	3.5	Selkirk Dr.
SW	4.5	CR 386 (Corporon Rd.)
SSW	4.5	CR 391 (Robbins Slough Rd.)
WSW	2.5	CR 358
W	4.5	FM 1095
WNW	4.5	CR 356 (Ashby-Buckeye Road)
NW	4.5	CR 354 (Mondrik Road)
NNW	3.0	Runnells Ranch – RM 1468
N	3.0	Runnells Ranch – RM 1468

QUALITY ASSURANCE

Quality assurance encompasses planned and systematic actions to ensure that an item or facility will perform satisfactorily. Reviews, surveillances, and audits have determined that the programs, procedures, and personnel are performing at a satisfactory level.

Quality audits and independent technical reviews help to determine areas that need attention. These areas are addressed in accordance with the station's Condition Reporting Process.

The measurement capabilities of the Radiological Laboratory are demonstrated by participating in an inter-laboratory measurement assurance program as well as performing duplicate and split sample analyses. Greater than 19 percent of the analyses performed are quality control samples. These consist of interlaboratory measurement assurance program samples, duplicate samples, and split samples. All analyses include Department of Energy's Mixed Analyte Performance Evaluation Program samples, blanks, intercomparison

Continued on p.6-18

LAND USE CENSUS ITEMS OF INTEREST

- No commercial dairies operate within Matagorda County.
- There were no identified animals producing milk for human consumption located within five miles of STP.
- A commercial olive tree orchard is located approximately 4.9 miles WSW of the plant is capable of producing olives for commercial use.
- One commercial fish farm continues to operate. It is located approximately four to

five miles southwest of the plant located in the area north of Robbins Slough Road and east of South Citrus Grove Road. The water supply for the ponds is not affected by the operations of the South Texas Project.

- Colorado River water from below the Bay City Dam has not been used to irrigate crops.
- There were no identified commercial vegetable farms located within five miles of STP.

- Broadleaf vegetation sampling is performed at the site boundary in the three most leeward sectors and at a control location in lieu of a garden census. The broadleaf vegetation samples collected also satisfy the collection requirement when milk samples are not available.

2025 Radiological Laboratory Quality Assurance Program Performance

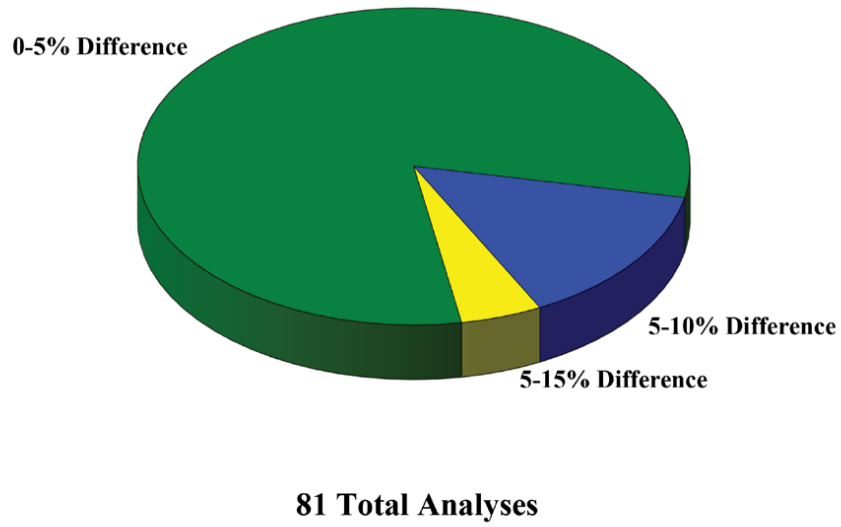


Figure 6-15

Duplicate & Split Agreement of Environmental Samples in 2025

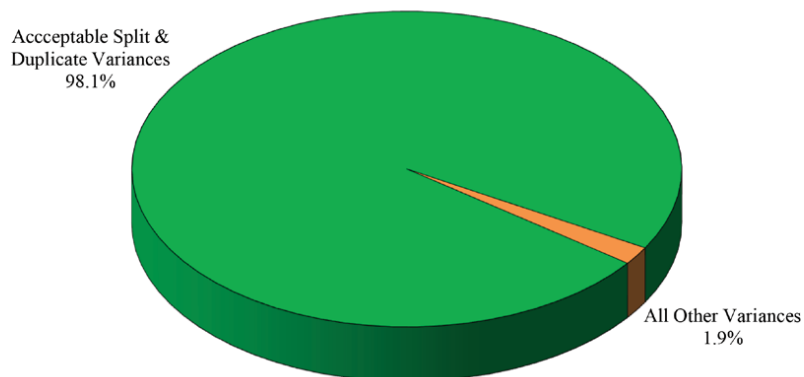


Figure 6-16



Photo courtesy of Greg McMullin

testing, duplicates and splits with over 1,250 samples analyzed for 2025.

The interlaboratory measurement assurance program provides samples that are similar in matrix and size to those measured by the Radiological Environmental Monitoring Program. This program assures that equipment calibrations and sample preparation methods

Generally, two samples split from the same original sample material should agree better

accurately measure radioactive material in samples. Figure 6-15 summarizes the results of the interlaboratory comparison programs.

Duplicate sampling of the environment allows the South Texas Project to estimate the repeatability of the sample collection, preparation, and analysis process. Splitting samples allows estimation of the precision and bias trends of the method of analysis without the added variables introduced by sampling. Generally, two samples split from the same original sample material should agree better than two separate samples collected in the same area and time. The 2025 variances for duplicates and splits are shown in Figure 6-16.

The census is performed by contacting local government agencies that provide the information.

PROGRAM DEVIATIONS

In addition to measurement accuracy, radiochemical measurements must meet

sensitivity requirements at the Lower Level of Detection for environmental samples. Deviations from the sampling program or sensitivity requirements must be acknowledged and explained in this report. The loss of a small fraction of the total samples collected in 2025 did not impact the ability to demonstrate that the South Texas Project continues to operate with no negative effect on the population or the environment.

During 2025 samples not collected or unacceptable for analysis: A windmill-powered well, Station #267, was not able to be sampled in 2025 because it was not operational. This onsite ground water sample station is the most distant location from the Main Cooling Reservoir that Tritium has been detected.

The census is performed by contacting local government agencies that provide the information.

This well is not used for human consumption.

- Two out of 260 Offsite Dose Calculation Manual (ODCM) required air sample were not collected due to loss of power from Station #01.
- Several air samples not required by the ODCM were not continuously collected for the full-time interval because of power or equipment failures from Station #06 and duplicate Station #6.
- There was one instance where water sample could not be collected from Station # 267 because the windmill was not operational and could not provide any water for sampling. This is the second year this sample could not be collected for analysis.

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

A summary of all required samples is given in Table 3. The table has been formatted to resemble a United States Nuclear Regulatory Commission industry standard. Modifications have been made for the sole purpose of reading ease. Only positive values are given in this table.

The medium type is printed at the top left of each table, and the units of measurement are printed at the top right. The first column lists the type of radioactivity or specific radionuclide for which each sample was analyzed. The second column gives the total number of analyses performed and the total number of non-routine analyses for each indicated nuclide. A non-routine measurement is a sample whose measured activity is greater than the reporting levels for Radioactivity Concentrations in Environmental Samples.

The “LOWER LIMIT OF DETECTION” column lists the normal measurement sensitivities achieved. The sensitivities were better than required by the United States Nuclear Regulatory Commission.



Photo courtesy of Greg McMullin

A set of statistical parameters is listed for each radionuclide in the remaining columns. The parameters contain information from the indicator locations, the location having the highest annual mean, and information from the Control Stations. Some sample types do not have Control Stations. When this is the case, “no samples” is listed in the control location column.

Continued on p.6-20



For each of these groups of data, the following is calculated:

- The mean positive values
- The number of positive measurements/ the total number of analyses
- The lowest and highest values for the analysis

STP followed the American National Standard Institute (ANSI)/Health Physics Society (HPS) N13.37 methodology

The data placed in Table 3 are from the samples required by the site's Offsite Dose Calculation Manual as described in Table 1. Additional BeOSL dosimeters were utilized each quarter for quality control purposes. The minimum samples required by Table 1 were supplemented in 2025 by numerous direct radiation measurements, additional surface water samples, ground water samples, additional pasture grass, additional rainwater samples, additional relief well water samples, and additional sediment samples. Fish and crustacean samples vary in number according to availability, but exceeded the minimum

number required by Table 1, as well as other meat samples. Also, numerous air station samples were collected from weekly air sample stations, in addition to the minimum number of samples required by Table 1 to strengthen the Radiological Environmental Monitoring Program.

The minimum required Radiological Environmental Monitoring Program is presented in Table 1. The table is organized by exposure pathway. Specific requirements such as location, sampling method, collection frequency, and analyses are given for each pathway.

STP followed the American National Standard Institute (ANSI)/Health Physics Society (HPS) N13.37 methodology from 2015 to 2025 using Panasonic thermoluminescent dosimeters (TLD) and beryllium oxide optically stimulated luminescence (BeOSL) for measurement of Direct Radiation. Quarterly Facility Dose was Not Detected (ND) for each of these Direct Radiation stations for 2025 as the values minus the baseline were less than five mrem, minimal detectable activity. These values were considered below background values (see chart on page 6-22).



Photo courtesy of William Sharpe



Photo courtesy of Greg McMullin



CHART 1 ANSI/HPS N13.37 STP ENVIRONMENTAL DOSIMETRY RESULTS

Station ID	Distance	Historical Bq Quarterly Baseline* (mrem)	Bq + MDDq (mrem)	2025 Normalized Net Dose				2025 Quarterly Facility Dose, Fq "ND" if Fq<=NDDq otherwise mrem				Annual Baseline Ba (mrem)	Ba +MDDa (mrem)	Annual Monitoring Dose Ma (mrem per year)	2025 Annual Facility Dose, Fa=Ma-Ba (mrem, or "ND" if Fa<=MDDa) Dose, Fa
				Mq (mrem per Std Qtr)	Qtr 1	Qtr 2	Qtr 3	Qtr 4	Qtr 1	Qtr 2	Qtr 3				
1	1 mile N	17.0	22.0	19.0	17.0	21.0	10.0	ND	ND	ND	ND	68.2	78.2	67.0	ND
2	1 mile NNE	17.4	22.4	15.0	16.0	15.0	17.0	ND	ND	ND	ND	69.6	79.6	63.0	ND
3	1 mile NE	18.0	23.0	24.0	11.0	15.0	15.0	6.0	ND	ND	ND	71.8	81.8	65.0	ND
4	1 mile ENE	17.6	22.6	15.0	12.0	13.0	15.0	ND	ND	ND	ND	70.4	80.4	55.0	ND
5	1 mile E	17.9	22.9	16.0	13.0	17.0	13.0	ND	ND	ND	ND	71.5	81.5	59.0	ND
6	3.5 miles ESE	18.6	23.6	21.0	15.0	18.0	21.0	ND	ND	ND	ND	74.5	84.5	75.0	ND
7	3.5 miles SE	15.8	20.8	13.0	11.0	12.0	16.0	ND	ND	ND	ND	63.2	73.2	52.0	ND
8	0.25 mile SSE	15.0	20.0	16.0	10.0	12.0	12.0	ND	ND	ND	ND	60.2	70.2	50.0	ND
9	0.25 mile S	18.1	23.1	14.0	14.0	17.0	17.0	ND	ND	ND	ND	72.5	82.5	62.0	ND
10	0.25 mile SSW	15.2	20.2	14.0	6.0	14.0	17.0	ND	ND	ND	ND	60.8	70.8	51.0	ND
11	0.5 mile SW	15.6	20.6	10.0	14.0	14.0	11.0	ND	ND	ND	ND	62.4	72.4	49.0	ND
12	1.5 mile WSW	17.1	22.1	13.0	18.0	16.0	14.0	ND	ND	ND	ND	68.4	78.4	61.0	ND
13	1.5 mile W	20.4	25.4	19.0	15.0	19.0	19.0	ND	ND	ND	ND	81.6	91.6	72.0	ND
14	1.5 mile WNW	19.4	24.4	21.0	19.0	15.0	20.0	ND	ND	ND	ND	77.6	87.6	75.0	ND
15	1 mile NW	17.5	22.5	22.0	12.0	16.0	18.0	ND	ND	ND	ND	70.0	80.0	68.0	ND
16	1 mile NNW	17.5	22.5	18.0	13.0	21.0	12.0	ND	ND	ND	ND	70.0	80.0	64.0	ND
17	6.5 miles N	17.6	22.6	15.0	18.0	12.0	11.0	ND	ND	ND	ND	70.5	80.5	56.0	ND
18	5.5 miles NNE	17.5	22.5	23.0	12.0	15.0	15.0	5.5	ND	ND	ND	70.0	80.0	65.0	ND
19	5.5 miles NE	17.4	22.4	18.0	21.0	11.0	14.0	ND	ND	ND	ND	69.6	79.6	64.0	ND
20	5 miles ENE	19.1	24.1	18.0	20.0	19.0	16.0	ND	ND	ND	ND	76.5	86.5	73.0	ND
21	5 miles E	17.7	22.7	17.0	18.0	13.0	15.0	ND	ND	ND	ND	70.6	80.6	63.0	ND
22	7 miles E	17.1	22.1	16.0	15.0	10.0	16.0	ND	ND	ND	ND	68.5	78.5	57.0	ND
23	16 miles ENE	19.2	24.2	17.0	16.0	16.0	18.0	ND	ND	ND	ND	76.8	86.8	67.0	ND
24	4 miles SSE	15.5	20.5	15.0	11.0	12.0	9.0	ND	ND	ND	ND	61.9	71.9	47.0	ND
25	4 miles S	16.0	21.0	14.0	11.0	11.0	11.0	ND	ND	ND	ND	64.2	74.2	47.0	ND
26	4 miles SSW	15.8	20.8	15.0	12.0	9.0	16.0	ND	ND	ND	ND	63.0	73.0	52.0	ND
27	2.5 miles SW	16.3	21.3	17.0	8.0	12.0	14.0	ND	ND	ND	ND	65.1	75.1	51.0	ND
28	5 miles WSW	17.6	22.6	24.0	13.0	16.0	14.0	6.4	ND	ND	ND	70.4	80.4	67.0	ND
29	4.5 miles W	19.2	24.2	27.0	18.0	18.0	15.0	7.8	ND	ND	ND	76.8	86.8	78.0	ND
30	6 miles WNW	16.6	21.6	14.0	10.0	19.0	13.0	ND	ND	ND	ND	66.5	76.5	56.0	ND
31	5.5 miles NW	16.7	21.7	13.0	10.0	12.0	14.0	ND	ND	ND	ND	66.9	76.9	49.0	ND
32	3.5 miles NNW	16.9	21.9	12.0	15.0	16.0	17.0	ND	ND	ND	ND	67.7	77.7	60.0	ND
33	14 miles NNE	17.6	22.6	24.0	14.0	12.0	9.0	6.4	ND	ND	ND	70.3	80.3	59.0	ND
34	7.5 miles ENE	16.8	21.8	22.0	12.0	11.0	10.0	5.2	ND	ND	ND	67.2	77.2	55.0	ND
35	8.5 miles SSE	16.8	21.8	11.0	11.0	16.0	13.0	ND	ND	ND	ND	67.0	77.0	51.0	ND
36	9 miles WSW	16.8	21.8	22.0	8.0	19.0	18.0	5.2	ND	ND	ND	67.3	77.3	67.0	ND
37	10 miles WSW	16.9	21.9	13.0	8.0	14.0	9.0	ND	ND	ND	ND	67.7	77.7	44.0	ND
38	10.5 miles NW	15.7	20.7	17.0	9.0	12.0	7.0	ND	ND	ND	ND	62.8	72.8	45.0	ND
39	9 miles NW	18.8	23.8	24.0	15.0	16.0	13.0	5.2	ND	ND	ND	75.2	85.2	68.0	ND
40	4.5 miles SW	17.1	22.1	24.0	14.0	14.0	14.0	6.9	ND	ND	ND	68.3	78.3	66.0	ND
41	2.0 miles ESE	16.0	21.0	29.0	13.0	11.0	10.0	13.0	ND	ND	ND	63.9	73.9	63.0	ND
43	4.5 miles SE	17.8	22.8	24.0	14.0	15.0	10.0	6.2	ND	ND	ND	71.0	81.0	63.0	ND

MDDq = 5 mrem, MDDa = 10 mrem ND = Not Detected MDDq = the quarterly minimum detectable dose values used is 5 mrem

Baseline background dose (Bq or Ba): The estimated mean background radiation dose at each field monitoring location in a specified time period as Bq for mrem on a quarterly basis or Ba for annual basis, based on historical measurements, excluding any dose contribution from the monitored facility.

Facility Related dose (Fq or Fa) mrem: The dose received by a field dosimeter at a monitoring location due to radiation from the monitored facility. Facility related dose excludes the background radiation dose, which is estimated by use of the baseline background dose. The facility related dose can be calculated for those monitoring locations where the normalized quarterly field doses Mq (or normalized annual dose

Quarterly facility related (Fq): If $Mq > (Bq + MDDq)$ then $Fq = Mq - Bq$ If $Mq \leq (Bq + MDDq)$ then $Fq =$ not detected

Annual facility related dose (Fa): If $Ma > (Ba + MDDa)$ then $Fa = Ma - Ba$ If $Ma \leq (Ba + MDDa)$ then $Fa =$ not detected

Minimum differential dose (MDDx): the smallest amount of facility related dose at each monitored location in a specified time period (x), above the baseline background dose that can be reliably detected by an environmental dosimetry system. MDDq is the quarterly or MDDa is the annual minimum differential dose. Due to natural background variations and measurements sensitivities and uncertainties, the minimum differential dose is greater than zero. As it is based on field results, the minimum differential dose is distinct from the minimum quantifiable dose which is based on laboratory irradiations.

Normalized quarterly field dose (Mq): Measured field dose (Mf) adjusted to a standardized 91 day period of time. This correction adjusts for the actual number of days of field deployment, which could vary depending on such factors as weather, staff availability, holidays, and the fact that the number of days in a year is not exactly divisible by four. The normalized quarterly field dose is given by: $Mq = Mf \times (91 \text{ days} / \text{no. of days in field})$. The corresponding normalized annual dose Ma is then the sum of the four normalized quarterly doses.

Minimum quantifiable dose (MqD): The smallest delivered dose above which the measurement process can provide results with a standard deviation that is less than or equal to 7% of the delivered dose. In this standard, the minimum quantifiable dose is determined for measurements of dose delivered from the minimum differential dose for facility related radiation.

Photo courtesy of Bradley Batchelder



**TABLE 1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

EXPOSURE: **DIRECT RADIATION**

40 TOTAL SAMPLING STATIONS

Sample Media, Number, Approximate Location and Distance of Sample Stations from Containment.	Routine Sampling Mode	Sampling and Collection Frequency	Analysis Type	Minimum Analysis Frequency
<p>Exposure Media: TLD</p> <p><u>16</u>- Located in all 16 meteorological sectors, 0.2* to 4 miles.</p> <p><u>16</u>- Located in all 16 meteorological sectors, 2 to 7 miles.</p> <p><u>6</u>- Located in special interest areas (e.g. school, population centers), within 14 miles.</p> <p><u>2</u>- Control stations located in areas of minimal wind direction (WSW,ENE), 10-16 miles.</p>	Continuously	Quarterly	Gamma dose	Quarterly

*The inner ring of stations in the southern sectors are located within 1 mile because of the main cooling reservoir

EXPOSURE: **AIRBORNE**

5 TOTAL SAMPLING STATIONS

Sample Media, Number, Approximate Location, and Distance of Sample Stations from Containment.	Routine Sampling Mode	Nominal Collection Frequency	Analysis Type	Minimum Analysis Frequency
<p><u>Charcoal and Particulate Filters</u></p> <p><u>3</u>- Located at the exclusion zone, N, NNW, NW Sectors, 1 mile.</p> <p><u>1</u>- Located in Bay City, 14 miles.</p> <p><u>1</u>- Control Station, located in a minimal wind direction (WSW), 10 miles.</p>	Continuous sampler operations	Weekly or more frequently if required by dust loading	<p><u>Radioiodine Canister</u>: I-131</p> <p><u>Particulate Sampler</u>: Gross Beta Activity Gamma- Isotopic of composite (by location)</p>	<p>Weekly</p> <p>Following filter change</p> <p>Quarterly</p>

EXPOSURE: **WATERBORNE**

13 TOTAL SAMPLING STATIONS

Sample Media, Number And Approximate Location of Sample Stations	Routine Sampling Mode	Nominal Collection Frequency	Analysis Type	Minimum Analysis Frequency
<p><u>Surface</u></p> <p><u>1</u>- Located in MCR at the MCR blowdown structure.</p> <p><u>1</u>- Located above the site on the Colorado River not influenced by plant discharge (control).</p> <p><u>1</u>- Located downstream from blow down entrance into the Colorado River.</p> <p><u>Ground</u></p> <p><u>5</u>- Located in wells used to monitor tritium migration in the shallow aquifer.</p> <p><u>Drinking Water</u></p> <p><u>1</u>- Located on site. *</p> <p><u>1</u>- Located at a control station.</p> <p><u>Sediment</u></p> <p><u>1</u>- Located above the site on the Colorado River, not influenced by plant discharge.</p> <p><u>1</u>- Located downstream from blowdown entrance into the Colorado River.</p> <p><u>1</u>- Located in MCR.</p>	<p>Composite sample over a 1 month period (grab if not available)</p> <p>Grab</p> <p>Grab</p> <p>Grab</p>	<p>Monthly</p> <p>Quarterly</p> <p>Monthly</p> <p>Semiannually</p>	<p>Gamma-Isotopic</p> <p>Tritium</p> <p>Gamma-Isotopic & Tritium</p> <p>Gross Beta & Gamma-Isotopic Tritium</p> <p>Gamma-Isotopic</p>	<p>Monthly</p> <p>Quarterly Composite</p> <p>Quarterly</p> <p>Monthly</p> <p>Quarterly Composites</p> <p>Semiannually</p>

*No municipal water systems are affected by STP. This sample taken from deep aquifer supplying drinking water to employees while at work.
MCR-STP Main Cooling Reservoir
STP-South Texas Project

Photo courtesy of Karl Villa



**TABLE 1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (CONT.)**

EXPOSURE: **INGESTION**

Z TOTAL SAMPLING STATIONS

Sample Media, Number And Approximate Location of Sample Stations	Routine Sampling Mode	Nominal Collection Frequency	Analysis Type	Minimum Analysis Frequency
<u>Milk</u> *	Grab	Semi-monthly when animals are on pasture; monthly at other times.	Gamma-Isotopic And Low Level I-131	Semi-monthly when animals are on pasture; monthly at other times.
<u>Broadleaf Vegetation**</u> 2- Located at the exclusion zone, N, NW, or NNW sectors. 1- Located in a minimal wind direction.	Grab	Monthly during growing season (When available)	Gamma-Isotopic	As collected
<u>Fish and Invertebrates (edible portions)</u> 1- Representing commercially or recreational important species in vicinity of STP that maybe influenced by plant operation. 1- Same or analogous species in area not influenced by STP. 1- Same or analogous species in the MCR.	Grab	Sample semi-annually	Gamma-Isotopic on edible portions	As collected
<u>Agricultural Products</u> ***	Grab	At time of harvest	Gamma-Isotopic Analysis in edible portion	As collected
<u>Domestic Meat</u> 1- Represents domestic stock fed on crops grown exclusively within 10 miles of the plant.	Grab	Annually	Gamma-Isotopic	As collected

* Limited source of sample in vicinity of the South Texas Project. (Attempts will be made to obtain samples when available.)

** Three different kinds of broadleaf vegetation are to be collected over the growing season, not each collection period.

*** No sample stations have been identified in the vicinity of the site. Presently no agricultural land is irrigated by water into which liquid plant wastes will be discharged. Agricultural products will be considered if these conditions change.

**TABLE 2
SAMPLE MEDIA AND LOCATION DESCRIPTIONS**

AI	AIRBORNE RADIOIODINE	CS	CRUSTACEAN SHRIMP	MG	GOAT MILK	SO	SOIL
AP	AIRBORNE PARTICULATE	DR	DIRECT RADIATION	M1	BEEF MEAT	S1	SEDIMENT - SHORELINE
B1	RESIDENT DABBLER DUCK	F1	FISH - PISCIVOROUS	M2	POULTRY MEAT	S2	SEDIMENT - BOTTOM
B2	RESIDENT DIVER DUCK	F2	FISH - CRUSTACEAN & INSECT FEEDERS	M3	WILD SWINE	VB	ANY COMBINATION OF BROAD LEAF SAMPLES (L1 thru L7)
B3	MIGRATORY DABBLER DUCK	F3	FISH - PLANKIVORES & DETRITUS FEEDERS	M4	DOMESTIC SWINE	VP	PASTURE GRASS
B4	MIGRATORY DIVER DUCK	L1	BANANA LEAVES	M5	EGGS	WD	DRINKING WATER
B5	GOOSE	L2	CANA LEAVES	M6	GAME DEER	WG	GROUND WATER
B6	DOVE	L4	TURNIP GREENS	M7	ALLIGATOR	WR	RAIN WATER
B7	QUAIL	L5	CABBAGE	M8	RABBIT	WS	SURFACE WATER
B8	PIGEON	L6	COLLARD GREENS	OY	OYSTER	WW	(relief) WELL WATER
CC	CRUSTACEAN CRAB	L7	MUSTARD GREENS	R4	TURNIP		



**TABLE 2
SAMPLE MEDIA AND LOCATION DESCRIPTIONS (CONT.)**

Media Code	Station Code	Vector (Approximate)	Location
DR AI AP VB VP SO	001	1 mile N	FM 521
DR	002	1 mile NNE	FM 521
DR	003	1 mile NE	FM 521
DR	004	1 mile ENE	FM 521
DR	005	1 mile E	FM 521
DR AI AP SO	006	3.5 miles ESE	Site near Reservoir Makeup Pumping Facility
DR	007	3.5 miles SE	MCR Dike
DR	008	0.25 mile SSE	MCR Dike
DR	009	0.25 mile S	MCR Dike
DR	010	0.25 mile SSW	MCR Dike
DR	011	0.5 mile SW	MCR Dike
DR	012	1.5 mile WSW	MCR Dike
DR	013	1.5 mile W	FM 521
DR	014	1.5 mile WNW	FM 521
DR AI AP VB SO VP	015	1 mile NW	FM 521
DR AI AP VB SO VP	016	1 mile NNW	FM 521
DR	017	6.5 miles N	SE corner @ intersection of FM 1468 (Buckeye RD) and CR 306 (Brown RD)
DR AI AP SO	018	5.5 miles NNE	OXEA Corp. - FM 3057
DR	019	5.5 miles NE	FM 2668
DR	020	5 miles ENE	FM 2668 & FM 2078
DR	021	5 miles E	FM 521& FM 2668
DR	022	7 miles E	Lyondellbasell Chemical Plant on SH 60
DR	023*	16 miles ENE	Intersection of FM 521 and FM 2540
DR	024	4 miles SSE	MCR Dike
DR	025	4 miles S	MCR Dike
DR	026	4 miles SSW	MCR Dike
DR	027	2.5 miles SW	MCR Dike
DR	028	5 miles WSW	FM 1095 & Ellis Road (CR 380)
DR SO	029	4.5 miles W	FM 1095
DR	030	6 miles WNW	Tres Palacios Oaks, FM 2853
DR	031	5.5 miles NW	Wilson Creek Road
DR	032	3.5 miles NNW	FM 1468

◆ This station may be used to obtain the required aquatic samples in the vicinity of STP that may be influenced by plant operations.

MCR-STP Main Cooling Reservoir

STP-South Texas Project

Media codes typed in bold satisfy collection requirement described in Table 1.

Station codes typed in bold identify offsite locations.

*Control Station

**TABLE 2
SAMPLE MEDIA AND LOCATION DESCRIPTIONS (CONT.)**

Media Code	Station Code	Vector (Approximate)	Location
DR AI AP SO	033	14 miles NNE	Microwave Tower at end of Kilowatt road in Bay City
DR	034	7.5 miles ENE	Wadsworth Water Supply Pump Station on Main St.
DR AI AP SO	035	8.5 miles SSE	Matagorda on Fisher St.
DR	036	9 miles WSW	College Port on FM 1095
DR AI AP VB VP SO	037*	10 miles WSW	Palacios AEP Substation on Harrison Rd. (CR 323)
DR	038	10.5 miles NW	AEP Substation on SH 71 near Blessing (0.2 miles North of SH 35)
DR AI AP SO	039	9 miles NW	SH 35 under High Voltage lines
DR	040	4.5 miles SW	Citrus Grove Rd. (CR 385)
DR	041	2.0 miles ESE	MCR Dike
DR	043	4.5 miles SE	Site boundary just south of the spillway discharge channel
WG	205	4.0 miles SE	Piezometer Well #446A. Alternate for WG is Station Code 206
WG	206	4.0 miles SE	Piezometer Well #446
WS	209	2 miles ESE	Kelly Lake
WD	210	On Site	Approved drinking water supply from STP
WS S1 F(1, 2, or 3)	211 ♦	3.5 miles S	East Branch Little Robbins Slough
WS S1 F(1, 2, or 3)	212 ♦	4 miles S	Little Robbins Slough
WS S1	213	4 miles SE	West Branch Colorado River
F(1, 2, or 3) CC	214	2.5 miles SE	MCR at Makeup Water Discharge. Alternate for F(1, 2, or 3) in any location in the MCR
S2	215	0.5 mile SW	MCR at Circulating Water Discharge (S2 Alternate is any location in MCR)
WS S2	216	3.5 miles SSE	MCR at blowdown structure
WS S(1 OR 2) F(1, 2 or 3)	217 ♦	7-9 miles SSE	Mouth of Colorado River and Intracoastal Waterway (Region 1)
WS F(1, 2 OR 3)	218 ♦	6-9 miles SE-SSE	Colorado River between Intracoastal Waterway and station 227 (Region 2)
WS F(1, 2 OR 3)	219	3-6 miles E-SE	Colorado River between Station 227 and FM 521 (Region 3)
F(1, 2, or 3)	220	3-10 miles E-N	Colorado River between FM 521 and the LCRA Dam (Region 4)
S(1 or 2) F(1, 2 or 3) WS	221	>10 miles N-NE	Above the LCRA Dam (Region 5)
F(1, 2, or 3) CC CS OY	222 ♦	>10 miles	West Matagorda Bay
F(1, 2, or 3)	224	9 miles SSE	West Intracoastal Canal
F(1, 2, or 3)	225	9 miles SE	East Intracoastal Canal
WS S(1 or 2)	227 ♦	6 miles SE	West bank of Colorado River downstream of STP. Alternate for WS or S(1 or 2) is station 233

♦ This station may be used to obtain the required aquatic samples in the vicinity of STP that may be influenced by plant operations.
MCR-STP Main Cooling Reservoir
STP-South Texas Project
Media codes typed in bold satisfy collection requirement described in Table 1.
Station codes typed in bold identify offsite locations.
*Control Station

**TABLE 2
SAMPLE MEDIA AND LOCATION DESCRIPTIONS (CONT.)**

Media Code	Station Code	Vector (Approximate)	Location
WD	228*	14 miles NNE	Le Tulle Park Public Water Supply on SH 35
WS S1	229	2 miles ESE	Plant Area Drainage Ditch north of reservoir that empties into Colorado River
S(1 or 2)	230♦	3.5 miles ESE	Colorado River at point where drainage ditch (#229) empties into it
S(1 or 2) WS	233♦	4.5 miles SE	Colorado River approx. 0.5 km south of the Spillway discharge channel empties into it.
WG	235	4 miles S	Well B-3 directly south from MCR
B8	236	N/A	STP Protected Area
WS	237	3.7 miles SSE	Spillway discharge channel from MCR
S(1 or 2) WS	242*	>10 miles N	Colorado River where it intersects SH 35
WS	243*	>10 miles N	Colorado River upstream of dam at the Lower Colorado River Authority pumping station near Bay City. Alternate for WS is station 242
WG	245	4.5 mile SSE	Water well (windmill) located on private property approx. 1 mile south of the MCR
WS S1	246	<1 mile N	Drainage ditch originating at protected area fence north of Unit 2
WS	247	<1 mile E	Essential Cooling Pond
WS S1	248	<1 mile N	Point in drainage ditch north of protected area downstream of Unit #1 Protected Area storm drain discharge
F(1,2, or 3) CS	249*	N/A	Control sample purchased from a local retailer
WG	251	4.0 miles SSE	Test Well B-4, upper shallow aquifer
WG	255	4.2 miles SE	Piezometer Well #415 110' deep
WG	256	2.8 miles ESE	Piezometer Well #417 100' deep
WG	257	3.9 miles SSW	Piezometer Well #421-02, 80' deep 1.1 miles down STP Road from Station Code #258 approximately 20' inside east of site boundary fence
WG	258	2.9 miles SW	Piezometer Well #435-01, 1.5 miles down STP Road from FM 521 along east of site boundary fence
WG	259	2.9 miles SW	Piezometer Well #435-02, 1.5 miles down STP Road from FM 521 20' east of fence (site boundary) WG Alternate is station 258
WG	260	3.7 miles S	Piezometer Well #437 74' deep
WG	263	3.2 miles ESE	Piezometer Well #447 104' deep
WG	264	3.2 miles ESE	Piezometer Well #447A 46' deep
WG	266	0.7 miles NW	Piezometer Well #602A 40' deep
WG	267	2.7 miles ESE	Windmill north of Heavy Haul Road
WG	268	3.0 miles SE	Windmill east of MCR
WG	269	4.2 miles SSE	Windmill south of STP owner controlled area on private land
WG	270	2.9 miles SW	Monitor well MW-805L 49' deep. Across Rd from station # 258 & 259
WG	271	2.9 miles SW	Monitor well MW-805U Across Rd from station # 258 & 259
WR	272	NA	Unit 1
WR	273	NA	Unit 2
WS	278	1.8 WNW	First catfish pond NW of plant next to FM 521

♦ This station may be used to obtain the required aquatic samples in the vicinity of STP that may be influenced by plant operations.
MCR-STP Main Cooling Reservoir
STP-South Texas Project
Media codes typed in bold satisfy collection requirement described in Table 1.
Station codes typed in bold identify offsite locations.
*Control Station



**TABLE 2
SAMPLE MEDIA AND LOCATION DESCRIPTIONS (CONT.)**

Media Code	Station Code	Vector (Approximate)	Location
S(1 or 2) WS	280	0.2 miles ESE	Beginning at Plant Area Discharge Ditch (PADD) west of the Nuclear Support Center
WS	281	0.2 miles ESE	Main Spill Gate, Located north of the beginning of the PADD (Protected Area Drainage Ditch)
WS	282	<1 mile N	Point in drainage ditch at the Protected Area storm drainage discharge pipe located West of station # 246
WG	283	1 mile NW	OW-928L depth 121 feet
WG	284	1 mile NW	OW-928U depth 40 feet
WG	285	1 mile W	OW-931U depth 36 feet
WG	286	1 mile SW	OW-950 L depth 132 feet
WG	287	1 mile SW	OW-950 U depth 42 feet
WG	288	1 mile N	OW-954 L depth 99 feet
WG	289	1 mile N	OW-954 U depth 46 feet
WG	290	1 mile E	OW-956 L depth 109 feet
WG	291	1 mile E	OW-956 U depth 29 feet
WG	292	2.3 miles ESE	OW-961 L depth 105 feet
WG	293	2.3 miles ESE	OW-961 U depth 25 feet
WG	294	1 mile NE	OW-962 L depth 116 feet
WG	295	1 mile NE	OW-962 U depth 43 feet
F(1, 2, or 3) CC S2	300	S	STP Main Cooling Reservoir
F(1, 2, or 3) S2	301-631	S	Grids located in Main Cooling Reservoir.
WW	701	4 miles S	MCR Relief Well #W-440
WW	702	4 miles S	MCR Relief Well #W-500
WW	703	4 miles S	MCR Relief Well #W-505
WW	704	4 miles S	MCR Relief Well #W-404
WW	705	4 miles S	MCR Relief Well #W-497
WW	706	4 miles S	MCR Relief Well #W-522
WW	707	4 miles S	MCR Relief Well #W-455
WS	Q01	N/A	Quarterly composite of station #227 and/or alternate #233
WS	Q02	N/A	Quarterly composite of station #243 and/or alternate #242

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Direct Radiation

Units: MilliRoentgen/Standard Quarter

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN LOCATION INFORMATION	HIGHEST ANNUAL MEAN † RANGE	CONTROL LOCATIONS MEAN † RANGE
Gamma	176/ 0	5.0E+00	1.4E+01 (164/ 164) (1.0E+01 - 2.2E+01)	1.5 miles W (#013)	1.7E+01 (8/ 8) (1.6E+01 - 1.9E+01)	1.5E+01 (12/ 12) (1.2E+01 - 1.7E+01)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Airborne Particulate & Radioiodine

Units: PicoCuries per cubic meter

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN LOCATION INFORMATION	HIGHEST ANNUAL MEAN † RANGE	CONTROL LOCATIONS MEAN † RANGE
Gross Beta	258/ 0	1.4E-03	2.4E-02 (206/ 206) (6.0E-03 - 5.2E-01)	1 mile N (#001)	3.0E-02 (50/ 50) (6.0E-03 - 5.2E-01)	2.2E-02 (52/ 52) (5.8E-03 - 4.5E-02)
Iodine-131	258/ 0	1.0E-02	--- (0/ 206)	---	---	--- (0/ 52)
Cesium-134	20/ 0	5.3E-04	--- (0/ 16)	---	---	--- (0/ 4)
Cesium-137	20/ 0	5.4E-04	--- (0/ 16)	---	---	--- (0/ 4)
Manganese-54	20/ 0	5.8E-04	--- (0/ 16)	---	---	--- (0/ 4)
Iron-59	20/ 0	2.6E-03	--- (0/ 16)	---	---	--- (0/ 4)
Cobalt-58	20/ 0	8.6E-04	--- (0/ 16)	---	---	--- (0/ 4)
Cobalt-60	20/ 0	6.1E-04	--- (0/ 16)	---	---	--- (0/ 4)
Zinc-65	20/ 0	1.6E-03	--- (0/ 16)	---	---	--- (0/ 4)
Zirconium-95	20/ 0	1.6E-03	--- (0/ 16)	---	---	--- (0/ 4)
Niobium-95	20/ 0	9.5E-04	--- (0/ 16)	---	---	--- (0/ 4)
Lanthanum-140 Barium-140	20/ 0	8.8E-03	--- (0/ 16)	---	---	--- (0/ 4)

† Number of positive measurements / total measurements at specified locations.



TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Surface Water

Units: PicoCuries per Kilogram

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Hydrogen-3	9/ 0	2.6E+02	8.7E+03 (5/ 8) (2.6E+02 - 1.3E+04)	3 miles SSE (#216)	1.1E+04 (4/ 4) (9.8E+03 - 1.3E+04)	--- (0/ 1)
Iodine-131	40/ 0	3.2E+00	--- (0/ 28)	---	---	--- (0/ 12)
Cesium-134	40/ 0	2.9E+00	--- (0/ 28)	---	---	--- (0/ 12)
Cesium-137	40/ 0	3.3E+00	--- (0/ 28)	---	---	--- (0/ 12)
Manganese-54	40/ 0	3.0E+00	--- (0/ 28)	---	---	--- (0/ 12)
Iron-59	40/ 0	6.4E+00	--- (0/ 28)	---	---	--- (0/ 12)
Cobalt-58	40/ 0	2.9E+00	--- (0/ 28)	---	---	--- (0/ 12)
Cobalt-60	40/ 0	3.3E+00	--- (0/ 28)	---	---	--- (0/ 12)
Zinc-65	40/ 0	7.1E+00	--- (0/ 28)	---	---	--- (0/ 12)
Zirconium-95	40/ 0	5.1E+00	--- (0/ 28)	---	---	--- (0/ 12)
Niobium-95	40/ 0	3.0E+00	--- (0/ 28)	---	---	--- (0/ 12)
Lanthanum-140 Barium-140	40/ 0	4.4E+00	--- (0/ 28)	---	---	--- (0/ 12)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Ground Water (*On site test well*)

Units: PicoCuries per Kilogram

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Hydrogen-3	24/ 0	2.6E+02	4.2E+03 (15/ 24) (1.8E+03 - 5.4E+03)	4.0 miles SSE (#251)	5.2E+03 (6/ 6) (4.7E+03 - 5.4E+03)	no samples
Iodine-131	24/ 0	2.9E+00	--- (0/ 24)	---	---	no samples
Cesium-134	24/ 0	2.8E+00	--- (0/ 24)	---	---	no samples
Cesium-137	24/ 0	3.0E+00	--- (0/ 24)	---	---	no samples
Manganese-54	24/ 0	2.6E+00	--- (0/ 24)	---	---	no samples
Iron-59	24/ 0	5.5E+00	--- (0/ 24)	---	---	no samples
Cobalt-58	24/ 0	2.7E+00	--- (0/ 24)	---	---	no samples
Cobalt-60	24/ 0	2.9E+00	--- (0/ 24)	---	---	no samples
Zinc-65	24/ 0	8.5E+00	--- (0/ 24)	---	---	no samples
Zirconium-95	24/ 0	4.7E+00	--- (0/ 24)	---	---	no samples
Niobium-95	24/ 0	3.0E+00	--- (0/ 24)	---	---	no samples
Lanthanum-140 Barium-140	24/ 0	3.9E+00	--- (0/ 24)	---	---	no samples

† Number of positive measurements / total measurements at specified locations

Photo courtesy of Cristina Armas

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Drinking Water

Units: PicoCuries per Kilogram

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Gross Beta	24/ 0	5.8E-01	2.4E+00 (10/ 12) (1.4E+00 - 5.1E+00)	14 miles NNE (#228)	2.8E+00 (12/ 12) (2.0E-01 - 6.9E+00)	2.8E+00 (12/ 12) (2.0E-01 - 6.9E+00)
Hydrogen-3	8/ 0	2.7E+02	--- (0/ 4)	---	---	--- (0/ 4)
Iodine-131	24/ 0	2.9E+00	--- (0/ 12)	---	---	--- (0/ 12)
Cesium-134	24/ 0	3.1E+00	--- (0/ 12)	---	---	--- (0/ 12)
Cesium-137	24/ 0	3.3E+00	--- (0/ 12)	---	---	--- (0/ 12)
Manganese-54	24/ 0	3.0E+00	--- (0/ 12)	---	---	--- (0/ 12)
Iron-59	24/ 0	6.0E+00	--- (0/ 12)	---	---	--- (0/ 12)
Cobalt-58	24/ 0	3.0E+00	--- (0/ 12)	---	---	--- (0/ 12)
Cobalt-60	24/ 0	3.2E+00	--- (0/ 12)	---	---	--- (0/ 12)
Zinc-65	24/ 0	9.5E+00	--- (0/ 12)	---	---	--- (0/ 12)
Zirconium-95	24/ 0	5.1E+00	--- (0/ 12)	---	---	--- (0/ 12)
Niobium-95	24/ 0	3.4E+00	--- (0/ 12)	---	---	--- (0/ 12)
Lanthanum-140 Barium-140	24/ 0	4.1E+00	--- (0/ 12)	---	---	--- (0/ 12)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Rain Water

Units: PicoCuries per Kilogram

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Hydrogen-3	6/ 0	2.7E+02	--- (0/ 6)	---	---	no samples
Iodine-131	6/ 0	3.1E+00	--- (0/ 6)	---	---	no samples
Cesium-134	6/ 0	2.6E+00	--- (0/ 6)	---	---	no samples
Cesium-137	6/ 0	2.9E+00	--- (0/ 6)	---	---	no samples
Manganese-54	6/ 0	2.7E+00	--- (0/ 6)	---	---	no samples
Iron-59	6/ 0	5.8E+00	--- (0/ 6)	---	---	no samples
Cobalt-58	6/ 0	2.7E+00	--- (0/ 6)	---	---	no samples
Cobalt-60	6/ 0	3.1E+00	--- (0/ 6)	---	---	no samples
Zinc-65	6/ 0	6.4E+00	--- (0/ 6)	---	---	no samples
Zirconium-95	6/ 0	4.9E+00	--- (0/ 6)	---	---	no samples
Niobium-95	6/ 0	2.8E+00	--- (0/ 6)	---	---	no samples
Lanthanum-140 Barium-140	6/ 0	4.2E+00	--- (0/ 6)	---	---	no samples

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Sediment-Shoreline

Units: PicoCuries per Kilogram dry weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN LOCATION INFORMATION	MEAN † RANGE	CONTROL LOCATIONS MEAN † RANGE
Cesium-134	5/0	2.1E+01	--- (0/ 3)	---	---	--- (0/ 2)
Cesium-137	5/0	2.2E+01	--- (0/ 3)	---	---	--- (0/ 2)
Manganese-54	5/0	2.2E+01	--- (0/ 3)	---	---	--- (0/ 2)
Iron-59	5/0	4.8E+01	--- (0/ 3)	---	---	--- (0/ 2)
Cobalt-58	5/0	1.9E+01	--- (0/ 3)	---	---	--- (0/ 2)
Cobalt-60	5/0	2.3E+01	--- (0/ 3)	---	---	--- (0/ 2)
Zinc-65	5/0	7.0E+01	--- (0/ 3)	---	---	--- (0/ 2)
Zirconium-95	5/0	3.7E+01	--- (0/ 3)	---	---	--- (0/ 2)
Niobium-95	5/0	2.4E+01	--- (0/ 3)	---	---	--- (0/ 2)
Lanthanum-140 Barium-140	5/0	3.1E+01	--- (0/ 3)	---	---	--- (0/ 2)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Sediment-Bottom

Units: PicoCuries per Kilogram dry weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN LOCATION INFORMATION	MEAN † RANGE	CONTROL LOCATIONS MEAN † RANGE
Cesium-134	4/0	3.0E+01	--- (0/ 4)	---	---	no samples
Cesium-137	4/0	2.2E+01	6.2E+01 (4/ 4) (3.5E+01 - 9.0E+01)	3 miles SSE (#216)	8.6E+01 (2/ 2) (8.3E+01 - 9.0E+01)	no samples
Manganese-54	4/0	2.5E+01	--- (0/ 4)	---	---	no samples
Iron-59	4/0	6.9E+01	--- (0/ 4)	---	---	no samples
Cobalt-58	4/0	3.0E+01	--- (0/ 4)	---	---	no samples
Cobalt-60	4/0	3.9E+01	2.5E+01 (3/ 4) (1.6E+01 - 3.8E+01)	1 mile SW (#215)	2.7E+01 (2/ 2) (1.6E+01 - 3.8E+01)	no samples
Zinc-65	4/0	9.5E+01	--- (0/ 4)	---	---	no samples
Zirconium-95	4/0	5.6E+01	--- (0/ 4)	---	---	no samples
Niobium-95	4/0	3.5E+01	--- (0/ 4)	---	---	no samples
Lanthanum-140 Barium-140	4/0	6.4E+01	--- (0/ 4)	---	---	no samples

† Number of positive measurements / total measurements at specified locations.



TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Banana Leaves

Units: PicoCuries per Kilogram wet weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Iodine-131	16/0	1.6E+01	--- (0/ 10)	---	---	--- (0/ 6)
Cesium-134	16/0	1.6E+01	--- (0/ 10)	---	---	--- (0/ 6)
Cesium-137	16/0	1.8E+01	--- (0/ 10)	---	---	--- (0/ 6)
Manganese-54	16/0	1.6E+01	--- (0/ 10)	---	---	--- (0/ 6)
Iron-59	16/0	3.8E+01	--- (0/ 10)	---	---	--- (0/ 6)
Cobalt-58	16/0	1.6E+01	--- (0/ 10)	---	---	--- (0/ 6)
Cobalt-60	16/0	1.9E+01	--- (0/ 10)	---	---	--- (0/ 6)
Zinc-65	16/0	4.8E+01	--- (0/ 10)	---	---	--- (0/ 6)
Zirconium-95	16/0	2.8E+01	--- (0/ 10)	---	---	--- (0/ 6)
Niobium-95	16/0	1.7E+01	--- (0/ 10)	---	---	--- (0/ 6)
Lanthanum-140 Barium-140	16/0	2.2E+01	--- (0/ 10)	---	---	--- (0/ 6)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Cana Leaves

Units: PicoCuries per Kilogram wet weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Iodine-131	6/0	1.5E+01	--- (0/ 3)	---	---	--- (0/ 3)
Cesium-134	6/0	1.6E+01	--- (0/ 3)	---	---	--- (0/ 3)
Cesium-137	6/0	1.7E+01	--- (0/ 3)	---	---	--- (0/ 3)
Manganese-54	6/0	1.7E+01	--- (0/ 3)	---	---	--- (0/ 3)
Iron-59	6/0	3.9E+01	--- (0/ 3)	---	---	--- (0/ 3)
Cobalt-58	6/0	1.7E+01	--- (0/ 3)	---	---	--- (0/ 3)
Cobalt-60	6/0	1.9E+01	--- (0/ 3)	---	---	--- (0/ 3)
Zinc-65	6/0	4.9E+01	--- (0/ 3)	---	---	--- (0/ 3)
Zirconium-95	6/0	2.8E+01	--- (0/ 3)	---	---	--- (0/ 3)
Niobium-95	6/0	1.7E+01	--- (0/ 3)	---	---	--- (0/ 3)
Lanthanum-140 Barium-140	6/0	1.9E+01	--- (0/ 3)	---	---	--- (0/ 3)

† Number of positive measurements / total measurements at specified locations.

Photo courtesy of Christie Dement



TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Collard Greens

Units: PicoCuries per Kilogram wet weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Iodine-131	14/ 0	1.3E+01	--- (0/ 11)	---	---	--- (0/ 3)
Cesium-134	14/ 0	1.3E+01	--- (0/ 11)	---	---	--- (0/ 3)
Cesium-137	14/ 0	1.4E+01	--- (0/ 11)	---	---	--- (0/ 3)
Manganese-54	14/ 0	1.3E+01	--- (0/ 11)	---	---	--- (0/ 3)
Iron-59	14/ 0	3.0E+01	--- (0/ 11)	---	---	--- (0/ 3)
Cobalt-58	14/ 0	1.2E+01	--- (0/ 11)	---	---	--- (0/ 3)
Cobalt-60	14/ 0	1.5E+01	--- (0/ 11)	---	---	--- (0/ 3)
Zinc-65	14/ 0	3.8E+01	--- (0/ 11)	---	---	--- (0/ 3)
Zirconium-95	14/ 0	2.2E+01	--- (0/ 11)	---	---	--- (0/ 3)
Niobium-95	14/ 0	1.4E+01	--- (0/ 11)	---	---	--- (0/ 3)
Lanthanum-140 Barium-140	14/ 0	1.8E+01	--- (0/ 11)	---	---	--- (0/ 3)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Fish - Piscivorous

Units: PicoCuries per Kilogram wet weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN		CONTROL LOCATIONS MEAN † RANGE
				LOCATION INFORMATION	MEAN † RANGE	
Cesium-134	4/ 0	4.1E+01	--- (0/ 4)	---	---	no samples
Cesium-137	4/ 0	4.5E+01	--- (0/ 4)	---	---	no samples
Manganese-54	4/ 0	4.5E+01	--- (0/ 4)	---	---	no samples
Iron-59	4/ 0	9.1E+01	--- (0/ 4)	---	---	no samples
Cobalt-58	4/ 0	4.2E+01	--- (0/ 4)	---	---	no samples
Cobalt-60	4/ 0	5.2E+01	--- (0/ 4)	---	---	no samples
Zinc-65	4/ 0	1.1E+02	--- (0/ 4)	---	---	no samples
Zirconium-95	4/ 0	7.3E+01	--- (0/ 4)	---	---	no samples
Niobium-95	4/ 0	4.0E+01	--- (0/ 4)	---	---	no samples
Lanthanum-140 Barium-140	4/ 0	6.4E+01	--- (0/ 4)	---	---	no samples

† Number of positive measurements / total measurements at specified locations.



TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Crustacean Shrimp

Units: PicoCuries per Kilogram wet weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN LOCATION INFORMATION	MEAN † RANGE	CONTROL LOCATIONS MEAN † RANGE
Cesium-134	7/0	3.4E+01	--- (0/ 3)	---	---	--- (0/ 4)
Cesium-137	7/0	3.5E+01	--- (0/ 3)	---	---	--- (0/ 4)
Manganese-54	7/0	3.4E+01	--- (0/ 3)	---	---	--- (0/ 4)
Iron-59	7/0	7.4E+01	--- (0/ 3)	---	---	--- (0/ 4)
Cobalt-58	7/0	3.5E+01	--- (0/ 3)	---	---	--- (0/ 4)
Cobalt-60	7/0	4.0E+01	--- (0/ 3)	---	---	--- (0/ 4)
Zinc-65	7/0	8.8E+01	--- (0/ 3)	---	---	--- (0/ 4)
Zirconium-95	7/0	6.0E+01	--- (0/ 3)	---	---	--- (0/ 4)
Niobium-95	7/0	3.6E+01	--- (0/ 3)	---	---	--- (0/ 4)
Lanthanum-140 Barium-140	7/0	5.8E+01	--- (0/ 3)	---	---	--- (0/ 4)

† Number of positive measurements / total measurements at specified locations.

TABLE 3

2025 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM ANALYSIS SUMMARY

Medium: Beef Meat

Units: PicoCuries per Kilogram wet weight

ANALYSIS TYPE	TOTAL ANALYSES /NONROUTINE MEASUREMENTS	LOWER LIMIT OF DETECTION	INDICATOR LOCATIONS MEAN † RANGE	LOCATION WITH HIGHEST ANNUAL MEAN LOCATION INFORMATION	MEAN † RANGE	CONTROL LOCATIONS MEAN † RANGE
Cesium-134	1/0	3.2E+01	--- (0/ 1)	---	---	no samples
Cesium-137	1/0	3.3E+01	--- (0/ 1)	---	---	no samples
Manganese-54	1/0	3.1E+01	--- (0/ 1)	---	---	no samples
Iron-59	1/0	9.5E+01	--- (0/ 1)	---	---	no samples
Cobalt-58	1/0	3.7E+01	--- (0/ 1)	---	---	no samples
Cobalt-60	1/0	3.9E+01	--- (0/ 1)	---	---	no samples
Zinc-65	1/0	8.1E+01	--- (0/ 1)	---	---	no samples
Zirconium-95	1/0	6.4E+01	--- (0/ 1)	---	---	no samples
Niobium-95	1/0	4.0E+01	--- (0/ 1)	---	---	no samples
Lanthanum-140 Barium-140	1/0	1.3E+02	--- (0/ 1)	---	---	no samples

† Number of positive measurements / total measurements at specified locations.



Maps provided by Janice Hopes

Cover photo by Karl Villa

*Photos courtesy of: Cristina Armas,
Bradley Batchelder, Christie Dement,
Christopher Kalka, Randy Maus, Greg
McMullin, Robert Nies, Gary Parkey, William
Sharpe, Laura Stoicescu, and Karl Villa*

Graphics by Diane Davis Design

*Coordination and support by Corporate
Communications*