



UNITED STATES  
**NUCLEAR REGULATORY COMMISSION**  
WASHINGTON, D.C. 20555-0001

FLORIDA POWER AND LIGHT COMPANY

DOCKET NO. 50-250

TURKEY POINT PLANT UNIT NO. 3

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 203  
License No. DPR-31

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Florida Power and Light Company (the licensee) dated April 26, 1999, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 3.B of Facility Operating License No. DPR-31 is hereby amended to read as follows:

(B) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 203, are hereby incorporated in the license. The Environmental Protection Plan contained in Appendix B is hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

2. This license amendment is effective as of its date of issuance and shall be implemented within 30 days.

FOR THE NUCLEAR REGULATORY COMMISSION

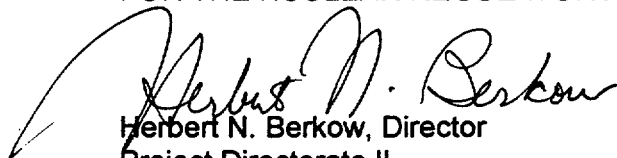

Herbert N. Berkow, Director  
Project Directorate II  
Division of Licensing Project Management  
Office of Nuclear Reactor Regulation

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: December 20, 1999



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D.C. 20555-0001

FLORIDA POWER AND LIGHT COMPANY

DOCKET NO. 50-251

TURKEY POINT PLANT UNIT NO. 4

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 197  
License No. DPR-41

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Florida Power and Light Company (the licensee) dated April 26, 1999, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 3.B of Facility Operating License No. DPR-41 is hereby amended to read as follows:

(B) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 197, are hereby incorporated in the license. The Environmental Protection Plan contained in Appendix B is hereby incorporated into the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of its date of issuance and shall be implemented within 30 days.

FOR THE NUCLEAR REGULATORY COMMISSION

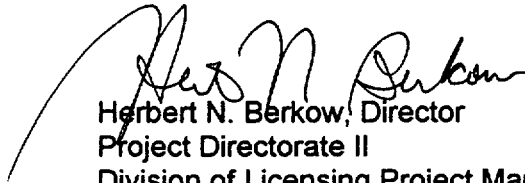

Herbert N. Berkow, Director  
Project Directorate II  
Division of Licensing Project Management  
Office of Nuclear Reactor Regulation

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: December 20, 1999

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 203 FACILITY OPERATING LICENSE NO. DPR-31

AMENDMENT NO.197 FACILITY OPERATING LICENSE NO. DPR-41

DOCKET NOS. 50-250 AND 50-251

Replace the following pages of the Appendix A Technical Specifications with the attached pages. The revised pages are identified by amendment number and contain marginal lines indicating the area of change.

Remove pages

iv  
v  
vi  
viii  
x  
xi  
xiv  
xxi  
xxii  
xxiii  
xxiv  
3/4 1-14  
3/4 1-14a  
3/4 7-18  
3/4 7-18a

Insert pages

iv  
v  
vi  
viii  
x  
xi  
--  
xiv  
xv  
xvi  
xvii  
3/4 1-14  
3/4 1-14a  
3/4 7-18  
3/4 7-18a

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.0 APPLICABILITY</u> .....	3/4 0-1
 <u>3/4.1 REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL	
Shutdown Margin - $T_{avg}$ Greater Than 200°F.....	3/4 1-1
FIGURE 3.1-1    REQUIRED SHUTDOWN MARGIN VERSUS REACTOR COOLANT BORON CONCENTRATION.....	3/4 1-3
Shutdown Margin - $T_{avg}$ Less Than or Equal to 200°F.....	3/4 1-4
Moderator Temperature Coefficient.....	3/4 1-5
Minimum Temperature for Criticality.....	3/4 1-7
 3/4.1.2 BORATION SYSTEMS	
Flow Path - Shutdown.....	3/4 1-8
Flow Paths - Operating.....	3/4 1-9
Charging Pumps - Operating.....	3/4 1-11
Borated Water Source - Shutdown.....	3/4 1-12
Borated Water Sources - Operating.....	3/4 1-14
FIGURE 3.1-2 BORIC ACID TANK MINIMUM VOLUME.....	3/4 1-14a
Heat Tracing.....	3/4 1-16
 3/4.1.3 MOVABLE CONTROL ASSEMBLIES	
Group Height.....	3/4 1-17
TABLE 3.1-1    ACCIDENT ANALYSES REQUIRING REEVALUATION IN THE EVENT OF AN INOPERABLE FULL-LENGTH ROD.....	3/4 1-19
Position Indication Systems - Operating.....	3/4 1-20
TABLE 4.1-1 ROD POSITION INDICATOR SURVEILLANCE REQUIREMENTS.....	3/4 1-22
Position Indication System - Shutdown.....	3/4 1-23
Rod Drop Time.....	3/4 1-24
Shutdown Rod Insertion Limit.....	3/4 1-25
Control Rod Insertion Limits.....	3/4 1-26

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1 AXIAL FLUX DIFFERENCE.....	3/4 2-1
FIGURE 3.2-1 AXIAL FLUX DIFFERENCE LIMITS AS A FUNCTION OF RATED THERMAL POWER.....	3/4 2-3
3/4.2.2 HEAT FLUX HOT CHANNEL FACTOR.....	3/4 2-4
3/4.2.3 NUCLEAR ENTHALPY RISE HOT CHANNEL FACTOR.....	3/4 2-11
3/4.2.4 QUADRANT POWER TILT RATIO.....	3/4 2-13
3/4.2.5 DNB PARAMETERS.....	3/4 2-16
 <u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1 REACTOR TRIP SYSTEM INSTRUMENTATION.....	3/4 3-1
TABLE 3.3-1 REACTOR TRIP SYSTEM INSTRUMENTATION.....	3/4 3-2
TABLE 4.3-1 REACTOR TRIP SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-8
3/4.3.2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION.....	3/4 3-13
TABLE 3.3-2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION.....	3/4 3-14
TABLE 3.3-3 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION TRIP SETPOINTS.....	3/4 3-23
TABLE 4.3-2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-31a
3/4.3.3 MONITORING INSTRUMENTATION	
Radiation Monitoring For Plant Operations.....	3/4 3-35

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>	<u>PAGE</u>
TABLE 3.3-4 RADIATION MONITORING INSTRUMENTATION FOR PLANT OPERATIONS.....	3/4 3-36
TABLE 4.3-3 RADIATION MONITORING INSTRUMENTATION FOR PLANT OPERATIONS SURVEILLANCE REQUIREMENTS.....	3/4 3-39
Movable Incore Detectors.....	3/4 3-40
Accident Monitoring Instrumentation.....	3/4 3-41
TABLE 3.3-5 ACCIDENT MONITORING INSTRUMENTATION.....	3/4 3-42
TABLE 4.3-4 ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-46
Fire Detection Instrumentation -.....	(DELETED)
Radioactive Liquid Effluent Monitoring Instrumentation	(DELETED)
TABLE 3.3-7 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION.	(DELETED)
TABLE 4.3-5 RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	(DELETED)
Explosive Gas Monitoring Instrumentation.....	3/4 3-47
TABLE 3.3-8 EXPLOSIVE GAS MONITORING INSTRUMENTATION.....	3/4 3-48
TABLE 4.3-6 EXPLOSIVE GAS MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS .....	3/4 3-49



INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>		<u>PAGE</u>
3/4.4.9	PRESSURE/TEMPERATURE LIMITS Reactor Coolant System.....	3/4 4-30
FIGURE 3.4-2	TURKEY POINT UNITS 3&4 REACTOR COOLANT SYSTEM HEATUP LIMITATIONS (60°F/hr) APPLICABLE UP TO 19 EFPY.....	3/4 4-31
FIGURE 3.4-3	TURKEY POINT UNITS 3&4 REACTOR COOLANT SYSTEM HEATUP LIMITATIONS (100°F/hr) APPLICABLE UP TO 19 EFPY.....	3/4 4-32
FIGURE 3.4-4	TURKEY POINT UNITS 3&4 REACTOR COOLANT SYSTEM COOLDOWN LIMITATIONS (100°F/hr) APPLICABLE UP TO 19 EFPY.....	3/4 4-33
TABLE 4.4-5	REACTOR VESSEL MATERIAL SURVEILLANCE PROGRAM- WITHDRAWAL SCHEDULE.....	3/4 4-34
	Pressurizer.....	3/4 4-35
	Overpressure Mitigating Systems.....	3/4 4-36
3/4.4.10	STRUCTURAL INTEGRITY.....	3/4 4-38
3/4.4.11	REACTOR COOLANT SYSTEM VENTS.....	3/4 4-39
<u>3/4.5 EMERGENCY CORE COOLING SYSTEMS</u>		
3/4.5.1	ACCUMULATORS.....	3/4 5-1
3/4.5.2	ECCS SUBSYSTEMS - $T_{avg}$ GREATER THAN OR EQUAL TO 350°F.....	3/4 5-3
FIGURE 3.5-1	RHR PUMP CURVE.....	3/4 5-6
3/4.5.3	ECCS SUBSYSTEMS - $T_{avg}$ LESS THAN 350°F.....	3/4 5-9
3/4.5.4	REFUELING WATER STORAGE TANK.....	3/4 5-10

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.7 PLANT SYSTEMS</u>	
3/4.7.1 TURBINE CYCLE	
Safety Valves.....	3/4 7-1
TABLE 3.7-1 MAXIMUM ALLOWABLE POWER RANGE NEUTRON FLUX HIGH SETPOINT WITH INOPERABLE STEAM LINE SAFETY VALVES DURING THREE LOOP OPERATION.....	3/4 7-2
TABLE 3.7-2 STEAM LINE SAFETY VALVES PER LOOP.....	3/4 7-2
Auxiliary Feedwater System.....	3/4 7-3
TABLE 3.7-3 AUXILIARY FEEDWATER SYSTEM OPERABILITY.....	3/4 7-5
Condensate Storage Tank.....	3/4 7-6
Specific Activity.....	3/4 7-8
TABLE 4.7-1 SECONDARY COOLANT SYSTEM SPECIFIC ACTIVITY SAMPLE AND ANALYSIS PROGRAM.....	3/4 7-9
Main Steam Line Isolation Valves.....	3/4 7-10
Standby Steam Generator Feedwater System.....	3/4 7-11
3/4.7.2 COMPONENT COOLING WATER SYSTEM.....	3/4 7-12
3/4.7.3 INTAKE COOLING WATER SYSTEM.....	3/4 7-14
3/4.7.4 ULTIMATE HEAT SINK.....	3/4 7-15
3/4.7.5 CONTROL ROOM EMERGENCY VENTILATION SYSTEM.....	3/4 7-16
3/4.7.6 SNUBBERS.....	3/4 7-18
TABLE 4.7-2 SNUBBER VISUAL INSPECTION INTERVAL.....	3/4 7-18a
3/4.7.7 SEALED SOURCE CONTAMINATION.....	3/4 7-22
3/4.7.8 EXPLOSIVE GAS MIXTURE.....	3/4 7-24
3/4.7.9 GAS DECAY TANKS.....	3/4 7-25

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

---

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.8 ELECTRICAL POWER SYSTEMS</u>	
3/4.8.1 AC SOURCES	
Operating.....	3/4 8-1
TABLE 4.8-1 .....NOT USED.....	3/4 8-10
Shutdown.....	3/4 8-11
3/4.8.2 DC SOURCES	
Operating.....	3/4 8-13
TABLE 4.8-2 BATTERY SURVEILLANCE REQUIREMENTS.....	3/4 8-16
Shutdown.....	3/4 8-17
3/4.8.3 ONSITE POWER DISTRIBUTION	
Operating.....	3/4 8-18
TABLE 3.8-1 APPLICABLE TO UNIT 3 BASED ON UNIT 4 LOAD CENTERS AND MOTOR CONTROL CENTERS INOPERABLE ALLOWABLE OUTAGE TIMES.....	3/4 8-21
TABLE 3.8-2 APPLICABLE TO UNIT 4 BASED ON UNIT 3 LOAD CENTERS AND MOTOR CONTROL CENTERS INOPERABLE ALLOWABLE OUTAGE TIMES.....	3/4 8-22
Shutdown.....	3/4 8-23

INDEX

DESIGN FEATURES

---

<u>SECTION</u>	<u>PAGE</u>
<u>5.1 SITE</u>	
5.1.1 EXCLUSION AREA.....	5-1
5.1.2 LOW POPULATION ZONE.....	5-1
5.1.3 MAP DEFINING UNRESTRICTED AREAS AND SITE BOUNDARY FOR RADIOACTIVE GASEOUS AND LIQUID EFFLUENTS.....	5-1
<u>5.2 CONTAINMENT</u>	
5.2.1 CONFIGURATION.....	5-1
5.2.2 DESIGN PRESSURE AND TEMPERATURE.....	5-1
FIGURE 5.1-1 SITE AREA MAP.....	5-2
FIGURE 5.1-2 PLANT AREA MAP.....	5-3
<u>5.3 REACTOR CORE</u>	
5.3.1 FUEL ASSEMBLIES.....	5-4
5.3.2 CONTROL ROD ASSEMBLIES.....	5-4
<u>5.4 REACTOR COOLANT SYSTEM</u>	
5.4.1 DESIGN PRESSURE AND TEMPERATURE.....	5-4
5.4.2 VOLUME.....	5-4
<u>5.5 METEOROLOGICAL TOWER LOCATION</u> .....	5-4
<u>5.6 FUEL STORAGE</u>	
5.6.1 CRITICALITY.....	5-5
5.6.2 DRAINAGE.....	5-6
5.6.3 CAPACITY.....	5-6
<u>5.7 COMPONENT CYCLIC OR TRANSIENT LIMIT</u> .....	5-6
TABLE 5.7-1 COMPONENT CYCLIC OR TRANSIENT LIMITS.....	5-7

INDEX

ADMINISTRATIVE CONTROLS

---

---

<u>SECTION</u>	<u>PAGE</u>
<u>6.1 RESPONSIBILITY</u> .....	6-1
<u>6.2 ORGANIZATION</u> .....	6-1
6.2.1 ONSITE AND OFFSITE ORGANIZATION.....	6-1
6.2.2 PLANT STAFF.....	6-2
TABLE 6.2-1 MINIMUM SHIFT CREW COMPOSITION.....	6-4
6.2.3 SHIFT TECHNICAL ADVISOR.....	6-5
<u>6.3 FACILITY STAFF QUALIFICATIONS</u> .....	6-5
<u>6.4 DELETED</u> .....	6-5
<u>6.5 DELETED</u> .....	6-5

INDEX

ADMINISTRATIVE CONTROLS

---

---

<u>SECTION</u>	<u>PAGE</u>
<u>6.6 DELETED</u> .....	6-12
<u>6.7 SAFETY LIMIT VIOLATION</u> .....	6-12
<u>6.8 PROCEDURES AND PROGRAMS</u> .....	6-13
<u>6.9 REPORTING REQUIREMENTS</u> .....	6-18
6.9.1 ROUTINE REPORTS.....	6-18
Startup Report.....	6-18
Annual Reports.....	6-19
Annual Radiological Environmental Operating Report.....	6-20
Annual Radioactive Effluent Release Report.....	6-20
Monthly Operating Report.....	6-20
Peaking Factor Limit Report.....	6-21
Core Operating Limits Report.....	6-21
6.9.2 SPECIAL REPORTS.....	6-22
<u>6.10 DELETED</u> .....	6-23

INDEX

ADMINISTRATIVE CONTROLS

---

<u>SECTION</u>	<u>PAGE</u>
6.11 DELETED.....	6-24
6.12 HIGH RADIATION AREA.....	6-24
6.13 DELETED.....	6-25
6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM).....	6-26

REACTIVITY CONTROL SYSTEMS

BORATED WATER SOURCES - OPERATING

LIMITING CONDITION FOR OPERATION

---

3.1.2.5 The following borated water sources shall be OPERABLE:

- a. A Boric Acid Storage System with:
  - 1) A minimum indicated borated water volume in accordance with Figure 3.1-2,
  - 2) A boron concentration in accordance with Figure 3.1-2, and
  - 3) A minimum boric acid tanks room temperature of 55°F.
- b. The refueling water storage tank (RWST) with:
  - 1) A minimum indicated borated water volume of 320,000 gallons,
  - 2) A minimum boron concentration of 1950 ppm,
  - 3) A minimum solution temperature of 39°F, and
  - 4) A maximum solution temperature of 100°F.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With the required Boric Acid Storage System inoperable verify that the RWST is OPERABLE; restore the system to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours\* and borated to a SHUTDOWN MARGIN equivalent to at least 1%  $\Delta k/k$  at 200°F; restore the Boric Acid Storage System to OPERABLE status within the next 72 hours or be in COLD SHUTDOWN within the next 30 hours.
- b. With the RWST inoperable, restore the tank to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With the boric acid tank inventory concentration greater than 3.5 wt%, verify that the boric acid solution temperature for boration sources and flow paths is greater than the solubility limit for the concentration.


---

\*If this action applies to both units simultaneously, be in at least HOT STANDBY within the next twelve hours.



FIGURE 3.1-2

BORIC ACID TANK MINIMUM VOLUME (1)  
 MODES 1,2,3 and 4

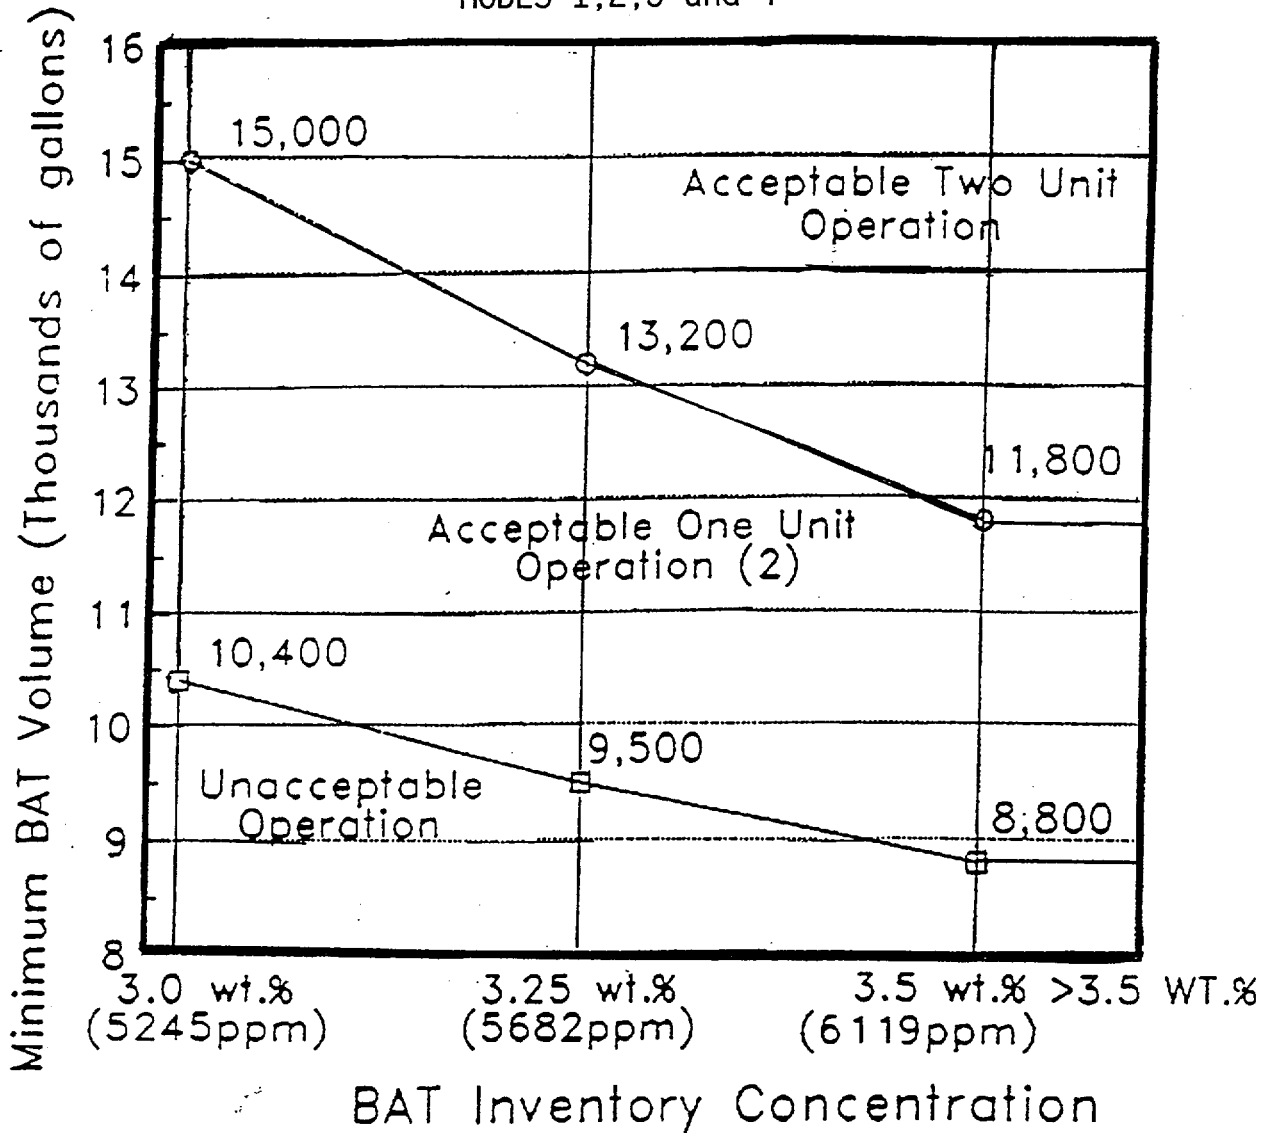

Minimum Acceptable  
Two Unit Operation

Minimum Acceptable  
One Unit Operation

Notes:

- (1) Combined volume of all available boric acid tanks assuming RWST boron concentration greater than or equal to 1950 ppm.
- (2) Includes 2900 gallons for shutdown unit.

## PLANT SYSTEMS

### 3/4.7.6 SNUBBERS

#### LIMITING CONDITION FOR OPERATION

---

3.7.6 All snubbers shall be OPERABLE. The only snubbers excluded from the requirements are those installed on nonsafety-related systems and then only if their failure or failure of the system on which they are installed would have no adverse effect on any safety-related system.

APPLICABILITY: MODES 1, 2, 3, and 4. MODES 5 and 6 for snubbers located on systems required OPERABLE in those MODES.

#### ACTION:

With one or more snubbers inoperable on any system, within 72 hours replace or restore the inoperable snubber(s) to OPERABLE status and perform an engineering evaluation per Specification 4.7.6f. on the attached component or declare the attached system inoperable and follow the appropriate ACTION statement for that system.

#### SURVEILLANCE REQUIREMENTS

---

4.7.6 Each snubber shall be demonstrated OPERABLE by performance of the following augmented inservice inspection program in addition to the requirements of Specification 4.0.5.

a. Inspection Types

As used in this specification, type of snubber shall mean snubbers of the same design and manufacturer, irrespective of capacity.

b. Visual Inspections

Snubbers are categorized as inaccessible or accessible during reactor operation. Each of these categories (inaccessible and accessible) may be inspected independently according to the schedule determined by Table 4.7-2. The visual inspection interval for each type of snubber shall be determined based upon the criteria provided in Table 4.7-2 and the first inspection interval determined using this criteria shall be based upon the previous inspection interval as established by the requirements in effect before Amendment 151 and 146.

c. Visual Inspection Acceptance Criteria

Visual inspections shall verify that: (1) the snubber has no visible indications of damage or impaired OPERABILITY, (2) attachments to the foundation or supporting structure are secure, and (3) fasteners for attachment of the snubber to the component and to the snubber anchorage are secure. Snubbers which appear inoperable as a result of visual

TABLE 4.7-2

## SNUBBER VISUAL INSPECTION INTERVAL

Population or Category (Notes 1 and 2)	NUMBER OF UNACCEPTABLE SNUBBERS		
	Column A Extended Interval (Notes 3 and 6)	Column B Repeat Interval (Notes 4 and 6)	Column C Reduce Interval (Notes 5 and 6)
1	0	0	1
80	0	0	2
100	0	1	4
150	0	3	8
200	2	5	13
300	5	12	25
400	8	18	36
500	12	24	48
750	20	40	78
1000 or greater	29	56	109

- Note 1: The next visual inspection interval for a snubber population or category size shall be determined based upon the previous inspection interval and the number of unacceptable snubbers found during that interval. Snubbers may be categorized, based upon their accessibility during power operation, as accessible or inaccessible. These categories may be examined separately or jointly. However, the licensee must make and document that decision before any inspection and shall use that decision as the basis upon which to determine the next inspection interval for that category.
- Note 2: Interpolation between population or category sizes and the number of unacceptable snubbers is permissible. Use next lower integer for the value of the limit for Columns A, B, or C if that integer includes a fractional value of unacceptable snubbers as determined by interpolation.
- Note 3: If the number of unacceptable snubbers is equal to or less than the number in Column A, the next inspection interval may be twice the previous interval but not greater than 48 months.
- Note 4: If the number of unacceptable snubbers is equal to or less than the number in Column B but greater than the number in Column A, the next inspection interval shall be the same as the previous interval.
- Note 5: If the number of unacceptable snubbers is equal to or greater than the number in Column C, the next inspection interval shall be two-thirds of the previous interval. However, if the number of