

50-255

Date Entered: May 15, 2000

TO: USNRC/WASHINGTON
JMCKNIGHT

Copy Number: 145

TRANSMITTAL NUMBER: 151744

PROCEDURE NUMBER: EI-4.1

TITLE: TECHNICAL SUPPORT CENTER ACTIVATION

TRANSMITTAL: LISTED BELOW ARE NEW/REVISED PROCEDURES WHICH MUST BE IMMEDIATELY INSERTED INTO OR DISCARDED FROM YOUR PROCEDURE MANUAL.

Action Required	Section or Description
REMOVE AND DESTROY	EI-4.1, R/12, COVERSHEET AND ATTACHMENT 8
REPLACE WITH	EI-4.1, R/12, COVERSHEET AND ATTACHMENT 8 EDITORIAL

SIGN, DATE, AND RETURN THE ACKNOWLEDGEMENT FORM WITHIN 10 DAYS TO THE PALISADES PLANT DOCUMENT CONTROL.

SIGNATURE OR INITIALS


DATE

NIR-037

A045

PALISADES NUCLEAR PLANT
EMERGENCY IMPLEMENTING PROCEDURE


TITLE: TECHNICAL SUPPORT CENTER ACTIVATION

 / 5/11/00
Procedure Sponsor Date

NKBrott / 8/10/99
Technical Reviewer Date

JLBeer / 8/31/99
User Reviewer Date

TECHNICAL SUPPORT CENTER LAYOUT/PHONE LOCATIONS

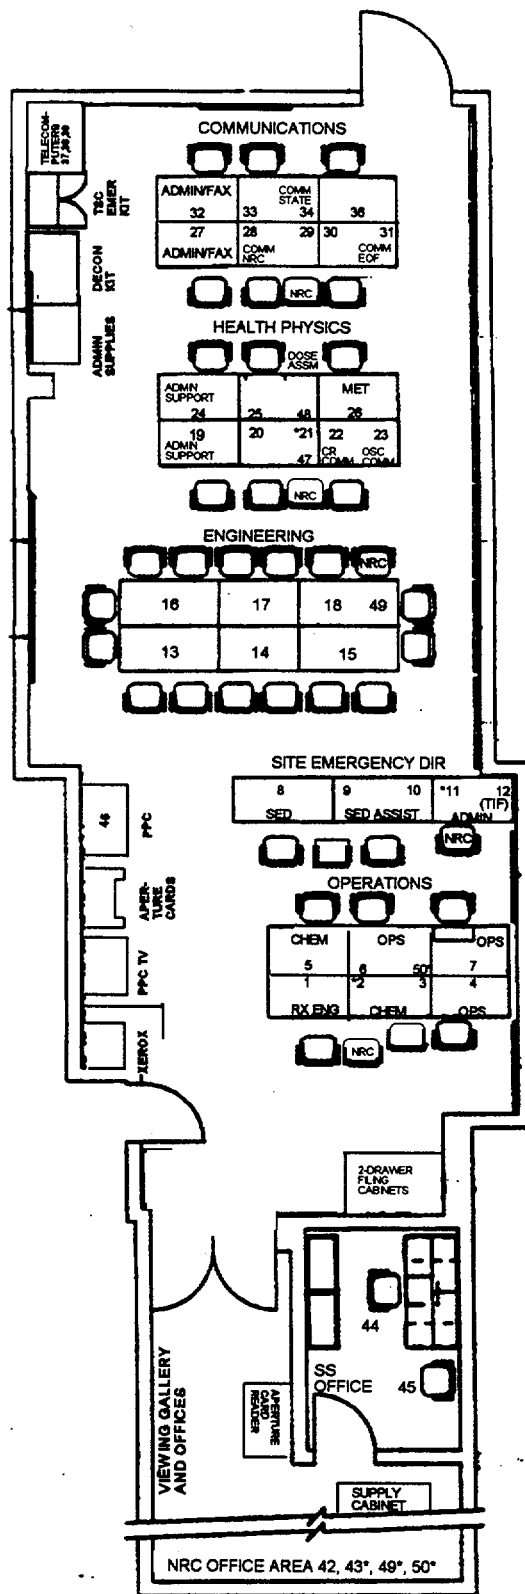

*Phone designated for use by NRC

TECHNICAL SUPPORT CENTER
LAYOUT/PHONE LOCATIONS

Proc No EI-4.1
Attachment 8
Revision 12
Page 2 of 2

e	1	2282 (RX ENG)	42	700-371-0007 (ENS)
	2	764-1445 (for NRC use)	43	4028
	3	2368 (CHEM)	44	2783
	4	2370 (OPS)	45	764-2252/2257/1569
	5	2297 (CHEM)	46	2274
	6	2287 (OPS)	47	Met Tower Radio Line
	7	2108 (OPS)	48	764-8372 (Computer Line)
	8	2472 (SED)	49	700-371-8914 (Protective Measures)
e	9	764-1222	50	700-371-9640 (Reactor Safety)
	10	EOF (Director ring down)		
	11	764-1206 (for NRC use)		
	12	2192 (TIF)		
	13	2250		
	14	2371		
	15	2376		
	16	2473		
	17	2372		
	18	2418		
	19	764-8979*/2354 (ADMIN)		
	20	764-8235		
e	21	700-371-0003 (HPN)		
	22	2505		
	23	OSC (HP ring down)		
	24	2111 (ADMIN Support)		
	25	2504		
	26	2506		
	27	764-8131 (fax)		
e	28	700-371-0007 (ENS)		
	29	2441		
	30	2236		
	31	EOF (Communications ring down EOF)		
	32	764-8159 * (fax)		
	33	2008		
	34	764-1285 (Comm State)*		
	35	Disconnected line		
	36	2538		
	37	764-8147		
	38	764-1729		
	39	764-8225		

Augmentation Telecomputers

* Power failure phone