


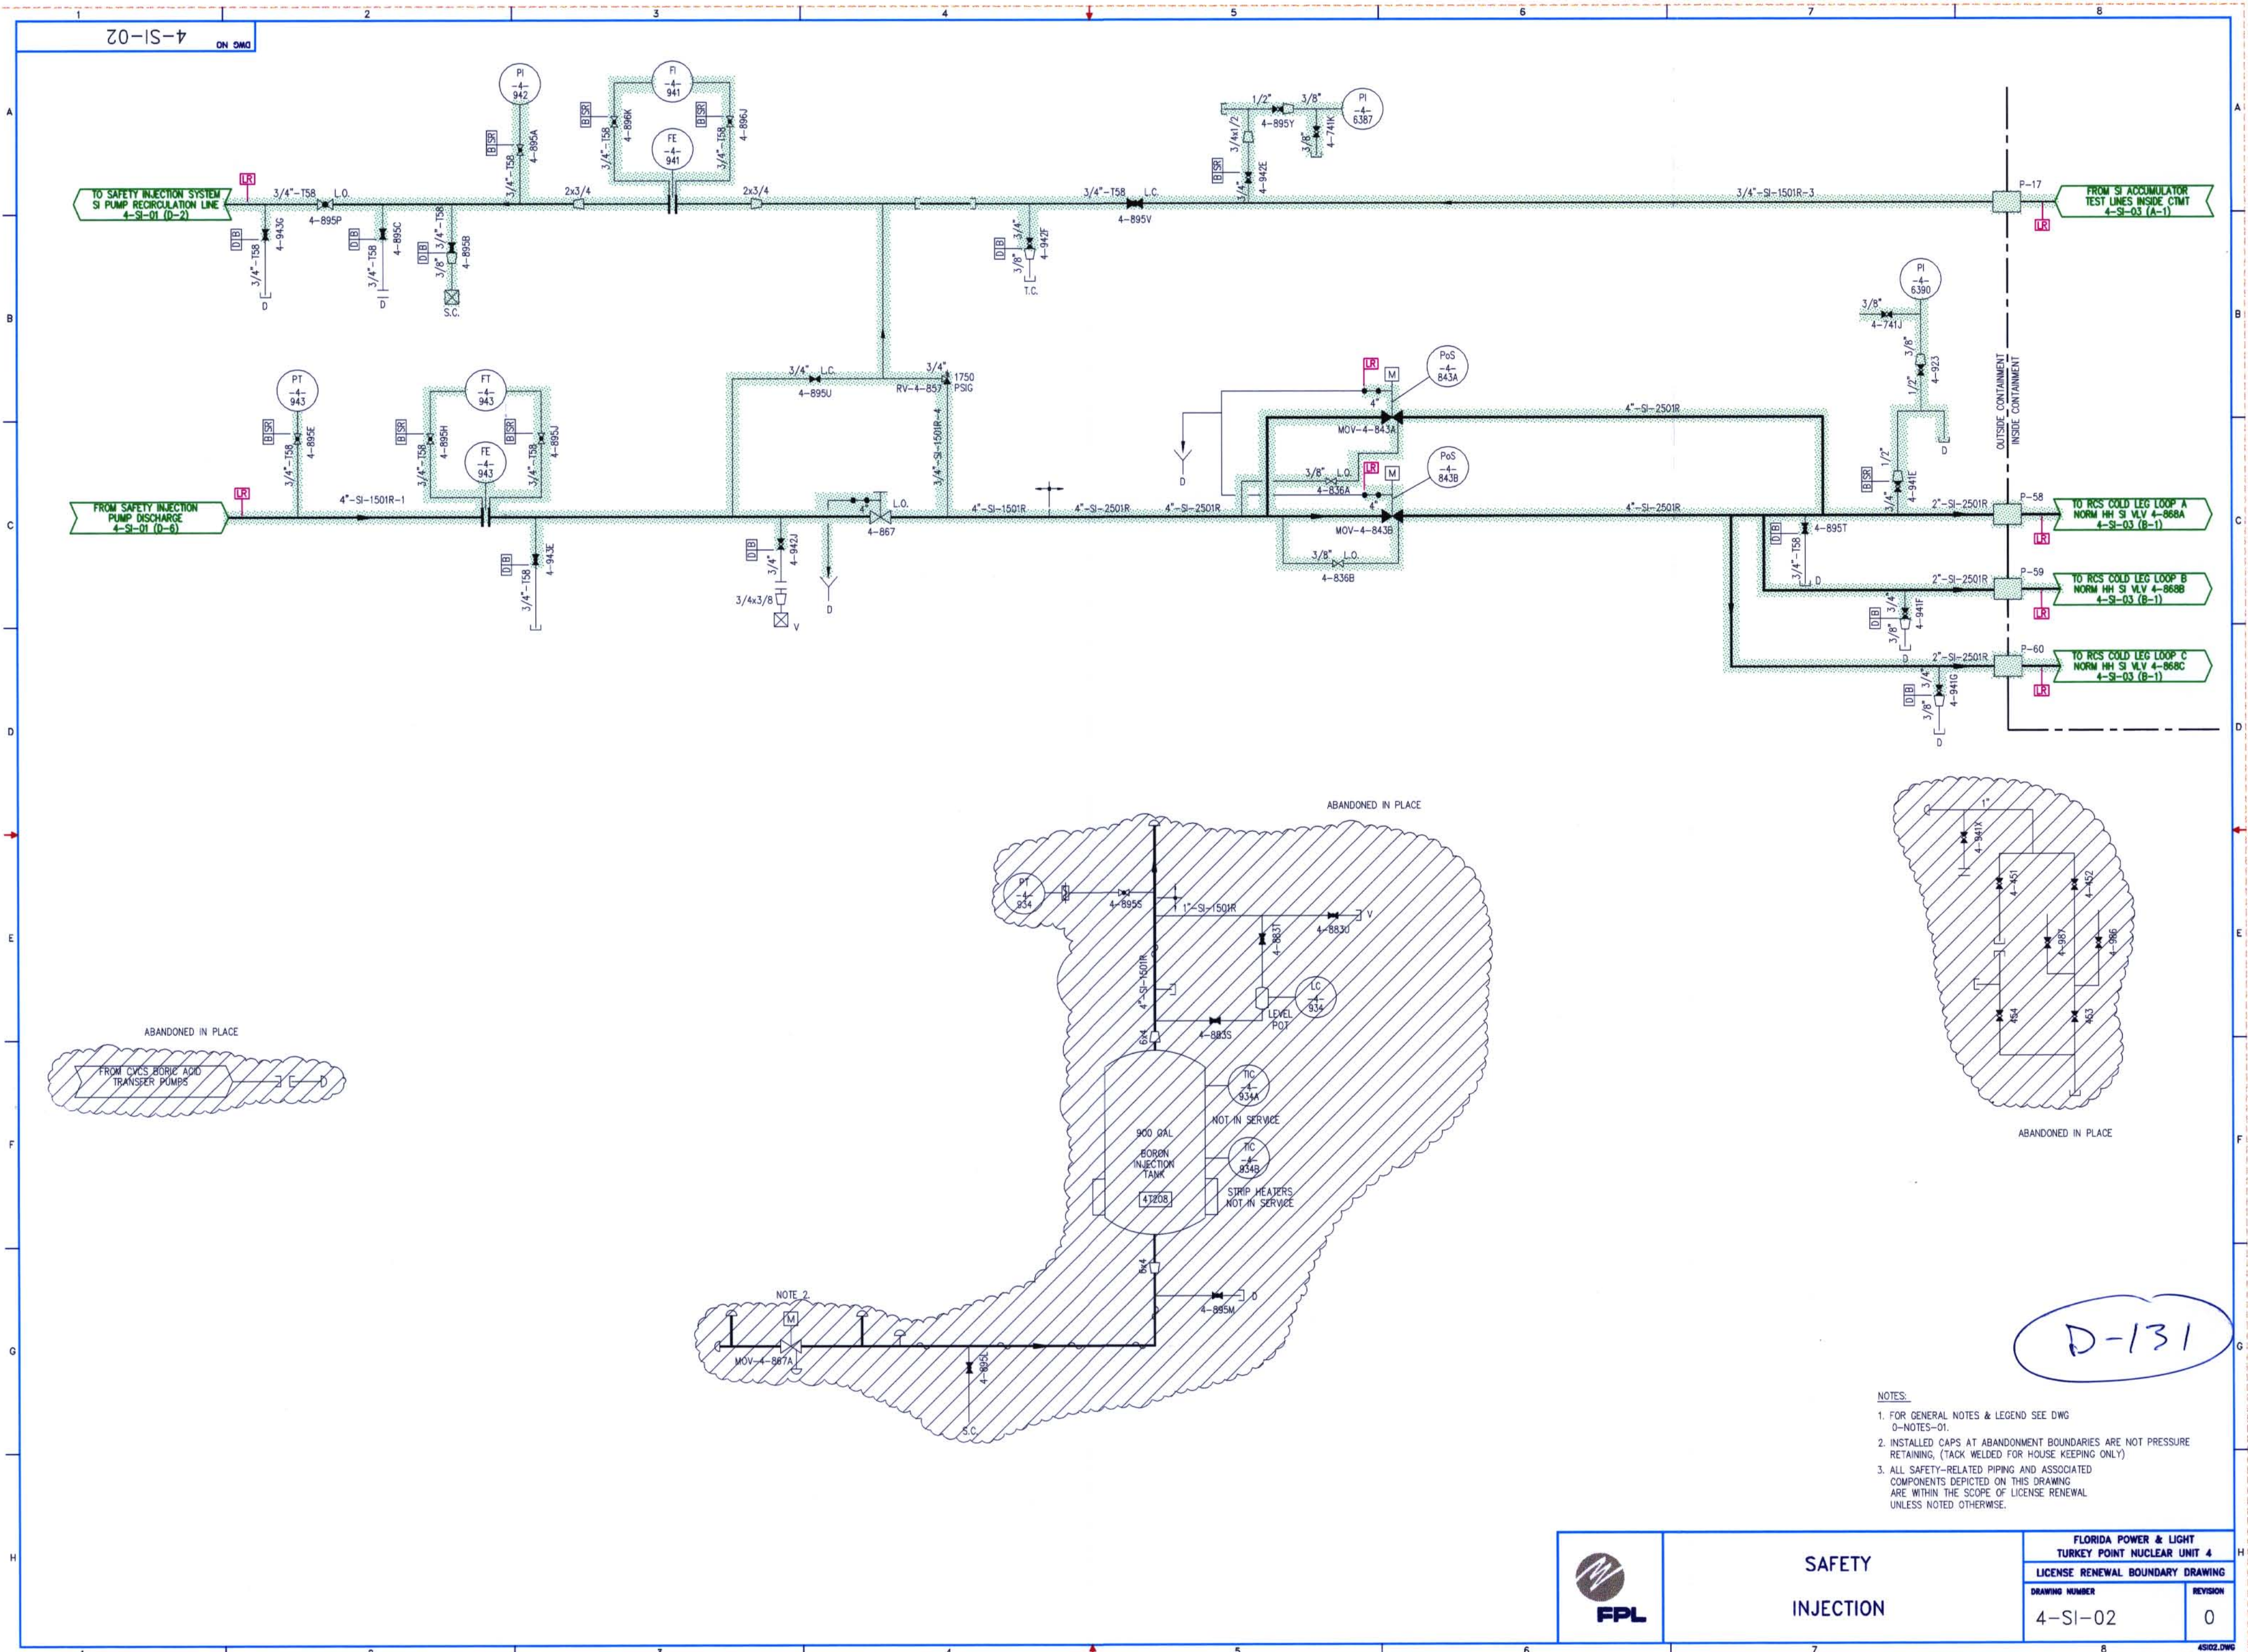

- NOTES:
1. FOR GENERAL NOTES & LEGEND SEE DWG 0-NOTES-01.
 2. INSTALLED CAPS AT ABANDONMENT BOUNDARIES ARE NOT PRESSURE RETAINING, (TACK WELDED FOR HOUSE KEEPING ONLY)
 3. ALL SAFETY-RELATED PIPING AND ASSOCIATED COMPONENTS DEPICTED ON THIS DRAWING ARE WITHIN THE SCOPE OF LICENSE RENEWAL UNLESS NOTED OTHERWISE.

	SAFETY INJECTION		FLORIDA POWER & LIGHT TURKEY POINT NUCLEAR UNIT 4	
			LICENSE RENEWAL BOUNDARY DRAWING	
	DRAWING NUMBER	REVISION	DRAWING NUMBER	REVISION
	4-SI-02	0		