


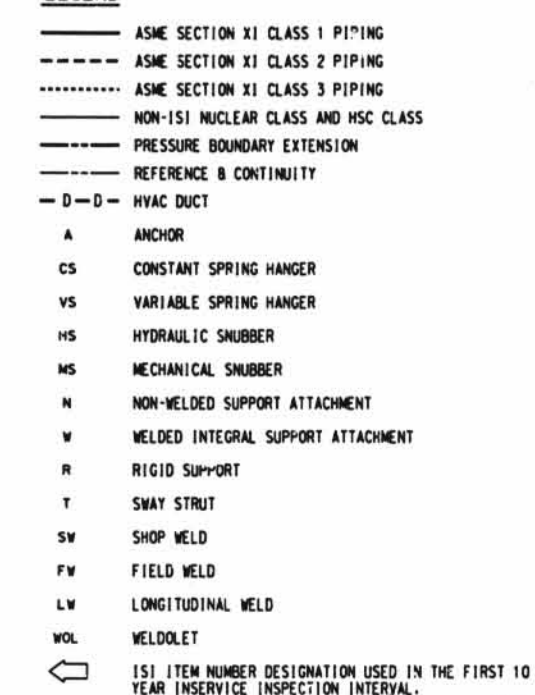

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2NHS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. CLASS 2 PIPING DOWNSTREAM OF VALVE DN-79 ON THIS DRAWING IS NON-EXCEPT, HOWEVER NO EXAMINATIONS ARE REQUIRED PER TABLE TWO-2500-1, CATEGORY C-F-1 BASED ON PIPE WALL THICKNESS.
3. PIPING SYSTEMS ON THIS DRAWING WHICH ARE OUTSIDE OF THE 151 BODY AND ARE SHOWN FOR REFERENCE AND/OR CONTINUITY PURPOSES ONLY IN THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

ISID2-033A HIGH PRESSURE INJECTION

[illegible]

K D-21