



LEGEND

- ASME SECTION XI CLASS 1 PIPING
- - - ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D - D - HYAC DUCT
- A ANCHOR
- CS CONSTANT SPRING HANGER
- VS VARIABLE SPRING HANGER
- HS HYDRAULIC SNUBBER
- MS MECHANICAL SNUBBER
- N NON-WELDED SUPPORT ATTACHMENT
- V WELDED INTEGRAL SUPPORT ATTACHMENT
- R RIGID SUPPORT
- T SWAY STRUT
- SW SHOP WELD
- FW FIELD WELD
- LW LONGITUDINAL WELD
- WOL WELDLET
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:


1. 4" X 2 1/2" CONCENTRIC REDUCER IS TAPERED FROM SCH. 160 ON SMALL END TO SCH. 120 ON LARGE END.

GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

IS102-0330 HIGH PRESSURE INJECTION

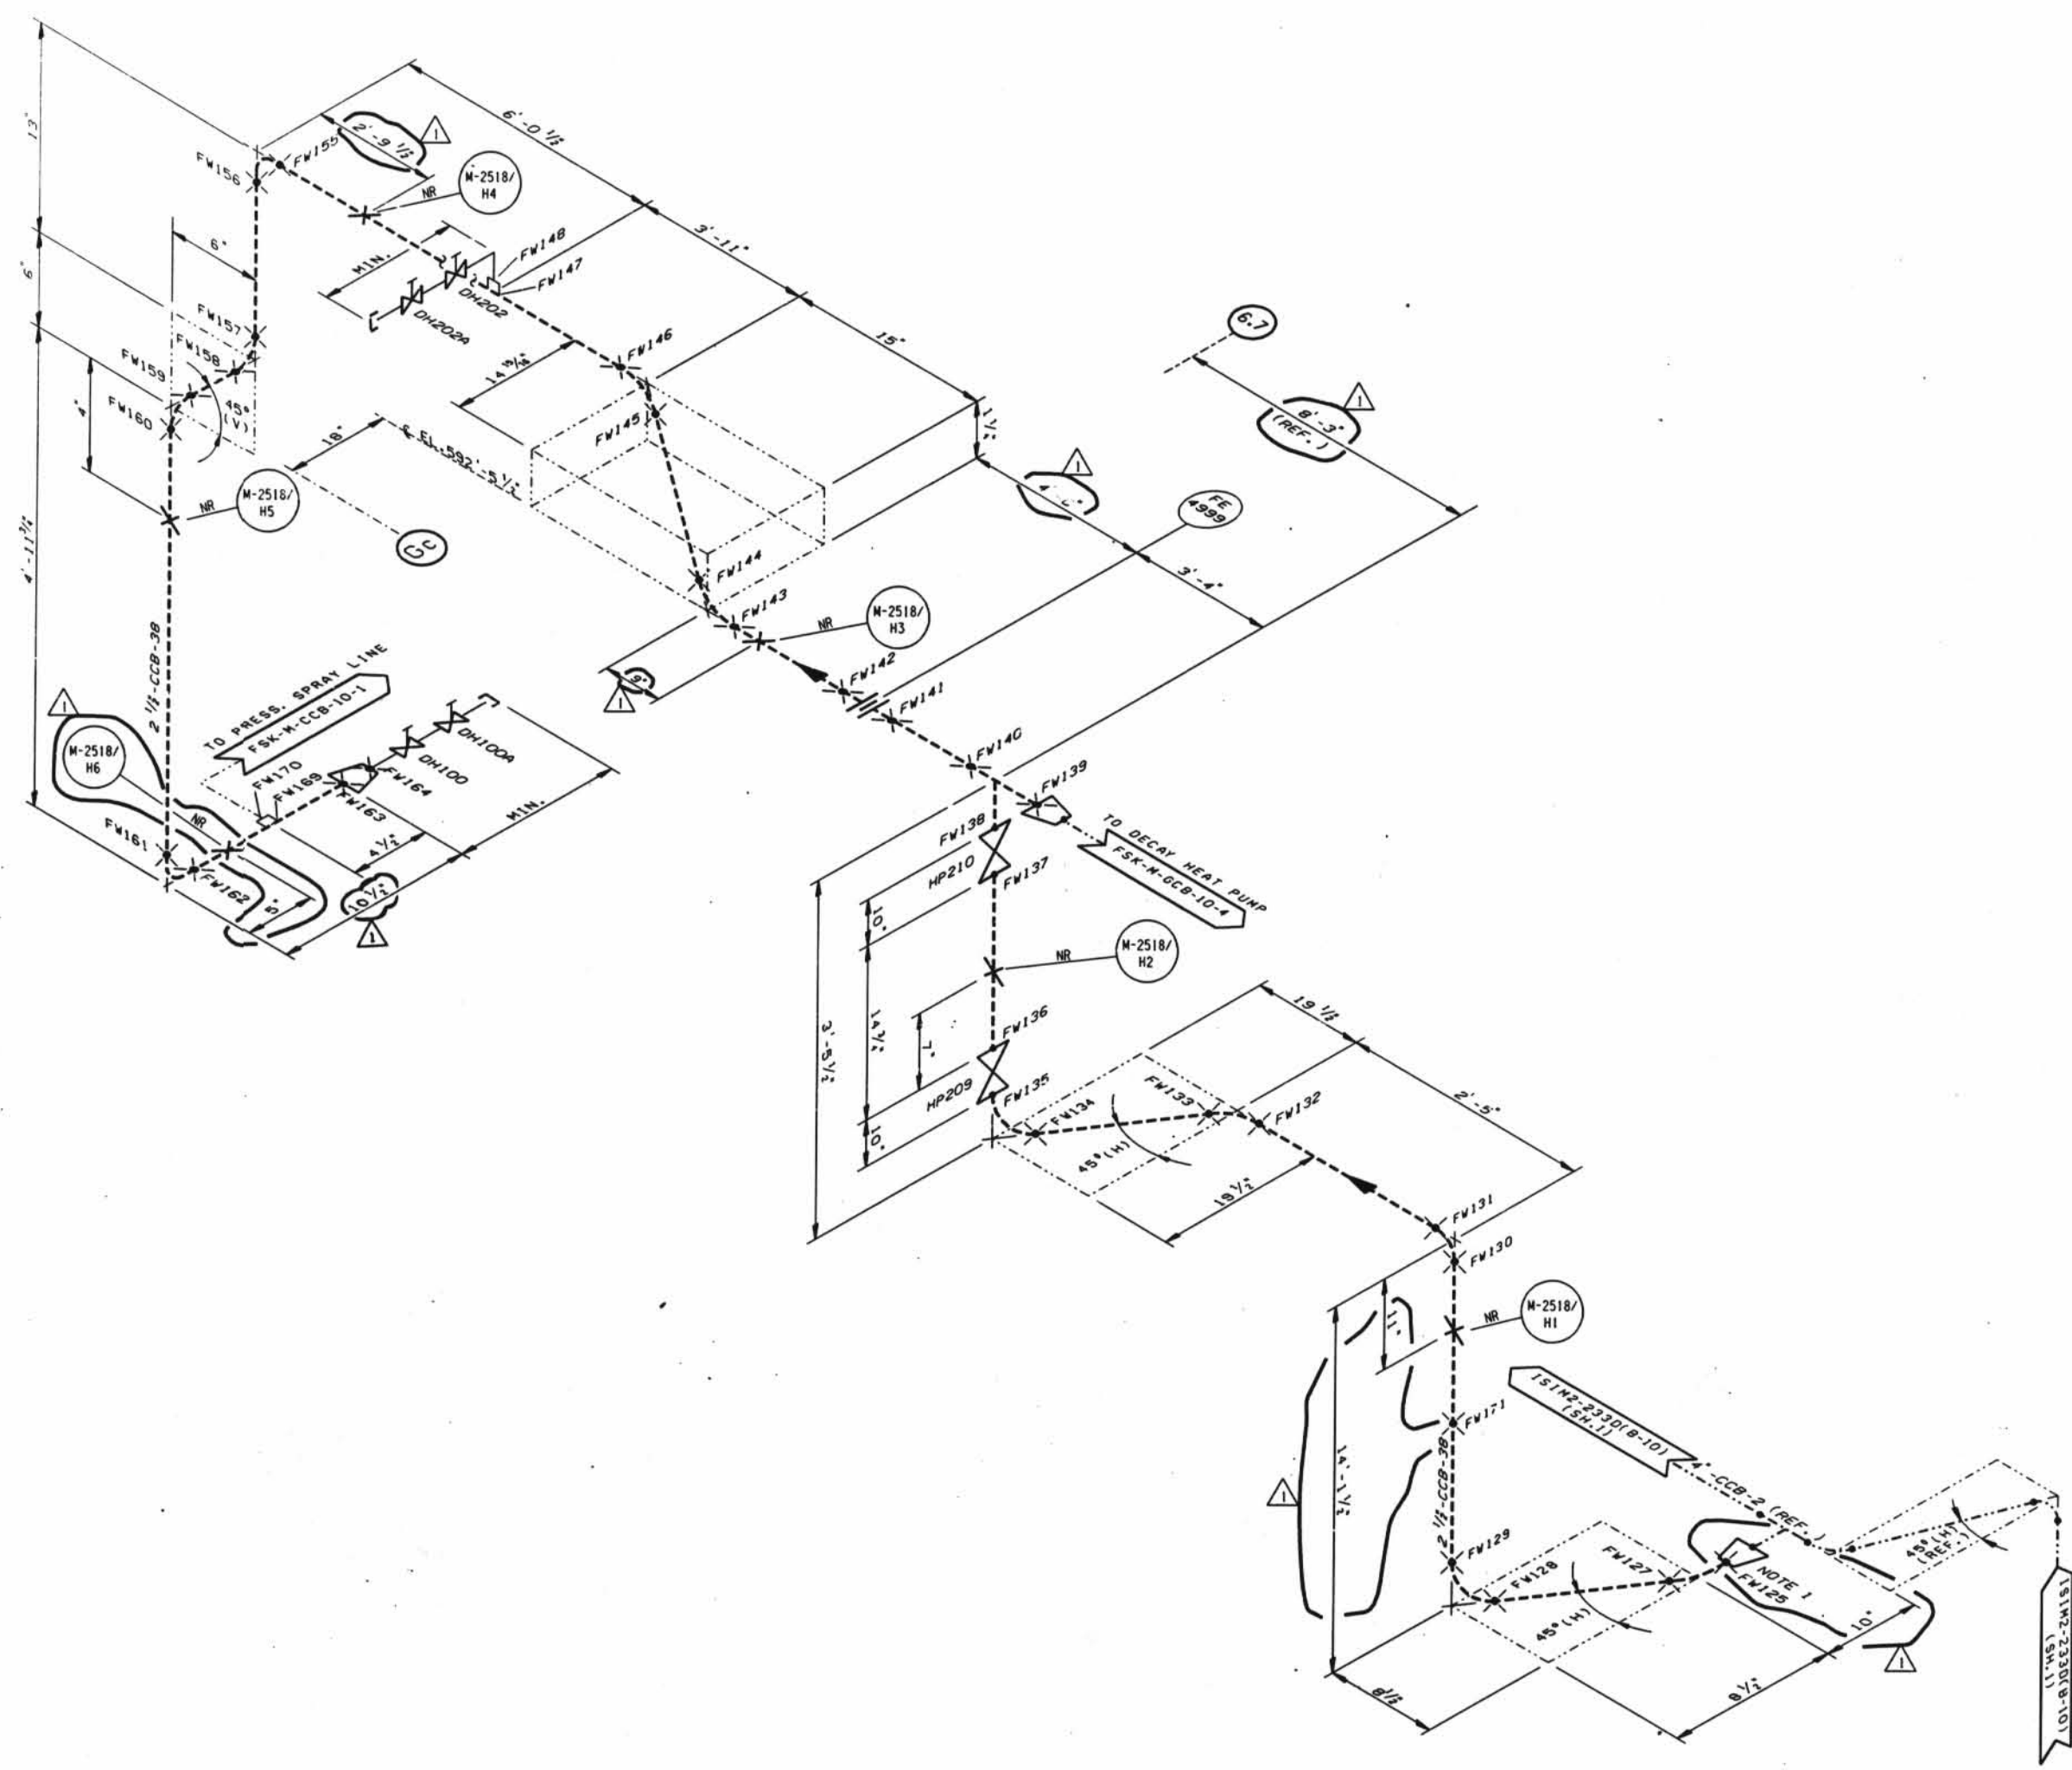

INC. DCM IS102-2330-16 PER MOD 97-0074 SUPP. 0		JOB NO.	DATE
ISSUED FOR MOD 97-0074 SUP. 00		INITIALS ON FILE	
NO.	DATE	REVISIONS	BY
SCALE N.T.S.	DESIGNED BY	DRAWN BY	DATE 09-01-99
DAVIS-BESSE NUCLEAR POWER STATION UNIT NO. 1			
INSERVICE INSPECTION ISOMETRIC H.P. INJECTION SYSTEM AUXILIARY BUILDING			
DRAWING NO.		REV.	
ISIM2-2330 SHEET 4		1	

D-29

7-11-00 Lisa Bowne 30x