


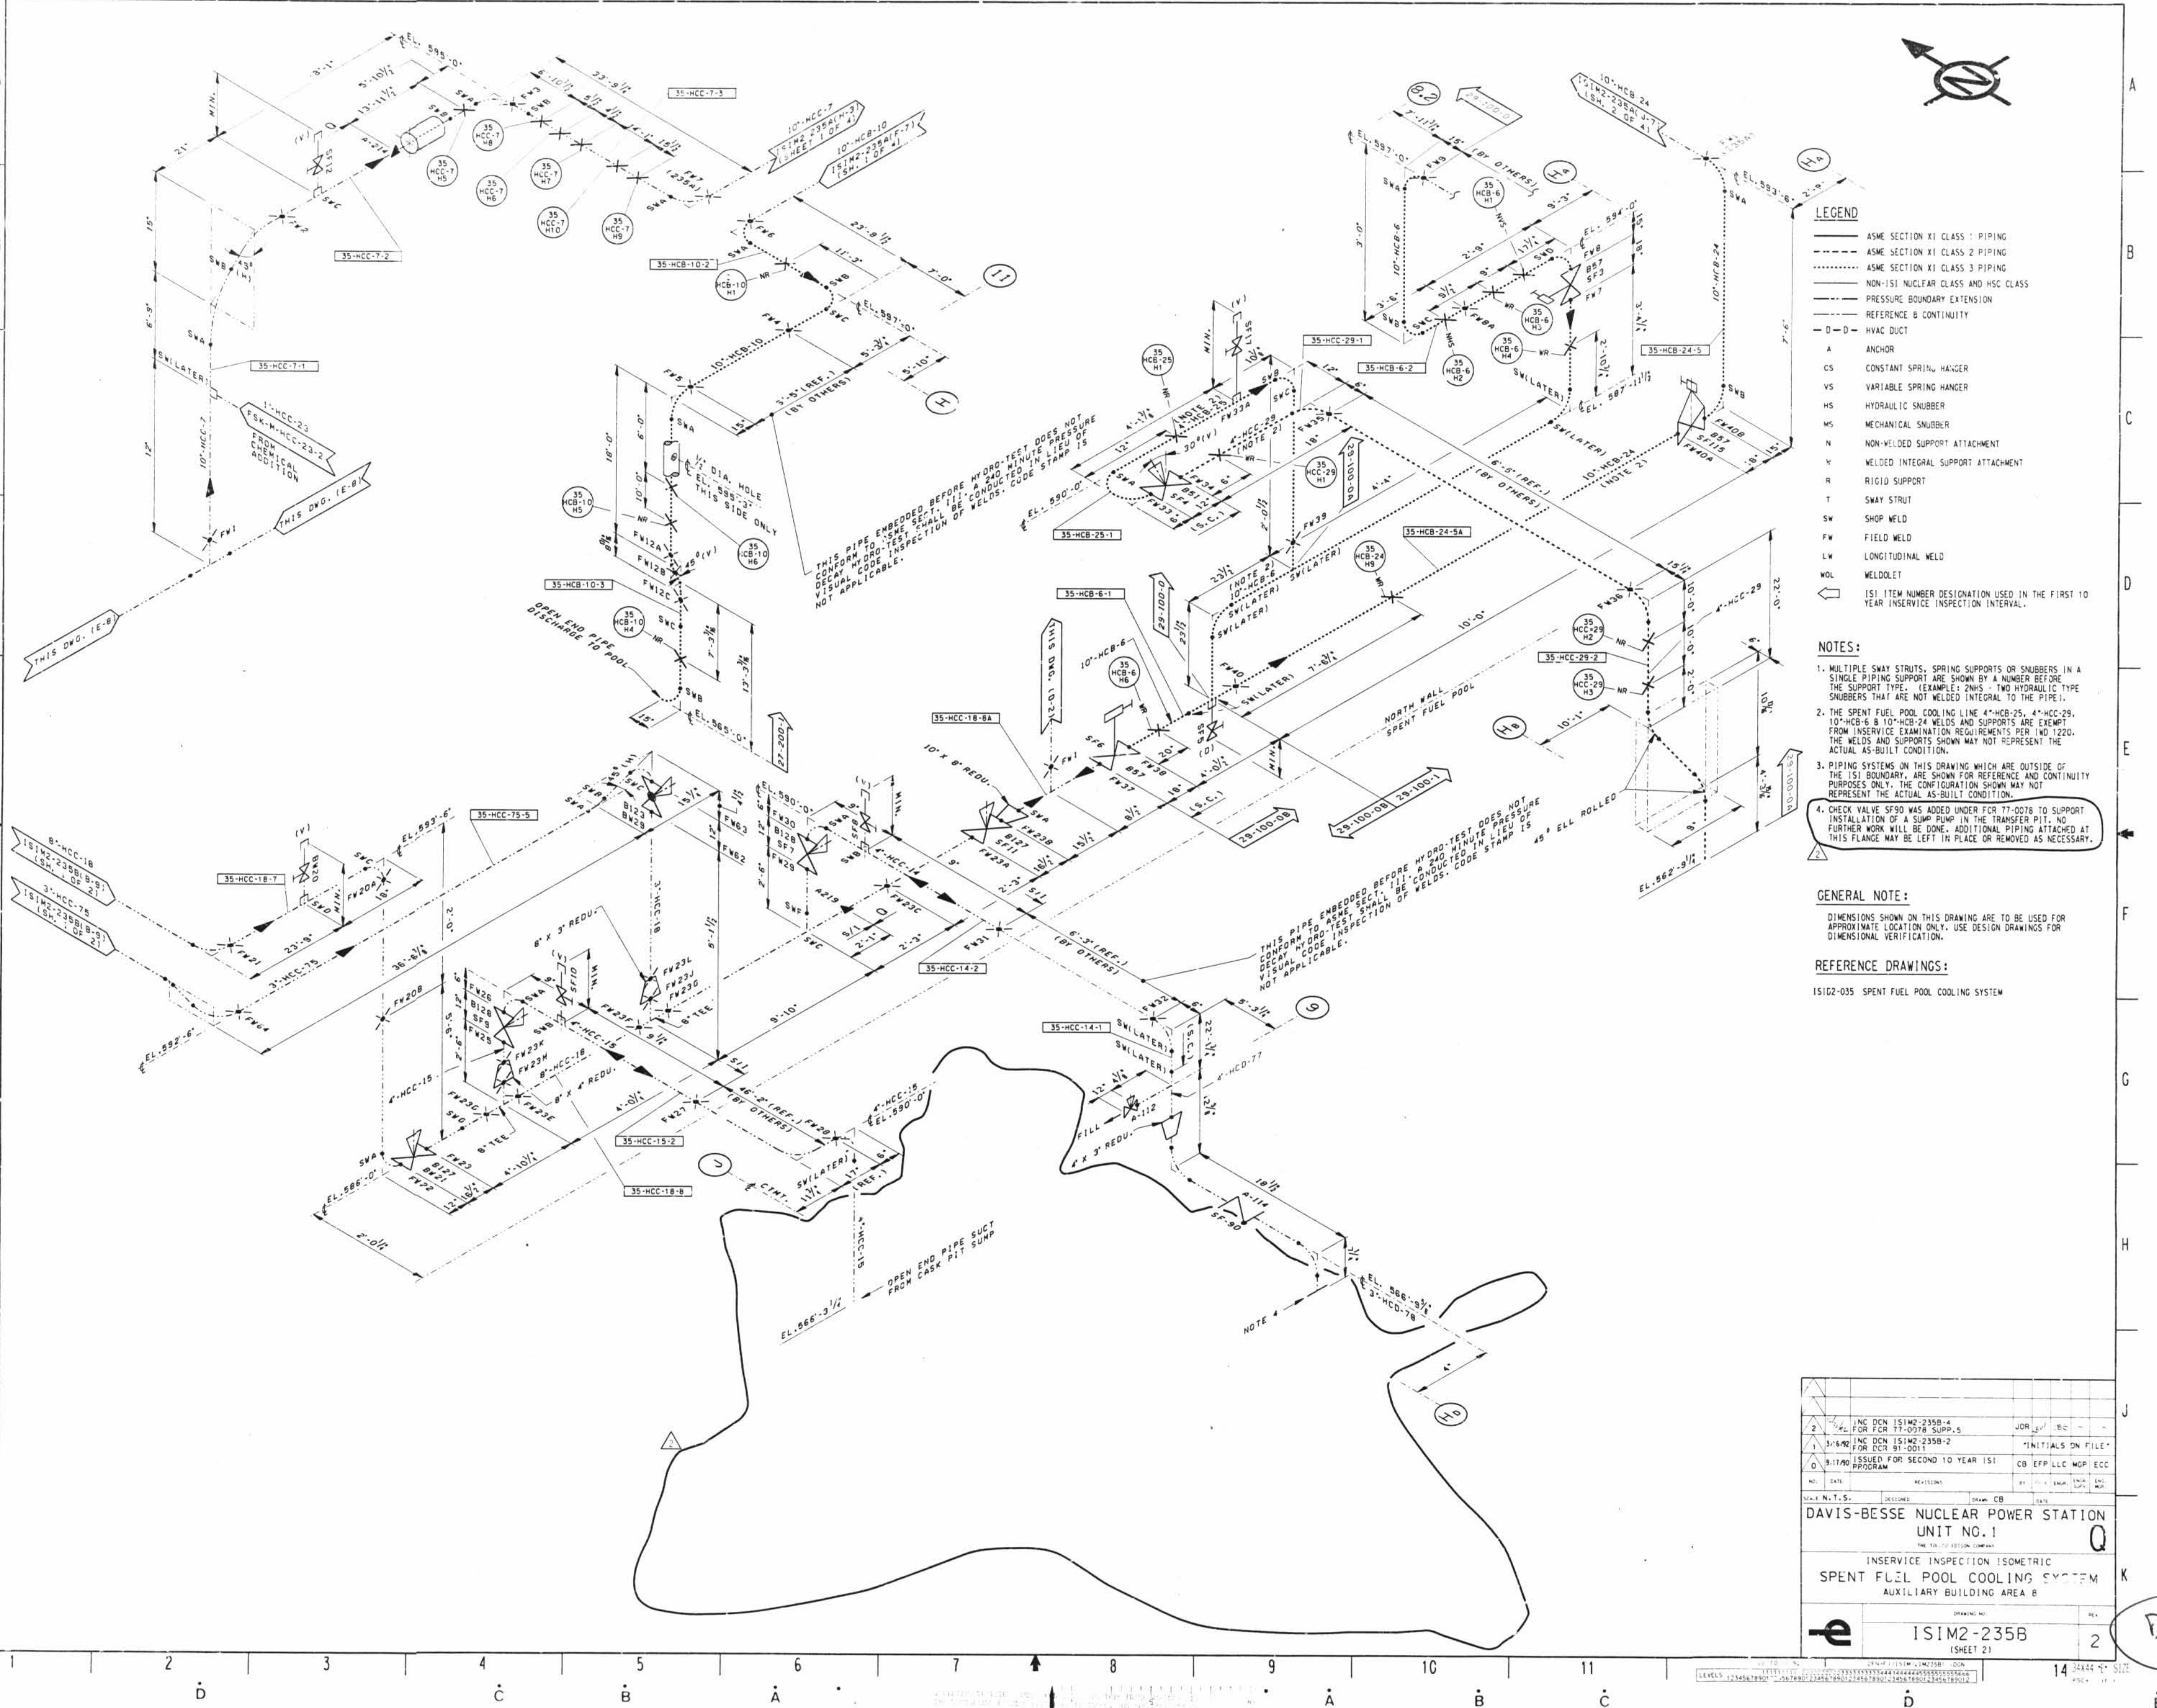

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-151 NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE B CONTINUITY
- HVAC DUCT
- ANCHOR
- CONSTANT SPRING HANGER
- VARIABLE SPRING HANGER
- HYDRAULIC SNUBBER
- MECHANICAL SNUBBER
- NON-WELDED SUPPORT ATTACHMENT
- WELDED INTEGRAL SUPPORT ATTACHMENT
- RIGID SUPPORT
- SWAY STRUT
- SHOP WELD
- FIELD WELD
- LONGITUDINAL WELD
- WELDLET
- 151 ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL

NOTES:

- MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2NHS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE.)
- THE SPENT FUEL POOL COOLING LINE 4\"/>

GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

15102-035 SPENT FUEL POOL COOLING SYSTEM

2	INC DCN 15102-235B-4 FOR PFR 77-0774 SUPP-5	WORK	REV	
3/16/92	INC DCN 15102-235B-2 FOR DCR 91-0011	INITIALS ON FILE		
0	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB EPP LLC MDP ECC		
NO.	DATE	REVISIONS	BY	CHKD
NO.	DATE	REVISIONS	BY	CHKD
DAVIS-BESSE NUCLEAR POWER STATION UNIT NO. 1				
INSERVICE INSPECTION ISOMETRIC				
SPENT FUEL POOL COOLING SYSTEM				
AUXILIARY BUILDING AREA B				
ISIM2-235B (SHEET 2)				

D-49