


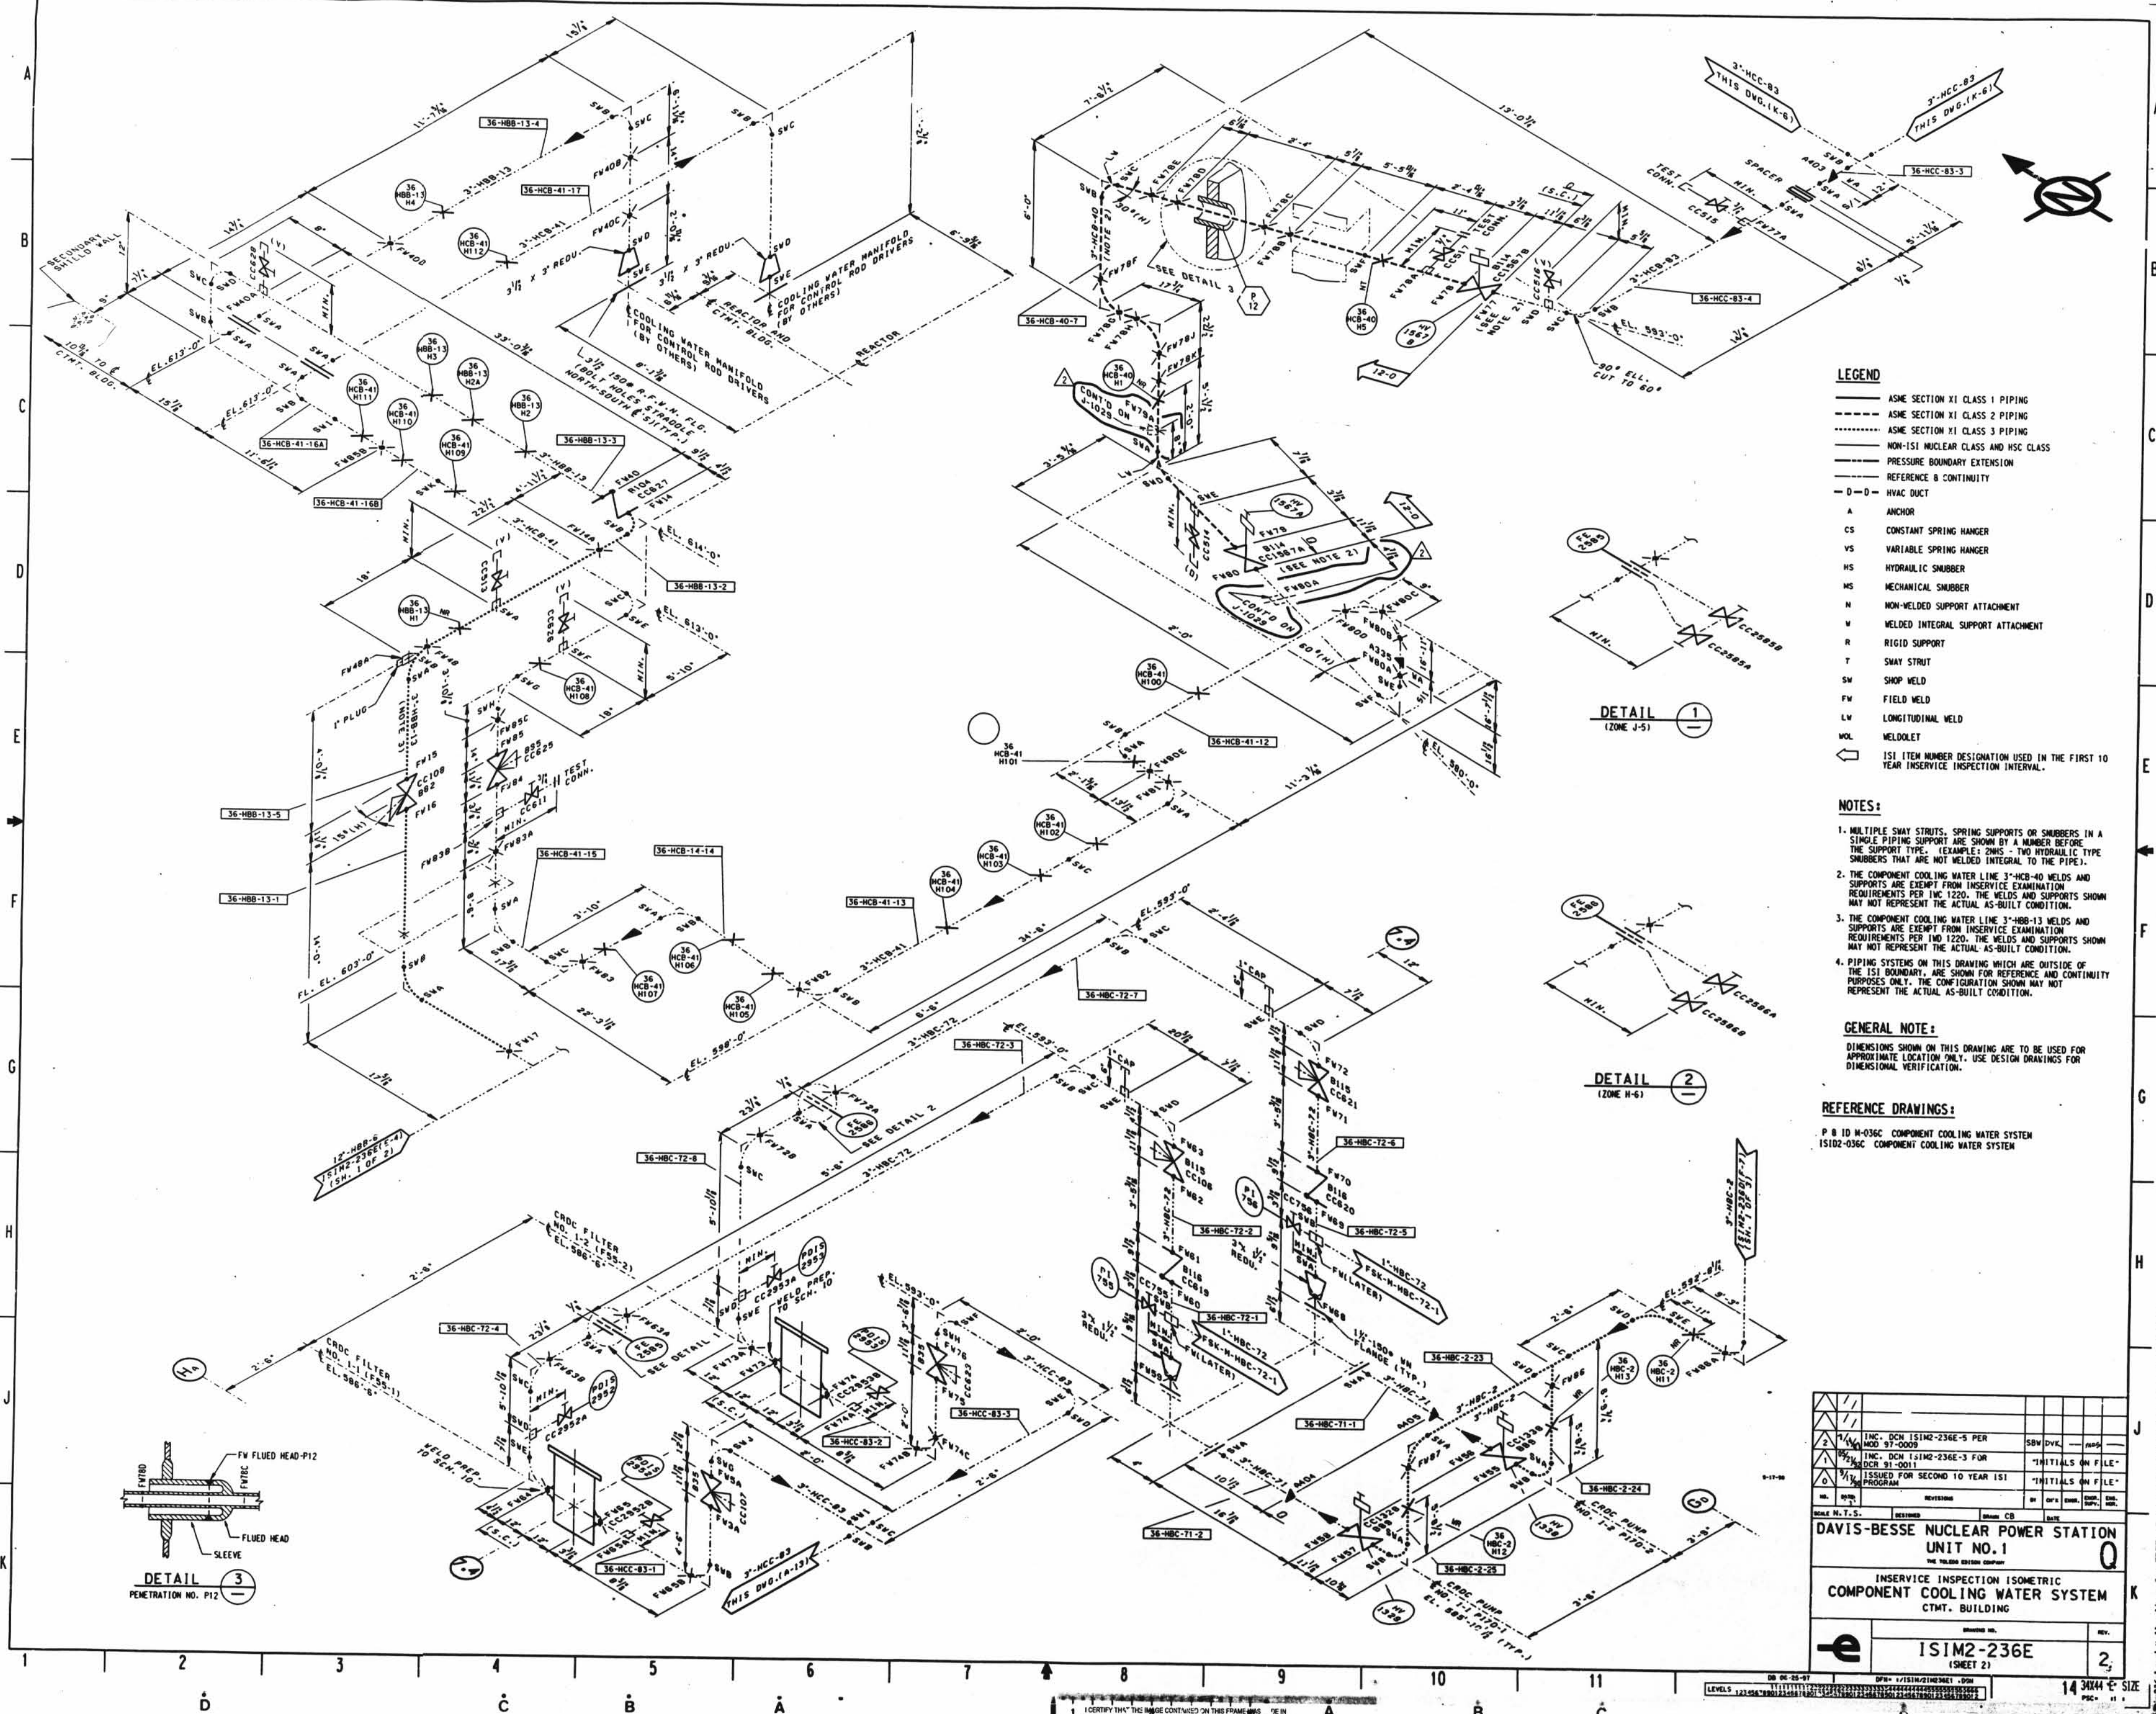

- LEGEND**
- ASME SECTION XI CLASS 1 PIPING
 - ASME SECTION XI CLASS 2 PIPING
 - ASME SECTION XI CLASS 3 PIPING
 - NON-151 NUCLEAR CLASS AND HSC CLASS
 - PRESSURE BOUNDARY EXTENSION
 - REFERENCE & CONTINUITY
 - D-D-H HVAC DUCT
 - A ANCHOR
 - CS CONSTANT SPRING HANGER
 - VS VARIABLE SPRING HANGER
 - HS HYDRAULIC SNUBBER
 - MS MECHANICAL SNUBBER
 - N NON-WELDED SUPPORT ATTACHMENT
 - W WELDED INTEGRAL SUPPORT ATTACHMENT
 - R RIGID SUPPORT
 - T SHAY STRUT
 - SW SHOP WELD
 - FW FIELD WELD
 - LW LONGITUDINAL WELD
 - WOL WELDOUT
 - ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

- NOTES:**
1. MULTIPLE SHAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2MS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
 2. THE COMPONENT COOLING WATER LINE 36-HCB-40 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER 10C 1220, THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.
 3. THE COMPONENT COOLING WATER LINE 36-HCB-13 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER 10C 1220, THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.
 4. PIPING SYSTEMS ON THIS DRAWING WHICH ARE OUTSIDE OF THE ISI BOUNDARY, ARE SHOWN FOR REFERENCE AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE:
DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

- REFERENCE DRAWINGS:**
- P 8 10 H-036C COMPONENT COOLING WATER SYSTEM
 - 15102-036C COMPONENT COOLING WATER SYSTEM

REVISION		DATE	BY	CHKD	APP'D
1	INC. DCH 151M2-236E-5 PER MOD 97-0009				
2	INC. DCH 151M2-236E-3 FOR DCH 97-0011				
3	ISSUED FOR SECOND 10 YEAR ISI PROGRAM				
DAVIS-BESSE NUCLEAR POWER STATION UNIT NO. 1 INSERVICE INSPECTION ISOMETRIC COMPONENT COOLING WATER SYSTEM CMT. BUILDING ISSUED FOR SECOND 10 YEAR ISI PROGRAM 151M2-236E (SHEET 2)					

This drawing is a reproduction of the original drawing. It is not to be used for construction purposes. It is for reference only. The original drawing is the only authoritative source for the design. The original drawing is located in the drawing room of the Davis-Besse Nuclear Power Station. The original drawing is dated 02/19/94 PM EDT.

D-61