


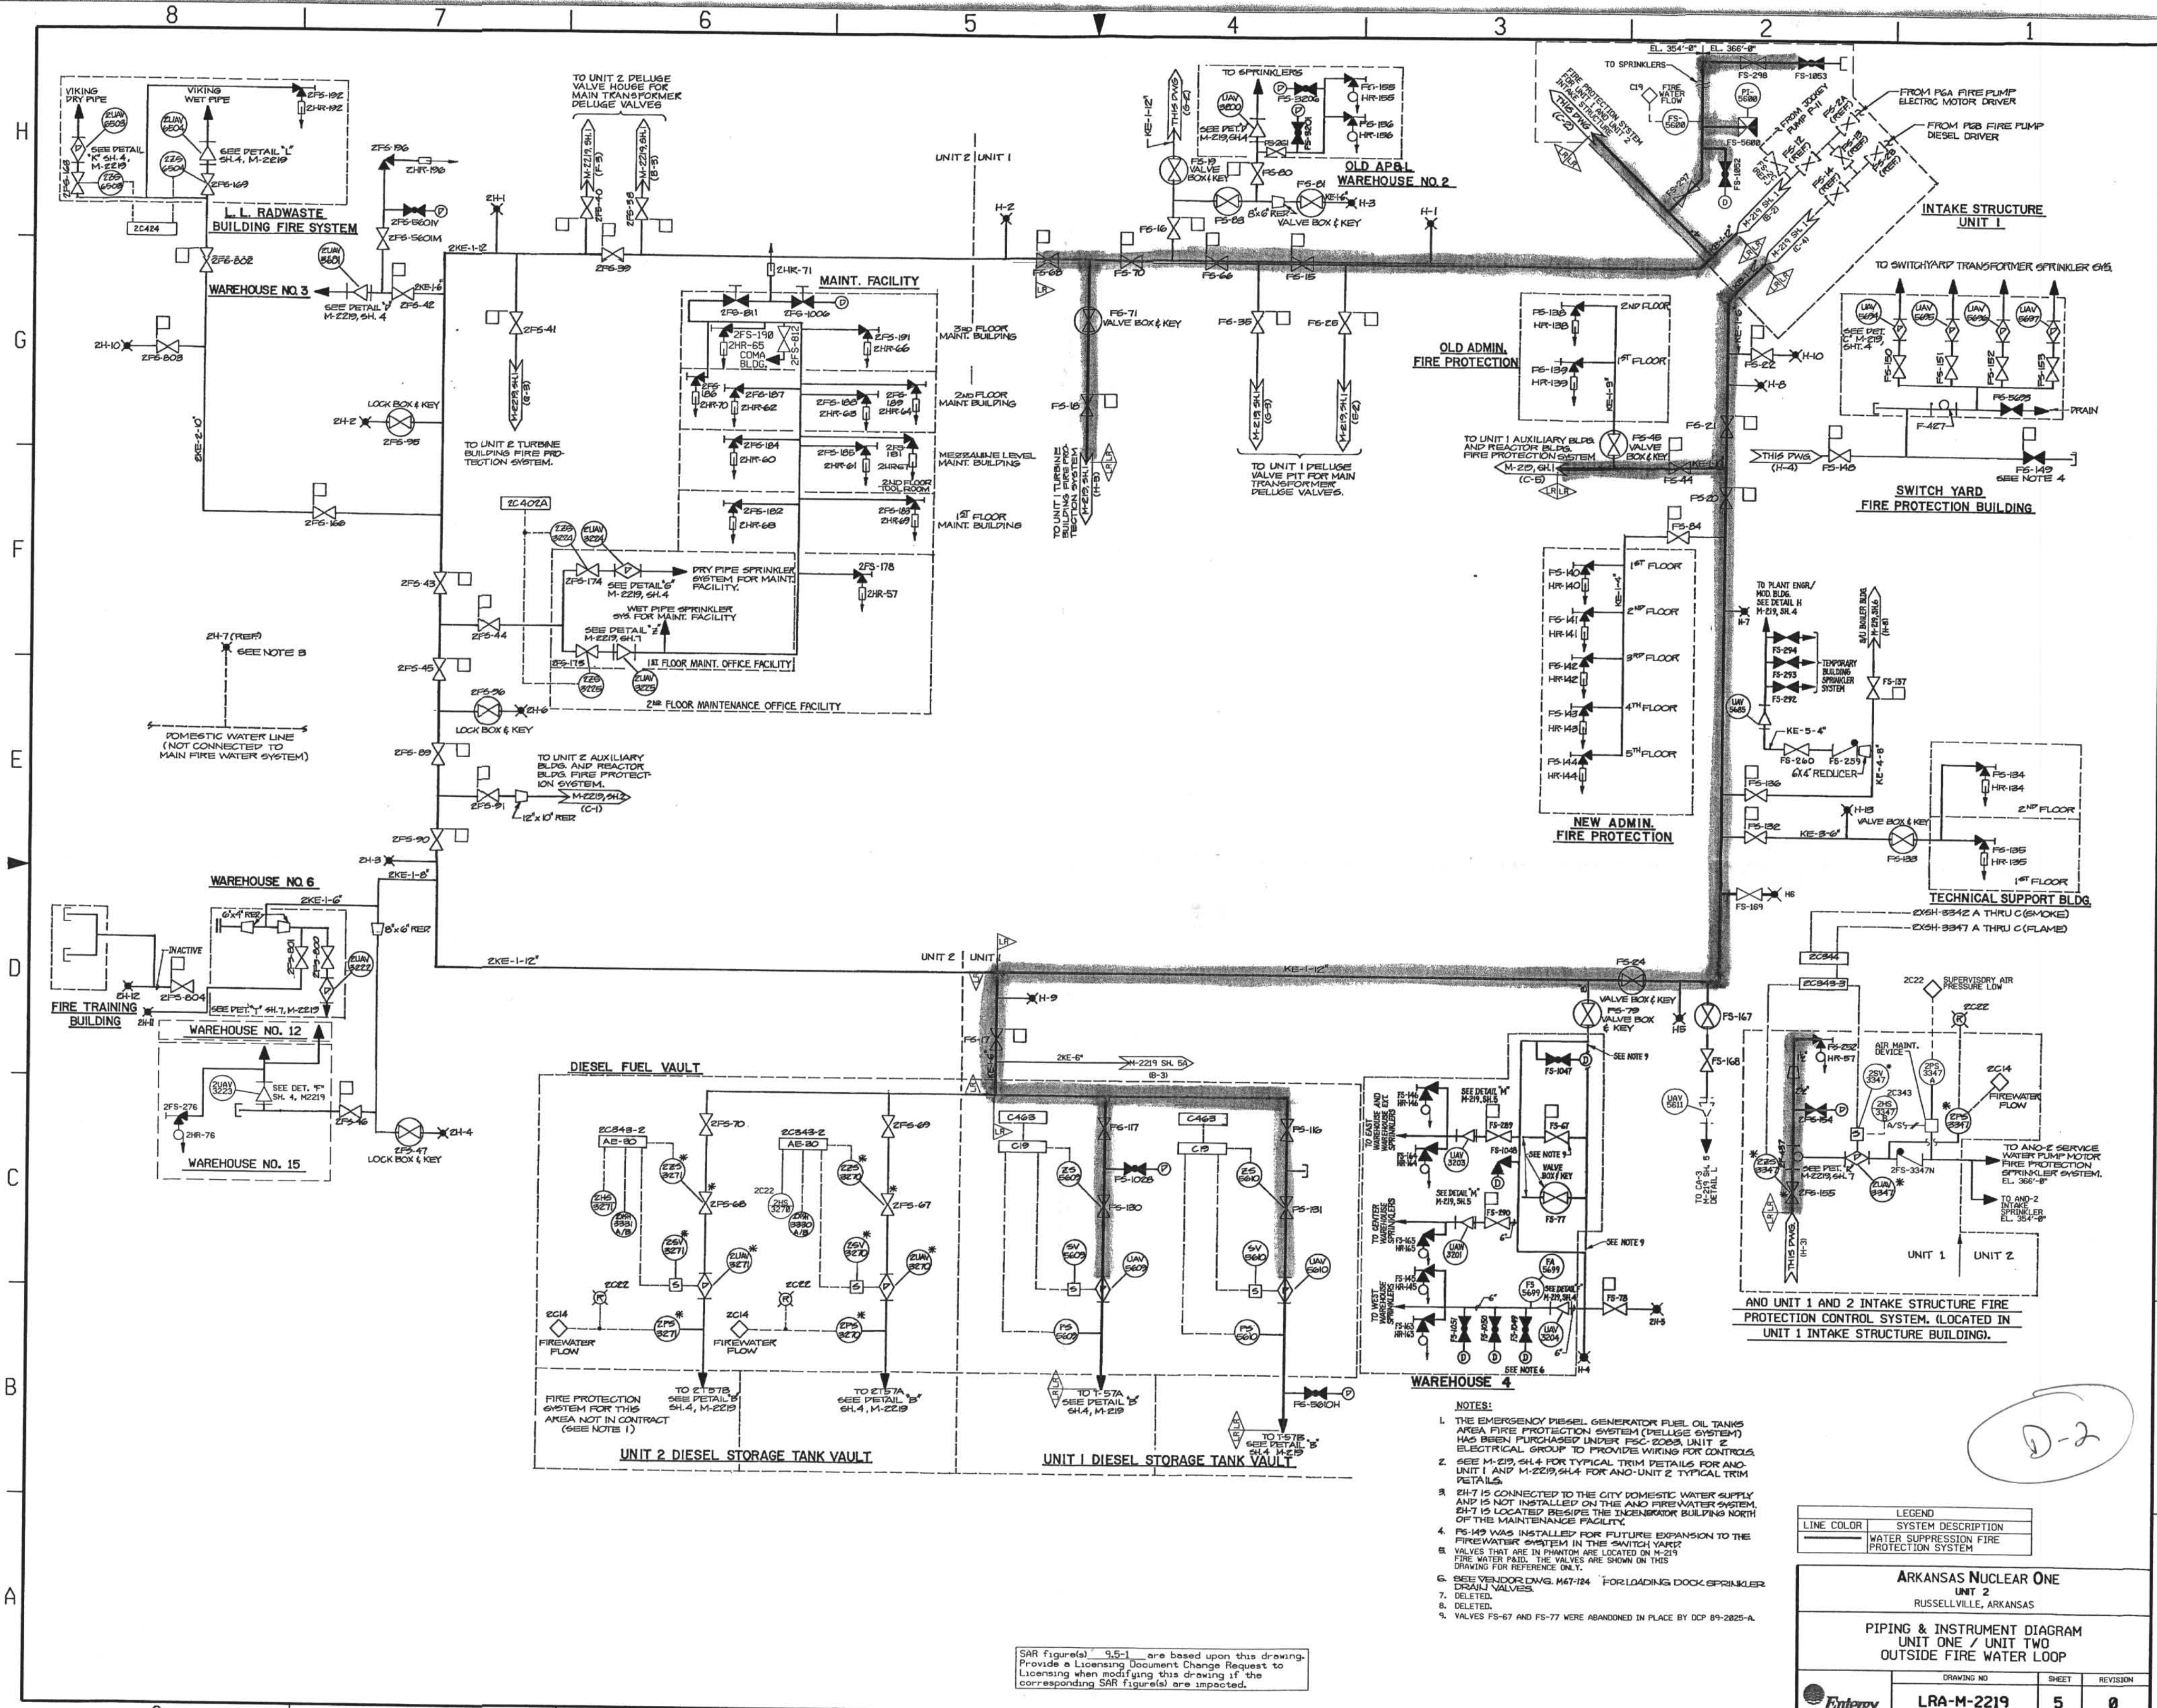

- NOTES:
1. THE EMERGENCY DIESEL GENERATOR FUEL OIL TANKS AREA FIRE PROTECTION SYSTEM (DELLAGE SYSTEM) HAS BEEN PURCHASED UNDER FSC-2003. UNIT ELECTRICAL GROUP TO PROVIDE WIRING FOR CONTROLS.
 2. SEE M-219, SH. 4 FOR TYPICAL TRIM DETAILS FOR ANO-UNIT 1 AND M-229, SH. 4 FOR ANO-UNIT 2 TYPICAL TRIM DETAILS.
 3. ZH-7 IS CONNECTED TO THE CITY DOMESTIC WATER SUPPLY AND IS NOT INSTALLED ON THE ANO FIREWATER SYSTEM. ZH-7 IS LOCATED BESIDE THE INCENDIAR BUILDING NORTH OF THE MAINTENANCE FACILITY.
 4. FS-149 WAS INSTALLED FOR FUTURE EXPANSION TO THE FIREWATER SYSTEM IN THE SWITCH YARD.
 5. VALVES THAT ARE IN PHANTOM ARE LOCATED ON M-219 FIRE WATER PAID. THE VALVES ARE SHOWN ON THIS DRAWING FOR REFERENCE ONLY.
 6. SEE VENDOR DWG. M-219-124 FOR LOADING DOCK SPRINKLER DRAIN VALVES.
 7. DELETED.
 8. DELETED.
 9. VALVES FS-67 AND FS-77 WERE ABANDONED IN PLACE BY DCP 89-225-A.

LEGEND	
LINE COLOR	SYSTEM DESCRIPTION
—	WATER SUPPRESSION FIRE PROTECTION SYSTEM

ARKANSAS NUCLEAR ONE UNIT 2 RUSSELLVILLE, ARKANSAS		
PIPING & INSTRUMENT DIAGRAM UNIT ONE / UNIT TWO OUTSIDE FIRE WATER LOOP		
DRAWING NO.	SHEET	REVISION
LRA-M-2219	5	0

SAR figure(s) 9.5-1 are based upon this drawing. Provide a Licensing Document Change Request to Licensing when modifying this drawing if the corresponding SAR figure(s) are impacted.