


LNP COL 2.4-2

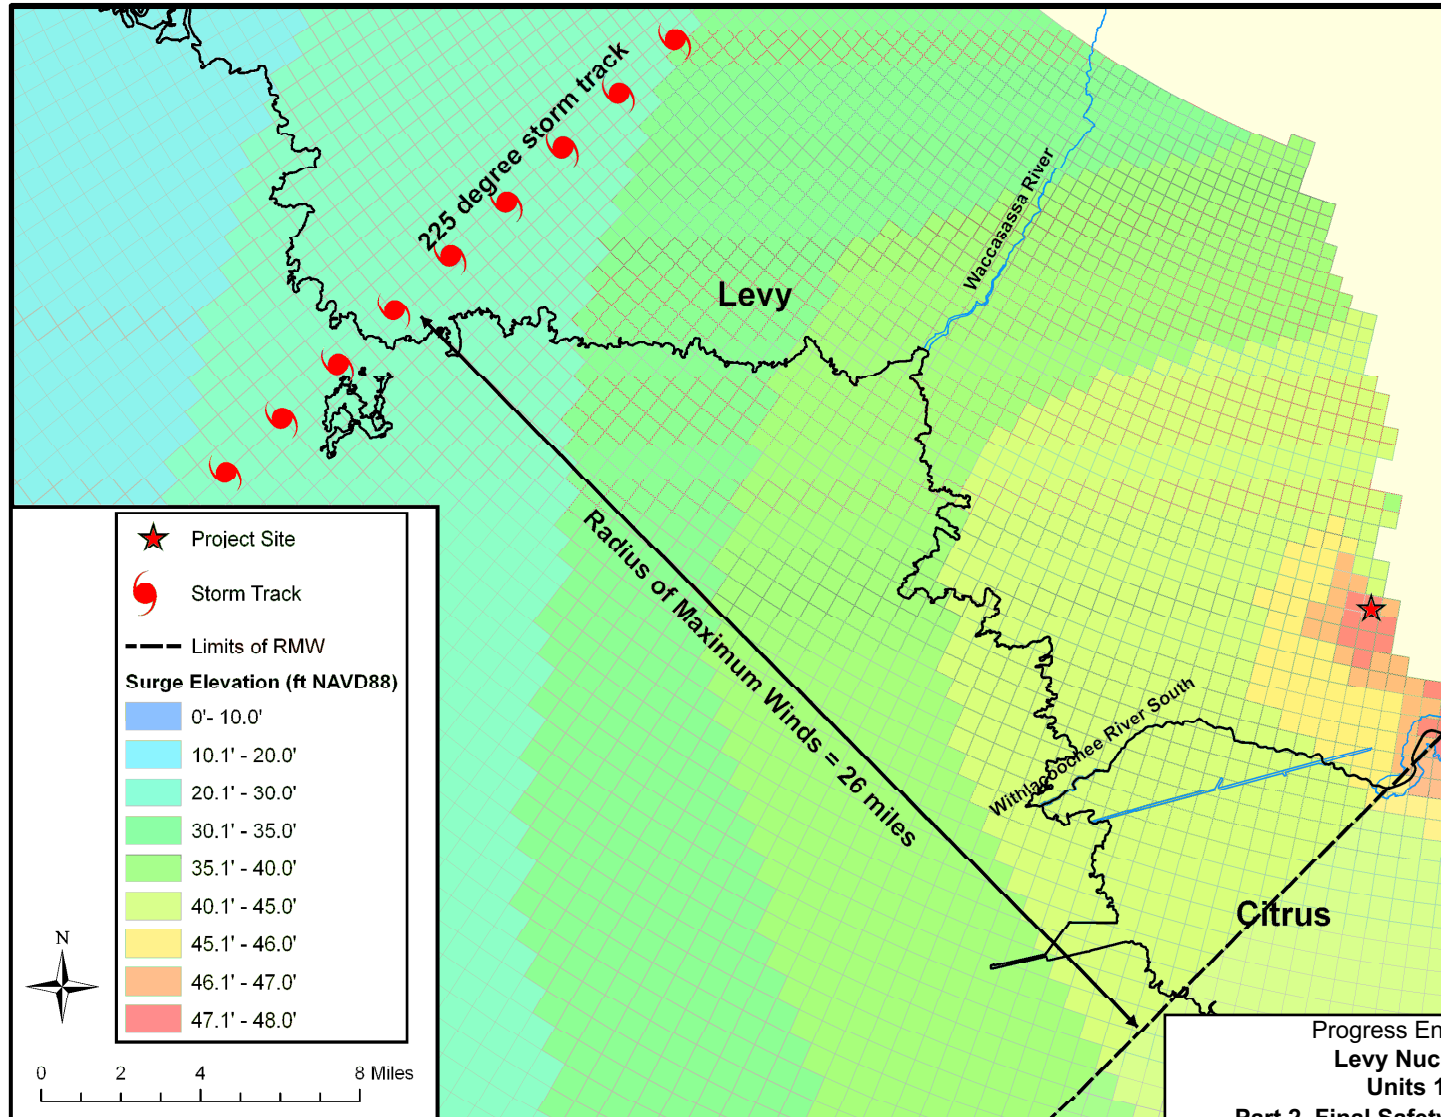

Progress Energy Florida
**Levy Nuclear Plant
 Units 1 and 2**
Part 2, Final Safety Analysis Report

PMH Parameters and Maximum Surge
 at LNP Site for Scenario 1
 FIGURE 2.4.5-240

Rev 3