


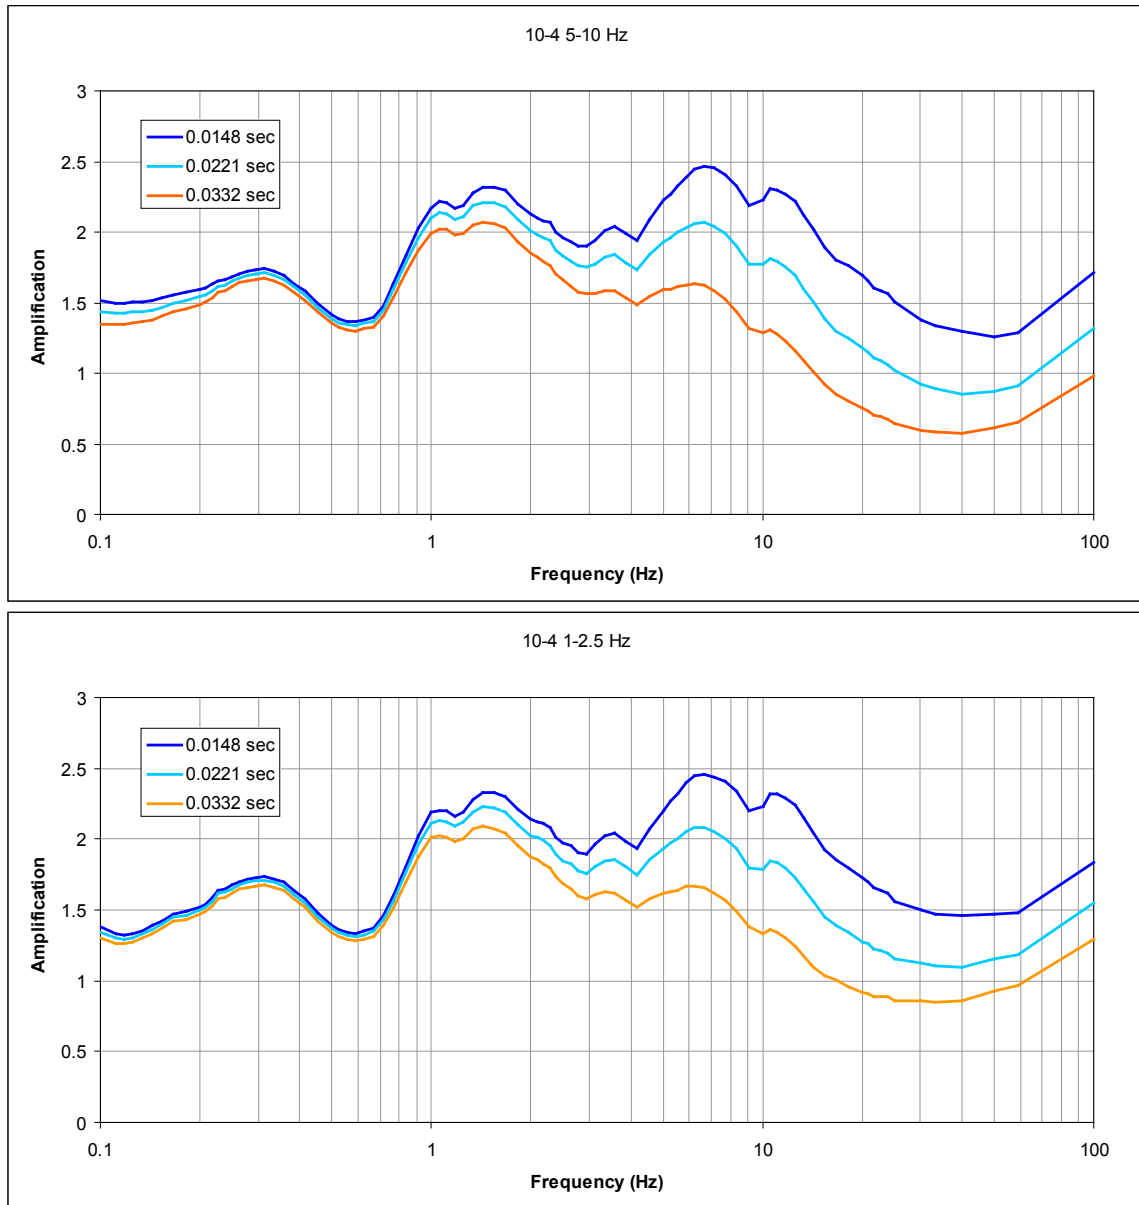

Progress Energy Florida
**Levy Nuclear Plant
 Units 1 and 2
 Part 2, Final Safety Analysis Report**

Sensitivity of Mean Site Amplification to
 Site κ for the LNP 1 GMRS Profile and the
 10^{-4} Ground Motion Input

FIGURE 2.5.2-270

Rev 0