


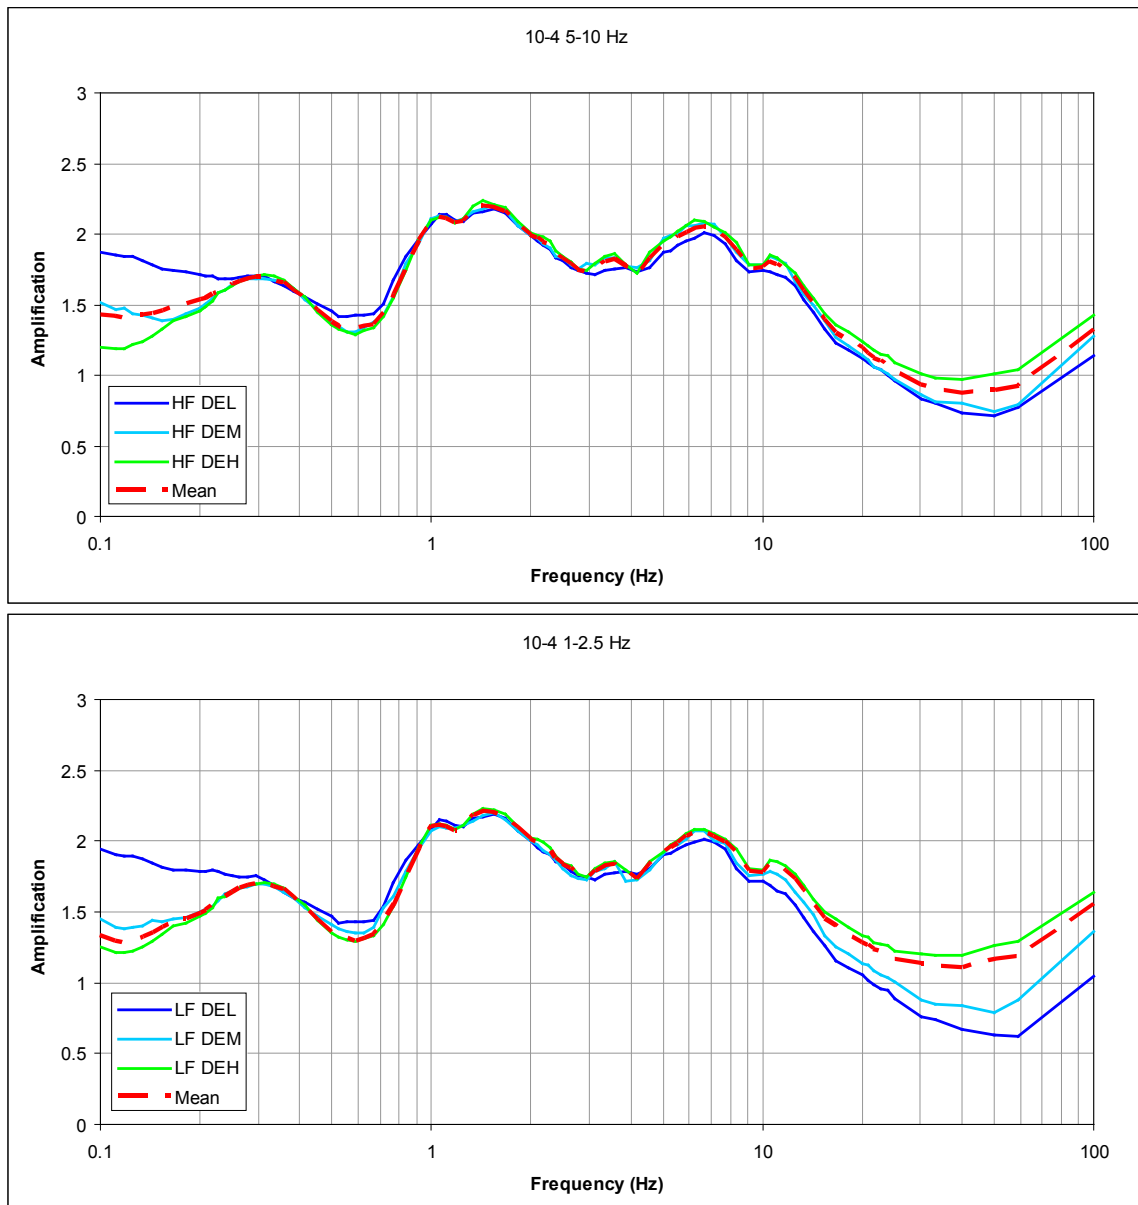

Note: LNP 1 GMRS Profile and 10^{-4} ground motion input

Progress Energy Florida
Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

Sensitivity of Mean Site Amplification
to Deaggregation Earthquake
Motions for LNP 1
FIGURE 2.5.2-272

Rev 0