


### La Salle 1

#### 2Q/2000 Performance Indicators

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

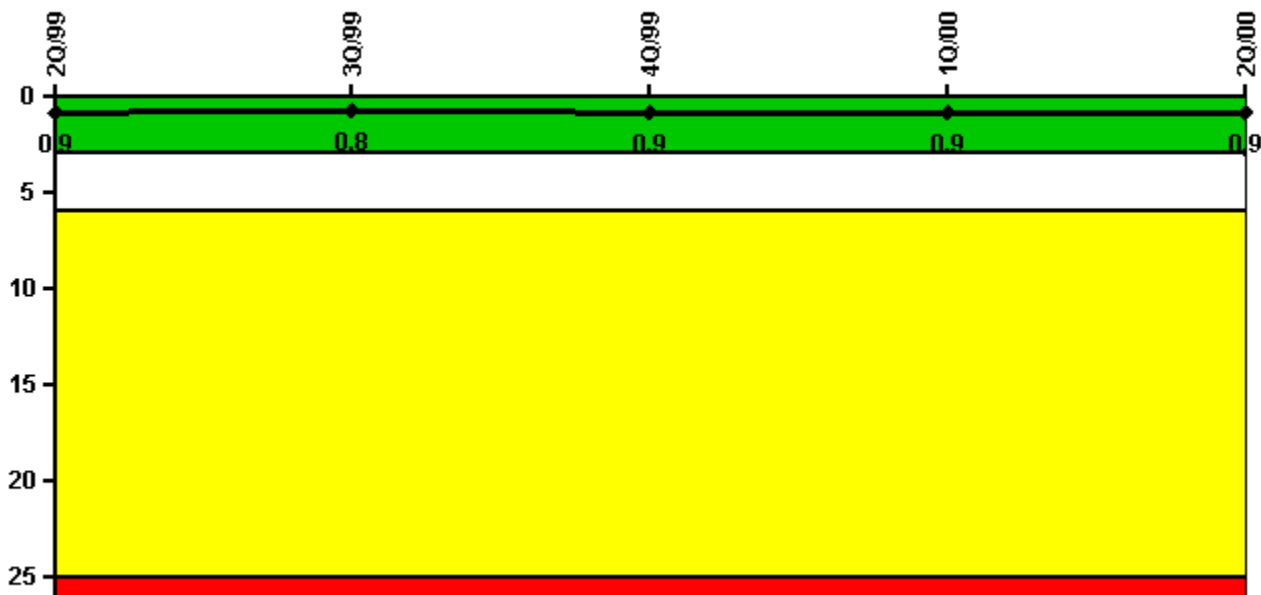

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

#### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned scrams	0	1.0	0	0	0
Critical hours	2183.0	2166.4	1509.8	2184.0	2183.0
<b>Indicator value</b>	<b>0.9</b>	<b>0.8</b>	<b>0.9</b>	<b>0.9</b>	<b>0.9</b>

Licensee Comments: none

### Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

#### Notes

Scrams with Loss of Normal Heat Removal	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Scrams	0	0	0	0	0
Indicator value			0	0	0

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

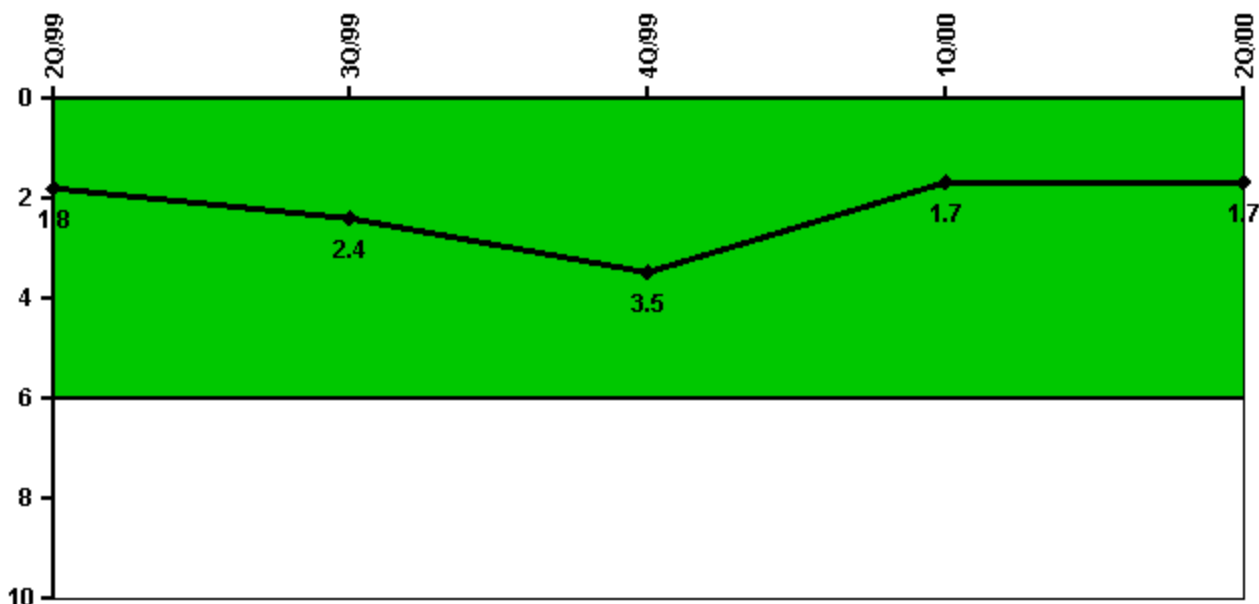


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned power changes	0	1.0	1.0	0	0
Critical hours	2183.0	2166.4	1509.8	2184.0	2183.0
<b>Indicator value</b>	<b>1.8</b>	<b>2.4</b>	<b>3.5</b>	<b>1.7</b>	<b>1.7</b>

Licensee Comments: none

### Safety System Unavailability, Emergency AC Power, >2EDG

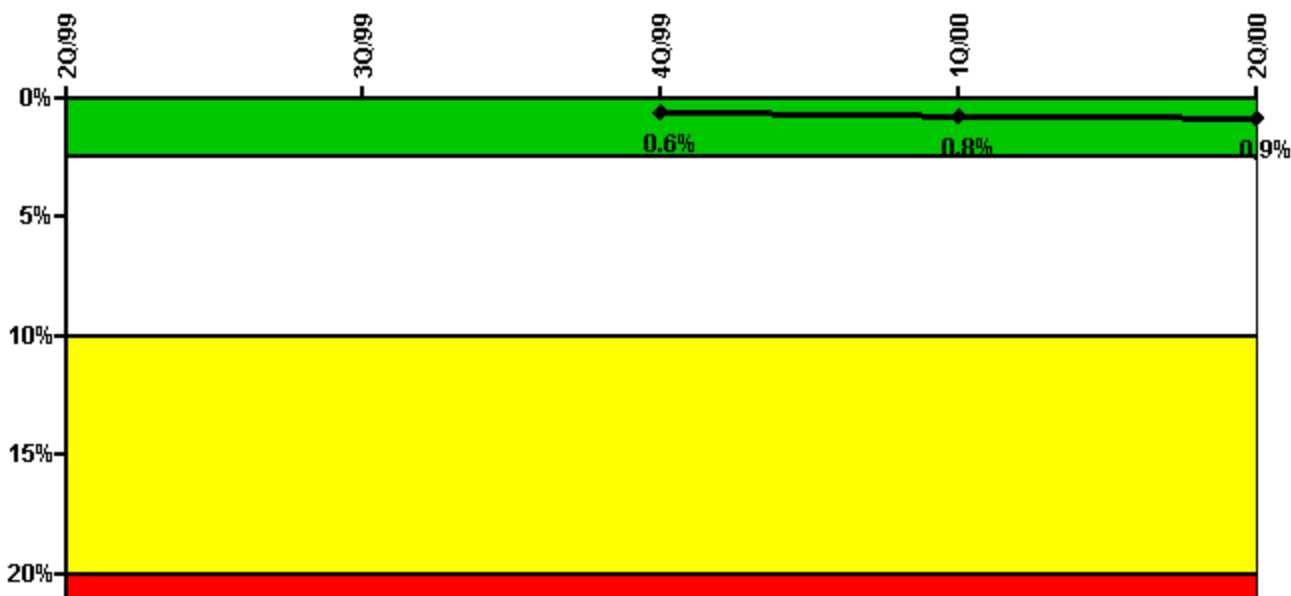


Thresholds: White > 2.5% Yellow > 10.0% Red > 20.0%

#### Notes

Safety System Unavailability, Emergency AC Power, >2EDG	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	1.90	27.20	134.30	40.35	0.85
Unplanned unavailable hours	0	0	0	0	17.00
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
<b>Train 2</b>					
Planned unavailable hours	0	51.80	1.30	39.57	1.05
Unplanned unavailable hours	12.60	0	0	5.77	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
<b>Train 3</b>					
Planned unavailable hours	63.10	59.40	13.20	32.75	43.90
Unplanned unavailable hours	0	31.00	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
<b>Indicator value</b>			<b>0.6%</b>	<b>0.8%</b>	<b>0.9%</b>

Licensee Comments: none

### Safety System Unavailability, High Pressure Injection System (HPCS)

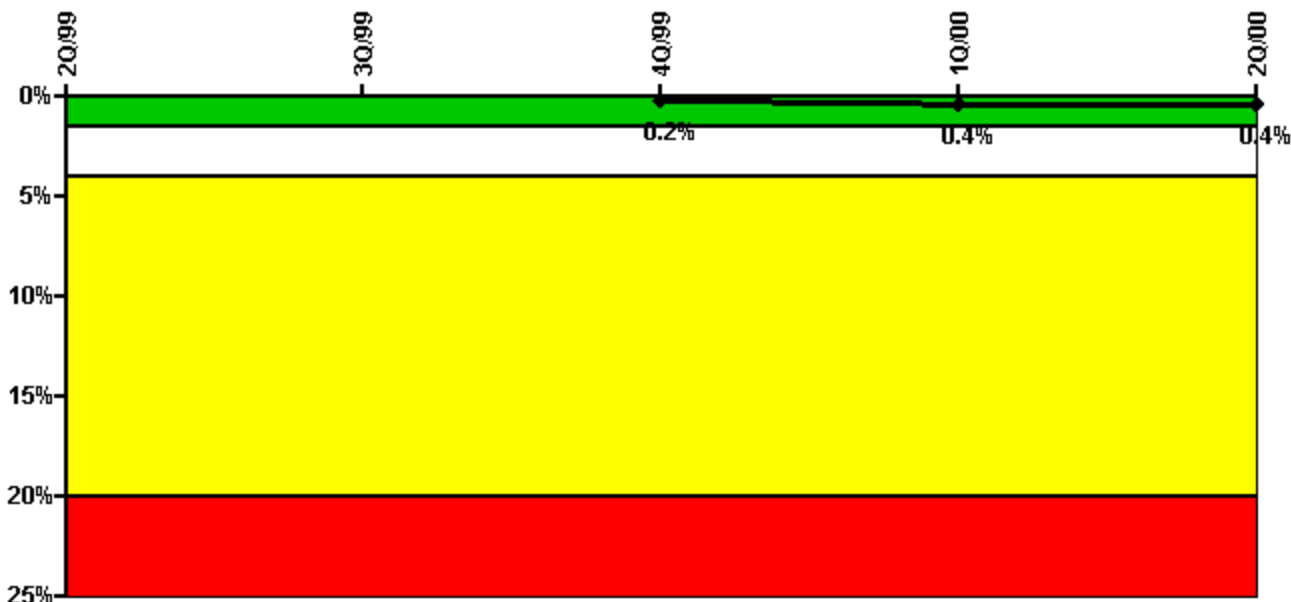

Thresholds: White > 1.5% Yellow > 4.0% Red > 20.0%


#### Notes

Safety System Unavailability, High Pressure Injection System (HPCS)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	14.30	0	0	29.40	4.60
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2166.40	1509.80	2184.00	2183.00
<b>Indicator value</b>			<b>0.2%</b>	<b>0.4%</b>	<b>0.4%</b>

Licensee Comments:

2Q/00: Error made in determining end time of Planned Unavailable Hours. Error found during review of Maintenance Rule data. The planned unavailable hours for May changed from 1.2 hours.

### Safety System Unavailability, Heat Removal System (RCIC)

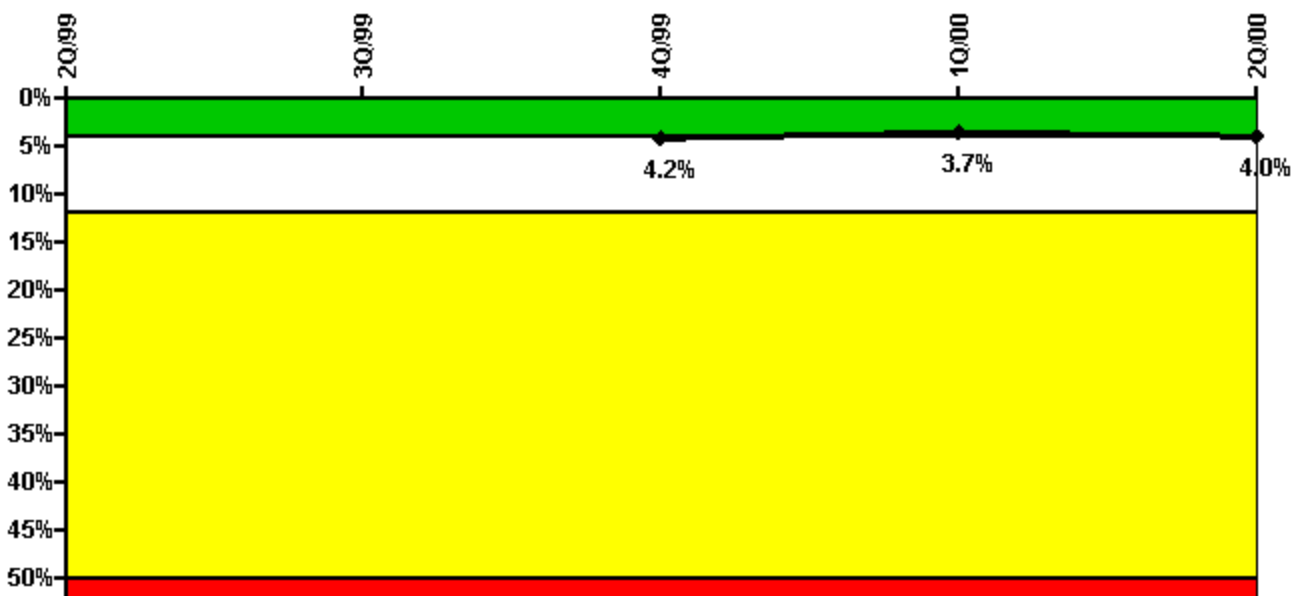

Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%


#### Notes

Safety System Unavailability, Heat Removal System (RCIC)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	1.50	94.90	0	24.80	92.30
Unplanned unavailable hours	0	0	5.90	0	20.40
Fault exposure hours	0	0	0	0	5.40
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2166.40	1509.80	2184.00	2183.00
<b>Indicator value</b>			<b>4.2%</b>	<b>3.7%</b>	<b>4.0%</b>

Licensee Comments:

2Q/00: Error found during review of maintenance rule hours. The planned unavailable hours changed from 39 to 42.9 hours for the month of May.

### Safety System Unavailability, Residual Heat Removal System

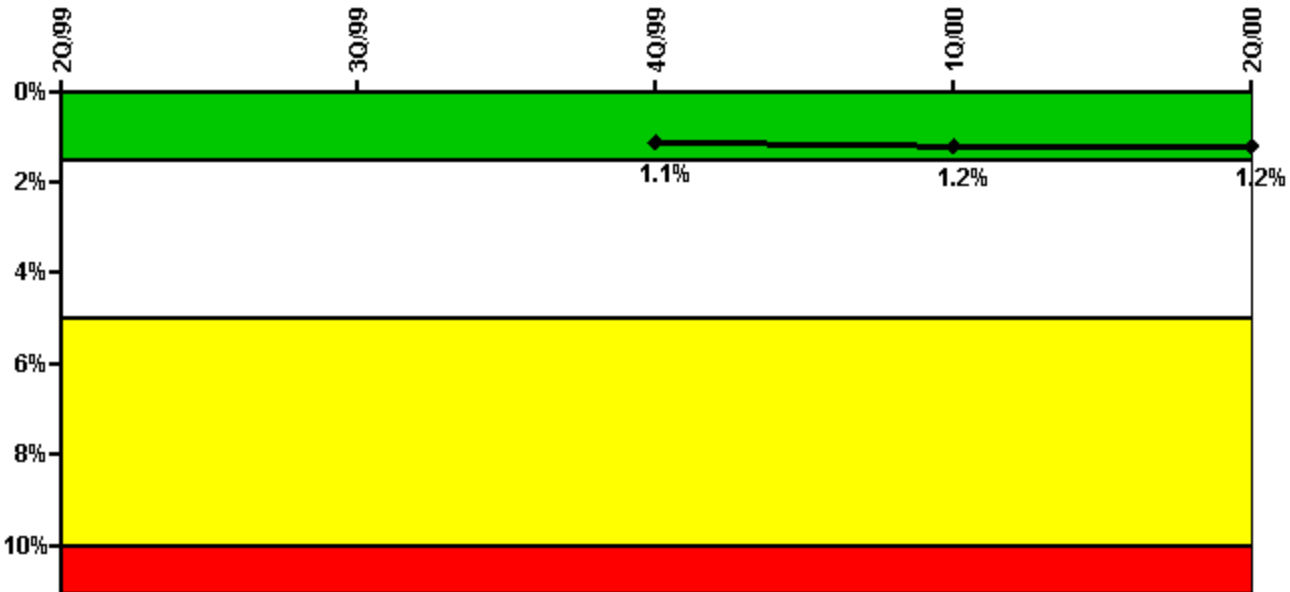


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

**Notes**

Safety System Unavailability, Residual Heat Removal System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	0	12.70	14.20	29.90	39.40
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
<b>Train 2</b>					
Planned unavailable hours	0	15.90	128.00	20.90	9.10
Unplanned unavailable hours	0	0	183.20	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
<b>Indicator value</b>			1.1%	1.2%	1.2%

Licensee Comments: none

### Safety System Functional Failures (BWR)

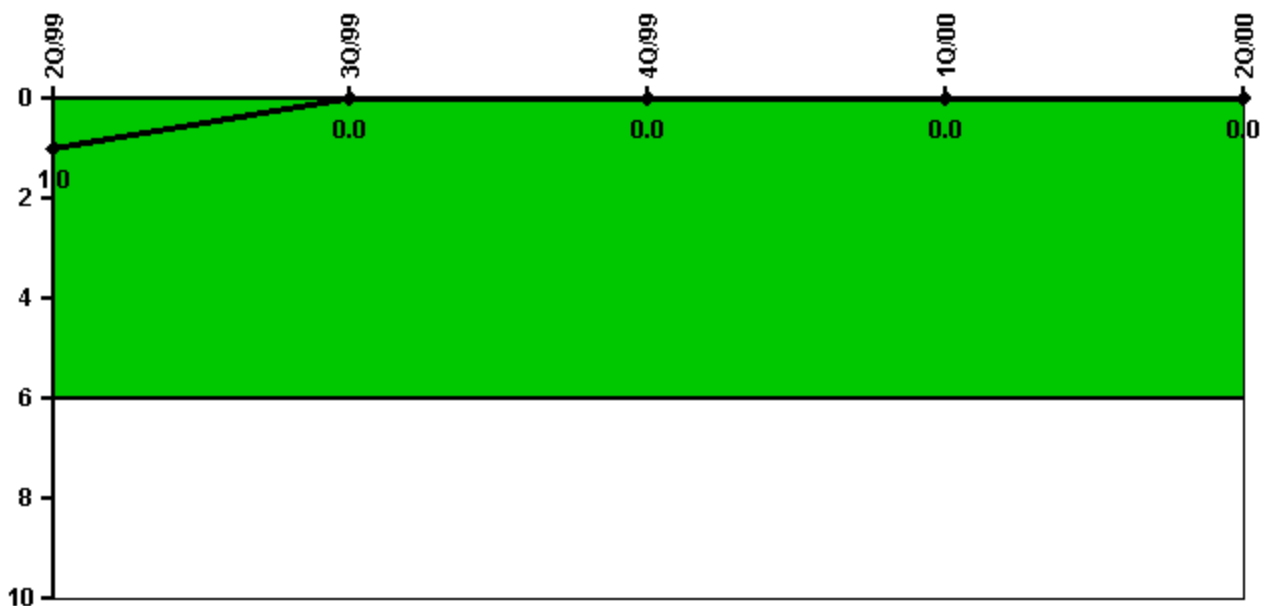

Thresholds: White > 6.0


#### Notes

Safety System Functional Failures (BWR)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Safety System Functional Failures	0	0	0	0	0
Indicator value	1	0	0	0	0

Licensee Comments: none



### Reactor Coolant System Activity

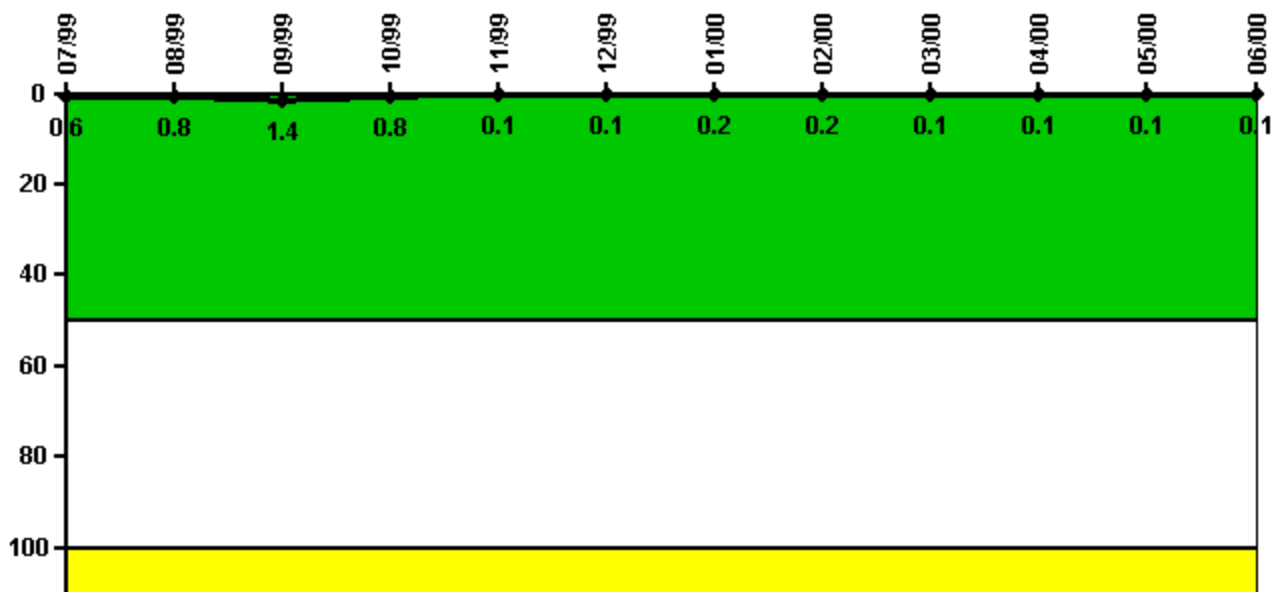


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Activity	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum activity	0.001210	0.001590	0.002700	0.001680	0.000170	0.000230	0.000390	0.000490	0.000160	0.000250	0.000150	0.000200
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.6	0.8	1.4	0.8	0.1	0.1	0.2	0.2	0.1	0.1	0.1	0.1

Licensee Comments: none

### Reactor Coolant System Leakage

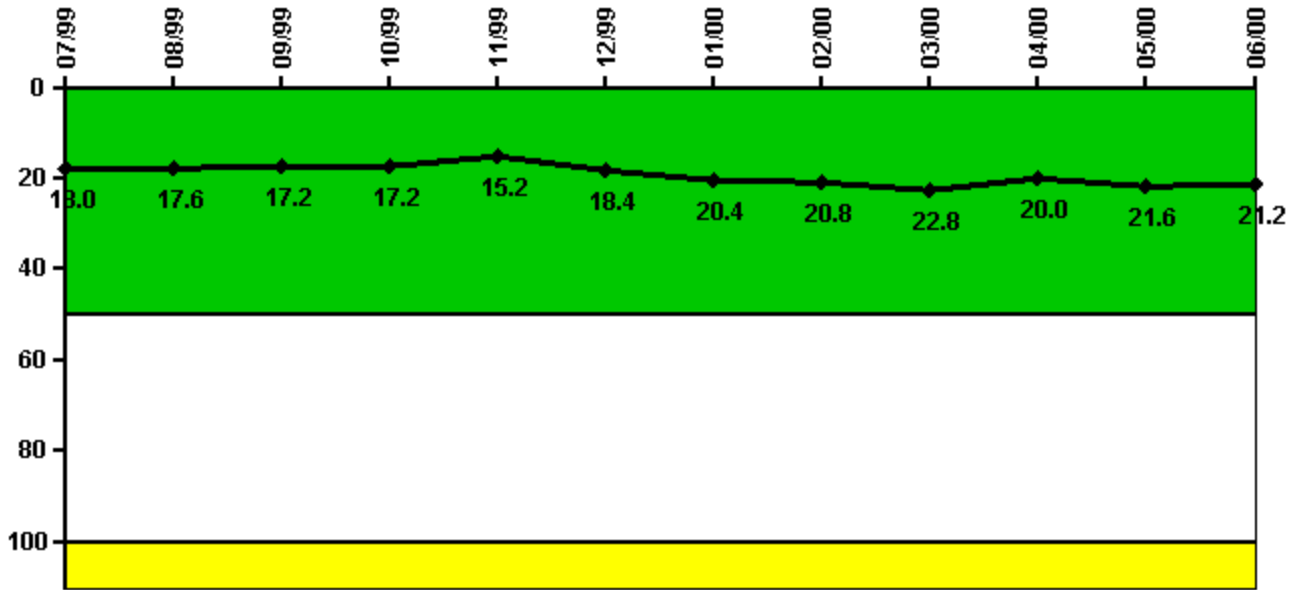


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum leakage	4.500	4.400	4.300	4.300	3.800	4.600	5.100	5.200	5.700	5.000	5.400	5.300
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	18.0	17.6	17.2	17.2	15.2	18.4	20.4	20.8	22.8	20.0	21.6	21.2

Licensee Comments: none

### Drill/Exercise Performance

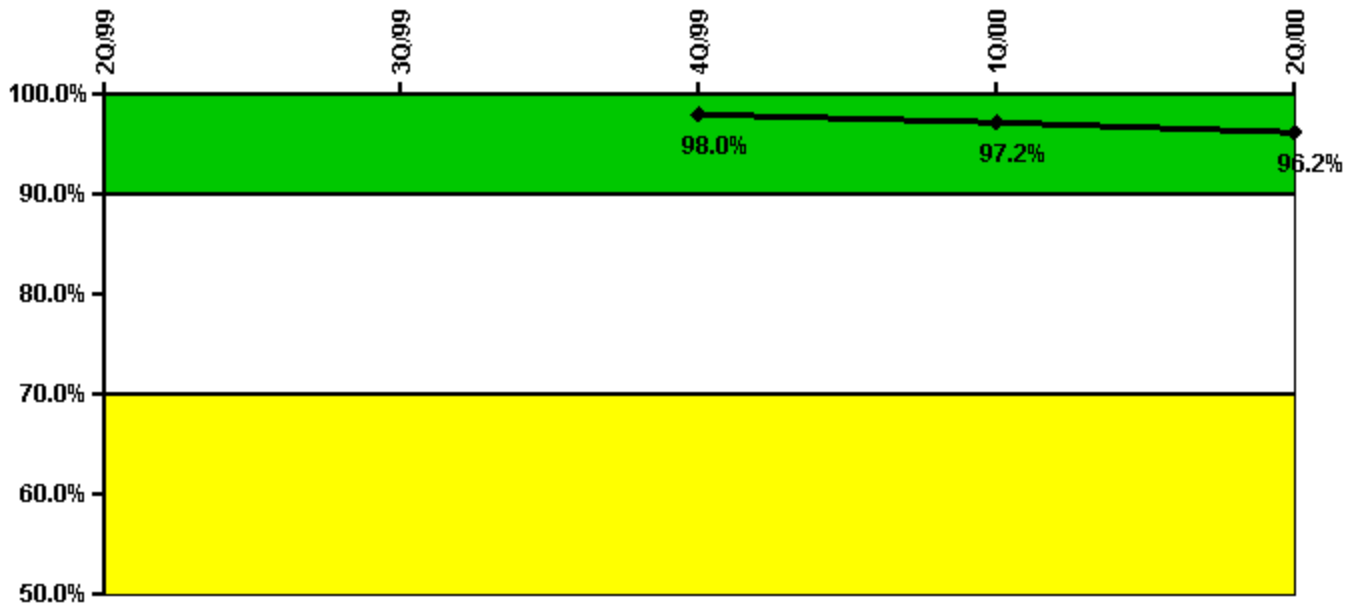

Thresholds: White < 90.0% Yellow < 70.0%


#### Notes

Drill/Exercise Performance	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful opportunities	12.0	12.0	0	5.0	19.0
Total opportunities	13.0	12.0	0	5.0	20.0
Indicator value			98.0%	97.2%	96.2%

#### Licensee Comments:

2Q/00: ComEd has reviewed the guidance for determining the number of opportunities for the NRC Drill, Exercise and Event (DEP) Performance Indicator 08. The process ComEd uses to make a notification for a concurrent classification of General Emergency and an initial PAR for that classification cannot be logically separated into two notifications. The notification is made via the same call to the same audience. Success criteria requires both the classification and PAR to be timely and accurate to count as a success. Therefore the notification is counted as one opportunity instead of two as suggested by the NEI guidance.

### ERO Drill Participation

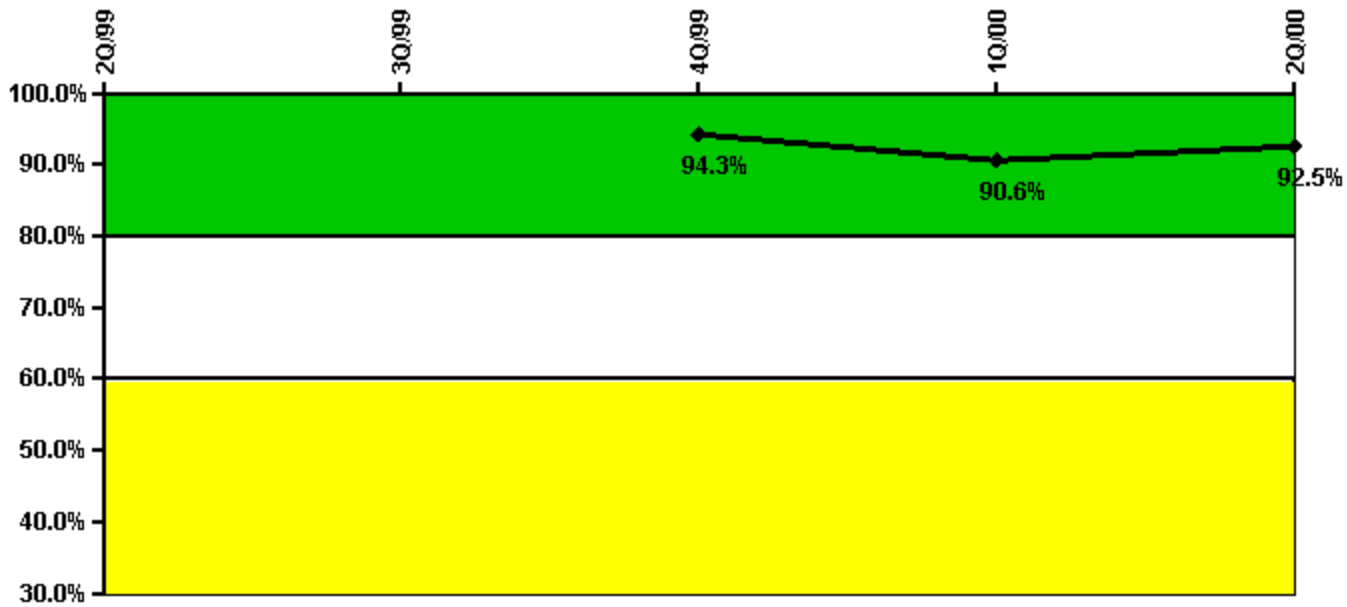


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Participating Key personnel			50.0	48.0	49.0
Total Key personnel			53.0	53.0	53.0
<b>Indicator value</b>			<b>94.3%</b>	<b>90.6%</b>	<b>92.5%</b>

Licensee Comments: none

### Alert & Notification System

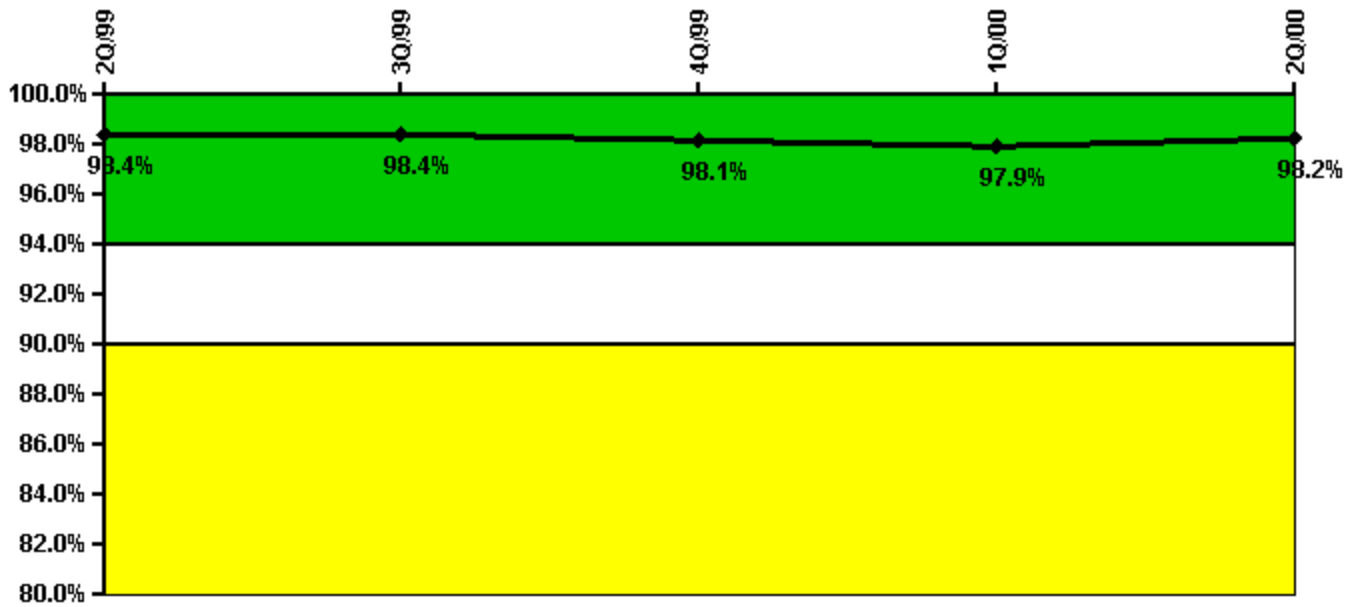


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful siren-tests	2109	2142	2097	2143	2129
Total sirens-tests	2176	2176	2142	2176	2176
Indicator value	98.4%	98.4%	98.1%	97.9%	98.2%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

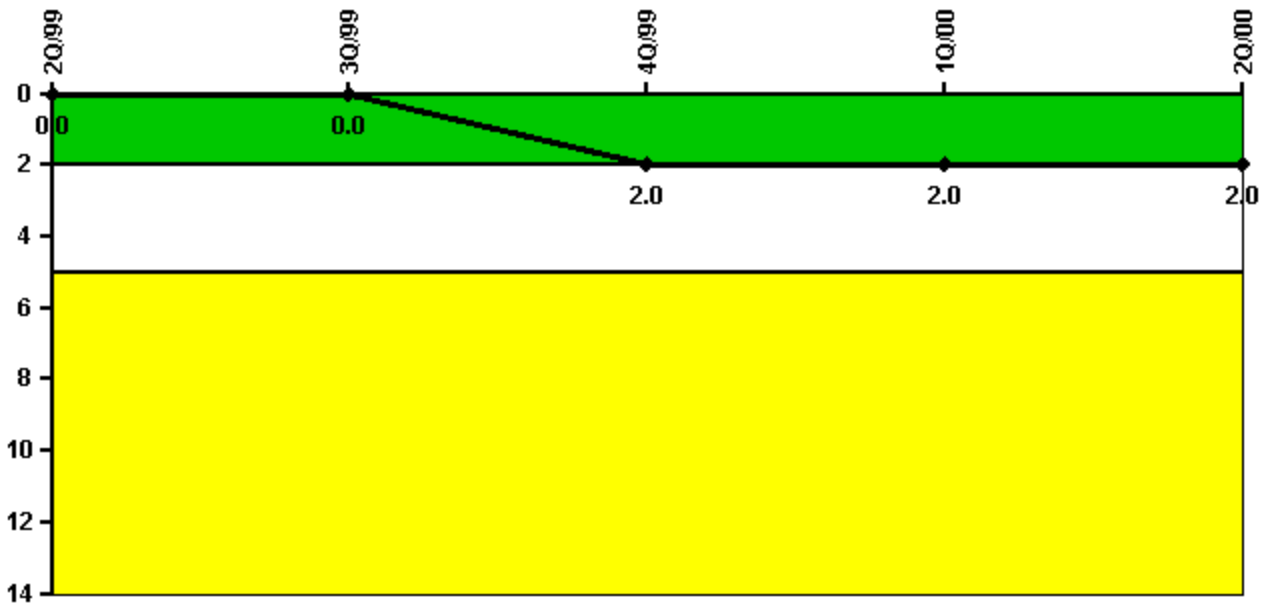

Thresholds: White > 2.0 Yellow > 5.0


#### Notes

Occupational Exposure Control Effectiveness	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
High radiation area occurrences	0	0	2	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>2</b>	<b>2</b>	<b>2</b>

Licensee Comments:

4Q/99: The December 1999 event had been removed. It has since been determined that it should not have been removed and is being added back in.

### RETS/ODCM Radiological Effluent

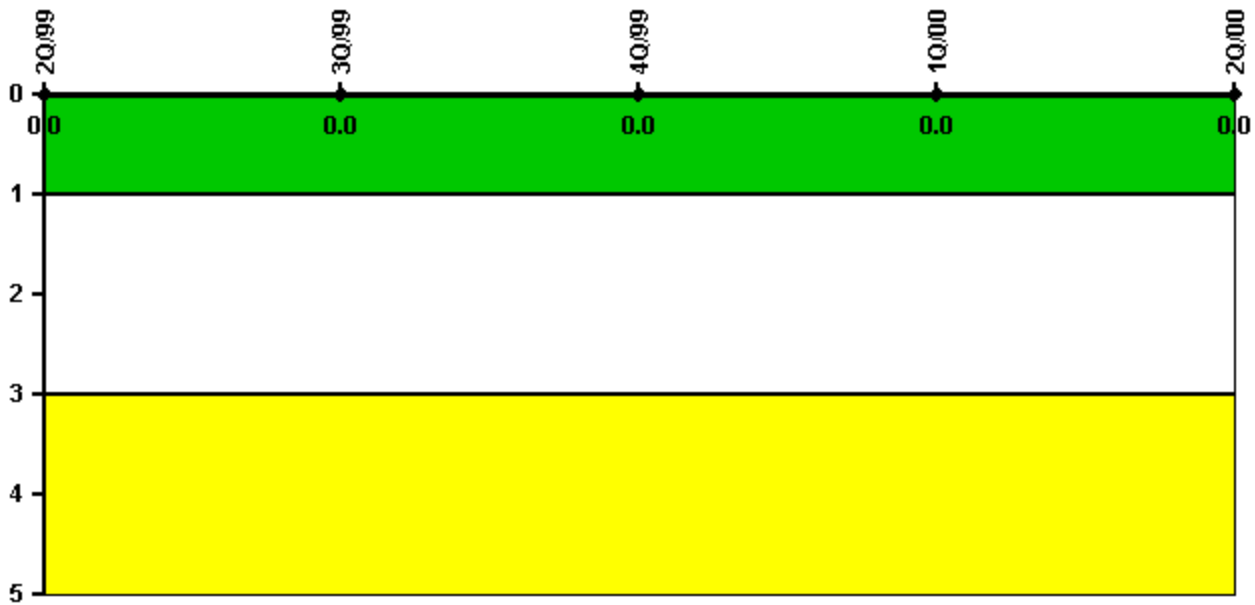


Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

### Protected Area Security Performance Index

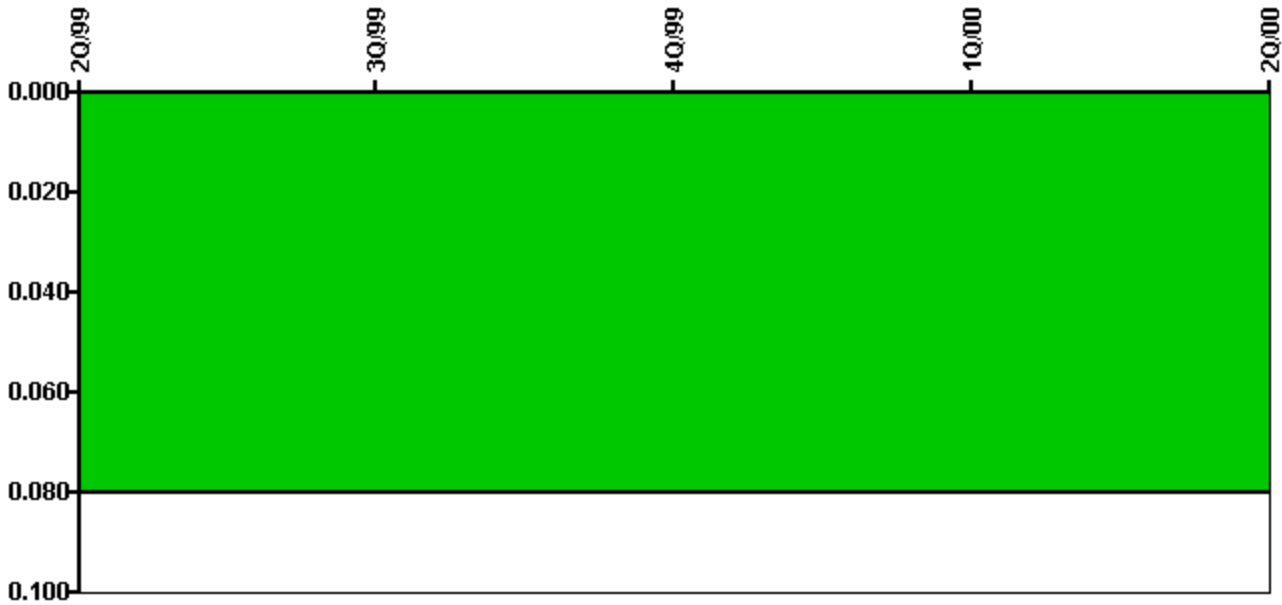

Thresholds: White > 0.080

#### Notes


Protected Area Security Performance Index	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
IDS compensatory hours	1403.40	1335.00	657.40	81.30	12.60
CCTV compensatory hours	595.5	1347.1	205.1	9.6	32.0
IDS normalization factor	1.20	1.20	1.20	1.20	1.20
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
<b>Index Value</b>	<b>0.309</b>	<b>0.344</b>	<b>0.353</b>	<b>0.289</b>	<b>0.190</b>

#### Licensee Comments:

2Q/00: A clarification of FAQ (ID #59) has been submitted to the NEI/NRC task Forces. ComEd's practice has been that if a zone is required to be declared inoperable for a compliance issue (associated with a Security Plan Commitment), but the zone remains functional (capable of performing its intended function), then the hours associated with the comp. posting are not counted as long as maintenance/test proves the zone to be operable assuming that no corrective maintenance was required. ComEd contends that if the zone tests acceptable per the standard test procedures there is no added value to have Maintenance check operable equipment.



### Personnel Screening Program

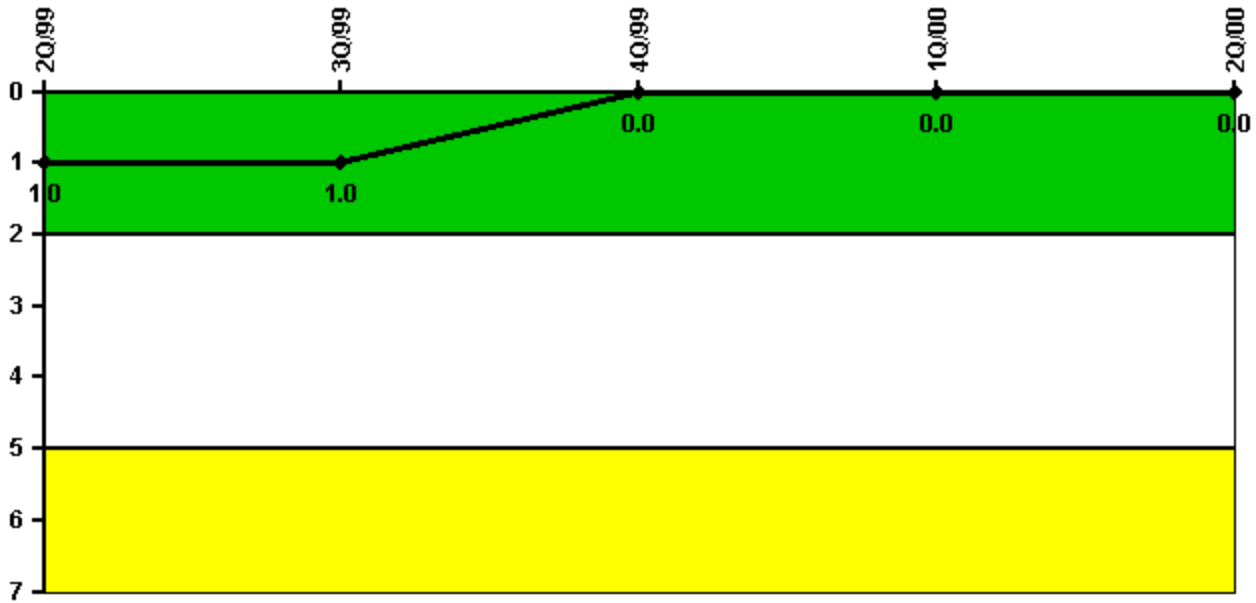


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Personnel Screening Program	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program failures	0	0	0	0	0
Indicator value	1	1	0	0	0

Licensee Comments: none

### FFD/Personnel Reliability

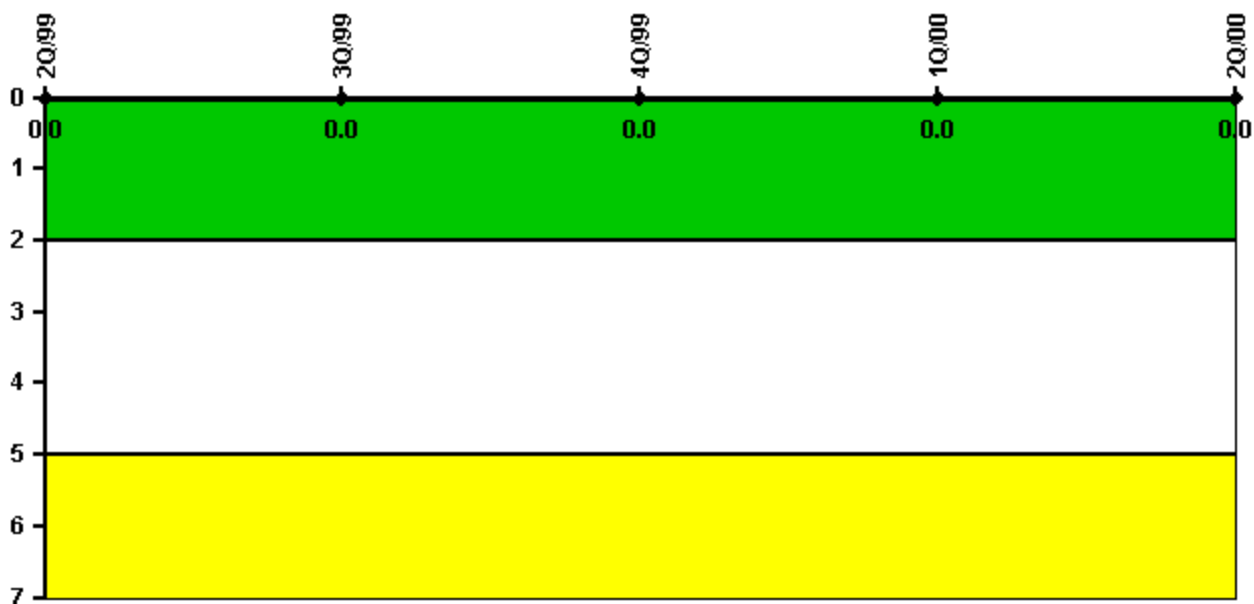

Thresholds: White > 2.0 Yellow > 5.0

#### Notes

FFD/Personnel Reliability	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

[PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 1, 2002