


Oyster Creek

2Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

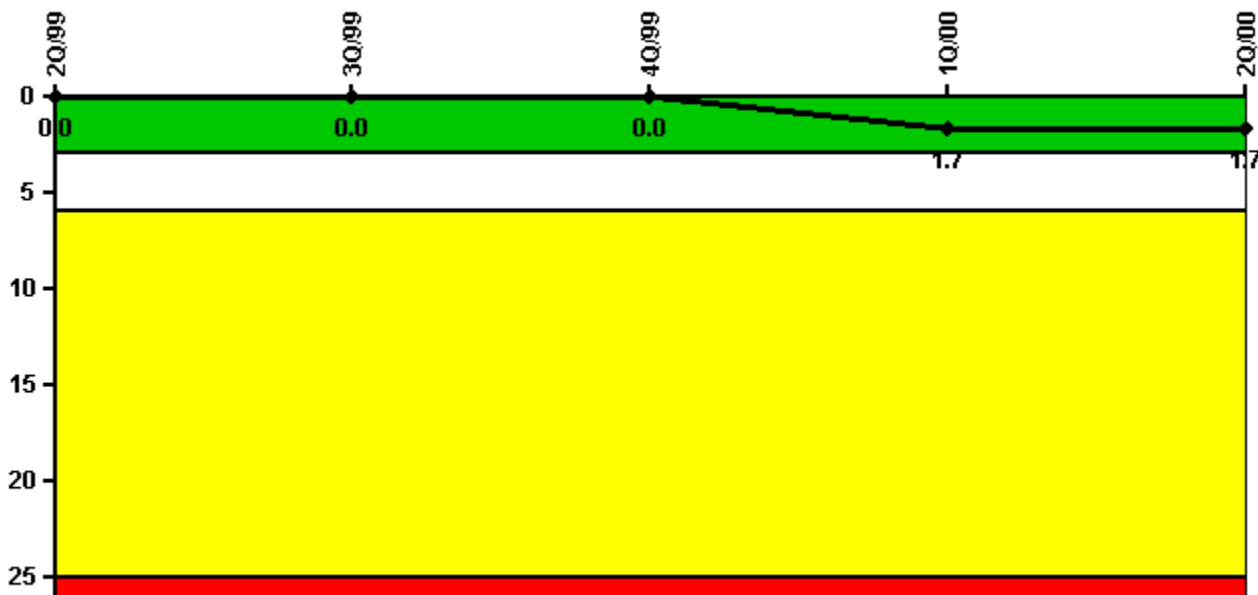

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned scrams	0	0	0	2.0	0
Critical hours	2183.0	2208.0	2209.0	1620.3	2183.0
Indicator value	0	0	0	1.7	1.7

Licensee Comments: none

Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Scrams	0	0	0	1.0	0
Indicator value	1.0	1.0	1.0	2.0	2.0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

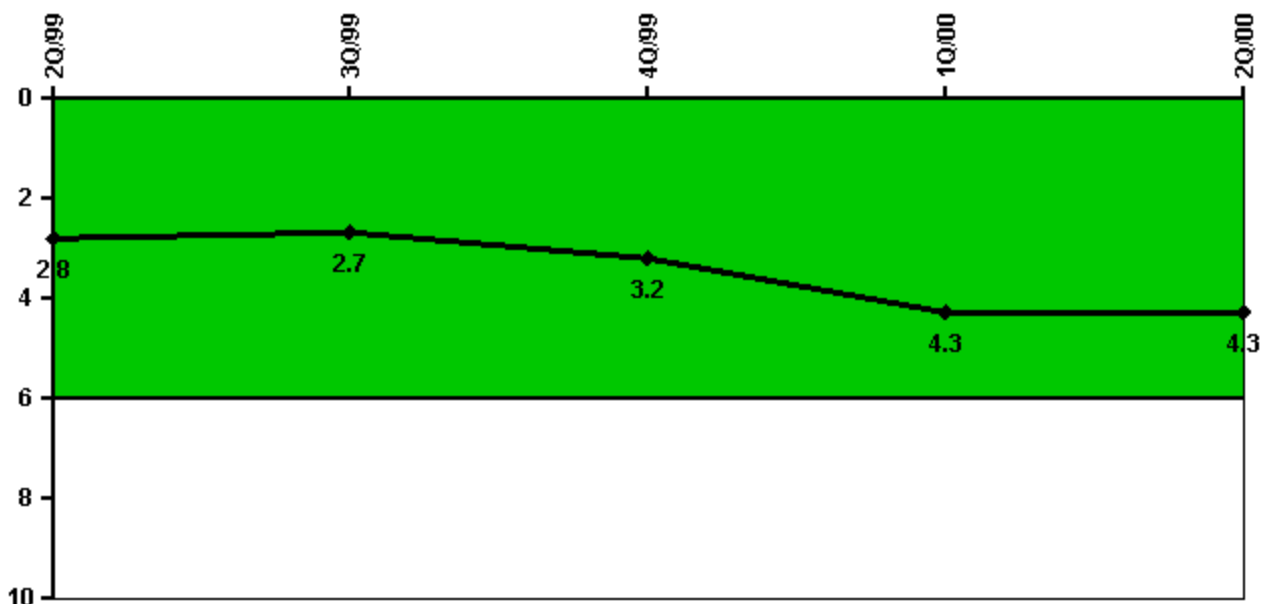


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned power changes	1.0	1.0	1.0	2.0	1.0
Critical hours	2183.0	2208.0	2209.0	1620.3	2183.0
Indicator value	2.8	2.7	3.2	4.3	4.3

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

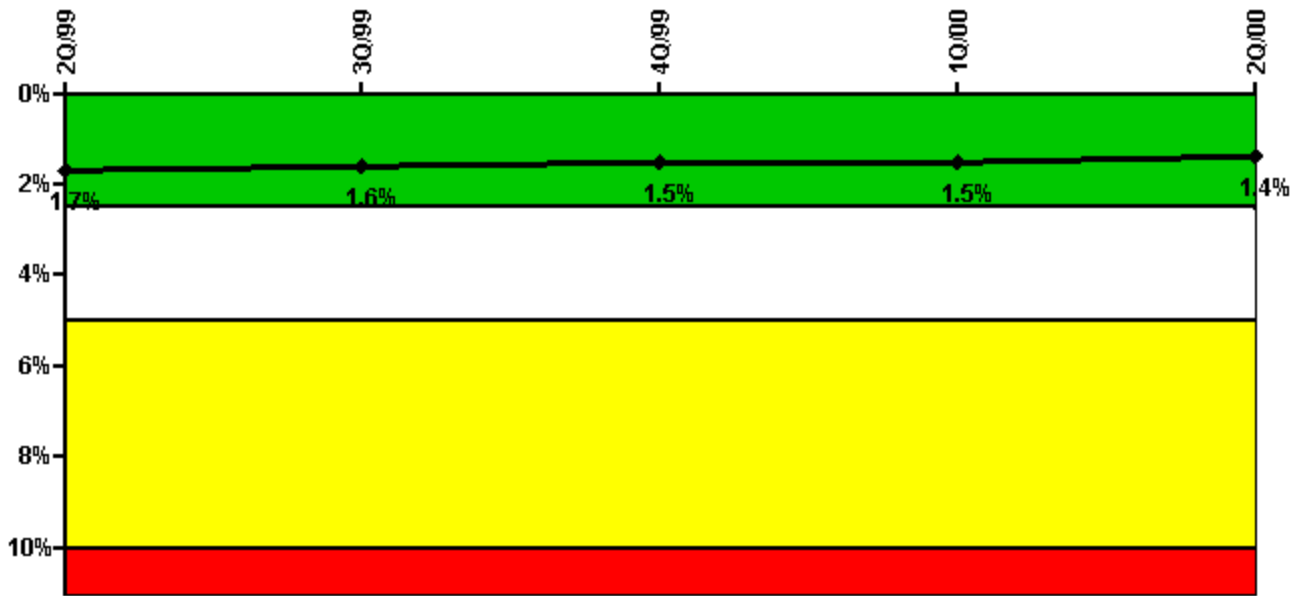

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	32.80	0	23.30	0	0
Unplanned unavailable hours	0	0	8.50	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	0	30.20	0	24.98	0
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Indicator value	1.7%	1.6%	1.5%	1.5%	1.4%

Licensee Comments:

4Q/99: Discrepancy of 8.5 hrs for DG 1 (4th Quarter 1999-Historical Data) was identified while performing 3rd Quarter 2000 review. Changes did not result in a threshold color change. Updated and corrected historical data per system engineer On 12-7-2000.

4Q/99: Discrepancy of 8.5 hrs for DG 1 (4th Quarter 1999-Historical Data) was identified while performing 3rd Quarter 2000 review. Changes did not result in a threshold color change.

3Q/99: Updated/corrected historical data

Safety System Unavailability, High Pressure Injection System

**Not applicable due to
 unique design
 characteristics.
 Performance in this area
 will be assessed through
 focused NRC inspection
 efforts.**

Notes

Safety System Unavailability, High Pressure Injection System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	0	0	31.23	82.68	29.88
Unplanned unavailable hours	0	0	0	26.38	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	1722.71	2183.00
Train 2					
Planned unavailable hours	0	16.42	25.08	34.86	53.97
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	1722.71	2183.00
Indicator value			0.3%	0.5%	0.7%

Licensee Comments: none

Safety System Unavailability, Heat Removal System


Thresholds
under
development /
review

Notes

Safety System Unavailability, Heat Removal System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	0	63.10	0		
Unplanned unavailable hours	0	0	0		
Fault exposure hours	0	0	0		
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00		
Train 2					
Planned unavailable hours	17.40	0	0		
Unplanned unavailable hours	0	0	0		
Fault exposure hours	0	0	0		
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00		
Indicator value			0.5%		

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

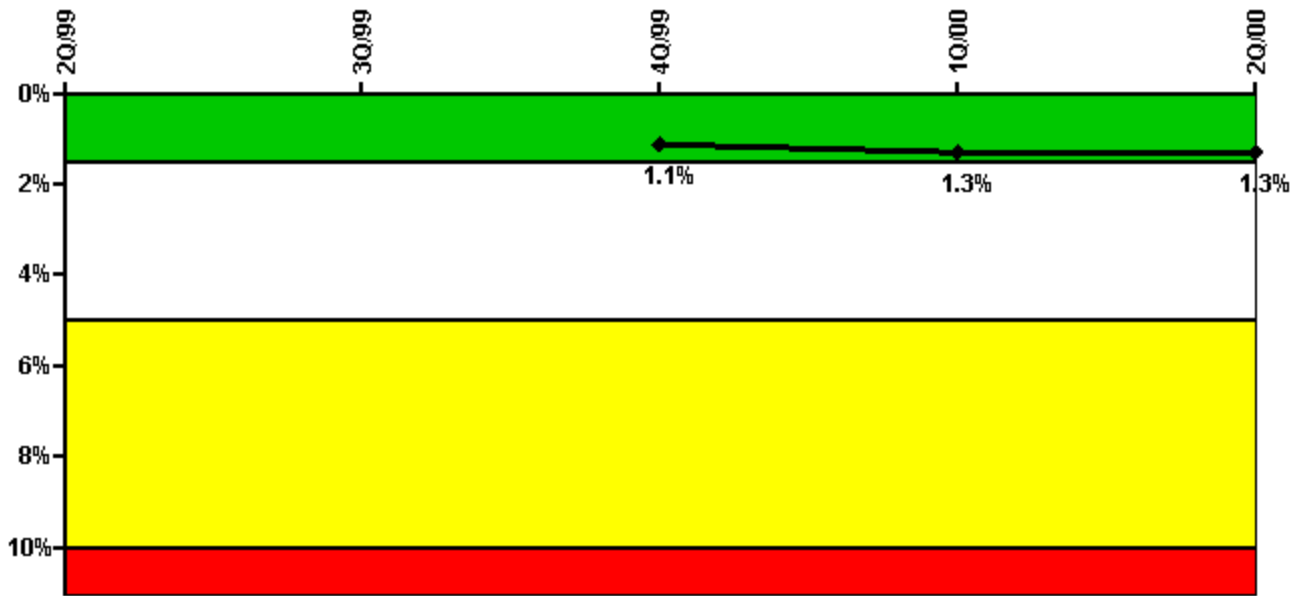

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	26.45	0	4.82	27.42	0.92
Unplanned unavailable hours	0	0	0	93.28	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	6.47	0	23.72	0	0.83
Unplanned unavailable hours	0	0	0	93.56	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 3					
Planned unavailable hours	2.23	0	28.09	0	10.62
Unplanned unavailable hours	0	0	0	93.28	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 4					
Planned unavailable hours	0	63.30	0	2.13	6.89
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 5					
Planned unavailable hours	3.60	32.40	37.80	2.51	6.56
Unplanned unavailable hours	40.50	0	0	0	0
Fault exposure hours	0	0	0	0	0


Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Indicator value			1.1%	1.3%	1.3%

Licensee Comments:

2Q/00: First Quarter data was re-entered due to a data transposition error between the 5 trains. This error did not effect the overall indicator. Additionally, the initial calculation of unavailable hours for a specific RHR event was determined to be overly conservative. A correction was made lowering the total time by 29 hours. These corrections did not effect the green color of the indicator.

1Q/00: First Quarter data was re-entered due to a data transposition error among the 5 trains. This error did not effect the overall indicator. Additionally, the initial calculation of unavailable hours for a specific RHR event was determined to be overly conservative. A correction was made lowering the total unavailable time by 29 hours. These corrections did not effect the green color of the indicator.

Safety System Functional Failures (BWR)

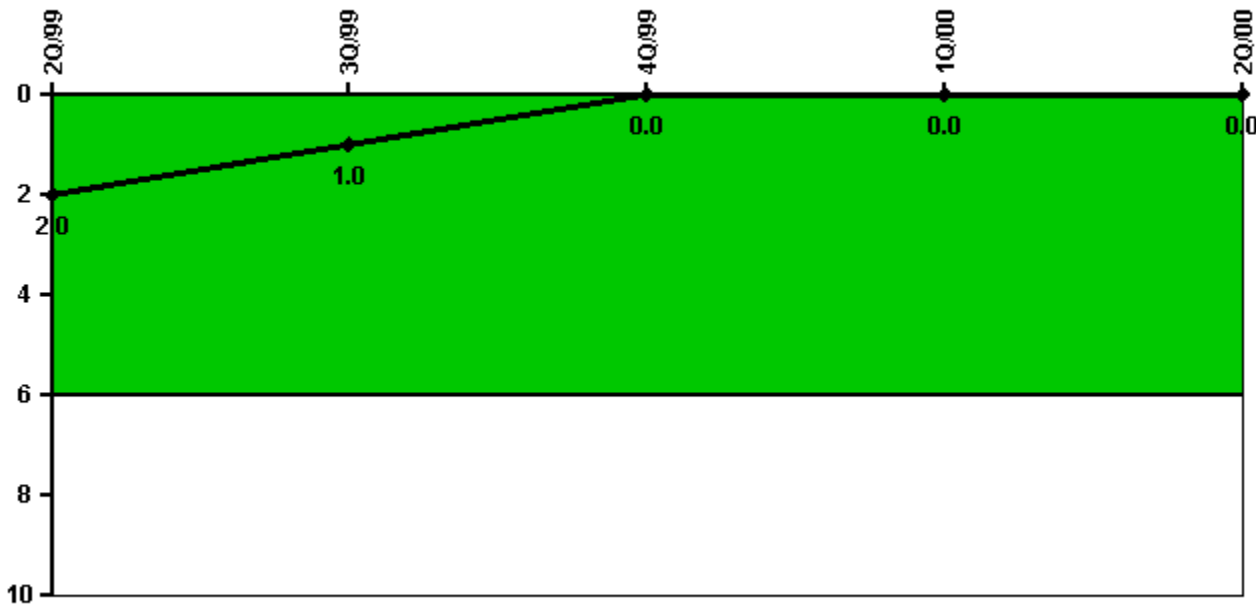


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Safety System Functional Failures	0	0	0	0	0
Indicator value	2	1	0	0	0

Licensee Comments: none

Reactor Coolant System Activity

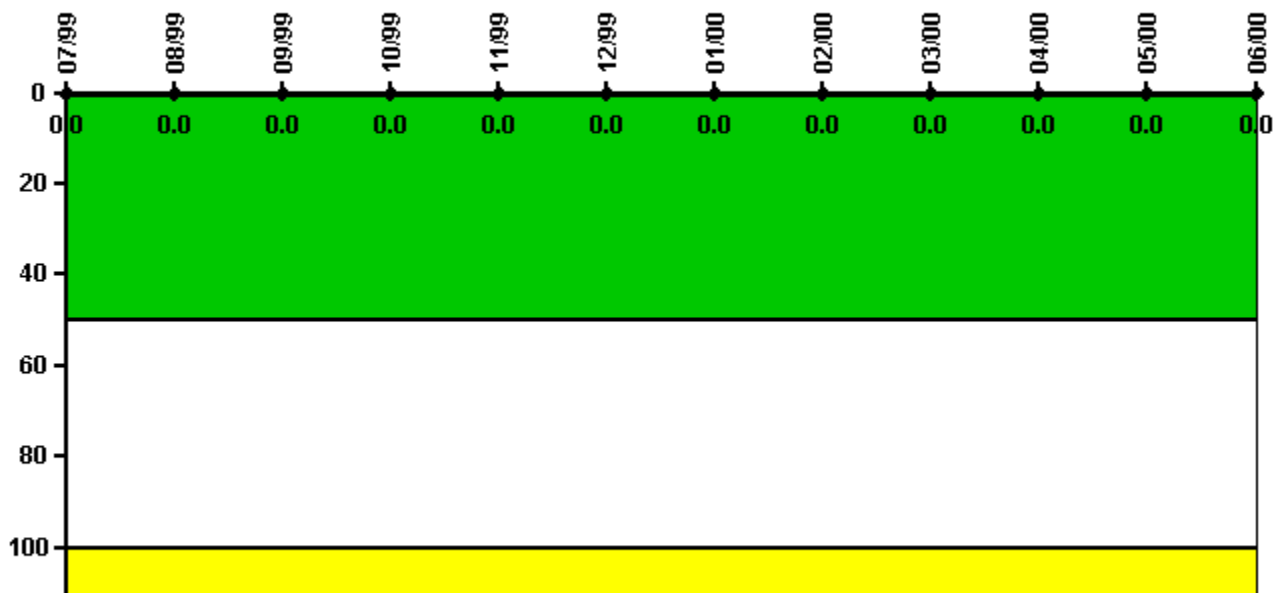


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum activity	0.000029	0.000034	0.000035	0.000037	0.000028	0.000023	0.000036	0.000030	0.000040	0.000058	0.000031	0.000044
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

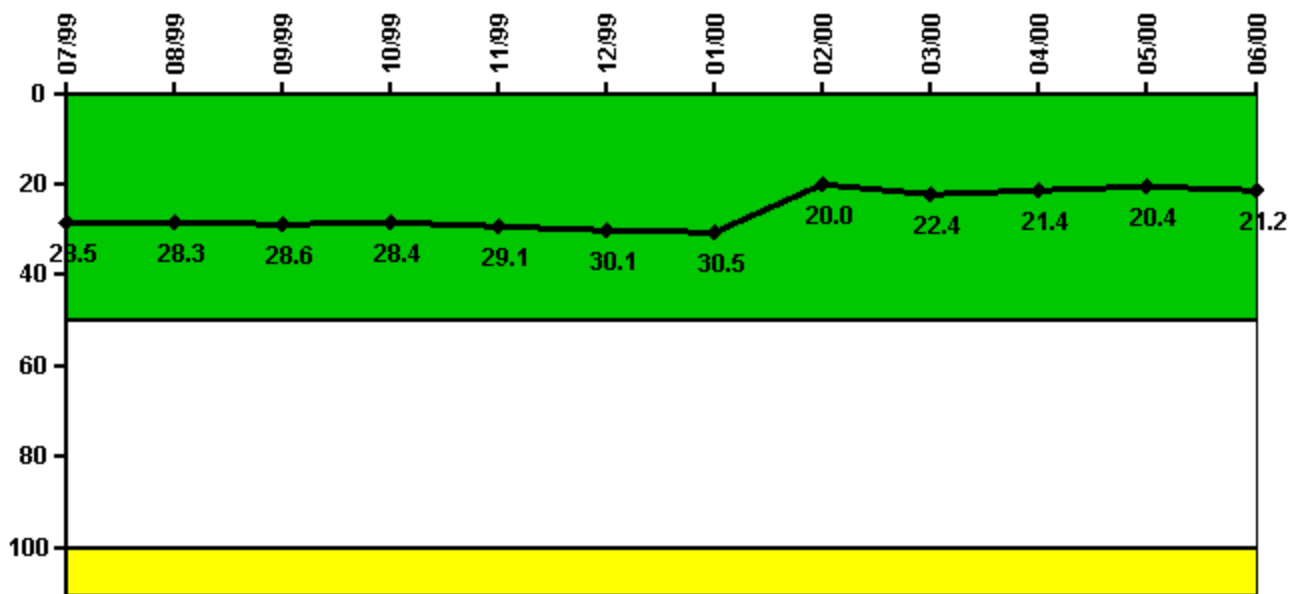


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum leakage	7.120	7.080	7.140	7.090	7.270	7.530	7.630	5.000	5.610	5.350	5.090	5.290
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	28.5	28.3	28.6	28.4	29.1	30.1	30.5	20.0	22.4	21.4	20.4	21.2

Licensee Comments: none

Drill/Exercise Performance

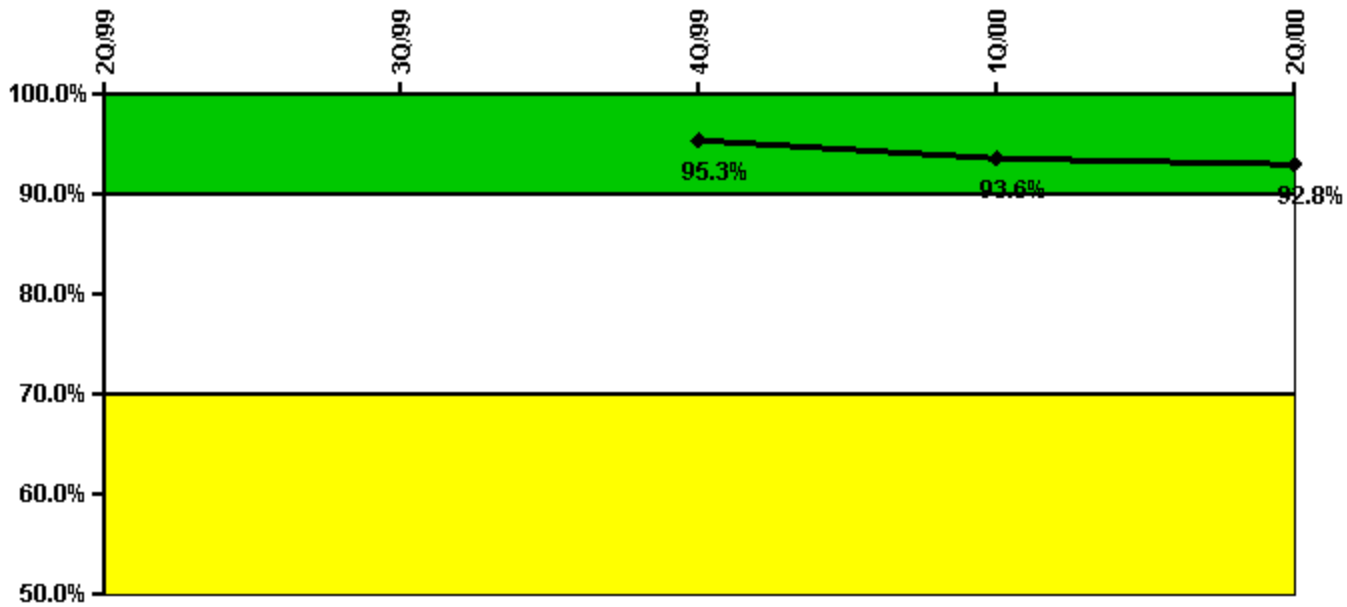


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful opportunities	56.0	26.0	23.0	37.0	128.0
Total opportunities	57.0	27.0	25.0	43.0	140.0
Indicator value			95.3%	93.6%	92.8%

Licensee Comments: none

ERO Drill Participation

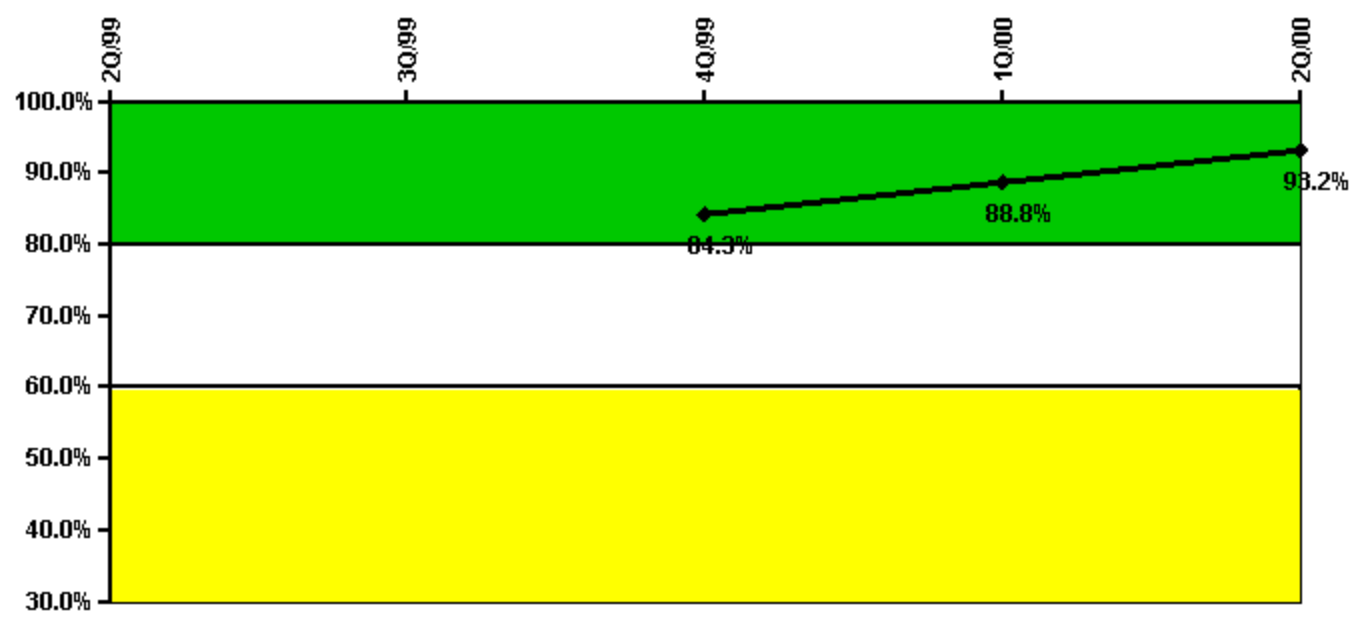


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Participating Key personnel			75.0	79.0	82.0
Total Key personnel			89.0	89.0	88.0
Indicator value			84.3%	88.8%	93.2%

Licensee Comments: none

Alert & Notification System

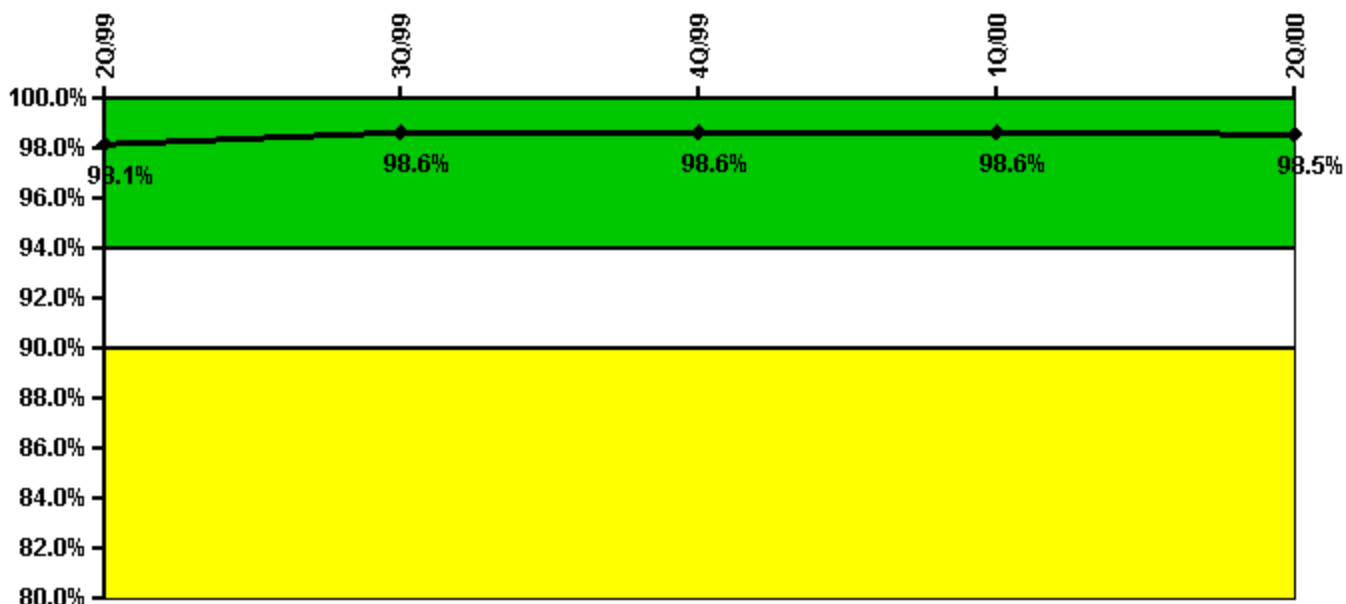


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful siren-tests	291	288	331	291	331
Total sirens-tests	294	294	336	294	336
Indicator value	98.1%	98.6%	98.6%	98.6%	98.5%

Licensee Comments: none

Occupational Exposure Control Effectiveness

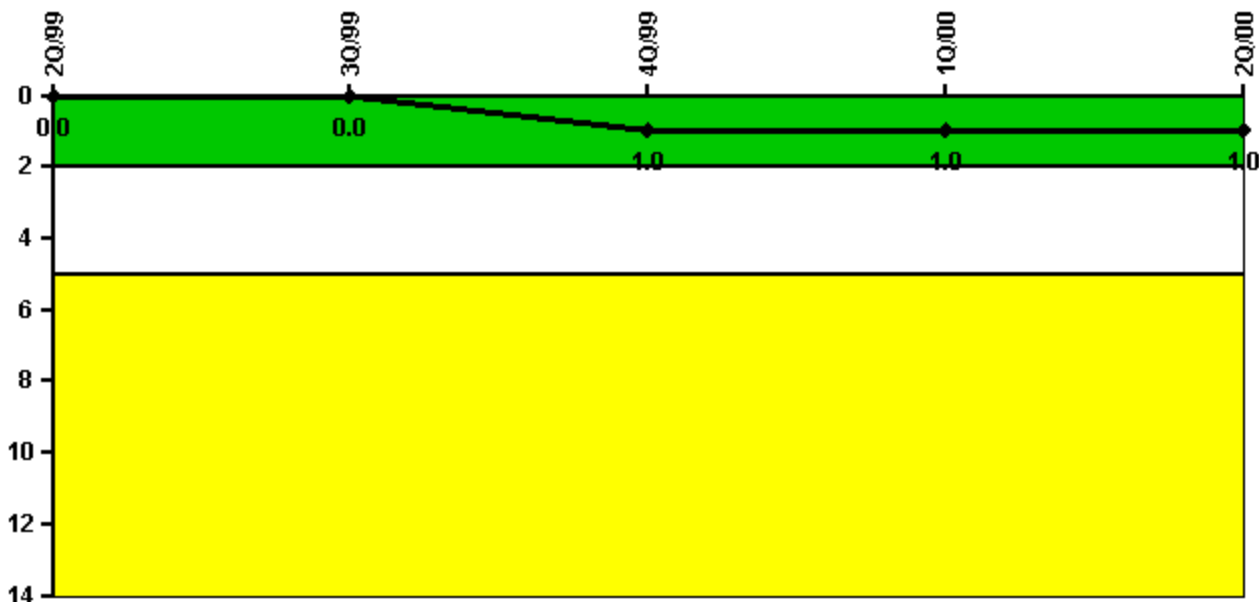

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
High radiation area occurrences	0	0	1	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	0	0	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

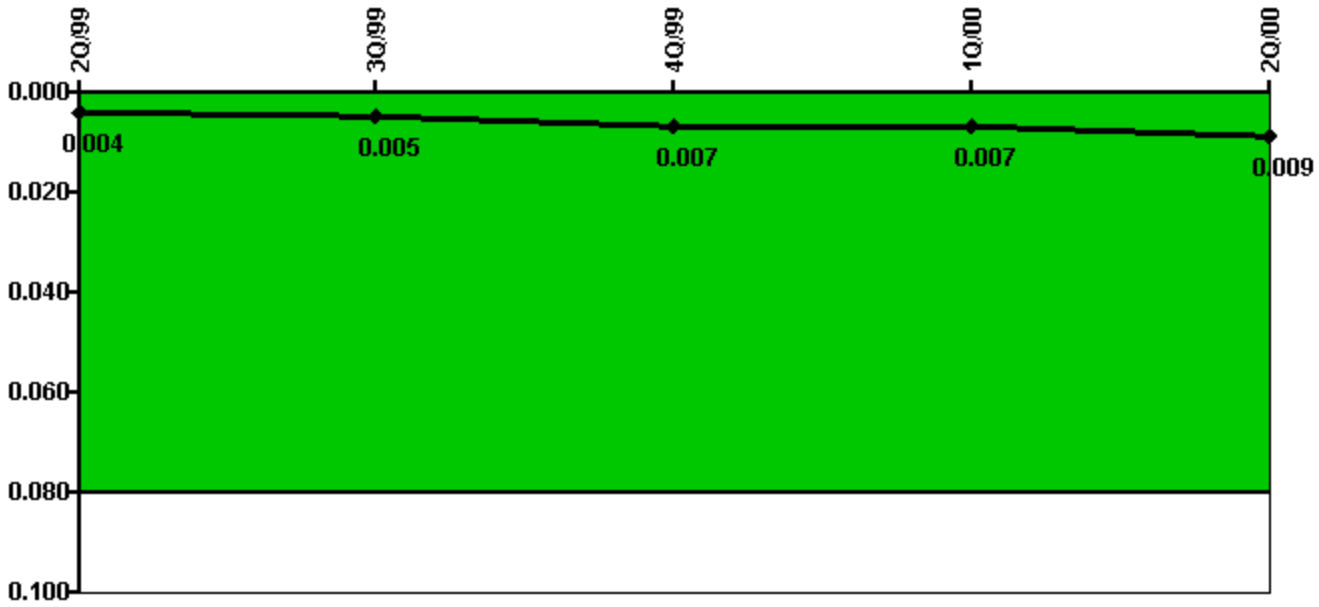


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
IDS compensatory hours	5.30	64.00	75.20	65.50	87.10
CCTV compensatory hours	3.2	2.2	5.0	2.0	0
IDS normalization factor	1.95	1.95	1.95	1.95	1.95
CCTV normalization factor	1.5	1.5	1.5	1.5	1.5
Index Value	0.004	0.005	0.007	0.007	0.009

Licensee Comments: none

Personnel Screening Program

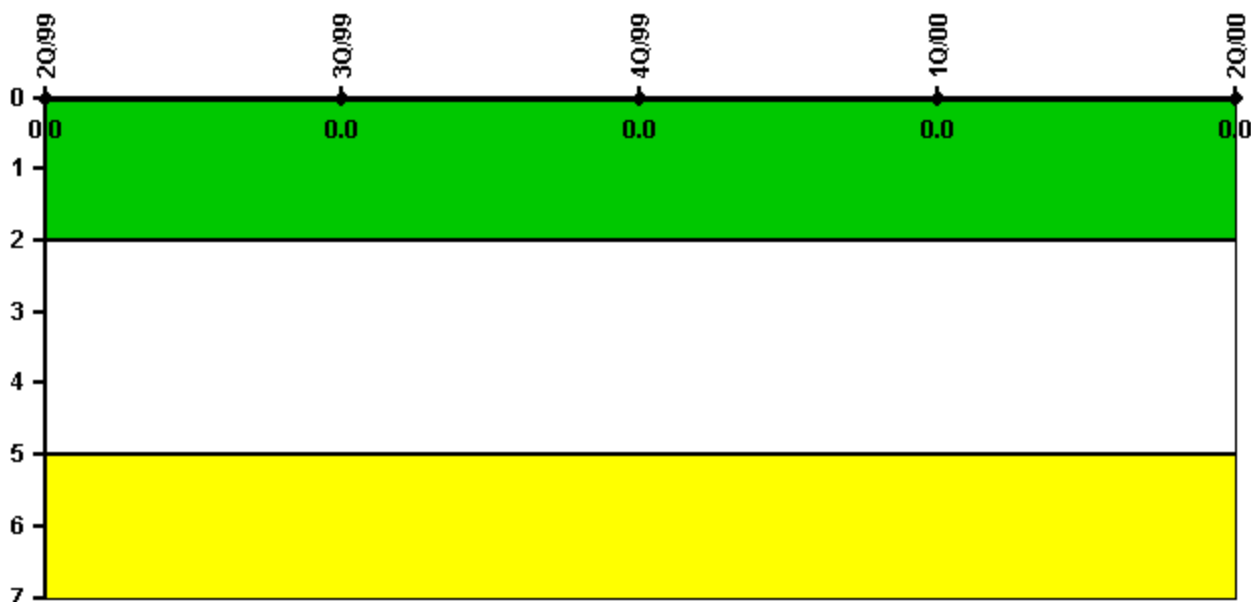

Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 1, 2002