


Quad Cities 2

3Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

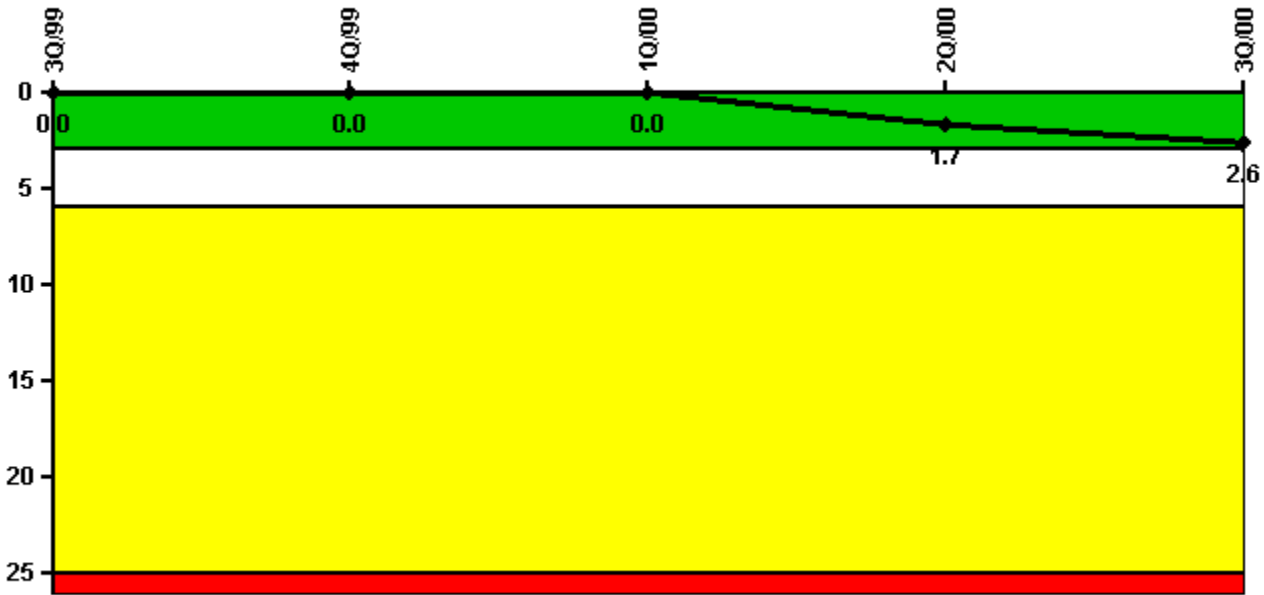


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Unplanned scrams	0	0	0	2.0	1.0
Critical hours	2208.0	2209.0	1688.2	2132.0	2181.0
Indicator value	0	0	0	1.7	2.6

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

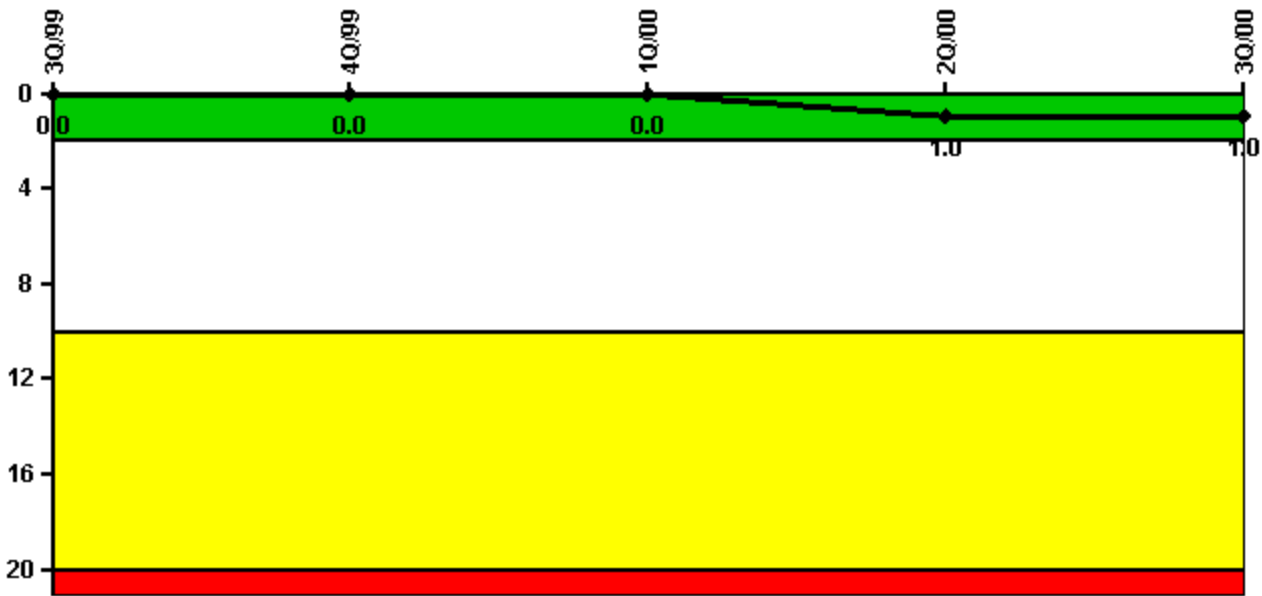


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Scrams	0	0	0	1.0	0
Indicator value	0	0	0	1.0	1.0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

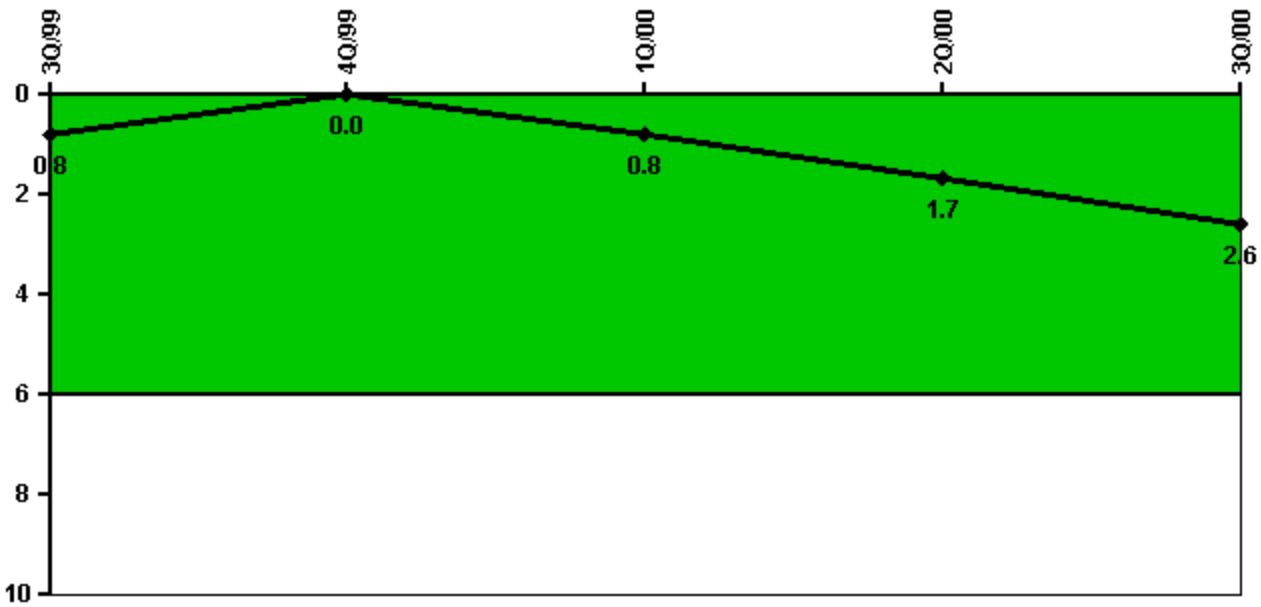


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Unplanned power changes	0	0	1.0	1.0	1.0
Critical hours	2208.0	2209.0	1688.2	2132.0	2181.0
Indicator value	0.8	0	0.8	1.7	2.6

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

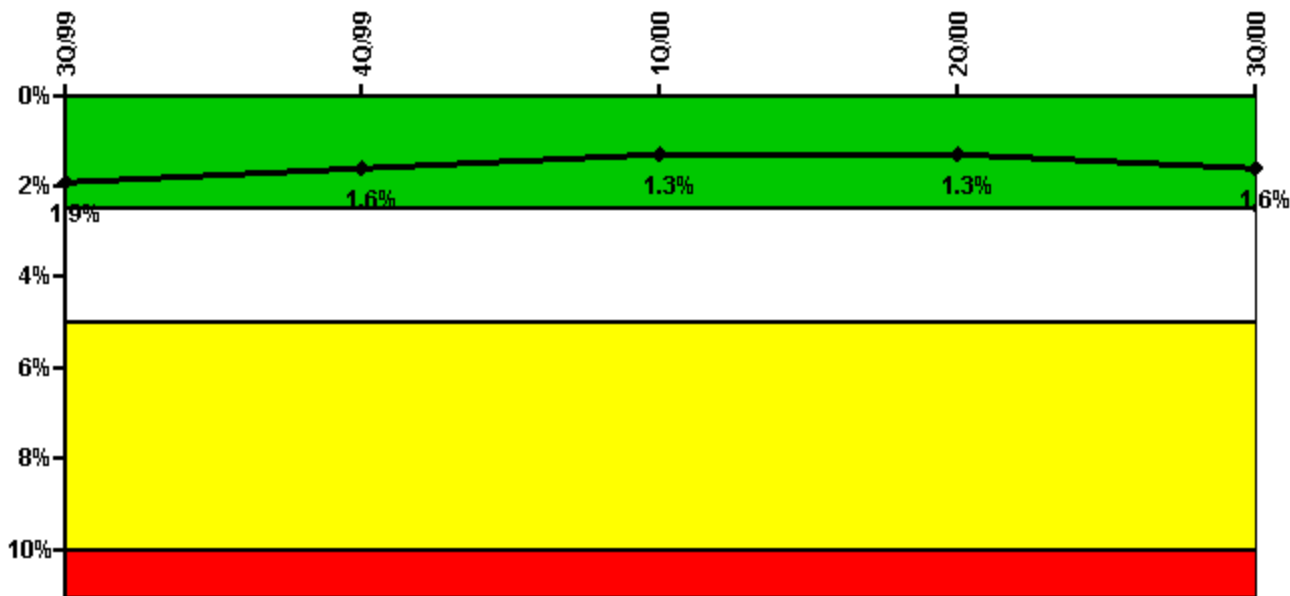


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	6.00	9.52	36.53	72.54	52.84
Unplanned unavailable hours	0	0	0	0	58.18
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00
Train 2					
Planned unavailable hours	103.65	18.26	11.23	11.32	69.70
Unplanned unavailable hours	0	0	0	0	3.30
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00
Indicator value	1.9%	1.6%	1.3%	1.3%	1.6%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPCI)

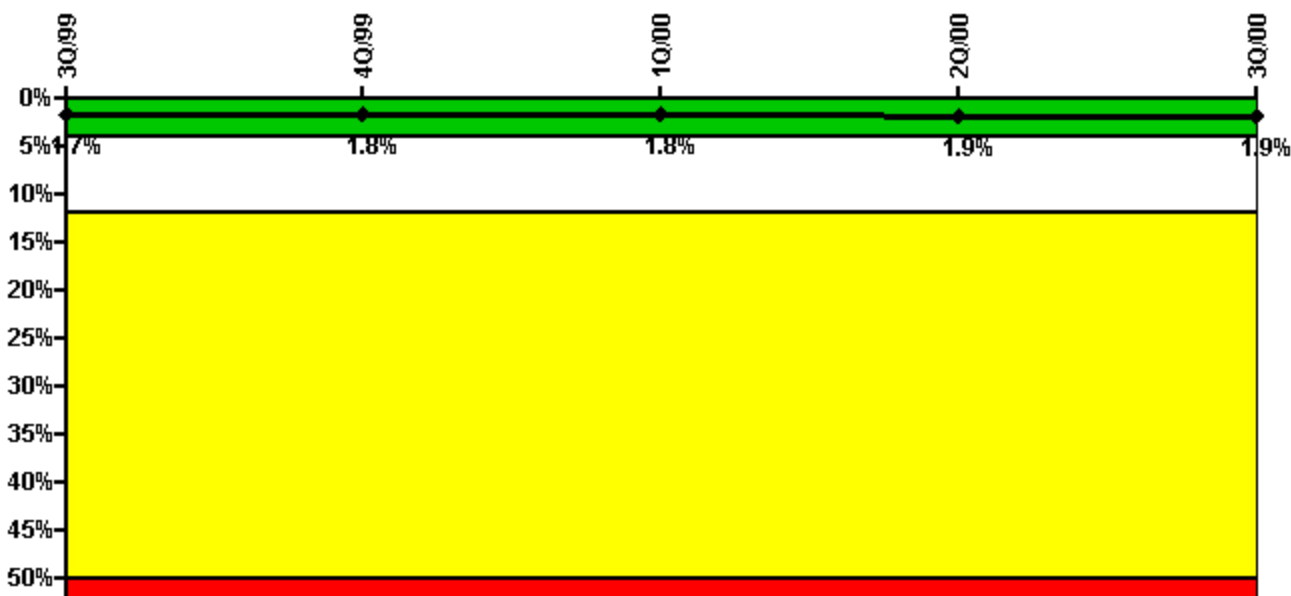


Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPCI)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	13.58	6.47	6.52	76.61	6.15
Unplanned unavailable hours	0	17.10	0.72	0	0
Fault exposure hours	0	0	1.67	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	1688.20	2132.00	2181.00
Indicator value	1.7%	1.8%	1.8%	1.9%	1.9%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (RCIC)

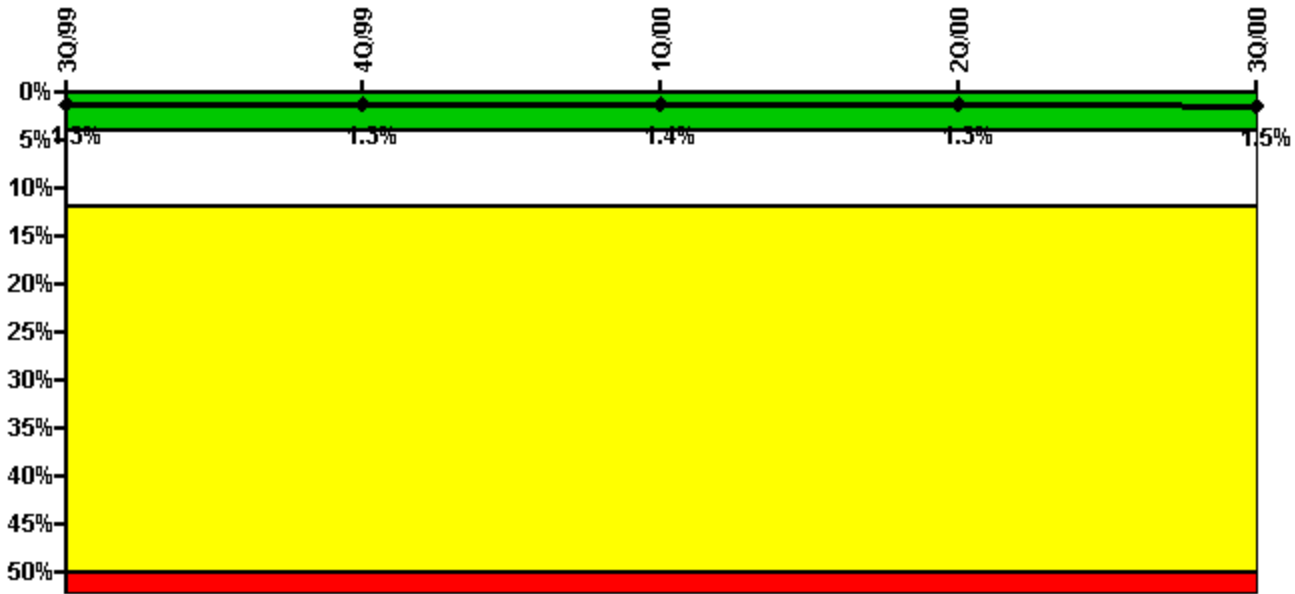


Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%

Notes

Safety System Unavailability, Heat Removal System (RCIC)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	33.52	13.66	10.34	23.44	47.53
Unplanned unavailable hours	29.50	0	0.80	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	1688.20	2132.00	2181.00
Indicator value	1.3%	1.3%	1.4%	1.3%	1.5%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

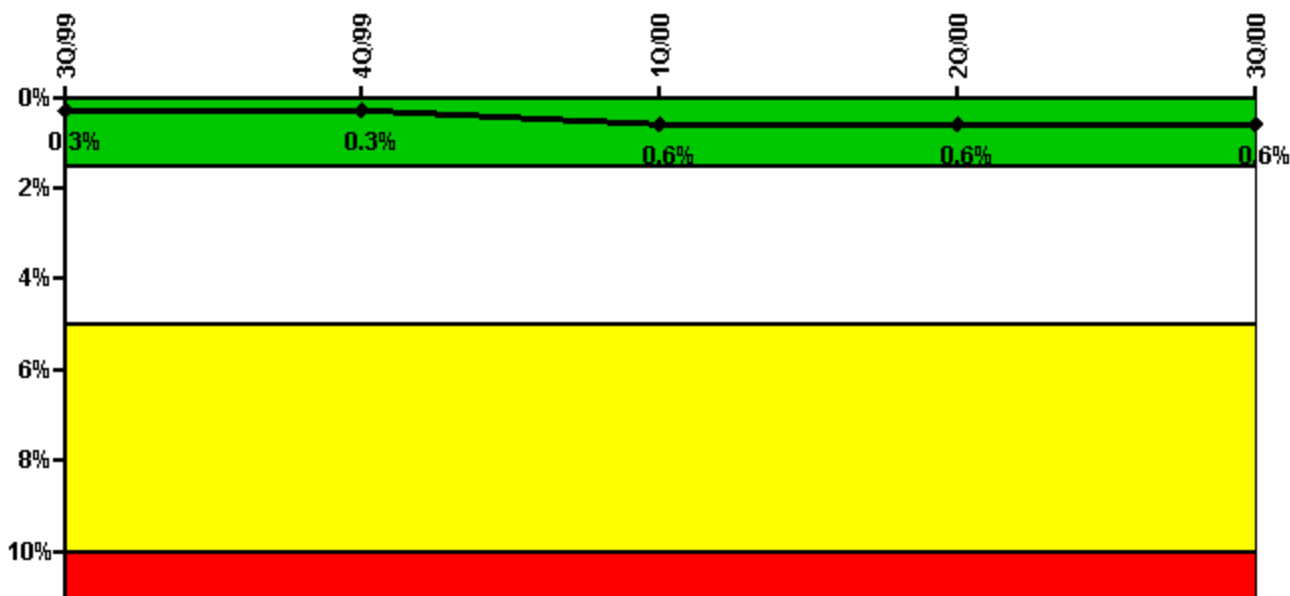


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	32.00	7.02	0	0.05	0
Unplanned unavailable hours	0	4.52	3.83	0	0.47
Fault exposure hours	0	0	161.87	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00
Train 2					
Planned unavailable hours	4.40	0	0	0	2.13
Unplanned unavailable hours	0	5.30	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00
Indicator value	0.3%	0.3%	0.6%	0.6%	0.6%

Licensee Comments: none

Safety System Functional Failures (BWR)

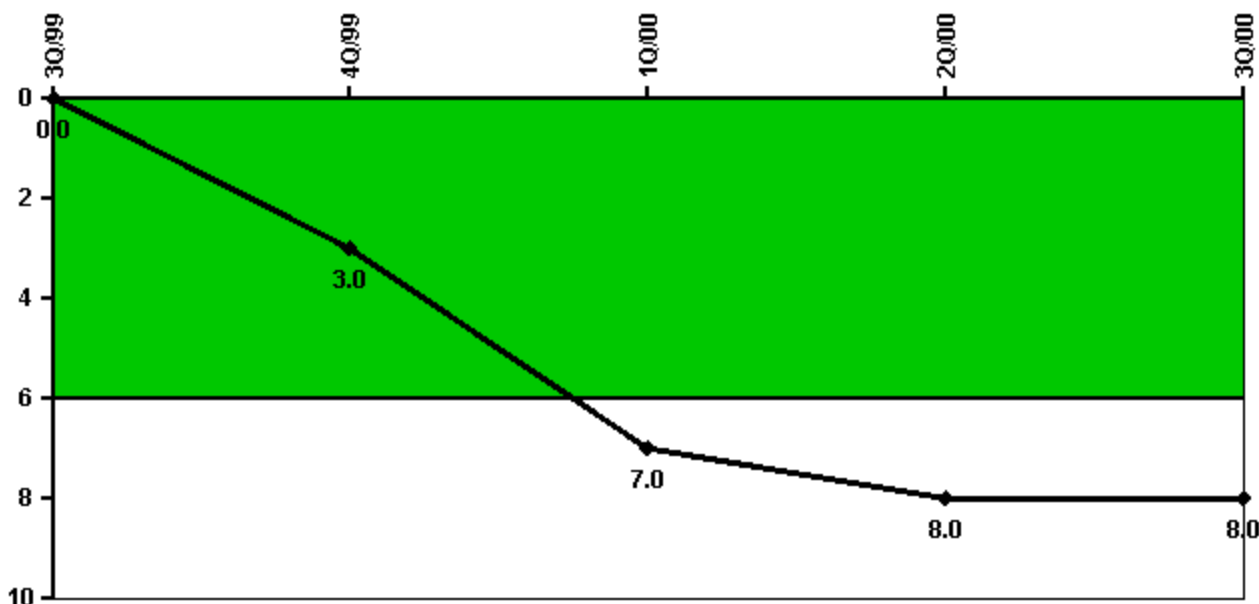

Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Safety System Functional Failures	0	3	4	1	0
Indicator value	0	3	7	8	8


Licensee Comments:

3Q/00: This indicator remains WHITE. A self-assessment of the Mitigating Systems Cornerstone has been performed including assessment of the systems that contributed to this WHITE indicator. Also, a common cause investigation and a supplemental NRC Inspection were performed for this indicator. The conclusions and corrective actions that resulted are in the corrective action program.

1Q/00: Two Safety System Functional Failures have been added to the first quarter 2000 indicator in response to Inspection Report 50-265/01-08. Licensee review of the events is ongoing. {With the fourth quarter 2001 submittal, one of the two abovementioned Safety System Functional Failures was withdrawn in accordance with a 12/4/01 NRC letter concerning IR 50-254(265)/01-08.}

1Q/00: Two Safety System Functional Failures have been added to the first quarter 2000 indicator in response to Inspection Report 50-265/01-08. Licensee review of the events is ongoing.

Reactor Coolant System Activity

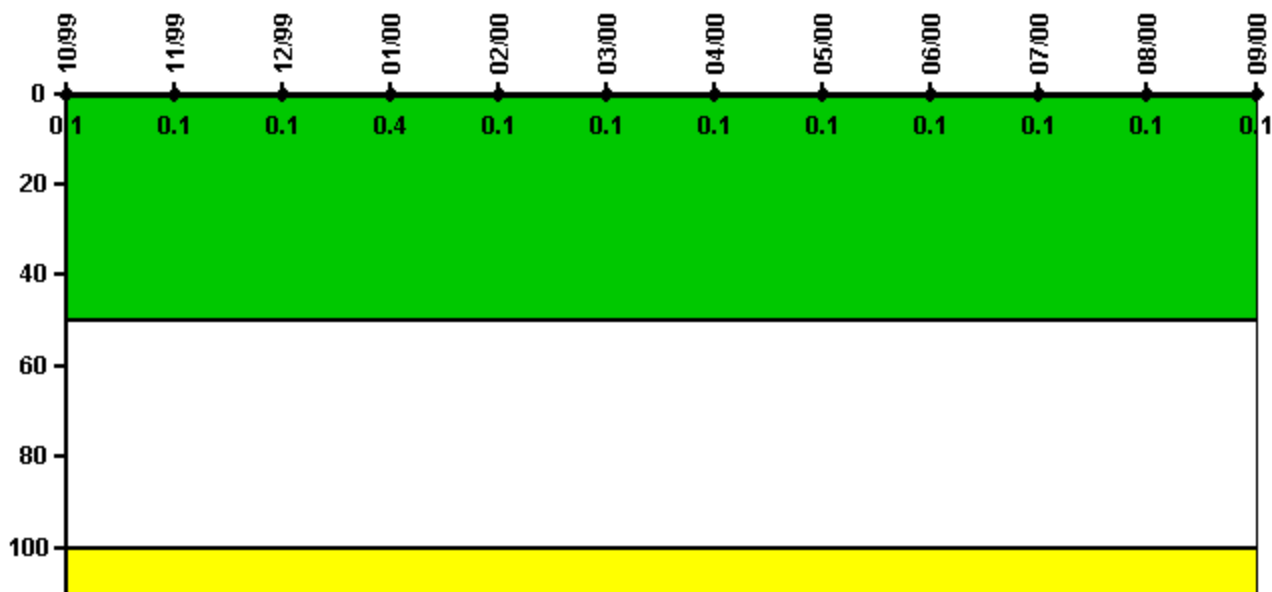


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum activity	0.000280	0.000269	0.000242	0.000805	0.000104	0.000196	0.000264	0.000273	0.000168	0.000225	0.000207	0.000186
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.4	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

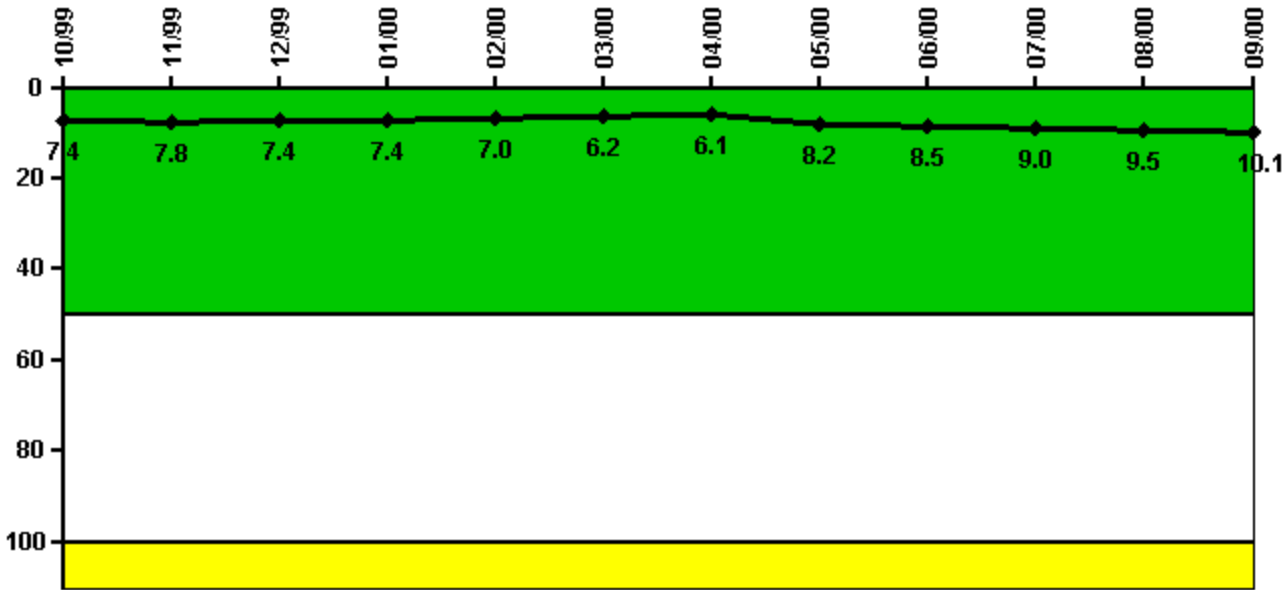


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum leakage	1.850	1.940	1.850	1.850	1.740	1.540	1.530	2.040	2.120	2.260	2.380	2.530
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.4	7.8	7.4	7.4	7.0	6.2	6.1	8.2	8.5	9.0	9.5	10.1

Licensee Comments: none

Drill/Exercise Performance

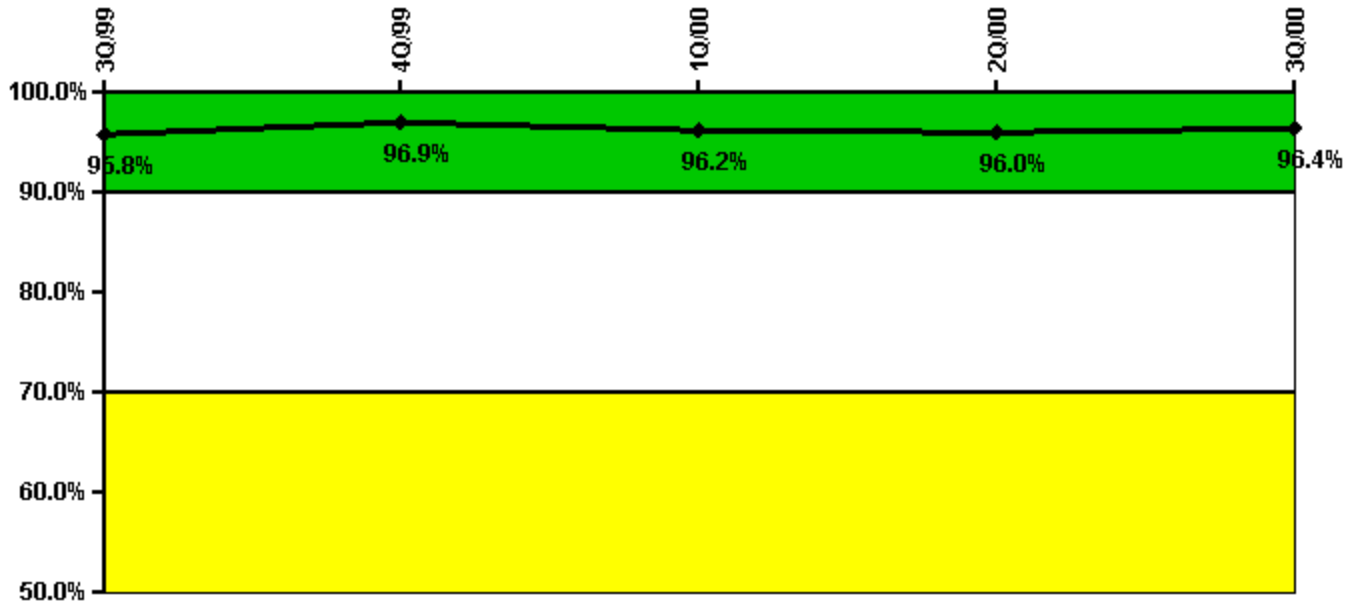

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Successful opportunities	55.0	56.0	15.0	59.0	50.0
Total opportunities	55.0	57.0	17.0	62.0	53.0
Indicator value	95.8%	96.9%	96.2%	96.0%	96.4%

Licensee Comments:

3Q/00: Third Quarter 2000 data collection process included a change based on FAQ 195 to count a notification opportunity that included both a classification and a Protective Action Recommendation as two notification opportunities.

ERO Drill Participation

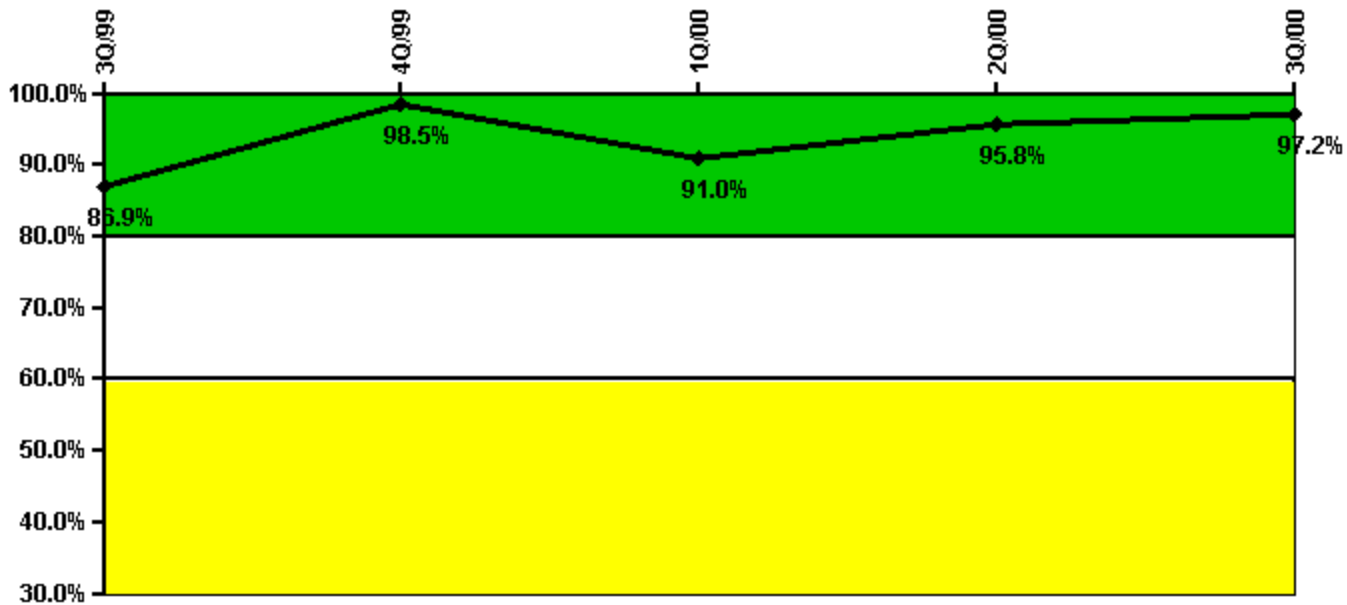


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Participating Key personnel	53.0	64.0	61.0	69.0	69.0
Total Key personnel	61.0	65.0	67.0	72.0	71.0
Indicator value	86.9%	98.5%	91.0%	95.8%	97.2%

Licensee Comments: none

Alert & Notification System

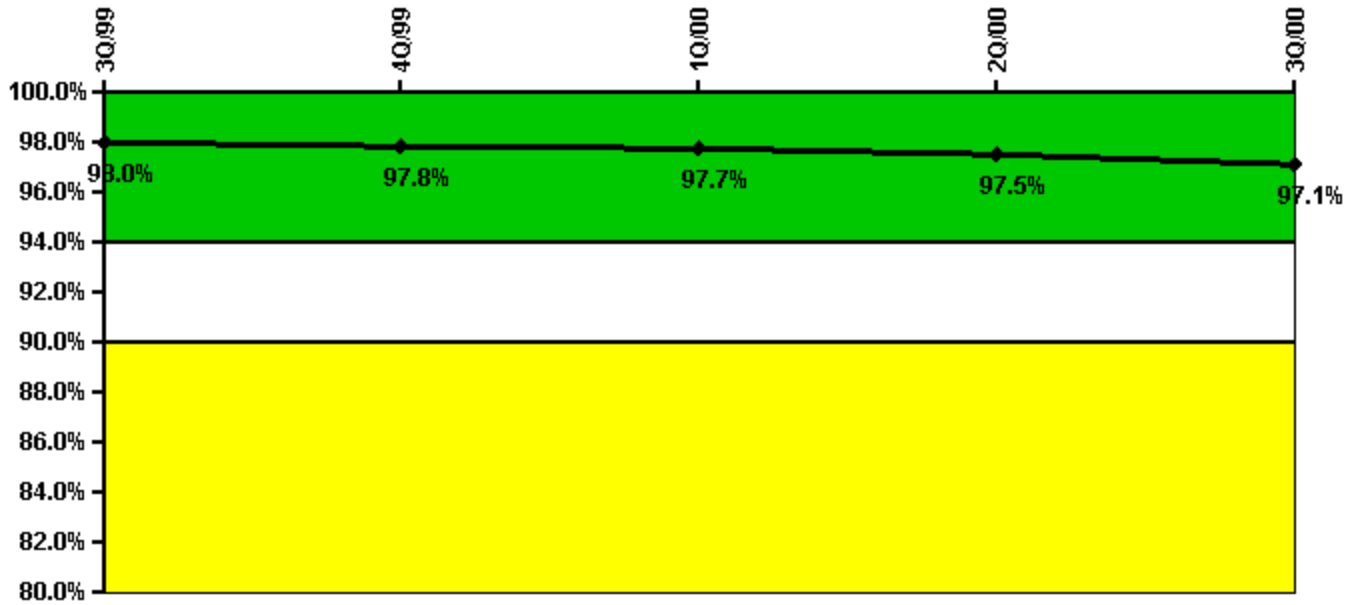


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Successful siren-tests	3303	3219	3321	3190	3150
Total sirens-tests	3380	3276	3380	3328	3276
Indicator value	98.0%	97.8%	97.7%	97.5%	97.1%

Licensee Comments: none

Occupational Exposure Control Effectiveness

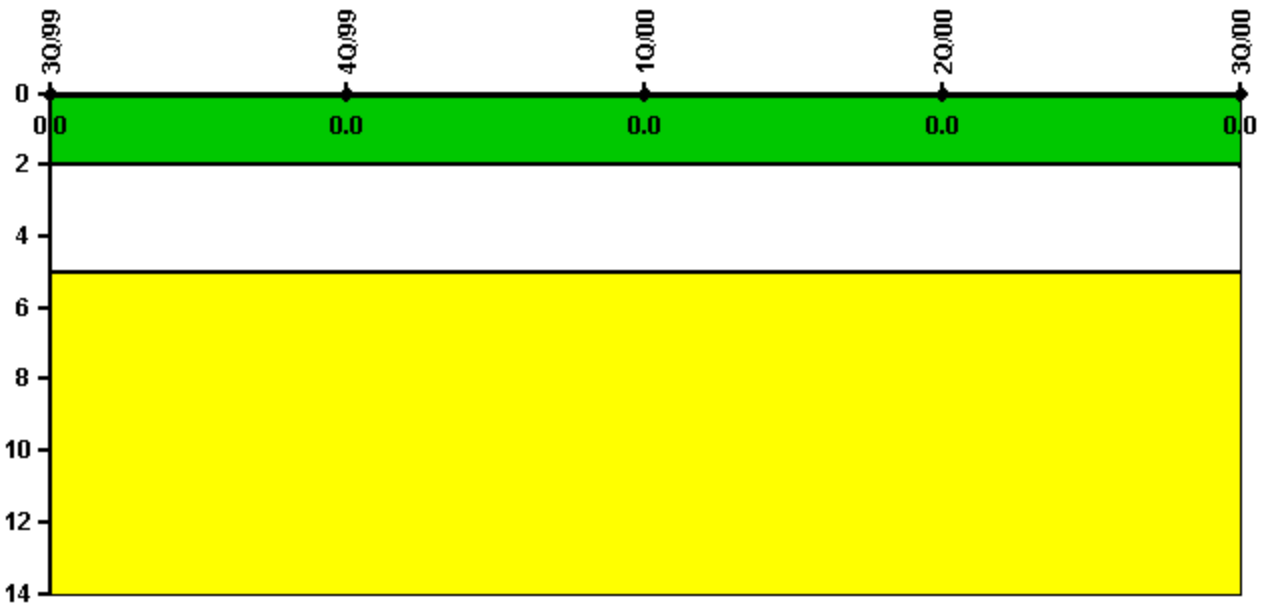

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

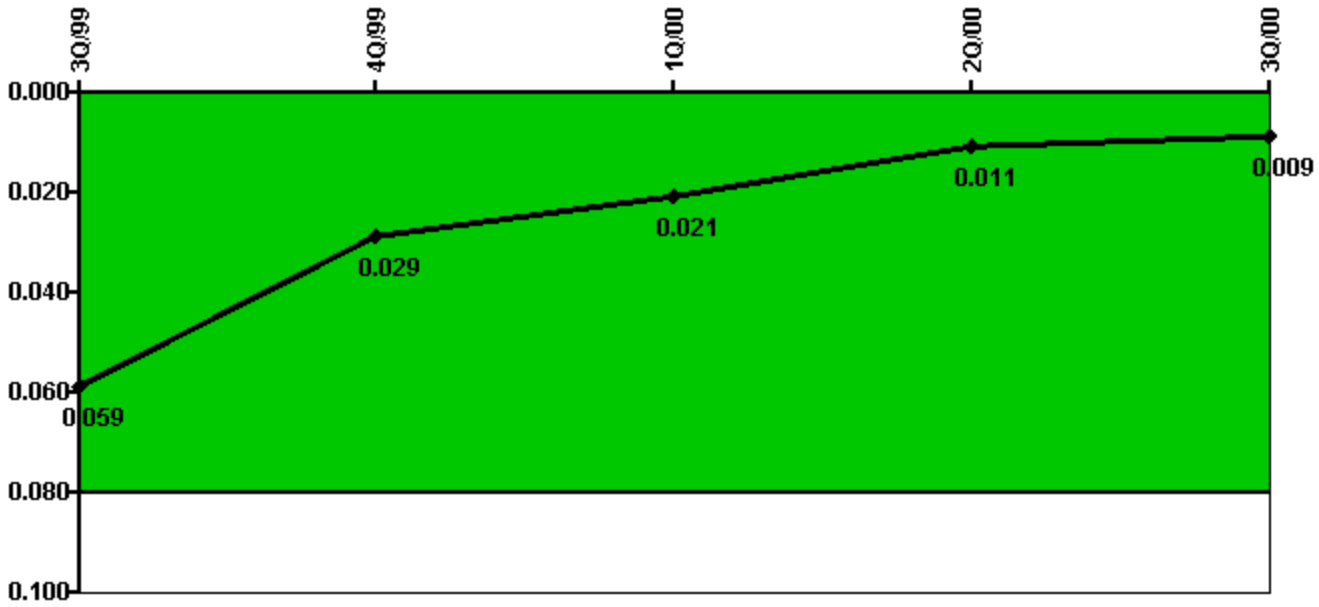


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
IDS compensatory hours	47.69	22.10	28.50	82.20	24.32
CCTV compensatory hours	0.6	2.2	0	4.3	1.6
IDS normalization factor	1.00	1.00	1.00	1.00	1.00
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
Index Value	0.059	0.029	0.021	0.011	0.009

Licensee Comments: none

Personnel Screening Program

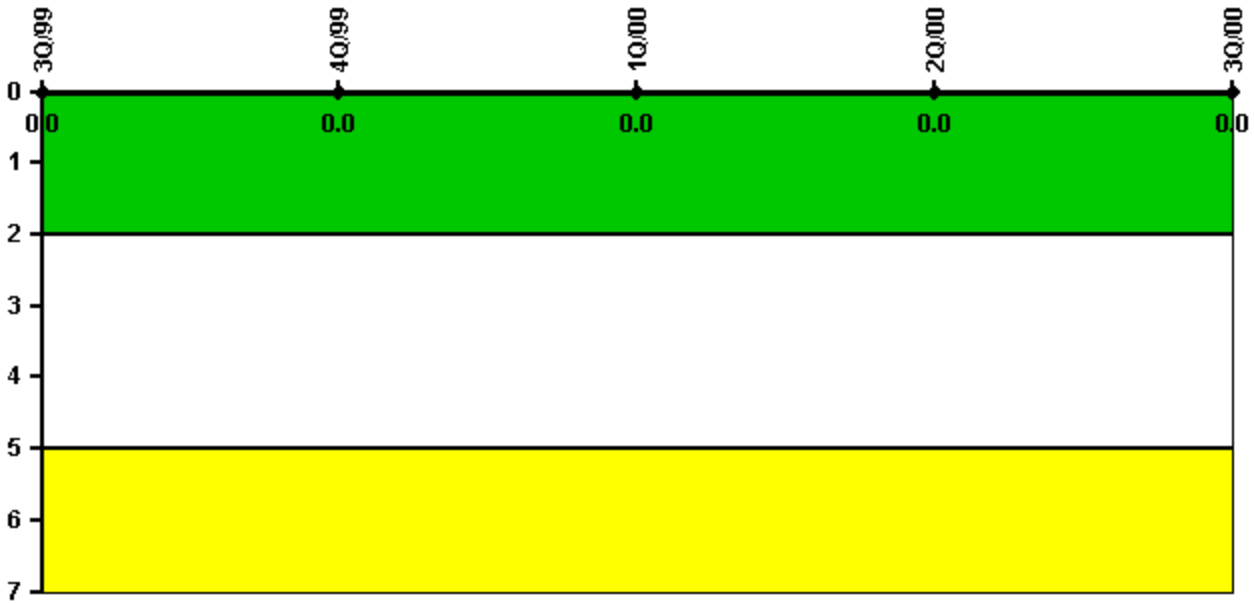


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

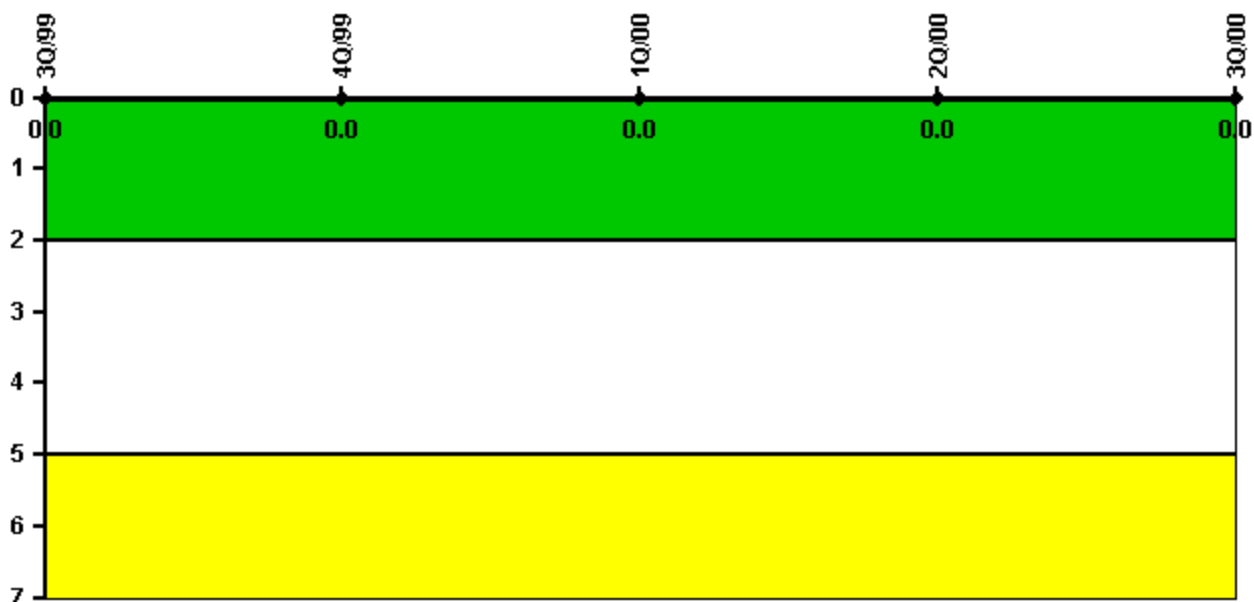

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

[PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 29, 2002