


Surry 1

3Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

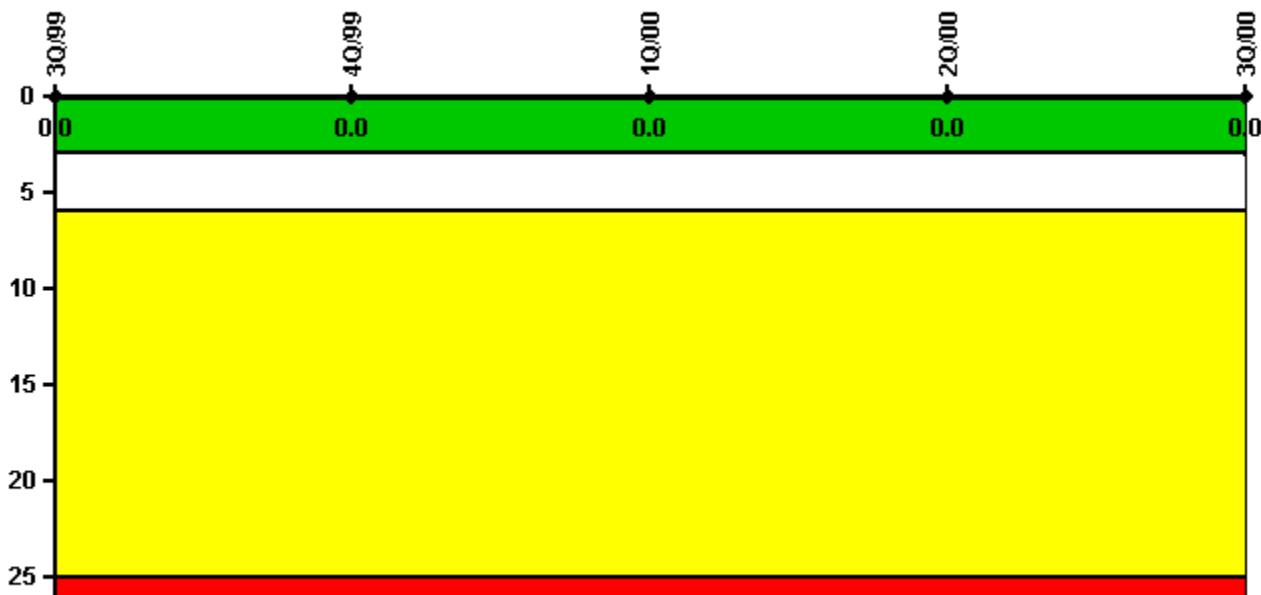

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Unplanned scrams	0	0	0	0	0
Critical hours	2208.0	2209.0	2184.0	1646.0	2208.0
Indicator value	0	0	0	0	0

Licensee Comments:

3Q/00: Hours of critical operation for April and May, 2000 were inaccurate. April's data did not compensate for Daylight Savings Time (1 hour) and May's data miscalculated the post refueling outage critical hours by 1 day (24 hours). Second quarter data was corrected with no change in color.

Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Scrams	0	0	0	0	0
Indicator value		0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

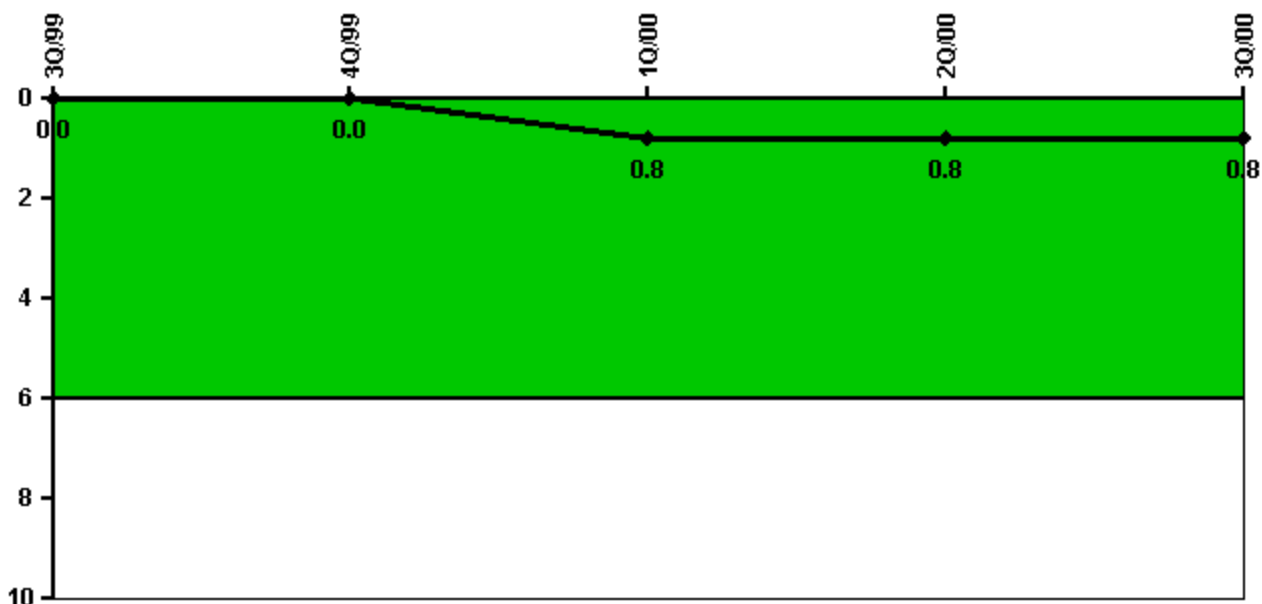

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Unplanned power changes	0	0	1.0	0	0
Critical hours	2208.0	2209.0	2184.0	1646.0	2208.0
Indicator value	0	0	0.8	0.8	0.8

Licensee Comments:

3Q/00: Hours of critical operation for April and May, 2000 were inaccurate. April's data did not compensate for Daylight Savings Time (1 hour) and May's data miscalculated the post refueling outage critical hours by 1 day (24 hours). Second quarter data was corrected with no change in color.

Safety System Unavailability, Emergency AC Power

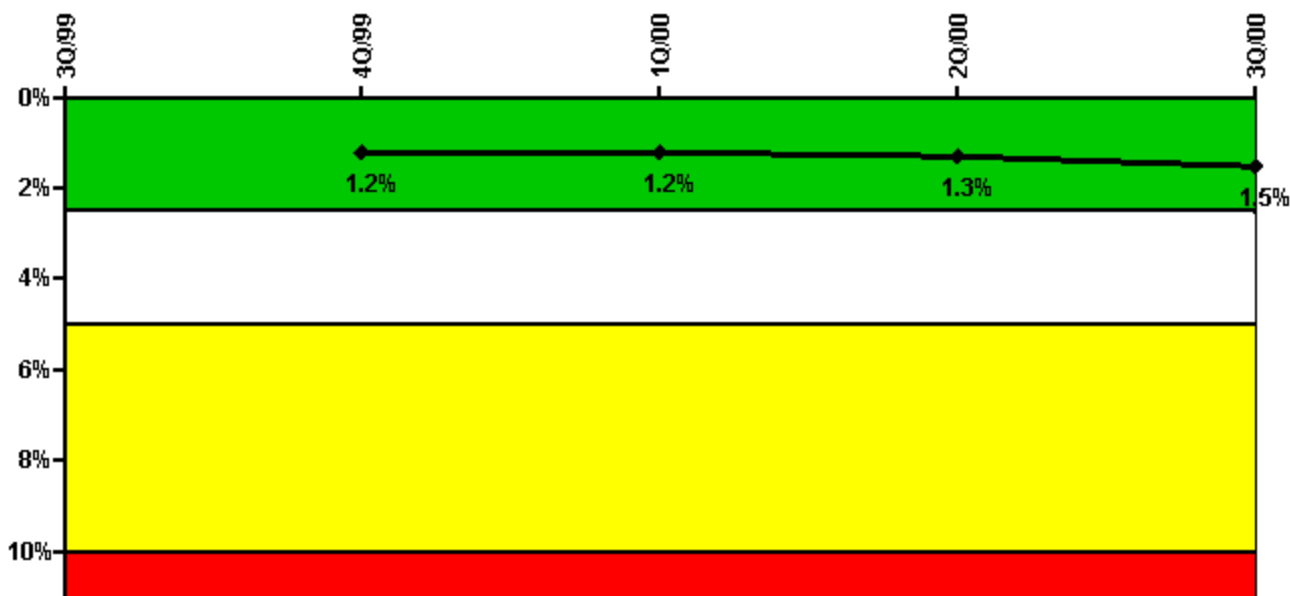

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Emergency AC Power	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	23.00	17.30	13.40	26.60	17.39
Unplanned unavailable hours	0	0	0	0	83.68
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2076.00	2208.00
Train 2					
Planned unavailable hours	15.65	41.05	26.08	16.86	33.78
Unplanned unavailable hours	0	0	0	50.20	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00
Indicator value		1.2%	1.2%	1.3%	1.5%

Licensee Comments:

2Q/00: Due to the clarifying notes for testing and on-line planned overhaul maintenance in Revision 0 of NEI 99-02, reportable "planned unavailable hours" for this PI could be reduced. Historical data from 1Q1997 through 1Q2000 was corrected. The PI color did not change.

Safety System Unavailability, High Pressure Injection System (HPSI)

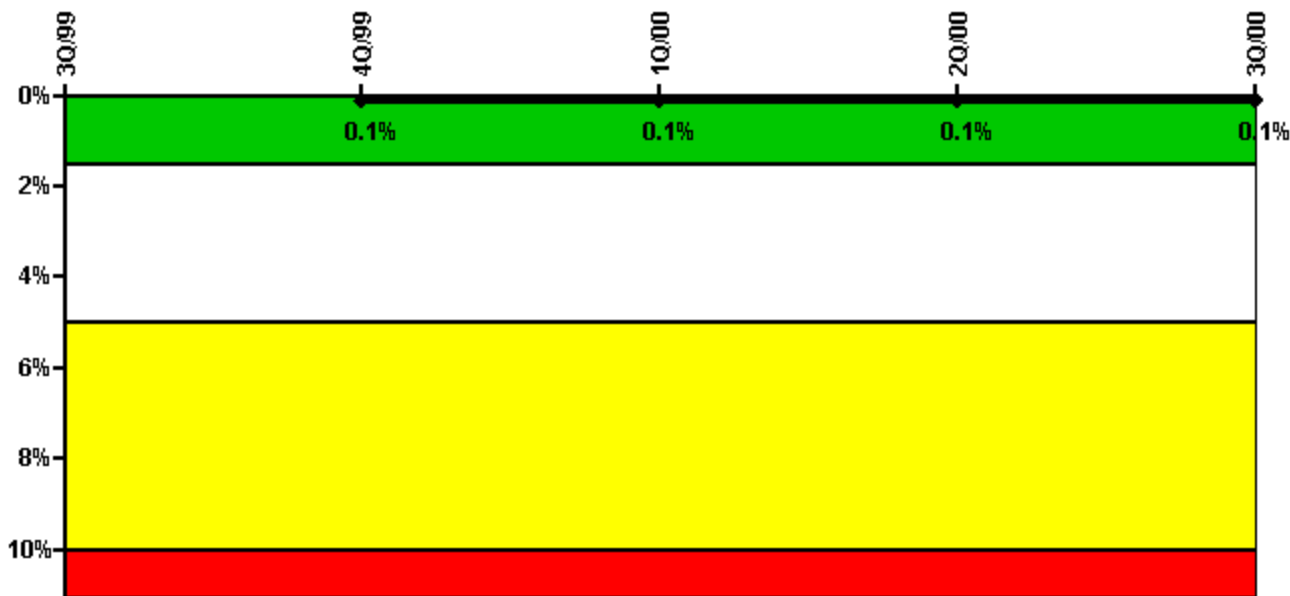


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	0	0	5.20	0	0
Unplanned unavailable hours	0	0	0	1.20	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	1699.00	2208.00
Train 2					
Planned unavailable hours	0	0	10.00	9.70	0
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	1699.00	2208.00
Indicator value		0.1%	0.1%	0.1%	0.1%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

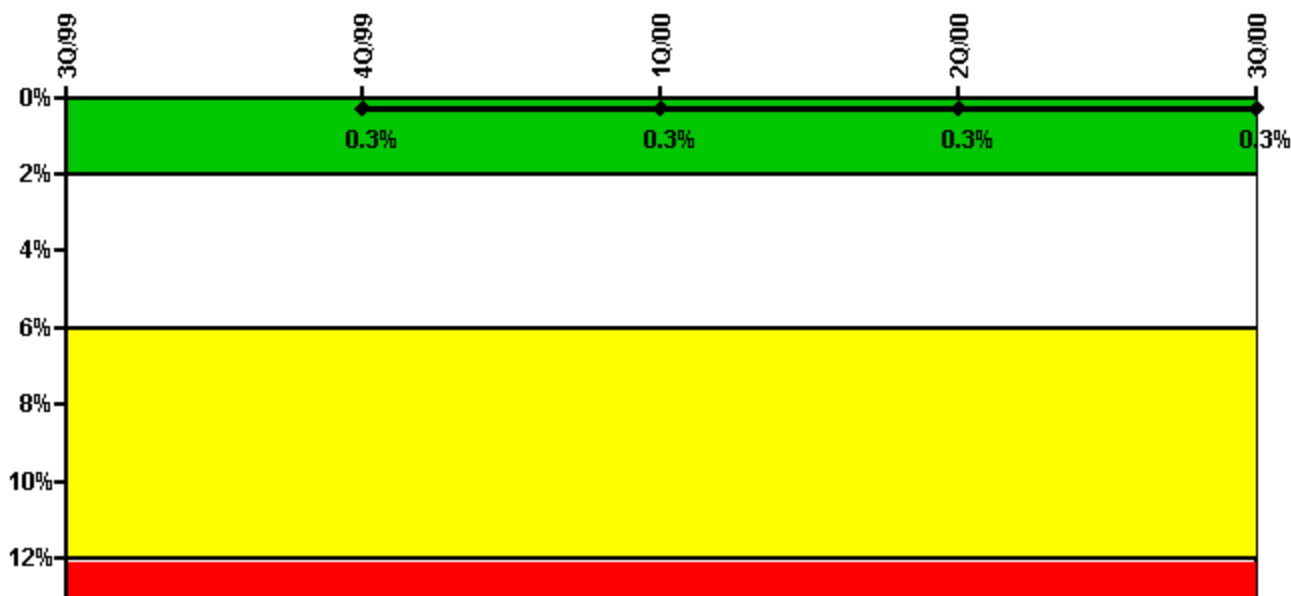


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	9.10	3.30	2.90	0.60	3.19
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	1699.00	2208.00
Train 2					
Planned unavailable hours	12.40	0	1.50	1.20	0.92
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	1699.00	2208.00
Train 3					
Planned unavailable hours	11.50	2.00	19.90	11.30	2.48
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	1699.00	2197.00
Indicator value		0.3%	0.3%	0.3%	0.3%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

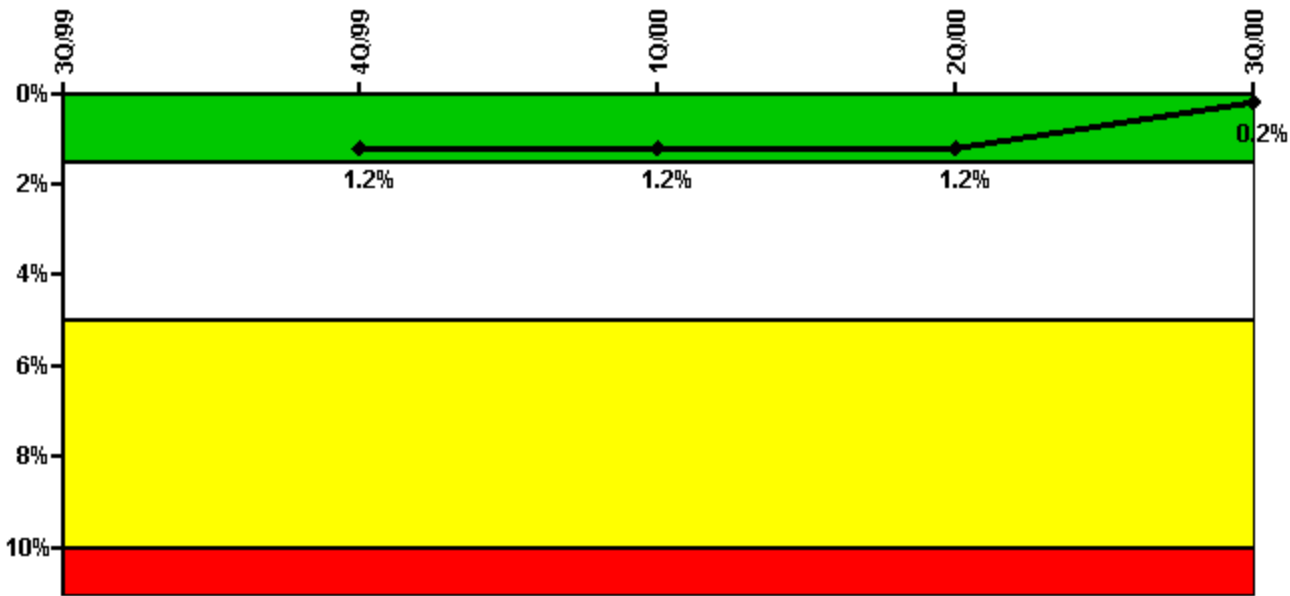

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	0	0	10.00	0.40	0.58
Unplanned unavailable hours	6.30	0	0	1.50	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	1699.00	2208.00
Train 2					
Planned unavailable hours	0	0	0.10	0.40	13.15
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	1015.00
Required hours	2208.00	2209.00	2184.00	1699.00	2208.00
Train 3					
Planned unavailable hours	0	0	0	10.40	0
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2076.00	2208.00
Train 4					
Planned unavailable hours	0	0	0	10.50	0
Unplanned unavailable hours	0	0	0	6.80	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2076.00	2208.00
Indicator value		1.2%	1.2%	1.2%	0.2%

Licensee Comments:


3Q/00: Fault exposure hours for Train 2 for February, 1999 have been removed as allowed by NEI 99-02, Rev. 0

3Q/00: Fault exposure hours for Train 2 for February, 1999 have been removed as allowed by NEI 99-02, Rev. 0

Effective Reset Comments:

3Q/00: Previously reset hours were reset under the new process.

Safety System Functional Failures (PWR)

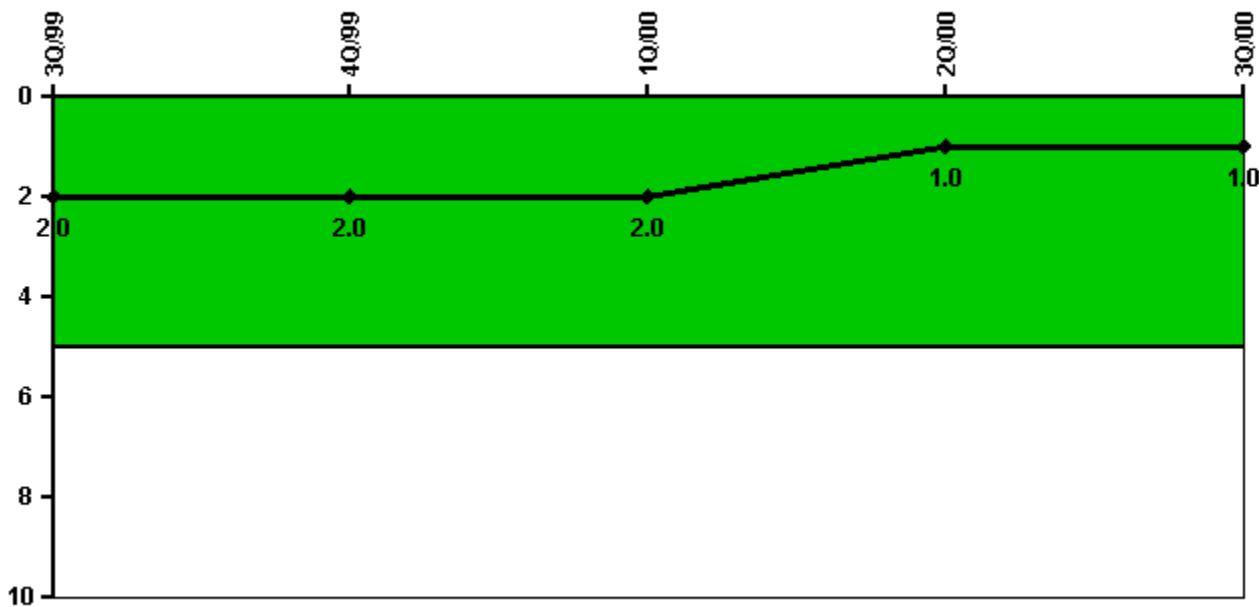

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Safety System Functional Failures	1	0	0	0	1
Indicator value	2	2	2	1	1

Licensee Comments:

3Q/00: Refer to Licensing Event Report 50-280, 281/00002-00

Reactor Coolant System Activity

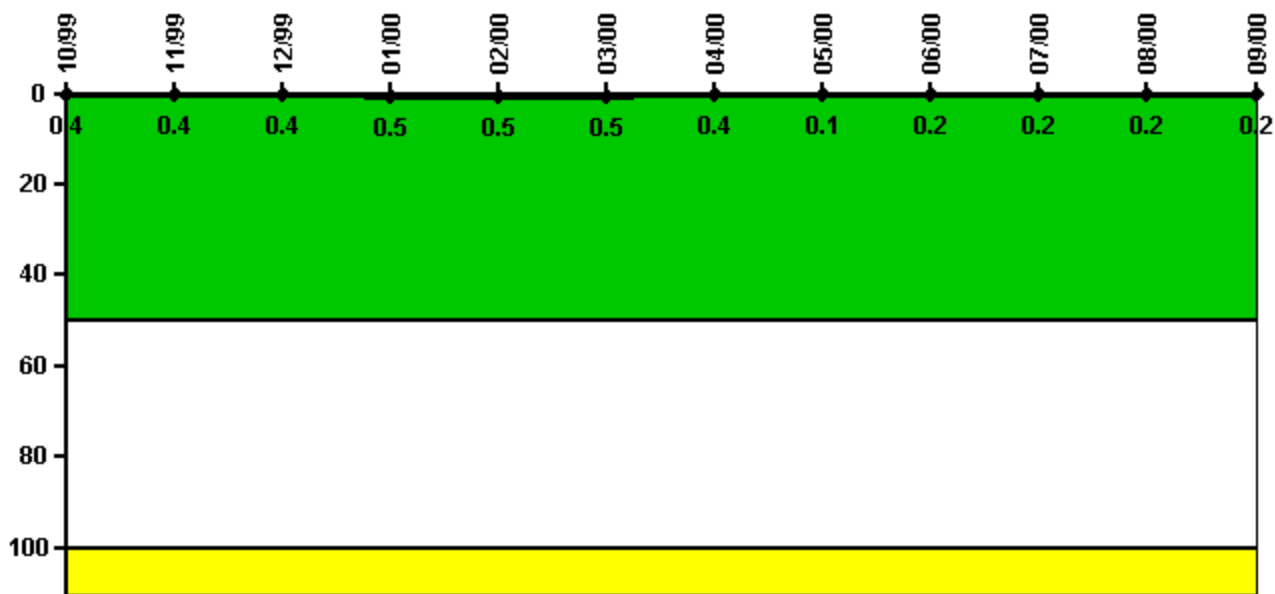


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum activity	0.004070	0.004460	0.004370	0.004500	0.004660	0.005130	0.003910	0.001360	0.001720	0.001550	0.001770	0.002050
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.4	0.4	0.4	0.5	0.5	0.5	0.4	0.1	0.2	0.2	0.2	0.2

Licensee Comments: none

Reactor Coolant System Leakage

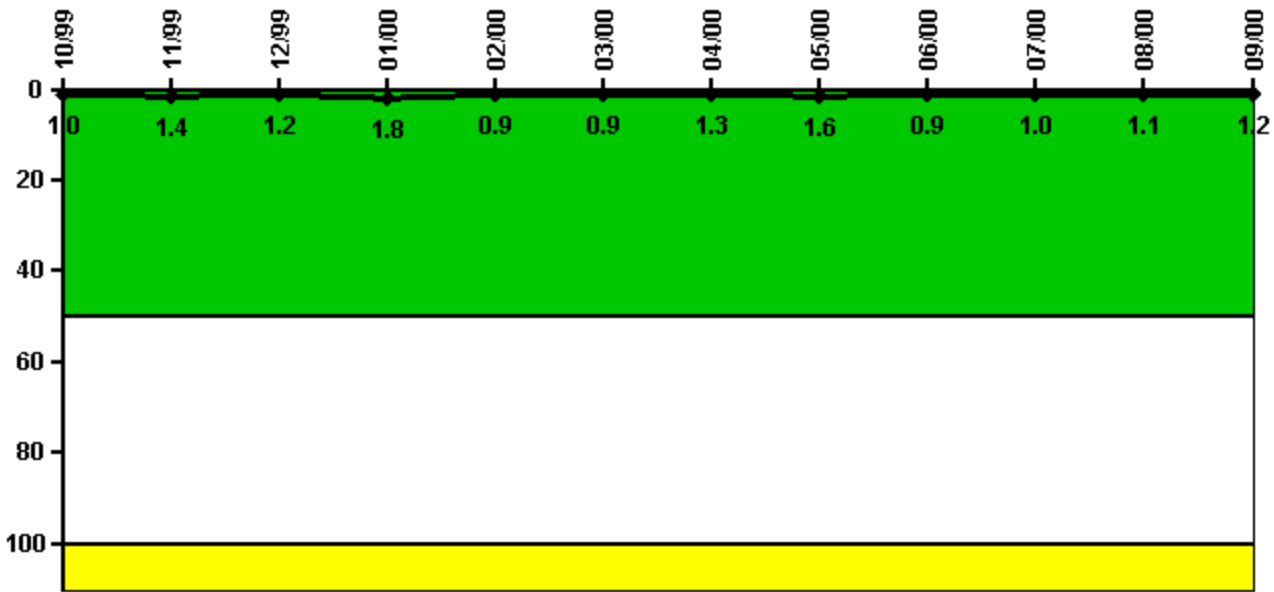


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum leakage	0.100	0.140	0.120	0.180	0.090	0.090	0.130	0.160	0.090	0.100	0.110	0.120
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.0	1.4	1.2	1.8	0.9	0.9	1.3	1.6	0.9	1.0	1.1	1.2

Licensee Comments: none

Drill/Exercise Performance

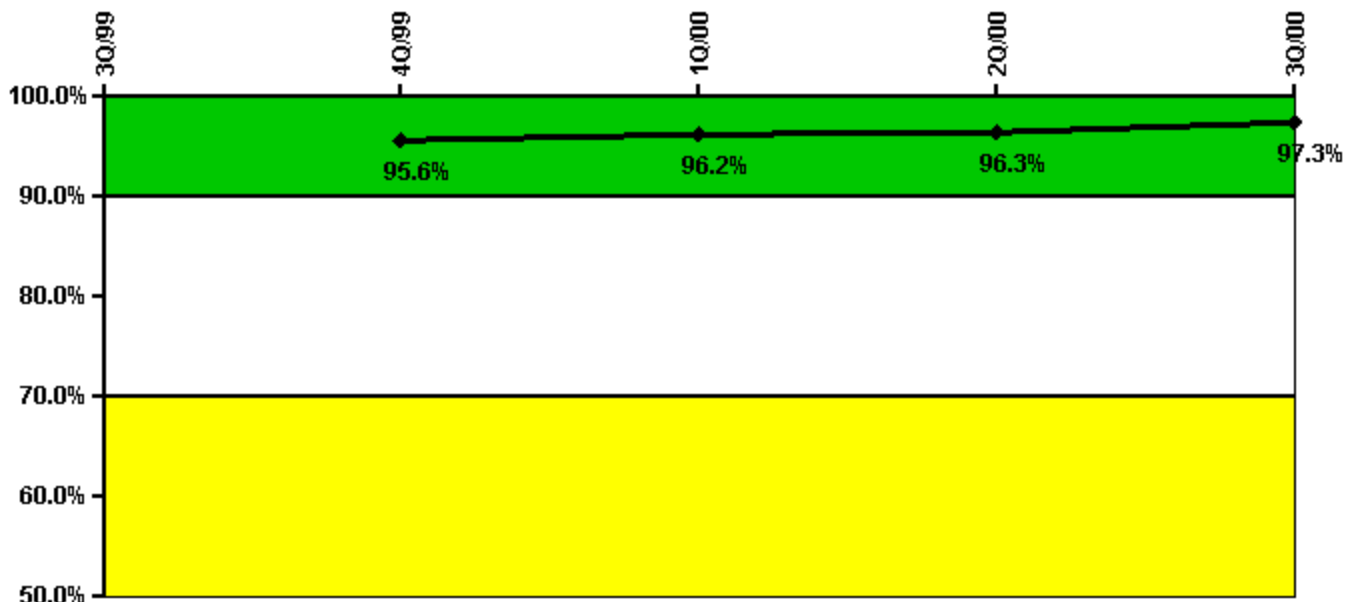


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Successful opportunities	9.0	78.0	44.0	7.0	72.0
Total opportunities	9.0	81.0	45.0	7.0	72.0
Indicator value		95.6%	96.2%	96.3%	97.3%

Licensee Comments: none

ERO Drill Participation

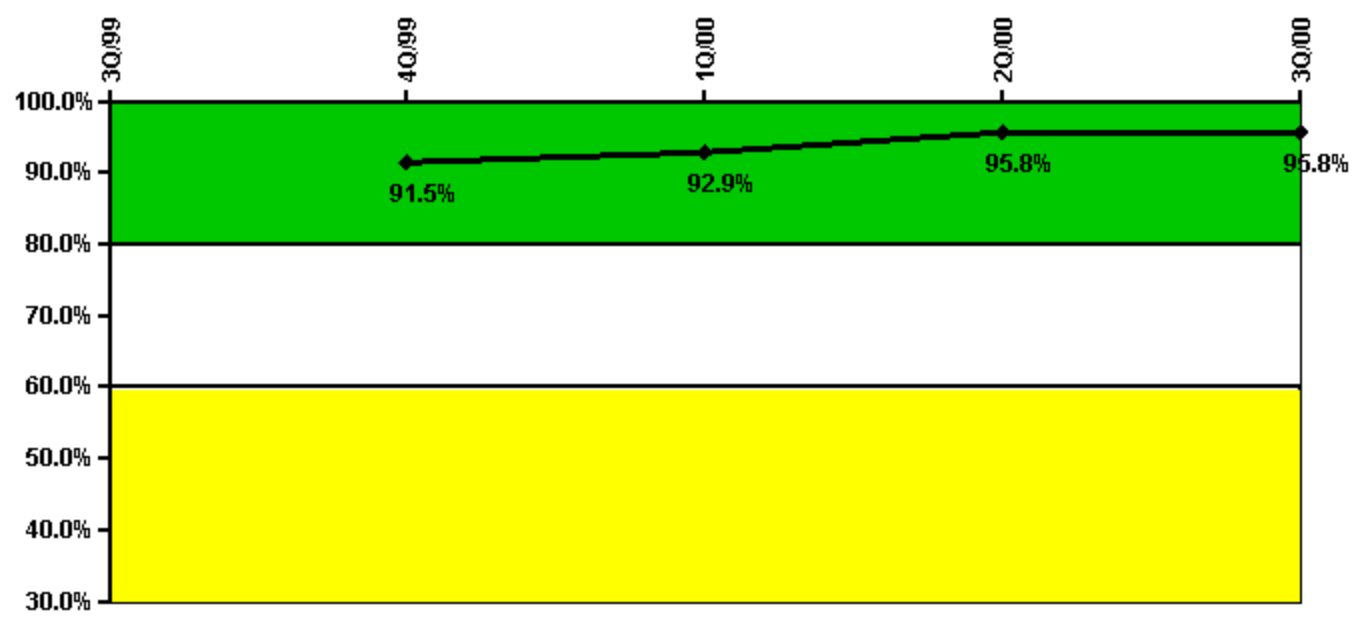


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Participating Key personnel		151.0	157.0	158.0	161.0
Total Key personnel		165.0	169.0	165.0	168.0
Indicator value		91.5%	92.9%	95.8%	95.8%

Licensee Comments: none

Alert & Notification System

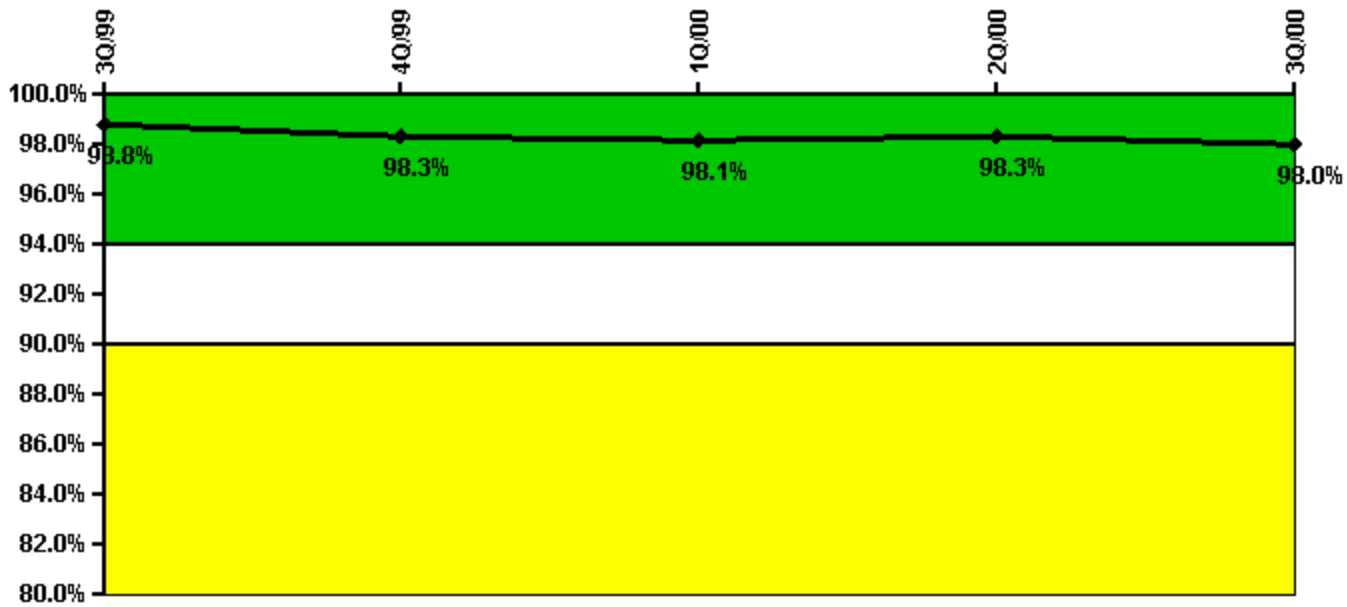


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Successful siren-tests	493	492	498	441	437
Total sirens-tests	500	504	506	448	448
Indicator value	98.8%	98.3%	98.1%	98.3%	98.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

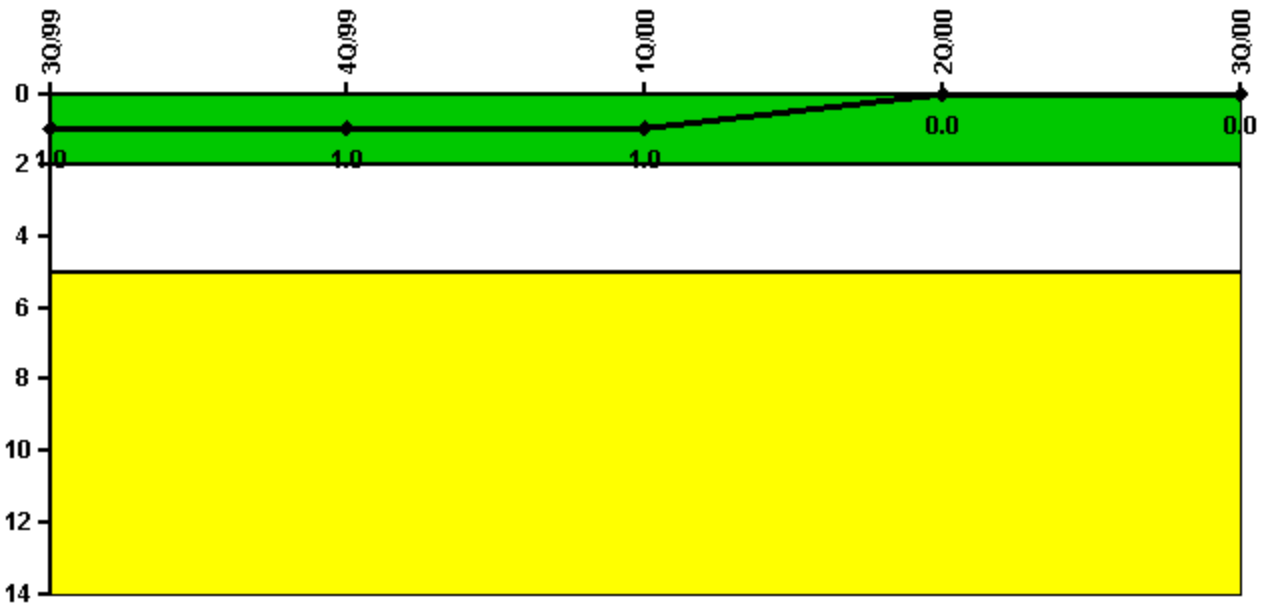


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	1	1	1	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

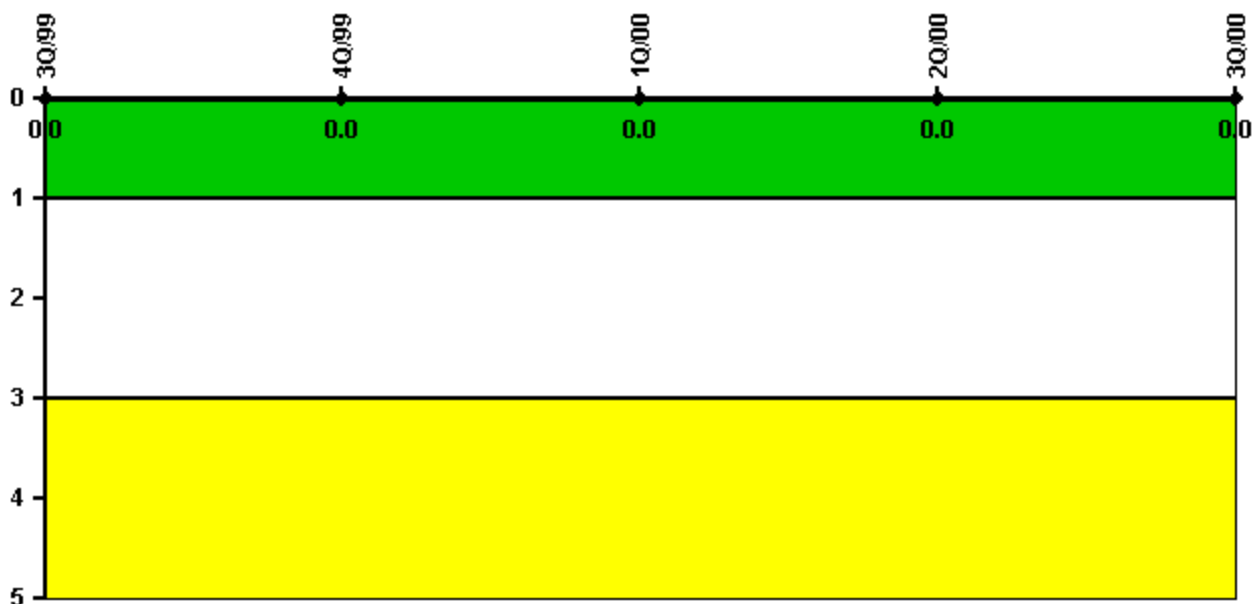


Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

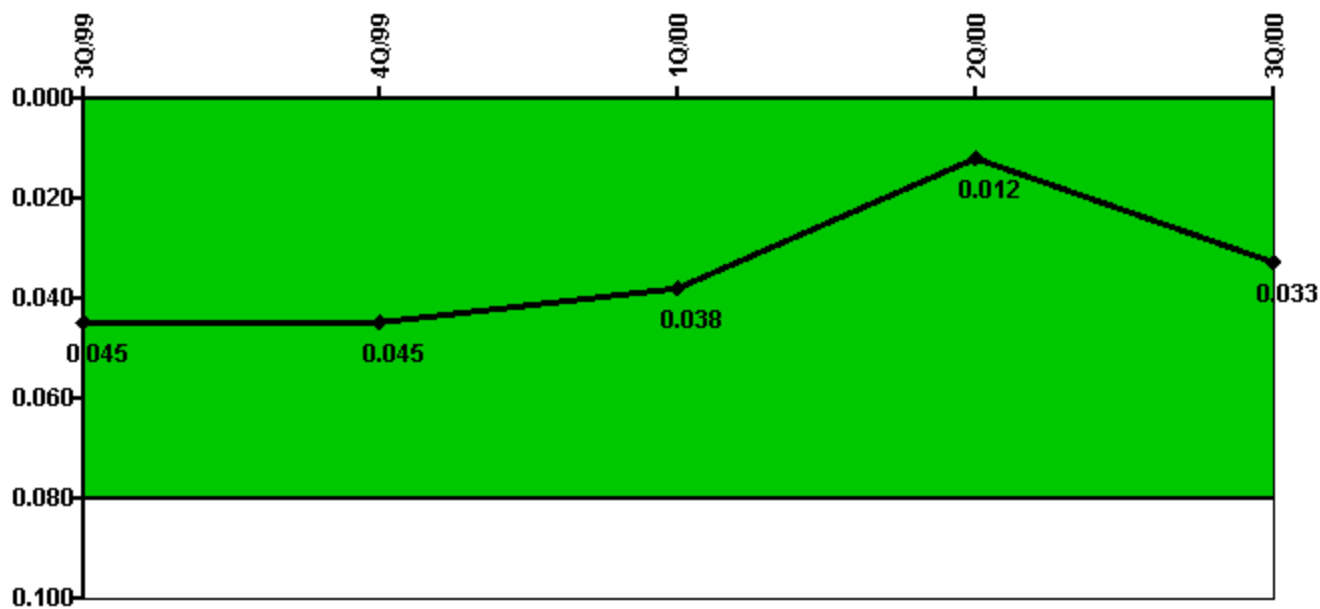

Thresholds: White > 0.080


Notes

Protected Area Security Performance Index	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
IDS compensatory hours	124.30	8.20	26.05	59.40	513.85
CCTV compensatory hours	0	0	0	0	0
IDS normalization factor	1.05	1.05	1.05	1.05	1.05
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
Index Value	0.045	0.045	0.038	0.012	0.033

Licensee Comments:

3Q/00: The Protected Area perimeter threat assessment function at Surry is primarily provided by armed response personnel in towers. This performance data reflects one CCTV camera which covers the part of the perimeter not covered by a tower.

Personnel Screening Program

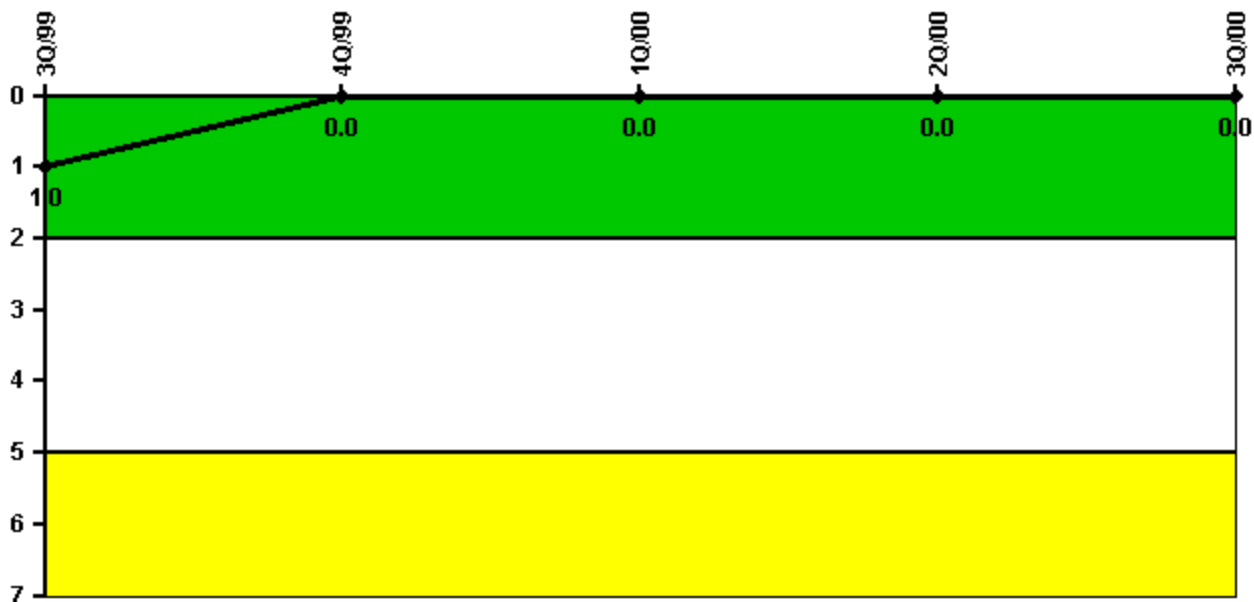


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Program failures	0	0	0	0	0
Indicator value	1	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

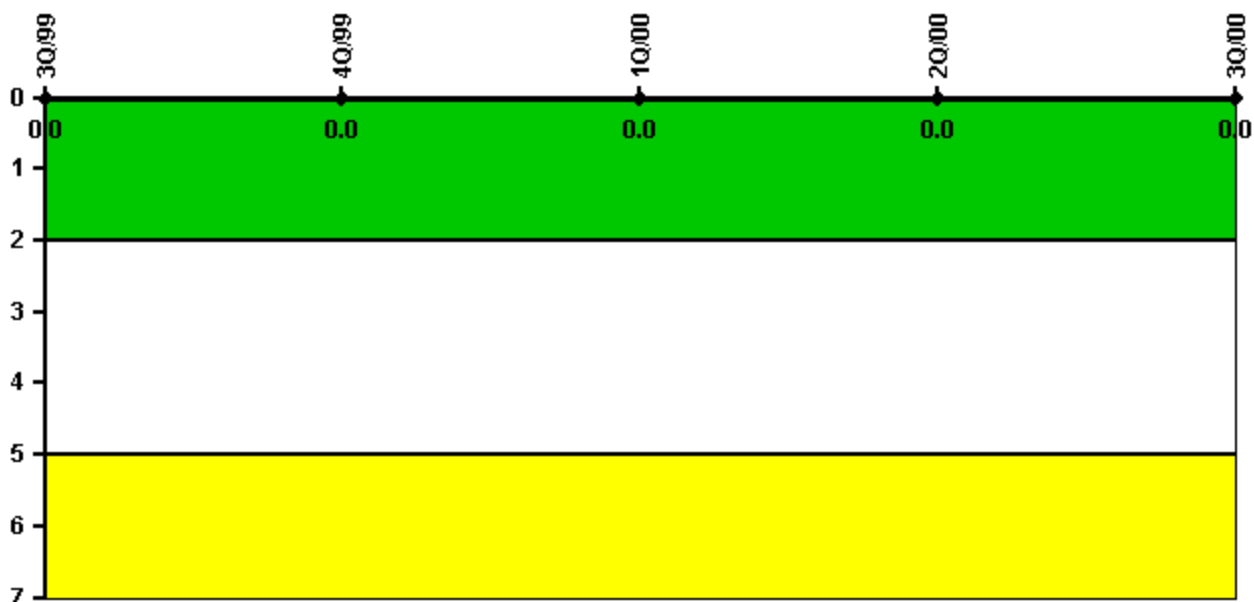

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

[PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 29, 2002