


Millstone 3

4Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

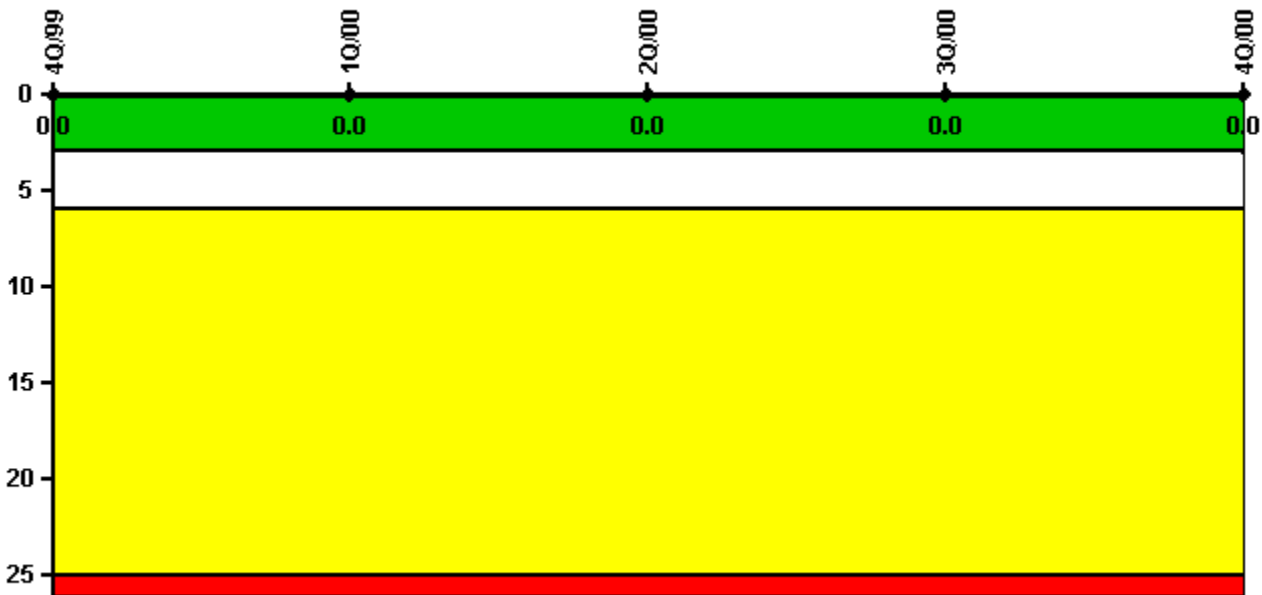

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Unplanned scrams	0	0	0	0	0
Critical hours	2209.0	2184.0	2183.0	2208.0	2209.0
Indicator value	0	0	0	0	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Scrams	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

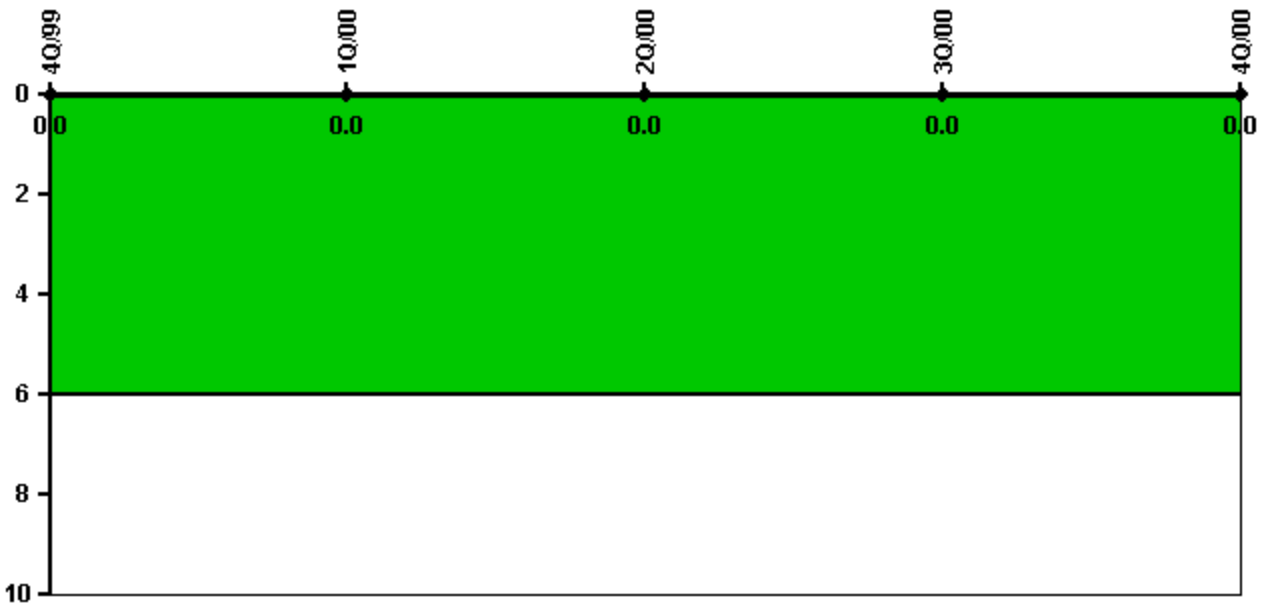


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Unplanned power changes	0	0	0	0	0
Critical hours	2209.0	2184.0	2183.0	2208.0	2209.0
Indicator value	0	0	0	0	0

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

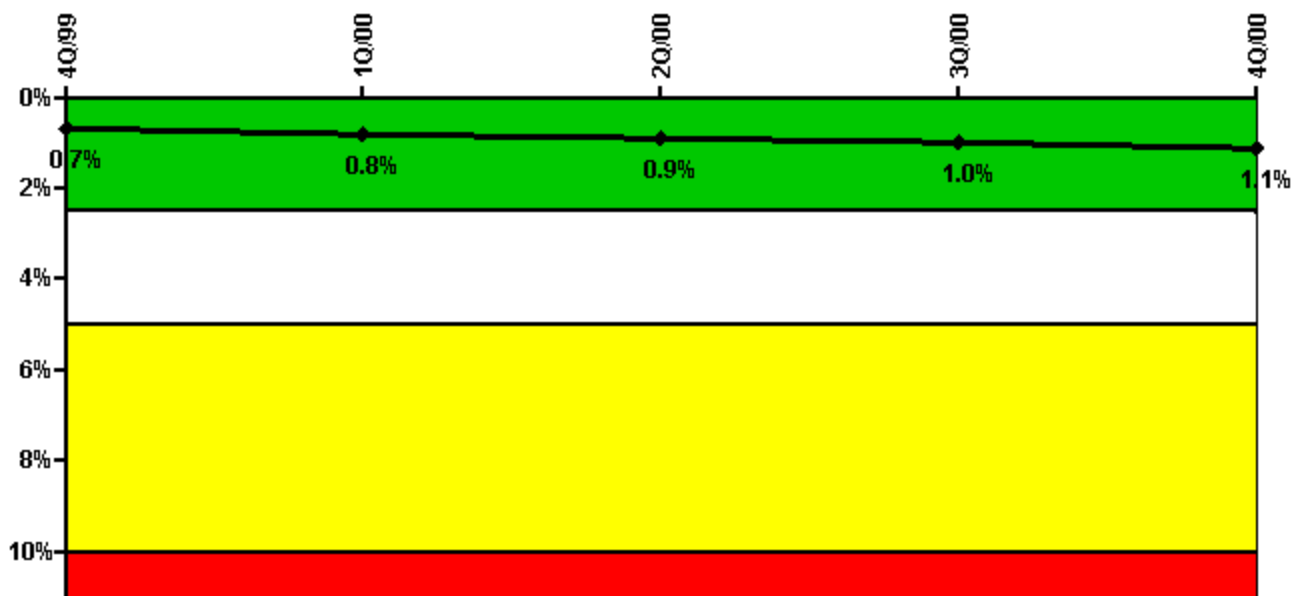

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	19.30	36.55	16.13	20.64	28.80
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 2					
Planned unavailable hours	20.72	25.03	28.49	16.88	44.30
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Indicator value	0.7%	0.8%	0.9%	1.0%	1.1%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)




Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	11.44	22.40	24.60	23.09	34.40
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 2					
Planned unavailable hours	13.65	22.52	15.33	44.47	19.59
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 3					
Planned unavailable hours	12.84	20.90	15.34	22.92	19.57
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 4					
Planned unavailable hours	21.89	9.51	11.73	15.41	27.12
Unplanned unavailable hours	0	0	1.72	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Indicator value	0.7%	0.8%	0.8%	0.8%	0.9%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

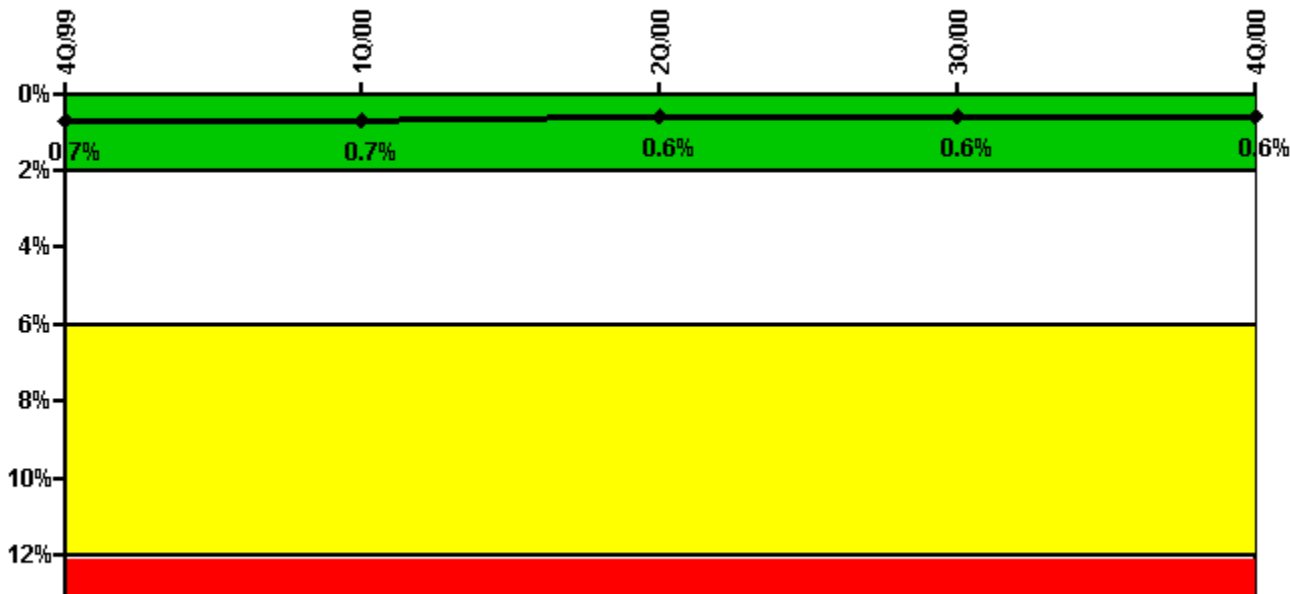


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	9.88	9.92	2.97	13.20	3.78
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 2					
Planned unavailable hours	3.95	11.45	9.69	6.52	1.98
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 3					
Planned unavailable hours	13.47	5.96	9.47	23.00	3.75
Unplanned unavailable hours	26.03	10.28	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Indicator value	0.7%	0.7%	0.6%	0.6%	0.6%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

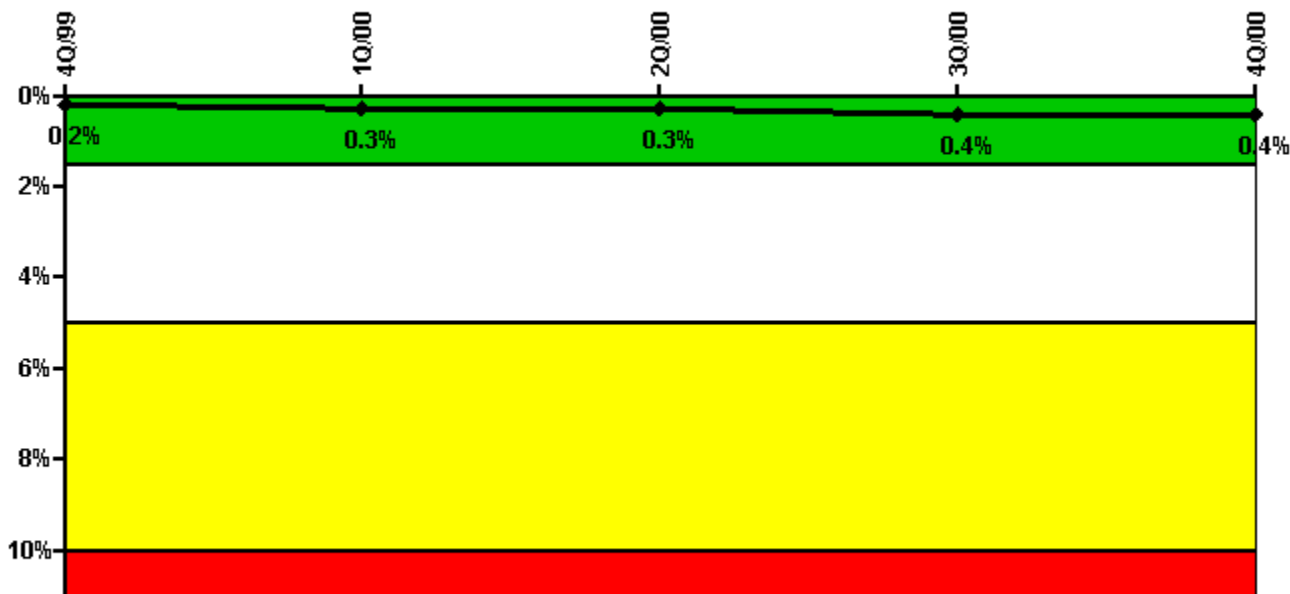

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	23.60	9.70	0	0	0
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	0	0	0
Train 2					
Planned unavailable hours	13.54	17.60	0	0	0
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	0	0	0
Train 3					
Planned unavailable hours	10.30	9.08	13.33	17.19	5.83
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 4					
Planned unavailable hours	17.40	3.70	7.47	31.62	6.02
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0

Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Indicator value	0.2%	0.3%	0.3%	0.4%	0.4%

Licensee Comments: none

Safety System Functional Failures (PWR)

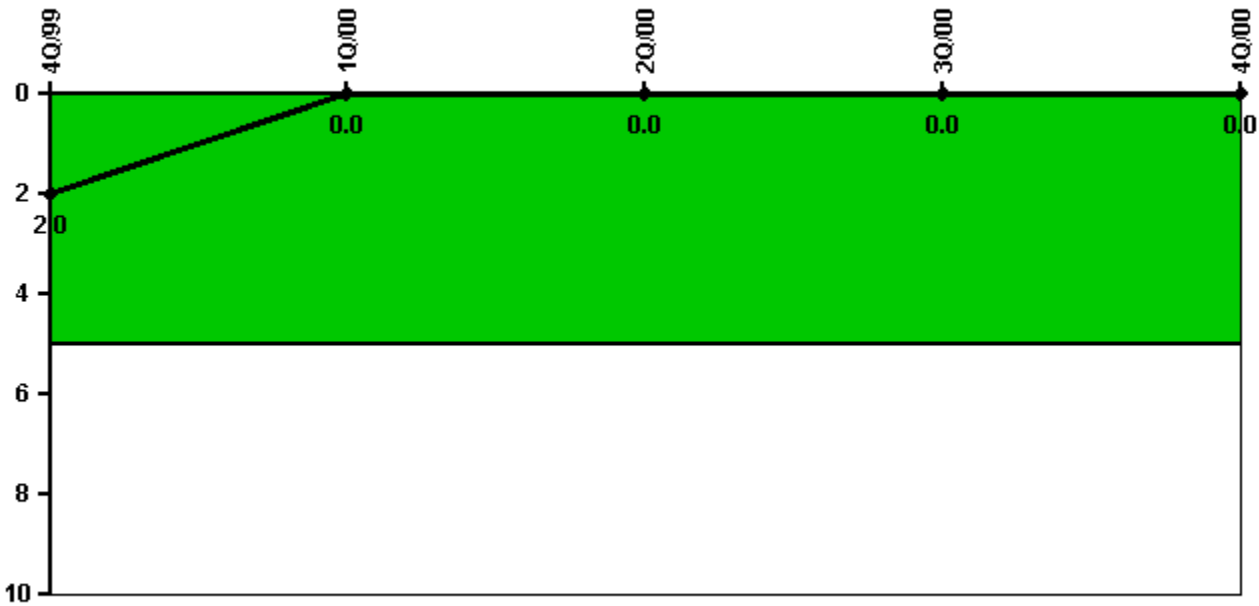


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Safety System Functional Failures	0	0	0	0	0
Indicator value	2	0	0	0	0

Licensee Comments: none

Reactor Coolant System Activity

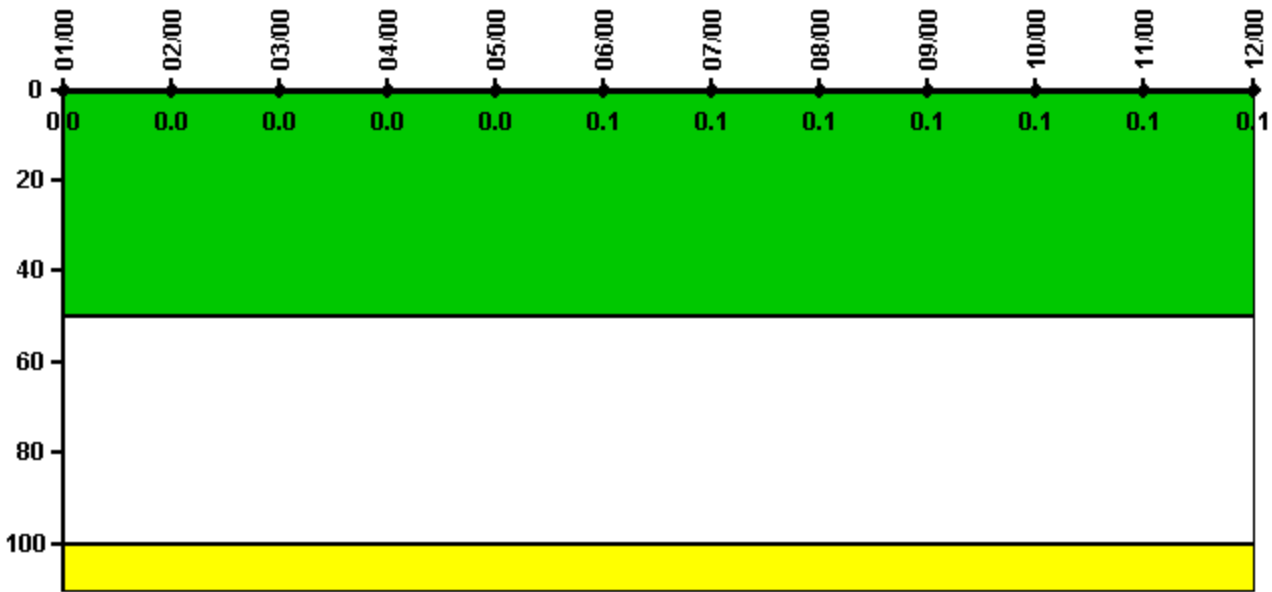


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00
Maximum activity	0.000424	0.000442	0.000486	0.000477	0.000488	0.000505	0.000508	0.000517	0.000538	0.000540	0.000543	0.000578
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

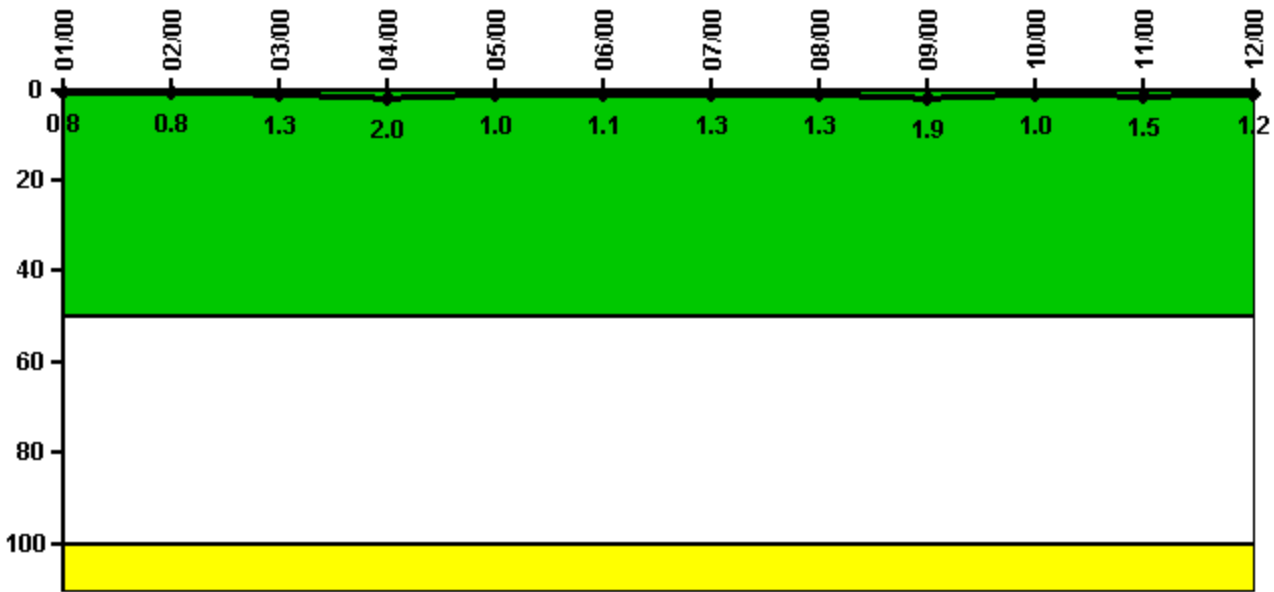


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00
Maximum leakage	0.075	0.084	0.127	0.203	0.099	0.107	0.131	0.134	0.185	0.098	0.146	0.124
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.8	0.8	1.3	2.0	1.0	1.1	1.3	1.3	1.9	1.0	1.5	1.2

Licensee Comments: none

Drill/Exercise Performance

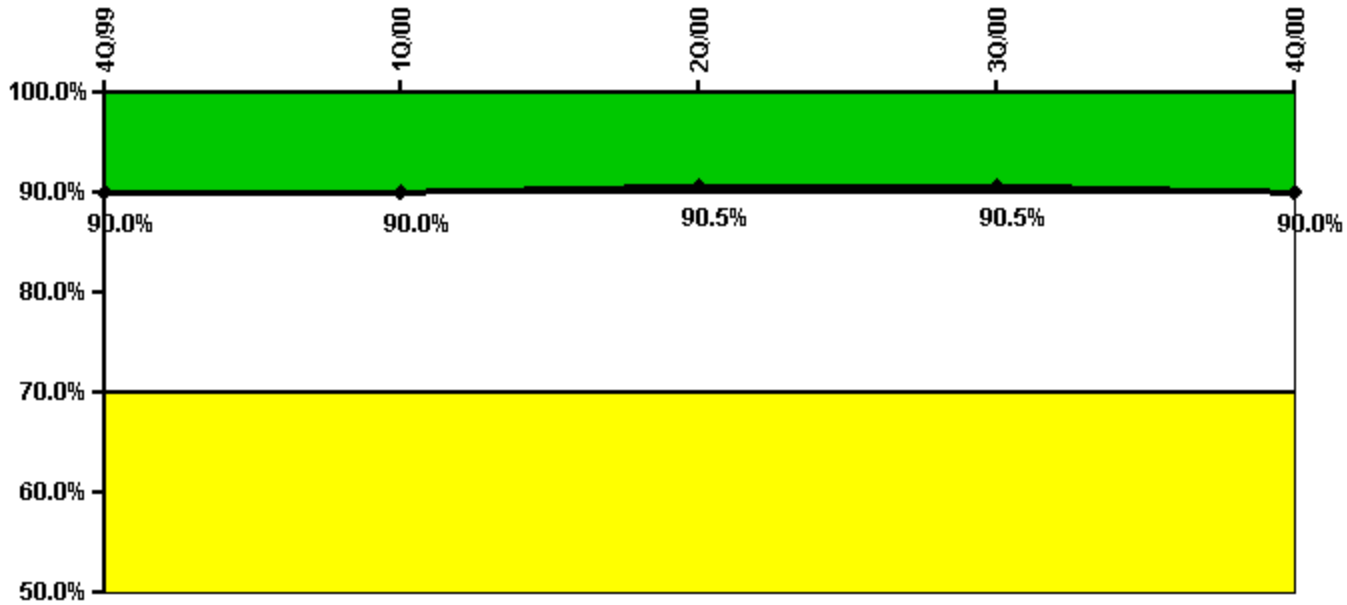


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Successful opportunities	12.0	27.0	14.0	0	11.0
Total opportunities	14.0	28.0	14.0	0	12.0
Indicator value	90.0%	90.0%	90.5%	90.5%	90.0%

Licensee Comments: none

ERO Drill Participation

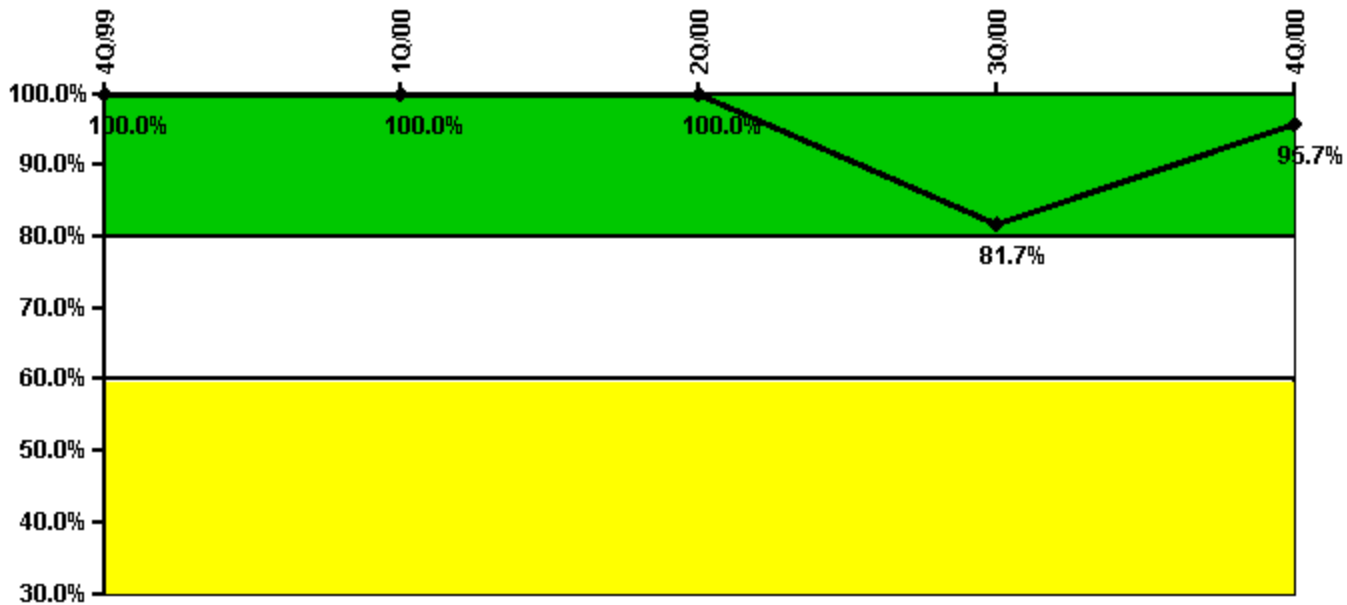


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Participating Key personnel	74.0	76.0	55.0	58.0	66.0
Total Key personnel	74.0	76.0	55.0	71.0	69.0
Indicator value	100.0%	100.0%	100.0%	81.7%	95.7%

Licensee Comments: none

Alert & Notification System

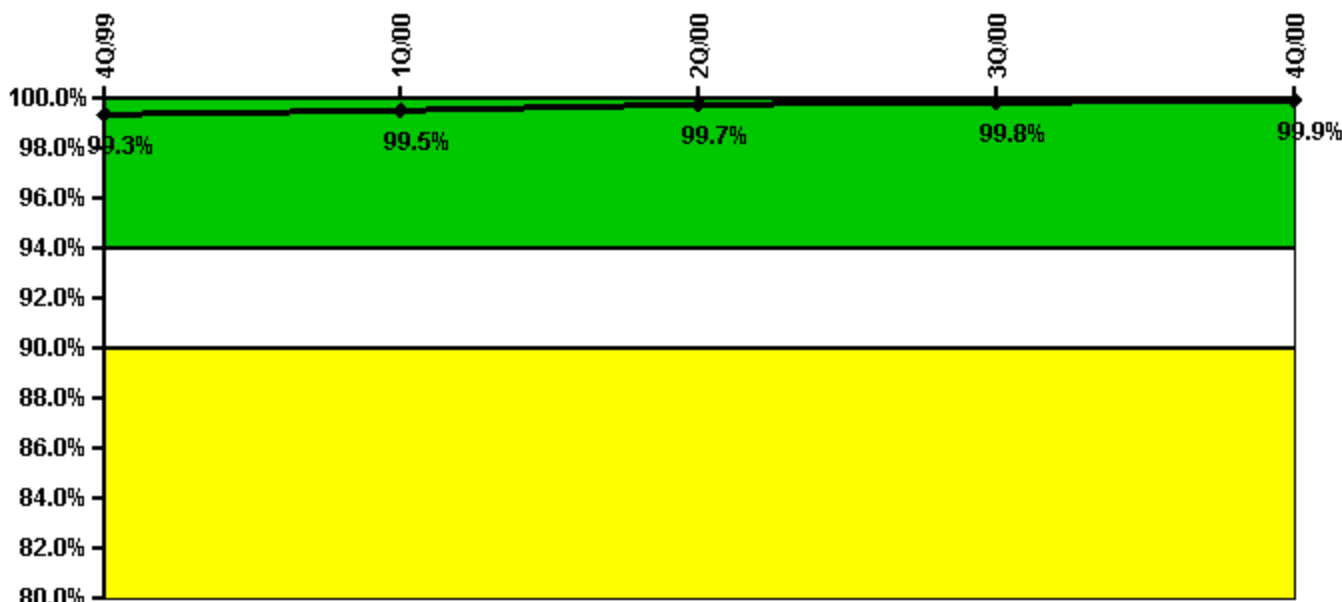

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Successful siren-tests	335	304	308	308	474
Total sirens-tests	336	306	308	308	474
Indicator value	99.3%	99.5%	99.7%	99.8%	99.9%

Licensee Comments:

4Q/00: The reporting data was found to be inconsistent with industry norms and not reflective of all tests conducted. Previously reported siren encoder tests were removed, as were 11 sirens located outside of the plume exposure zone. The quarterly growl tests conducted in the 4th quarter, not previously reported, were added in. Adjusting the data had minimal effects on the indicator values and did not result in any threshold being crossed. Consistent with the guidance provided in NEI 99-02 the data has only been corrected back to the 1st quarter 2000.


4Q/00: An error in the data collection was discovered. Previously the siren test data reported each quarter was actually 4 quarters of data. Historical data was corrected back to the First Quarter 1999 only, data in the previous quarters was not corrected. Correction of the error had a small effect on the indicator value and did not result in any threshold being crossed.

3Q/00: The reporting data was found to be inconsistent with industry norms and not reflective of all tests conducted. Previously reported siren encoder tests were removed, as were 11 sirens located outside of the plume exposure zone. The quarterly growl tests conducted in the 4th quarter, not previously reported, were added in. Adjusting the data had minimal effects on the indicator values and did not result in any threshold being crossed. Consistent with the guidance provided in NEI 99-02 the data has only been corrected back to the 1st quarter 2000.

2Q/00: The reporting data was found to be inconsistent with industry norms and not reflective of all tests conducted. Previously reported siren encoder tests were removed, as were 11 sirens located outside of the plume exposure zone. The quarterly growl tests conducted in the 4th quarter, not previously reported, were added in. Adjusting the data had minimal effects on the indicator values and did not result in any threshold being crossed. Consistent with the guidance provided in NEI 99-02 the data has only been corrected back to the 1st quarter 2000.

1Q/00: The reporting data was found to be inconsistent with industry norms and not reflective of all tests conducted. Previously reported siren encoder tests were removed, as were 11 sirens located outside of the plume exposure zone. The quarterly growl tests conducted in the 4th quarter, not previously reported, were added in. Adjusting the data had minimal effects on the indicator values and did not result in any threshold being crossed. Consistent with the guidance provided in NEI 99-02 the data has only been corrected back to the 1st quarter 2000.

Occupational Exposure Control Effectiveness

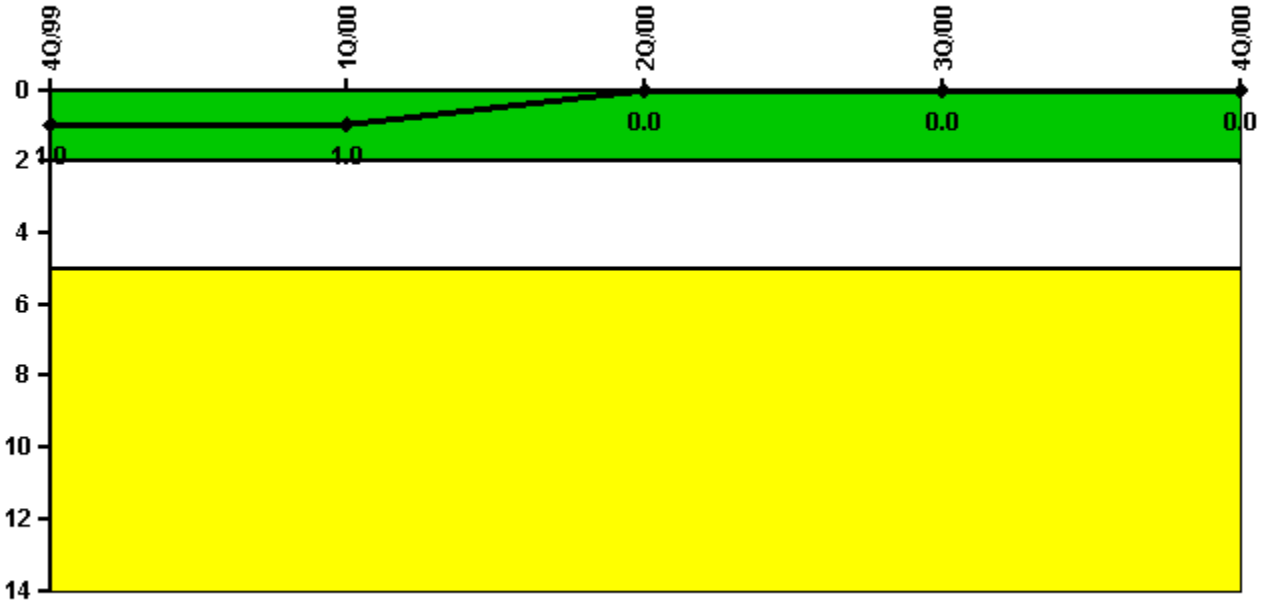

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	1	1	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

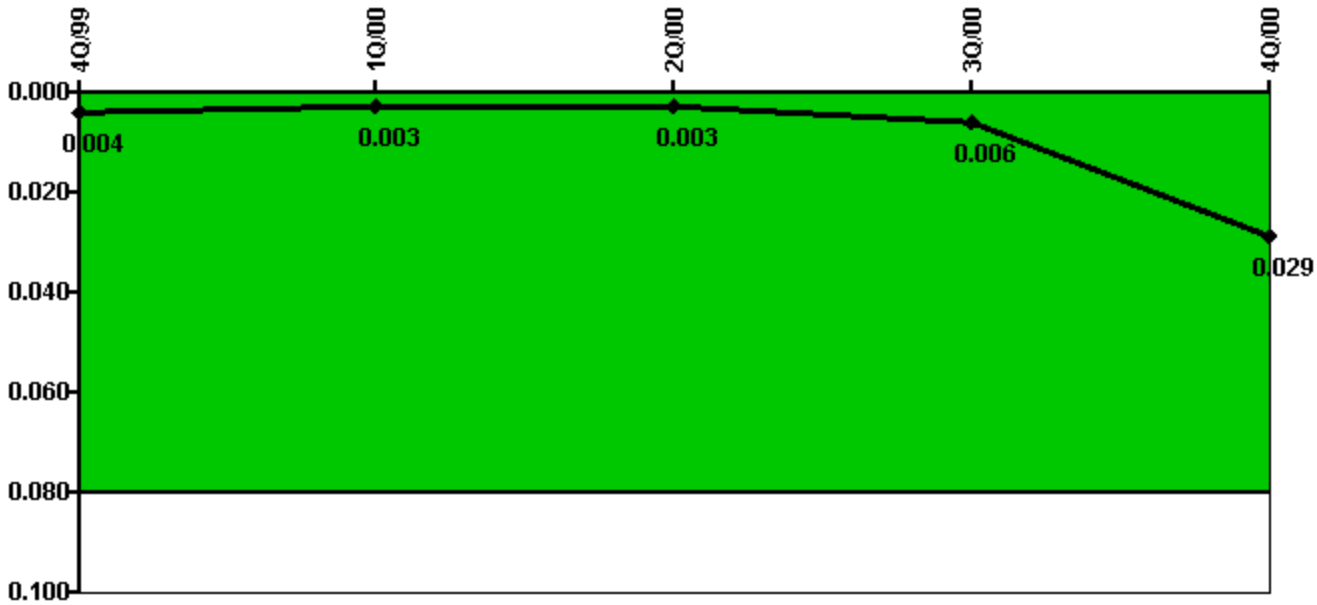


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
IDS compensatory hours	17.70	29.10	15.10	134.00	1037.00
CCTV compensatory hours	0.5	0	29.1	12.9	0
IDS normalization factor	2.55	2.55	2.50	2.50	2.50
CCTV normalization factor	2.1	2.1	2.1	2.1	2.1
Index Value	0.004	0.003	0.003	0.006	0.029

Licensee Comments: none

Personnel Screening Program

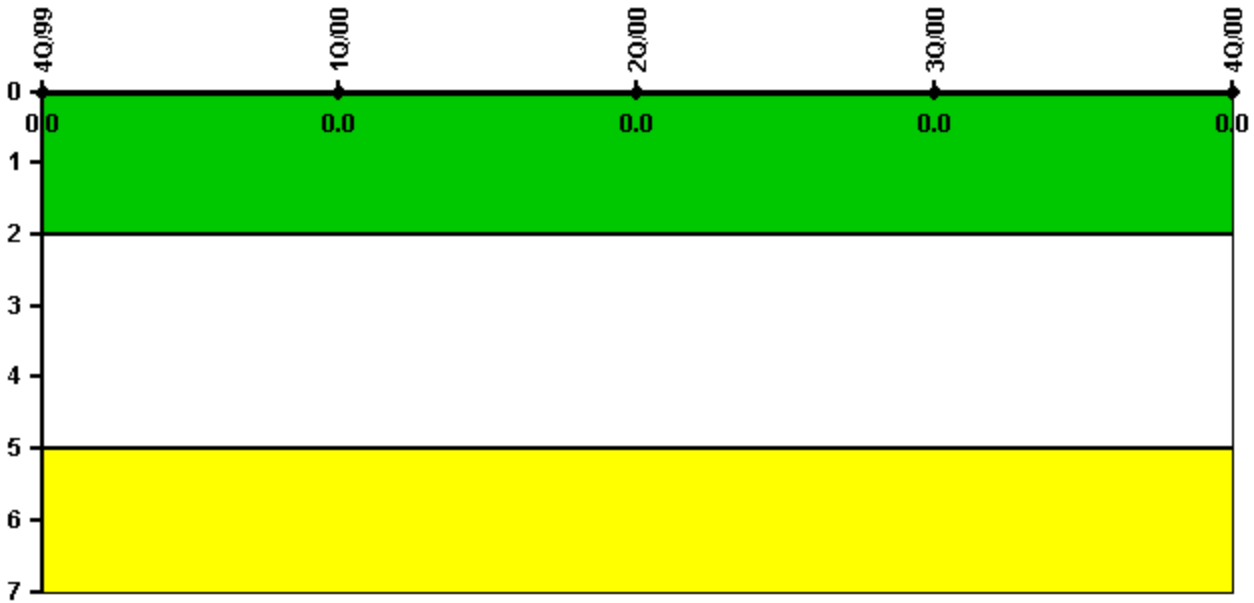


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

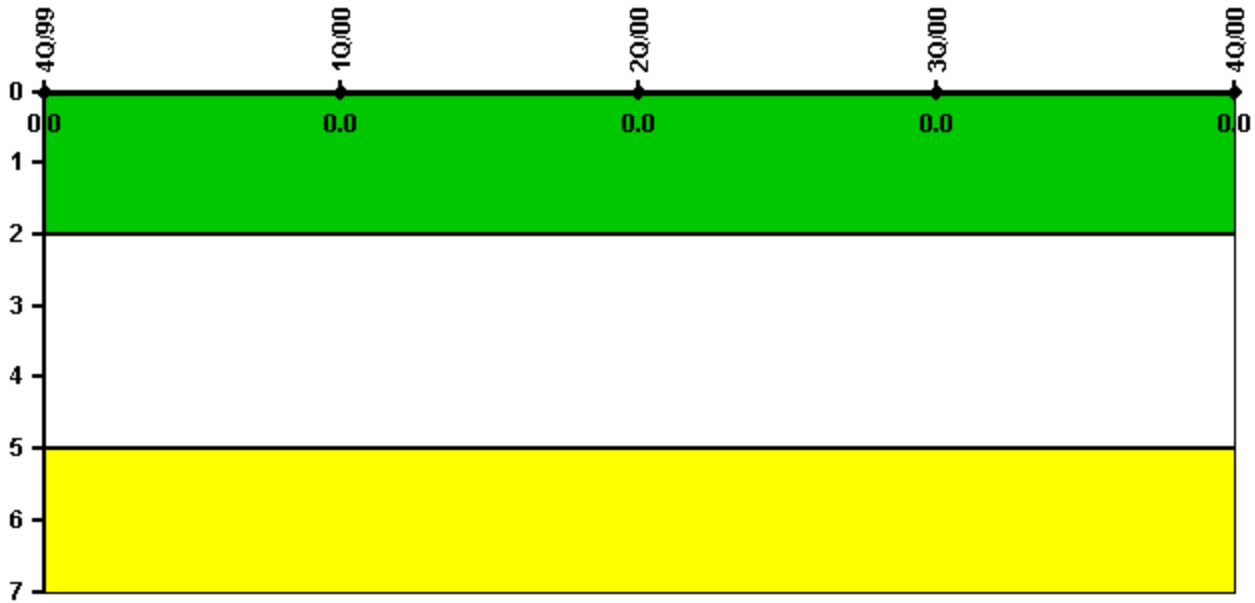

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Action Matrix Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 28, 2002