


River Bend 1

4Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

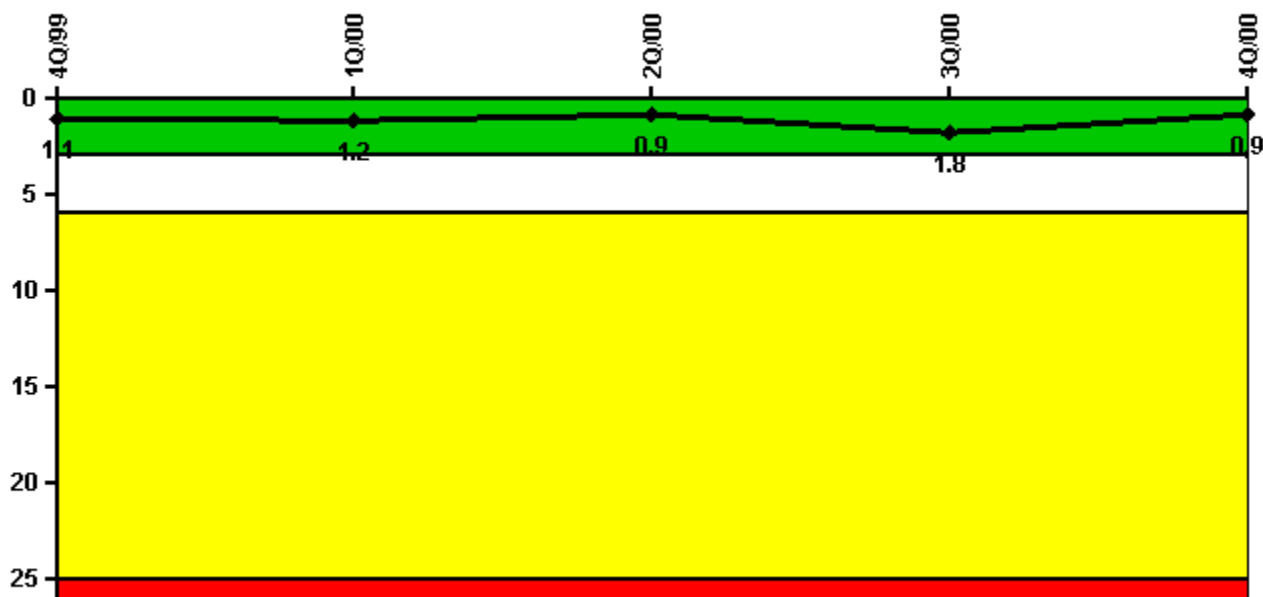

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Unplanned scrams	1.0	0	0	1.0	0
Critical hours	2145.8	1512.4	2044.4	2110.4	2209.0
Indicator value	1.1	1.2	0.9	1.8	0.9

Licensee Comments:

4Q/00: 3Q/00: A data review was conducted which identified an error in the entry of the monthly data. The hours of critical operation were corrected. This change does not change the indicator color.

Scrams with Loss of Normal Heat Removal

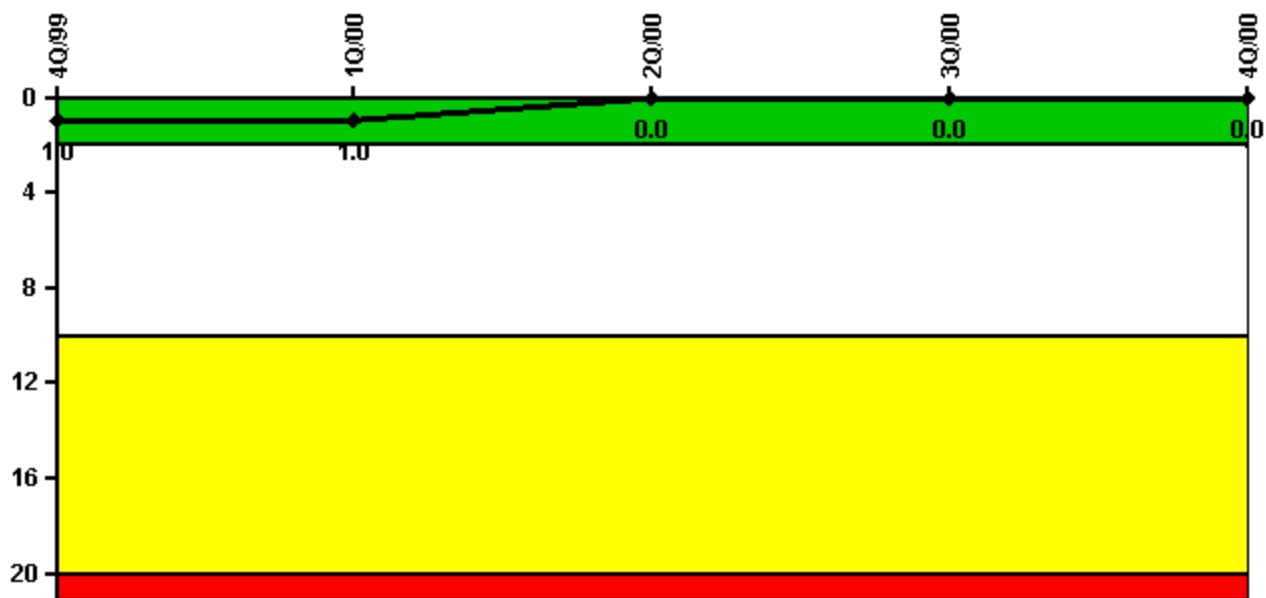


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Scrams	0	0	0	0	0
Indicator value	1.0	1.0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

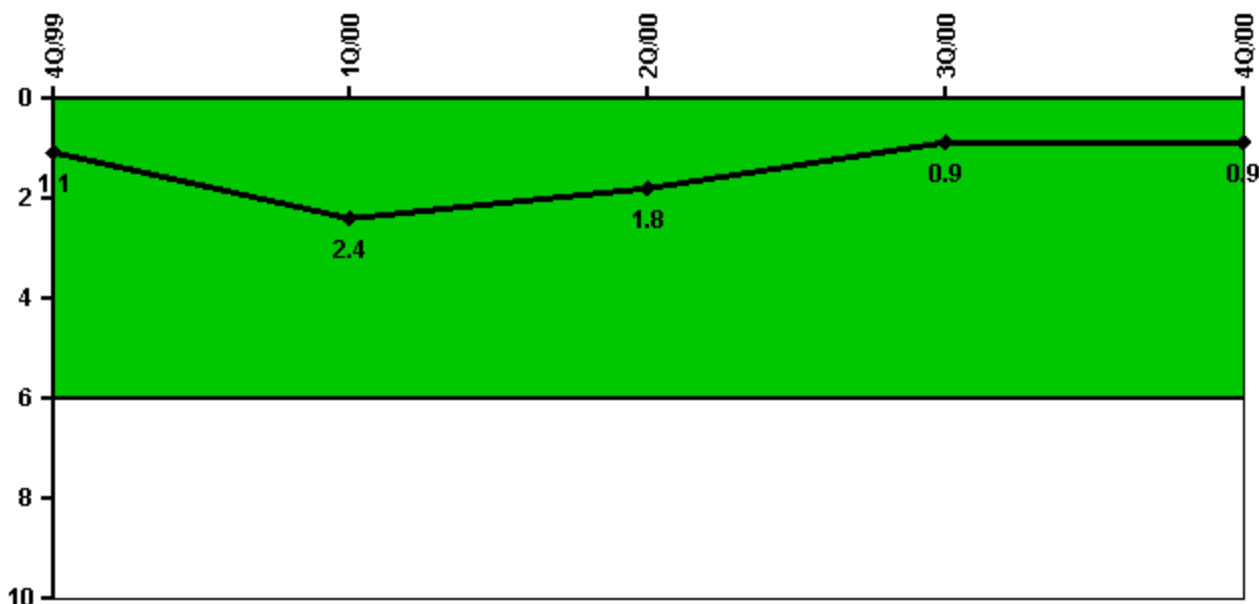

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Unplanned power changes	0	1.0	0	0	0
Critical hours	2145.8	1512.4	2044.4	2110.4	2209.0
Indicator value	1.1	2.4	1.8	0.9	0.9

Licensee Comments:

4Q/00: 3Q/00: A data review was conducted which identified an error in the entry of the monthly data. The hours of critical operation were corrected. This change does not change the indicator color.

Safety System Unavailability, Emergency AC Power, >2EDG

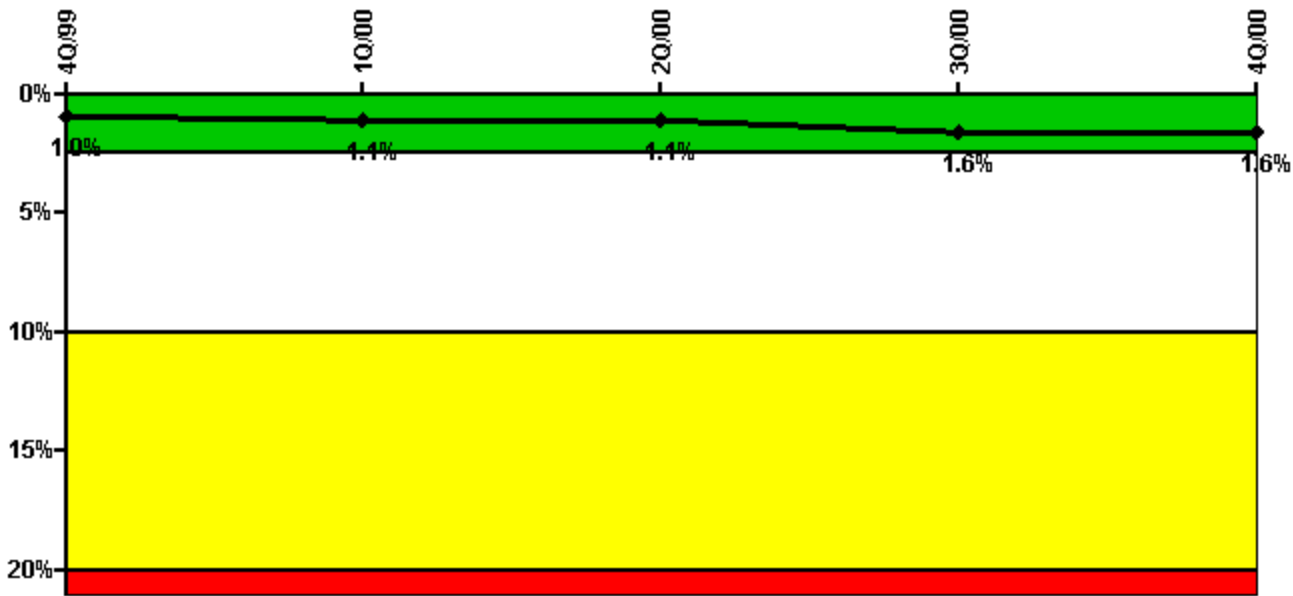

Thresholds: White > 2.5% Yellow > 10.0% Red > 20.0%

Notes

Safety System Unavailability, Emergency AC Power, >2EDG	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	28.70	26.40	43.30	23.10	24.00
Unplanned unavailable hours	5.80	0	1.00	7.60	3.30
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 2					
Planned unavailable hours	37.10	25.20	23.80	4.50	12.30
Unplanned unavailable hours	3.00	0	0	9.70	0
Fault exposure hours	0	0	0	419.50	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 3					
Planned unavailable hours	10.60	15.00	10.40	19.40	1.30
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Indicator value	1.0%	1.1%	1.1%	1.6%	1.6%

Licensee Comments:


4Q/00: 3Q/00: An engineering re-evaluation resulted in a change to the unavailability hours for the Division 1 diesel. 327.5 hours of fault exposure unavailability and 11.1 hours of unplanned unavailability were removed. These changes do not change the indicator color. 1Q/00: A review of unavailability data was conducted which identified an error in the entry of the monthly data. 1.5 hours of planned unavailability was added to the Division 2 diesel. This change does not change the indicator color.

1Q/00: A review of unavailability data for 1999 and 1st quarter 2000 was conducted. This data was revised to meet NEI 99-02 Rev. 0. In

accordance with NEI 99-02, fault exposure hours are included, starting with the 4th quarter of 1999. These changes have not changed the indicator color. The incorrect reporting of data was entered in the River Bend corrective action program. 1997/1998 data may or may not include fault exposure or support systems.

1Q/00: A review of unavailability data for 1999 and 1st quarter 2000 was conducted. This data was revised to meet NEI 99-02 Rev. 0. In accordance with NEI 99-02, fault exposure hours are included, starting with the 4th quarter of 1999. These changes have not changed the indicator color. The incorrect reporting of data was entered in the River Bend corrective action program. 1997/1998 data may or may not include fault exposure or support systems.

Safety System Unavailability, High Pressure Injection System (HPCS)

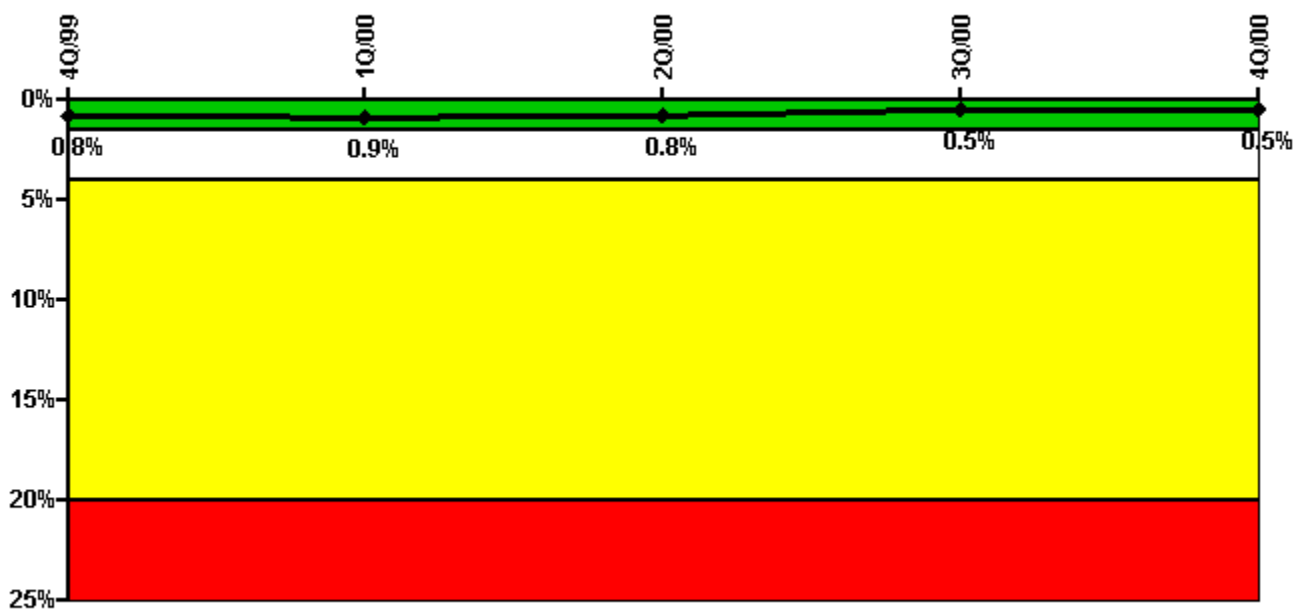

Thresholds: White > 1.5% Yellow > 4.0% Red > 20.0%


Notes

Safety System Unavailability, High Pressure Injection System (HPCS)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	5.90	18.90	0	1.50	9.90
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2145.82	1512.37	2044.37	2110.38	2209.00
Indicator value	0.8%	0.9%	0.8%	0.5%	0.5%

Licensee Comments:

4Q/00: 3Q/00: A review of unavailability data was conducted which identified an error in the entry of the monthly data. The hours the train was required was corrected. This change does not change the indicator color.

Safety System Unavailability, Heat Removal System (RCIC)

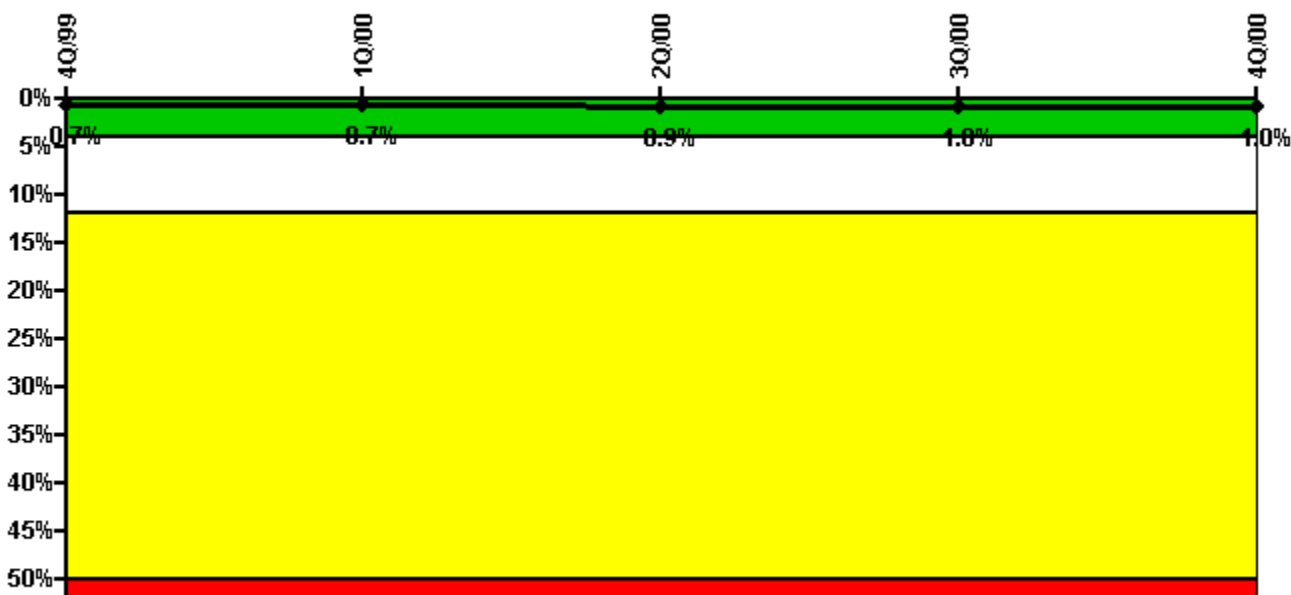

Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%

Notes

Safety System Unavailability, Heat Removal System (RCIC)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	10.30	8.60	23.40	49.00	6.20
Unplanned unavailable hours	0	0.40	5.00	4.40	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2145.82	1512.37	2044.37	2110.38	2209.00
Indicator value	0.7%	0.7%	0.9%	1.0%	1.0%

Licensee Comments:

4Q/00: 3Q/00: A review of unavailability data was conducted which identified an error in the entry of the monthly data. The hours the train was required was corrected. This change does not change the indicator color.

Safety System Unavailability, Residual Heat Removal System



Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	36.50	58.00	40.40	4.10	4.00
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Train 2					
Planned unavailable hours	50.90	38.80	5.80	7.20	2.90
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00
Indicator value	0.8%	1.0%	0.9%	0.9%	0.9%

Licensee Comments:


4Q/00: 1Q/00: A review of unavailability data was conducted which identified an error in the entry of the monthly data. 36 hours of planned unavailability were removed from the train 2 RHR. This change does not change the indicator color. 2Q/00: A review of unavailability data was conducted which identified an error in the entry of the monthly data. 30.4 hours of planned unavailability were removed from the train 2 RHR. This change does not change the indicator color. 3Q/00: A review of unavailability data was conducted which identified an error in the entry of the monthly data. The hours required for service for both trains were corrected. This change does not change the indicator color.

2Q/00: A review of unavailability data for 1999 and 1st quarter 2000 was conducted. This data was revised to meet NEI 99-02 Rev. 0. In accordance with NEI 99-02, fault exposure hours are included, starting with the 4th quarter of 1999. These changes have not changed the indicator color. The incorrect reporting of data was entered in the River Bend corrective action program. 1997/1998 data may or may not include fault exposure or support systems.

1Q/00: A review of unavailability data for 1999 and 1st quarter 2000 was conducted. This data was revised to meet NEI 99-02 Rev. 0. In accordance with NEI 99-02, fault exposure hours are included, starting with the 4th quarter of 1999. These changes have not changed the

indicator color. The incorrect reporting of data was entered in the River Bend corrective action program. 1997/1998 data may or may not include fault exposure or support systems.

Safety System Functional Failures (BWR)

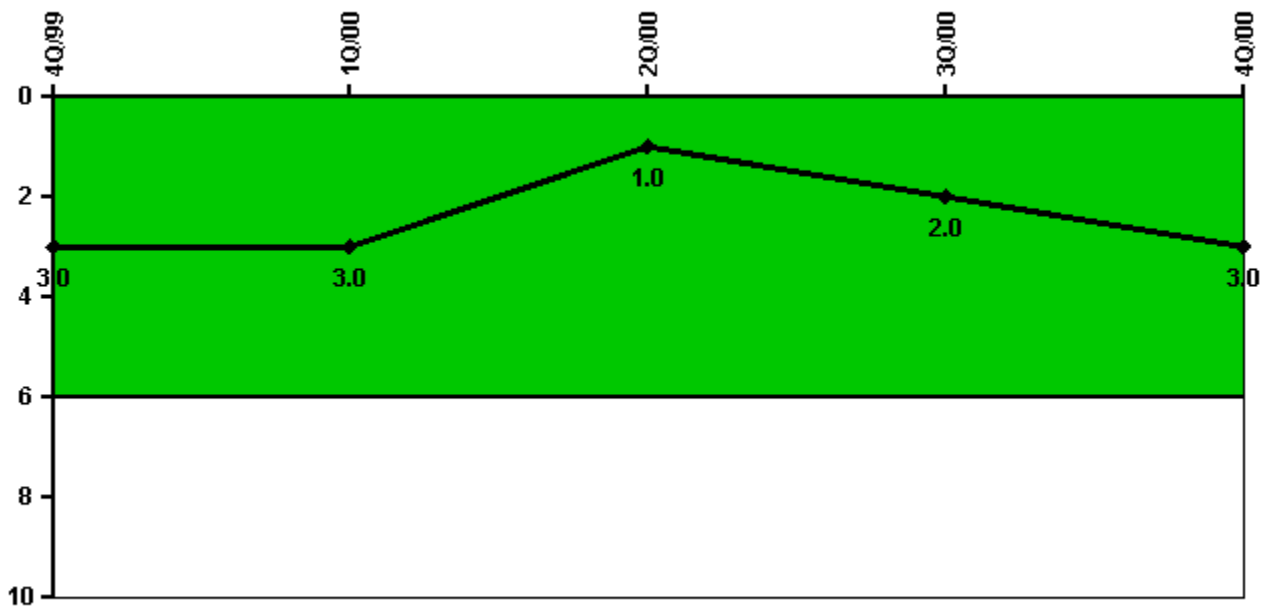


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Safety System Functional Failures	0	1	0	1	1
Indicator value	3	3	1	2	3

Licensee Comments: none

Reactor Coolant System Activity

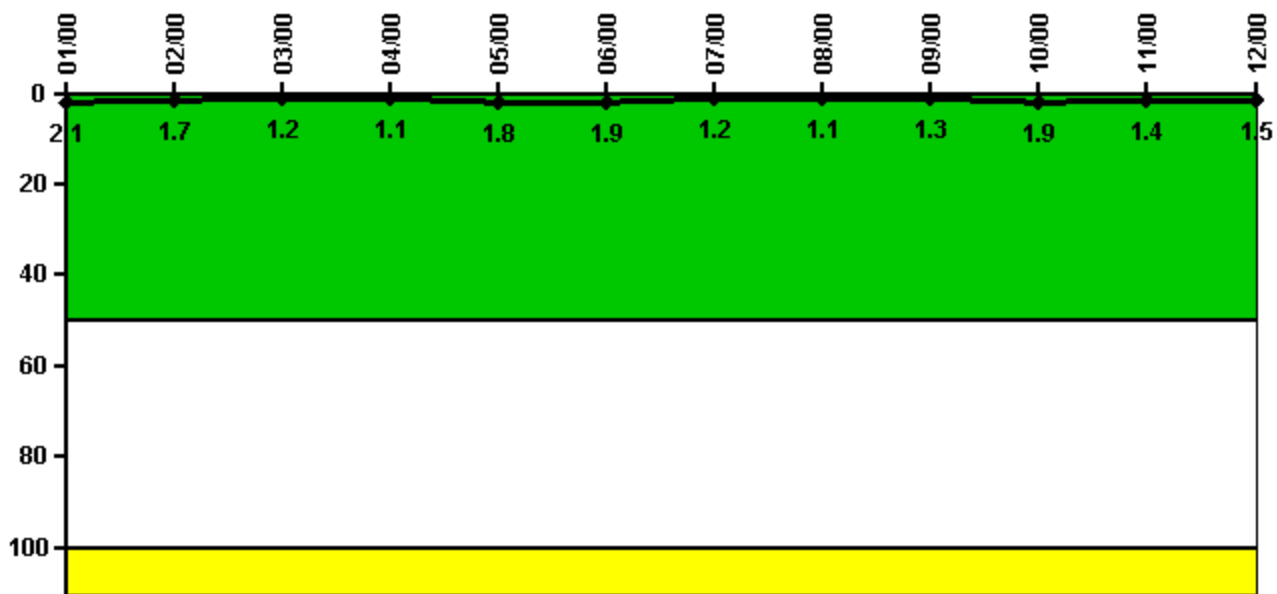


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00
Maximum activity	0.004190	0.003480	0.002350	0.002250	0.003500	0.003700	0.002470	0.002270	0.002600	0.003780	0.002780	0.002950
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	2.1	1.7	1.2	1.1	1.8	1.9	1.2	1.1	1.3	1.9	1.4	1.5

Licensee Comments: none

Reactor Coolant System Leakage

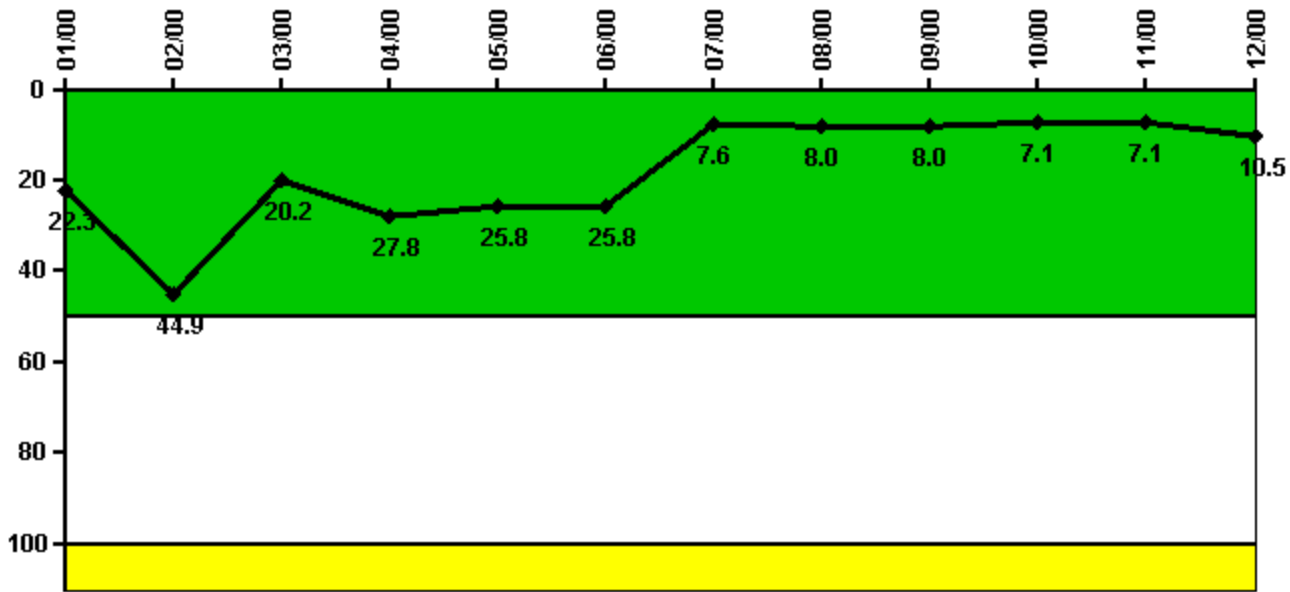


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00
Maximum leakage	6.690	13.470	6.070	8.340	7.750	7.750	2.290	2.410	2.400	2.130	2.130	3.150
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	22.3	44.9	20.2	27.8	25.8	25.8	7.6	8.0	8.0	7.1	7.1	10.5

Licensee Comments: none

Drill/Exercise Performance

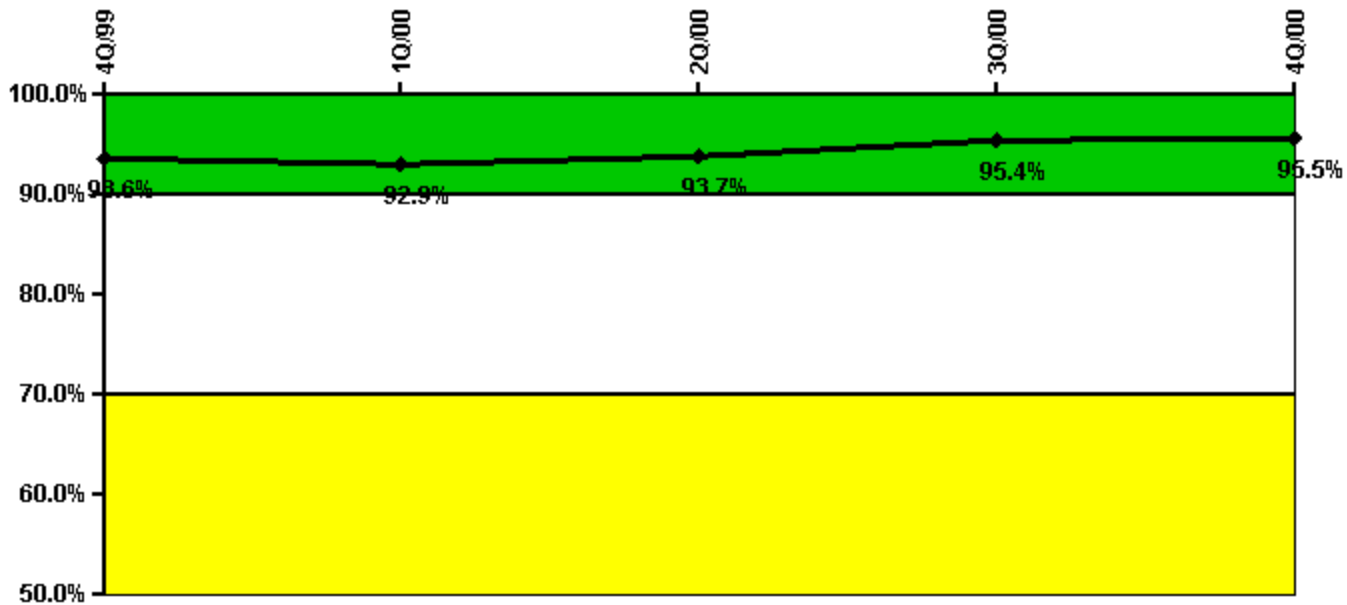

Thresholds: White < 90.0% Yellow < 70.0%

Notes


Drill/Exercise Performance	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Successful opportunities	29.0	6.0	22.0	17.0	15.0
Total opportunities	31.0	6.0	22.0	17.0	17.0
Indicator value	93.6%	92.9%	93.7%	95.4%	95.5%

Licensee Comments:

1Q/00: The number of drill, exercise, and actual event opportunities have been revised for the 1st and 3rd quarters in 1998. These changes do not change the color of the indicator.

4Q/99: Data based on best effort review of available information.

ERO Drill Participation

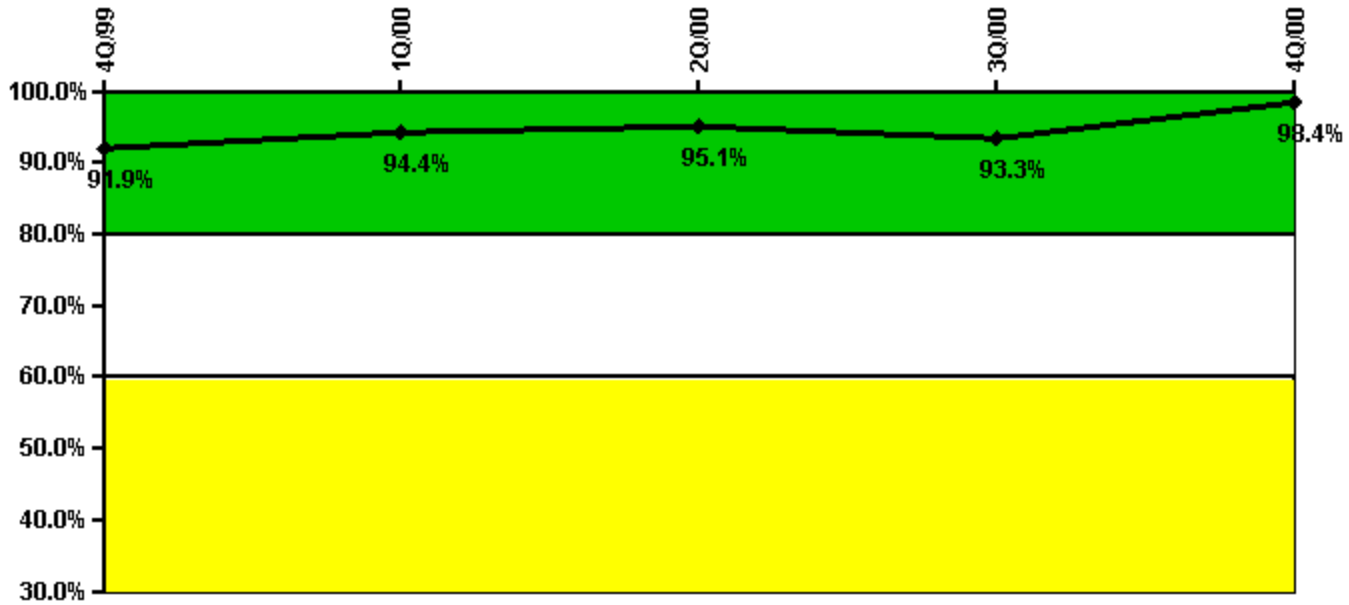


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Participating Key personnel	114.0	119.0	117.0	112.0	122.0
Total Key personnel	124.0	126.0	123.0	120.0	124.0
Indicator value	91.9%	94.4%	95.1%	93.3%	98.4%

Licensee Comments: none

Alert & Notification System

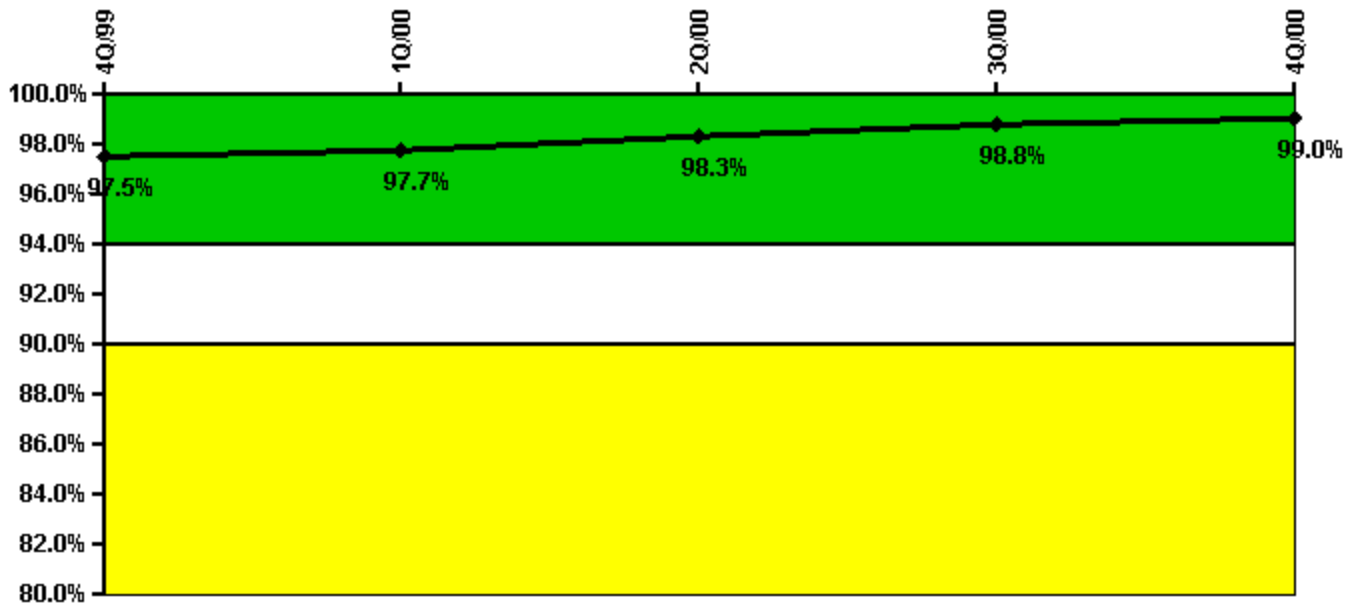


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Successful siren-tests	999	925	923	1195	918
Total sirens-tests	1023	930	930	1209	930
Indicator value	97.5%	97.7%	98.3%	98.8%	99.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

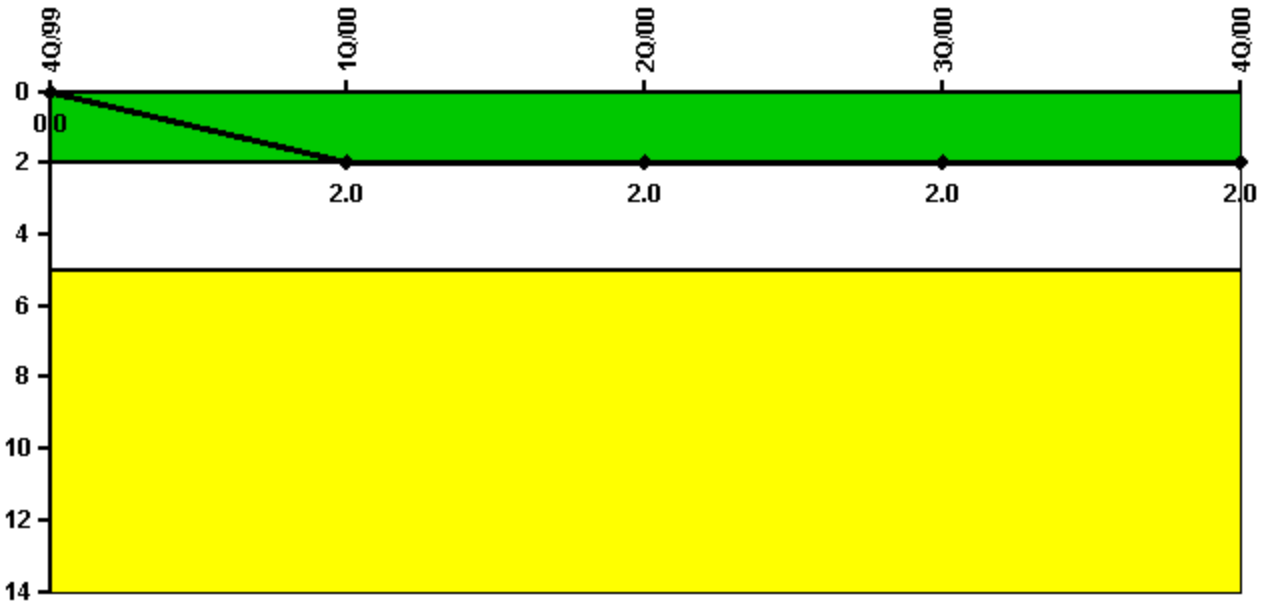

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
High radiation area occurrences	0	2	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	0	2	2	2	2

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

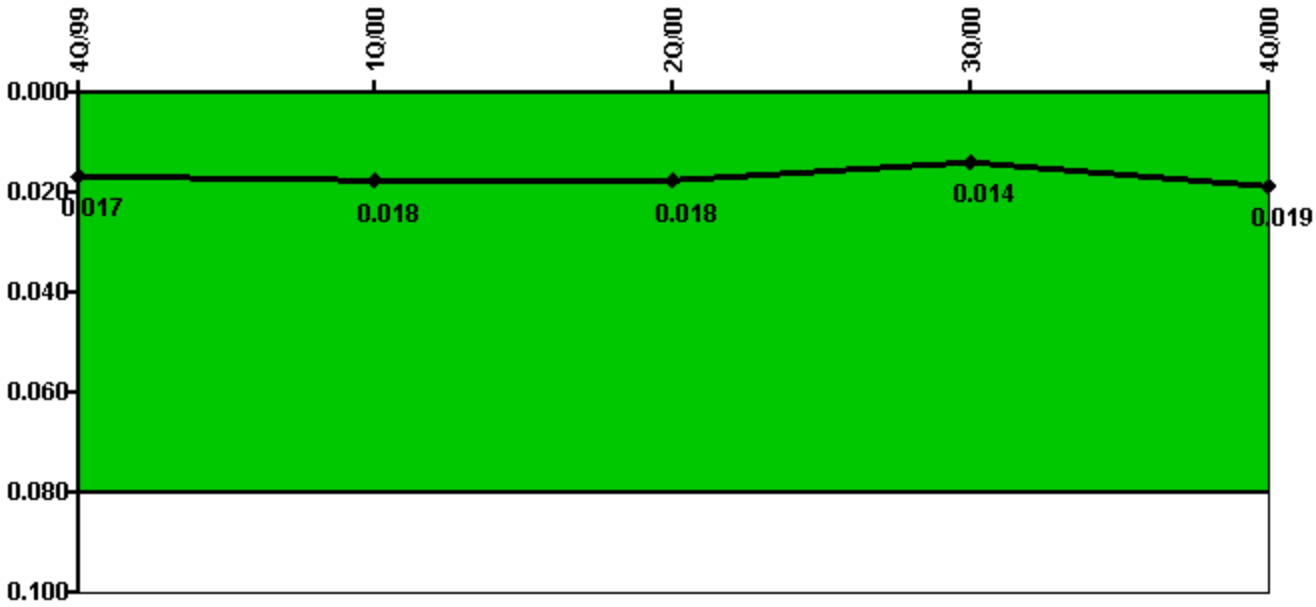


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
IDS compensatory hours	7.82	74.33	49.82	74.08	19.50
CCTV compensatory hours	24.1	27.5	26.6	13.1	90.6
IDS normalization factor	1.30	1.30	1.30	1.30	1.30
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
Index Value	0.017	0.018	0.018	0.014	0.019

Licensee Comments: none

Personnel Screening Program

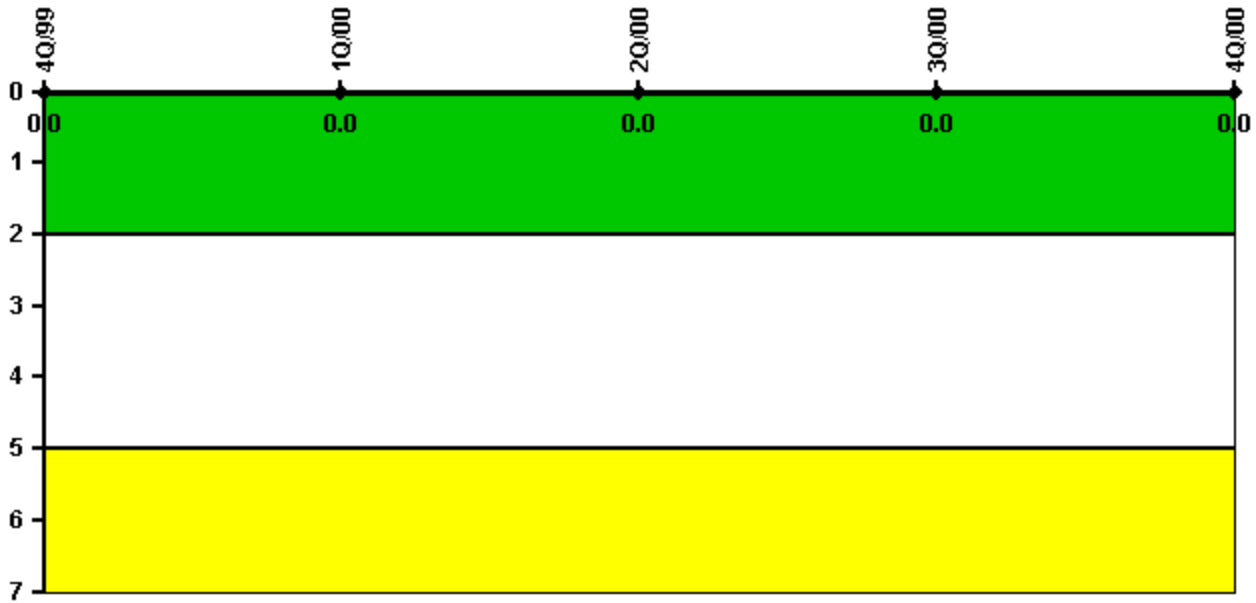


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

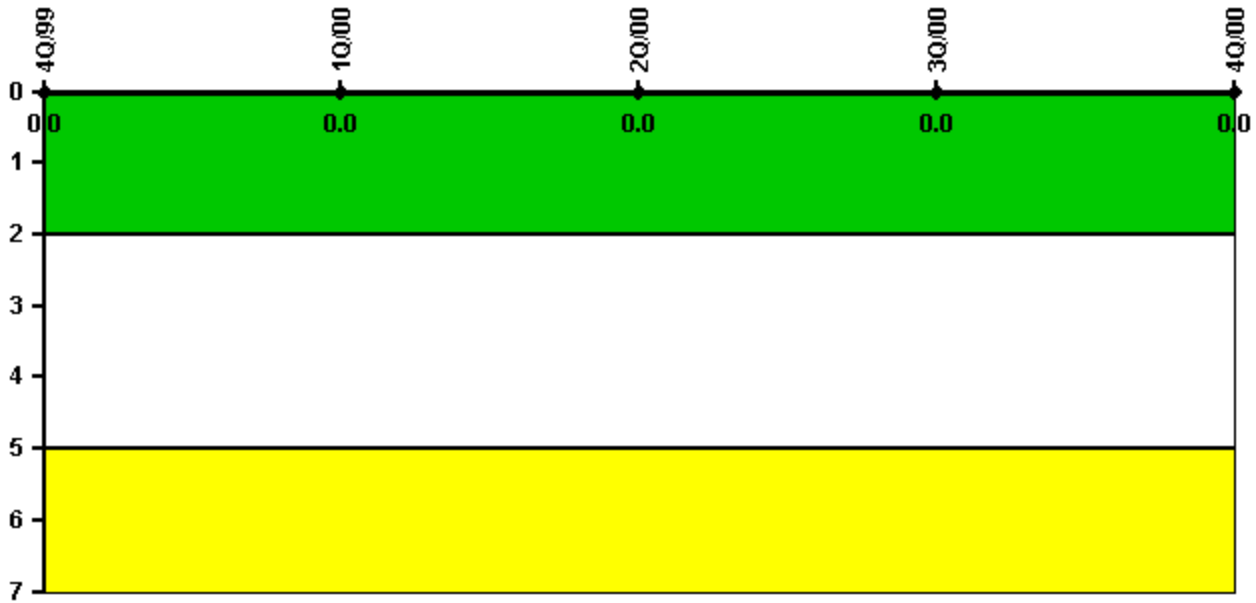

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Action Matrix Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 28, 2002