


Saint Lucie 1

3Q/2001 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

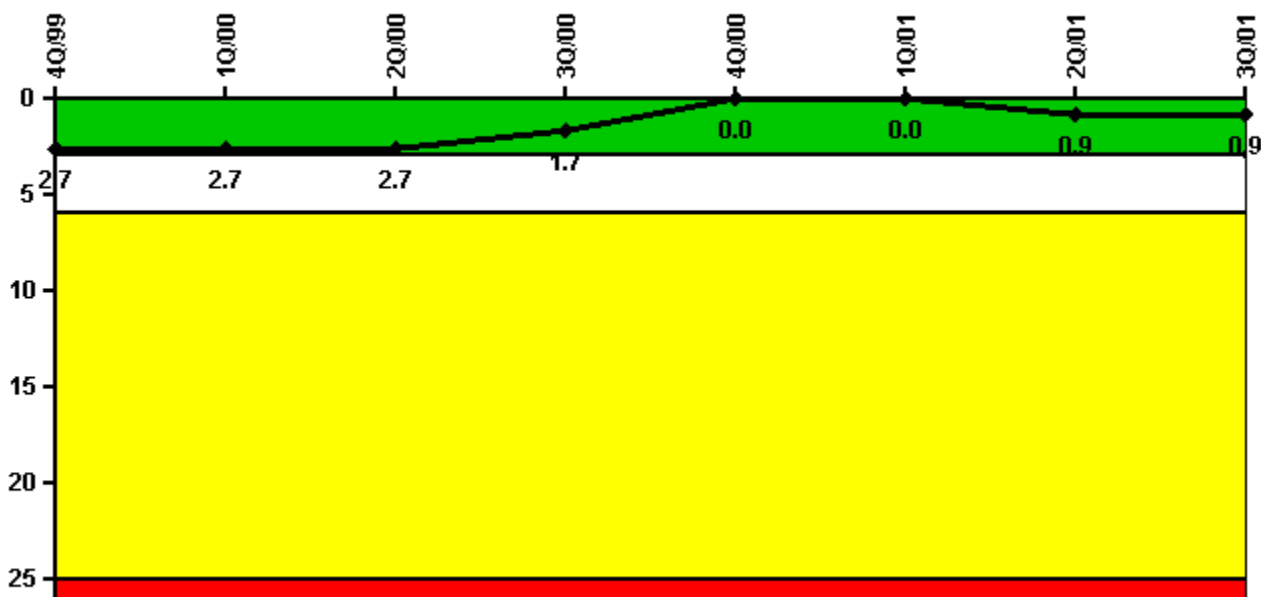


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Unplanned scrams	2.0	0	0	0	0	0	1.0	0
Critical hours	1800.0	2184.0	2183.0	2208.0	2209.0	2160.0	1505.2	2208.0
Indicator value	2.7	2.7	2.7	1.7	0	0	0.9	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

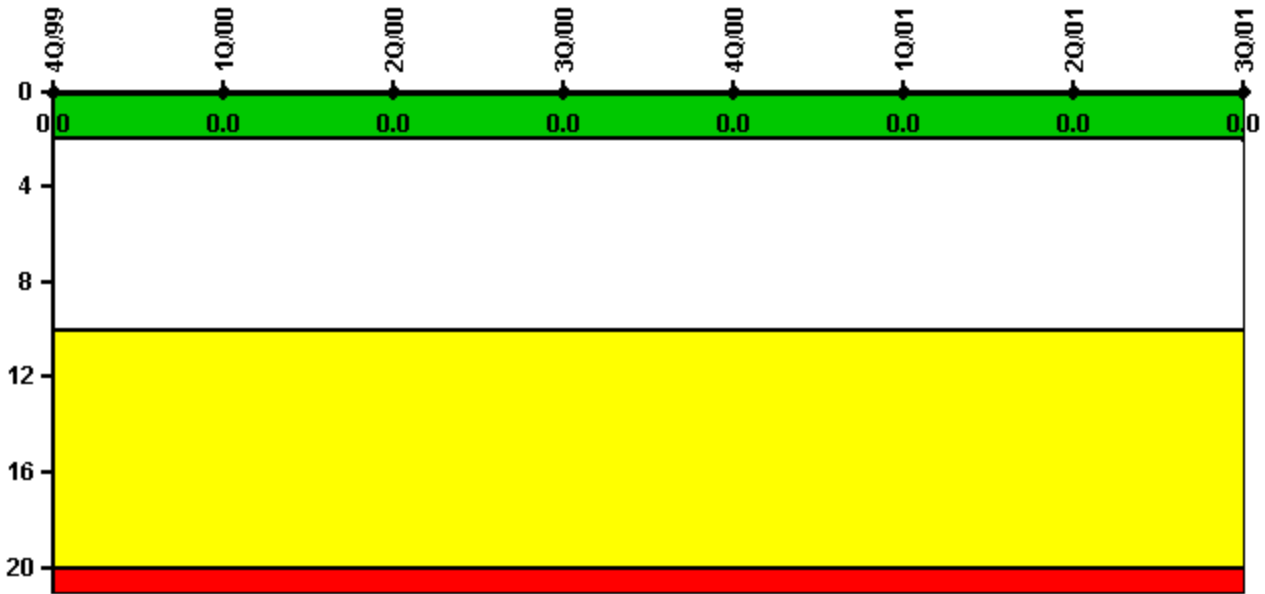


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

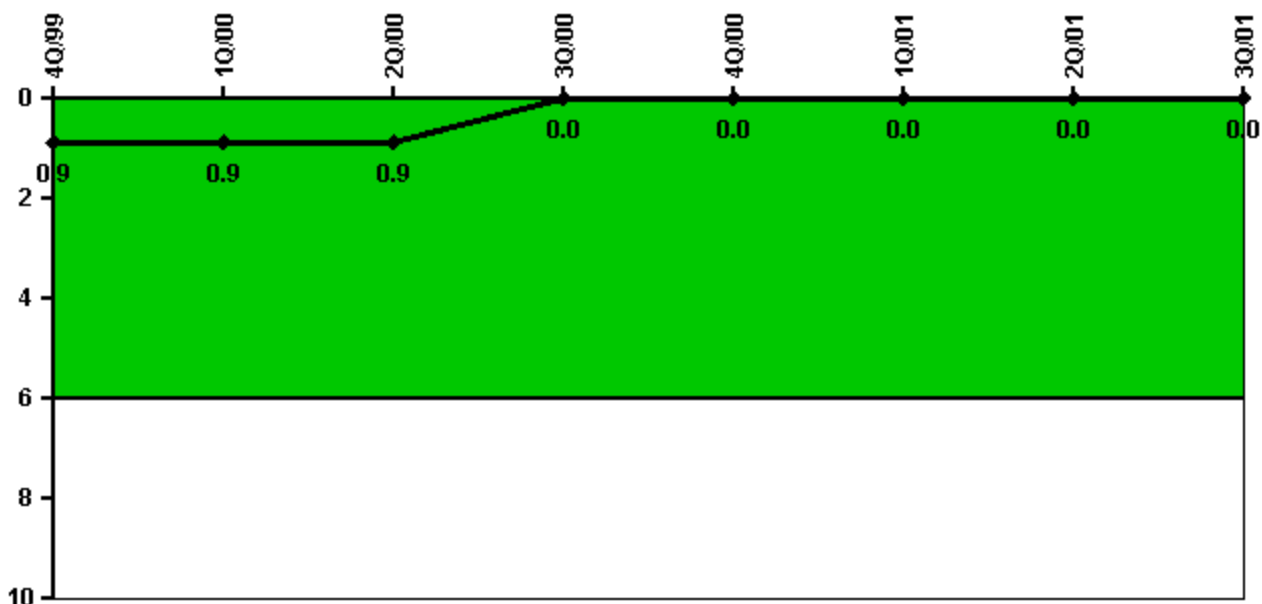


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1800.0	2184.0	2183.0	2208.0	2209.0	2160.0	1505.2	2208.0
Indicator value	0.9	0.9	0.9	0	0	0	0	0

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

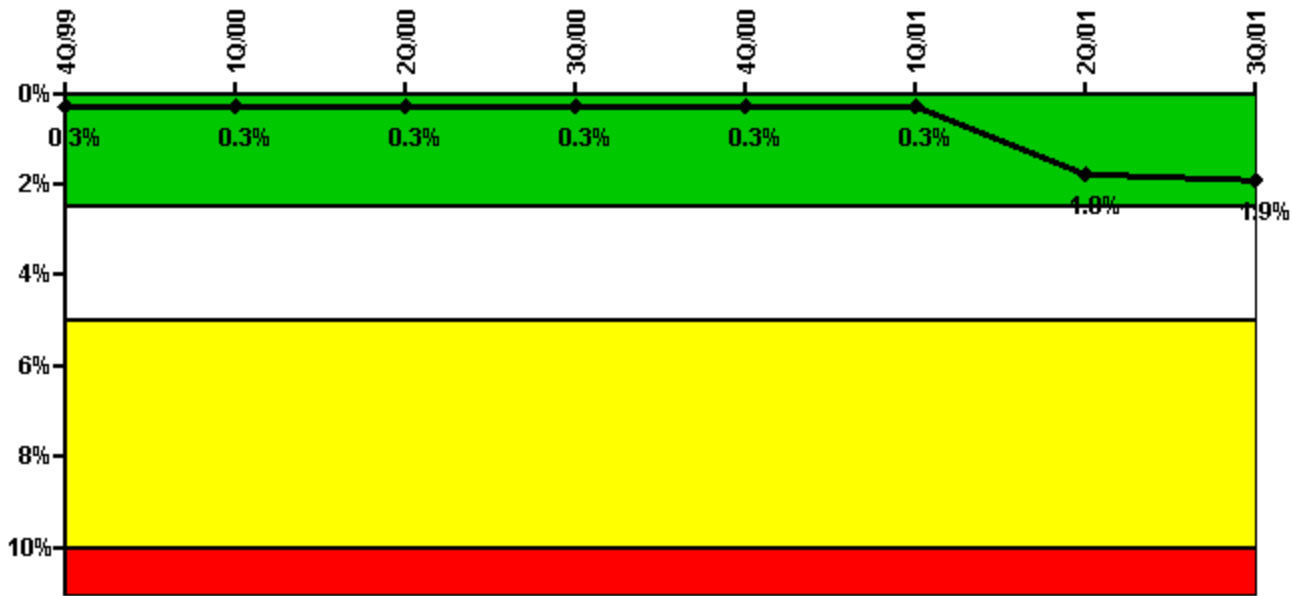


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Train 1								
Planned unavailable hours	0	3.00	4.20	6.90	2.90	8.10	3.00	51.70
Unplanned unavailable hours	18.30	0	9.70	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2066.80	2184.00	2183.00	2208.00	2209.00	2160.00	1945.60	2208.00
Train 2								
Planned unavailable hours	0	5.20	4.00	3.90	4.10	3.90	0	4.60
Unplanned unavailable hours	0	0	0	0	0	0	190.00	0
Fault exposure hours	0	0	0	0	0	0	555.00	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2066.80	2184.00	2183.00	2208.00	2209.00	2160.00	1945.60	2208.00
Indicator value	0.3%	0.3%	0.3%	0.3%	0.3%	0.3%	1.8%	1.9%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

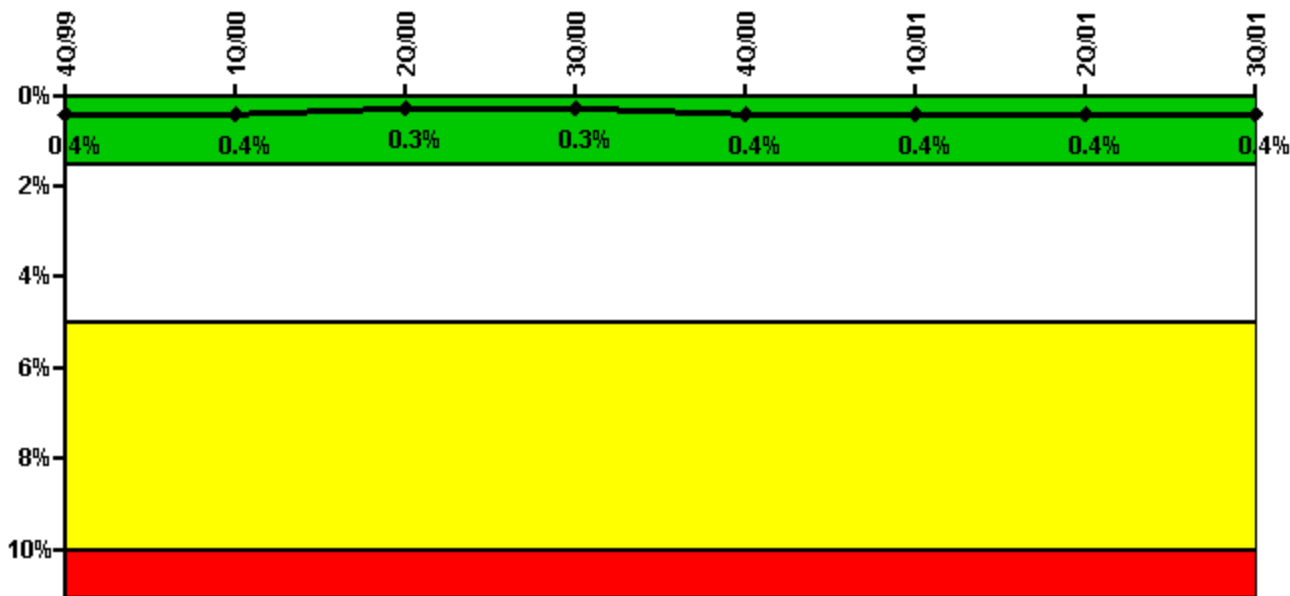


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Train 1								
Planned unavailable hours	0.90	1.90	3.20	1.60	24.30	1.00	0.50	0.40
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1773.00	2184.00	2183.00	2208.00	2209.00	2160.00	1706.20	2208.00
Train 2								
Planned unavailable hours	0.80	3.20	0.70	0.40	35.80	6.60	0.80	12.60
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1773.00	2184.00	2183.00	2208.00	2209.00	2160.00	1706.20	2208.00
Indicator value	0.4%	0.4%	0.3%	0.3%	0.4%	0.4%	0.4%	0.4%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

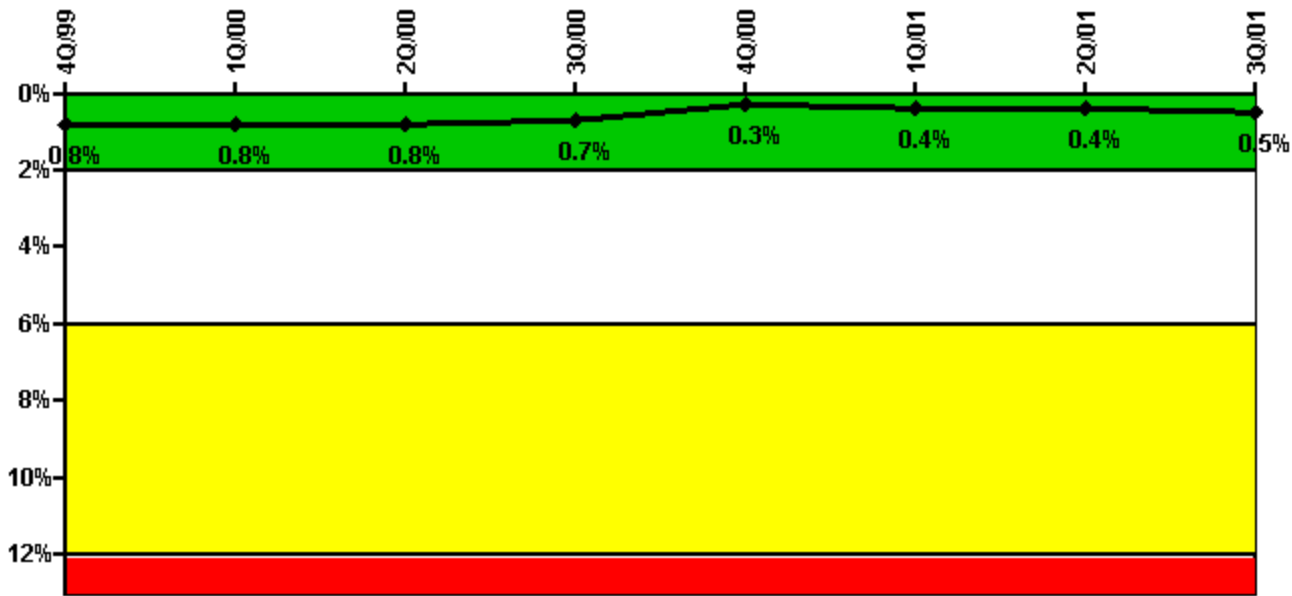


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Train 1								
Planned unavailable hours	0	35.10	0	0	2.90	2.30	1.40	4.50
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1800.00	2184.00	2183.00	2208.00	2209.00	2160.00	1606.00	2208.00
Train 2								
Planned unavailable hours	0	4.80	0	0	1.80	3.00	0.60	3.20
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1800.00	2184.00	2183.00	2208.00	2209.00	2160.00	1606.00	2208.00
Train 3								
Planned unavailable hours	7.00	17.30	0	1.37	16.20	32.60	0.80	8.60
Unplanned unavailable hours	0	0	0	0	0	0	1.70	0
Fault exposure hours	0	0	0	0	0	40.30	25.70	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1800.00	2184.00	2183.00	2208.00	2209.00	2160.00	1606.00	2208.00
Indicator value	0.8%	0.8%	0.8%	0.7%	0.3%	0.4%	0.4%	0.5%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

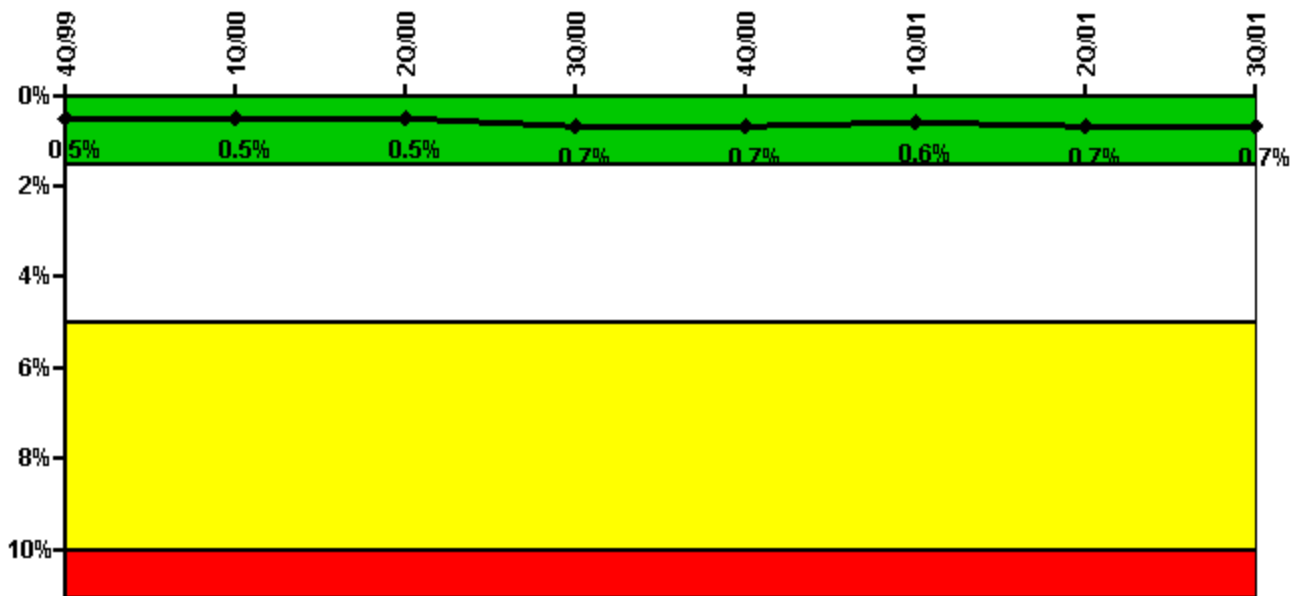

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Train 1								
Planned unavailable hours	2.00	2.00	45.10	61.90	28.50	22.00	45.00	3.60
Unplanned unavailable hours	0	0	0	0	0	0	0	20.60
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1885.10	2184.00	2183.00	2208.00	2209.00	2160.00	1578.00	2208.00
Train 2								
Planned unavailable hours	1.90	3.20	37.60	53.90	21.40	29.50	10.90	0.40
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1885.10	2184.00	2183.00	2208.00	2209.00	2160.00	1578.00	2208.00
Train 3								
Planned unavailable hours	0	0	0	0	0	0	4.70	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	304.60	0	0	0	0	0	578.30	0
Train 4								
Planned unavailable hours	0	0	0	0	0	0	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	304.60	0	0	0	0	0	578.30	0
Indicator value	0.5%	0.5%	0.5%	0.7%	0.7%	0.6%	0.7%	0.7%

Licensee Comments:


4Q/99: Recalculated and revised using historical data in accordance with NEI 99-02, Rev. 1 App. D Plant Specific Design Issues for CE NSSS RHR SSU performance option 2.

3Q/99: Recalculated and revised using historical data in accordance with NEI 99-02, Rev. 1 App. D Plant Specific Design Issues for CE NSSS RHR SSU performance option 2.

2Q/99: Recalculated and revised using historical data in accordance with NEI 99-02, Rev. 1 App. D Plant Specific Design Issues for CE NSSS RHR SSU performance option 2.

1Q/99: Recalculated and revised using historical data in accordance with NEI 99-02, Rev. 1 App. D Plant Specific Design Issues for CE NSSS RHR SSU performance option 2.

Safety System Functional Failures (PWR)

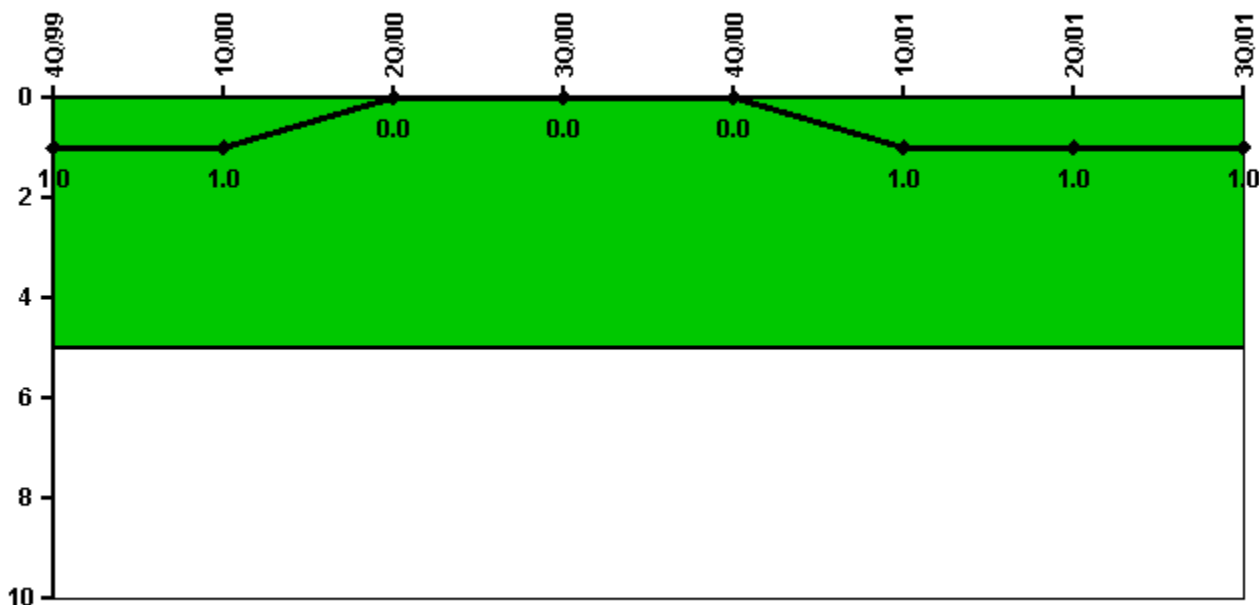

Thresholds: White > 5.0

Notes


Safety System Functional Failures (PWR)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Safety System Functional Failures	0	0	0	0	0	1	0	0
Indicator value	1	1	0	0	0	1	1	1

Licensee Comments:

3Q/01: Correction - Two separate occurrences of a single train (of a multiple train system) failure were incorrectly reported as SSFFs. There were no SSFFs in Q3 2001

2Q/01: Correction - A single train (of a multiple train system) failure was incorrectly reported as a SSFF. There were no SSFFs Q2 2001.

Reactor Coolant System Activity

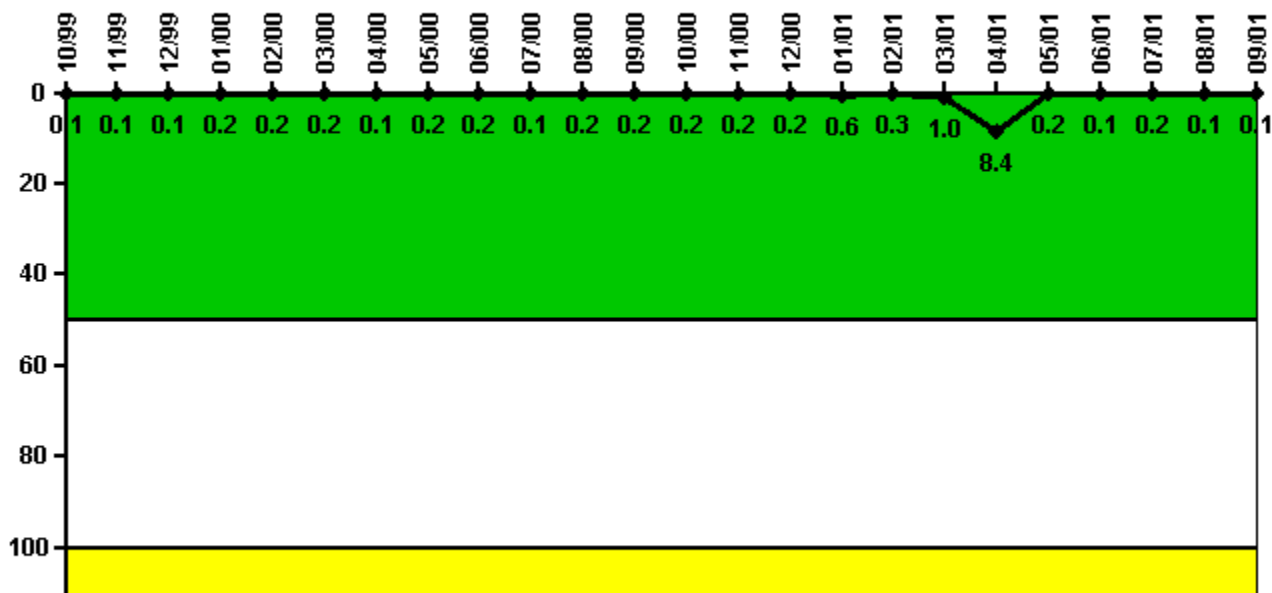

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum activity	0.001400	0.001000	0.001000	0.001880	0.002270	0.001670	0.001400	0.001500	0.001530	0.001450	0.002110	0.001560
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.2	0.2	0.1	0.2	0.2

Reactor Coolant System Activity	10/00	11/00	12/00	1/01	2/01	3/01	4/01	5/01	6/01	7/01	8/01	9/01
Maximum activity	0.001790	0.001800	0.001760	0.005530	0.003090	0.010100	0.083700	0.001870	0.001260	0.002060	0.001240	0.001260
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.6	0.3	1.0	8.4	0.2	0.1	0.2	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

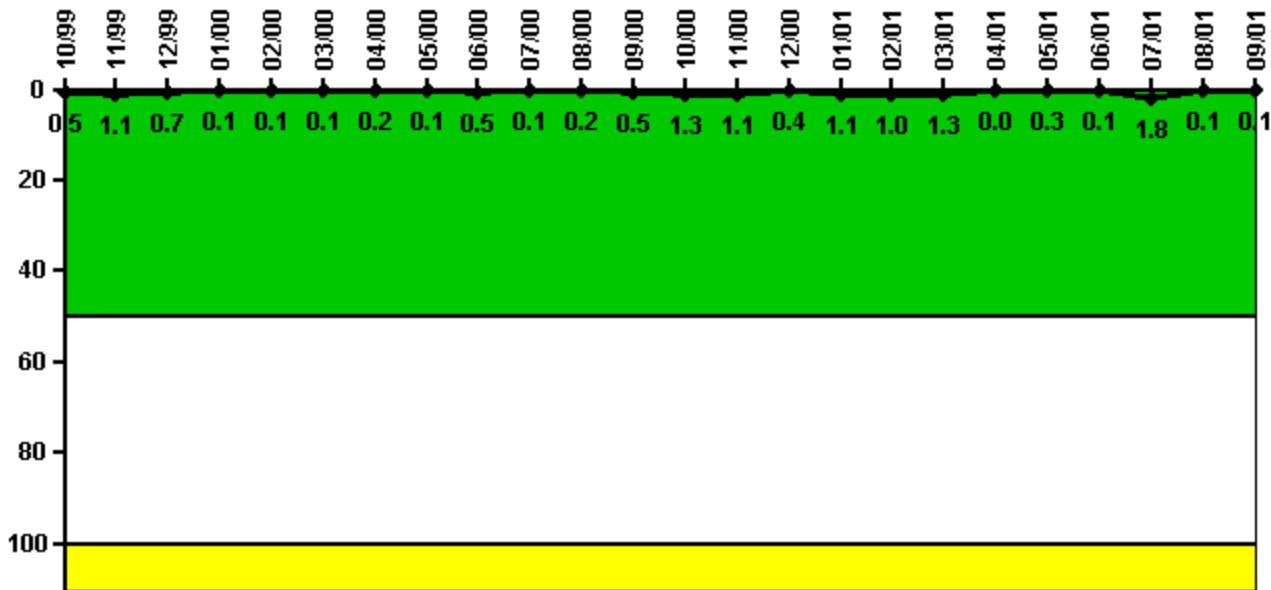

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum leakage	0.050	0.110	0.070	0.010	0.010	0.010	0.020	0.010	0.050	0.010	0.020	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	1.1	0.7	0.1	0.1	0.1	0.2	0.1	0.5	0.1	0.2	0.5

Reactor Coolant System Leakage	10/00	11/00	12/00	1/01	2/01	3/01	4/01	5/01	6/01	7/01	8/01	9/01
Maximum leakage	0.130	0.110	0.040	0.110	0.100	0.130	0	0.030	0.010	0.180	0.010	0.010
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.3	1.1	0.4	1.1	1.0	1.3	0	0.3	0.1	1.8	0.1	0.1

Licensee Comments: none

Drill/Exercise Performance

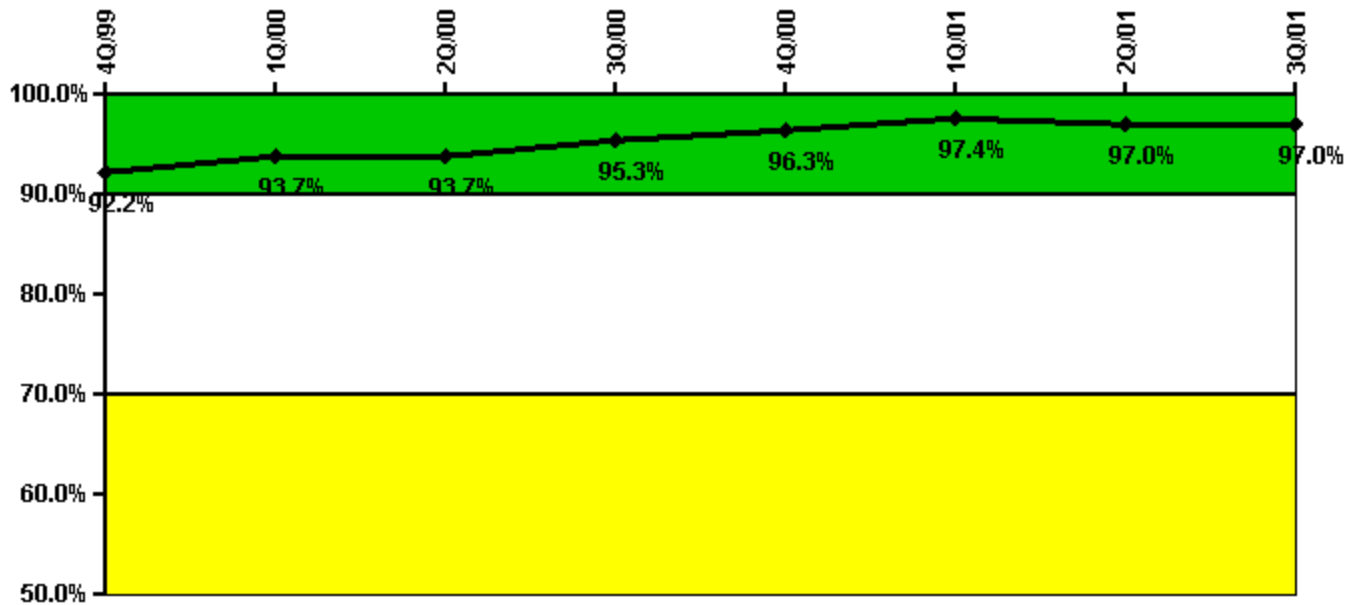

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Successful opportunities	98.0	26.0	8.0	65.0	127.0	8.0	37.0	82.0
Total opportunities	100.0	27.0	9.0	65.0	130.0	8.0	41.0	85.0
Indicator value	92.2%	93.7%	93.7%	95.3%	96.3%	97.4%	97.0%	97.0%

Licensee Comments:

3Q/01: Minor correction made to 2Q01 data due to incorrect counting of drill opportunities.

ERO Drill Participation

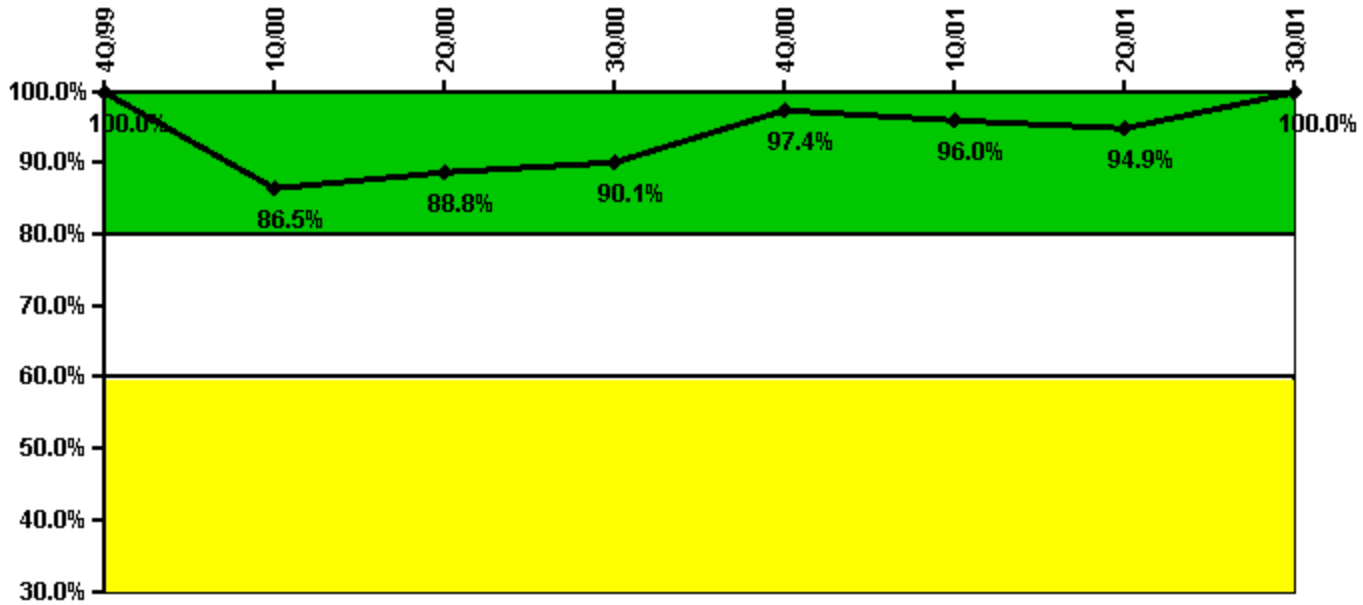


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Participating Key personnel	85.0	77.0	71.0	73.0	75.0	72.0	75.0	79.0
Total Key personnel	85.0	89.0	80.0	81.0	77.0	75.0	79.0	79.0
Indicator value	100.0%	86.5%	88.8%	90.1%	97.4%	96.0%	94.9%	100.0%

Licensee Comments: none

Alert & Notification System

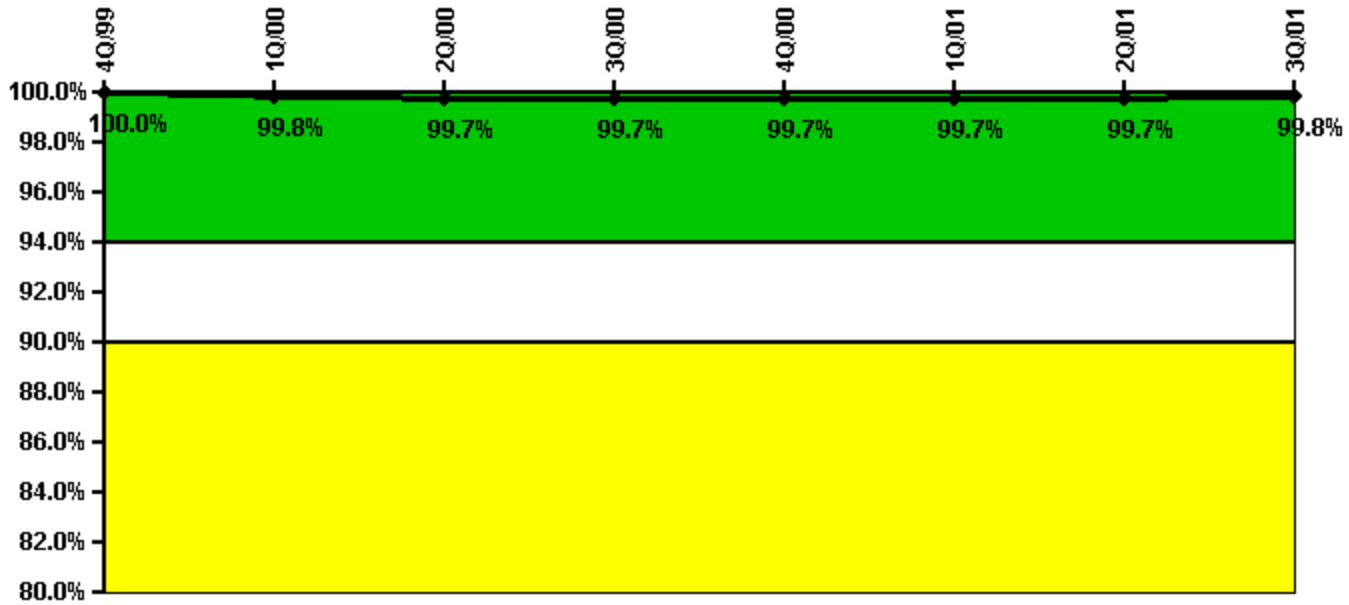


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Successful siren-tests	696	606	519	694	522	607	521	703
Total sirens-tests	696	609	522	696	522	609	523	704
Indicator value	100.0%	99.8%	99.7%	99.7%	99.7%	99.7%	99.7%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

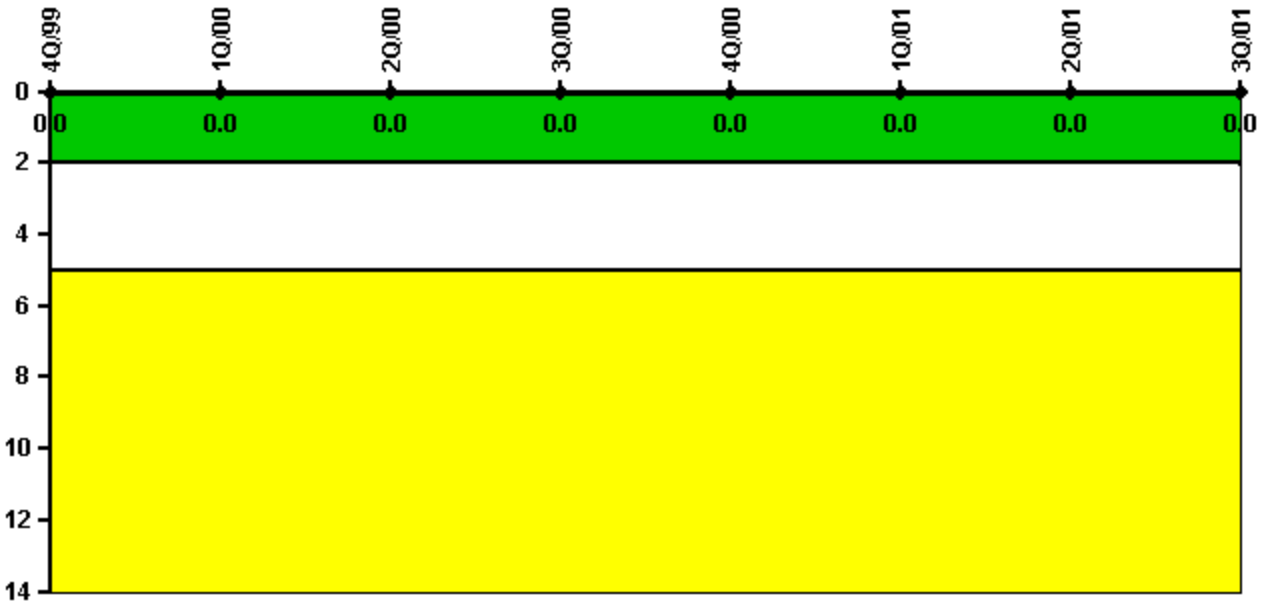


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

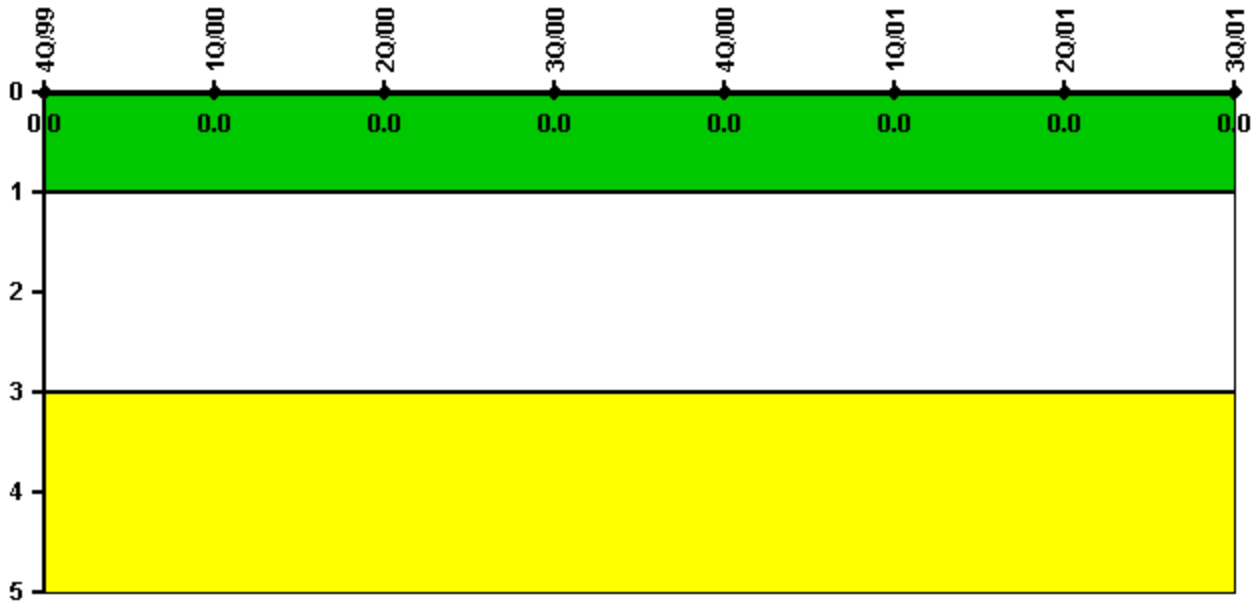


Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

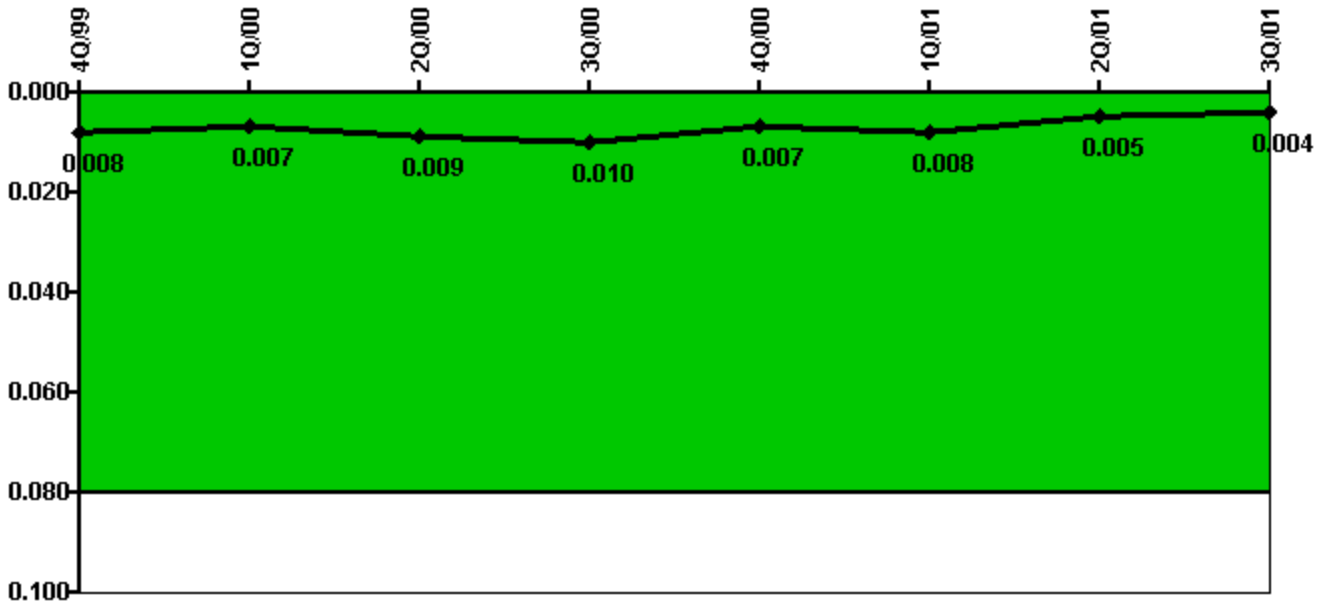


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
IDS compensatory hours	112.10	0	99.00	106.00	25.60	12.75	0	81.20
CCTV compensatory hours	0	0	1.5	0	0	0	0	0
IDS normalization factor	1.80	1.80	1.80	1.80	1.80	1.80	1.80	1.80
CCTV normalization factor	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
Index Value	0.008	0.007	0.009	0.010	0.007	0.008	0.005	0.004

Licensee Comments: none

Personnel Screening Program

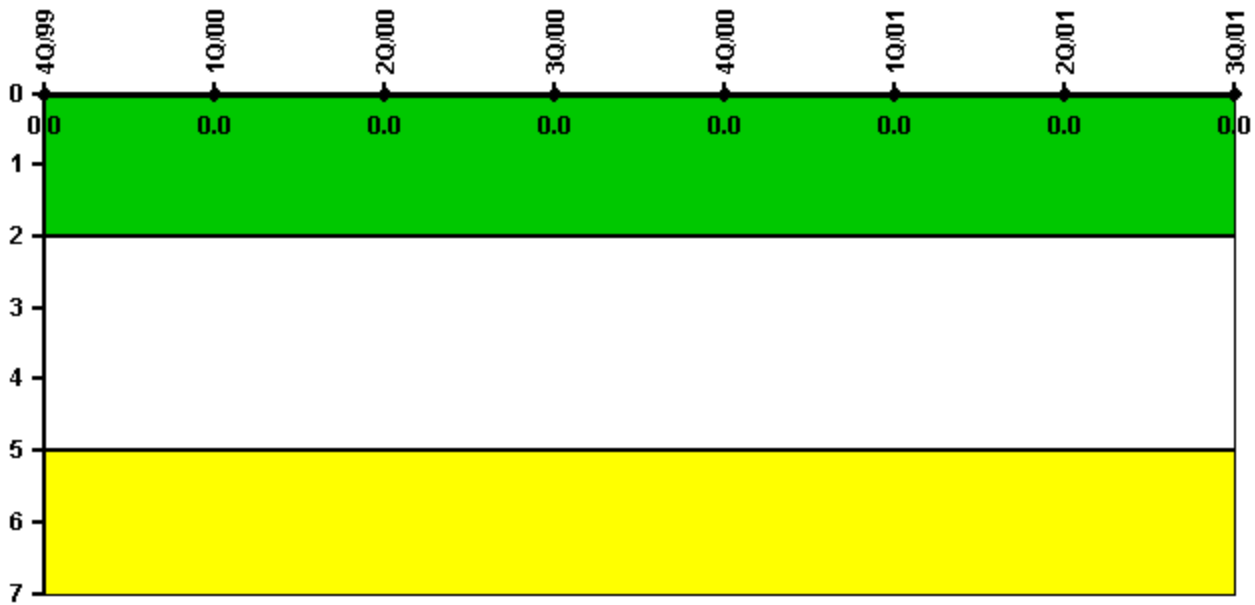

Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Program failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01
Program Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Action Matrix Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 26, 2002