


Waterford 3

2Q/2002 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

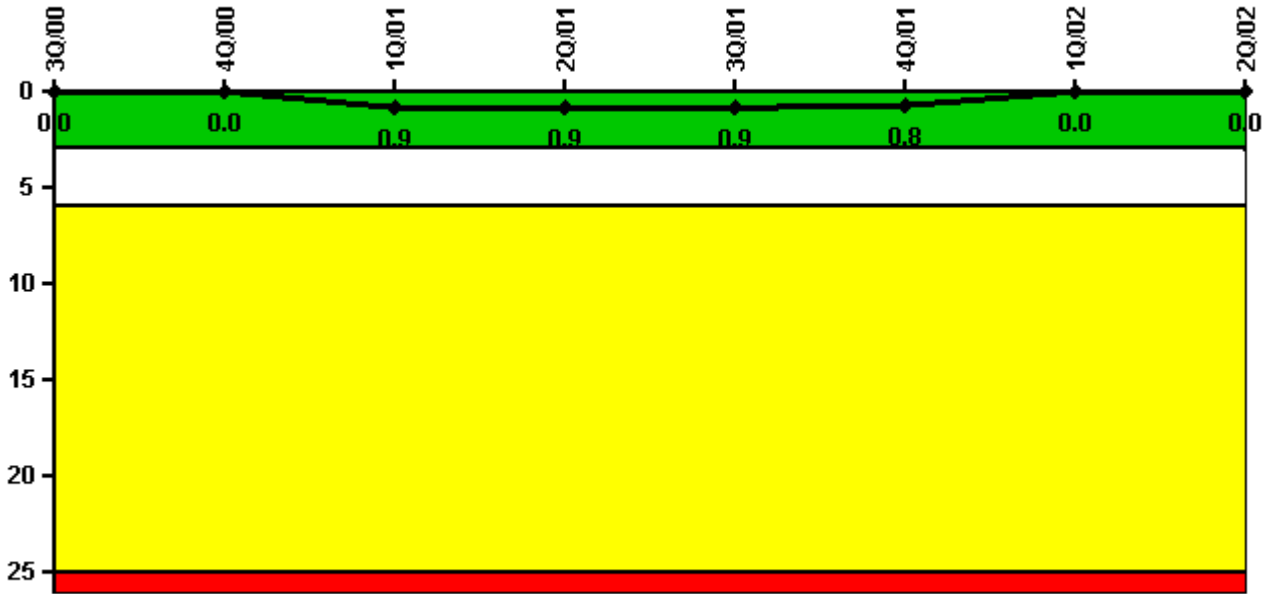


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Unplanned scrams	0	0	1.0	0	0	0	0	0
Critical hours	2208.0	1410.7	2127.0	2183.0	2208.0	2209.0	1942.9	1806.0
Indicator value	0	0	0.9	0.9	0.9	0.8	0	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

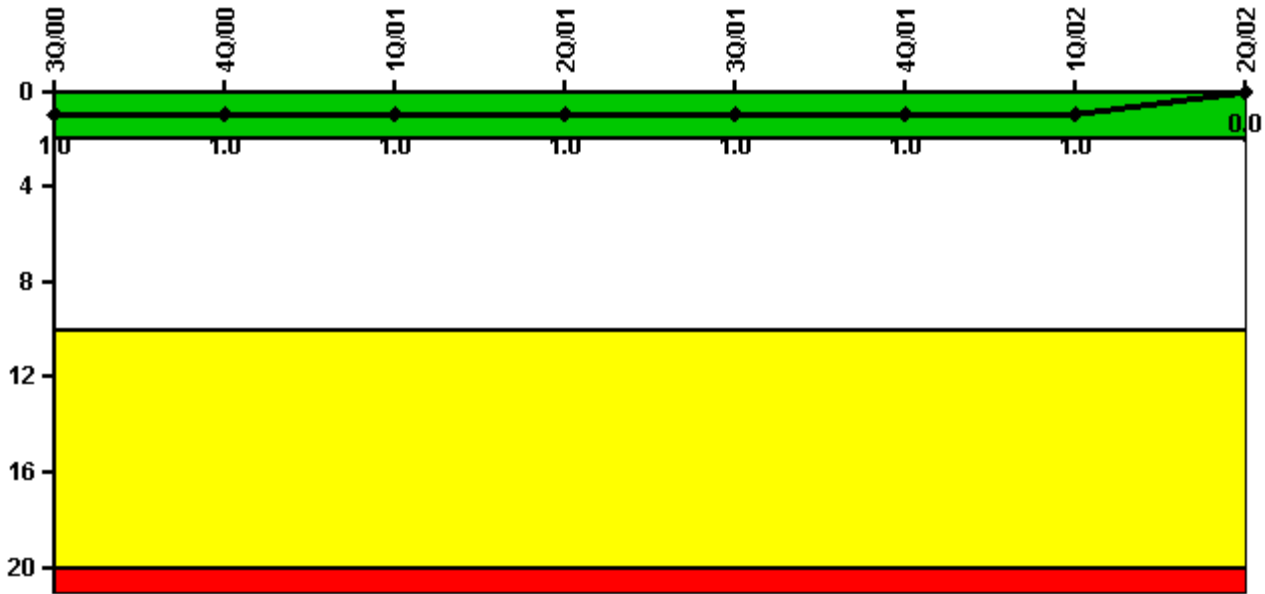


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Scrams	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	1.0	1.0	1.0	1.0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

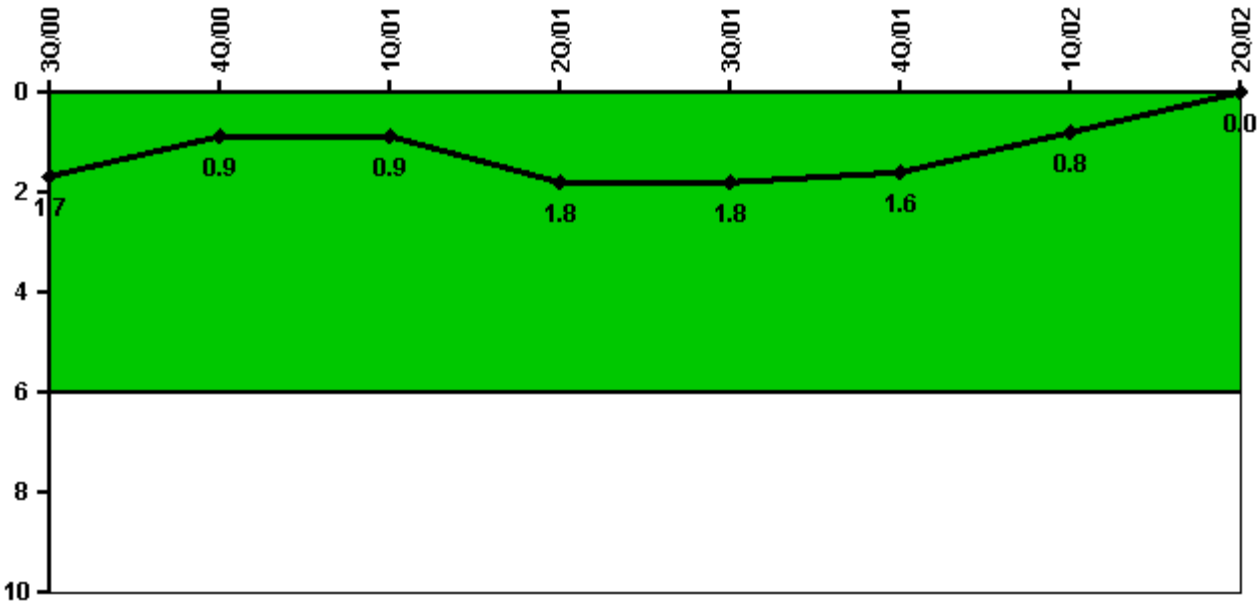


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Unplanned power changes	0	0	1.0	1.0	0	0	0	0
Critical hours	2208.0	1410.7	2127.0	2183.0	2208.0	2209.0	1942.9	1806.0
Indicator value	1.7	0.9	0.9	1.8	1.8	1.6	0.8	0

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

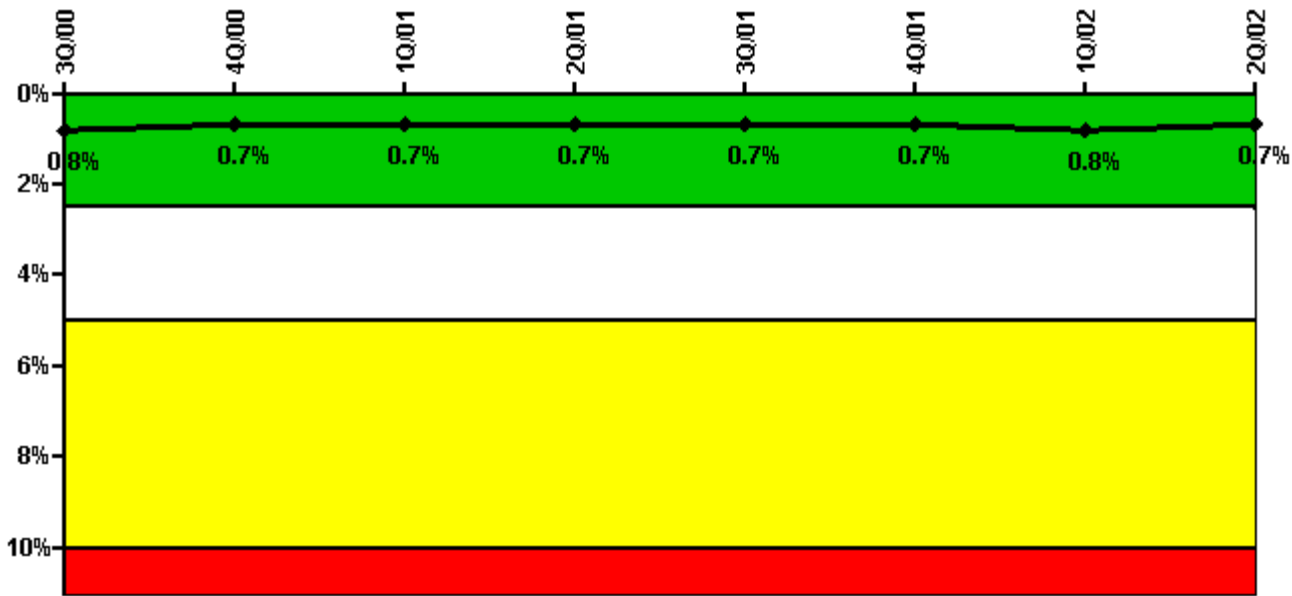


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Train 1								
Planned unavailable hours	3.88	0	0	0	0	5.68	9.95	0
Unplanned unavailable hours	21.55	3.50	2.60	0	16.33	47.48	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00	2183.00
Train 2								
Planned unavailable hours	2.52	3.98	2.65	1.50	0	1.92	12.77	0
Unplanned unavailable hours	9.22	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00	2183.00
Indicator value	0.8%	0.7%	0.7%	0.7%	0.7%	0.7%	0.8%	0.7%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

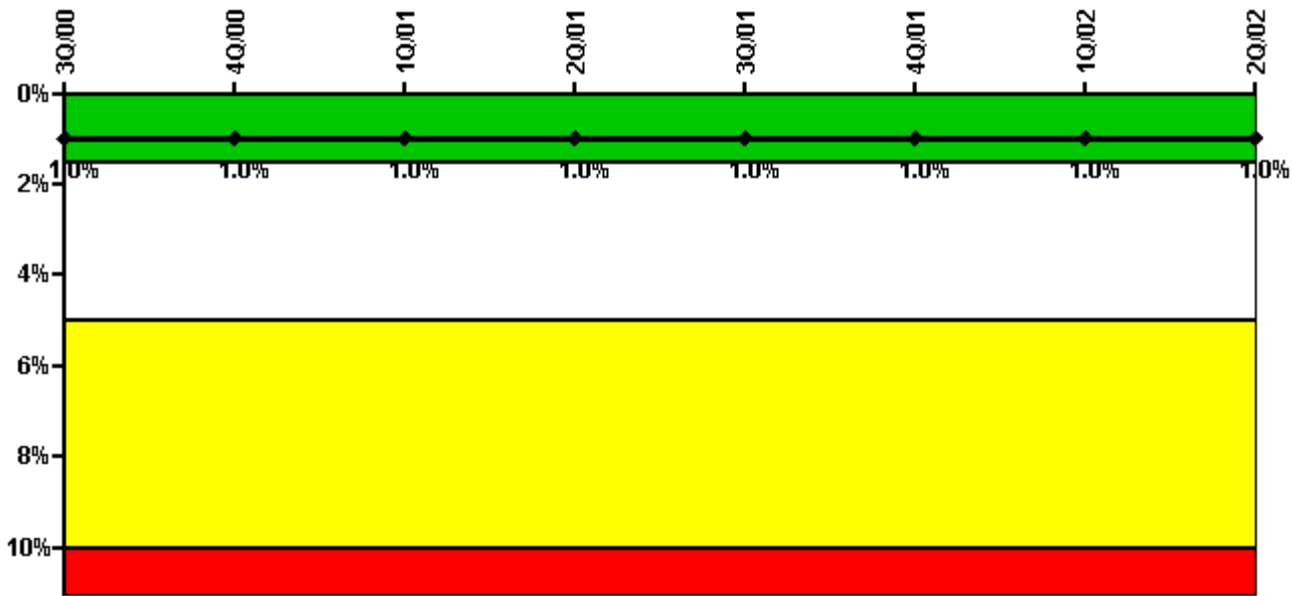


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Train 1								
Planned unavailable hours	18.43	1.65	2.53	1.00	22.43	14.38	9.80	0
Unplanned unavailable hours	21.55	3.50	5.40	0	0.58	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1410.60	2127.00	2183.00	2208.00	2209.00	1952.78	1838.62
Train 2								
Planned unavailable hours	2.33	3.98	2.65	1.72	0	0	14.42	0
Unplanned unavailable hours	9.22	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1410.60	2127.00	2183.00	2208.00	2209.00	1952.78	1838.62
Indicator value	1.0%	1.0%	1.0%	1.0%	1.0%	1.0%	1.0%	1.0%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

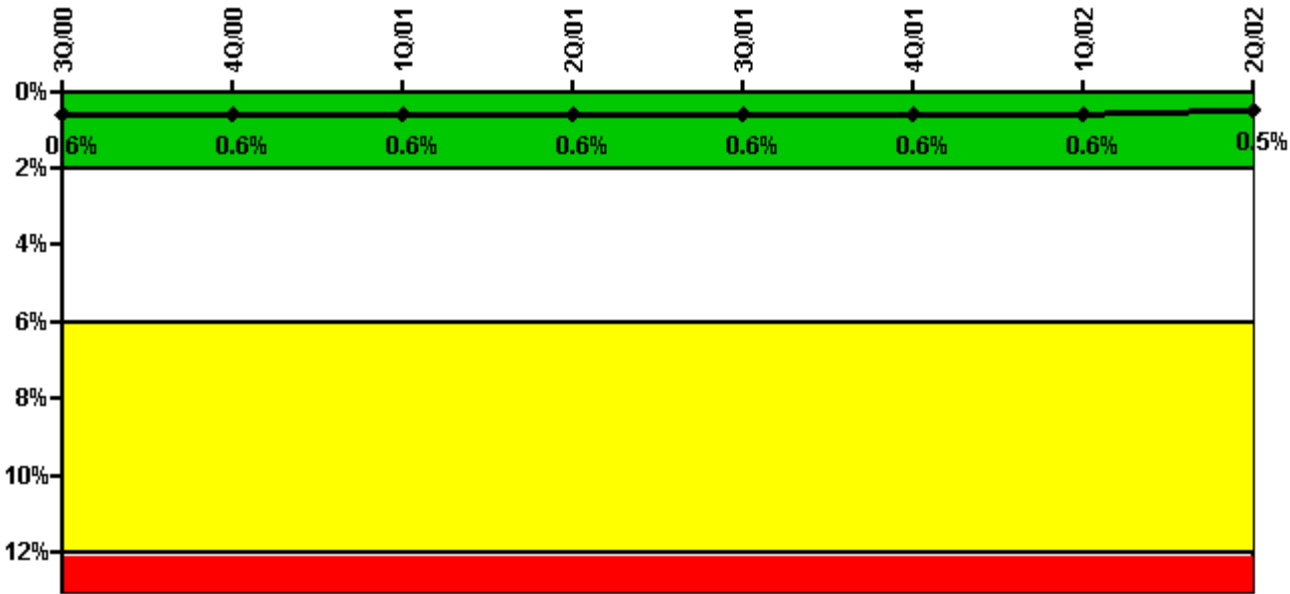


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Train 1								
Planned unavailable hours	3.88	0	0	0	11.00	14.38	9.80	6.22
Unplanned unavailable hours	21.55	3.50	2.60	0	0.58	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1457.60	2160.00	2183.00	2208.00	2209.00	1952.78	1838.62
Train 2								
Planned unavailable hours	0	3.98	2.65	1.50	8.38	0.32	12.77	0
Unplanned unavailable hours	9.22	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1457.60	2160.00	2183.00	2208.00	2209.00	1952.78	1838.62
Train 3								
Planned unavailable hours	0.22	0	0	7.90	0	0	0	0
Unplanned unavailable hours	0	0	0	0.87	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1457.60	2160.00	2183.00	2208.00	2209.00	1952.78	1838.62
Indicator value	0.6%	0.6%	0.6%	0.6%	0.6%	0.6%	0.6%	0.5%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

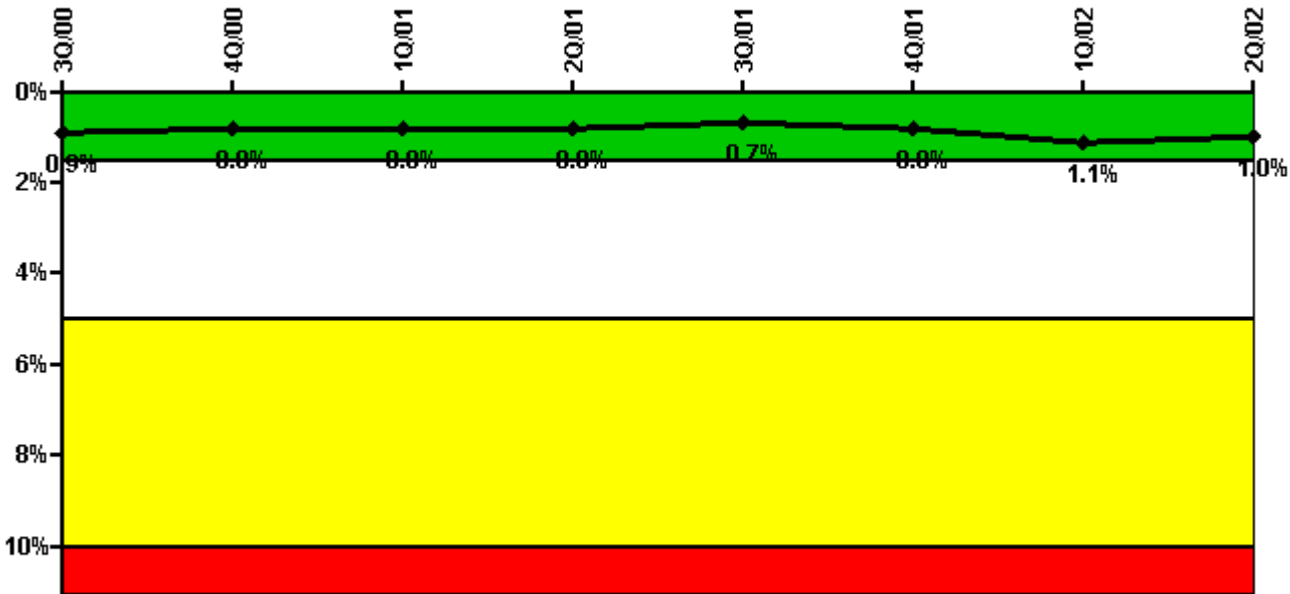

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Train 1								
Planned unavailable hours	18.91	2.45	0	0	0	14.38	9.80	0
Unplanned unavailable hours	21.85	3.50	2.60	0	0.58	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1457.60	2160.00	2183.00	2208.00	2209.00	1952.78	1838.62
Train 2								
Planned unavailable hours	0.92	5.03	2.65	1.50	0	18.52	34.25	0
Unplanned unavailable hours	9.22	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	1457.60	2160.00	2183.00	2208.00	2209.00	1952.78	1838.62
Train 3								
Planned unavailable hours	0	0	0	0	0	0	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	2.83	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	0	549.20	0	0	0	0	207.22	345.38
Train 4								
Planned unavailable hours	0	0	0	0	0	0	0	0

Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	2.93	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	0	549.20	0	0	0	0	207.22	345.38
Indicator value	0.9%	0.8%	0.8%	0.8%	0.7%	0.8%	1.1%	1.0%

Licensee Comments: none

Safety System Functional Failures (PWR)

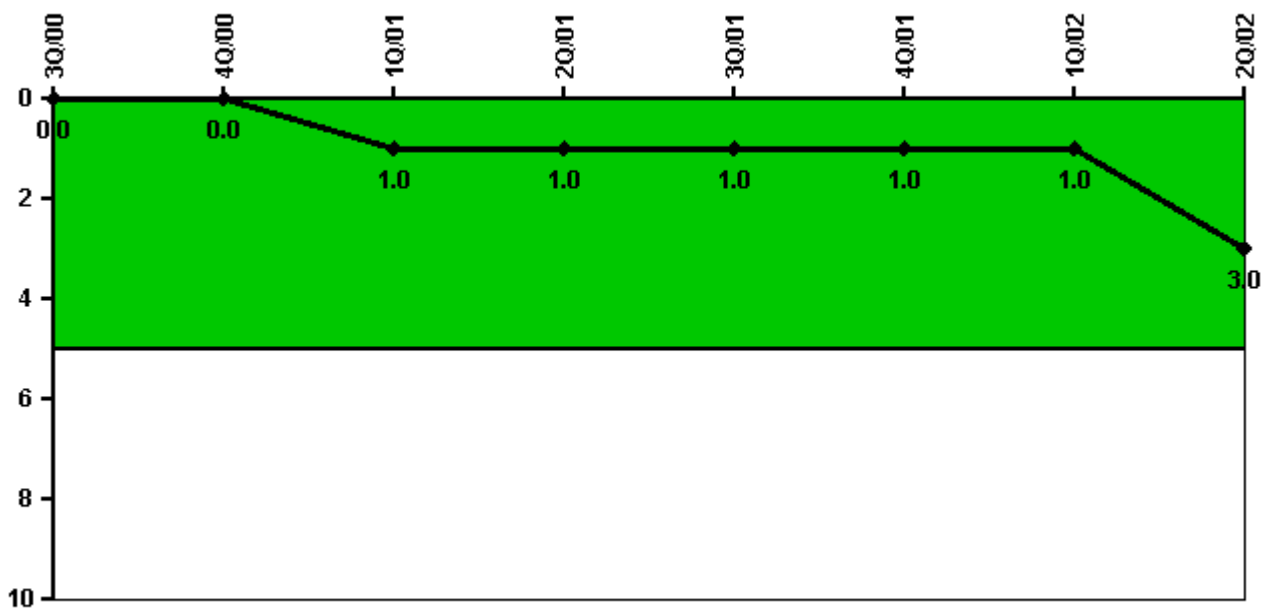


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Safety System Functional Failures	0	0	1	0	0	0	1	2
Indicator value	0	0	1	1	1	1	1	3

Licensee Comments: none

Reactor Coolant System Activity

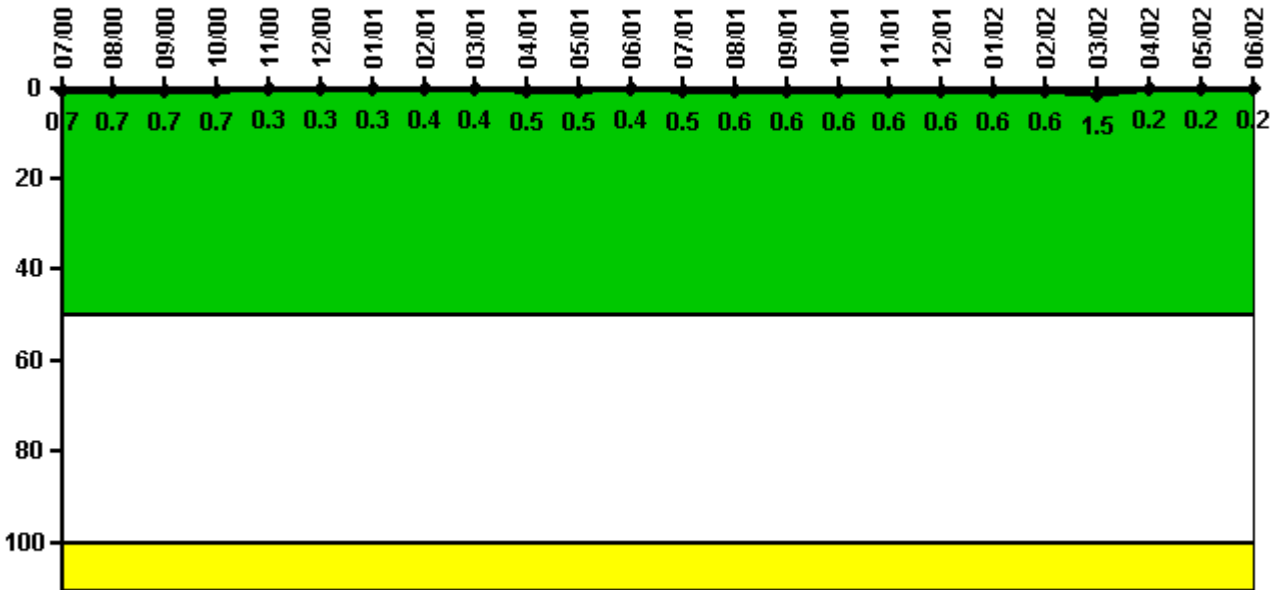

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01	4/01	5/01	6/01
Maximum activity	0.007090	0.006960	0.006990	0.007100	0.002710	0.003120	0.003460	0.004220	0.004250	0.004500	0.004500	0.004280
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.7	0.7	0.7	0.7	0.3	0.3	0.3	0.4	0.4	0.5	0.5	0.4

Reactor Coolant System Activity	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02	4/02	5/02	6/02
Maximum activity	0.005040	0.005940	0.005670	0.005640	0.005650	0.005870	0.005610	0.005930	0.015200	0.001890	0.002180	0.002270
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	1.5	0.2	0.2	0.2

Licensee Comments: none

Reactor Coolant System Leakage

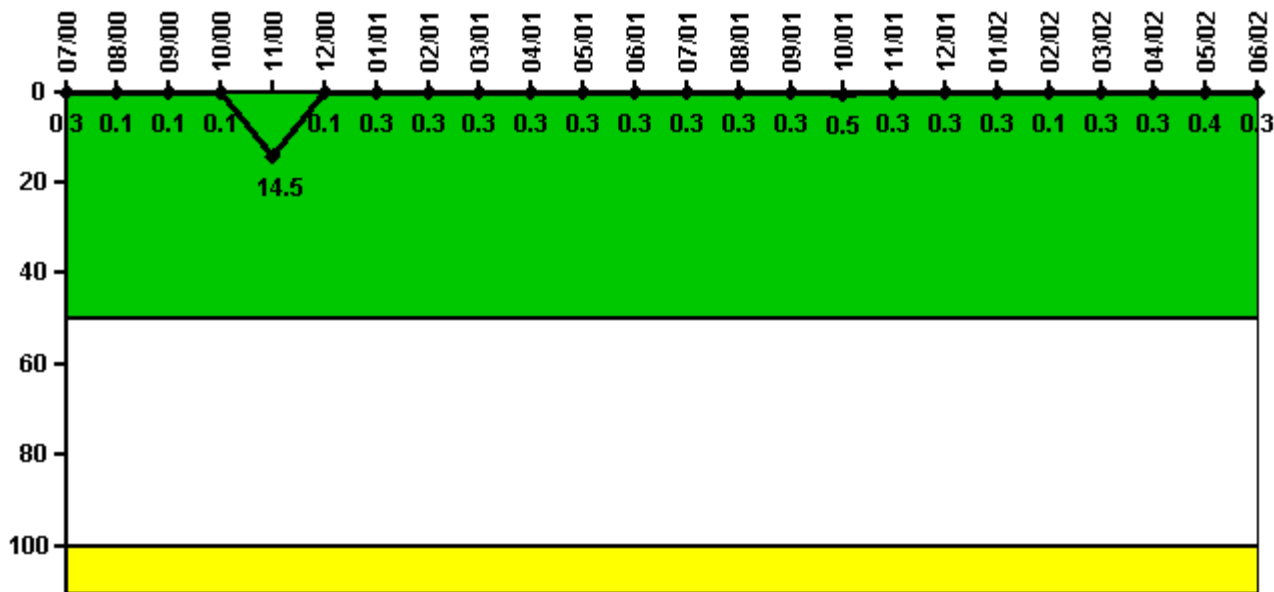

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01	4/01	5/01	6/01
Maximum leakage	0.027	0.014	0.014	0.014	1.452	0.014	0.028	0.028	0.028	0.028	0.028	0.028
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.1	0.1	0.1	14.5	0.1	0.3	0.3	0.3	0.3	0.3	0.3

Reactor Coolant System Leakage	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02	4/02	5/02	6/02
Maximum leakage	0.028	0.028	0.028	0.051	0.028	0.027	0.033	0.014	0.026	0.030	0.040	0.027
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.3	0.3	0.5	0.3	0.3	0.3	0.1	0.3	0.3	0.4	0.3

Licensee Comments: none

Drill/Exercise Performance

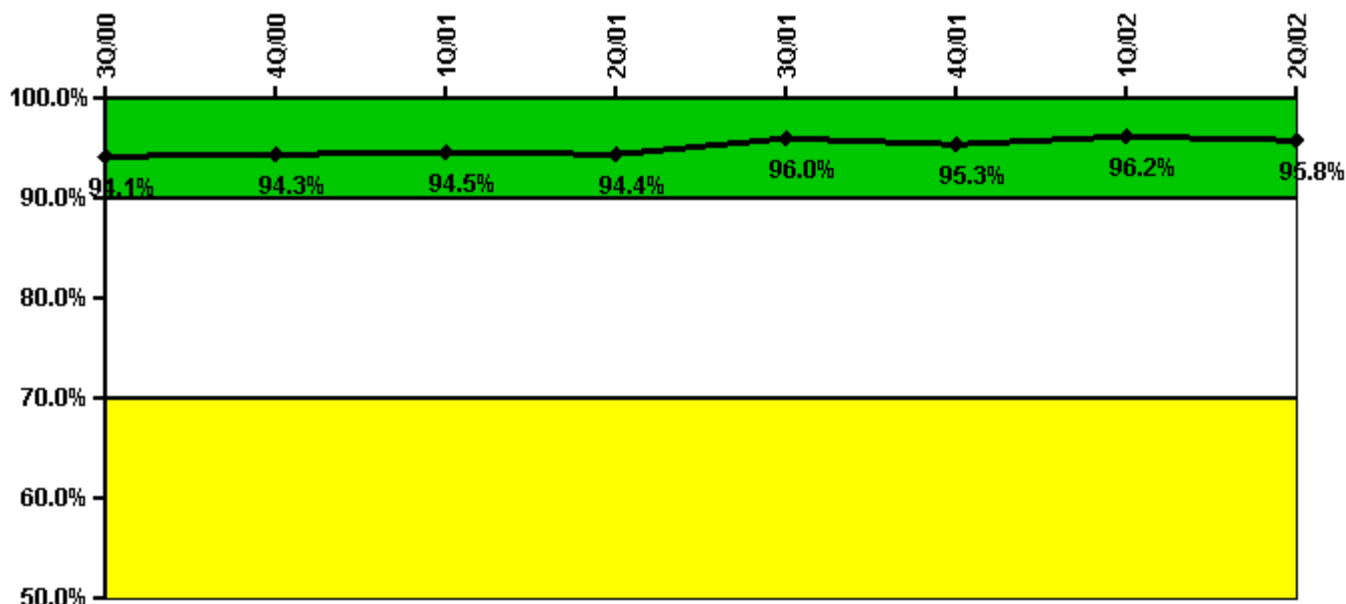


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Successful opportunities	46.0	10.0	12.0	20.0	21.0	43.0	38.0	17.0
Total opportunities	50.0	10.0	12.0	20.0	22.0	46.0	38.0	18.0
Indicator value	94.1%	94.3%	94.5%	94.4%	96.0%	95.3%	96.2%	95.8%

Licensee Comments: none

ERO Drill Participation

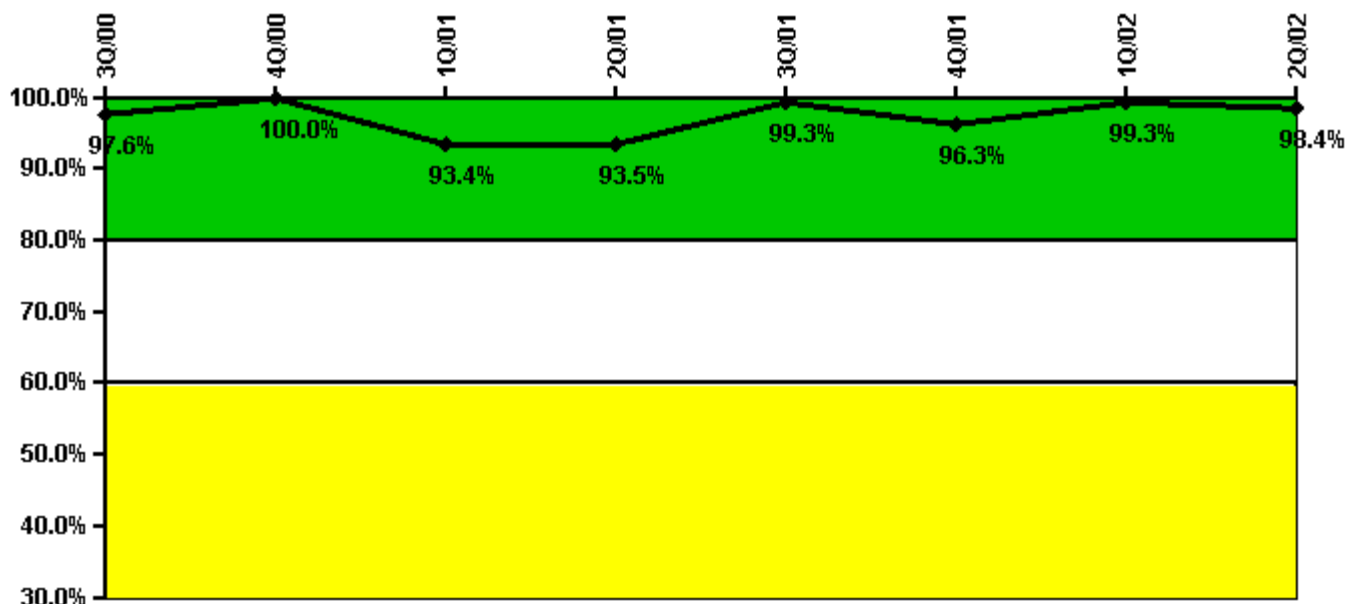


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Participating Key personnel	121.0	122.0	128.0	129.0	135.0	130.0	141.0	127.0
Total Key personnel	124.0	122.0	137.0	138.0	136.0	135.0	142.0	129.0
Indicator value	97.6%	100.0%	93.4%	93.5%	99.3%	96.3%	99.3%	98.4%

Licensee Comments: none

Alert & Notification System

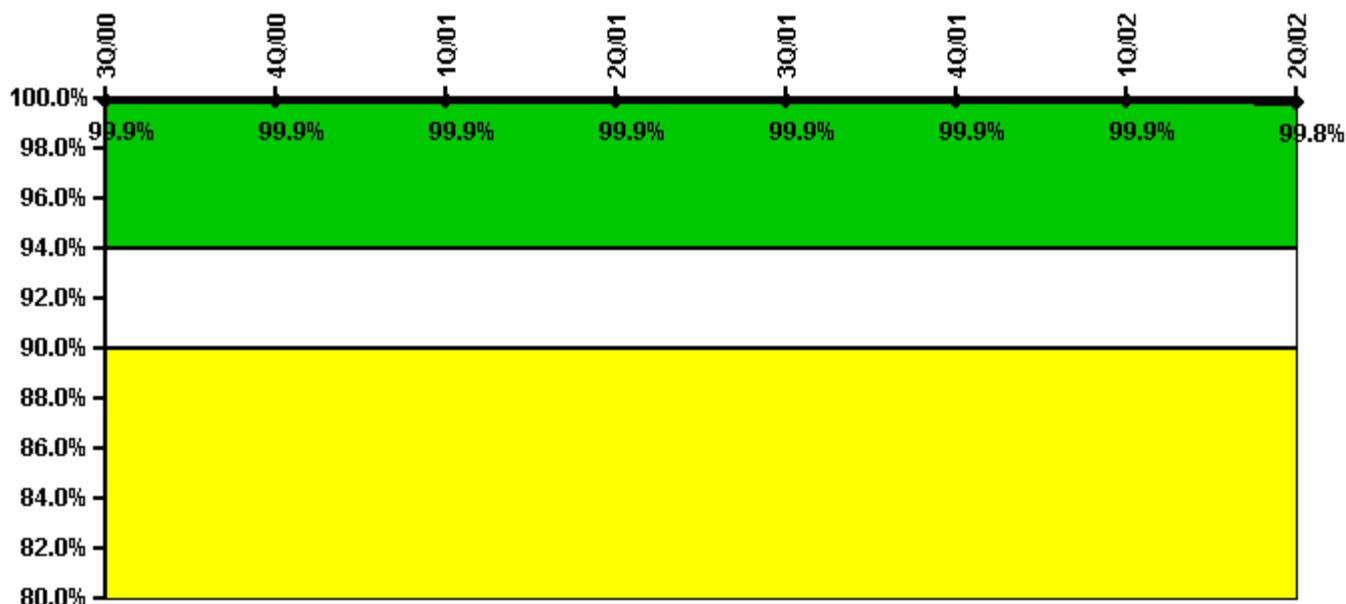


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Successful siren-tests	401	402	402	402	401	401	420	419
Total sirens-tests	402	402	402	402	402	402	420	420
Indicator value	99.9%	99.9%	99.9%	99.9%	99.9%	99.9%	99.9%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

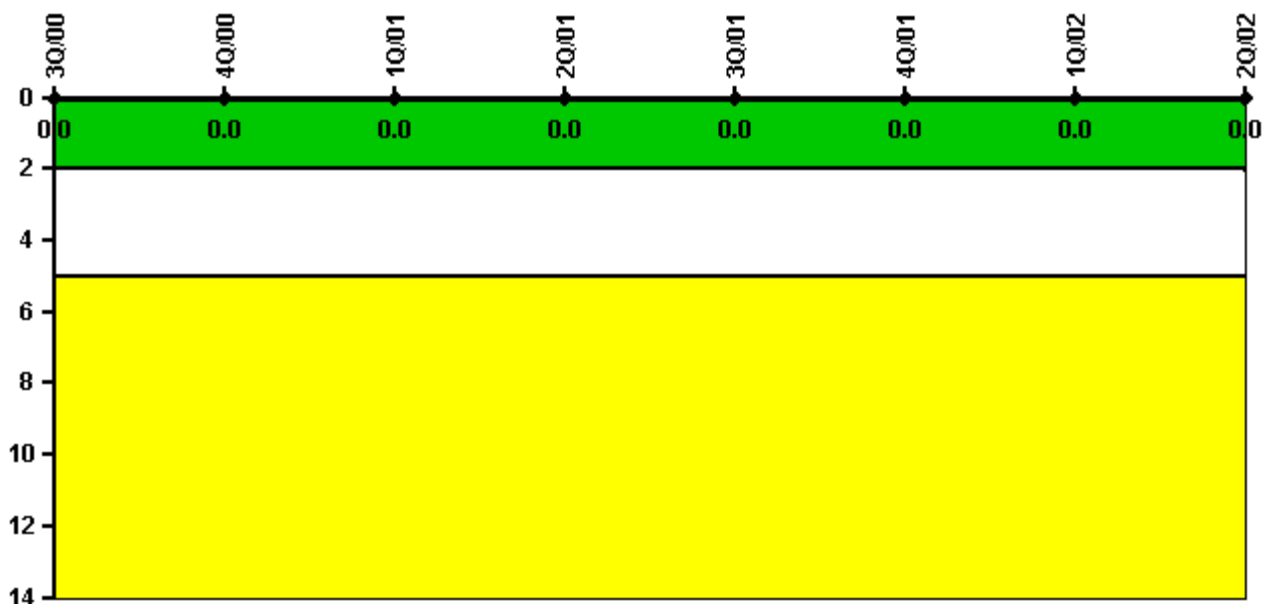

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

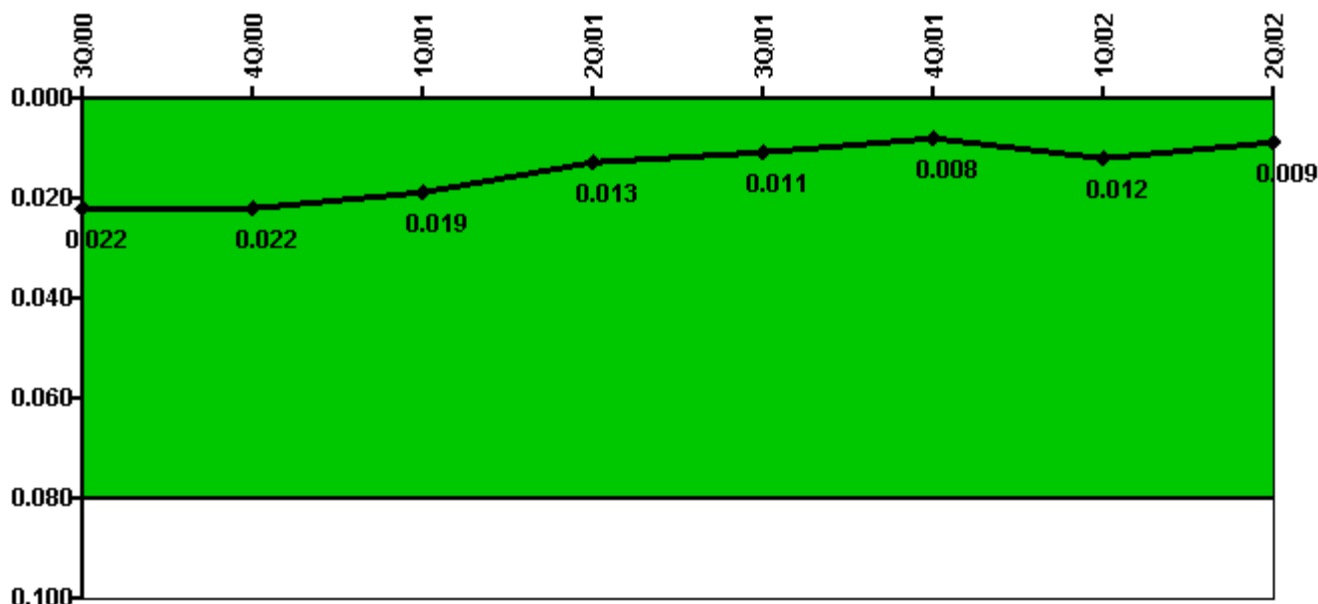

Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
IDS compensatory hours	43.60	25.70	18.60	65.40	8.60	8.70	82.10	7.90
CCTV compensatory hours	19.7	53.1	9.9	5.9	31.3	14.8	14.3	0
IDS normalization factor	1.10	1.10	1.10	1.10	1.10	1.10	1.10	1.10
CCTV normalization factor	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1
Index Value	0.022	0.022	0.019	0.013	0.011	0.008	0.012	0.009

Licensee Comments:

2Q/02: The IDS PI number for March 2002 was incorrectly reported as 33.2 hours. The correct number is 33.5 hours. This change does not effect the PI color. Accordingly, a change report was submitted to make this correction.

1Q/02: The IDS PI number for March 2002 was incorrectly reported as 33.2 hours. The correct number is 33.5 hours. This change does not effect the PI color. Accordingly, a change report was submitted to make this correction.

Personnel Screening Program




Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Program failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

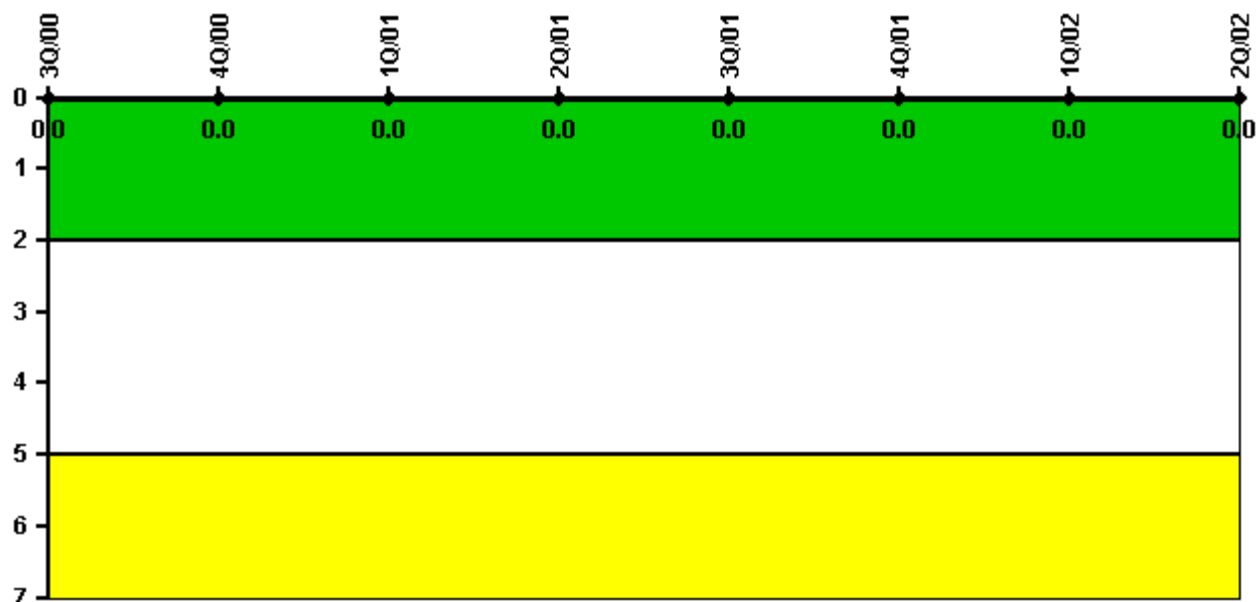

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02	2Q/02
Program Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: July 31, 2002