


Beaver Valley 1

1Q/2003 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

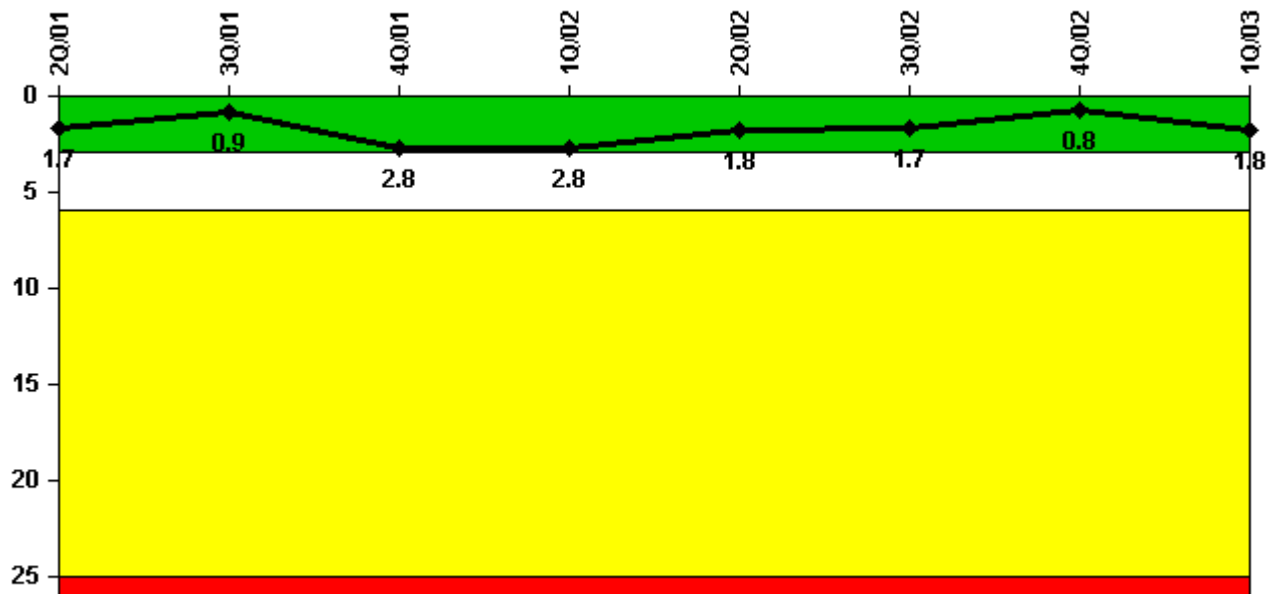


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 1.0 | 0 | 2.0 | 0 | 0 | 0 | 1.0 | 1.0 |
| Critical hours | 1905.1 | 1488.9 | 1908.5 | 2160.0 | 2183.0 | 2208.0 | 1958.1 | 1531.5 |
| | | | | | | | | |
| Indicator value | 1.7 | 0.9 | 2.8 | 2.8 | 1.8 | 1.7 | 0.8 | 1.8 |

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

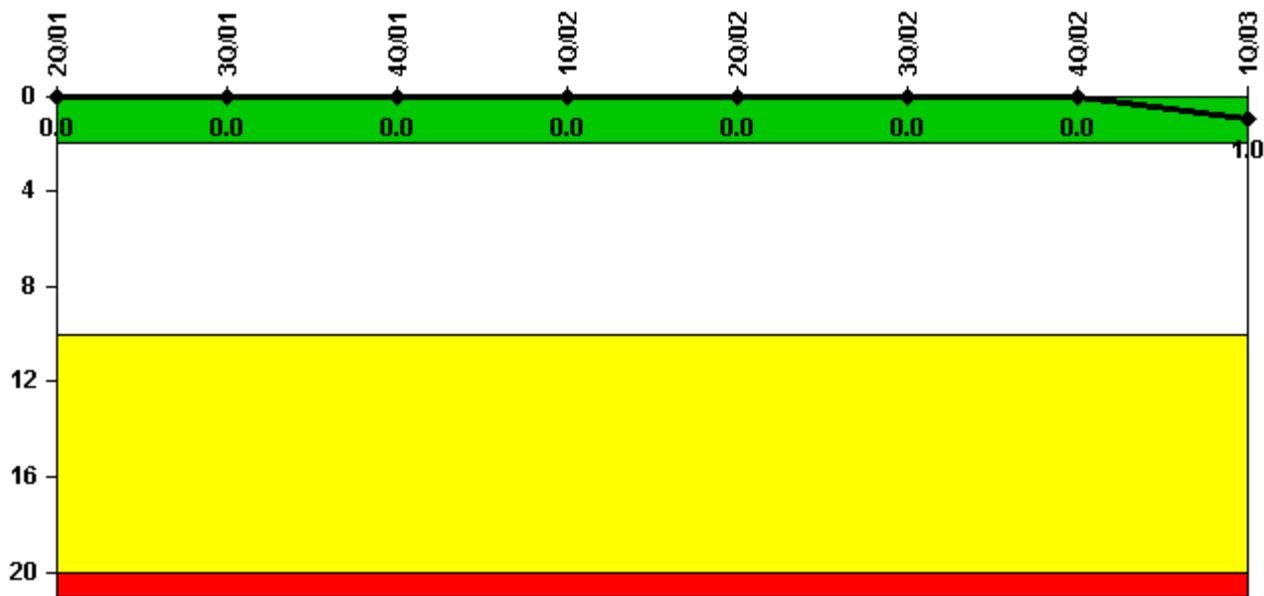


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

| Scrams with Loss of Normal Heat Removal | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1.0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

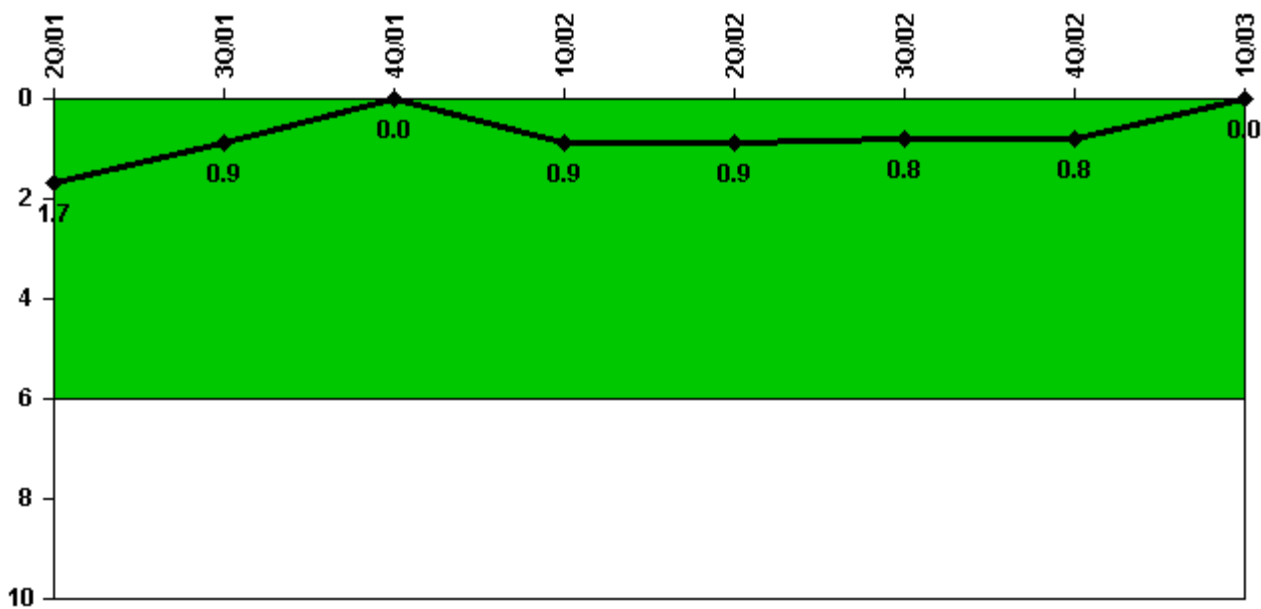


Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 0 | 0 | 1.0 | 0 | 0 | 0 | 0 |
| Critical hours | 1905.1 | 1488.9 | 1908.5 | 2160.0 | 2183.0 | 2208.0 | 1958.1 | 1531.5 |
| | | | | | | | | |
| Indicator value | 1.7 | 0.9 | 0 | 0.9 | 0.9 | 0.8 | 0.8 | 0 |

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

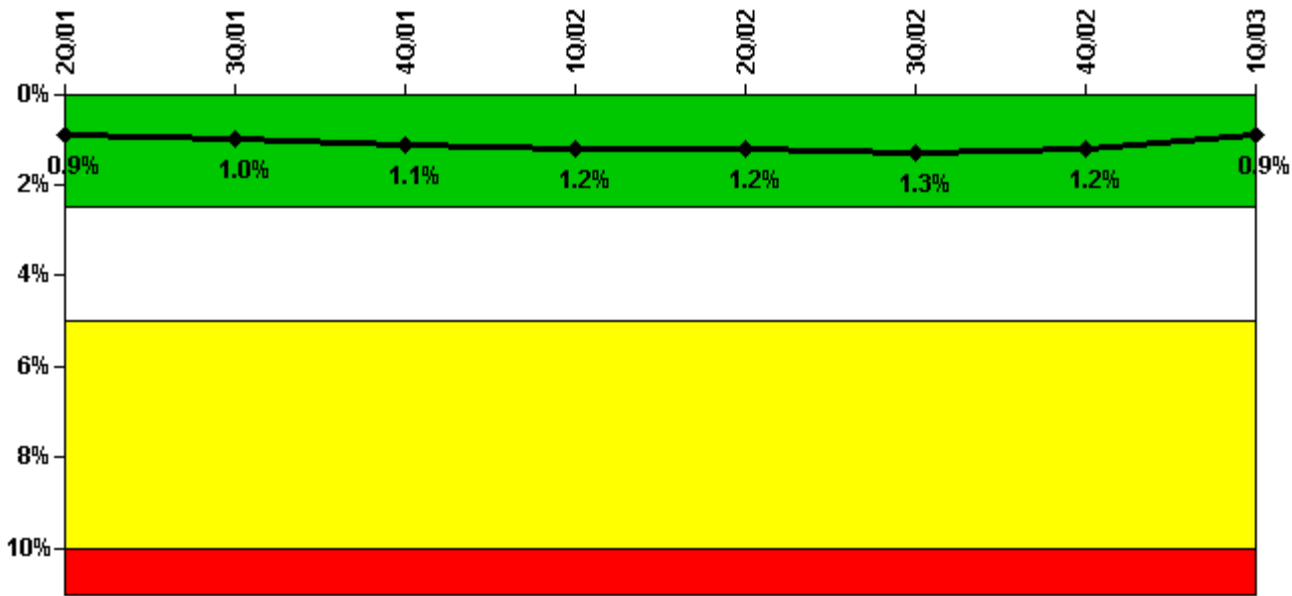


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

| Safety System Unavailability, Emergency AC Power | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|--|---------|---------|---------|---------|---------|---------|---------|---------|
| Train 1 | | | | | | | | |
| Planned unavailable hours | 26.80 | 4.10 | 10.40 | 4.40 | 7.00 | 31.10 | 6.20 | 13.80 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0 | 12.10 | 0 | 0 |
| Fault exposure hours | 0 | 102.50 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2183.00 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 2208.00 | 2209.00 | 2160.00 |
| Train 2 | | | | | | | | |
| Planned unavailable hours | 6.20 | 3.70 | 7.00 | 11.70 | 5.50 | 19.50 | 6.40 | 24.90 |
| Unplanned unavailable hours | 0 | 0 | 22.60 | 25.50 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2183.00 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 2208.00 | 2209.00 | 2160.00 |
| Indicator value | 0.9% | 1.0% | 1.1% | 1.2% | 1.2% | 1.3% | 1.2% | 0.9% |

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

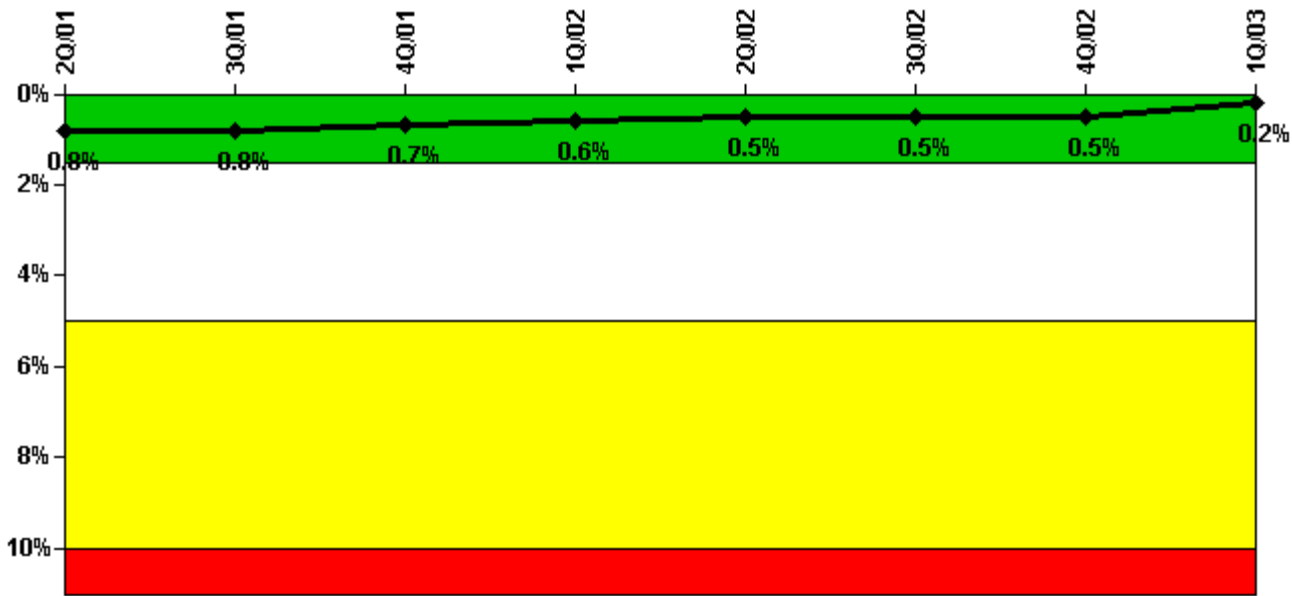


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

| Safety System Unavailability, High Pressure Injection System (HPSI) | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| Train 1 | | | | | | | | |
| Planned unavailable hours | 9.04 | 0.98 | 2.59 | 1.27 | 3.73 | 10.09 | 1.22 | 2.51 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2124.48 | 2160.00 | 2183.00 | 2208.00 | 1940.07 | 1534.70 |
| Train 2 | | | | | | | | |
| Planned unavailable hours | 2.09 | 4.07 | 4.29 | 3.07 | 2.79 | 1.35 | 0.55 | 1.26 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0.40 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2124.48 | 2160.00 | 2183.00 | 2208.00 | 1940.07 | 1534.70 |
| | | | | | | | | |
| Indicator value | 0.8% | 0.8% | 0.7% | 0.6% | 0.5% | 0.5% | 0.5% | 0.2% |

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

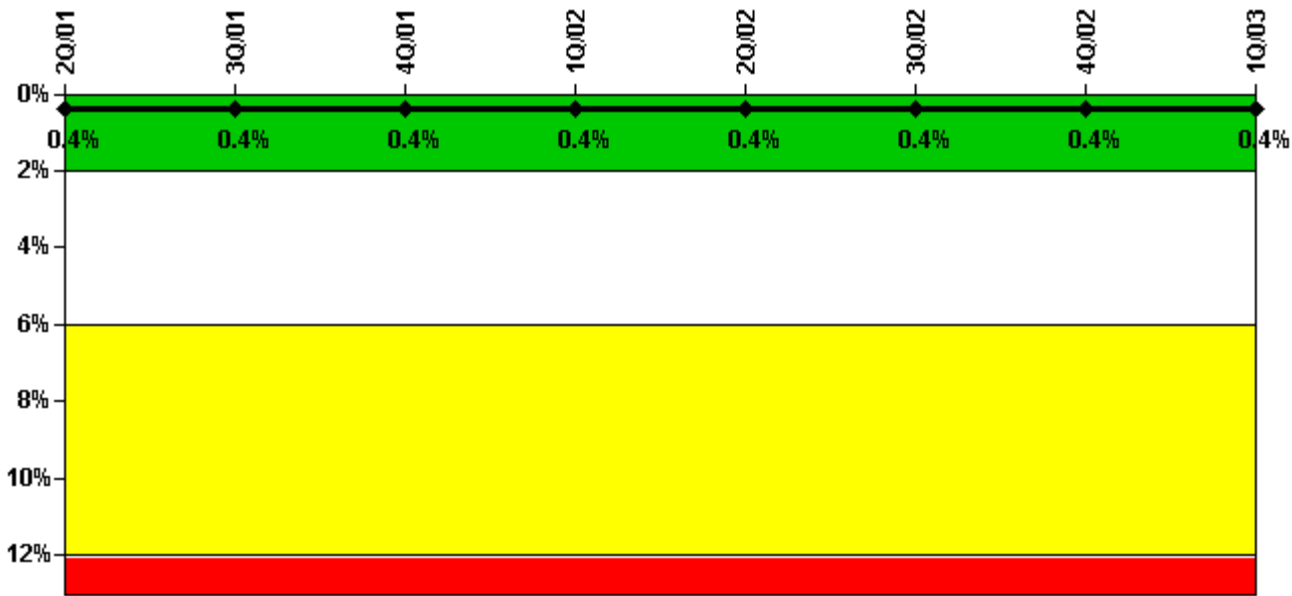


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

| Safety System Unavailability, Heat Removal System (AFW) | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|---------|---------|---------|---------|---------|---------|---------|---------|
| Train 1 | | | | | | | | |
| Planned unavailable hours | 1.50 | 0.12 | 1.00 | 2.27 | 3.82 | 29.88 | 12.15 | 0 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0.28 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2124.48 | 2160.00 | 2183.00 | 2208.00 | 1940.07 | 1595.60 |
| Train 2 | | | | | | | | |
| Planned unavailable hours | 12.87 | 0 | 4.77 | 0 | 0 | 0.98 | 0 | 0 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2124.48 | 2160.00 | 2183.00 | 2208.00 | 1940.07 | 1595.60 |
| Train 3 | | | | | | | | |
| Planned unavailable hours | 11.80 | 0.55 | 68.30 | 0 | 1.38 | 1.50 | 3.17 | 0 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 5.20 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2107.08 | 2160.00 | 2183.00 | 2208.00 | 1940.07 | 1595.60 |
| Indicator value | 0.4% | 0.4% | 0.4% | 0.4% | 0.4% | 0.4% | 0.4% | 0.4% |

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

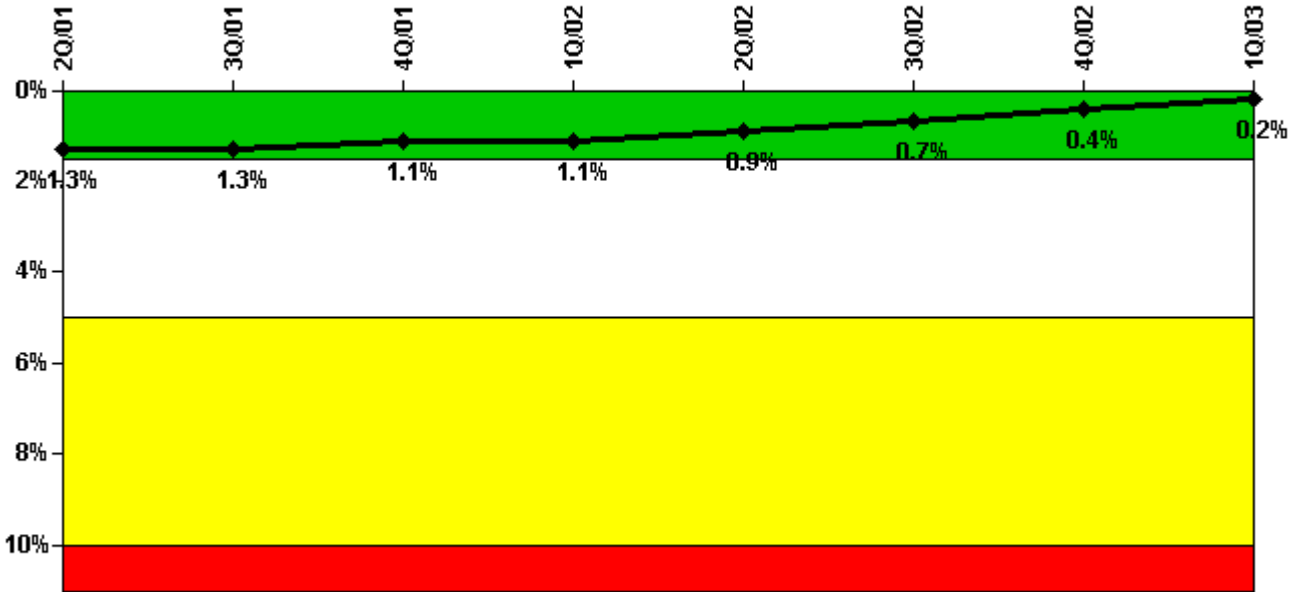

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

| Safety System Unavailability, Residual Heat Removal System | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|--|---------|---------|---------|---------|---------|---------|---------|---------|
| Train 1 | | | | | | | | |
| Planned unavailable hours | 10.63 | 0.98 | 1.75 | 8.33 | 17.25 | 1.21 | 0.27 | 1.63 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2124.48 | 2160.00 | 2183.00 | 2208.00 | 2041.33 | 1587.60 |
| Train 2 | | | | | | | | |
| Planned unavailable hours | 0.33 | 1.02 | 12.11 | 2.14 | 1.10 | 1.35 | 0.30 | 0.64 |
| Unplanned unavailable hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 2001.70 | 1494.77 | 2124.48 | 2160.00 | 2183.00 | 2208.00 | 2041.33 | 1587.60 |
| Train 3 | | | | | | | | |
| Planned unavailable hours | 0 | 0 | 0.52 | 0 | 0 | 0 | 0 | 0 |
| Unplanned unavailable hours | 0.60 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0.80 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 194.12 | 606.32 | 75.11 | 0 | 0 | 0 | 200.20 | 263.10 |
| Train 4 | | | | | | | | |
| Planned unavailable hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

| | | | | | | | | |
|-----------------------------|--------|--------|-------|------|------|------|--------|--------|
| Unplanned unavailable hours | 0.60 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Fault exposure hours | 0.80 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Effective Reset hours | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Required hours | 194.12 | 606.32 | 76.56 | 0 | 0 | 0 | 200.20 | 263.10 |
| Indicator value | 1.3% | 1.3% | 1.1% | 1.1% | 0.9% | 0.7% | 0.4% | 0.2% |

Licensee Comments: none

Safety System Functional Failures (PWR)

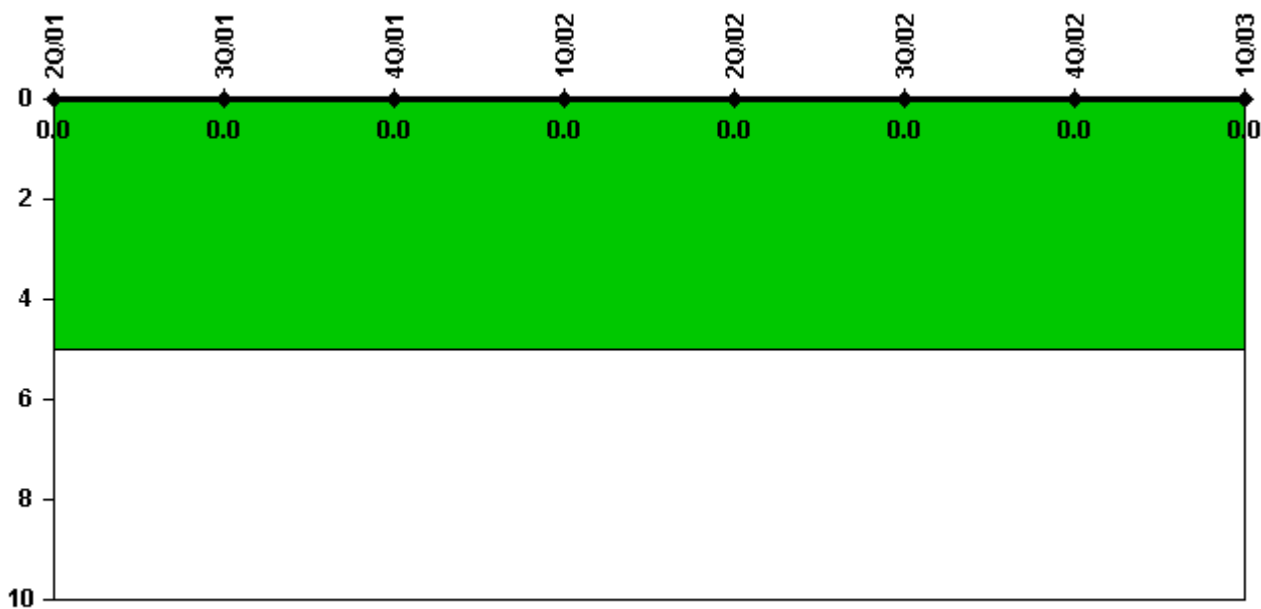


Thresholds: White > 5.0

Notes

| Safety System Functional Failures (PWR) | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Reactor Coolant System Activity

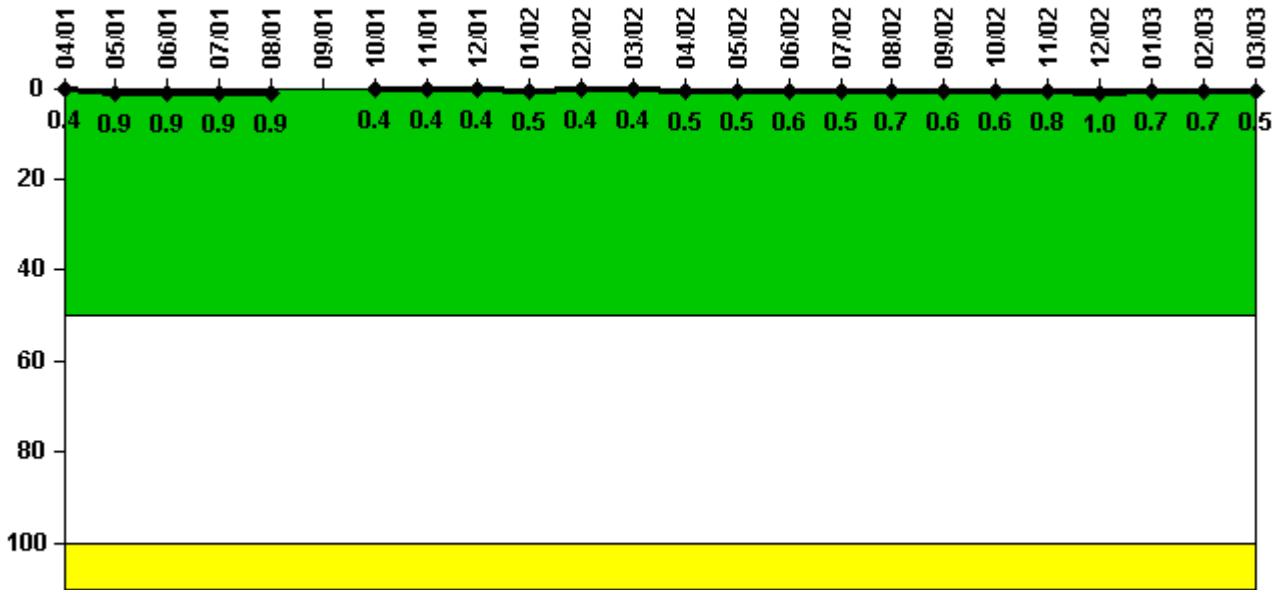

Thresholds: White > 50.0 Yellow > 100.0


Notes

| Reactor Coolant System Activity | 4/01 | 5/01 | 6/01 | 7/01 | 8/01 | 9/01 | 10/01 | 11/01 | 12/01 | 1/02 | 2/02 | 3/02 |
|---------------------------------|----------|----------|----------|----------|----------|------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000779 | 0.000917 | 0.000854 | 0.000918 | 0.000914 | N/A | 0.000360 | 0.000389 | 0.000376 | 0.000515 | 0.000448 | 0.000433 |
| Technical specification limit | 0.2 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 |
| Indicator value | 0.4 | 0.9 | 0.9 | 0.9 | 0.9 | N/A | 0.4 | 0.4 | 0.4 | 0.5 | 0.4 | 0.4 |

| Reactor Coolant System Activity | 4/02 | 5/02 | 6/02 | 7/02 | 8/02 | 9/02 | 10/02 | 11/02 | 12/02 | 1/03 | 2/03 | 3/03 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000540 | 0.000540 | 0.000570 | 0.000539 | 0.000650 | 0.000606 | 0.000642 | 0.000806 | 0.000979 | 0.000705 | 0.000687 | 0.000509 |
| Technical specification limit | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 | 0.1 |
| Indicator value | 0.5 | 0.5 | 0.6 | 0.5 | 0.7 | 0.6 | 0.6 | 0.8 | 1.0 | 0.7 | 0.7 | 0.5 |

Licensee Comments: none

Reactor Coolant System Leakage

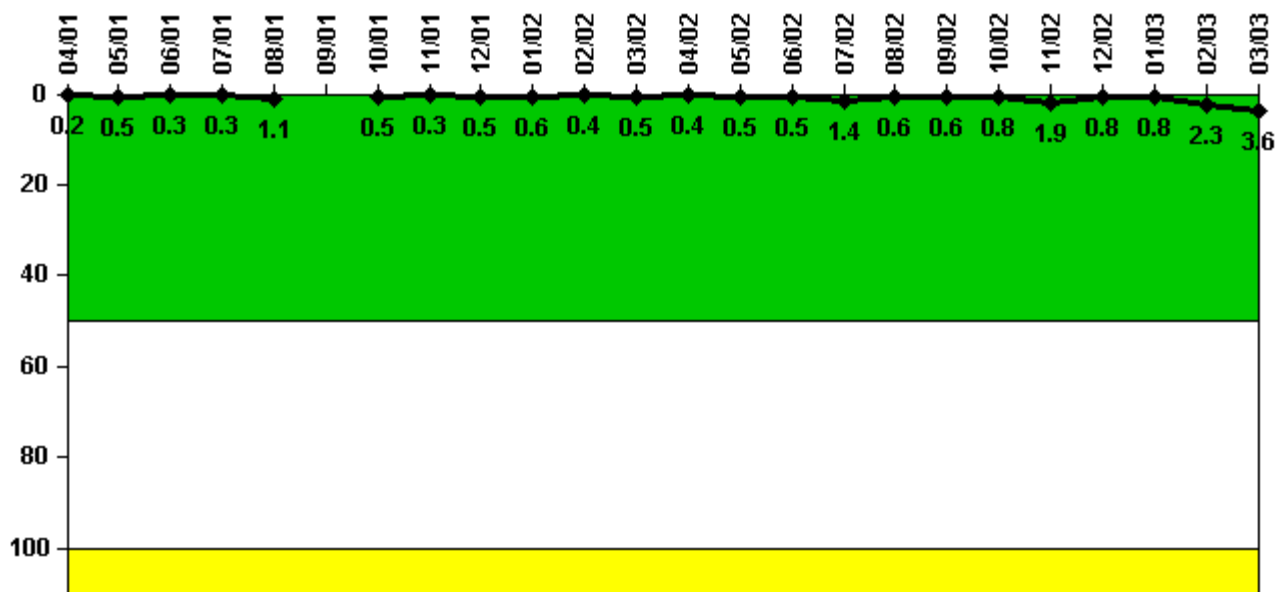

Thresholds: White > 50.0 Yellow > 100.0


Notes

| Reactor Coolant System Leakage | 4/01 | 5/01 | 6/01 | 7/01 | 8/01 | 9/01 | 10/01 | 11/01 | 12/01 | 1/02 | 2/02 | 3/02 |
|--------------------------------|-------|-------|-------|-------|-------|------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 0.020 | 0.050 | 0.030 | 0.030 | 0.110 | N/A | 0.050 | 0.030 | 0.050 | 0.060 | 0.040 | 0.050 |
| Technical specification limit | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 |
| Indicator value | 0.2 | 0.5 | 0.3 | 0.3 | 1.1 | N/A | 0.5 | 0.3 | 0.5 | 0.6 | 0.4 | 0.5 |

| Reactor Coolant System Leakage | 4/02 | 5/02 | 6/02 | 7/02 | 8/02 | 9/02 | 10/02 | 11/02 | 12/02 | 1/03 | 2/03 | 3/03 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 0.040 | 0.050 | 0.050 | 0.140 | 0.060 | 0.060 | 0.080 | 0.190 | 0.080 | 0.081 | 0.230 | 0.360 |
| Technical specification limit | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 |
| Indicator value | 0.4 | 0.5 | 0.5 | 1.4 | 0.6 | 0.6 | 0.8 | 1.9 | 0.8 | 0.8 | 2.3 | 3.6 |

Licensee Comments: none

Drill/Exercise Performance

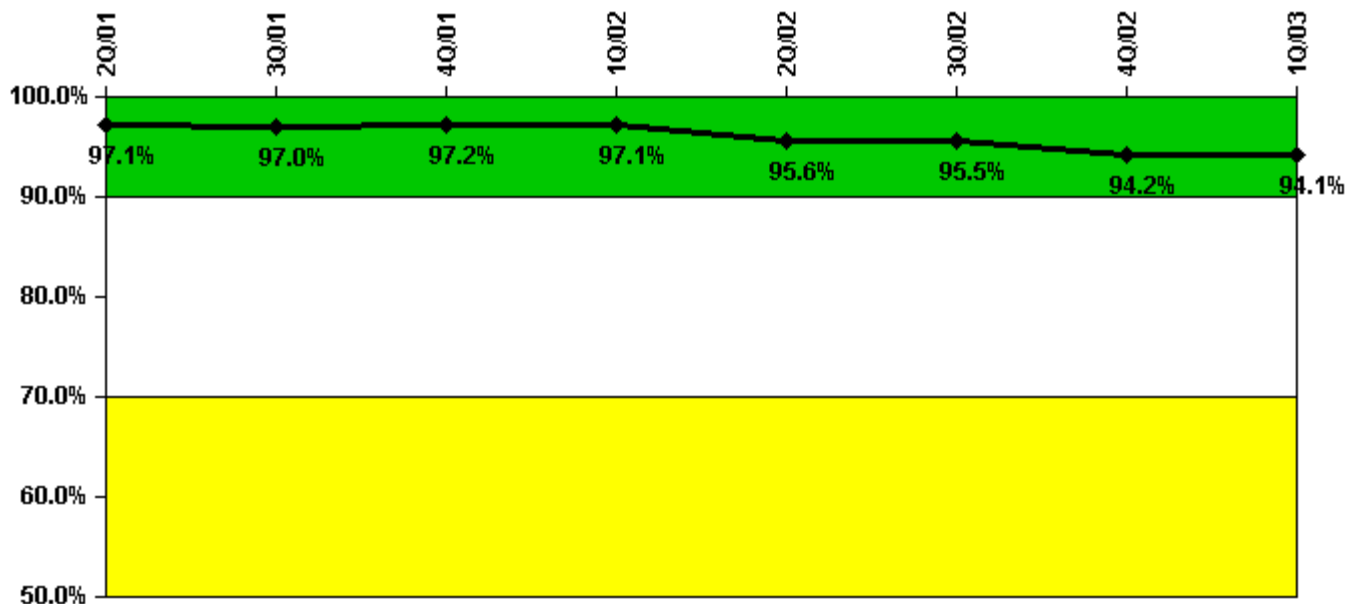


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 71.0 | 38.0 | 39.0 | 5.0 | 25.0 | 46.0 | 29.0 | 2.0 |
| Total opportunities | 75.0 | 39.0 | 39.0 | 5.0 | 30.0 | 48.0 | 33.0 | 2.0 |
| | | | | | | | | |
| Indicator value | 97.1% | 97.0% | 97.2% | 97.1% | 95.6% | 95.5% | 94.2% | 94.1% |

Licensee Comments: none

ERO Drill Participation

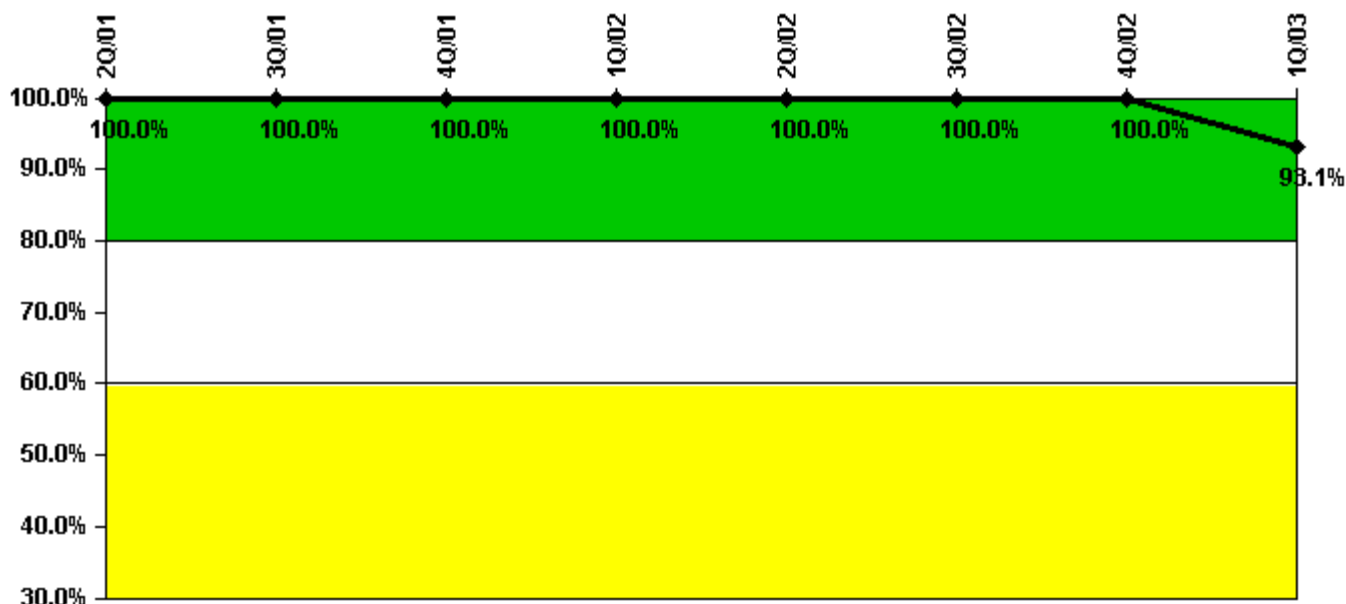


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|-----------------------------|--------|--------|--------|--------|--------|--------|--------|-------|
| Participating Key personnel | 91.0 | 102.0 | 104.0 | 104.0 | 105.0 | 120.0 | 121.0 | 122.0 |
| Total Key personnel | 91.0 | 102.0 | 104.0 | 104.0 | 105.0 | 120.0 | 121.0 | 131.0 |
| | | | | | | | | |
| Indicator value | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 93.1% |

Licensee Comments: none

Alert & Notification System

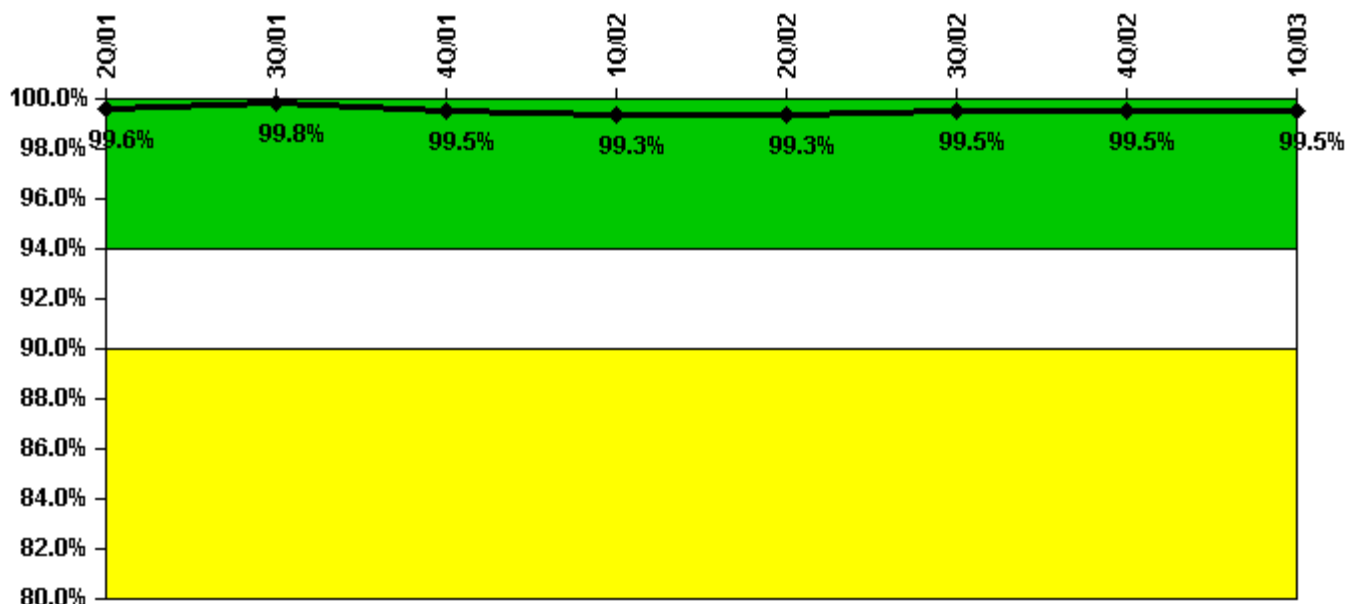


Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 110 | 109 | 218 | 109 | 117 | 117 | 232 | 116 |
| Total sirens-tests | 110 | 110 | 220 | 110 | 117 | 117 | 234 | 117 |
| | | | | | | | | |
| Indicator value | 99.6% | 99.8% | 99.5% | 99.3% | 99.3% | 99.5% | 99.5% | 99.5% |

Licensee Comments: none

Occupational Exposure Control Effectiveness

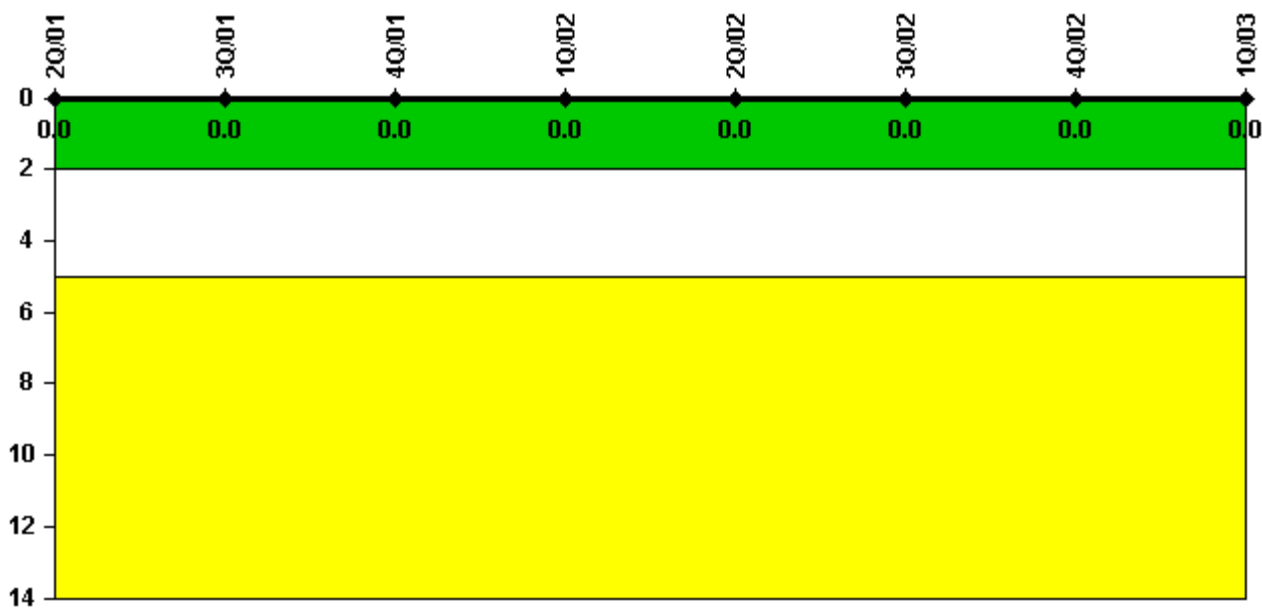

Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Protected Area Security Performance Index

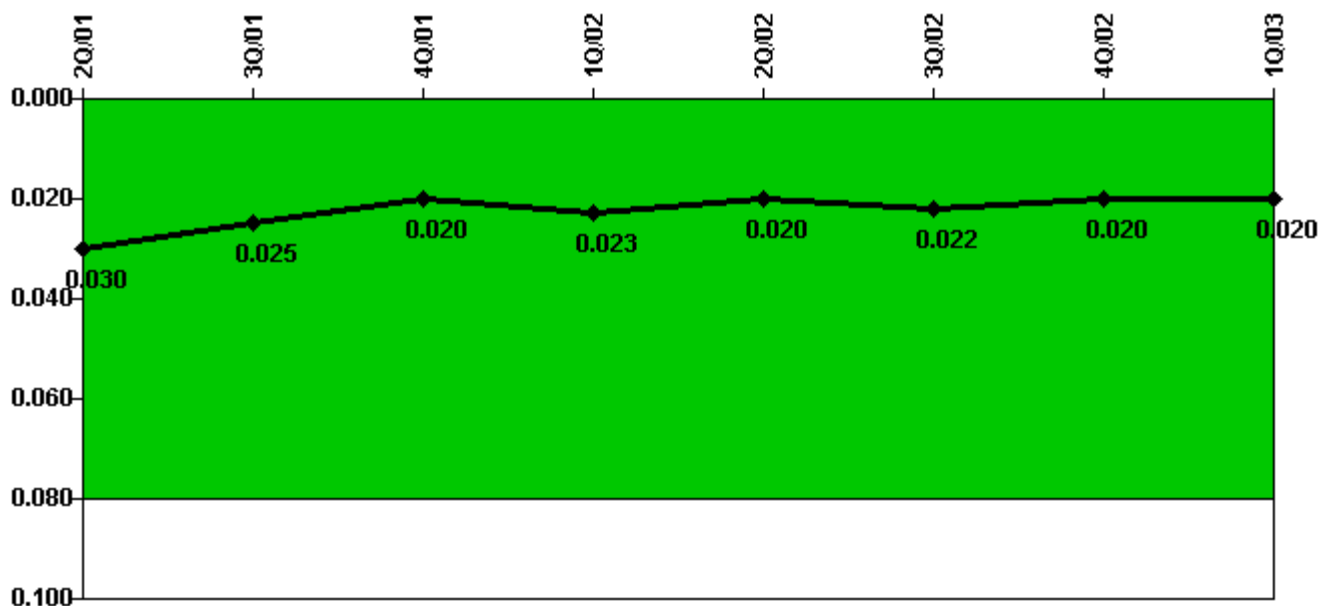

Thresholds: White > 0.080

Notes

| Protected Area Security Performance Index | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---|--------|--------|--------|--------|--------|--------|-------|--------|
| IDS compensatory hours | 584.02 | 108.39 | 119.85 | 287.09 | 420.56 | 196.75 | 43.38 | 134.68 |
| CCTV compensatory hours | 0 | 0 | 7.1 | 0 | 6.4 | 0 | 0 | 0.5 |
| IDS normalization factor | 2.82 | 2.75 | 2.75 | 2.75 | 2.75 | 2.75 | 2.75 | 2.35 |
| CCTV normalization factor | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.5 | 1.7 |
| | | | | | | | | |
| Index Value | 0.030 | 0.025 | 0.020 | 0.023 | 0.020 | 0.022 | 0.020 | 0.020 |

Licensee Comments:

1Q/03: Normalization factors changed after January 2003. so averages were used for this quarter. {IDS from 2.75 to 2.15; CCTV from 1.5 to 1.8}

Personnel Screening Program



Thresholds: White > 2.0 Yellow > 5.0

Notes

| Personnel Screening Program | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Program failures | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

Notes

| FFD/Personnel Reliability | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 | 2Q/02 | 3Q/02 | 4Q/02 | 1Q/03 |
|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Program Failures | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments:

2Q/02: An FAQ has been submitted to determine if the event reported for May 2002 should be counted. FAQ 336 determined that this event should not be counted, therefore the value for May 2002 was changed to zero.

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 22, 2003