


## D.C. Cook 2

### 1Q/2005 Performance Indicators

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

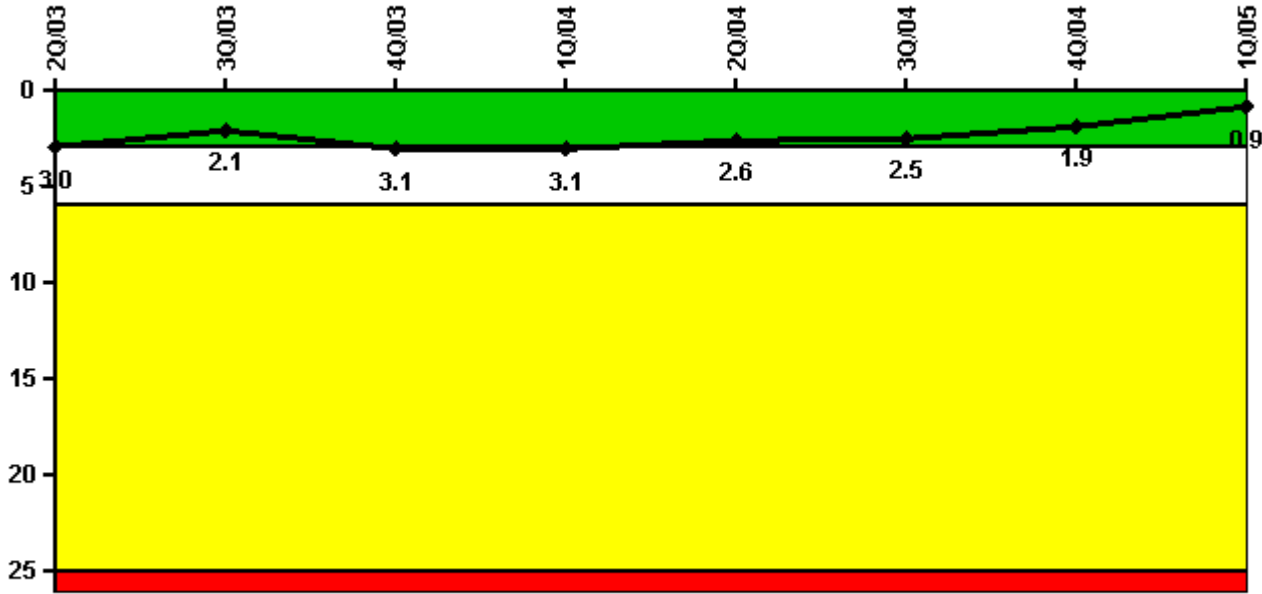


**Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0**

#### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Unplanned scrams	1.0	0	1.0	1.0	1.0	0	0	0
Critical hours	824.0	1832.1	2174.5	2052.7	2059.3	2208.0	1145.9	2135.0
Indicator value	3.0	2.1	3.1	3.1	2.6	2.5	1.9	0.9

Licensee Comments: none

### Scrams with Loss of Normal Heat Removal

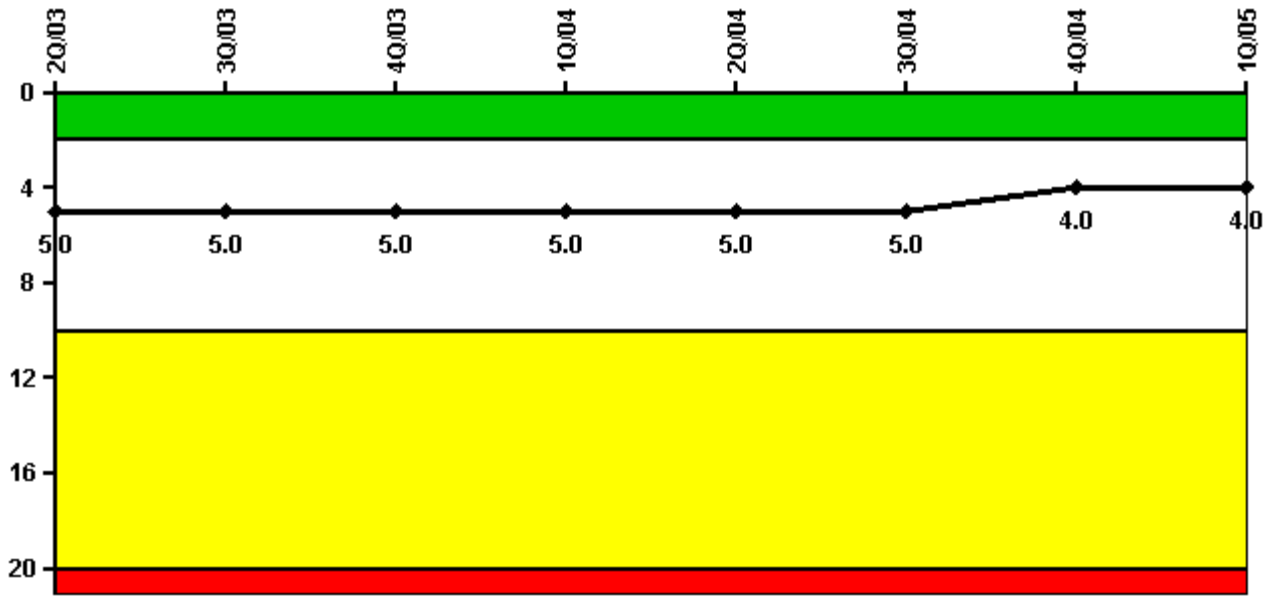


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

#### Notes

Scrams with Loss of Normal Heat Removal	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Scrams	1.0	0	0	0	0	0	0	0
Indicator value	5.0	5.0	5.0	5.0	5.0	5.0	4.0	4.0

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

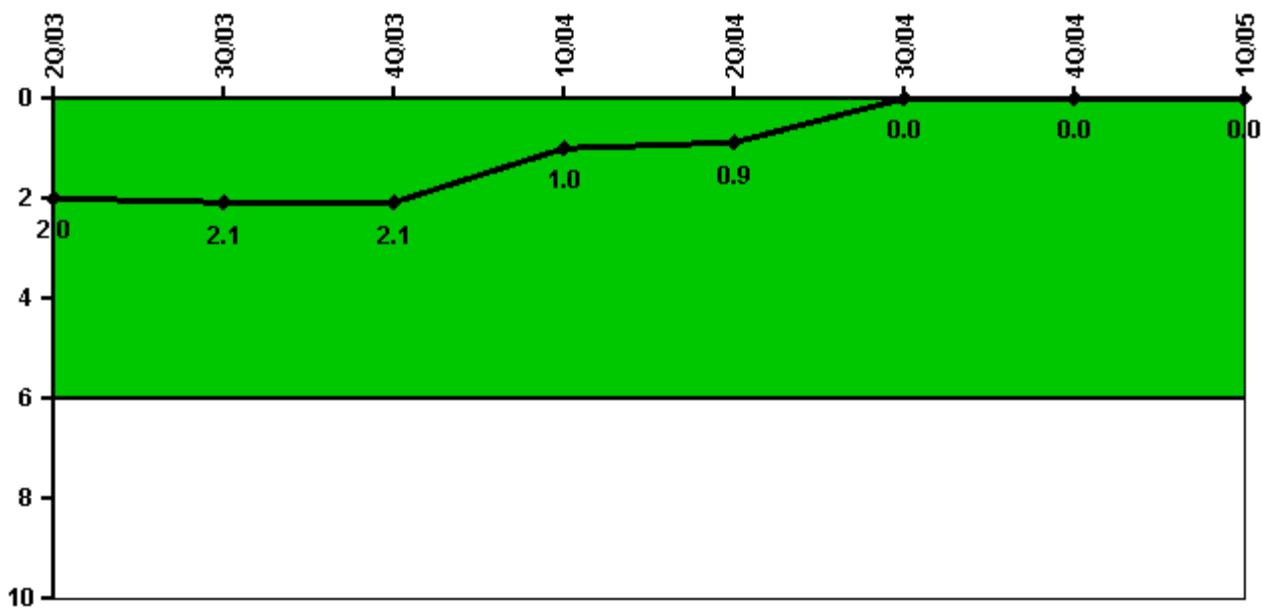


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Unplanned power changes	0	1.0	0	0	0	0	0	0
Critical hours	824.0	1832.1	2174.5	2052.7	2059.3	2208.0	1145.9	2135.0
<b>Indicator value</b>	<b>2.0</b>	<b>2.1</b>	<b>2.1</b>	<b>1.0</b>	<b>0.9</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Safety System Unavailability, Emergency AC Power

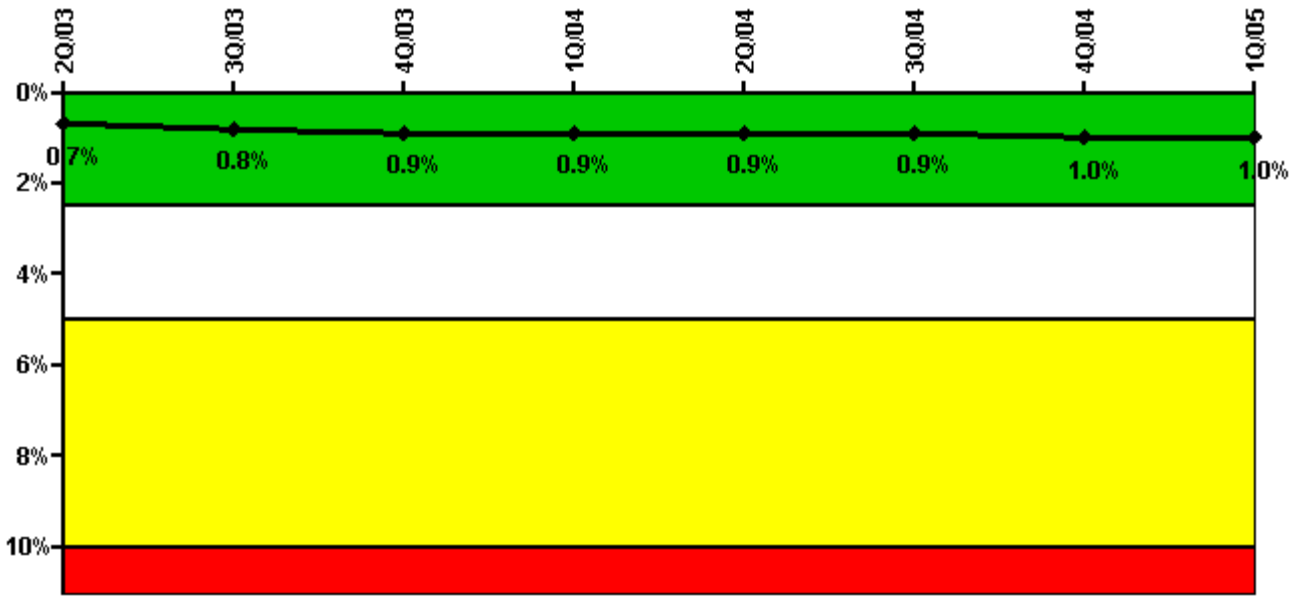


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

#### Notes

Safety System Unavailability, Emergency AC Power	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
<b>Train 1</b>								
Planned unavailable hours	0.32	21.99	1.14	18.54	16.29	4.19	18.91	0.90
Unplanned unavailable hours	0	8.63	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2185.00	2208.00	2209.00	2184.00	2183.00	2208.00	1504.18	2160.00
<b>Train 2</b>								
Planned unavailable hours	0.65	9.35	4.91	25.24	0.97	20.29	0.42	17.51
Unplanned unavailable hours	0	0	102.12	0.20	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1079.77	2208.00	2209.00	2184.00	2183.00	2208.00	1989.06	2160.00
<b>Indicator value</b>	<b>0.7%</b>	<b>0.8%</b>	<b>0.9%</b>	<b>0.9%</b>	<b>0.9%</b>	<b>0.9%</b>	<b>1.0%</b>	<b>1.0%</b>

Licensee Comments: none

### Safety System Unavailability, High Pressure Injection System (HPSI)

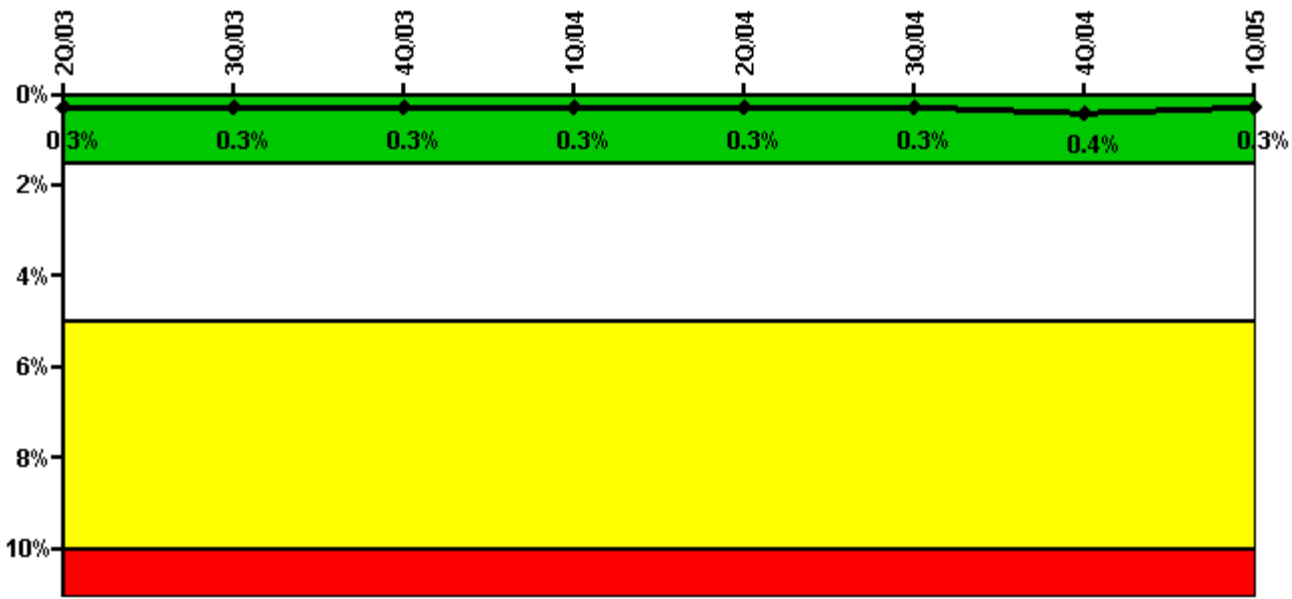


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

#### Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
<b>Train 1</b>								
Planned unavailable hours	3.33	8.58	0	13.35	0	16.75	28.03	0
Unplanned unavailable hours	64.58	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	927.64	2096.37	2209.00	2184.00	2183.00	2208.00	1239.60	2160.00
<b>Train 2</b>								
Planned unavailable hours	10.97	0	3.53	0	25.58	0	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1007.37	1886.30	2209.00	2184.00	2183.00	2208.00	1284.24	2160.00
<b>Train 3</b>								
Planned unavailable hours	0	0	0	0	0	0	4.17	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	912.07	1886.30	2209.00	2184.00	2183.00	2208.00	1239.60	2160.00
<b>Train 4</b>								
Planned unavailable hours	0	9.08	0	0	20.47	6.25	0	0
Unplanned unavailable hours	0	0	13.42	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	912.07	1886.30	2209.00	2184.00	2183.00	2208.00	1239.60	2160.00
<b>Indicator value</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.4%</b>	<b>0.3%</b>

Licensee Comments: none

### Safety System Unavailability, Heat Removal System (AFW)

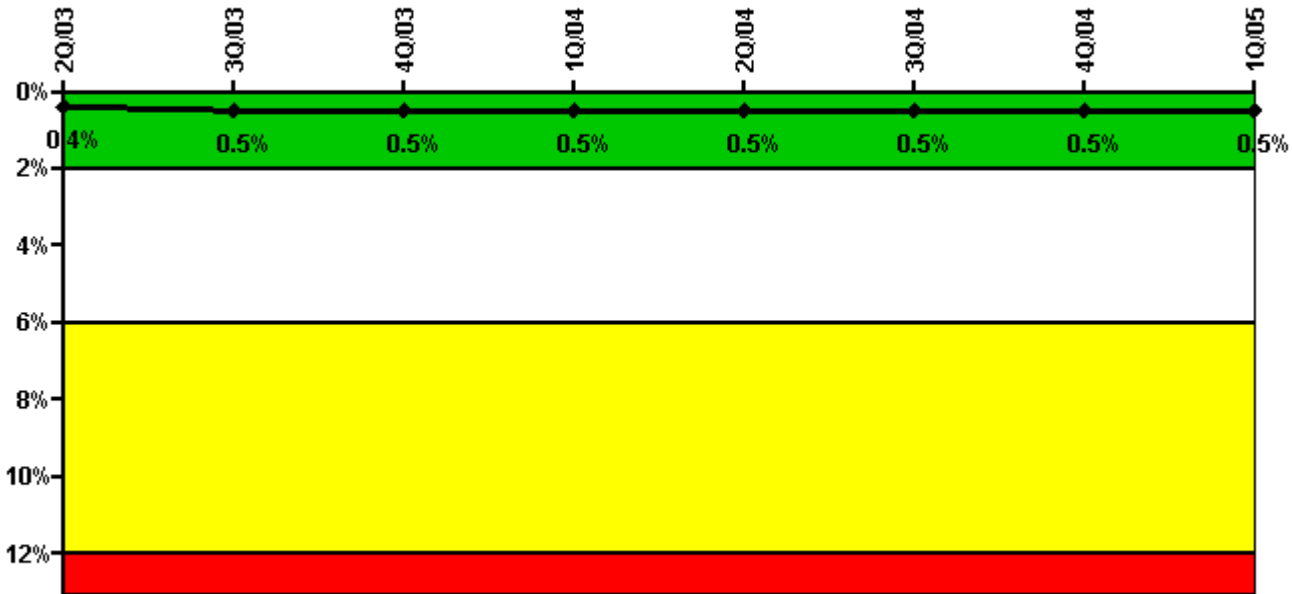


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

### Notes

Safety System Unavailability, Heat Removal System (AFW)	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
<b>Train 1</b>								
Planned unavailable hours	0	6.05	4.62	0	11.75	0.55	3.58	8.17
Unplanned unavailable hours	0	0	0.05	0	0	0	0	1.08
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	912.07	1886.30	2209.00	2184.00	2183.00	2208.00	1239.60	2160.00
<b>Train 2</b>								
Planned unavailable hours	0	0	0	5.53	0	17.27	0	11.05
Unplanned unavailable hours	0	0	0.07	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	912.07	1886.30	2209.00	2184.00	2183.00	2208.00	1239.60	2160.00
<b>Train 3</b>								
Planned unavailable hours	0	0	20.90	0	16.00	13.47	0	32.35
Unplanned unavailable hours	0	0	0	0	8.35	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	912.07	1886.30	2209.00	2184.00	2183.00	2208.00	1239.60	2160.00
<b>Indicator value</b>	<b>0.4%</b>	<b>0.5%</b>	<b>0.5%</b>	<b>0.5%</b>	<b>0.5%</b>	<b>0.5%</b>	<b>0.5%</b>	<b>0.5%</b>

Licensee Comments: none

### Safety System Unavailability, Residual Heat Removal System

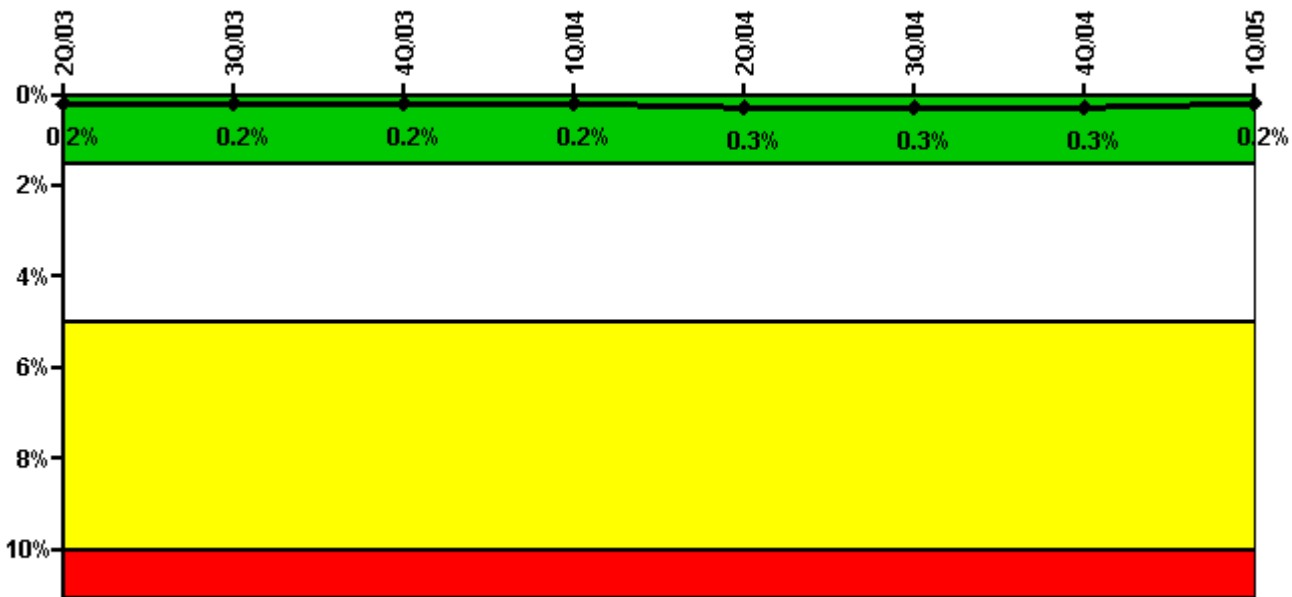


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

#### Notes

Safety System Unavailability, Residual Heat Removal System	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
<b>Train 1</b>								
Planned unavailable hours	0	0	0	0	17.28	4.48	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1838.30	2208.00	2209.00	2184.00	2183.00	2208.00	1933.22	2160.00
<b>Train 2</b>								
Planned unavailable hours	0	10.67	14.18	0	8.15	5.30	4.20	0
Unplanned unavailable hours	0	0	17.45	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1838.30	2208.00	2209.00	2184.00	2183.00	2208.00	1933.22	2160.00
<b>Indicator value</b>	<b>0.2%</b>	<b>0.2%</b>	<b>0.2%</b>	<b>0.2%</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.3%</b>	<b>0.2%</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

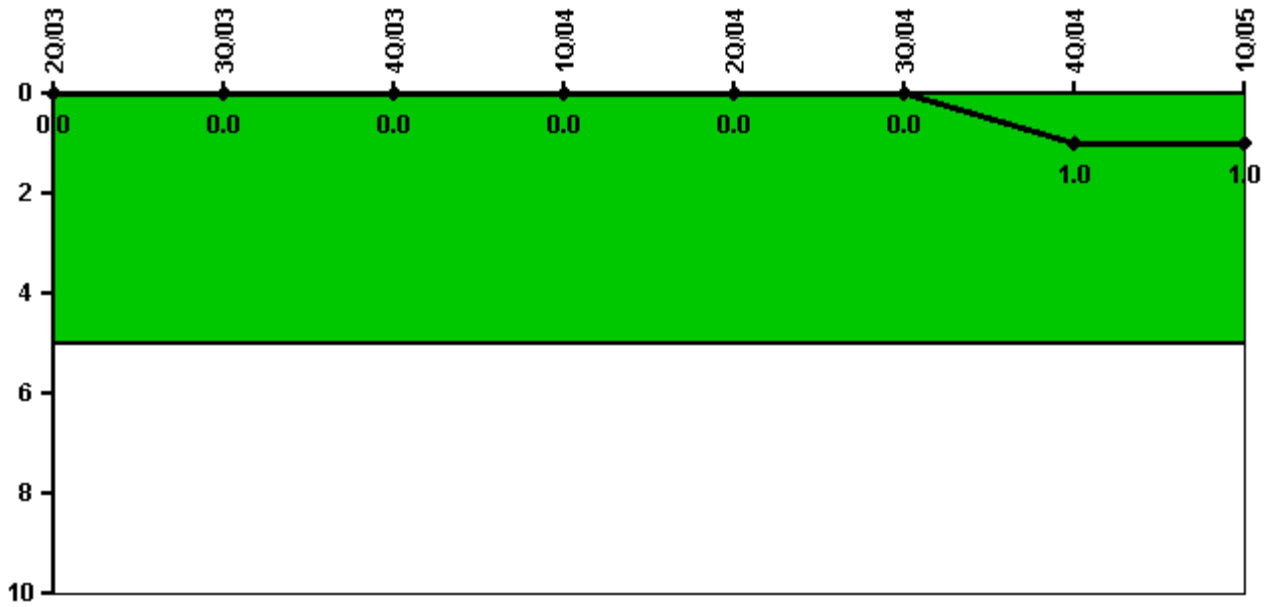

Thresholds: White > 5.0


#### Notes

Safety System Functional Failures (PWR)	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Safety System Functional Failures	0	0	0	0	0	0	1	0
Indicator value	0	0	0	0	0	0	1	1

Licensee Comments: none



### Reactor Coolant System Activity

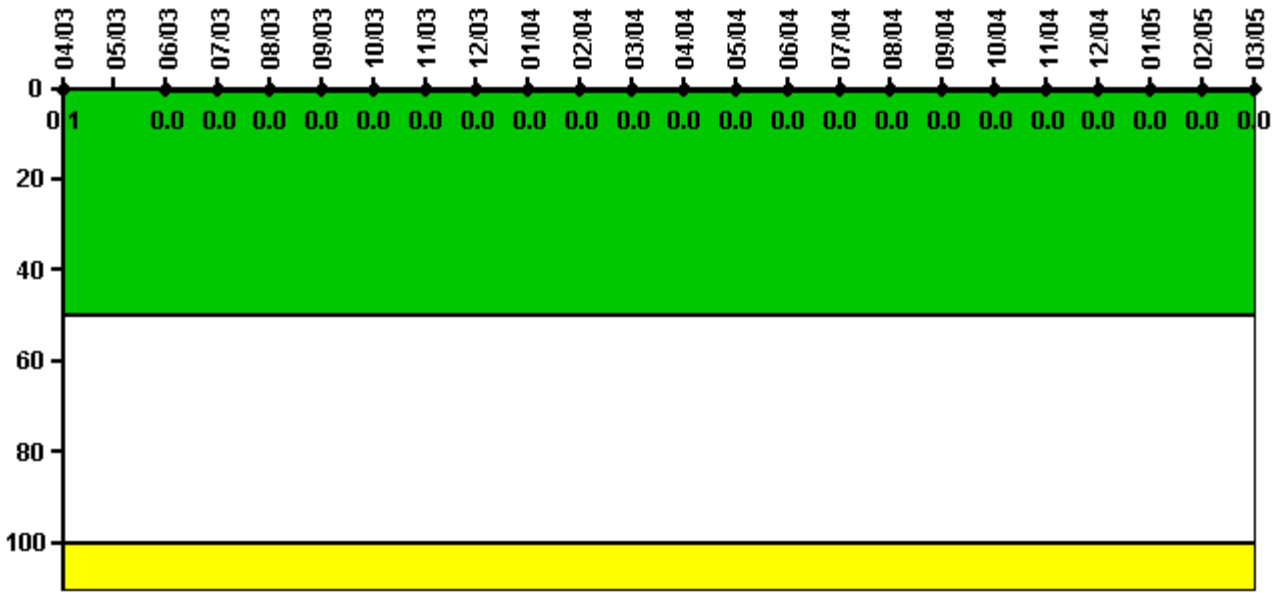

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	4/03	5/03	6/03	7/03	8/03	9/03	10/03	11/03	12/03	1/04	2/04	3/04
Maximum activity	0.001070	N/A	0.000159	0.000217	0.000175	0.000188	0.000196	0.000201	0.000215	0.000219	0.000242	0.000243
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	N/A	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/04	5/04	6/04	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05
Maximum activity	0.000385	0.000247	0.000261	0.000283	0.000269	0.000469	0.000241	0.000136	0.000140	0.000150	0.000378	0.000345
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

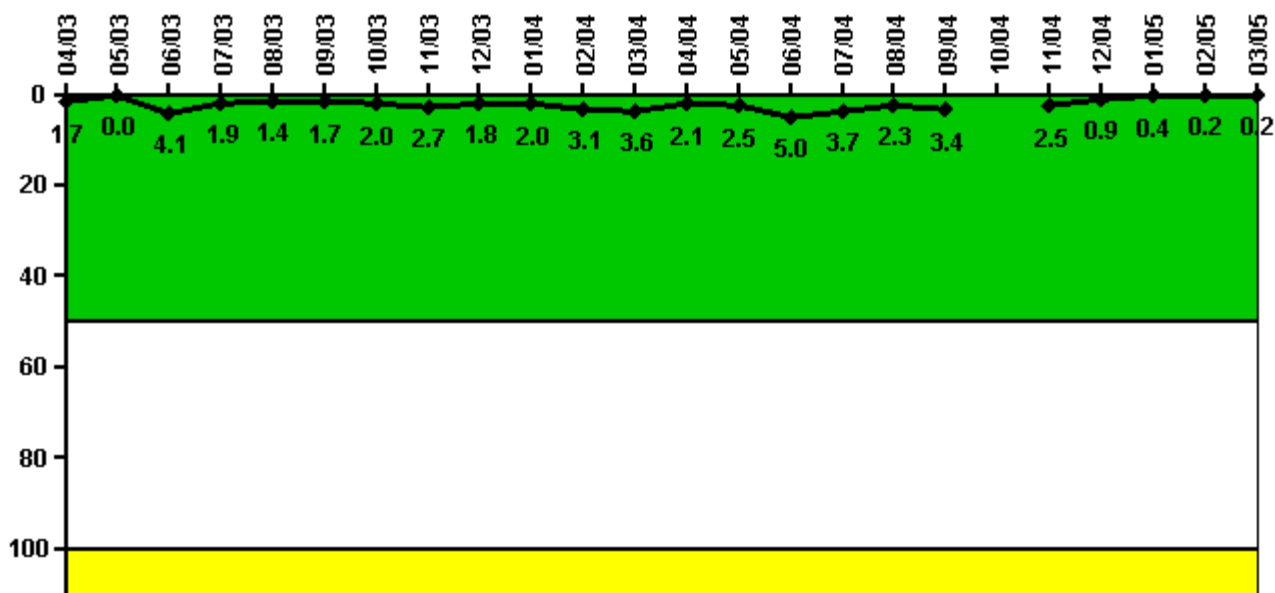


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	4/03	5/03	6/03	7/03	8/03	9/03	10/03	11/03	12/03	1/04	2/04	3/04
Maximum leakage	0.184	0	0.450	0.211	0.152	0.190	0.220	0.294	0.193	0.225	0.336	0.399
Technical specification limit	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0
Indicator value	1.7	0	4.1	1.9	1.4	1.7	2.0	2.7	1.8	2.0	3.1	3.6
Reactor Coolant System Leakage	4/04	5/04	6/04	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05
Maximum leakage	0.226	0.276	0.551	0.408	0.257	0.369	N/A	0.274	0.096	0.039	0.020	0.019
Technical specification limit	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0	11.0
Indicator value	2.1	2.5	5.0	3.7	2.3	3.4	N/A	2.5	0.9	0.4	0.2	0.2

Licensee Comments: none

### Drill/Exercise Performance

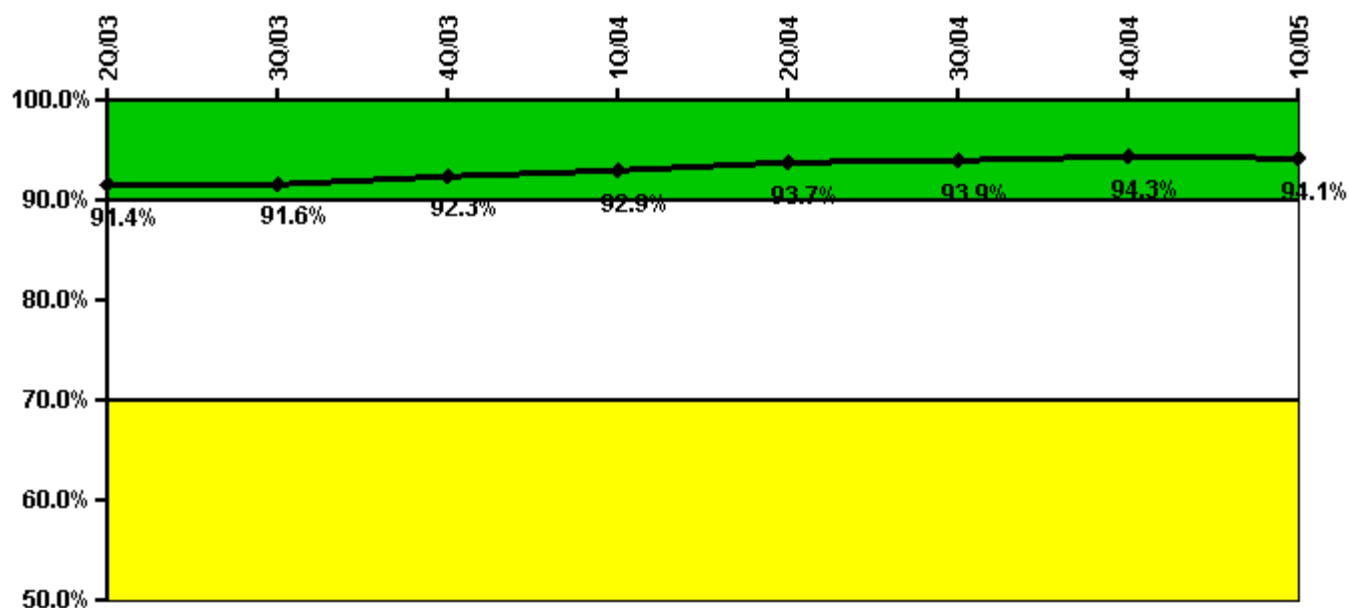

Thresholds: White < 90.0% Yellow < 70.0%


#### Notes

Drill/Exercise Performance	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Successful opportunities	30.0	176.0	83.0	132.0	83.0	74.0	67.0	89.0
Total opportunities	33.0	192.0	90.0	137.0	89.0	78.0	68.0	93.0
Indicator value	91.4%	91.6%	92.3%	92.9%	93.7%	93.9%	94.3%	94.1%

Licensee Comments:

4Q/04: The December data was updated to capture 6 previously uncounted performance opportunities.

### ERO Drill Participation

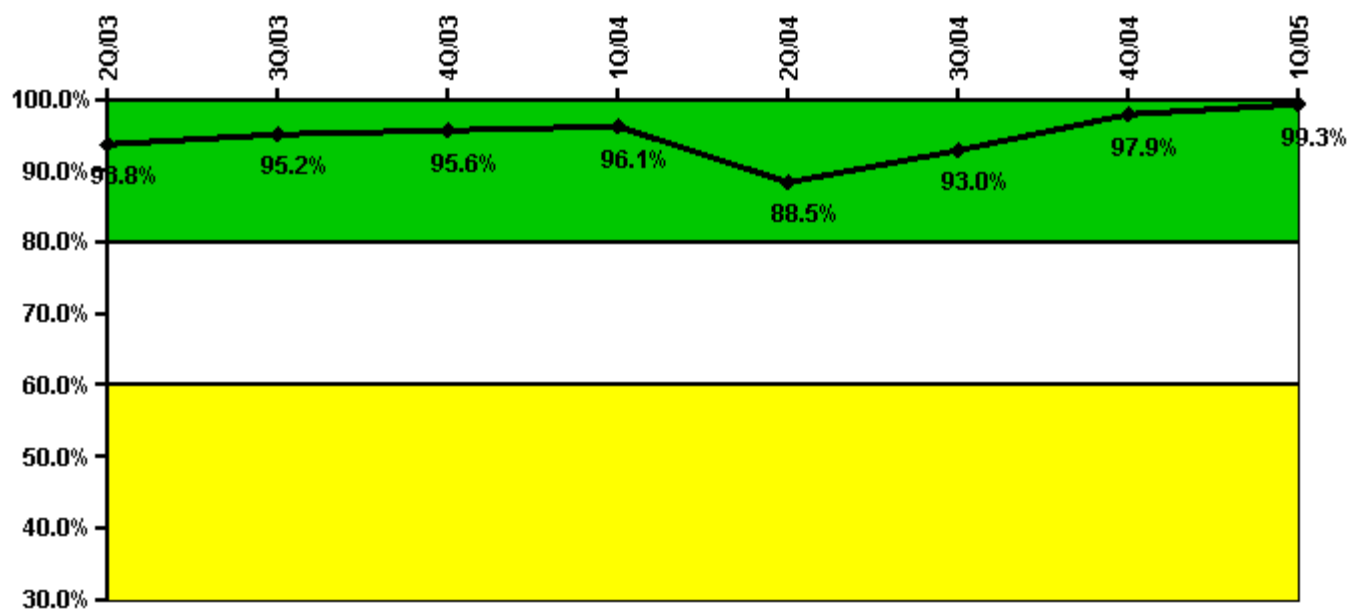


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Participating Key personnel	135.0	138.0	129.0	124.0	131.0	133.0	138.0	151.0
Total Key personnel	144.0	145.0	135.0	129.0	148.0	143.0	141.0	152.0
Indicator value	93.8%	95.2%	95.6%	96.1%	88.5%	93.0%	97.9%	99.3%

Licensee Comments: none

### Alert & Notification System

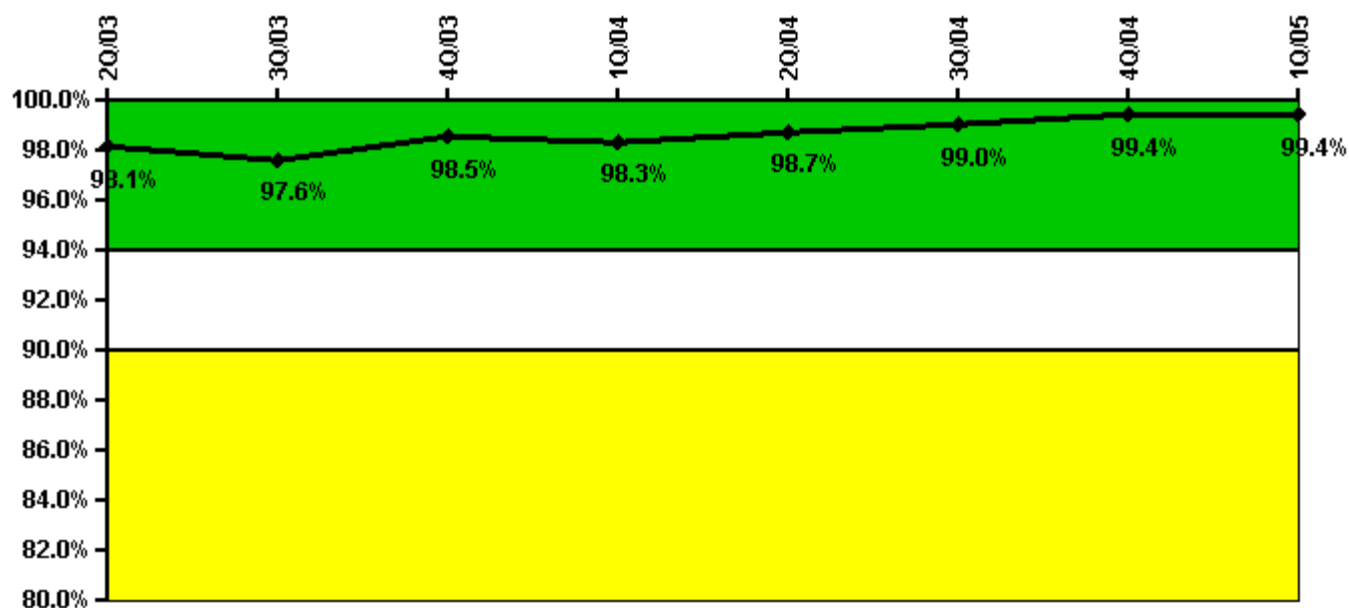


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
Successful siren-tests	205	205	207	209	208	208	210	209
Total sirens-tests	210	210	210	210	210	210	210	210
Indicator value	98.1%	97.6%	98.5%	98.3%	98.7%	99.0%	99.4%	99.4%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

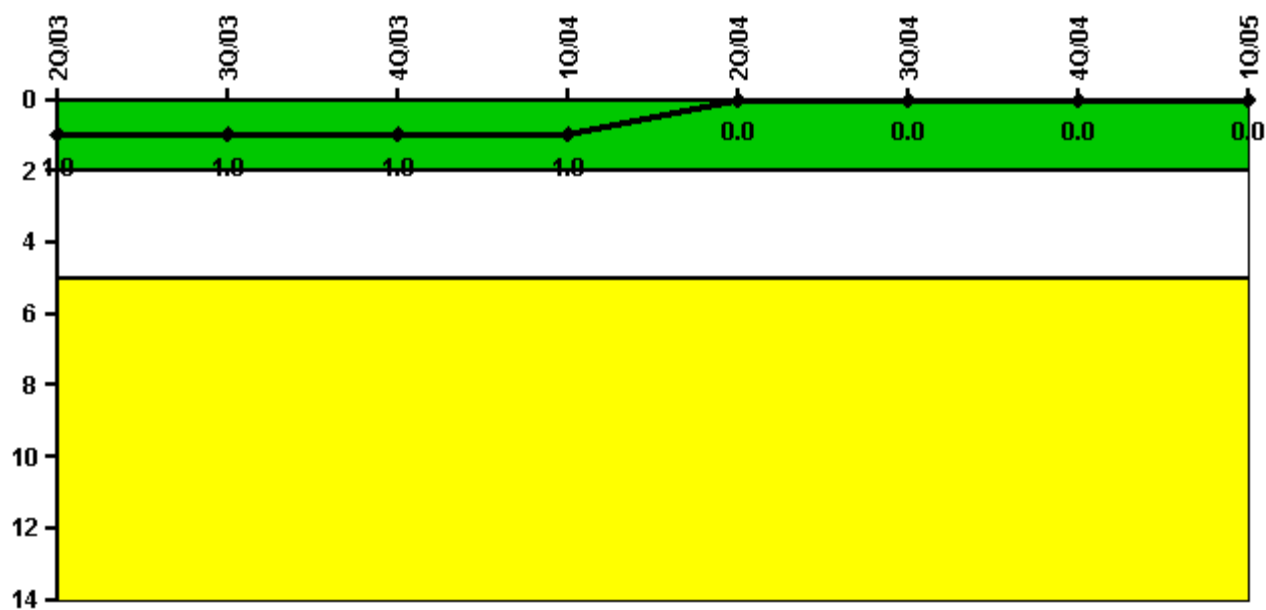

Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	1	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	2Q/03	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: June 17, 2005