


Ginna

2Q/2005 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

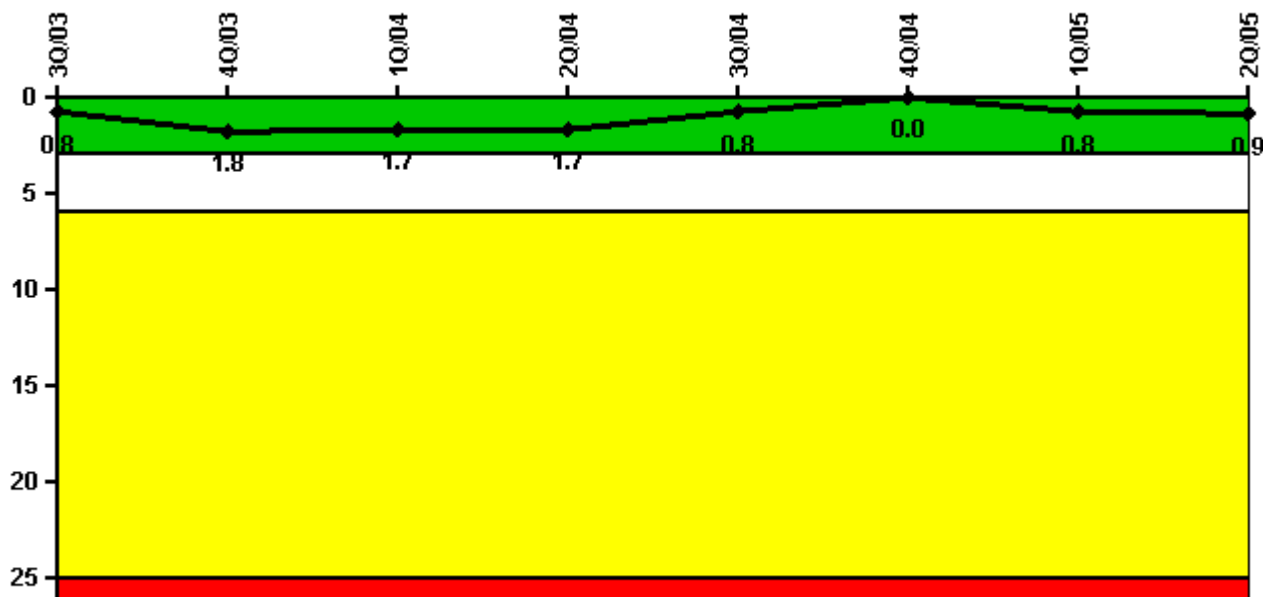


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Unplanned scrams	1.0	1.0	0	0	0	0	1.0	0
Critical hours	1761.8	1876.5	2184.0	2183.0	2208.0	2163.6	1857.5	1953.7
Indicator value	0.8	1.8	1.7	1.7	0.8	0	0.8	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

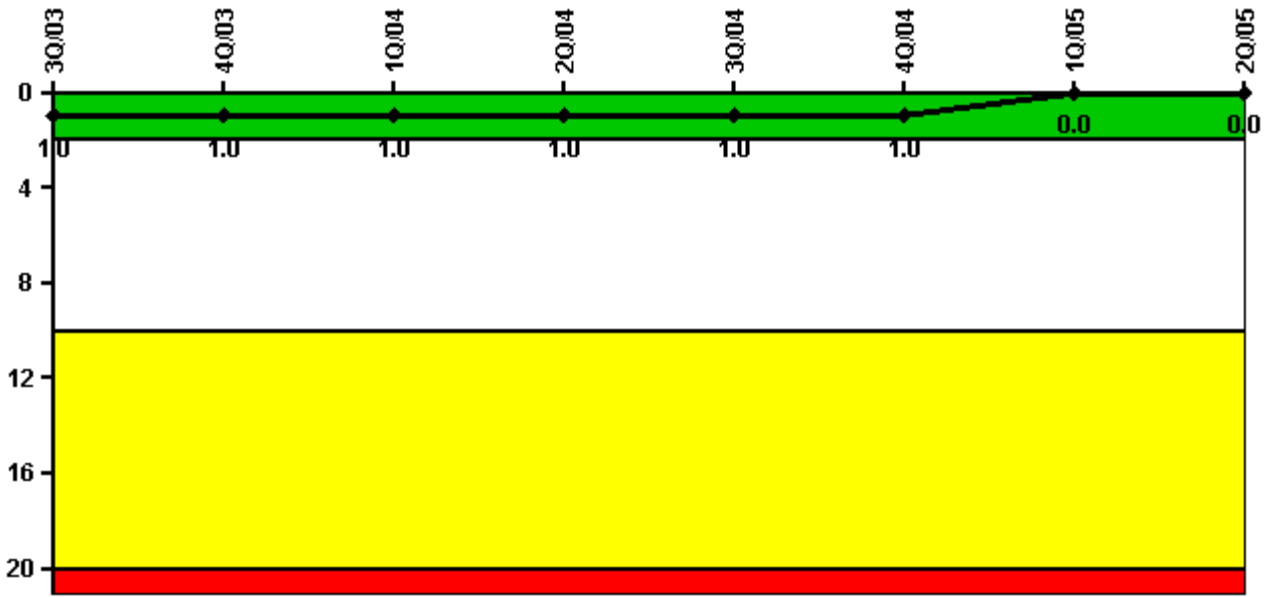


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Scrams	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	1.0	1.0	1.0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

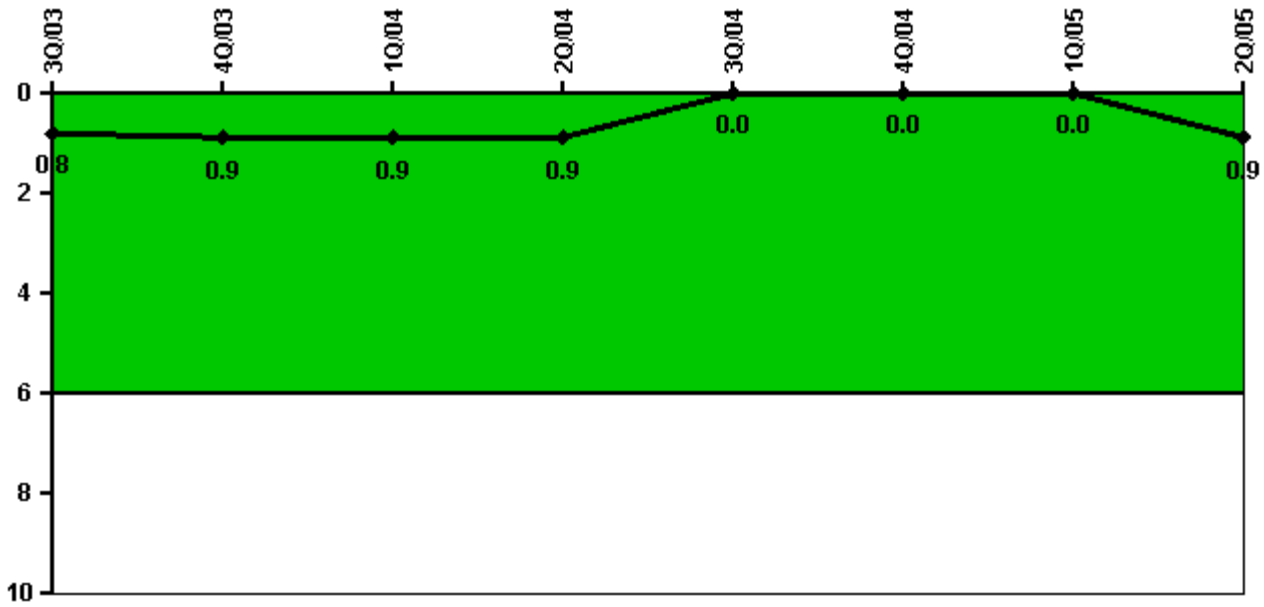


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Unplanned power changes	1.0	0	0	0	0	0	0	1.0
Critical hours	1761.8	1876.5	2184.0	2183.0	2208.0	2163.6	1857.5	1953.7
Indicator value	0.8	0.9	0.9	0.9	0	0	0	0.9

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

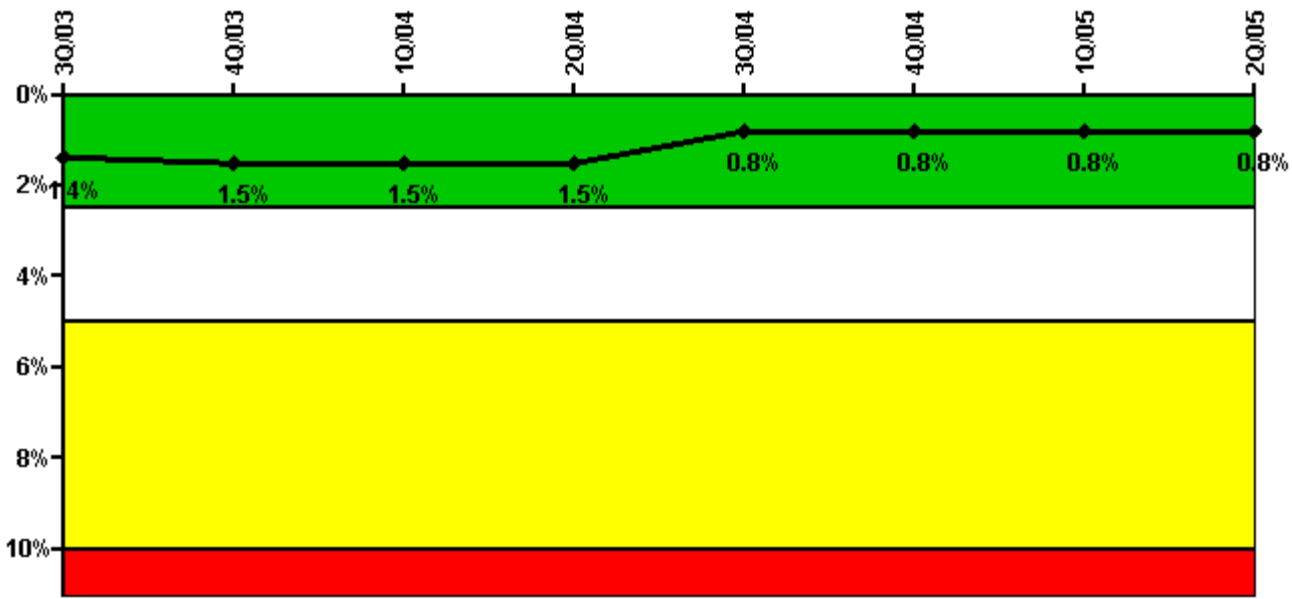


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Train 1								
Planned unavailable hours	6.40	49.50	19.70	11.10	8.90	36.90	12.30	8.50
Unplanned unavailable hours	0	0	4.90	0	0	0	0	3.10
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00	2183.00
Train 2								
Planned unavailable hours	11.70	24.80	20.30	8.50	11.40	29.60	11.40	10.70
Unplanned unavailable hours	8.20	0	0	0	0	0	0	17.00
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00	2183.00
Indicator value	1.4%	1.5%	1.5%	1.5%	0.8%	0.8%	0.8%	0.8%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

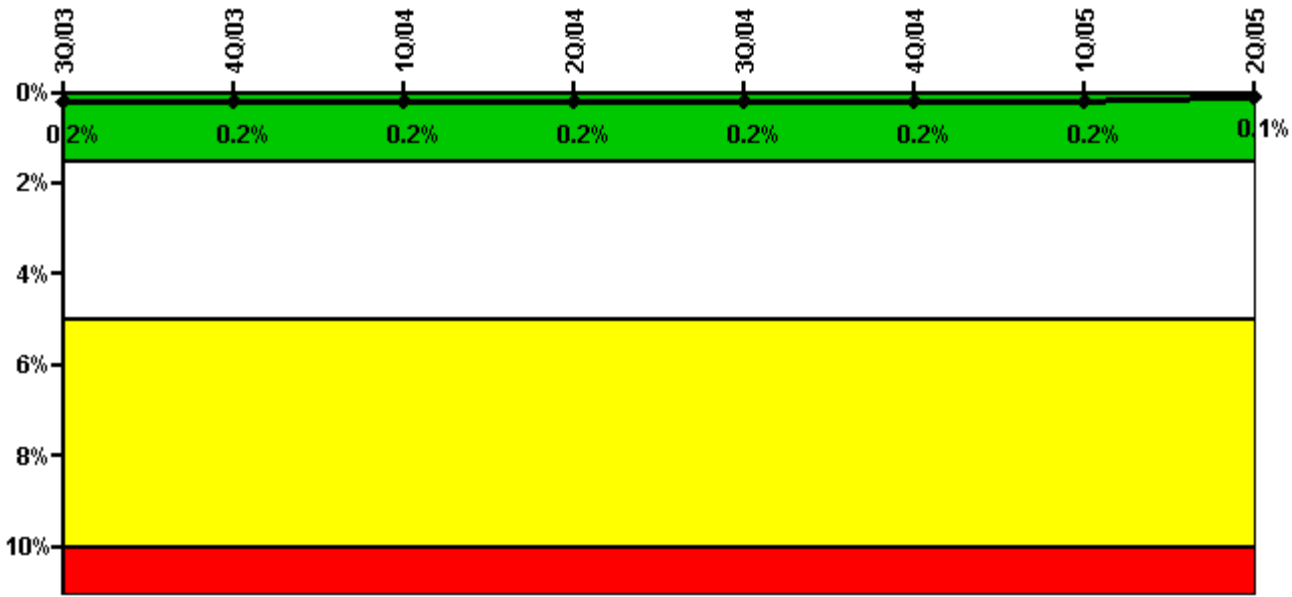


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Train 1								
Planned unavailable hours	0	5.91	0	0	5.23	0.18	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1872.00	1968.00	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Train 2								
Planned unavailable hours	6.83	1.28	9.92	0	5.88	0.20	0	7.25
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1872.00	1968.00	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Train 3								
Planned unavailable hours	0.22	4.75	0.25	1.03	0.85	13.28	0	3.83
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1872.00	1968.00	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Indicator value	0.2%	0.2%	0.2%	0.2%	0.2%	0.2%	0.2%	0.1%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

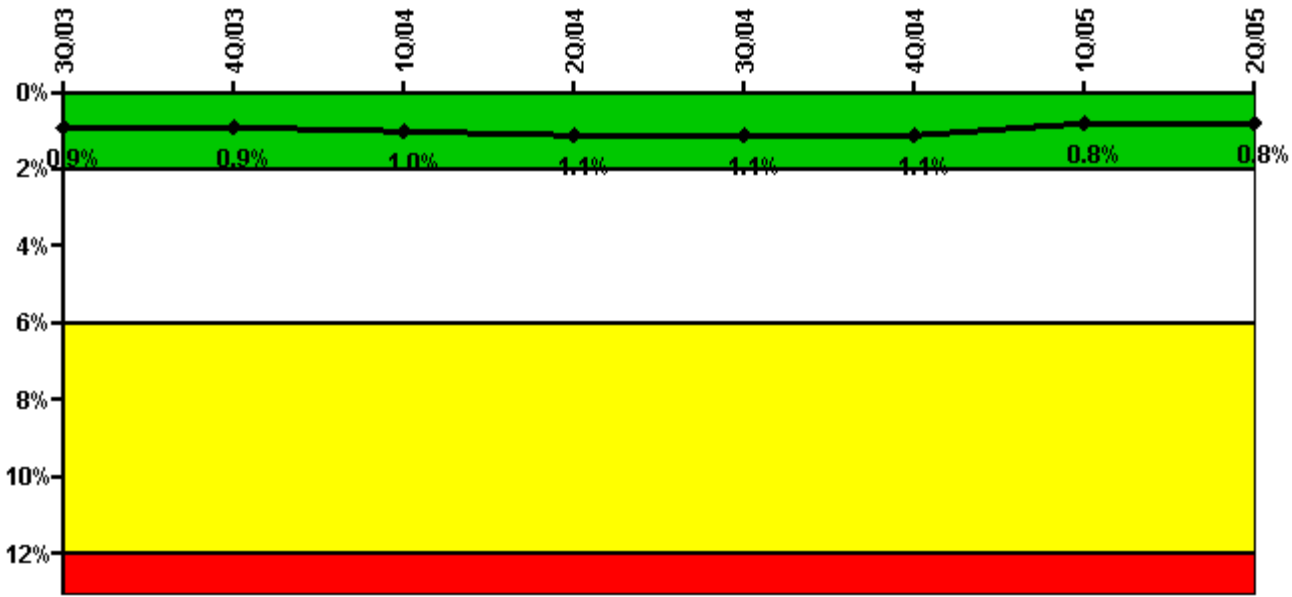

Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%


Notes

Safety System Unavailability, Heat Removal System (AFW)	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Train 1								
Planned unavailable hours	2.42	0	0	8.88	0	8.05	0	0
Unplanned unavailable hours	81.69	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1837.12	1907.67	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Train 2								
Planned unavailable hours	17.69	0	10.28	0	0	0	0	0
Unplanned unavailable hours	102.31	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1837.12	1907.67	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Train 3								
Planned unavailable hours	11.05	7.27	9.40	3.63	0	15.30	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	59.78	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1837.12	1907.67	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Train 4								
Planned unavailable hours	31.00	2.49	82.83	0	0	0	0	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1837.12	1907.67	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Train 5								
Planned unavailable hours	78.25	0	64.97	9.00	0	0	0	0
Unplanned unavailable hours	0	0	0	123.10	0	0	0	0

Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	1837.12	1907.67	2184.00	2183.00	2208.00	2163.58	1857.48	1953.67
Indicator value	0.9%	0.9%	1.0%	1.1%	1.1%	1.1%	0.8%	0.8%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

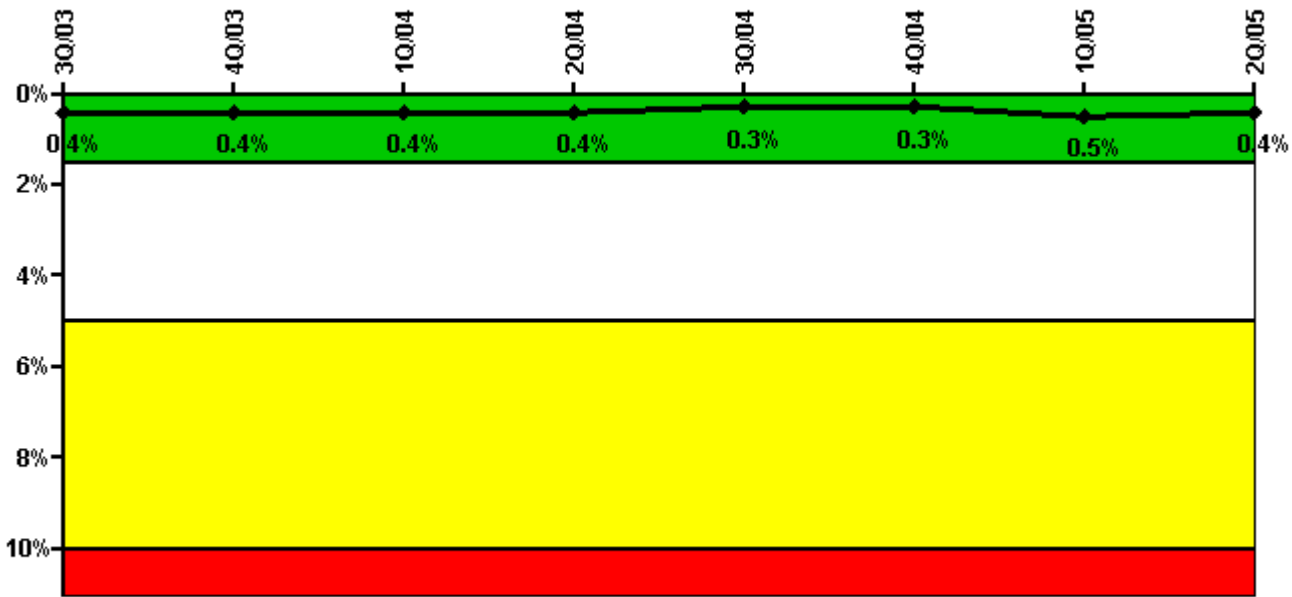


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Train 1								
Planned unavailable hours	0.83	8.62	1.56	4.02	1.78	1.79	47.63	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00	2183.00
Train 2								
Planned unavailable hours	15.42	8.15	8.90	3.17	1.45	1.77	36.33	0
Unplanned unavailable hours	15.55	0	0	0	0	0	0	1.43
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2208.00	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00	2183.00
Indicator value	0.4%	0.4%	0.4%	0.4%	0.3%	0.3%	0.5%	0.4%

Licensee Comments: none

Safety System Functional Failures (PWR)

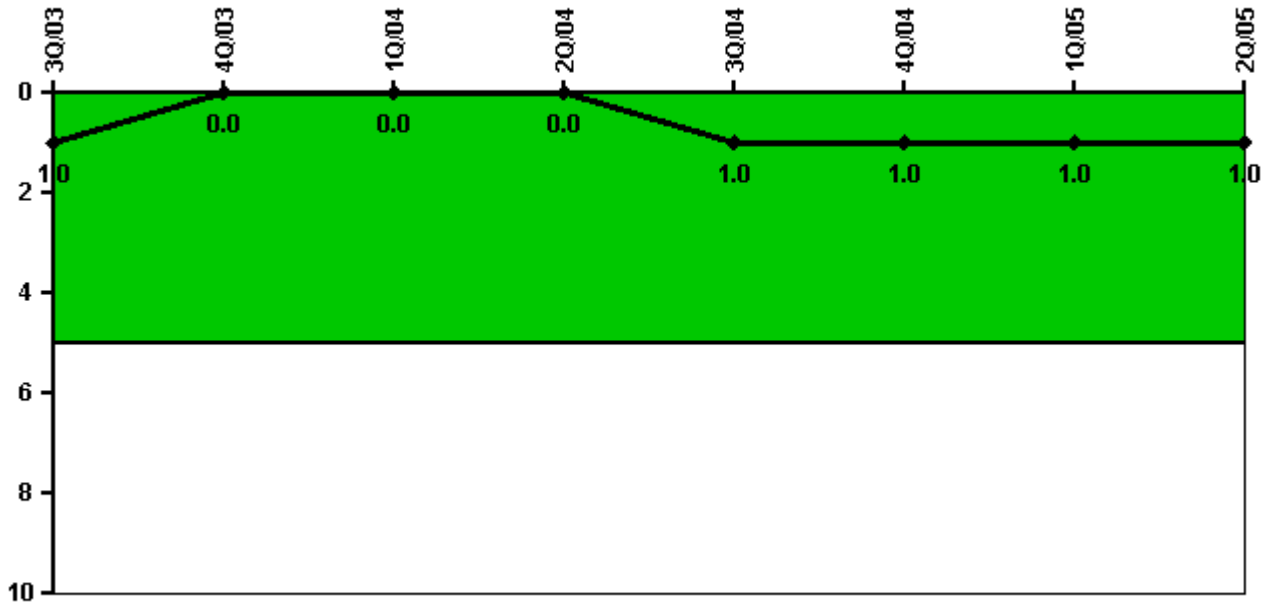


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Safety System Functional Failures	0	0	0	0	1	0	0	0
Indicator value	1	0	0	0	1	1	1	1

Licensee Comments: none

Reactor Coolant System Activity

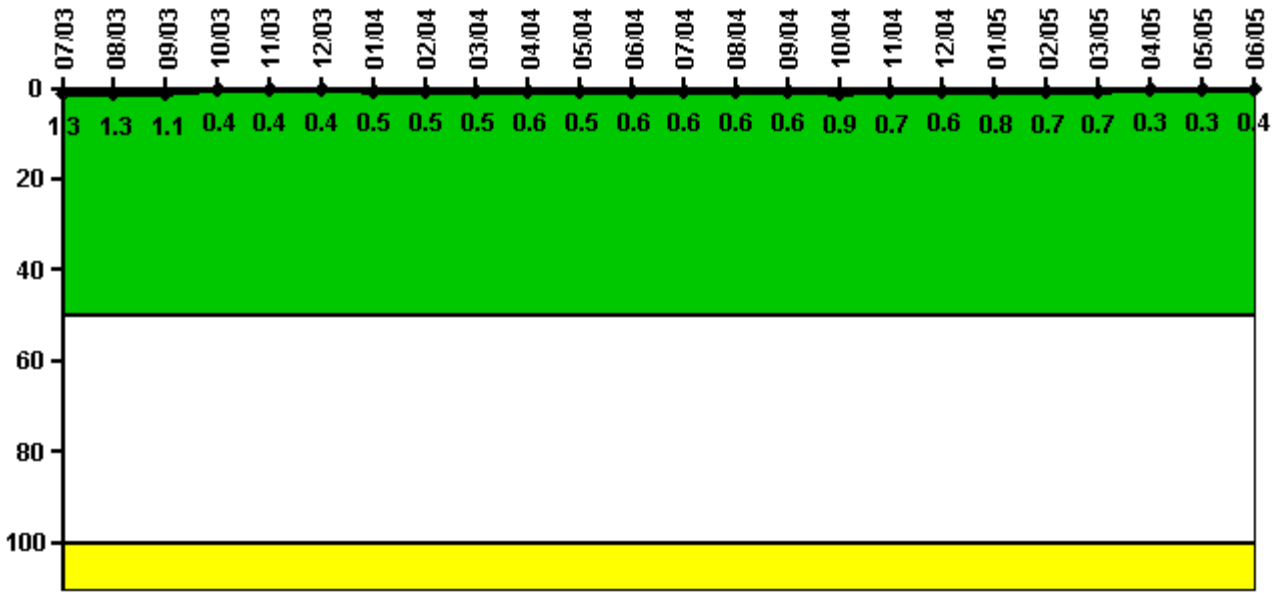


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/03	8/03	9/03	10/03	11/03	12/03	1/04	2/04	3/04	4/04	5/04	6/04
Maximum activity	0.008200	0.008480	0.007270	0.002740	0.002390	0.002690	0.002950	0.003110	0.003180	0.003930	0.003300	0.003600
Technical specification limit	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
Indicator value	1.3	1.3	1.1	0.4	0.4	0.4	0.5	0.5	0.5	0.6	0.5	0.6
Reactor Coolant System Activity	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05	4/05	5/05	6/05
Maximum activity	0.003860	0.004120	0.003660	0.005930	0.004560	0.003870	0.005020	0.004450	0.004530	0.001750	0.001830	0.002280
Technical specification limit	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
Indicator value	0.6	0.6	0.6	0.9	0.7	0.6	0.8	0.7	0.7	0.3	0.3	0.4

Licensee Comments: none

Reactor Coolant System Leakage

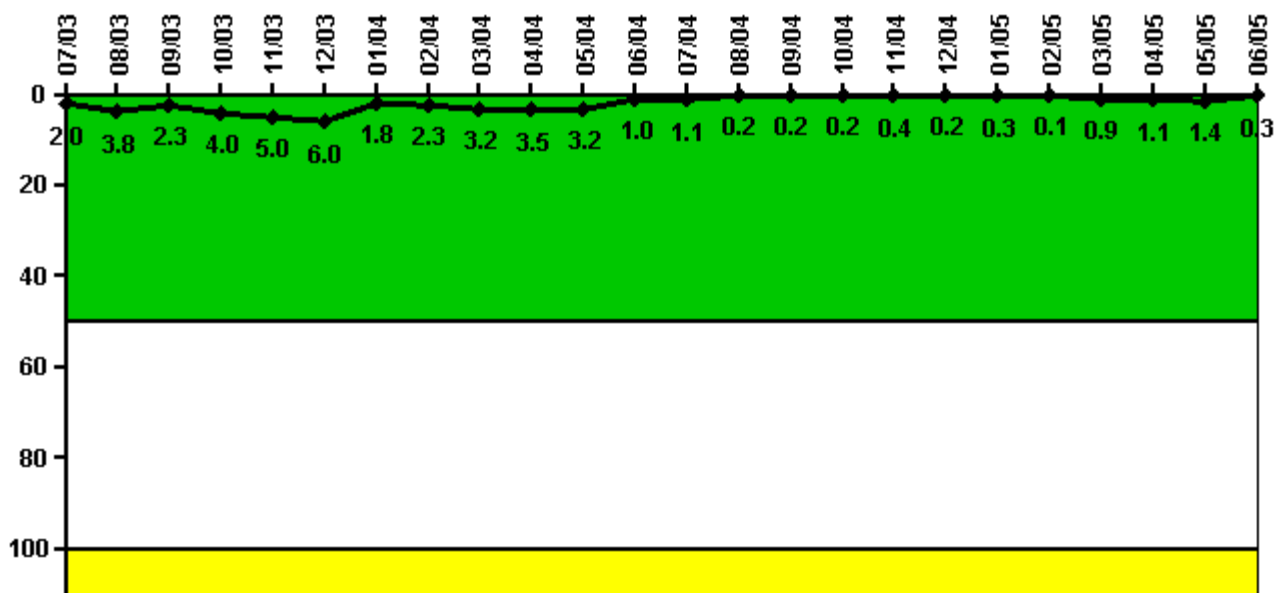

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	7/03	8/03	9/03	10/03	11/03	12/03	1/04	2/04	3/04	4/04	5/04	6/04
Maximum leakage	0.201	0.383	0.226	0.400	0.502	0.602	0.180	0.230	0.315	0.345	0.315	0.097
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.0	3.8	2.3	4.0	5.0	6.0	1.8	2.3	3.2	3.5	3.2	1.0

Reactor Coolant System Leakage	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05	4/05	5/05	6/05
Maximum leakage	0.105	0.019	0.018	0.020	0.036	0.023	0.027	0.014	0.090	0.114	0.140	0.031
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.1	0.2	0.2	0.2	0.4	0.2	0.3	0.1	0.9	1.1	1.4	0.3

Licensee Comments: none

Drill/Exercise Performance

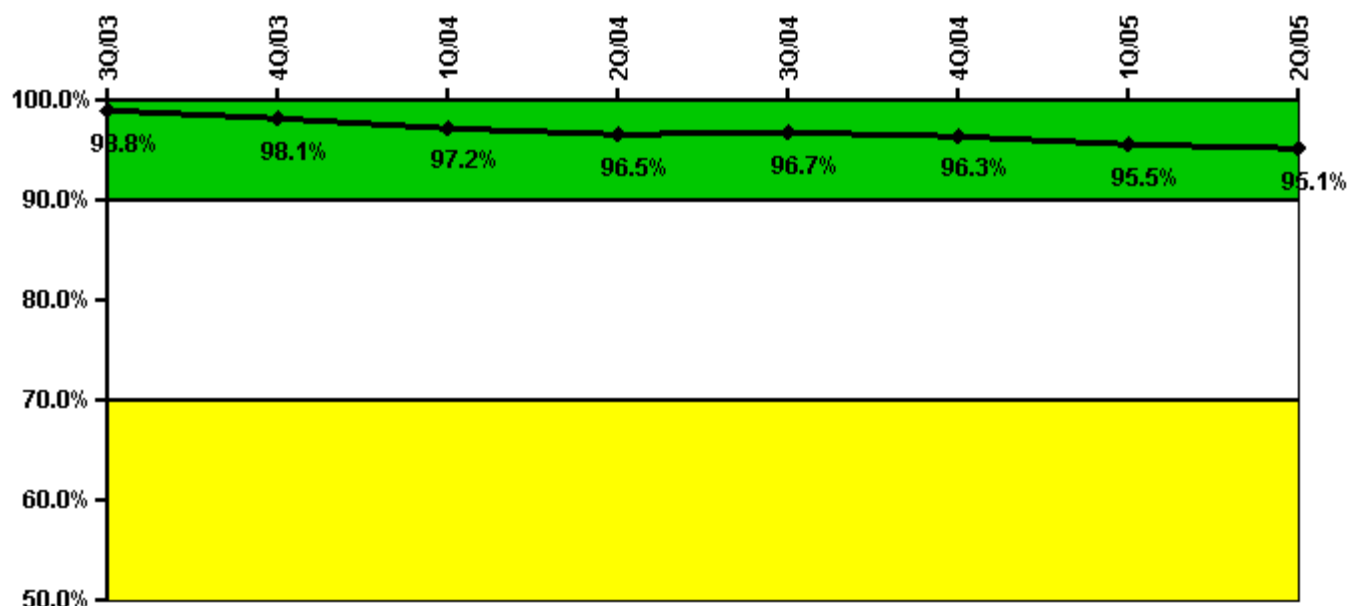


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Successful opportunities	10.0	47.0	84.0	47.0	43.0	45.0	36.0	35.0
Total opportunities	10.0	50.0	88.0	51.0	43.0	46.0	39.0	38.0
Indicator value	98.8%	98.1%	97.2%	96.5%	96.7%	96.3%	95.5%	95.1%

Licensee Comments: none

ERO Drill Participation

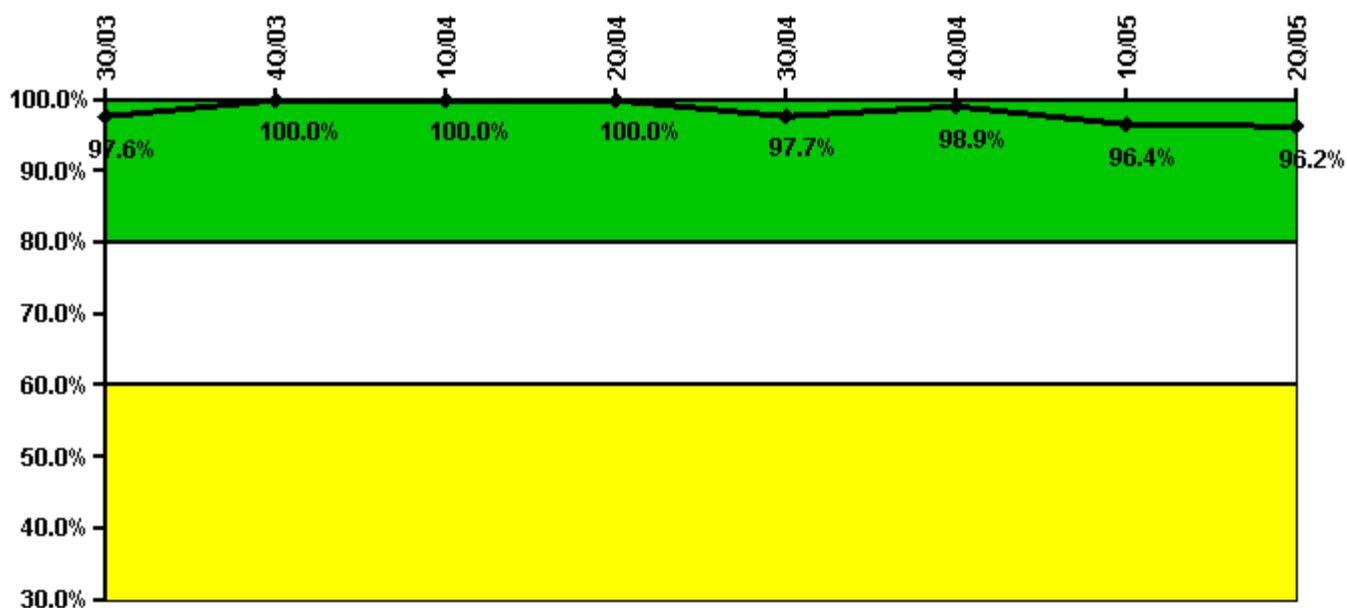


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Participating Key personnel	81.0	83.0	80.0	77.0	86.0	87.0	81.0	75.0
Total Key personnel	83.0	83.0	80.0	77.0	88.0	88.0	84.0	78.0
Indicator value	97.6%	100.0%	100.0%	100.0%	97.7%	98.9%	96.4%	96.2%

Licensee Comments: none

Alert & Notification System

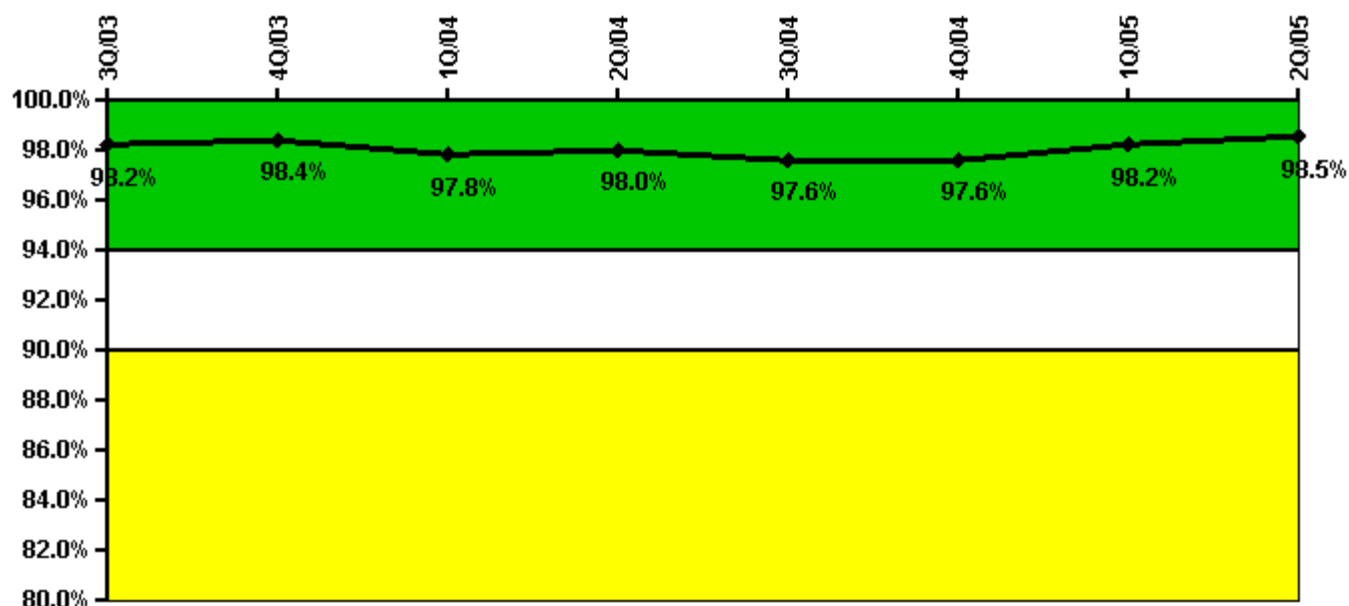


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
Successful siren-tests	1227	1231	1209	1224	1206	1140	1333	1237
Total sirens-tests	1248	1248	1248	1248	1248	1152	1344	1248
Indicator value	98.2%	98.4%	97.8%	98.0%	97.6%	97.6%	98.2%	98.5%

Licensee Comments: none

Occupational Exposure Control Effectiveness

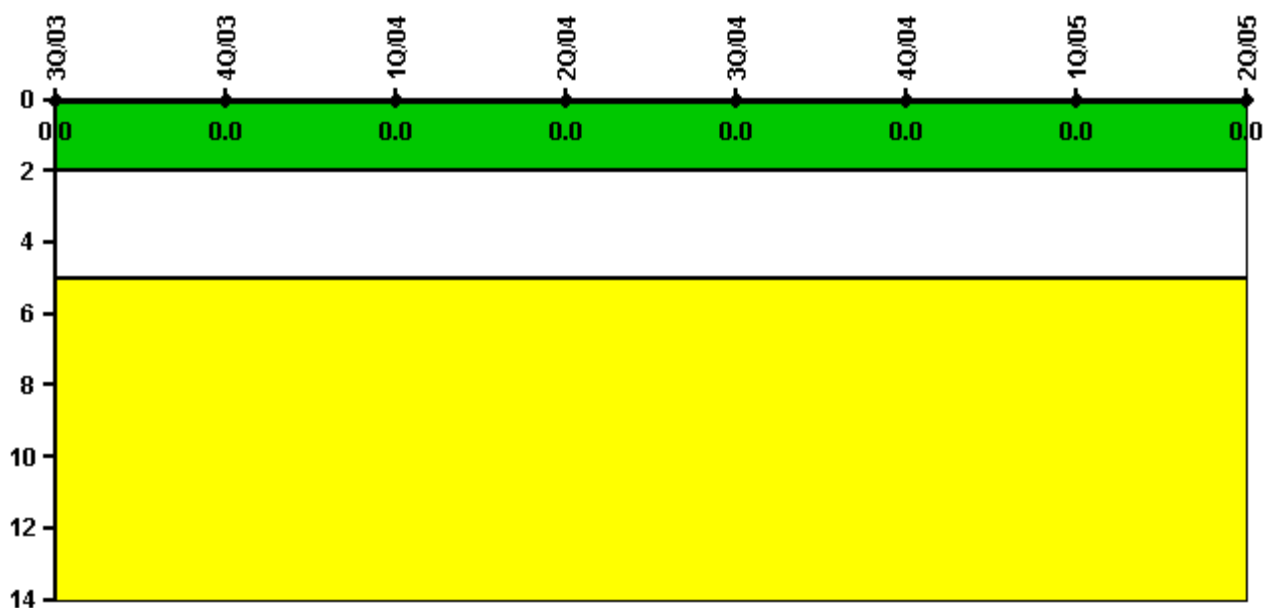


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

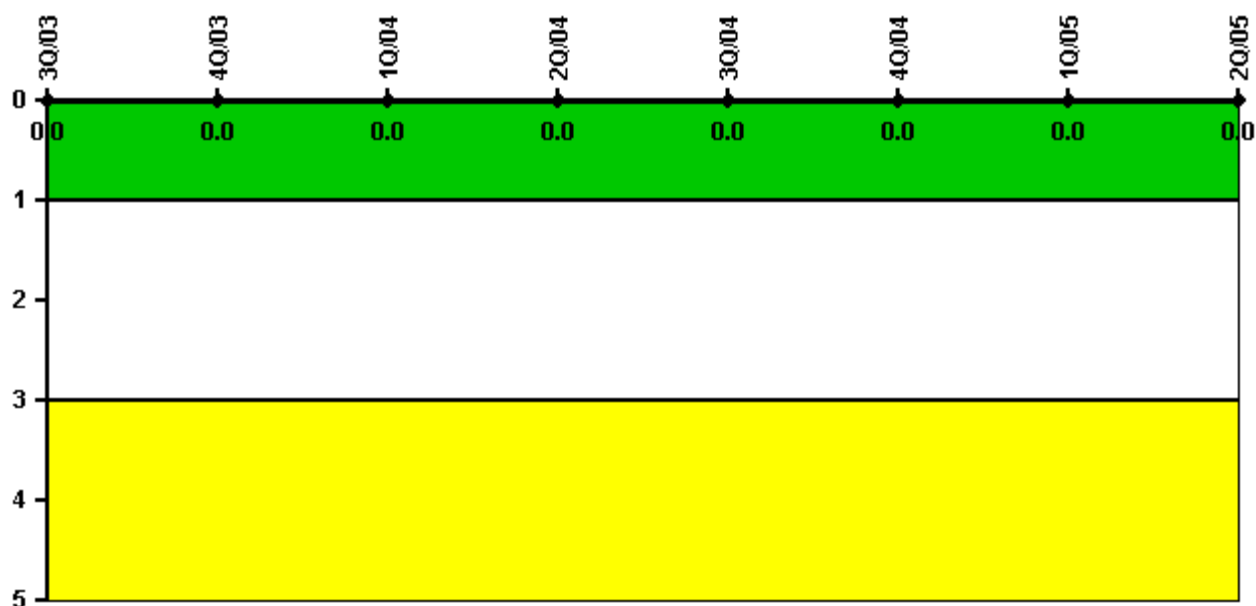

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/03	4Q/03	1Q/04	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.