


Susquehanna 2

4Q/2006 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

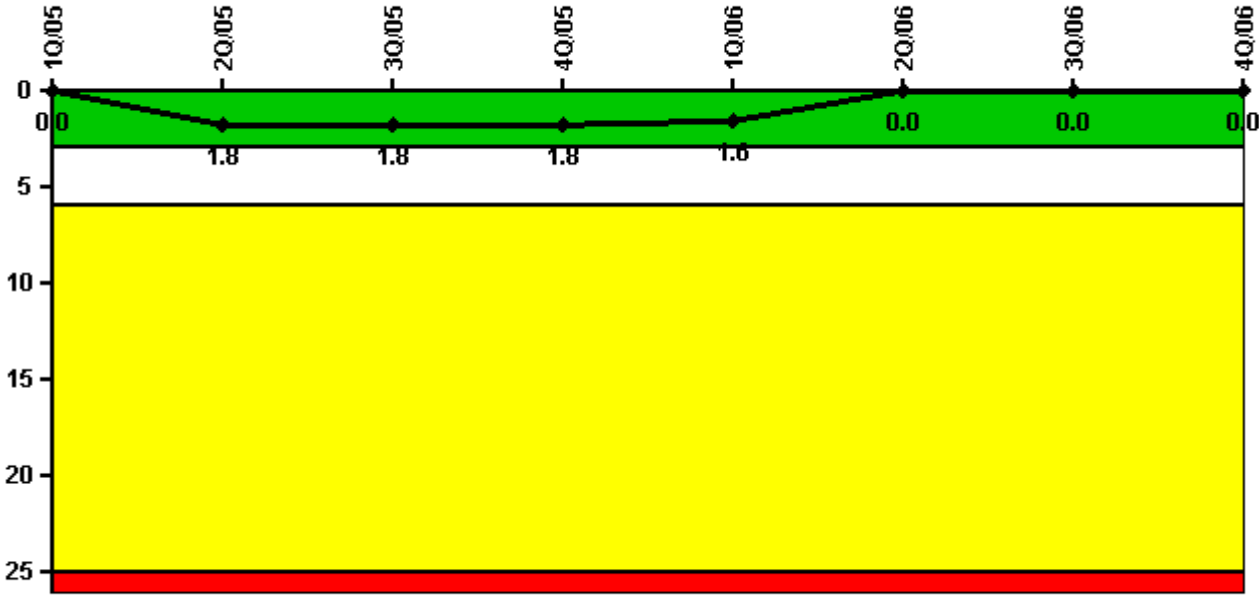

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 2.0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 1572.0 | 2003.0 | 2208.0 | 2209.0 | 2160.0 | 2053.8 | 2188.9 | 1832.0 |
| Indicator value | 0 | 1.8 | 1.8 | 1.8 | 1.6 | 0 | 0 | 0 |

Licensee Comments: none

Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

| Scrams with Loss of Normal Heat Removal | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

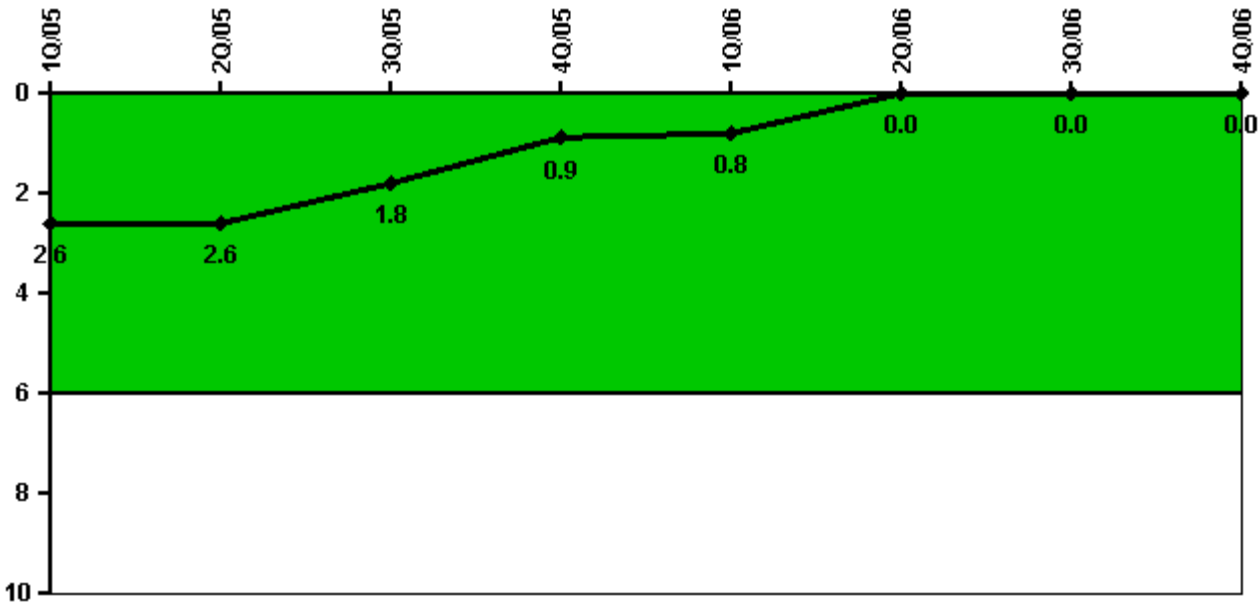


Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 1.0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 1572.0 | 2003.0 | 2208.0 | 2209.0 | 2160.0 | 2053.8 | 2188.9 | 1832.0 |
| Indicator value | 2.6 | 2.6 | 1.8 | 0.9 | 0.8 | 0 | 0 | 0 |

Licensee Comments: none

Safety System Functional Failures (BWR)

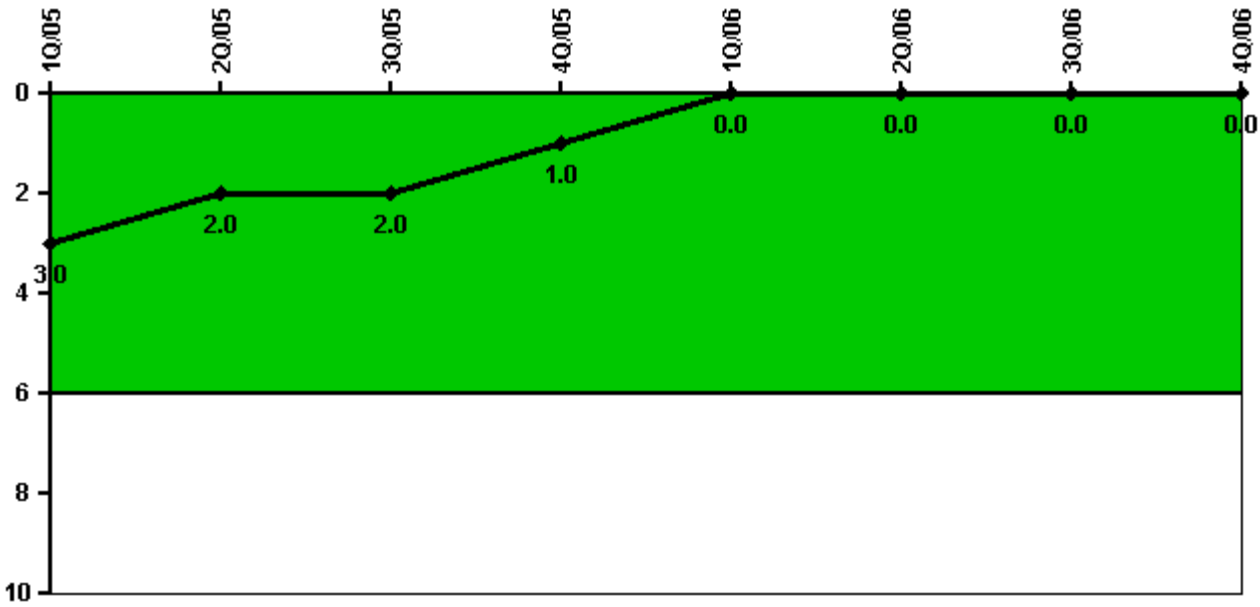


Thresholds: White > 6.0

Notes

| Safety System Functional Failures (BWR) | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 1 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 3 | 2 | 2 | 1 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

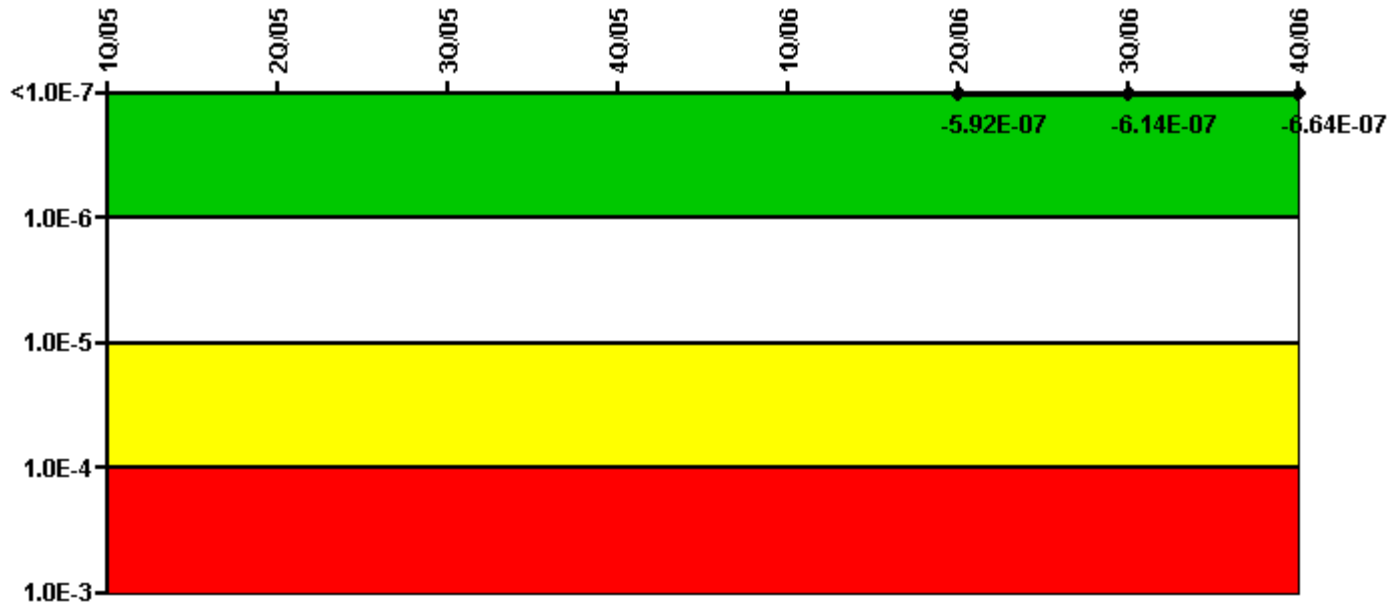


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|-------|-------|-------|-------|-------|-----------|-----------|-----------|
| UAI (Δ CDF) | | | | | | -1.20E-08 | -2.40E-08 | -2.40E-08 |
| URI (Δ CDF) | | | | | | -5.80E-07 | -5.90E-07 | -6.40E-07 |
| PLE | | | | | | NO | NO | NO |
| Indicator value | | | | | | -5.92E-07 | -6.14E-07 | -6.64E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

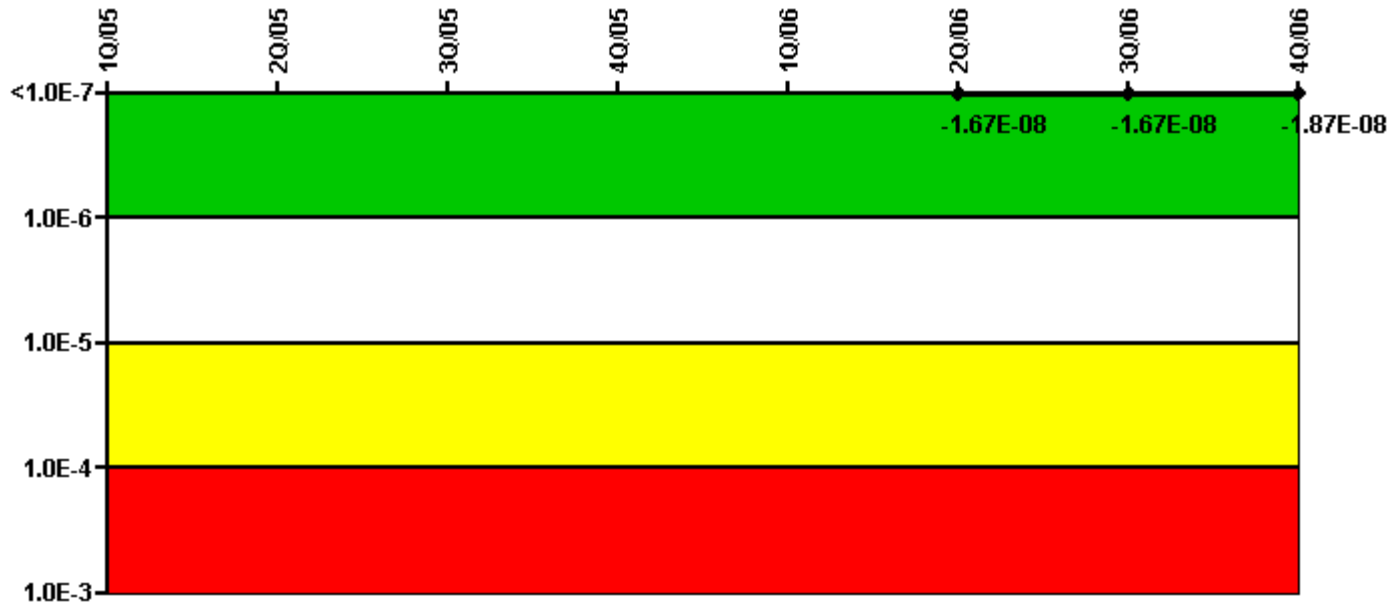


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|--|-------|-------|-------|-------|-------|-----------|-----------|-----------|
| UAI (Δ CDF) | | | | | | -4.70E-09 | -4.70E-09 | -4.70E-09 |
| URI (Δ CDF) | | | | | | -1.20E-08 | -1.20E-08 | -1.40E-08 |
| PLE | | | | | | NO | NO | NO |
| Indicator value | | | | | | -1.67E-08 | -1.67E-08 | -1.87E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

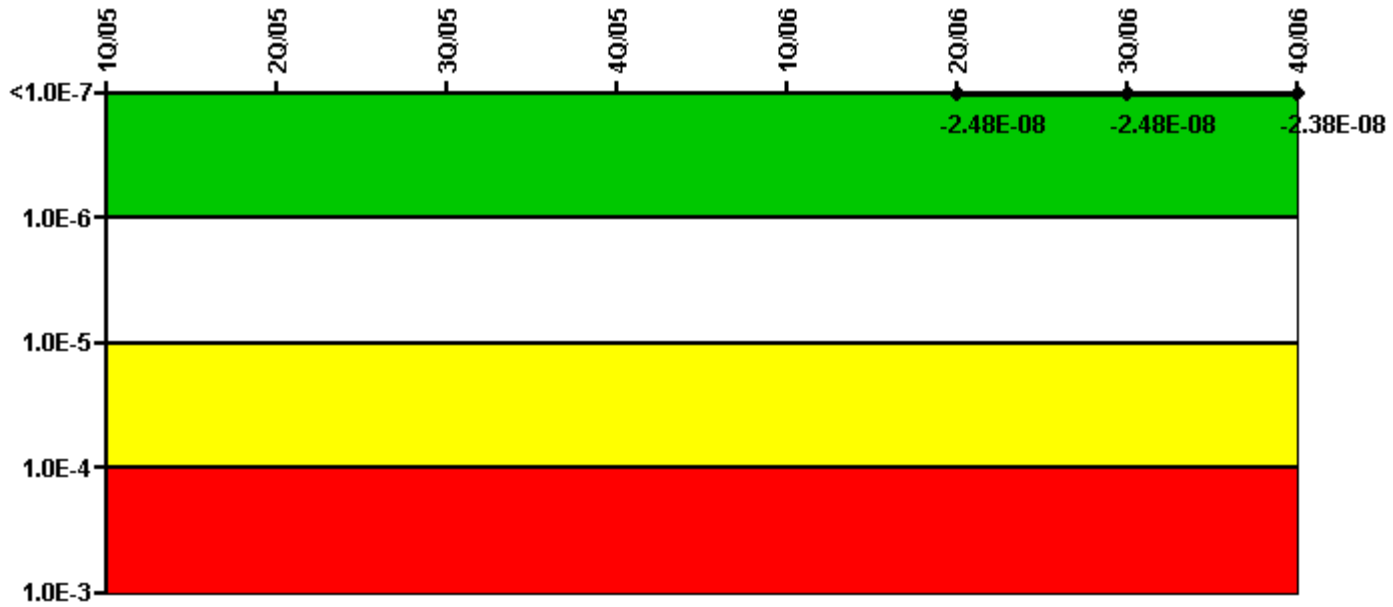


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|-------|-------|-------|-------|-------|-----------|-----------|-----------|
| UAI (Δ CDF) | | | | | | -6.80E-09 | -6.80E-09 | -4.80E-09 |
| URI (Δ CDF) | | | | | | -1.80E-08 | -1.80E-08 | -1.90E-08 |
| PLE | | | | | | NO | NO | NO |
| Indicator value | | | | | | -2.48E-08 | -2.48E-08 | -2.38E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

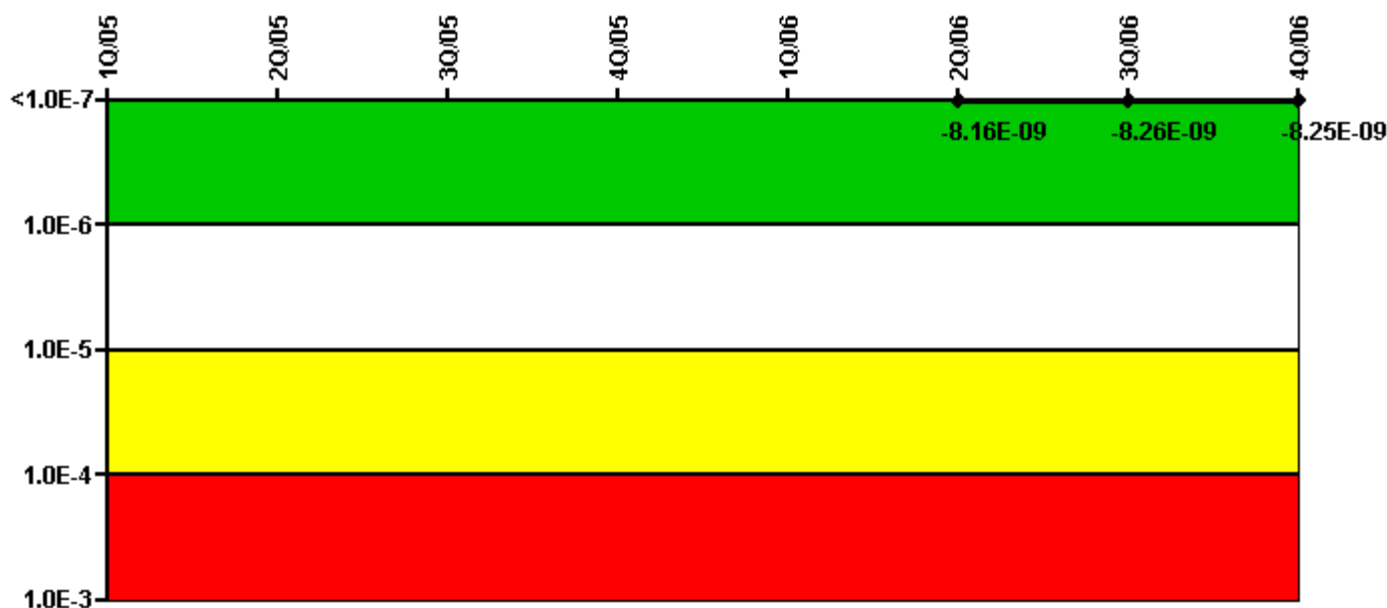

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|--|-------|-------|-------|-------|-------|-----------|-----------|-----------|
| UAI (ΔCDF) | | | | | | 1.40E-10 | 4.20E-11 | 4.50E-10 |
| URI (ΔCDF) | | | | | | -8.30E-09 | -8.30E-09 | -8.70E-09 |
| PLE | | | | | | NO | NO | NO |
| Indicator value | | | | | | -8.16E-09 | -8.26E-09 | -8.25E-09 |


Licensee Comments:

4Q/06: Changed PRA Parameter(s). Second and third quarter 2006 Mitigating System Performance Index (MSPI) data is revised due to minor changes to the Probabilistic Risk Assessment (PRA) baseline data as a result of incorporating comments from an NRC inspection in late October 2006. There is no safety significance associated with these changes to the PRA data. This revision does not affect the color of the current Performance Indicators nor the previously reported color of these PI's.

3Q/06: Changed PRA Parameter(s).

2Q/06: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

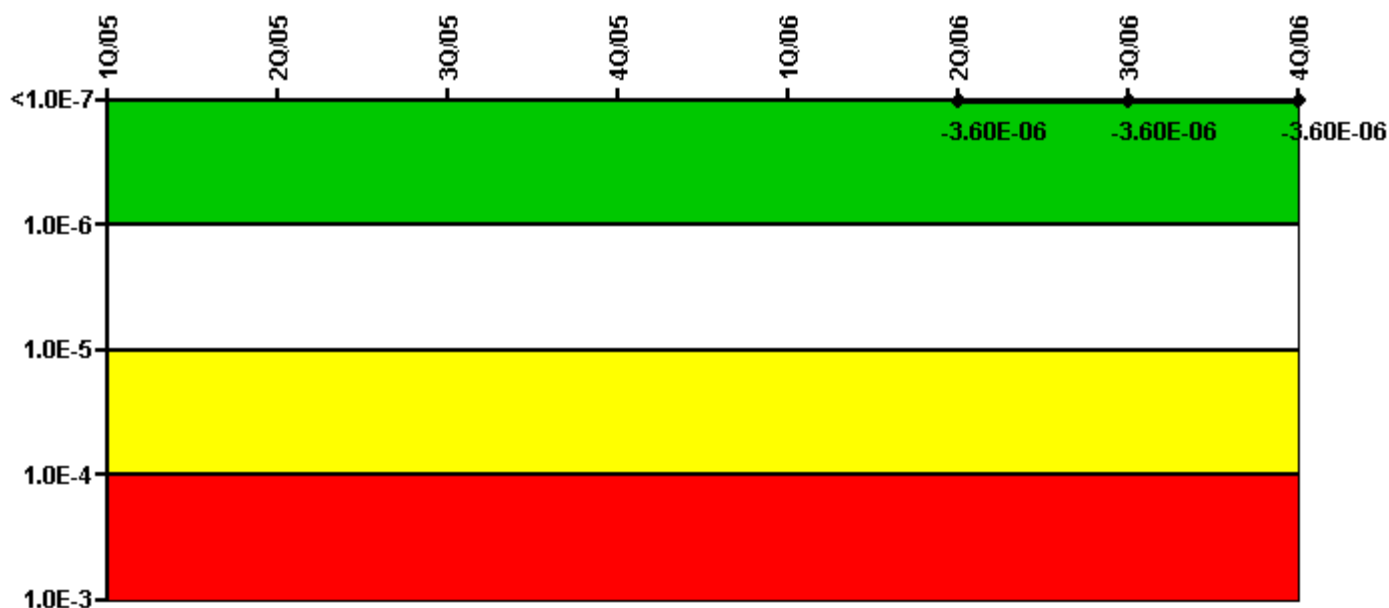

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|-------|-------|-------|-------|-------|-----------|-----------|-----------|
| UAI (ΔCDF) | | | | | | -3.60E-06 | -3.60E-06 | -3.60E-06 |
| URI (ΔCDF) | | | | | | -4.00E-09 | -4.20E-09 | 3.30E-10 |
| PLE | | | | | | NO | NO | NO |
| Indicator value | | | | | | -3.60E-06 | -3.60E-06 | -3.60E-06 |

Licensee Comments:

4Q/06: Changed PRA Parameter(s). Second and third quarter 2006 Mitigating System Performance Index (MSPI) data is revised due to minor changes to the Probabilistic Risk Assessment (PRA) baseline data as a result of incorporating comments from an NRC inspection in late October 2006. There is no safety significance associated with these changes to the PRA data. This revision does not affect the color of the current Performance Indicators nor the previously reported color of these PI's.

Reactor Coolant System Activity

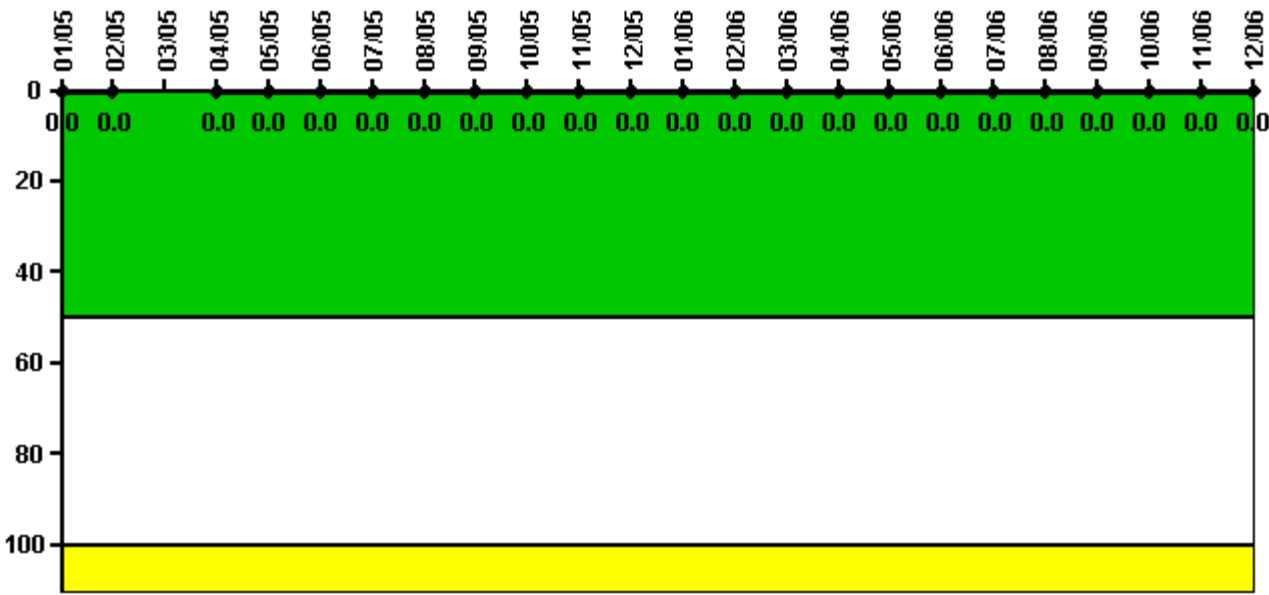

Thresholds: White > 50.0 Yellow > 100.0


Notes

| Reactor Coolant System Activity | 1/05 | 2/05 | 3/05 | 4/05 | 5/05 | 6/05 | 7/05 | 8/05 | 9/05 | 10/05 | 11/05 | 12/05 |
|---------------------------------|----------|----------|------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000006 | 0.000007 | N/A | 0.000003 | 0.000004 | 0.000004 | 0.000004 | 0.000004 | 0.000005 | 0.000005 | 0.000005 | 0.000009 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0 | 0 | N/A | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

| Reactor Coolant System Activity | 1/06 | 2/06 | 3/06 | 4/06 | 5/06 | 6/06 | 7/06 | 8/06 | 9/06 | 10/06 | 11/06 | 12/06 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000005 | 0.000005 | 0.000004 | 0.000005 | 0.000004 | 0.000005 | 0.000005 | 0.000005 | 0.000006 | 0.000006 | 0.000005 | 0.000005 |
| Technical specification limit | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 | 0.2 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Reactor Coolant System Leakage

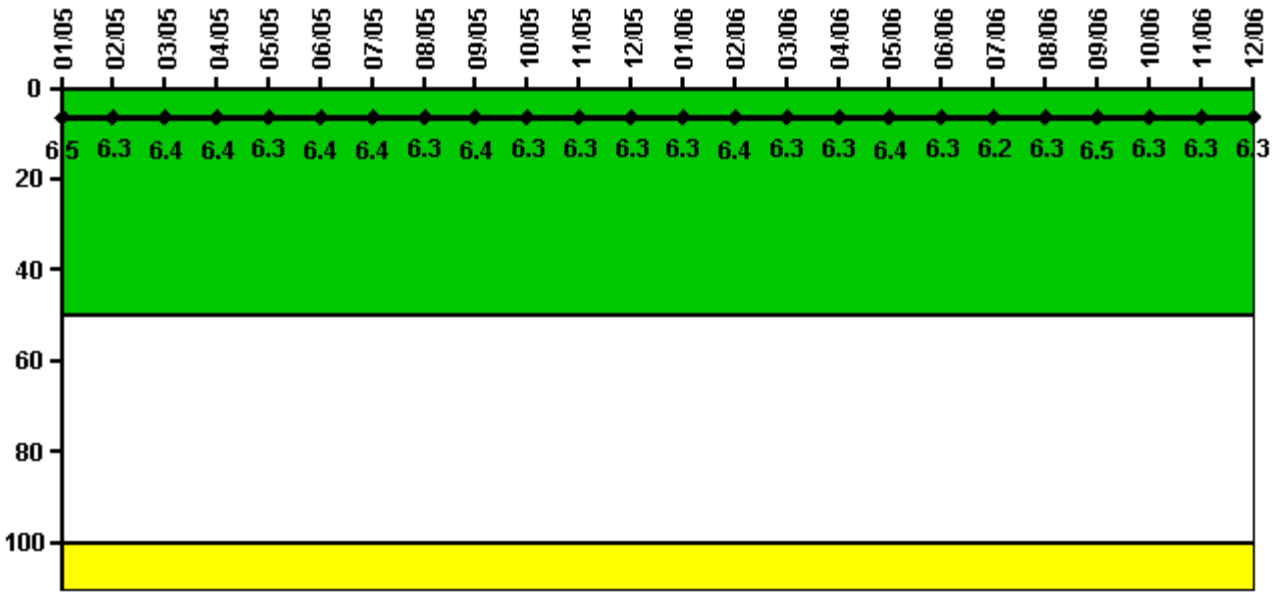

Thresholds: White > 50.0 Yellow > 100.0


Notes

| Reactor Coolant System Leakage | 1/05 | 2/05 | 3/05 | 4/05 | 5/05 | 6/05 | 7/05 | 8/05 | 9/05 | 10/05 | 11/05 | 12/05 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 1.620 | 1.580 | 1.590 | 1.600 | 1.580 | 1.590 | 1.590 | 1.580 | 1.600 | 1.570 | 1.570 | 1.570 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 6.5 | 6.3 | 6.4 | 6.4 | 6.3 | 6.4 | 6.4 | 6.3 | 6.4 | 6.3 | 6.3 | 6.3 |

| Reactor Coolant System Leakage | 1/06 | 2/06 | 3/06 | 4/06 | 5/06 | 6/06 | 7/06 | 8/06 | 9/06 | 10/06 | 11/06 | 12/06 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 1.570 | 1.590 | 1.580 | 1.580 | 1.590 | 1.570 | 1.560 | 1.570 | 1.620 | 1.570 | 1.570 | 1.570 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 6.3 | 6.4 | 6.3 | 6.3 | 6.4 | 6.3 | 6.2 | 6.3 | 6.5 | 6.3 | 6.3 | 6.3 |

Licensee Comments: none

Drill/Exercise Performance

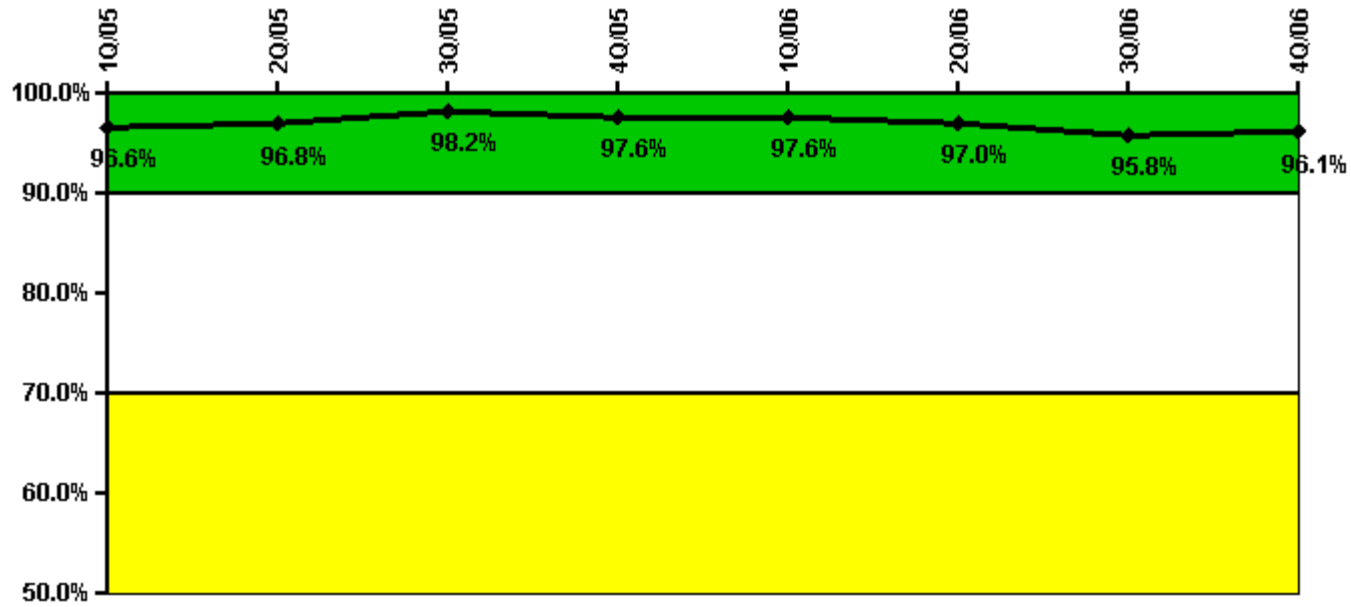


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 12.0 | 51.0 | 30.0 | 10.0 | 10.0 | 8.0 | 18.0 | 8.0 |
| Total opportunities | 12.0 | 53.0 | 30.0 | 11.0 | 10.0 | 9.0 | 20.0 | 8.0 |
| Indicator value | 96.6% | 96.8% | 98.2% | 97.6% | 97.6% | 97.0% | 95.8% | 96.1% |

Licensee Comments: none

ERO Drill Participation

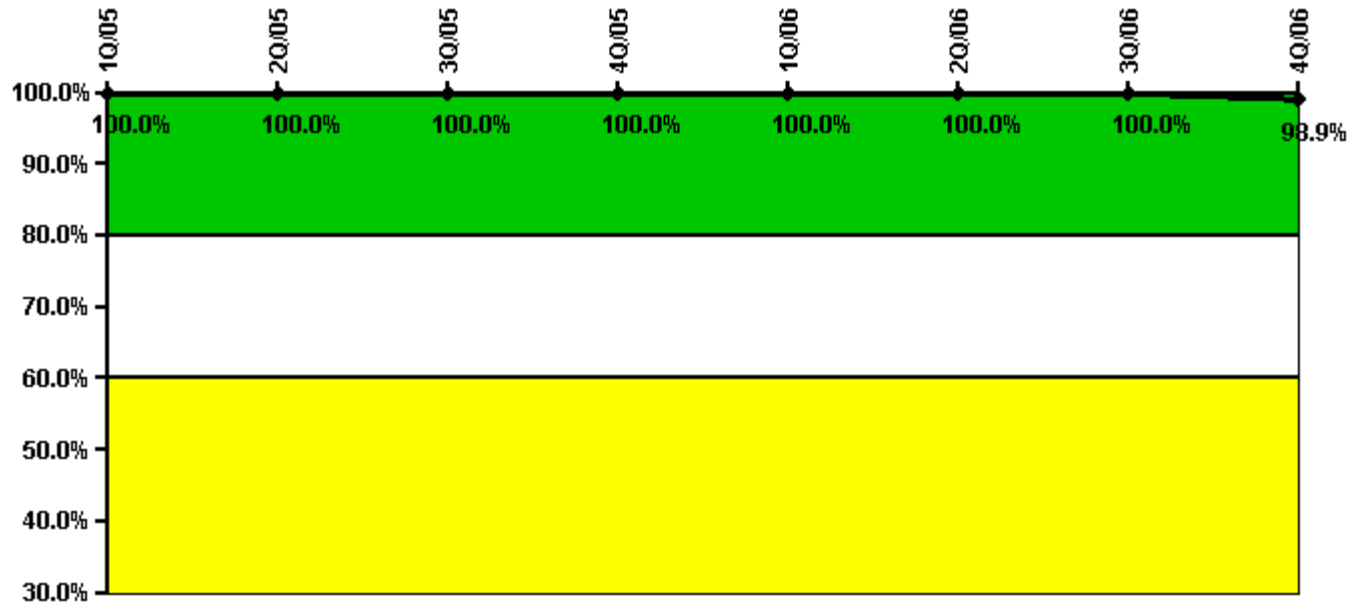


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|-----------------------------|---------------|---------------|---------------|---------------|---------------|---------------|---------------|--------------|
| Participating Key personnel | 91.0 | 95.0 | 91.0 | 94.0 | 95.0 | 92.0 | 91.0 | 86.0 |
| Total Key personnel | 91.0 | 95.0 | 91.0 | 94.0 | 95.0 | 92.0 | 91.0 | 87.0 |
| | | | | | | | | |
| Indicator value | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 98.9% |

Licensee Comments: none

Alert & Notification System

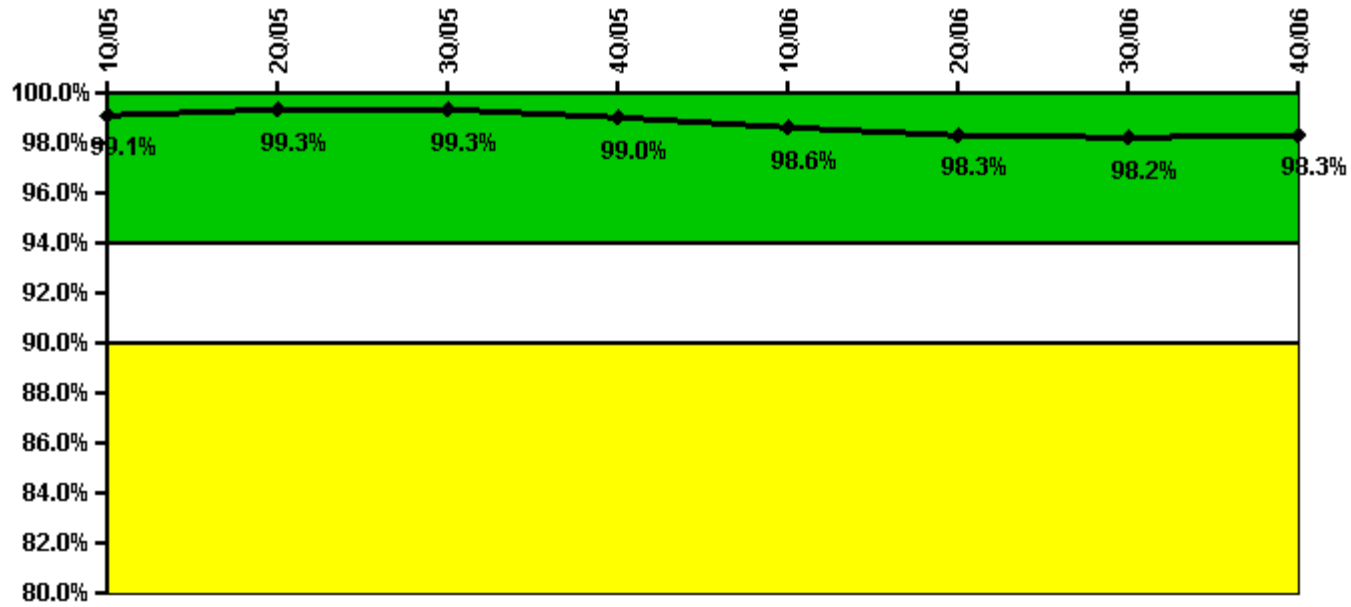

Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 894 | 778 | 884 | 880 | 880 | 660 | 880 | 882 |
| Total sirens-tests | 896 | 784 | 896 | 896 | 896 | 672 | 896 | 896 |
| Indicator value | 99.1% | 99.3% | 99.3% | 99.0% | 98.6% | 98.3% | 98.2% | 98.3% |

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 1Q/05 | 2Q/05 | 3Q/05 | 4Q/05 | 1Q/06 | 2Q/06 | 3Q/06 | 4Q/06 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

[Physical Protection](#) information not publicly available.