


Palisades

1Q/2007 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

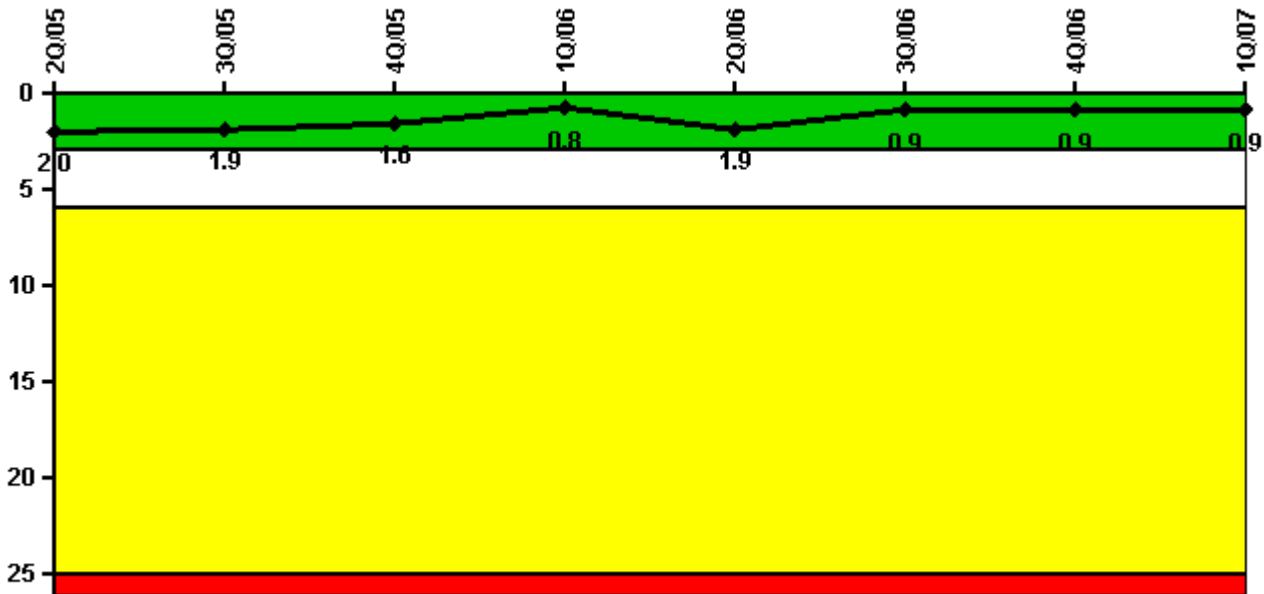


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned scrams	0	1.0	0	0	1.0	0	0	0
Critical hours	2183.0	2173.7	2185.2	2035.3	1155.0	2208.0	2163.5	1987.0
Indicator value	2.0	1.9	1.6	0.8	1.9	0.9	0.9	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

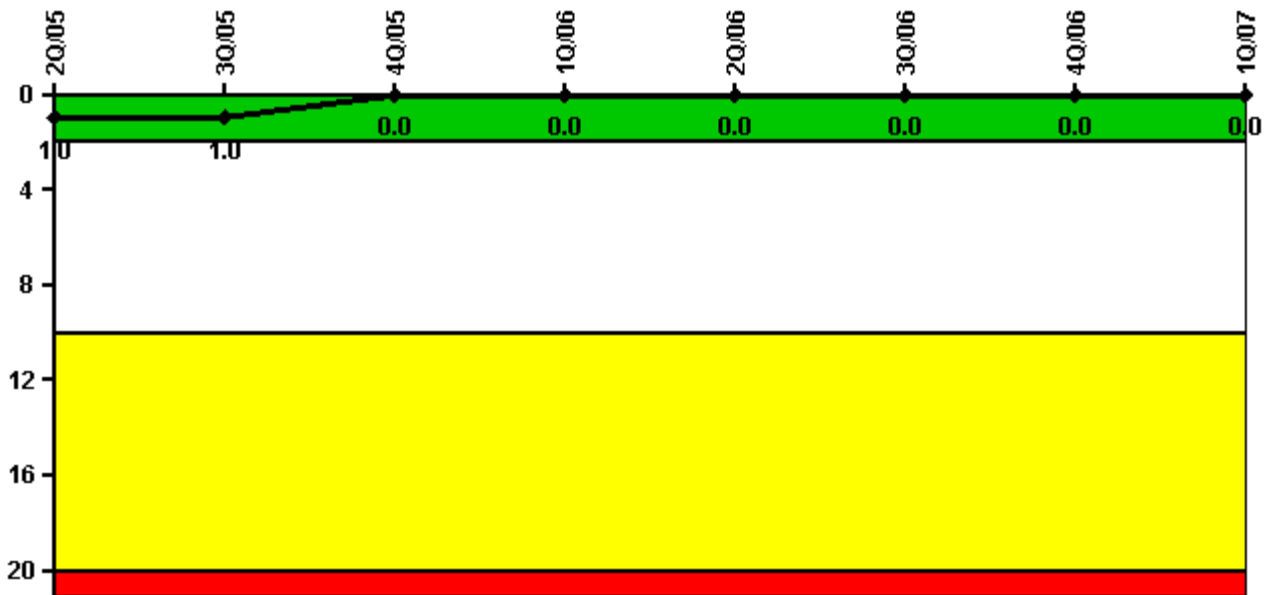


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Scrams	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

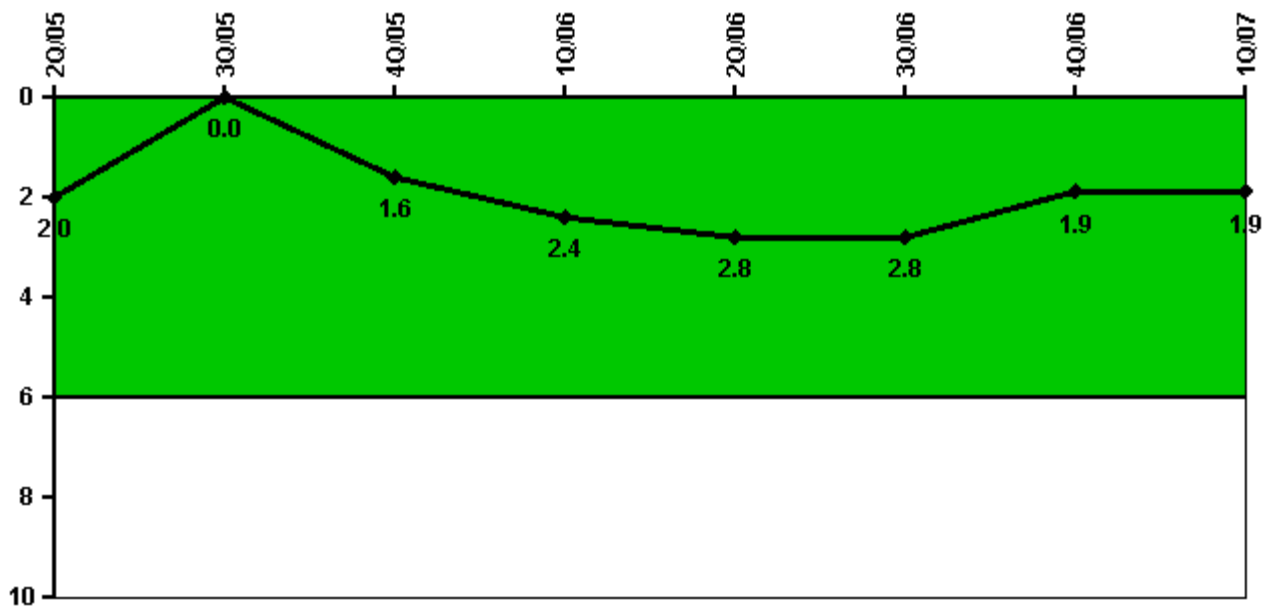


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned power changes	0	0	2.0	1.0	0	0	1.0	1.0
Critical hours	2183.0	2173.7	2185.2	2035.3	1155.0	2208.0	2163.5	1987.0
Indicator value	2.0	0	1.6	2.4	2.8	2.8	1.9	1.9

Licensee Comments: none

Safety System Functional Failures (PWR)

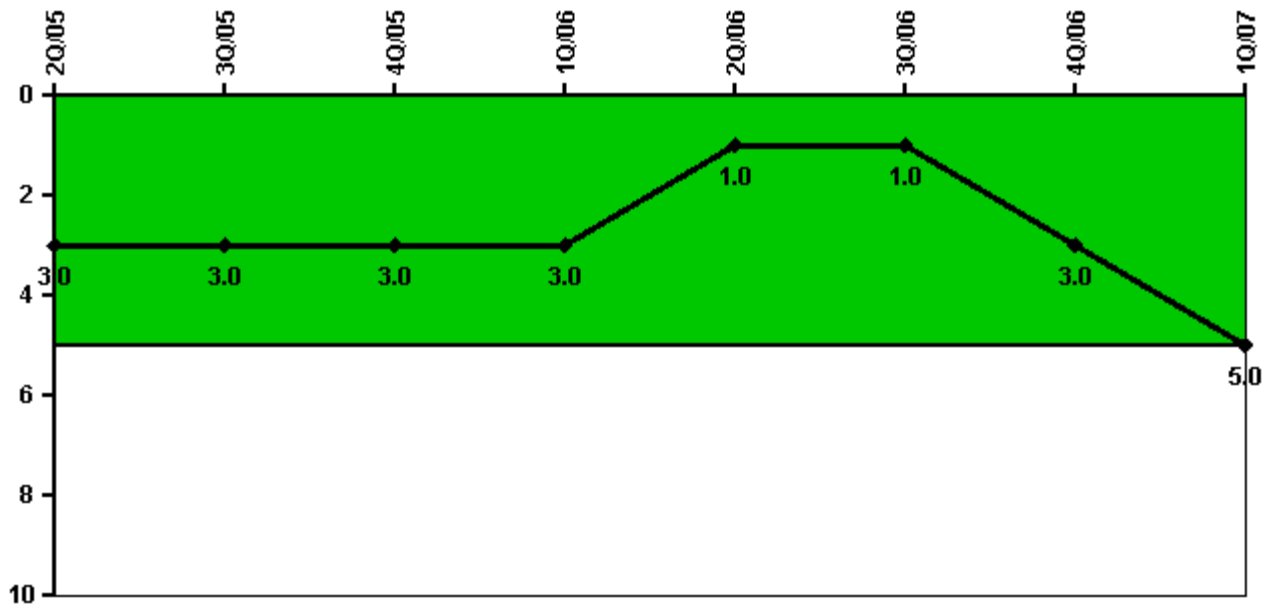

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Safety System Functional Failures	3	0	0	0	1	0	2	2
Indicator value	3	3	3	3	1	1	3	5

Licensee Comments:

1Q/07: LER 2006-008, Inoperable Containment Due to Containment Cooler Through-Wall Flaw and LER 2007-002, Inoperable Containment Due to Containment Cooler Through-Wall Flaw.

Mitigating Systems Performance Index, Emergency AC Power System

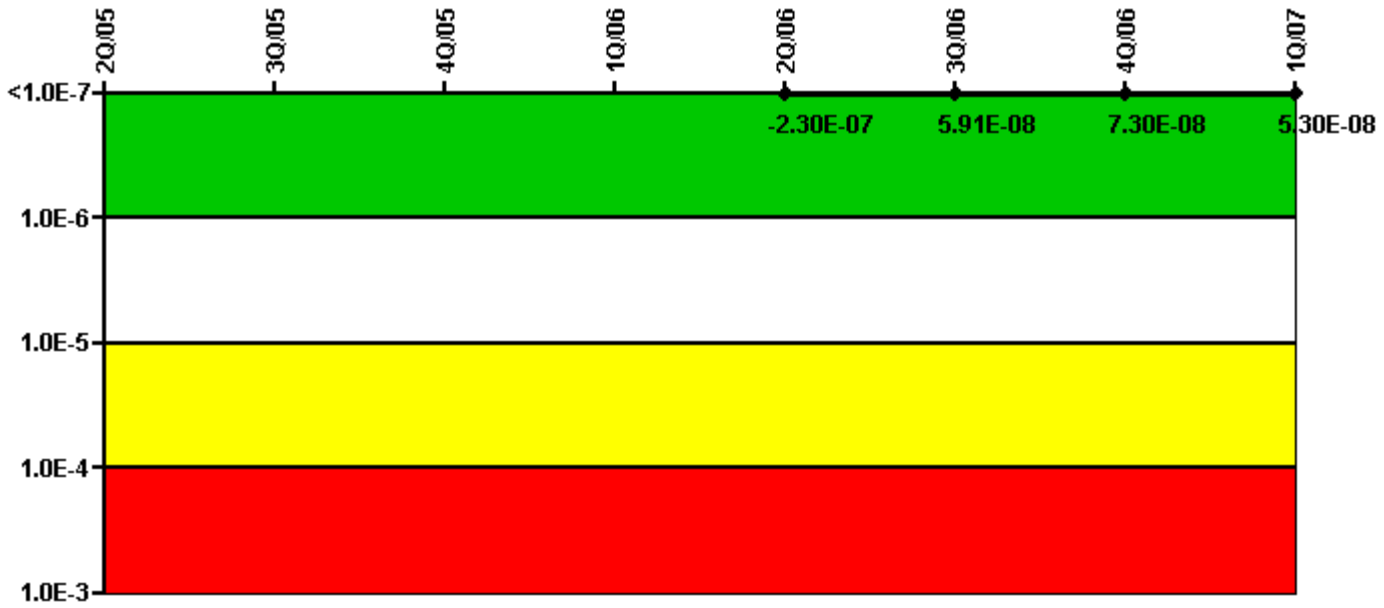


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					$2.20E-07$	$4.10E-09$	$1.80E-08$	$6.50E-08$
URI (Δ CDF)					$-4.50E-07$	$5.50E-08$	$5.50E-08$	$-1.20E-08$
PLE					NO	NO	NO	NO
Indicator value					$-2.30E-07$	$5.91E-08$	$7.30E-08$	$5.30E-08$

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

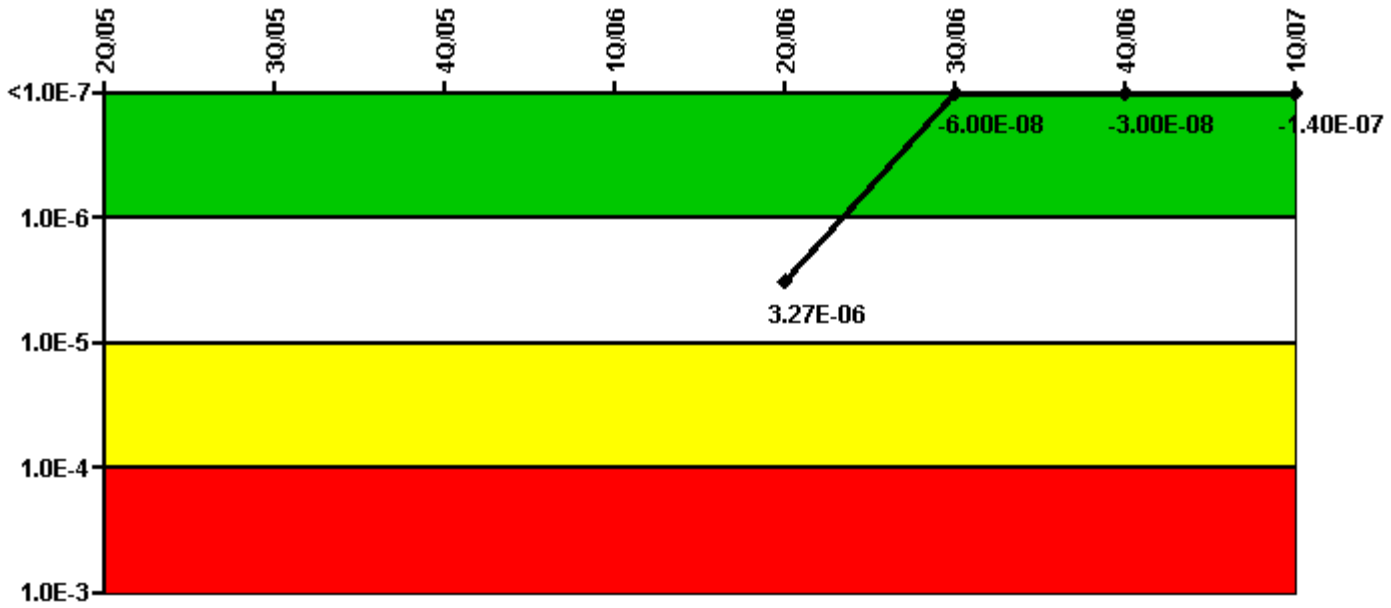


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					$4.70E-07$	$2.10E-07$	$2.40E-07$	$1.30E-07$
URI (Δ CDF)					$2.80E-06$	$-2.70E-07$	$-2.70E-07$	$-2.70E-07$
PLE					NO	NO	NO	NO
Indicator value					$3.27E-06$	$-6.00E-08$	$-3.00E-08$	$-1.40E-07$

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

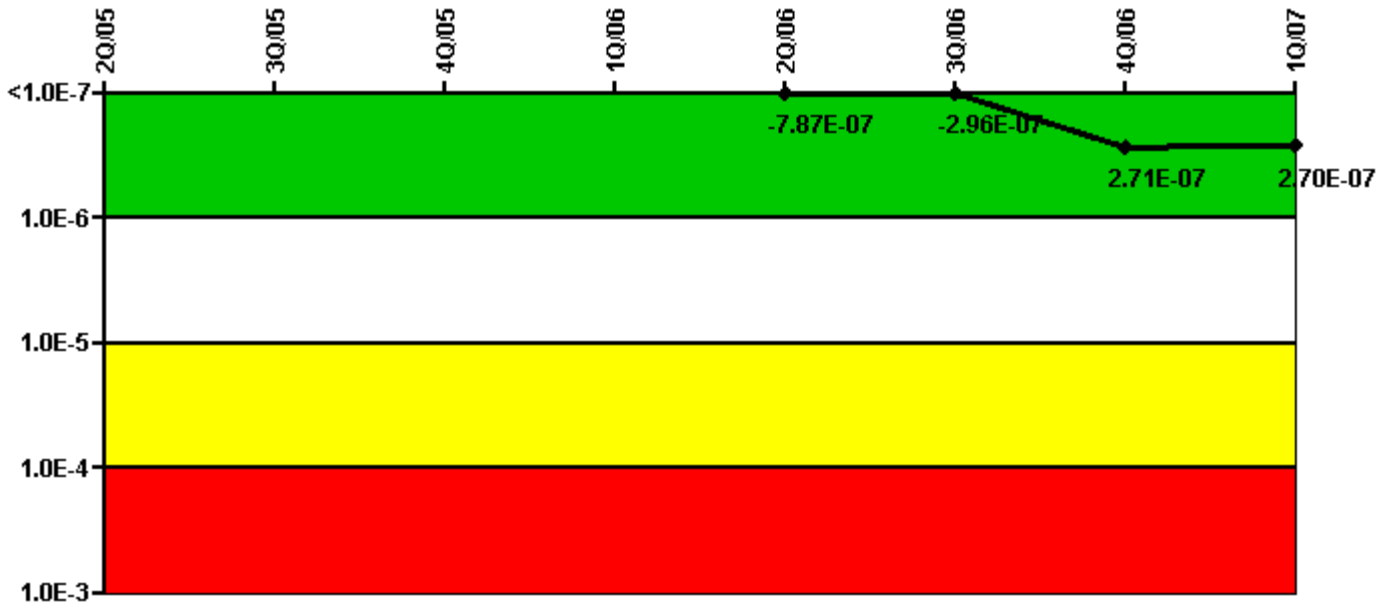


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (ΔCDF)					-4.70E-08	-1.60E-08	-9.10E-09	-1.00E-08
URI (ΔCDF)					-7.40E-07	-2.80E-07	2.80E-07	2.80E-07
PLE					NO	NO	NO	NO
Indicator value					-7.87E-07	-2.96E-07	2.71E-07	2.70E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

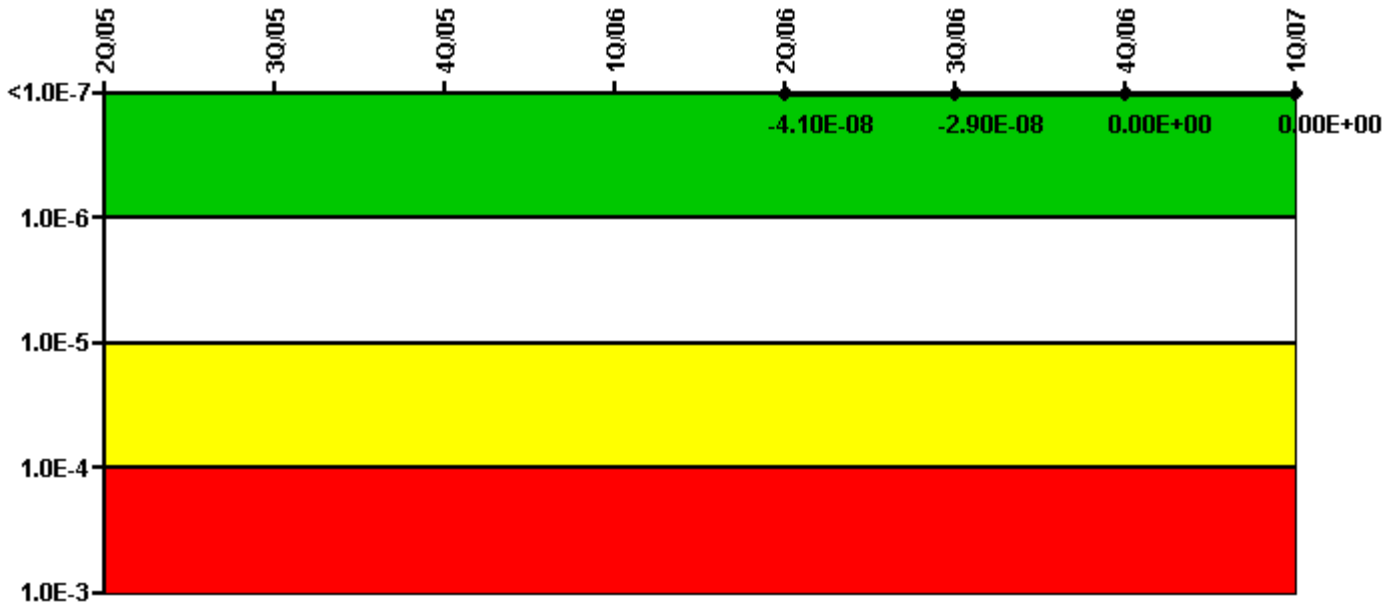


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					1.20E-08	1.10E-08	4.00E-08	4.00E-08
URI (Δ CDF)					-5.30E-08	-4.00E-08	-4.00E-08	-4.00E-08
PLE					NO	NO	NO	NO
Indicator value					-4.10E-08	-2.90E-08	0.00E+00	0.00E+00

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

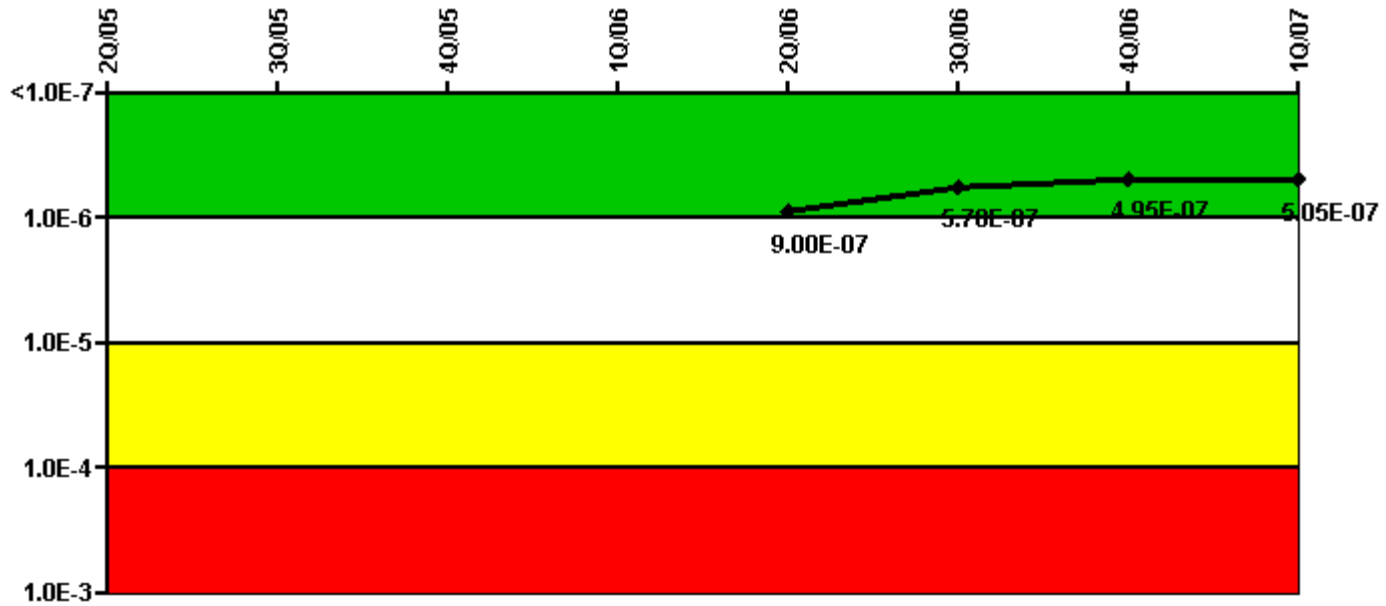

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					5.00E-08	1.00E-07	2.50E-08	2.50E-08
URI (Δ CDF)					8.50E-07	4.70E-07	4.70E-07	4.80E-07
PLE					NO	NO	NO	NO
Indicator value					9.00E-07	5.70E-07	4.95E-07	5.05E-07

Licensee Comments:

1Q/07: Evaluation continues on potential failures associated with degraded MSPI component cabling identified in Feb. 2007. Additional lab testing is scheduled to be completed in May 2007.

Reactor Coolant System Activity

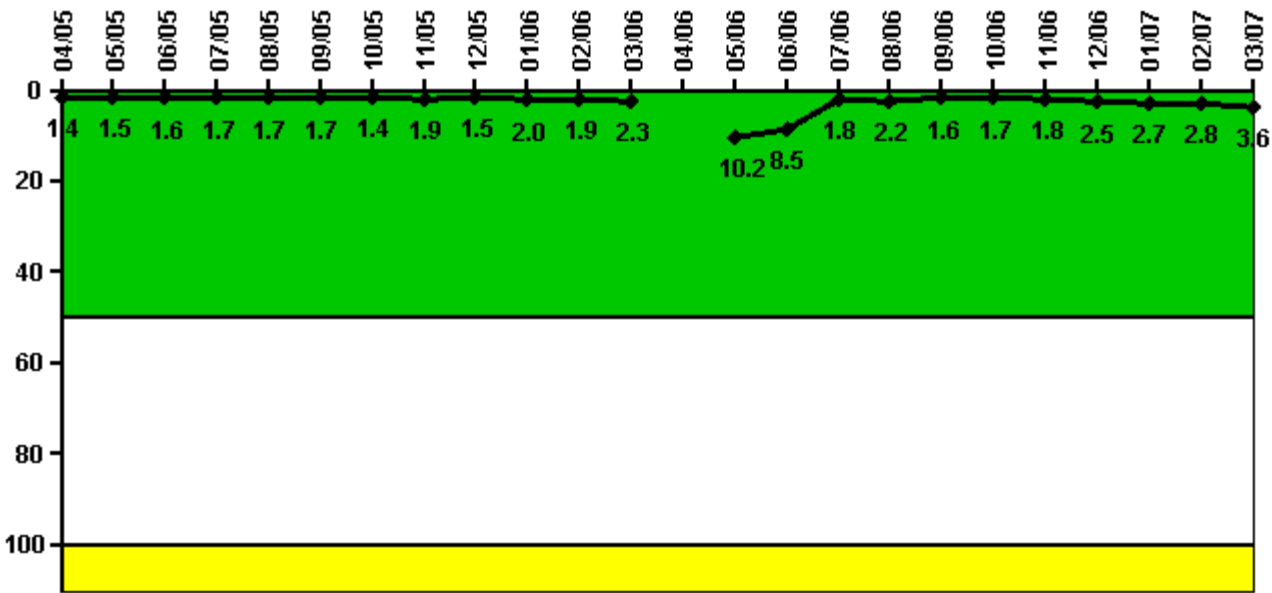


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum activity	0.014300	0.015200	0.015900	0.017400	0.017300	0.017100	0.013800	0.018600	0.014500	0.020000	0.019200	0.022700
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	1.4	1.5	1.6	1.7	1.7	1.7	1.4	1.9	1.5	2.0	1.9	2.3
Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	N/A	0.102000	0.084600	0.018300	0.022200	0.015700	0.017400	0.017800	0.024900	0.027300	0.028200	0.036000
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	N/A	10.2	8.5	1.8	2.2	1.6	1.7	1.8	2.5	2.7	2.8	3.6

Licensee Comments: none

Reactor Coolant System Leakage

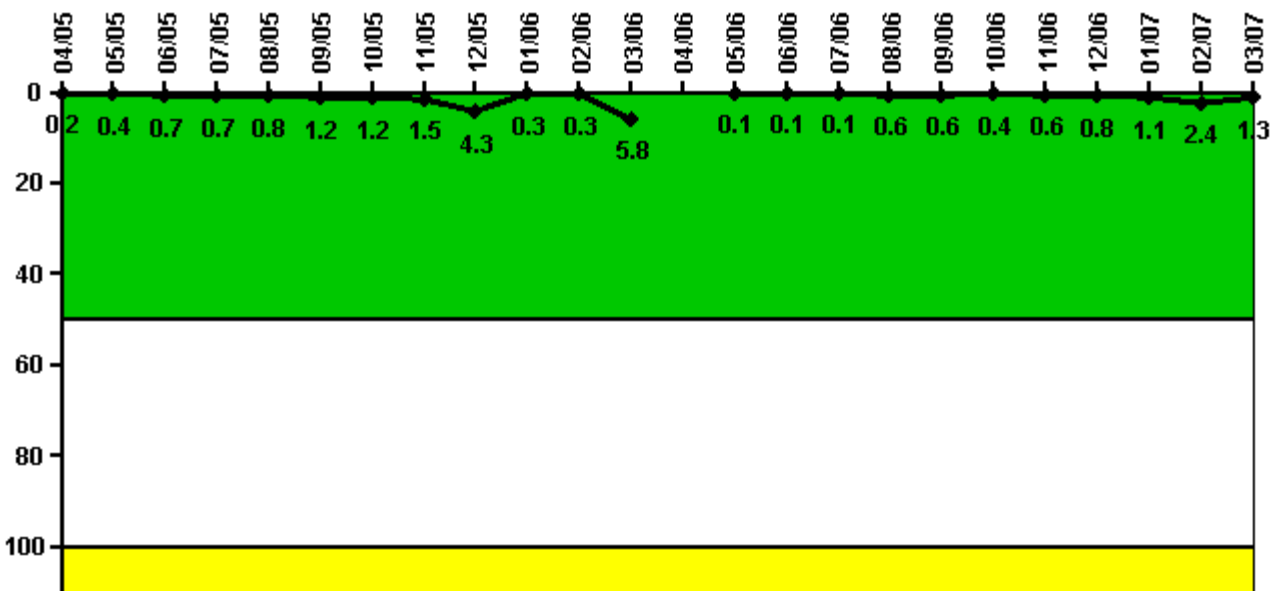

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum leakage	0.016	0.040	0.066	0.066	0.079	0.120	0.119	0.148	0.429	0.026	0.033	0.581
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.4	0.7	0.7	0.8	1.2	1.2	1.5	4.3	0.3	0.3	5.8

Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	N/A	0.013	0.013	0.007	0.059	0.059	0.040	0.055	0.079	0.111	0.238	0.125
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	N/A	0.1	0.1	0.1	0.6	0.6	0.4	0.6	0.8	1.1	2.4	1.3

Licensee Comments: none

Drill/Exercise Performance

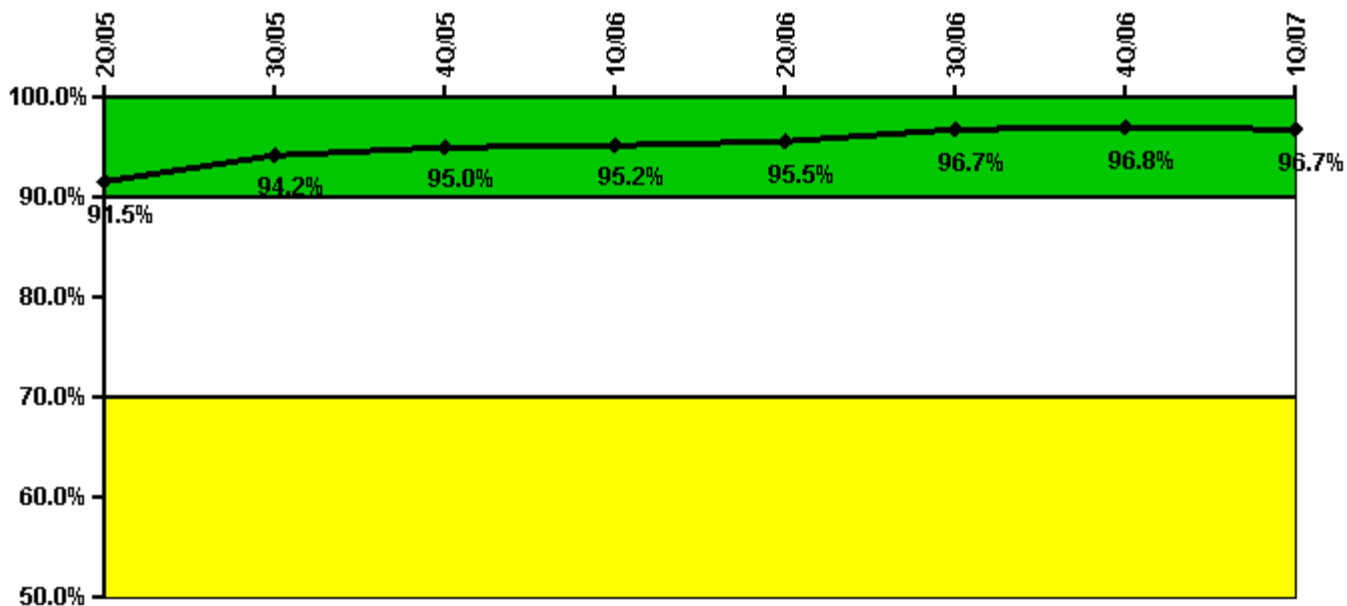


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful opportunities	75.0	82.0	12.0	96.0	36.0	40.0	25.0	19.0
Total opportunities	78.0	82.0	12.0	101.0	36.0	40.0	26.0	23.0
Indicator value	91.5%	94.2%	95.0%	95.2%	95.5%	96.7%	96.8%	96.7%

Licensee Comments: none

ERO Drill Participation

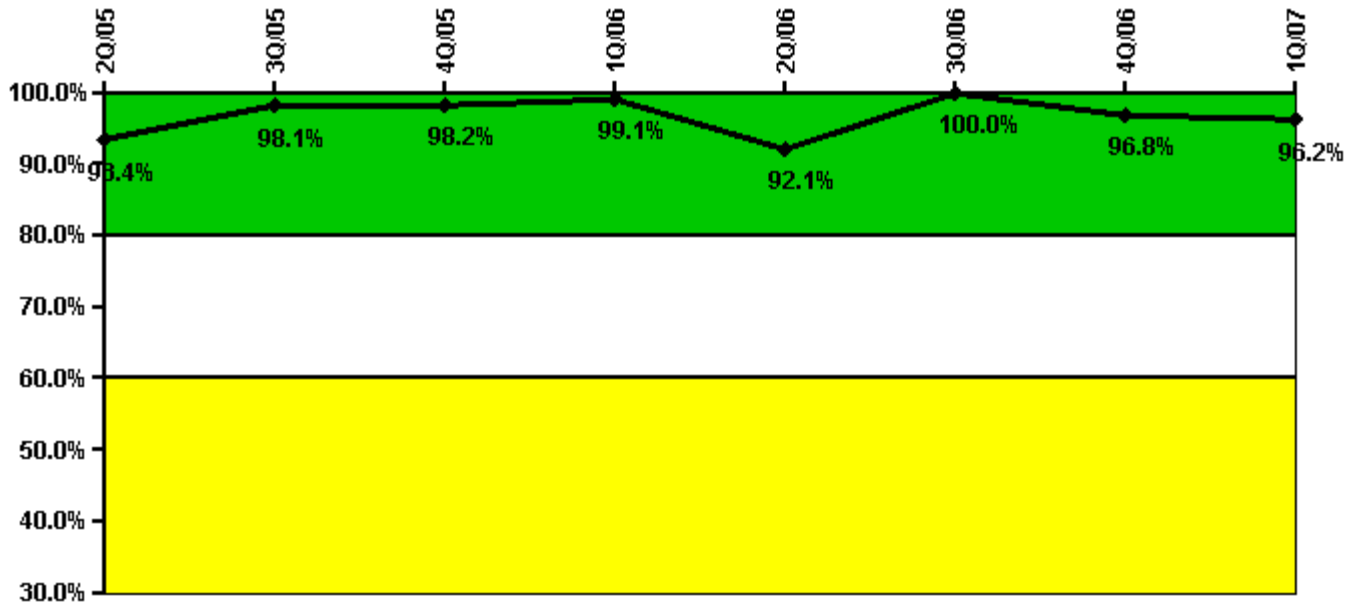


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Participating Key personnel	99.0	106.0	107.0	114.0	105.0	114.0	121.0	126.0
Total Key personnel	106.0	108.0	109.0	115.0	114.0	114.0	125.0	131.0
Indicator value	93.4%	98.1%	98.2%	99.1%	92.1%	100.0%	96.8%	96.2%

Licensee Comments: none

Alert & Notification System

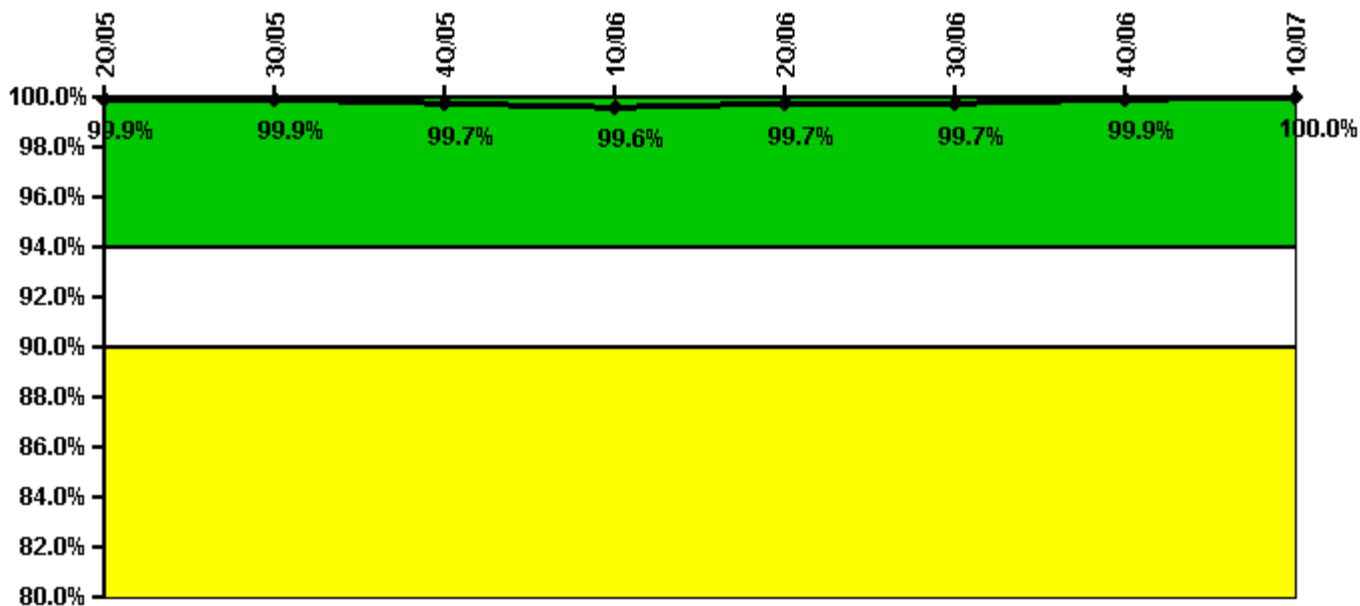


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful siren-tests	182	183	182	182	183	183	183	183
Total sirens-tests	183	183	183	183	183	183	183	183
Indicator value	99.9%	99.9%	99.7%	99.6%	99.7%	99.7%	99.9%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

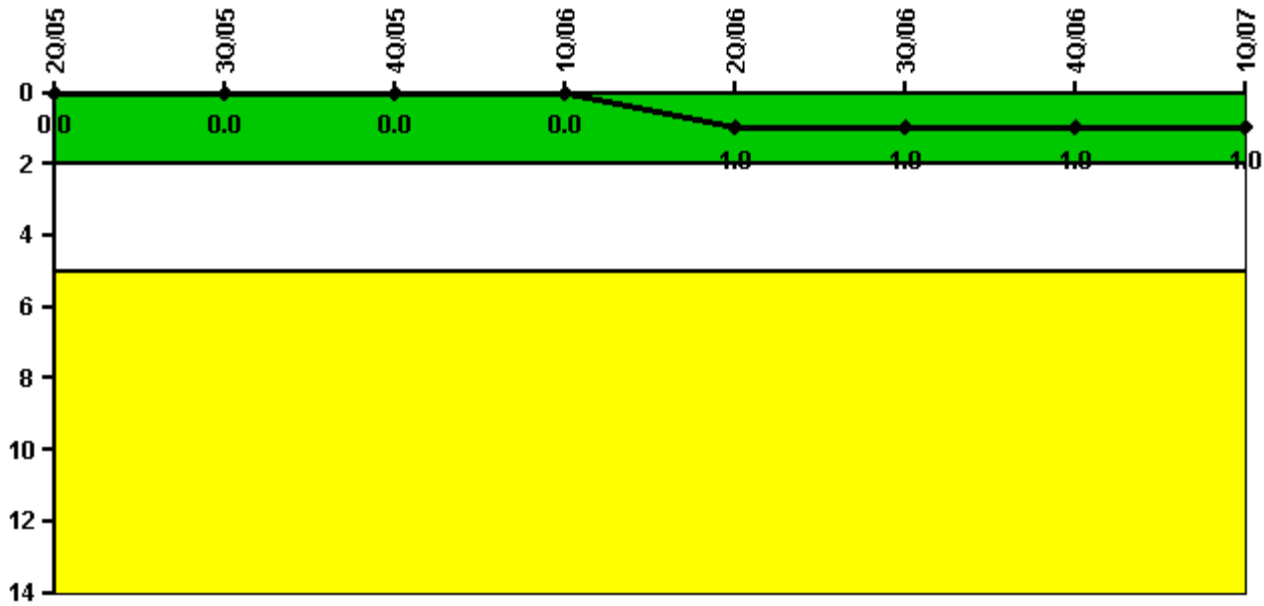


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
High radiation area occurrences	0	0	0	0	1	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	1	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent

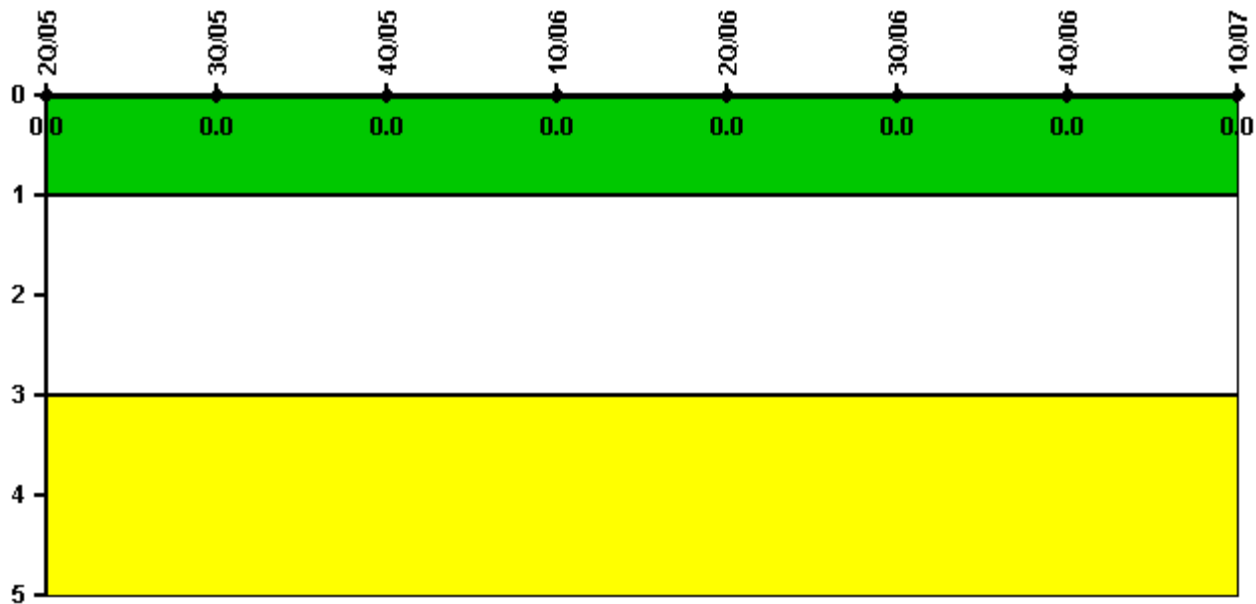

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: June 1, 2007