


Robinson 2

1Q/2007 Performance Indicators

Licensee's General Comments: These changes did not affect the indicator color. Indicators remains Green.

Unplanned Scrams per 7000 Critical Hrs

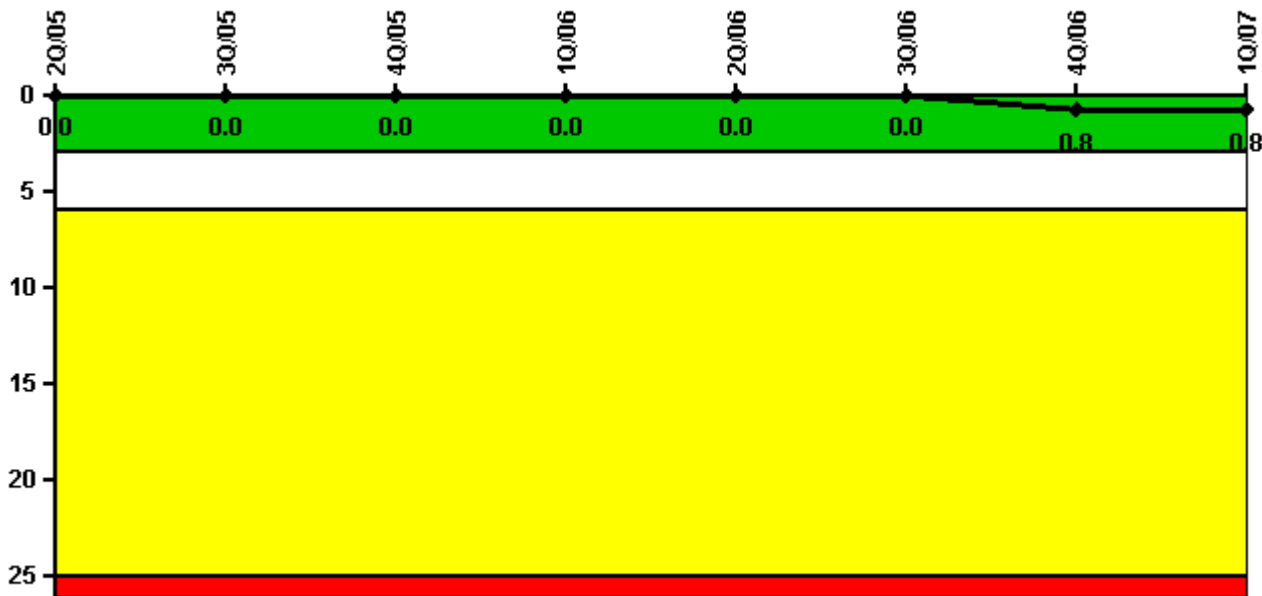

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned scrams	0	0	0	0	0	0	1.0	0
Critical hours	2183.0	1872.2	1641.0	2160.0	2183.0	2208.0	2172.0	2159.0
Indicator value	0	0	0	0	0	0	0.8	0.8

Licensee Comments: none

Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

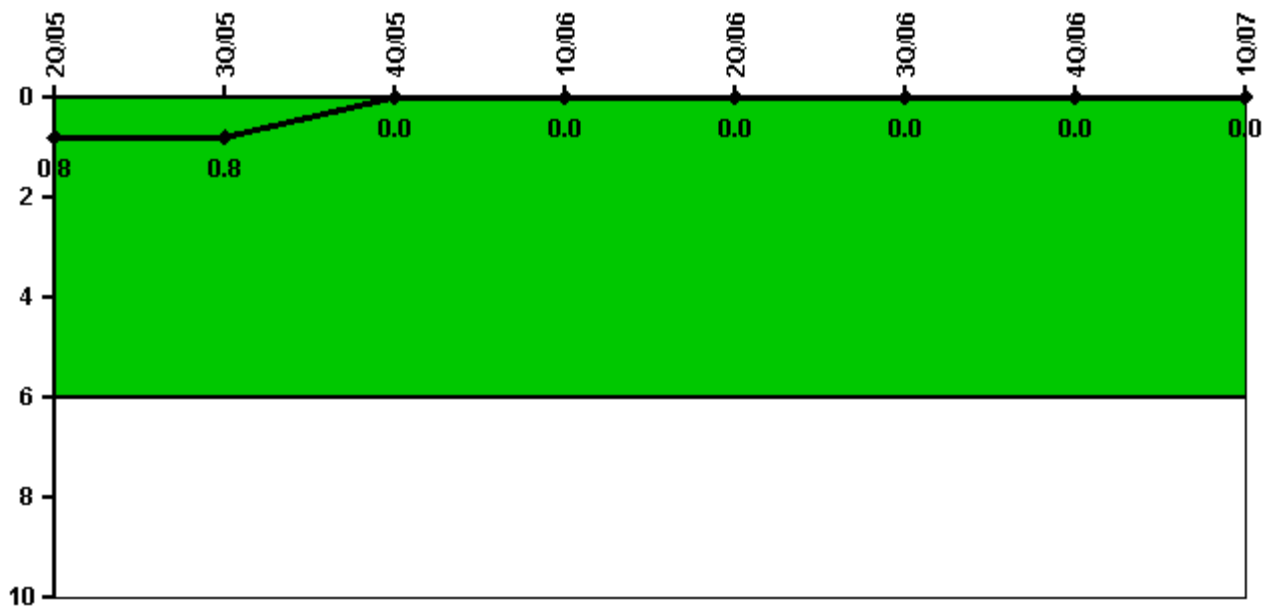


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2183.0	1872.2	1641.0	2160.0	2183.0	2208.0	2172.0	2159.0
Indicator value	0.8	0.8	0	0	0	0	0	0

Licensee Comments: none

Safety System Functional Failures (PWR)

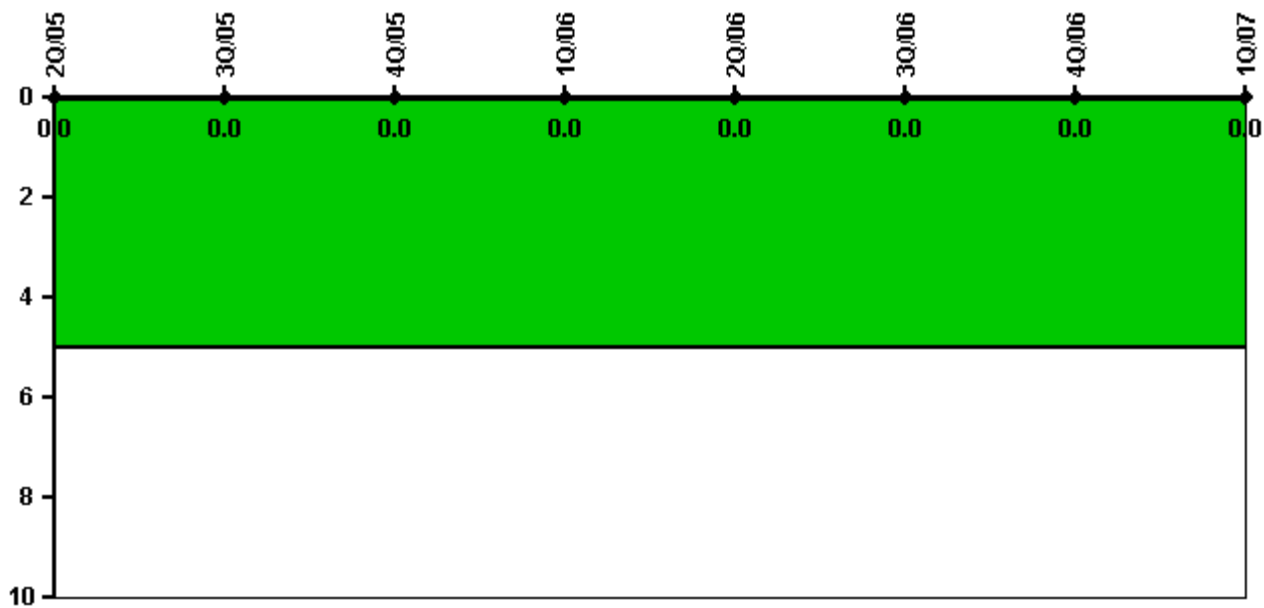


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

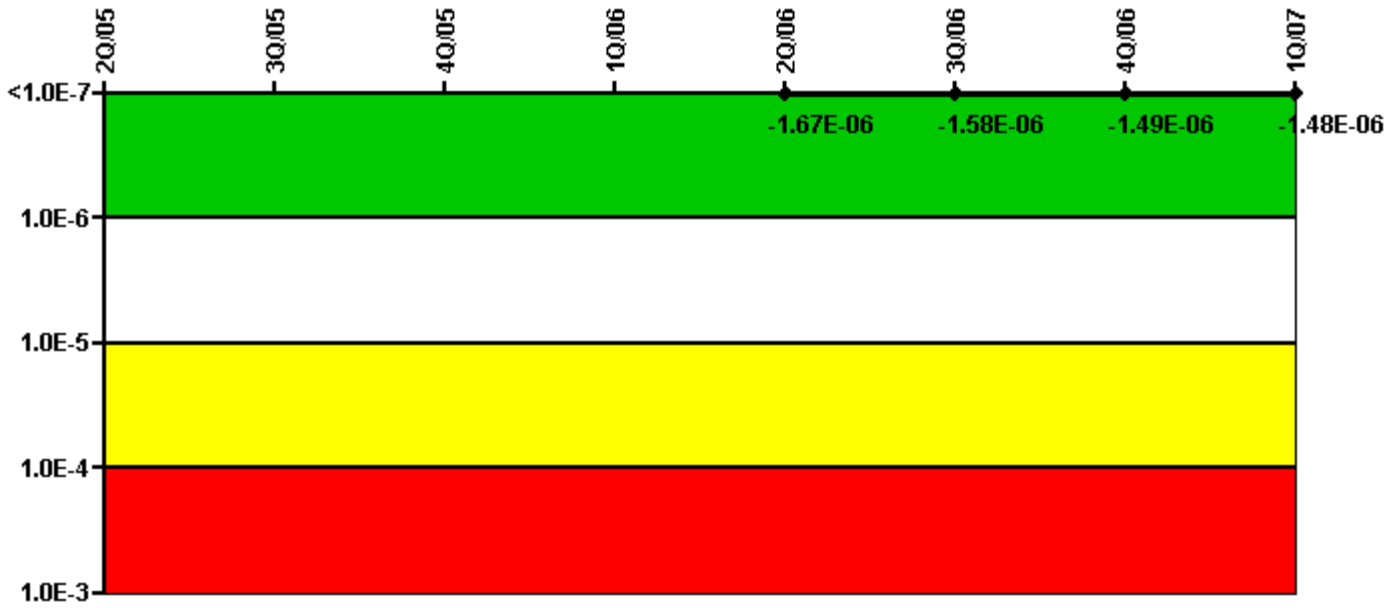


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (ΔCDF)					3.30E-08	1.20E-07	2.10E-07	2.20E-07
URI (ΔCDF)					-1.70E-06	-1.70E-06	-1.70E-06	-1.70E-06
PLE					NO	NO	NO	NO
Indicator value					-1.67E-06	-1.58E-06	-1.49E-06	-1.48E-06

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

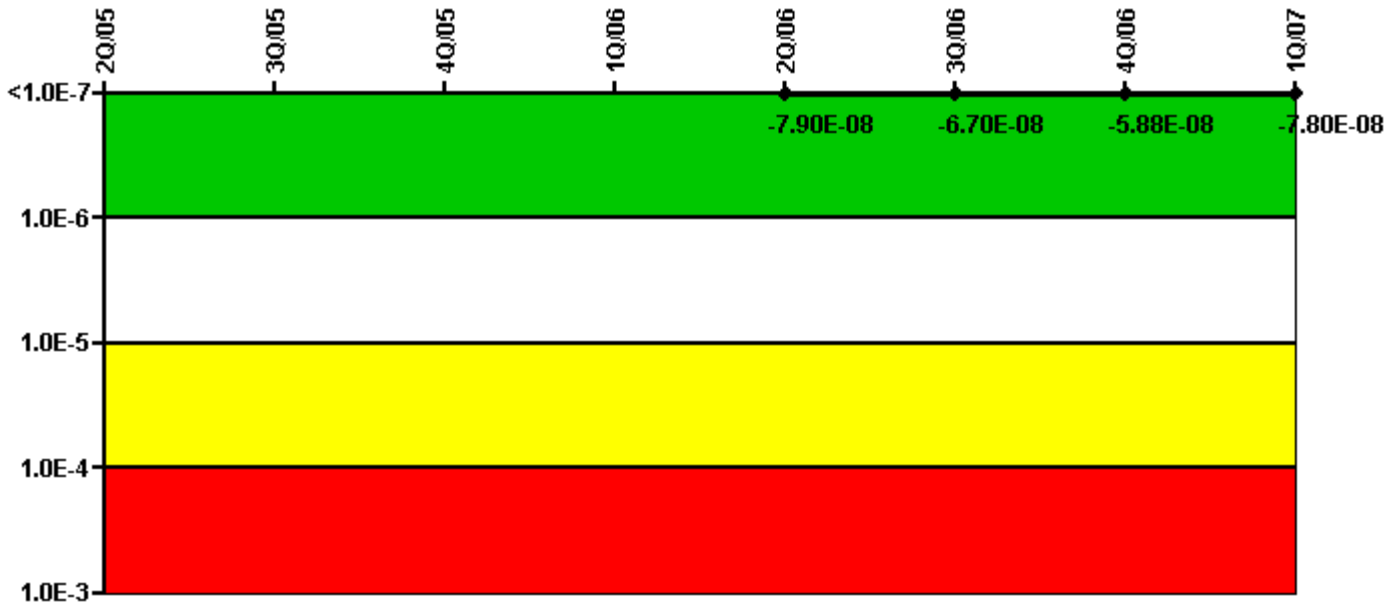


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					-2.30E-08	-1.10E-08	-2.80E-09	-2.20E-08
URI (Δ CDF)					-5.60E-08	-5.60E-08	-5.60E-08	-5.60E-08
PLE					NO	NO	NO	NO
Indicator value					-7.90E-08	-6.70E-08	-5.88E-08	-7.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

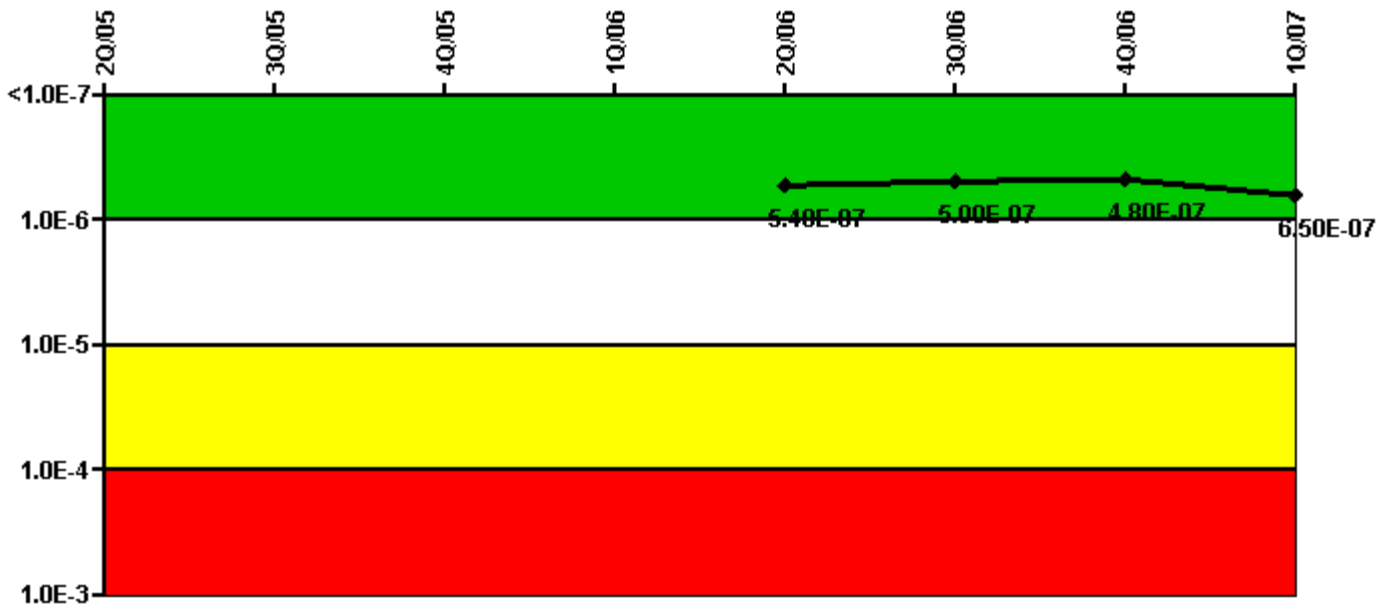

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (ΔCDF)					1.80E-07	1.40E-07	1.30E-07	3.00E-07
URI (ΔCDF)					3.60E-07	3.60E-07	3.50E-07	3.50E-07
PLE					NO	NO	NO	NO
Indicator value					5.40E-07	5.00E-07	4.80E-07	6.50E-07

Licensee Comments:

1Q/07: Risk Cap Invoked.

Mitigating Systems Performance Index, Residual Heat Removal System

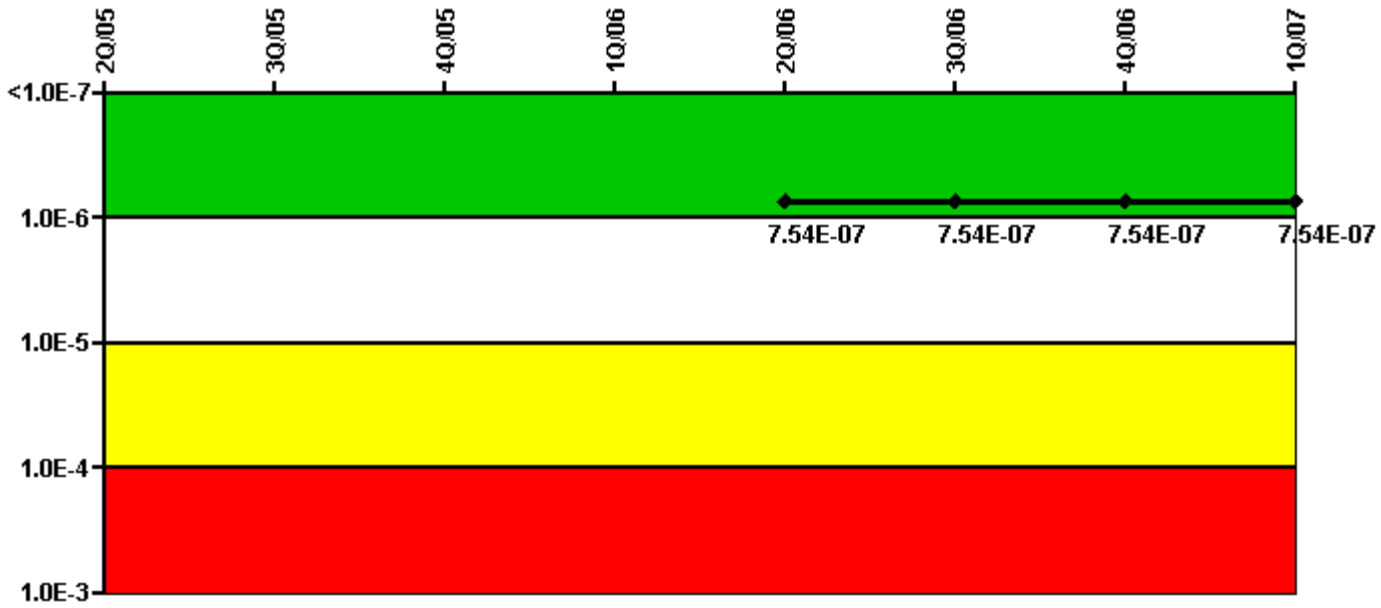


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (ΔCDF)					-2.60E-08	-2.60E-08	-2.60E-08	-2.60E-08
URI (ΔCDF)					7.80E-07	7.80E-07	7.80E-07	7.80E-07
PLE					NO	NO	NO	NO
Indicator value					7.54E-07	7.54E-07	7.54E-07	7.54E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

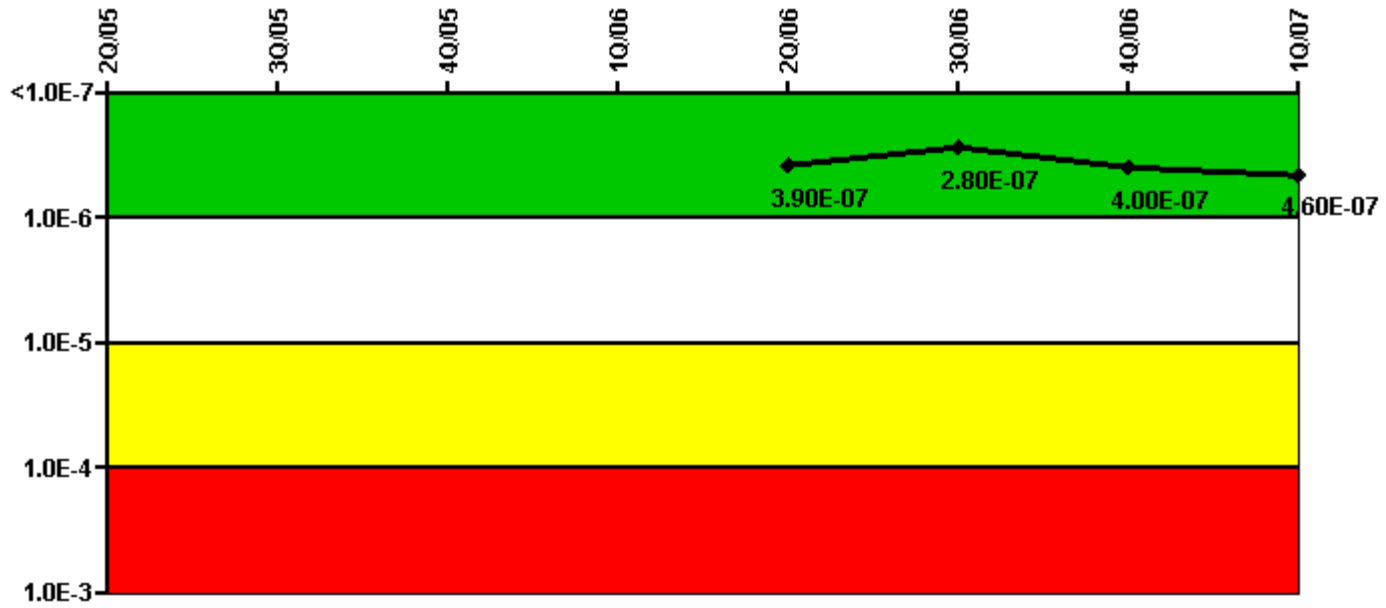


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					1.40E-07	1.40E-07	2.60E-07	3.20E-07
URI (Δ CDF)					2.50E-07	1.40E-07	1.40E-07	1.40E-07
PLE					NO	NO	NO	NO
Indicator value					3.90E-07	2.80E-07	4.00E-07	4.60E-07

Licensee Comments: none

Reactor Coolant System Activity

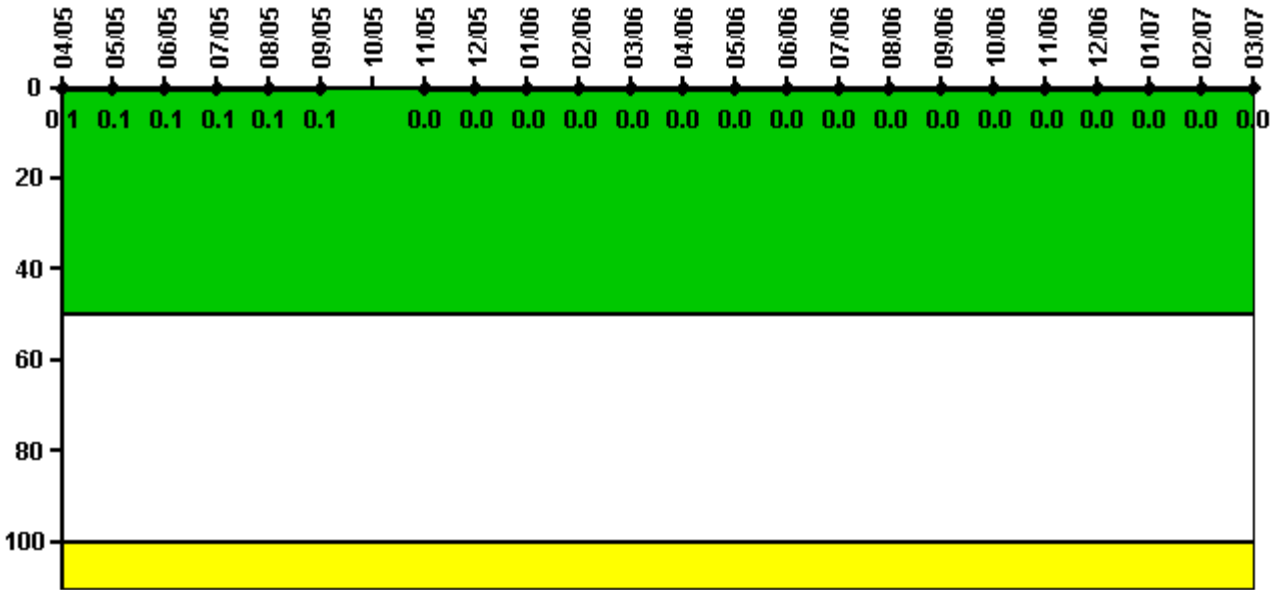

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum activity	0.000141	0.000153	0.000153	0.000155	0.000160	0.000153	N/A	0.000077	0.000078	0.000084	0.000084	0.000087
Technical specification limit	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	N/A	0	0	0	0	0

Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	0.000092	0.000089	0.000096	0.000090	0.000096	0.000094	0.000099	0.000118	0.000108	0.000118	0.000109	0.000114
Technical specification limit	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

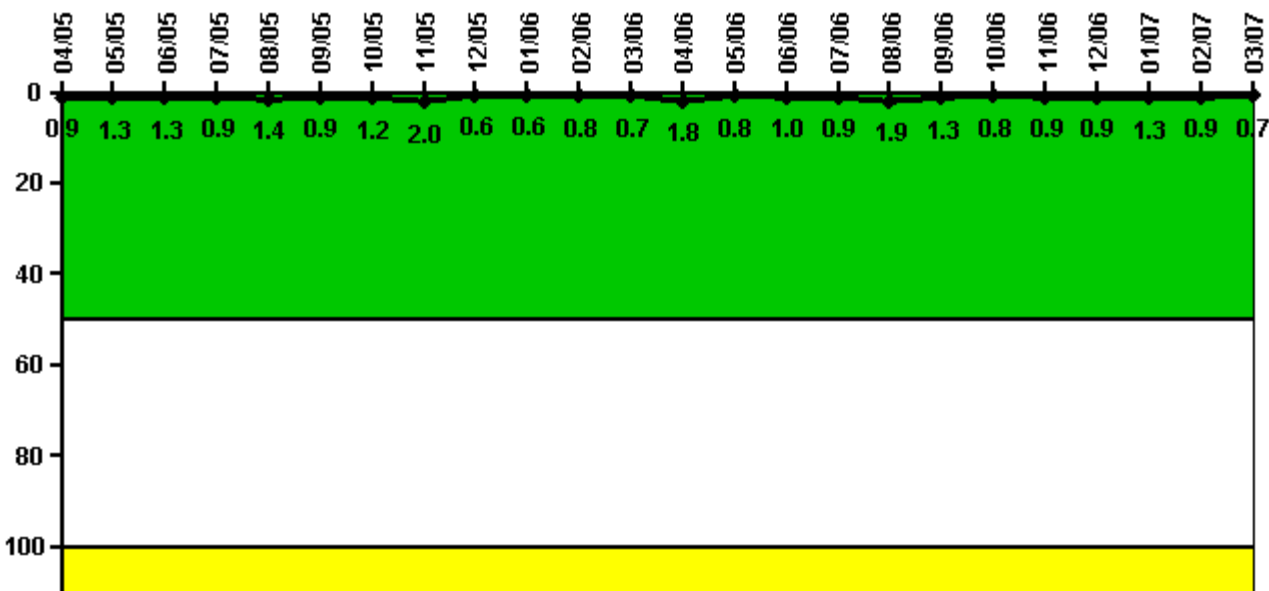

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum leakage	0.090	0.130	0.130	0.090	0.140	0.090	0.120	0.200	0.060	0.060	0.080	0.070
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.9	1.3	1.3	0.9	1.4	0.9	1.2	2.0	0.6	0.6	0.8	0.7

Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	0.180	0.080	0.100	0.090	0.190	0.130	0.080	0.090	0.090	0.130	0.090	0.070
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.8	0.8	1.0	0.9	1.9	1.3	0.8	0.9	0.9	1.3	0.9	0.7

Licensee Comments: none

Drill/Exercise Performance

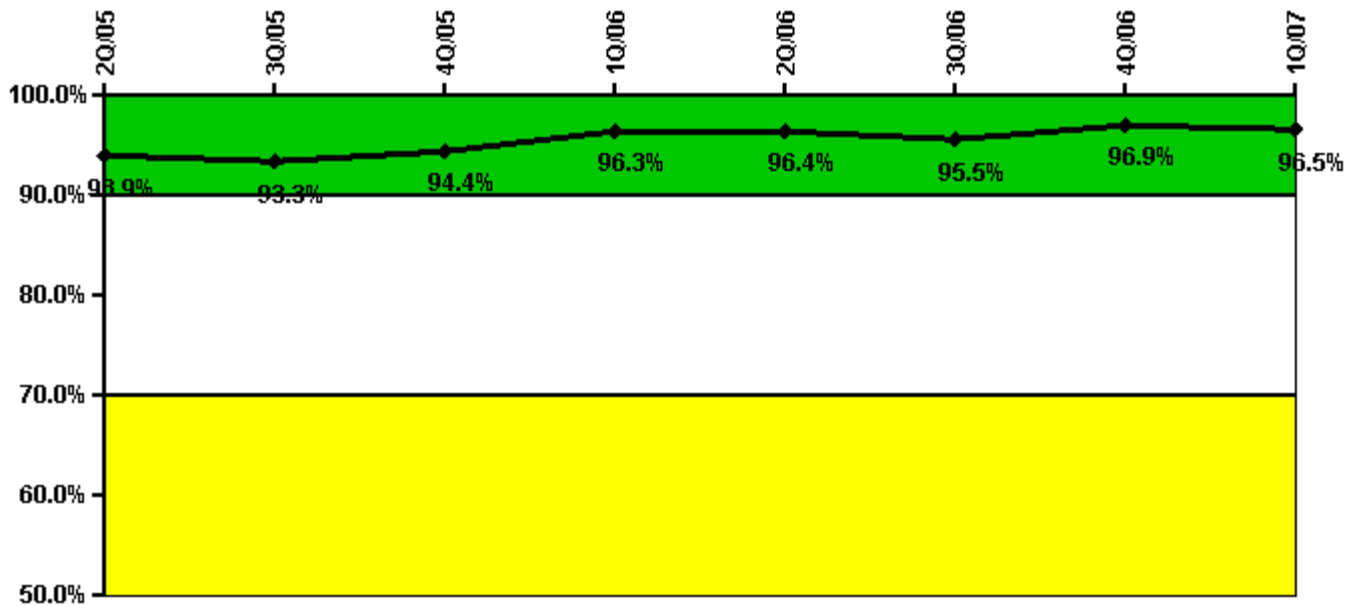

Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful opportunities	25.0	2.0	20.0	30.0	8.0	32.0	7.0	40.0
Total opportunities	25.0	2.0	20.0	31.0	8.0	34.0	8.0	42.0
Indicator value	93.9%	93.3%	94.4%	96.3%	96.4%	95.5%	96.9%	96.5%

Licensee Comments:

1Q/07: Corrected data provided via change report for first quarter 2006 and third quarter 2006. Indicator remains Green.

ERO Drill Participation




Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Participating Key personnel	58.0	59.0	56.0	57.0	54.0	58.0	54.0	54.0
Total Key personnel	59.0	60.0	57.0	58.0	55.0	58.0	55.0	55.0
Indicator value	98.3%	98.3%	98.2%	98.3%	98.2%	100.0%	98.2%	98.2%

Licensee Comments: none

Alert & Notification System

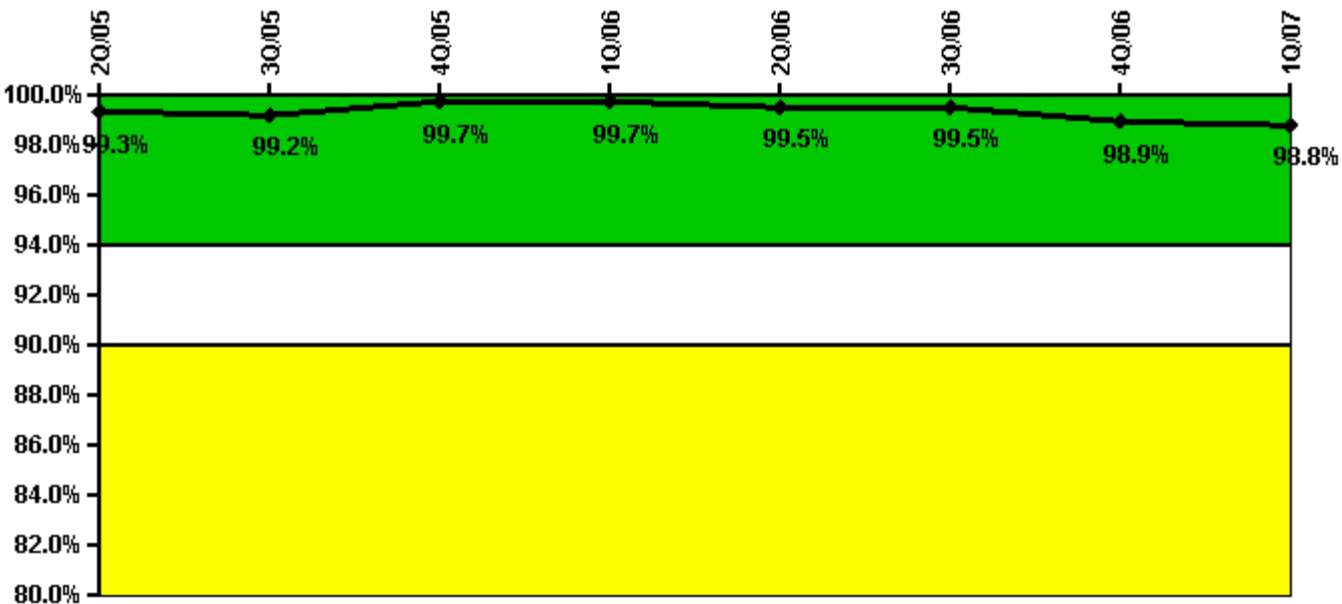

Thresholds: White < 94.0% Yellow < 90.0%


Notes

Alert & Notification System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful siren-tests	630	624	720	628	625	623	704	626
Total sirens-tests	630	630	720	630	630	630	720	630
Indicator value	99.3%	99.2%	99.7%	99.7%	99.5%	99.5%	98.9%	98.8%

Licensee Comments:

1Q/07: Corrected data provided via change report for fourth quarter 2006. Indicator remains Green.

Occupational Exposure Control Effectiveness

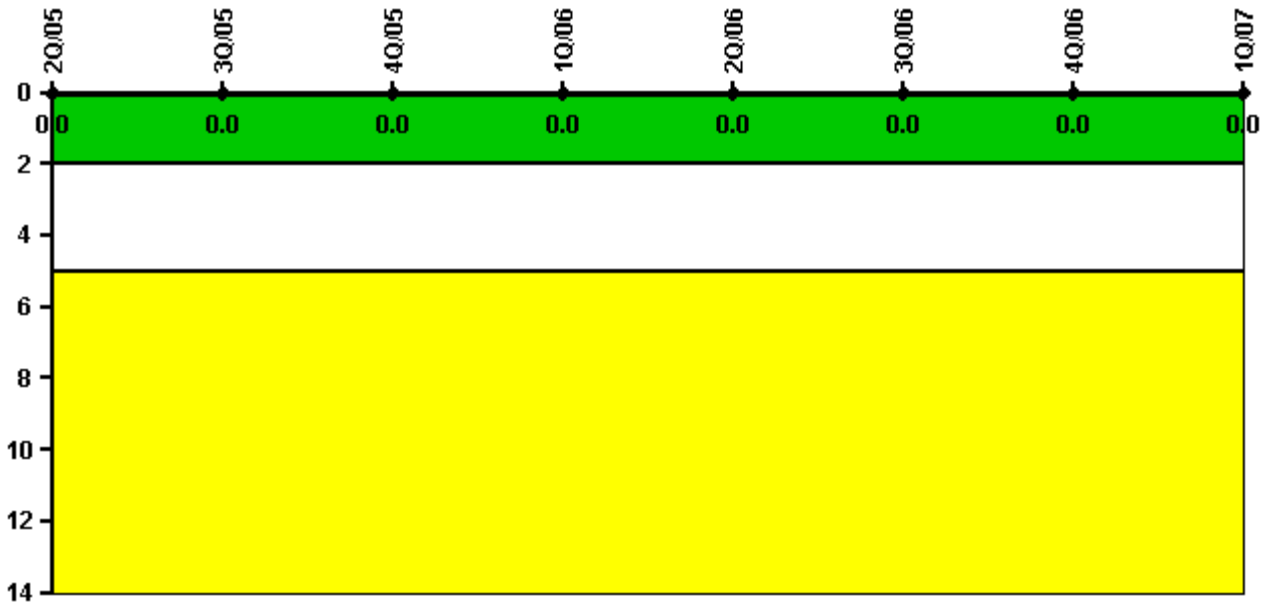

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: June 1, 2007