


Saint Lucie 1

1Q/2007 Performance Indicators

Licensee's General Comments: Independent validation of the 2005 MSPI CDE unavailability hours resulted in the revision to previous the values contained in CDE. A revision to the MSPI Design Bases Document changed some component reliability values (e.g., component demand and run hour data – not component level PRA data) contained in CDE. These internal CDE value changes caused the re-quantification of the MSPI indices.

Unplanned Scrams per 7000 Critical Hrs

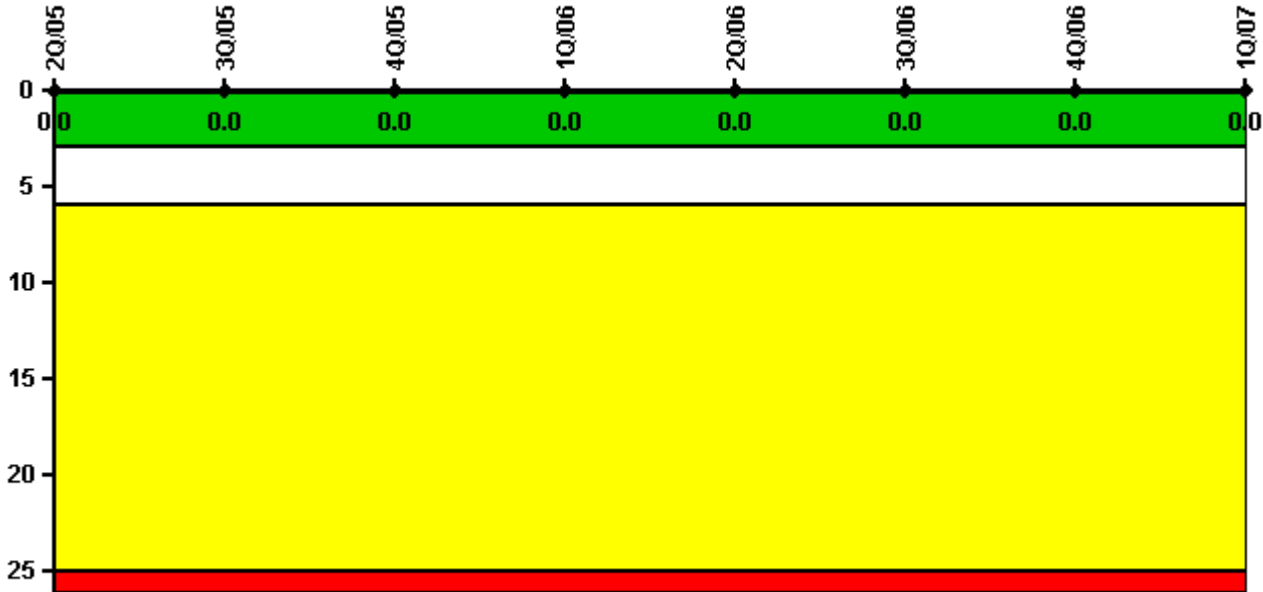


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2183.0	2208.0	692.0	2160.0	2183.0	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

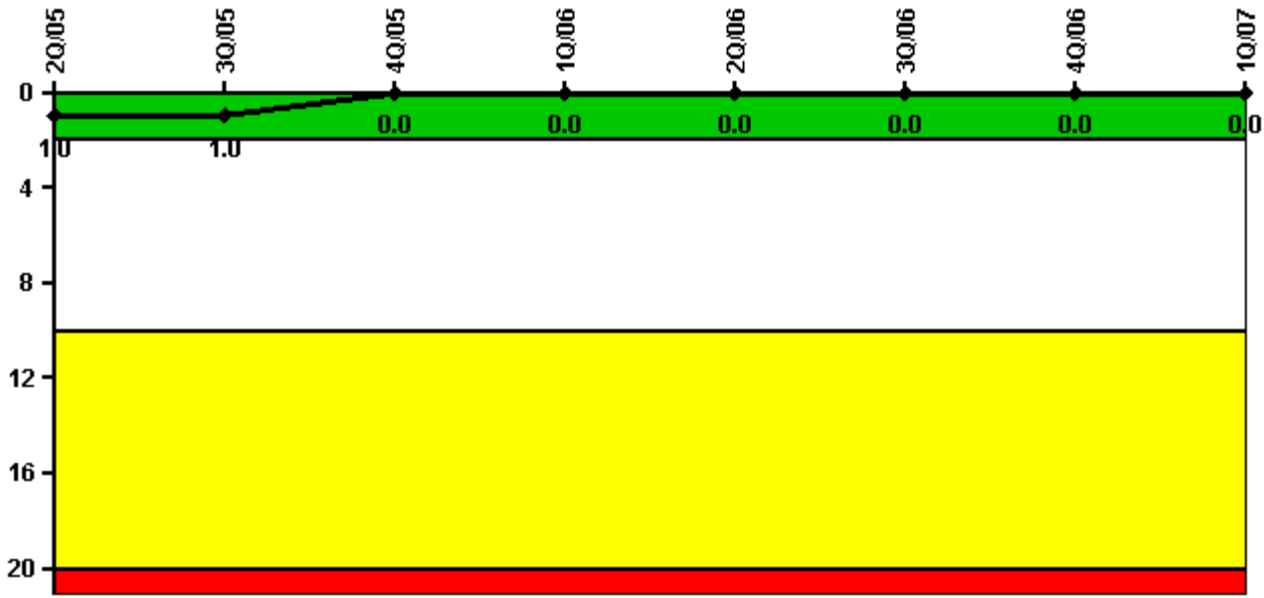


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Scrams	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

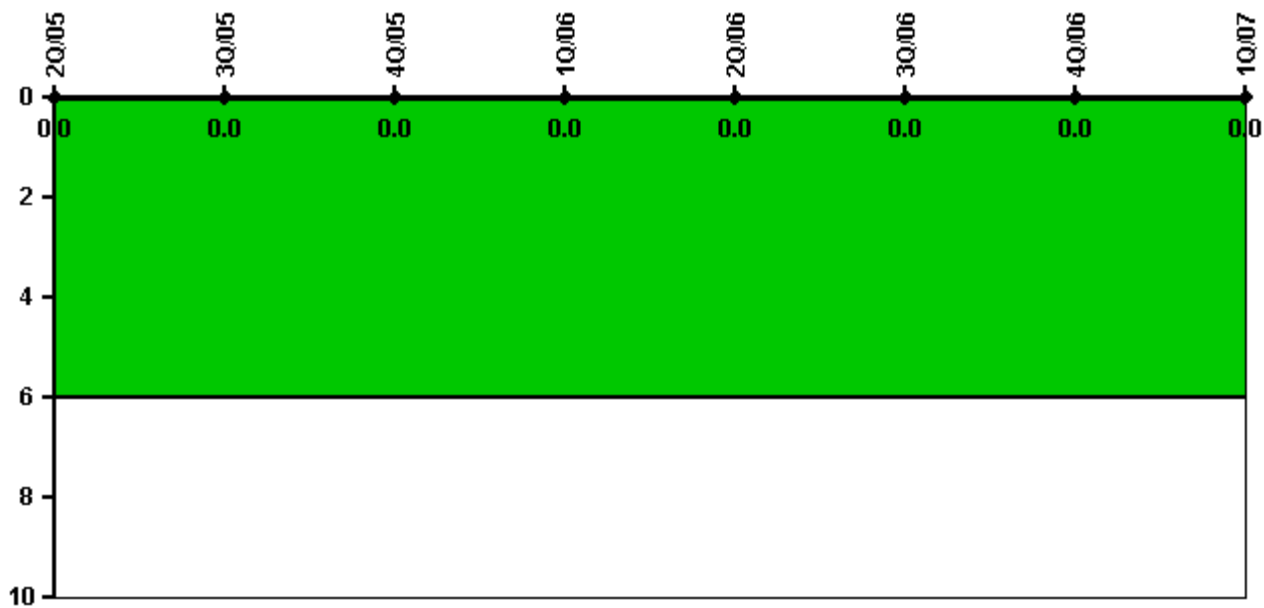


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2183.0	2208.0	692.0	2160.0	2183.0	2208.0	2209.0	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Safety System Functional Failures (PWR)

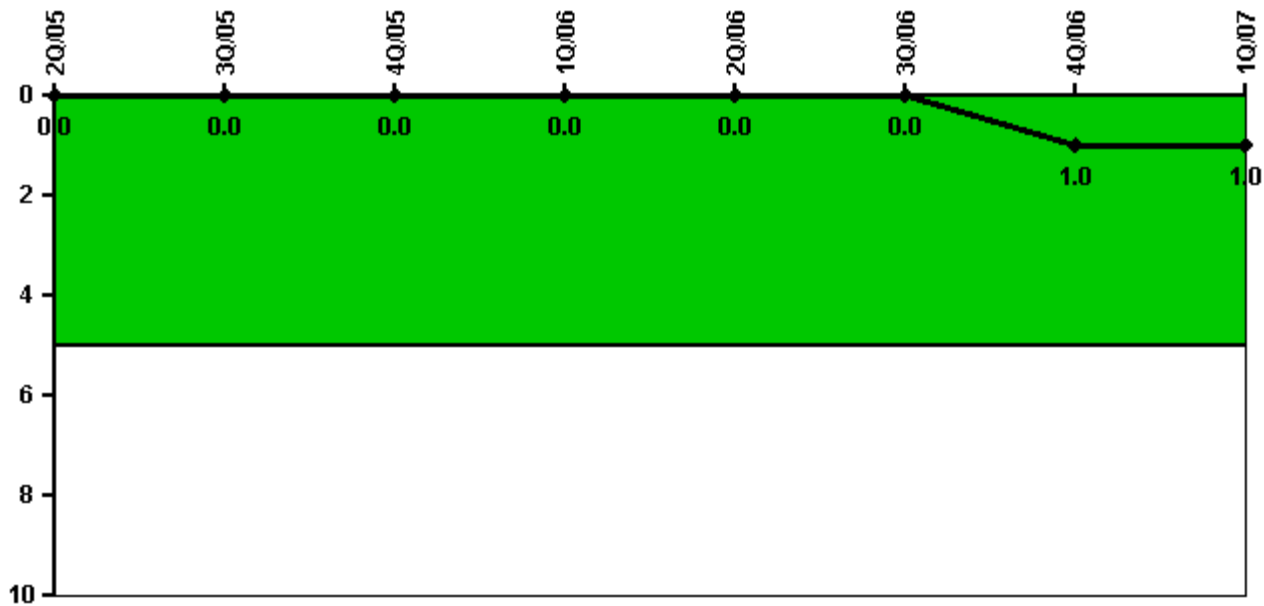


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Safety System Functional Failures	0	0	0	0	0	0	1	0
Indicator value	0	0	0	0	0	0	1	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

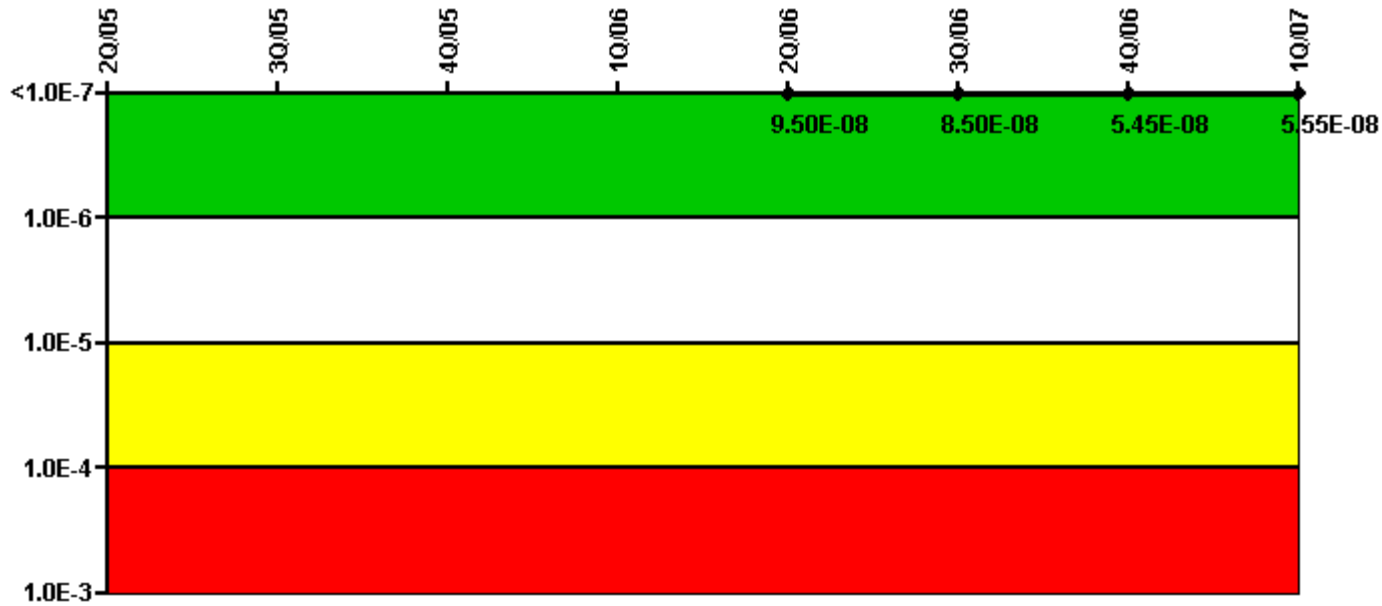

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (ΔCDF)					1.50E-07	1.40E-07	5.10E-08	5.20E-08
URI (ΔCDF)					-5.50E-08	-5.50E-08	3.50E-09	3.50E-09
PLE					NO	NO	NO	NO
Indicator value					9.50E-08	8.50E-08	5.45E-08	5.55E-08

Licensee Comments:

1Q/07: Changed PRA Parameter(s). A forced override of the Train A FVUAP CDE data was performed to correct a typographical error made during the 4Q/2006 PSA model update data entry. The incorrect value of 1.4303 was corrected to 1.43E-03.

4Q/06: Changed PRA Parameter(s). Unit 1 EAC train A FVUAP value was corrected. The September 06 MSPI Basis Document update value of 1.43E-03 was incorrectly entered as 1.4303 (no exponent). This value was corrected on February 8, 2007.

Mitigating Systems Performance Index, High Pressure Injection System

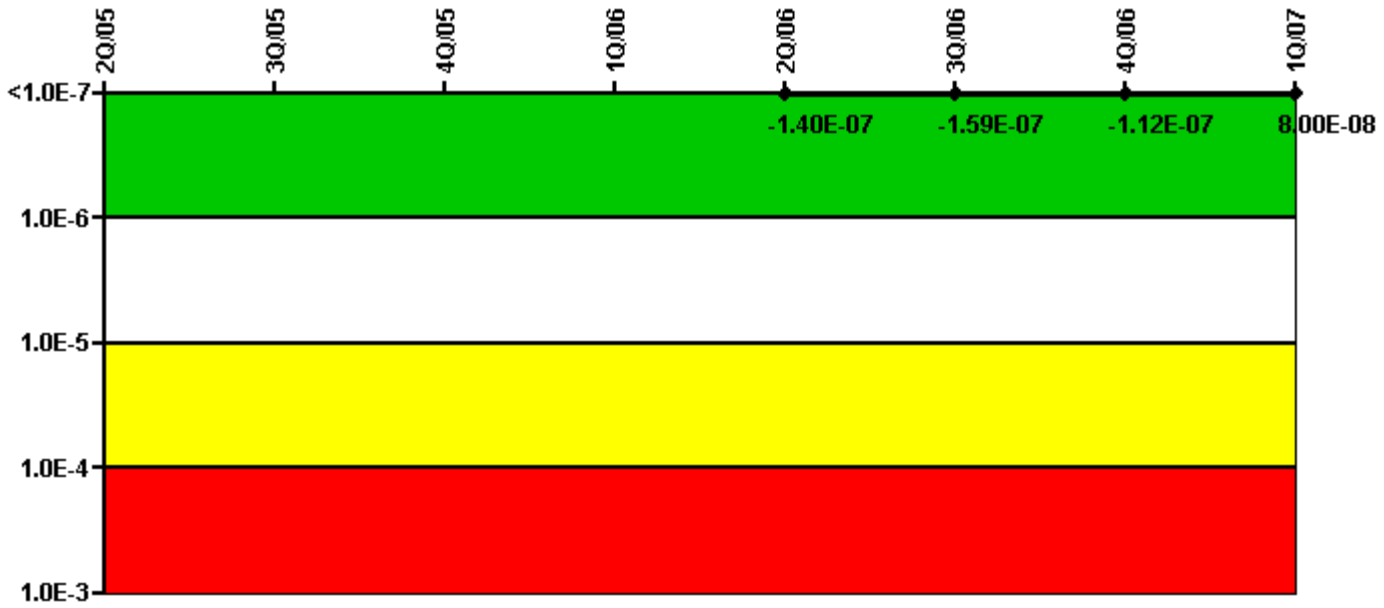


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					6.00E-08	4.10E-08	2.80E-08	2.20E-07
URI (Δ CDF)					-2.00E-07	-2.00E-07	-1.40E-07	-1.40E-07
PLE					NO	NO	NO	NO
Indicator value					-1.40E-07	-1.59E-07	-1.12E-07	8.00E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

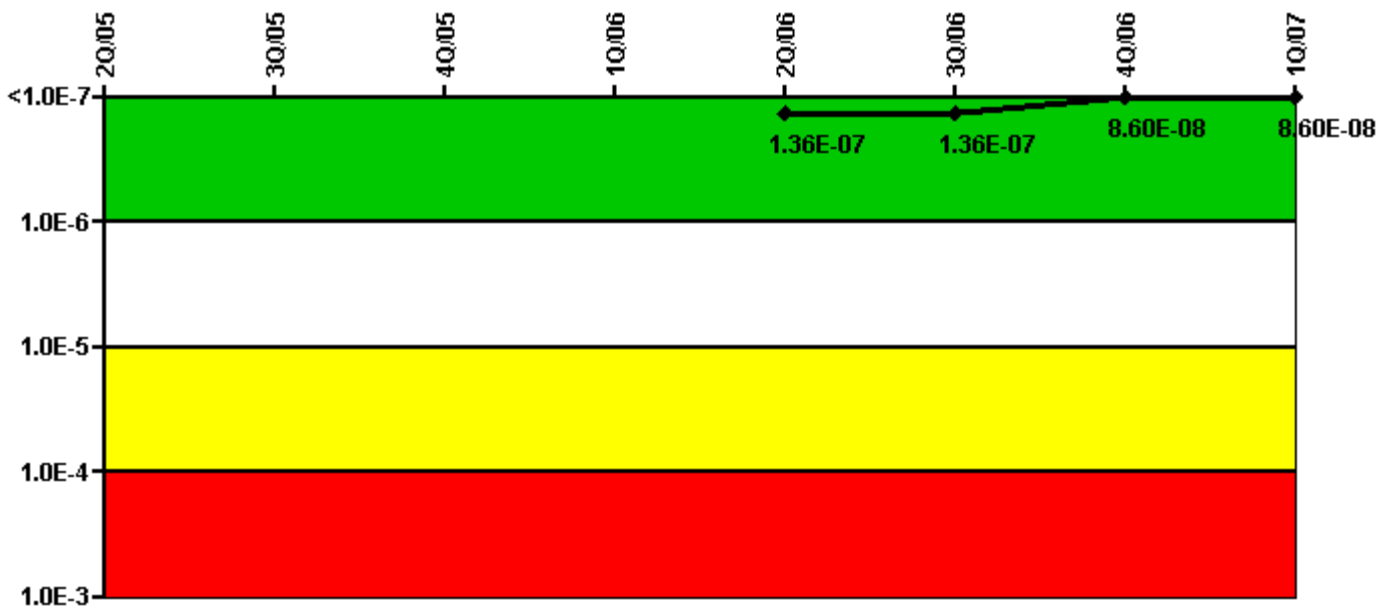


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					2.60E-08	2.60E-08	2.20E-08	2.20E-08
URI (Δ CDF)					1.10E-07	1.10E-07	6.40E-08	6.40E-08
PLE					NO	NO	NO	NO
Indicator value					1.36E-07	1.36E-07	8.60E-08	8.60E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

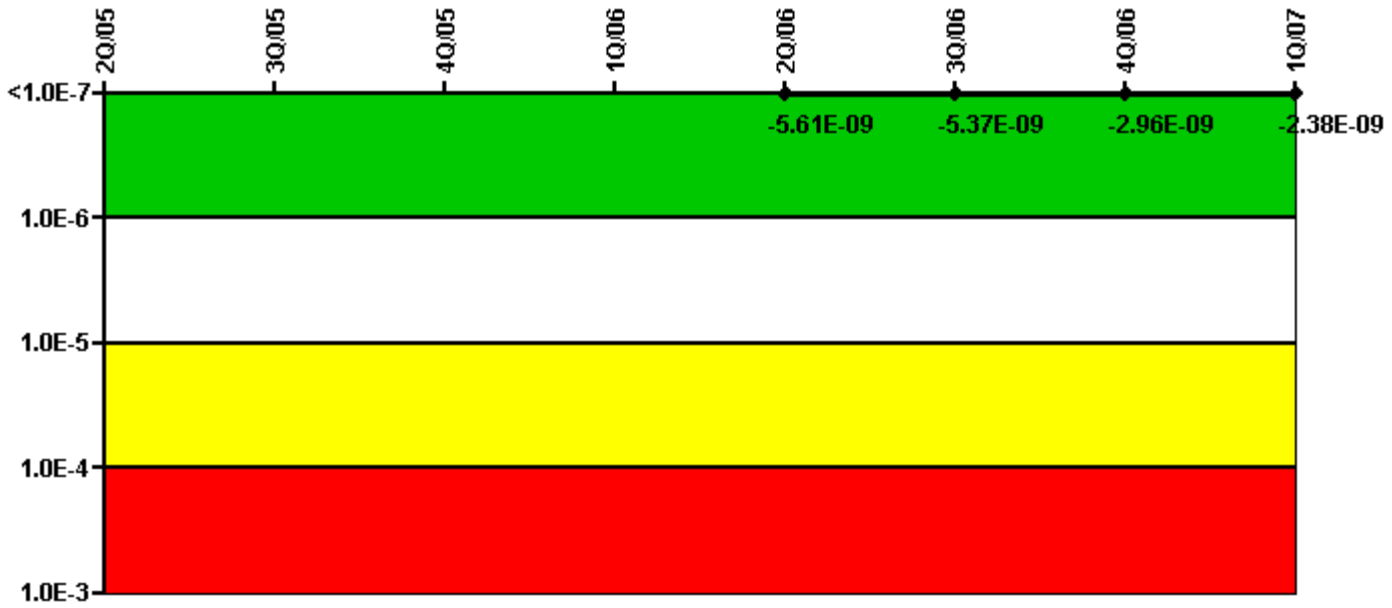


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					-6.10E-10	-3.70E-10	-2.60E-10	3.20E-10
URI (Δ CDF)					-5.00E-09	-5.00E-09	-2.70E-09	-2.70E-09
PLE					NO	NO	NO	NO
Indicator value					-5.61E-09	-5.37E-09	-2.96E-09	-2.38E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

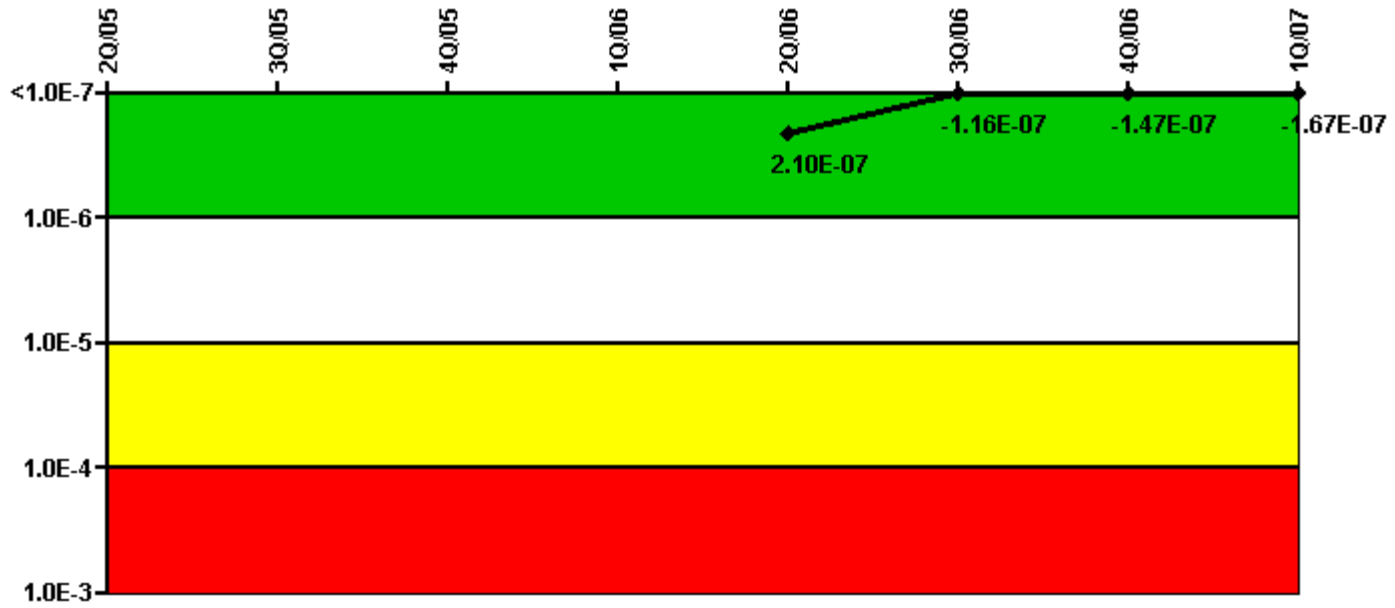


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					1.10E-07	-1.60E-07	-1.40E-07	-1.60E-07
URI (Δ CDF)					1.00E-07	4.40E-08	-6.80E-09	-6.80E-09
PLE					NO	NO	NO	NO
Indicator value					2.10E-07	-1.16E-07	-1.47E-07	-1.67E-07

Licensee Comments: none

Reactor Coolant System Activity

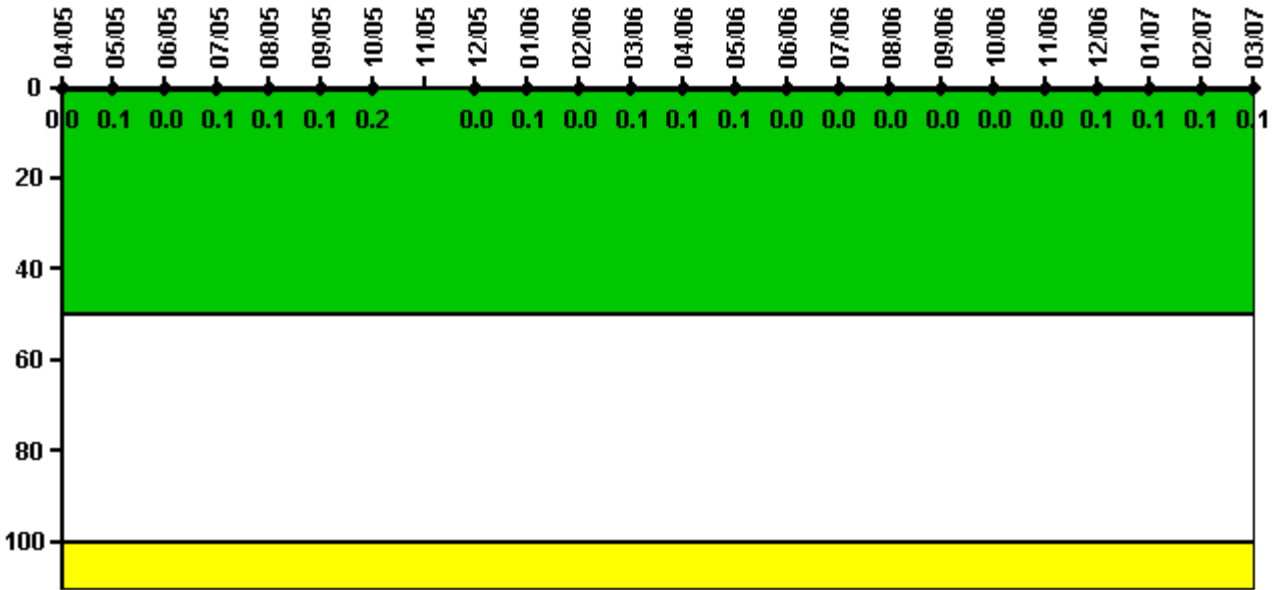

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum activity	0.000487	0.001160	0.000486	0.000772	0.000719	0.000755	0.001540	N/A	0.000313	0.001030	0.000481	0.000514
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0.1	0	0.1	0.1	0.1	0.2	N/A	0	0.1	0	0.1

Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	0.000526	0.000519	0.000467	0.000457	0.000467	0.000475	0.000490	0.000499	0.000541	0.000525	0.000709	0.001150
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0	0	0	0	0	0	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

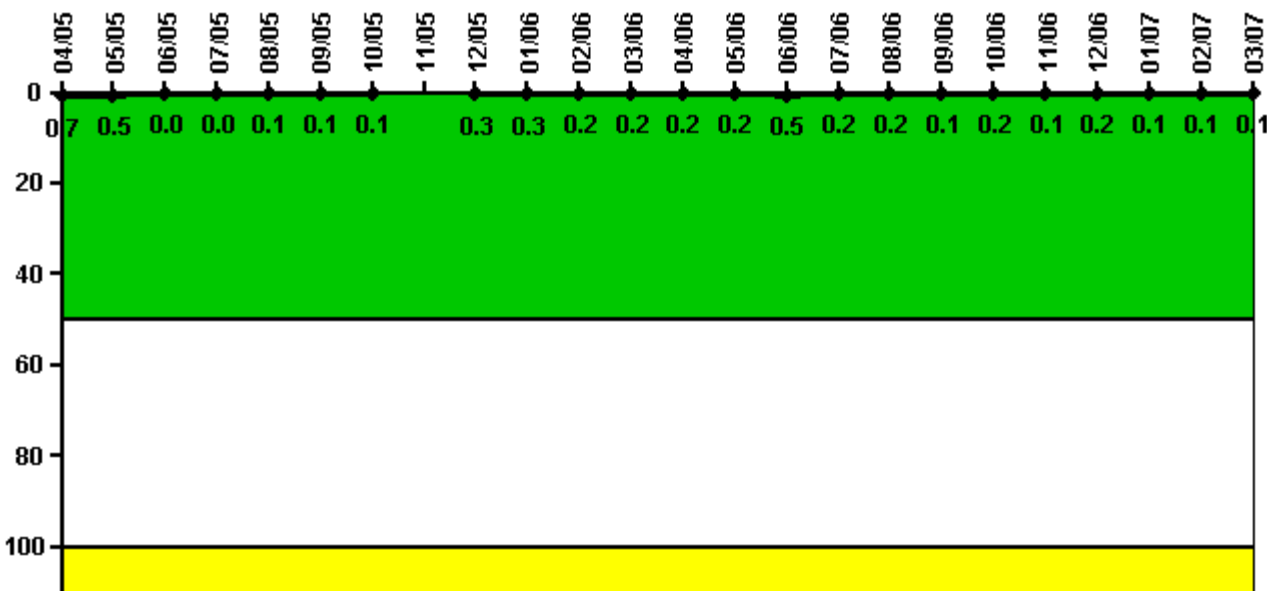

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum leakage	0.070	0.045	0	0.003	0.005	0.010	0.009	N/A	0.030	0.030	0.020	0.020
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	0.5	0	0	0.1	0.1	0.1	N/A	0.3	0.3	0.2	0.2

Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	0.023	0.018	0.045	0.020	0.018	0.014	0.020	0.010	0.023	0.010	0.010	0.013
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.2	0.5	0.2	0.2	0.1	0.2	0.1	0.2	0.1	0.1	0.1

Licensee Comments: none

Drill/Exercise Performance

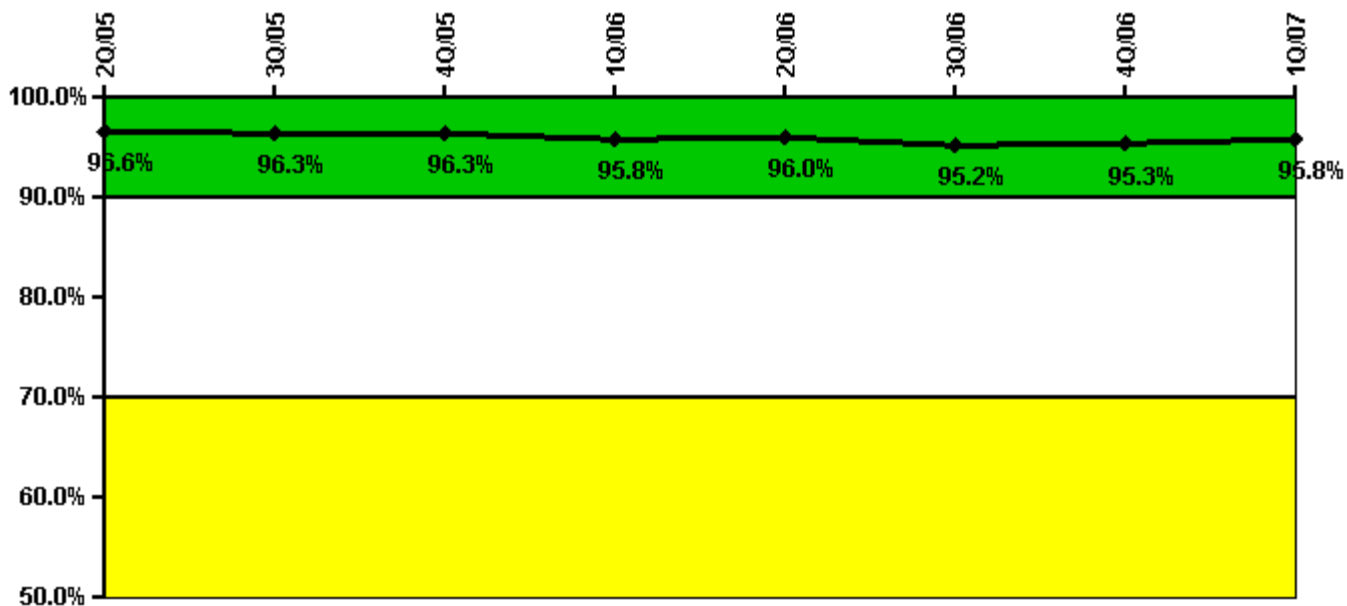


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful opportunities	88.0	67.0	9.0	49.0	66.0	71.0	78.0	113.0
Total opportunities	90.0	71.0	10.0	52.0	68.0	78.0	80.0	116.0
Indicator value	96.6%	96.3%	96.3%	95.8%	96.0%	95.2%	95.3%	95.8%

Licensee Comments: none

ERO Drill Participation

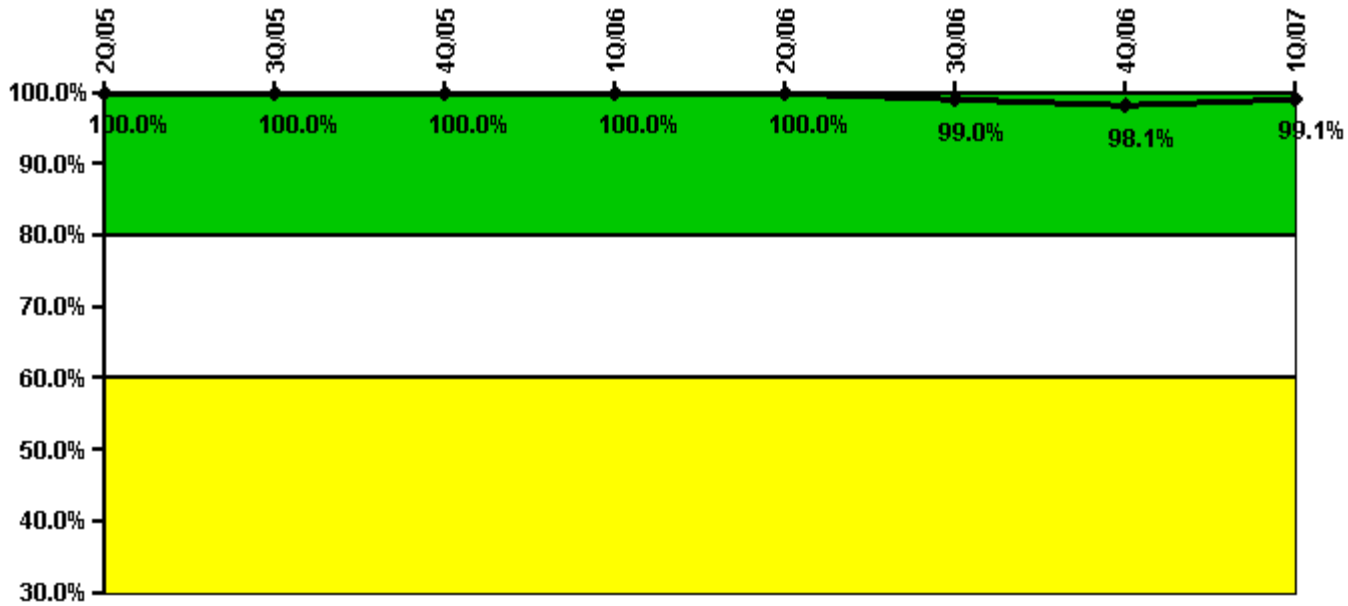


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Participating Key personnel	87.0	88.0	87.0	81.0	91.0	98.0	104.0	106.0
Total Key personnel	87.0	88.0	87.0	81.0	91.0	99.0	106.0	107.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	99.0%	98.1%	99.1%

Licensee Comments: none

Alert & Notification System

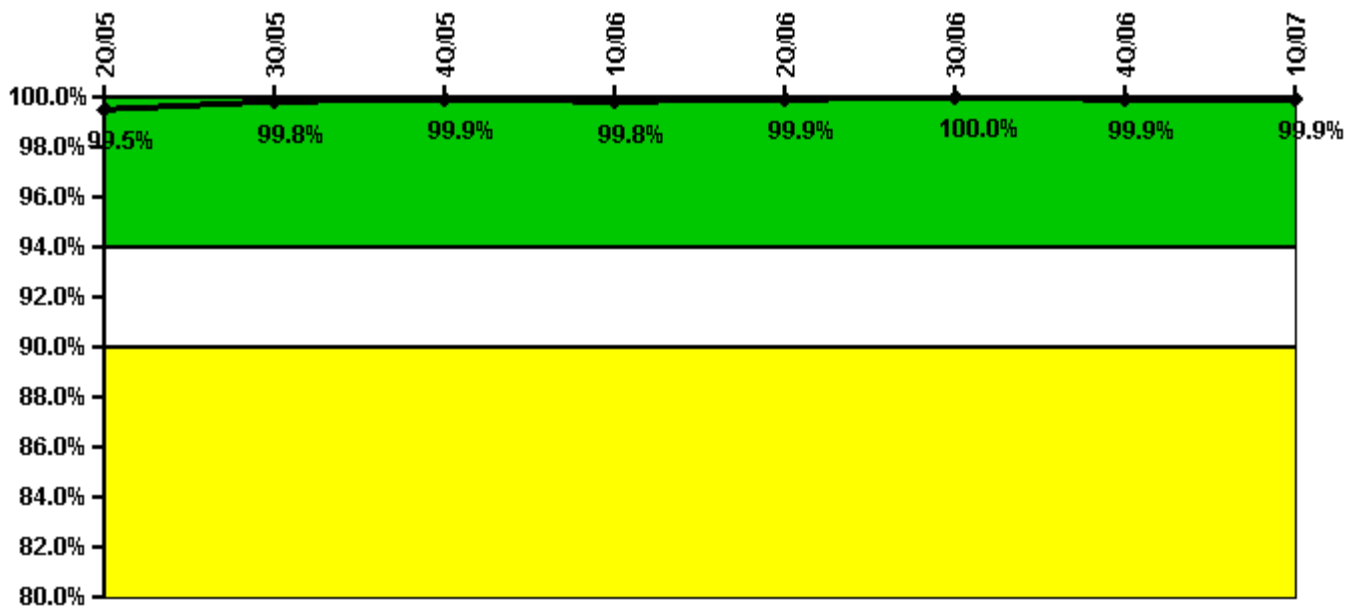

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful siren-tests	621	711	536	719	630	630	629	719
Total sirens-tests	623	712	536	720	630	630	630	720
Indicator value	99.5%	99.8%	99.9%	99.8%	99.9%	100.0%	99.9%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness




Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

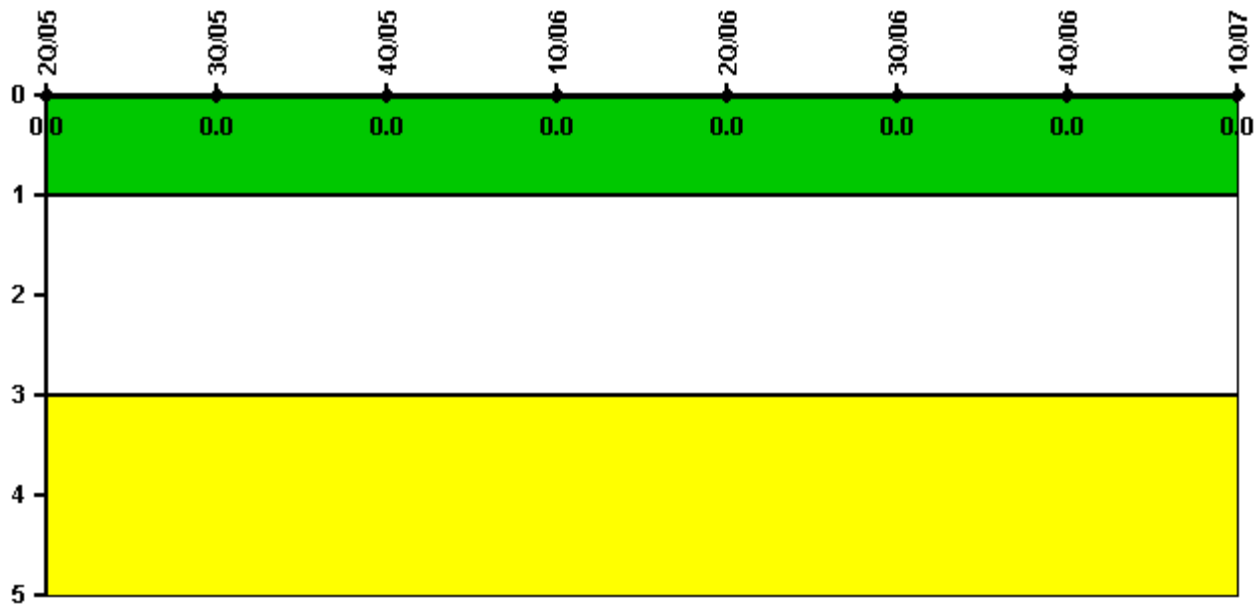

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: June 1, 2007