


# Ginna

## 4Q/2007 Performance Indicators

Licensee's General Comments: Added 6.38 planned unavailable hours on SI segment SI-RB for July 2006. The hours were not accurately identified for the MSPI segment during data collection. UAI changed from  $-1.0E-08$  to  $-9.9E-09$  for 2Q2007 and 3Q2007. The color of the indicator was not affected.

### Unplanned Scrams per 7000 Critical Hrs

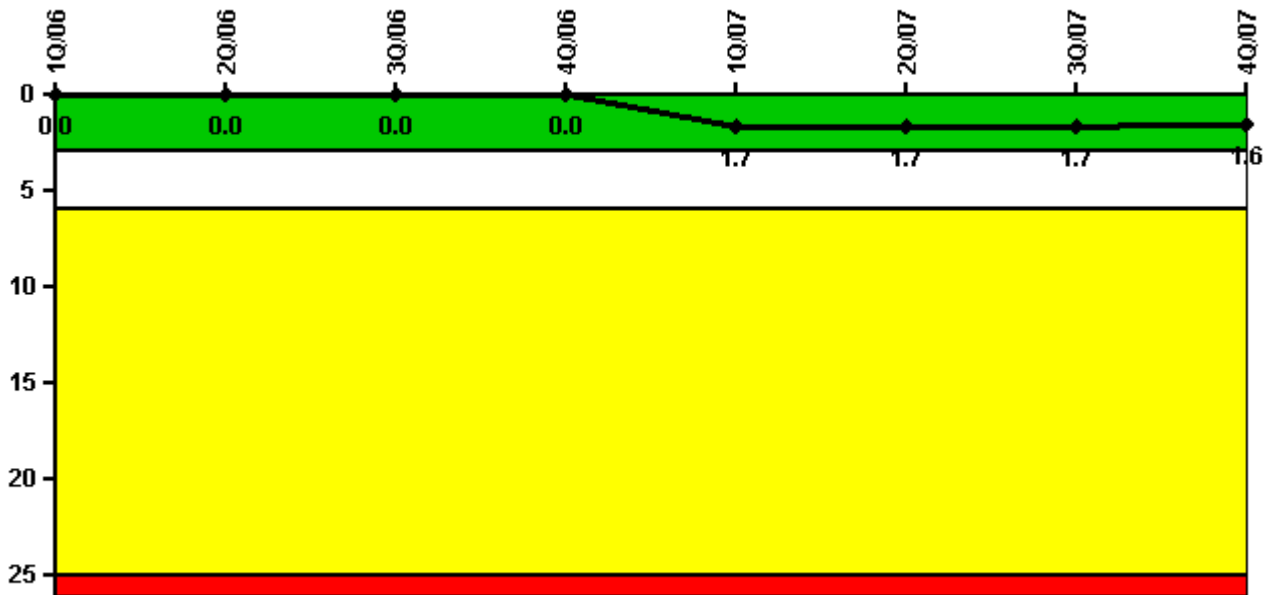


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned scrams	0	0	0	0	2.0	0	0	0
Critical hours	2160.0	2183.0	2208.0	1644.0	2091.8	2184.0	2208.0	2209.0
Indicator value	0	0	0	0	1.7	1.7	1.7	1.6

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

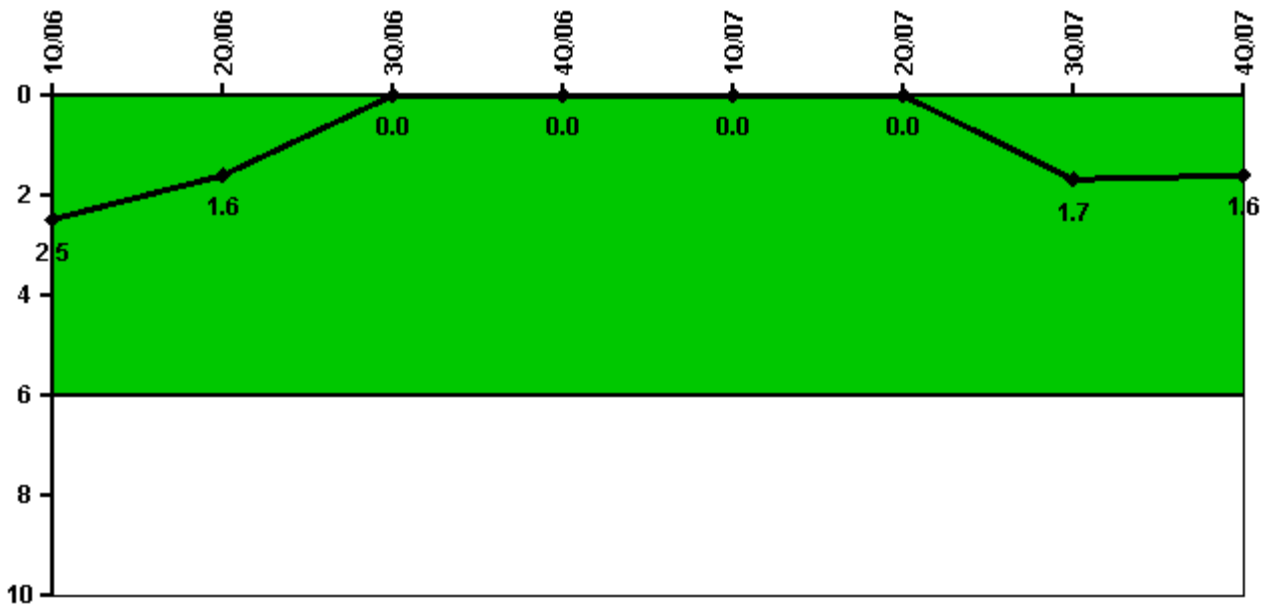


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned power changes	0	0	0	0	0	0	2.0	0
Critical hours	2160.0	2183.0	2208.0	1644.0	2091.8	2184.0	2208.0	2209.0
<b>Indicator value</b>	<b>2.5</b>	<b>1.6</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1.7</b>	<b>1.6</b>

Licensee Comments: none

# Unplanned Scrams with Complications

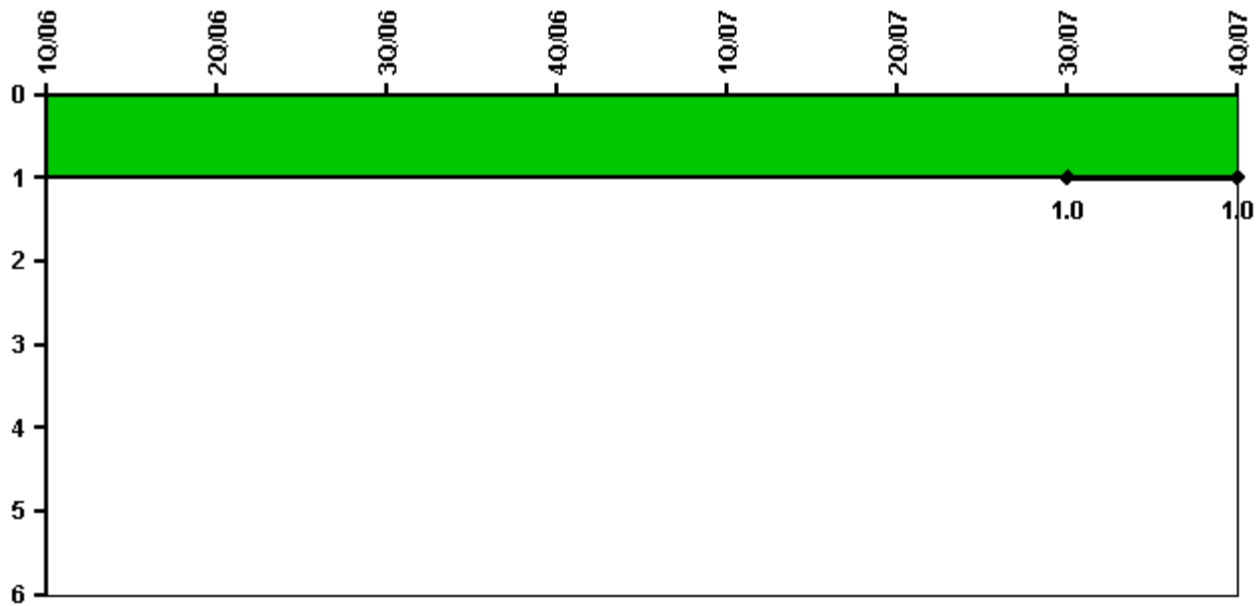


Thresholds: White > 1.0

## Notes

Unplanned Scrams with Complications	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Scrams with complications				0	1.0	0	0	0
<b>Indicator value</b>							<b>1.0</b>	<b>1.0</b>

Licensee Comments: none

## Safety System Functional Failures (PWR)

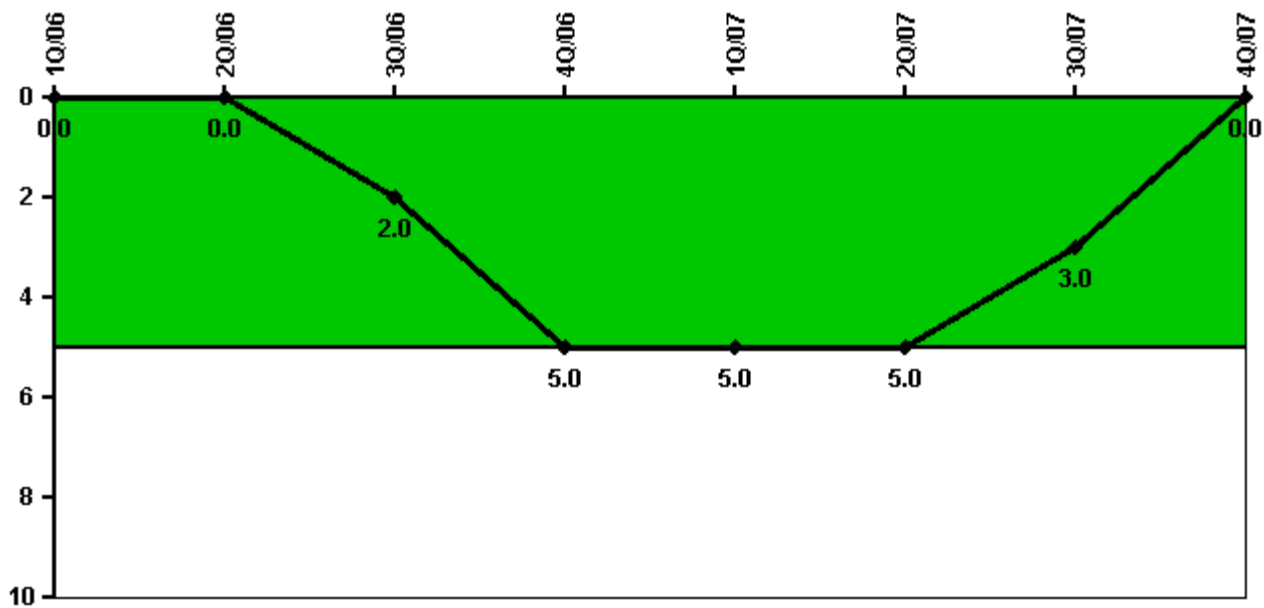


Thresholds: White > 5.0

### Notes

Safety System Functional Failures (PWR)	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Safety System Functional Failures	0	0	2	3	0	0	0	0
Indicator value	0	0	2	5	5	5	3	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

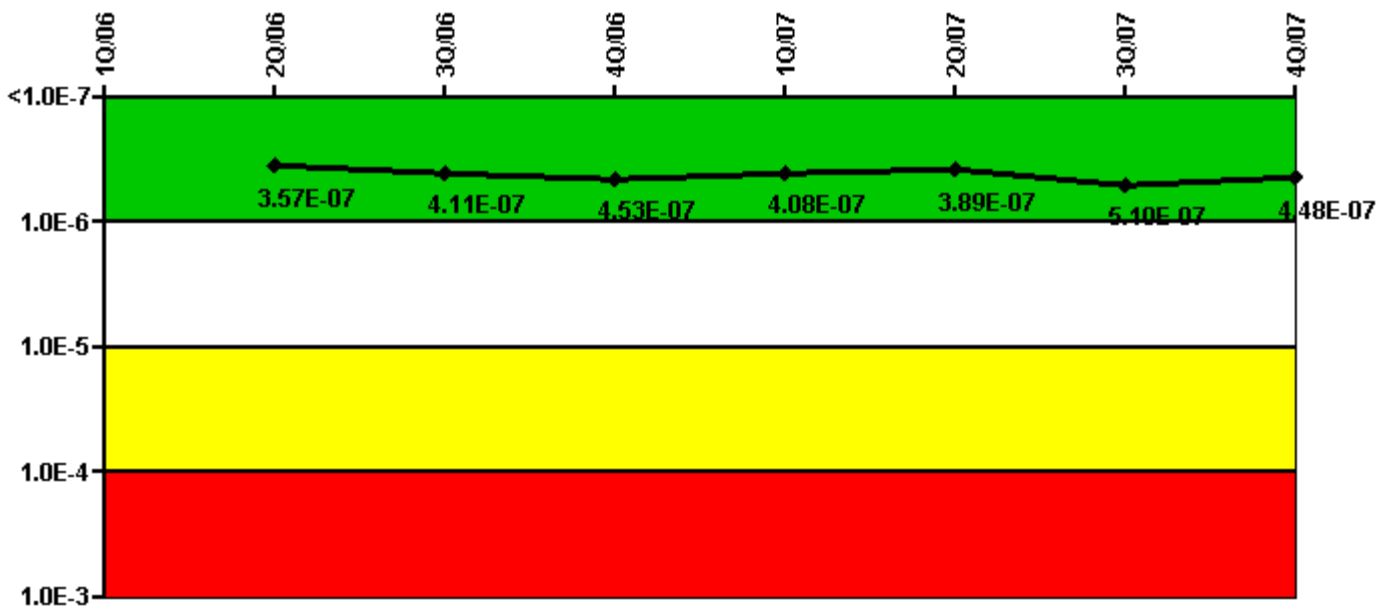


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		-2.70E-09	-2.90E-08	-2.70E-08	-4.20E-08	-2.10E-08	1.00E-07	3.80E-08
URI ( $\Delta$ CDF)		3.60E-07	4.40E-07	4.80E-07	4.50E-07	4.10E-07	4.10E-07	4.10E-07
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		3.57E-07	4.11E-07	4.53E-07	4.08E-07	3.89E-07	5.10E-07	4.48E-07

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

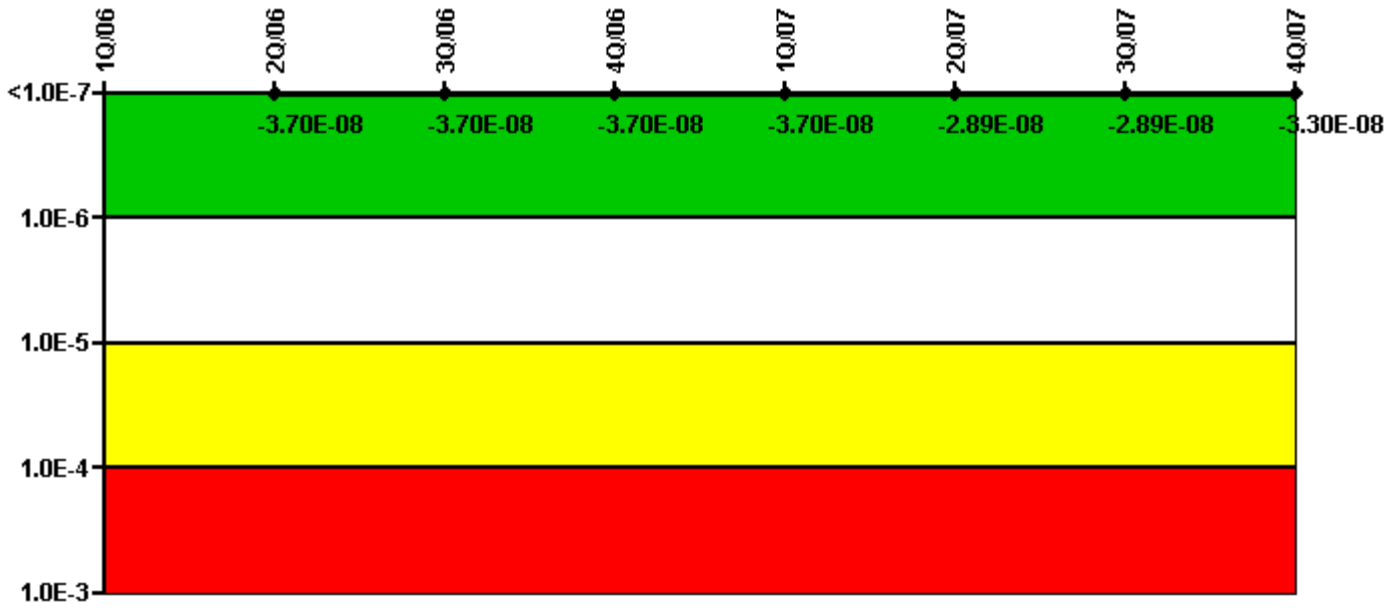


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		-1.50E-08	-1.50E-08	-1.50E-08	-1.50E-08	-9.90E-09	-9.90E-09	-1.20E-08
URI ( $\Delta$ CDF)		-2.20E-08	-2.20E-08	-2.20E-08	-2.20E-08	-1.90E-08	-1.90E-08	-2.10E-08
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-3.70E-08	-3.70E-08	-3.70E-08	-3.70E-08	-2.89E-08	-2.89E-08	-3.30E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

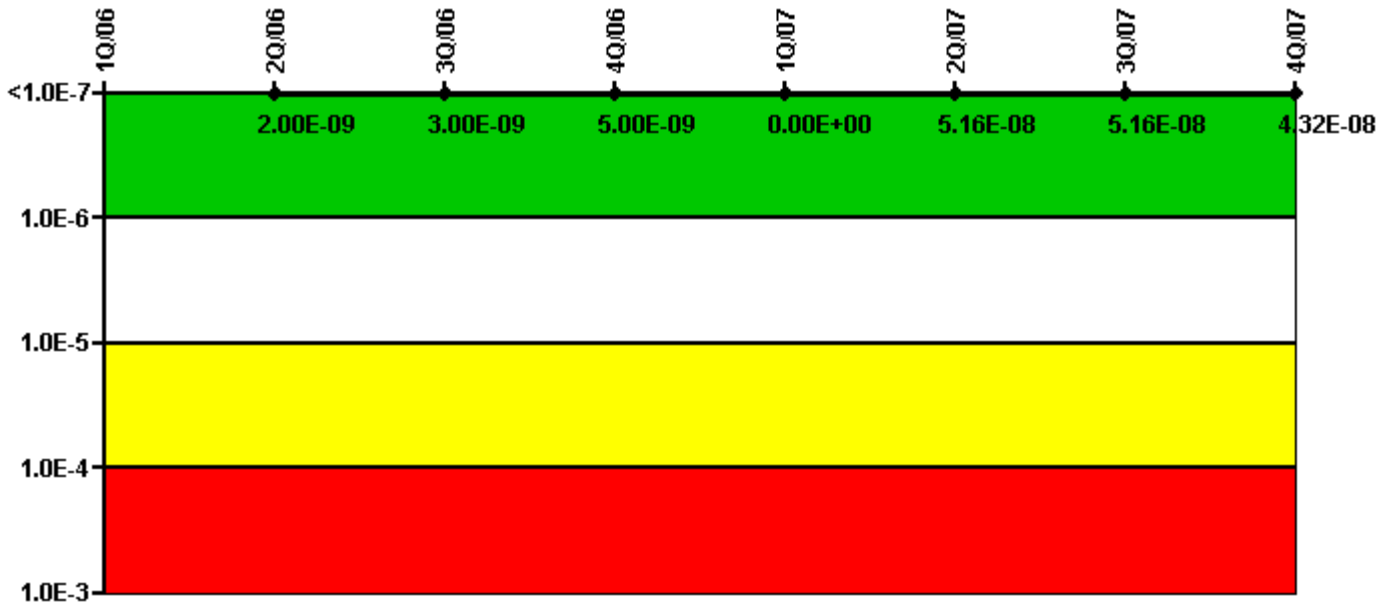


Thresholds: White >  $1.00E-6$  Yellow >  $1.00E-5$  Red >  $1.00E-4$

## Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		$2.20E-08$	$2.10E-08$	$2.30E-08$	$2.30E-08$	$5.90E-08$	$5.90E-08$	$5.30E-08$
URI ( $\Delta$ CDF)		$-2.00E-08$	$-1.80E-08$	$-1.80E-08$	$-2.30E-08$	$-7.40E-09$	$-7.40E-09$	$-9.80E-09$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$2.00E-09$	$3.00E-09$	$5.00E-09$	$0.00E+00$	$5.16E-08$	$5.16E-08$	$4.32E-08$

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

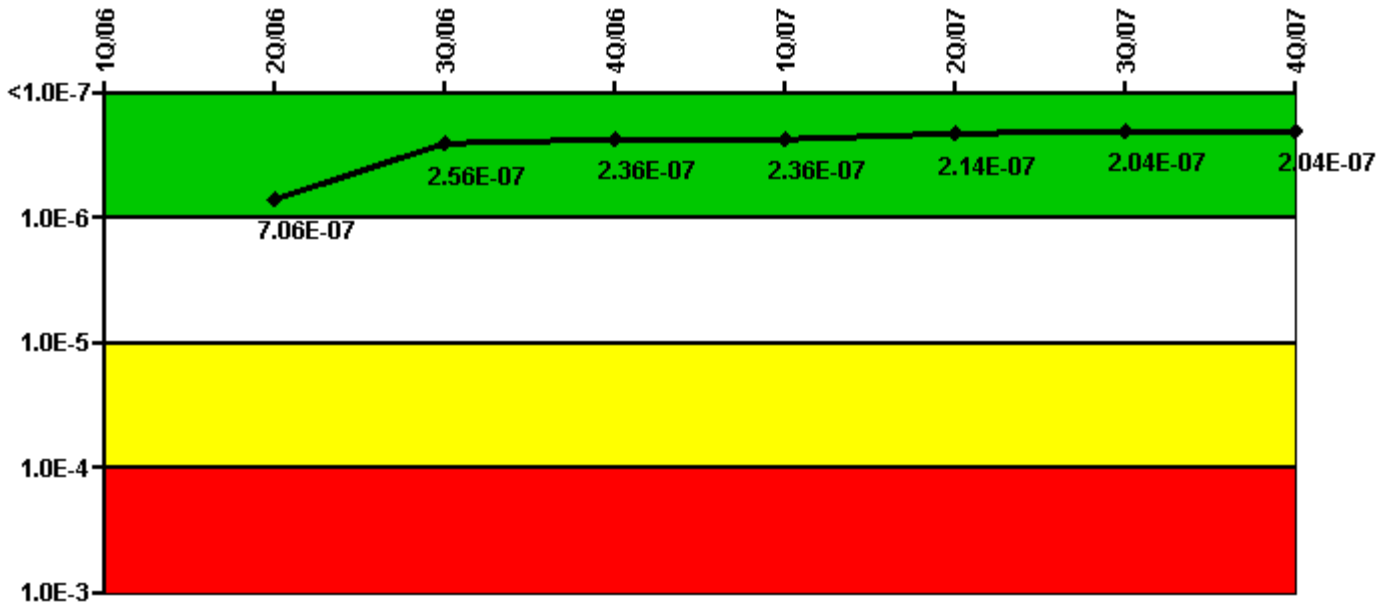

Thresholds: White >  $1.00E-6$  Yellow >  $1.00E-5$  Red >  $1.00E-4$


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		$1.60E-08$	$3.60E-08$	$2.60E-08$	$3.60E-08$	$3.70E-09$	$3.70E-09$	$3.70E-09$
URI ( $\Delta$ CDF)		$6.90E-07$	$2.20E-07$	$2.10E-07$	$2.00E-07$	$2.10E-07$	$2.00E-07$	$2.00E-07$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$7.06E-07$	$2.56E-07$	$2.36E-07$	$2.36E-07$	$2.14E-07$	$2.04E-07$	$2.04E-07$

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

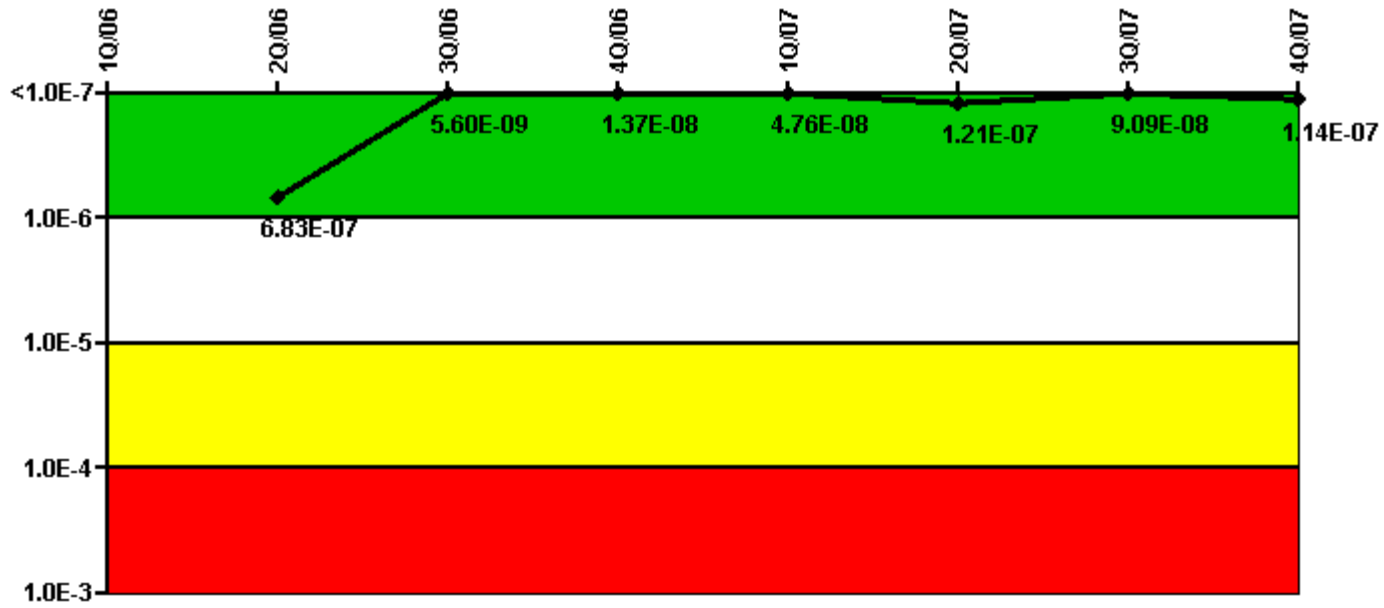

Thresholds: White >  $1.00E-6$  Yellow >  $1.00E-5$  Red >  $1.00E-4$

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		$6.90E-07$	$1.20E-08$	$2.00E-08$	$5.40E-08$	$1.20E-07$	$9.00E-08$	$9.60E-08$
URI ( $\Delta$ CDF)		$-6.80E-09$	$-6.40E-09$	$-6.30E-09$	$-6.40E-09$	$8.80E-10$	$9.00E-10$	$1.80E-08$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$6.83E-07$	$5.60E-09$	$1.37E-08$	$4.76E-08$	$1.21E-07$	$9.09E-08$	$1.14E-07$

Licensee Comments: none

# Reactor Coolant System Activity




Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum activity	0.003270	0.002740	0.003380	0.004030	0.003850	0.004200	0.004000	0.004050	0.003680	0.009500	0.000945	0.001460
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.4	1.0	0.1	0.1
Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.001540	0.001600	0.002240	0.002220	0.002880	0.002480	0.002620	0.002830	0.002960	0.003100	0.003180	0.003500
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.3	0.2	0.3	0.3	0.3	0.3	0.3	0.4

Licensee Comments: none

# Reactor Coolant System Leakage

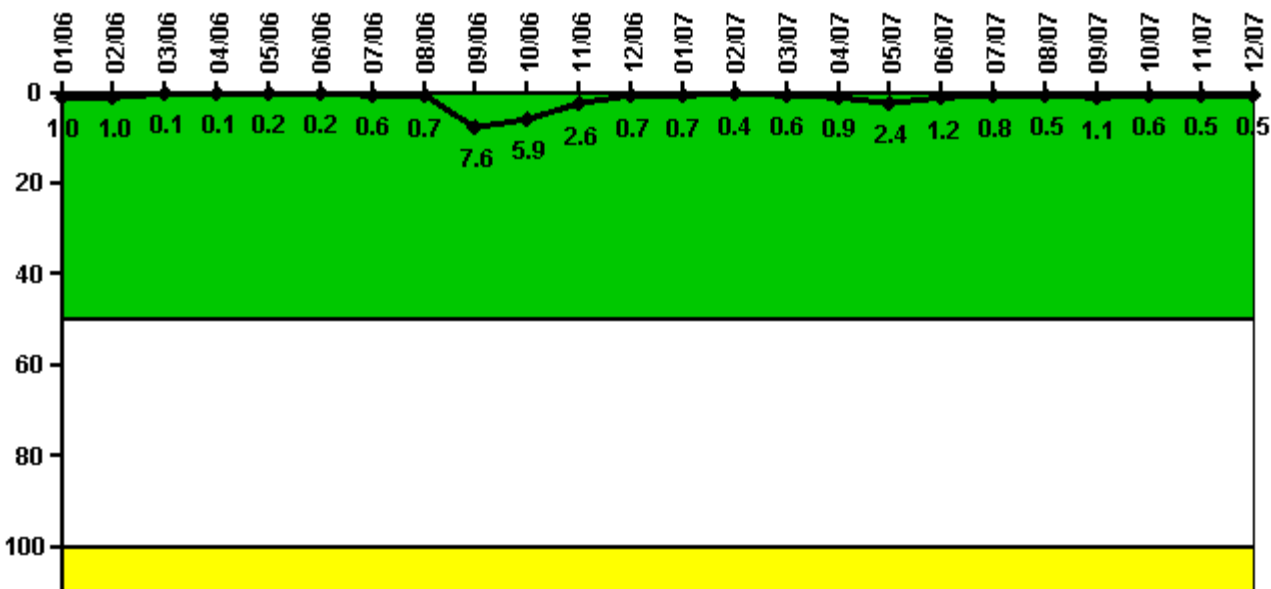

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Leakage	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum leakage	0.096	0.104	0.007	0.007	0.016	0.020	0.056	0.065	0.756	0.589	0.255	0.072
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.0	1.0	0.1	0.1	0.2	0.2	0.6	0.7	7.6	5.9	2.6	0.7

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	0.072	0.039	0.055	0.092	0.238	0.124	0.075	0.054	0.108	0.058	0.049	0.053
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	0.4	0.6	0.9	2.4	1.2	0.8	0.5	1.1	0.6	0.5	0.5

Licensee Comments: none

## Drill/Exercise Performance

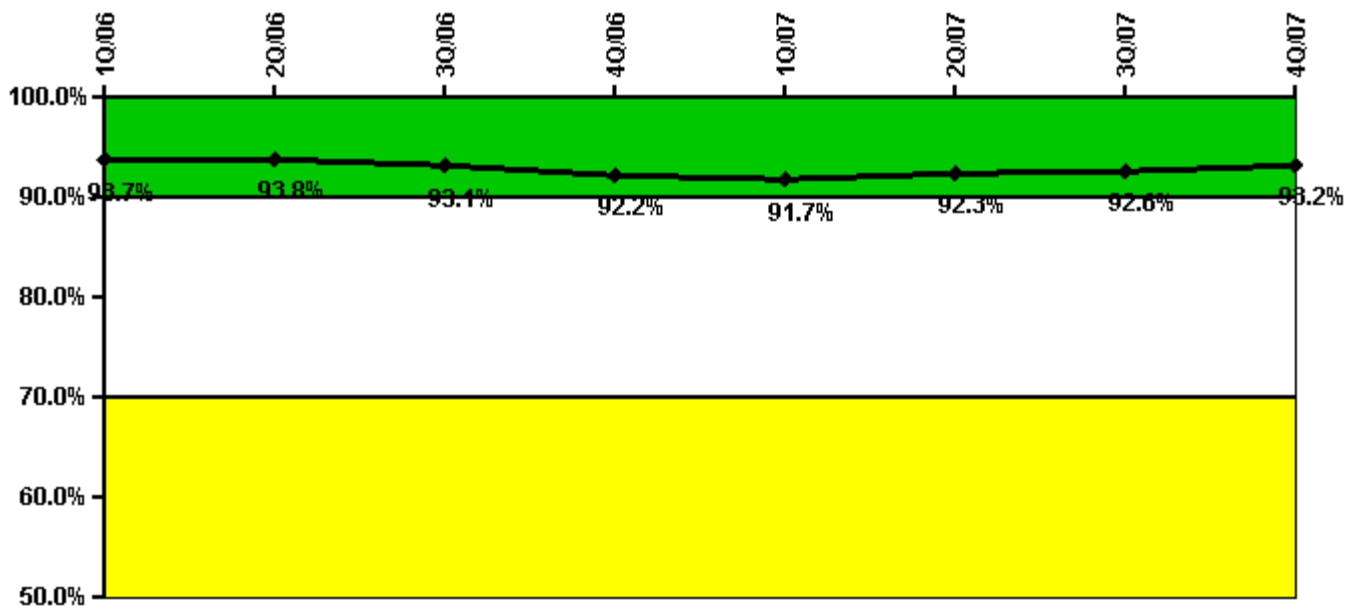


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful opportunities	32.0	41.0	10.0	14.0	64.0	42.0	9.0	33.0
Total opportunities	34.0	44.0	10.0	15.0	71.0	46.0	9.0	34.0
<b>Indicator value</b>	<b>93.7%</b>	<b>93.8%</b>	<b>93.1%</b>	<b>92.2%</b>	<b>91.7%</b>	<b>92.3%</b>	<b>92.6%</b>	<b>93.2%</b>

Licensee Comments: none

## ERO Drill Participation

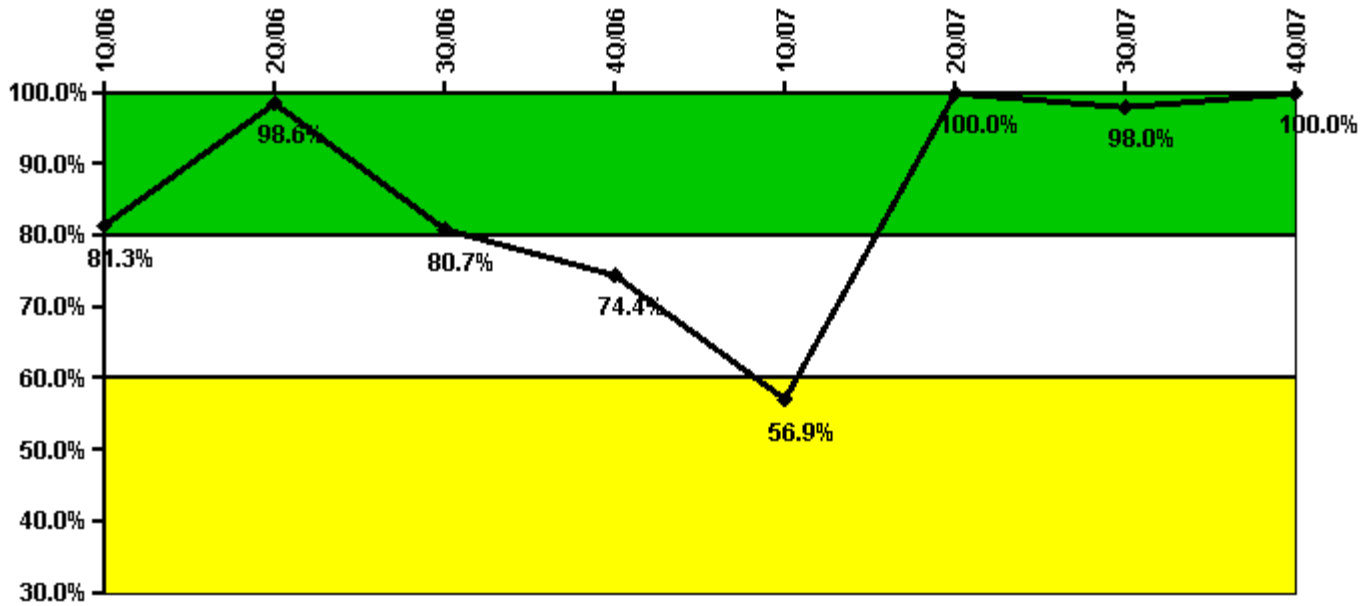


Thresholds: White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Participating Key personnel	65.0	72.0	71.0	67.0	82.0	49.0	50.0	51.0
Total Key personnel	80.0	73.0	88.0	90.0	144.0	49.0	51.0	51.0
<b>Indicator value</b>	<b>81.3%</b>	<b>98.6%</b>	<b>80.7%</b>	<b>74.4%</b>	<b>56.9%</b>	<b>100.0%</b>	<b>98.0%</b>	<b>100.0%</b>

Licensee Comments: none

# Alert & Notification System

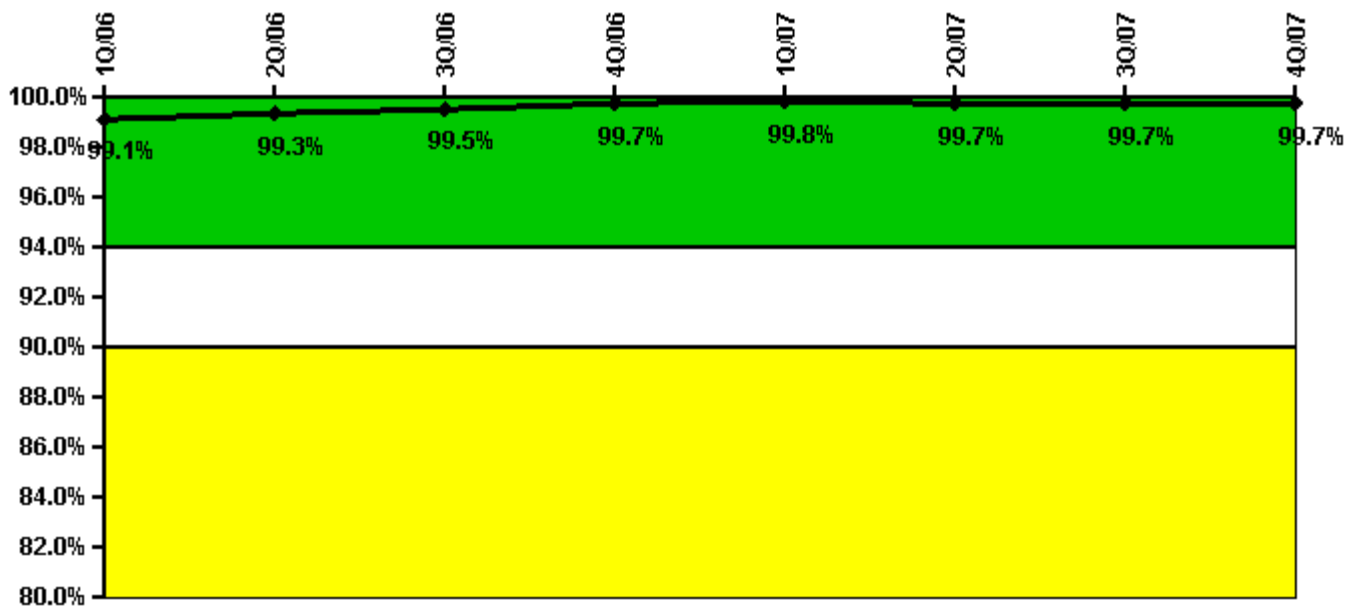


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful siren-tests	1239	1246	1239	1247	1247	1238	1247	1243
Total sirens-tests	1248	1248	1244	1248	1248	1248	1248	1246
<b>Indicator value</b>	<b>99.1%</b>	<b>99.3%</b>	<b>99.5%</b>	<b>99.7%</b>	<b>99.8%</b>	<b>99.7%</b>	<b>99.7%</b>	<b>99.7%</b>

Licensee Comments: none

# Occupational Exposure Control Effectiveness

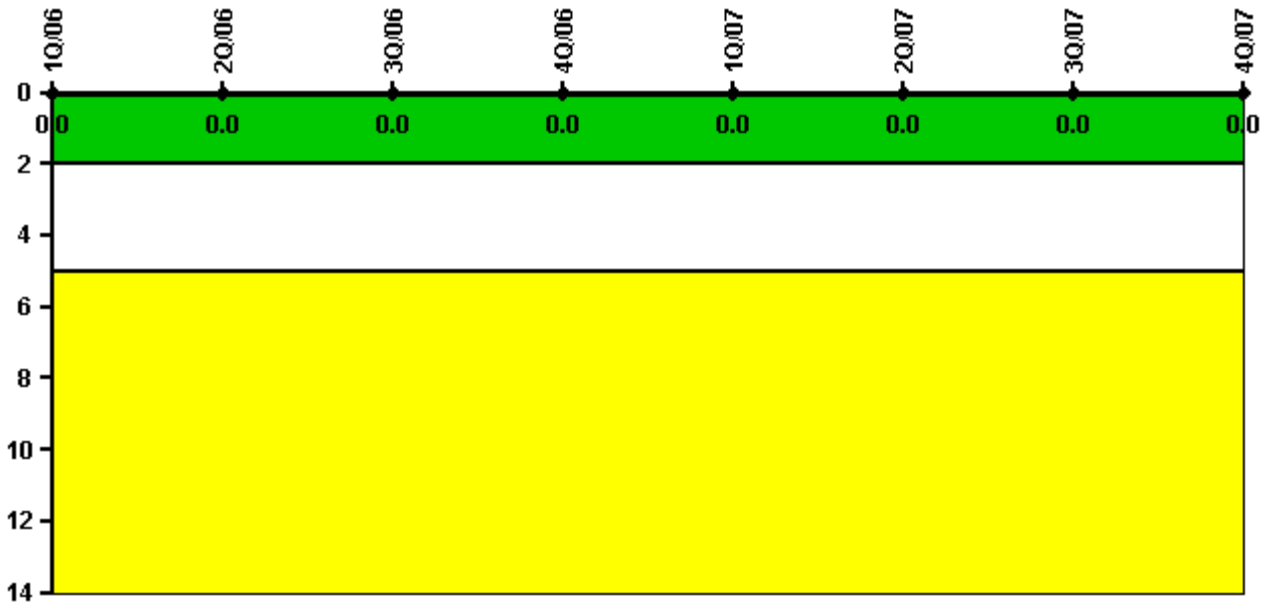

Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

# RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: February 4, 2008