


Oyster Creek

4Q/2007 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

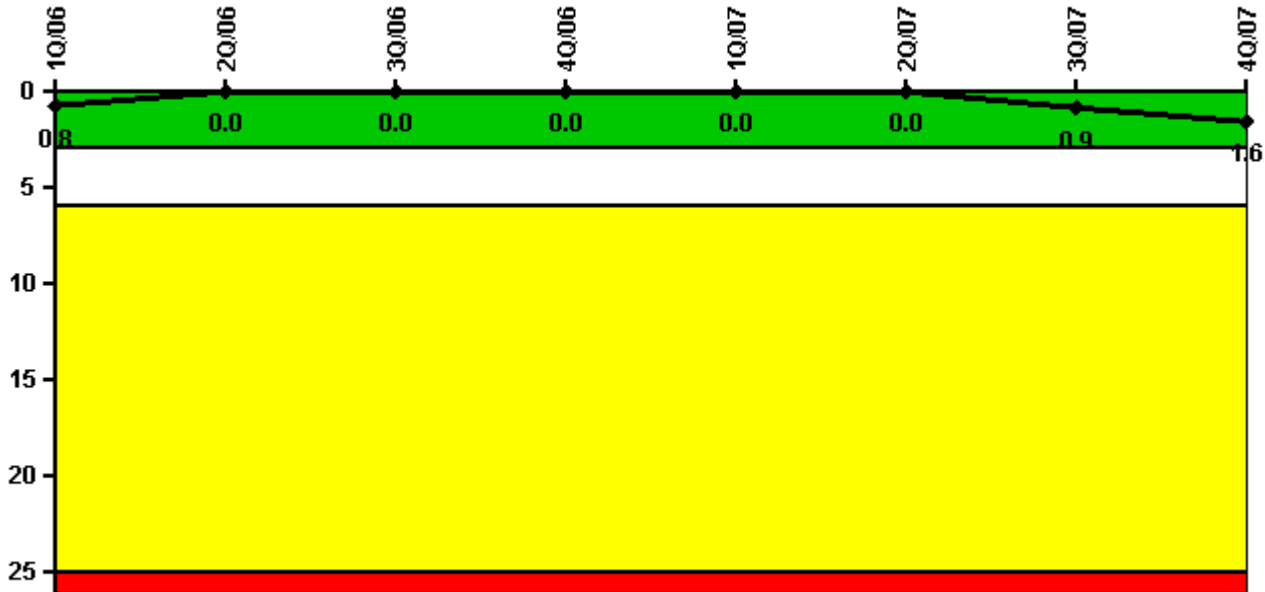


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned scrams	0	0	0	0	0	0	1.0	1.0
Critical hours	1999.4	2072.1	2208.0	1581.3	2159.0	2075.0	2092.2	2183.9
Indicator value	0.8	0	0	0	0	0	0.9	1.6

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

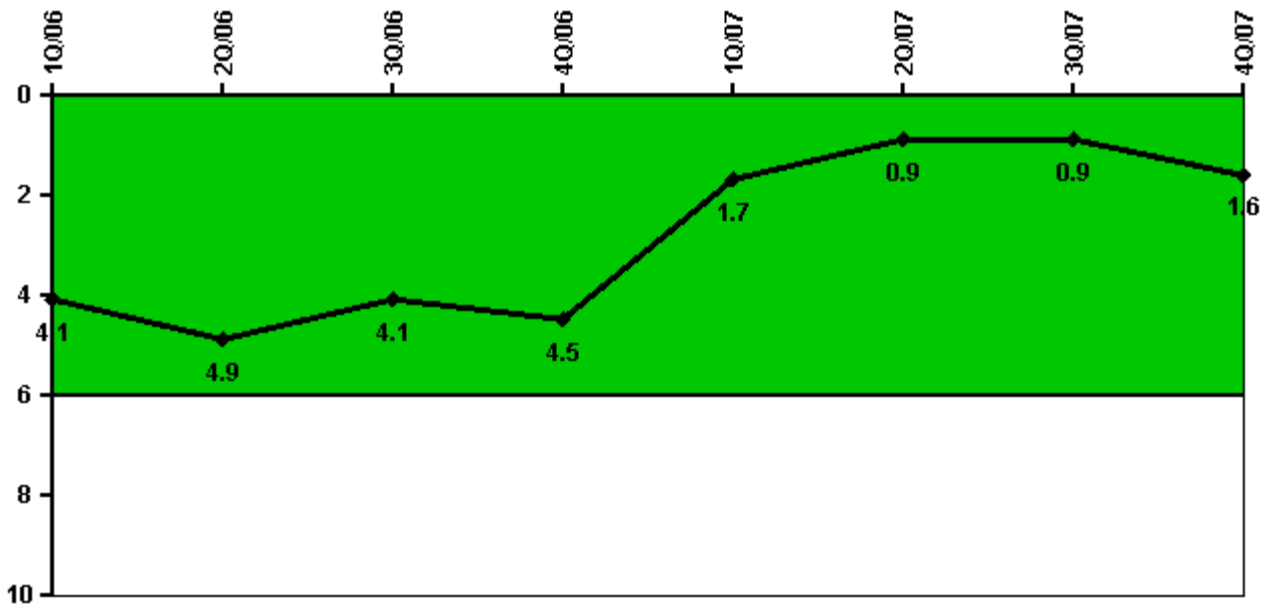


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned power changes	3.0	1.0	1.0	0	0	0	1.0	1.0
Critical hours	1999.4	2072.1	2208.0	1581.3	2159.0	2075.0	2092.2	2183.9
Indicator value	4.1	4.9	4.1	4.5	1.7	0.9	0.9	1.6

Licensee Comments: none

Unplanned Scrams with Complications

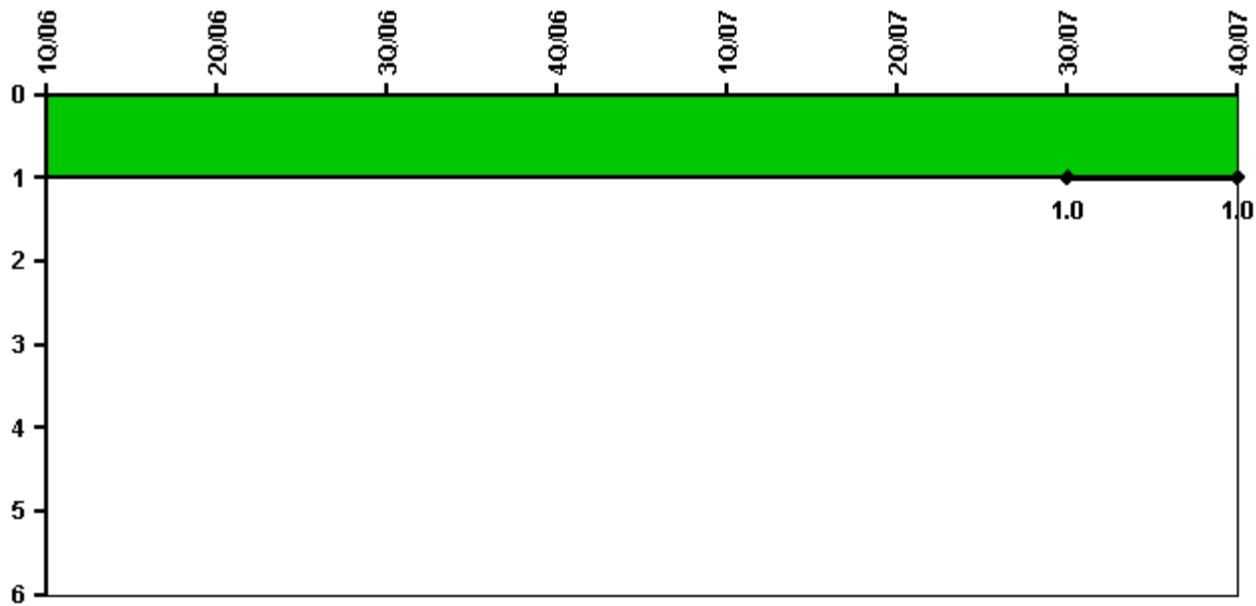


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Scrams with complications				0	0	0	1.0	0
Indicator value							1.0	1.0

Licensee Comments: none

Safety System Functional Failures (BWR)

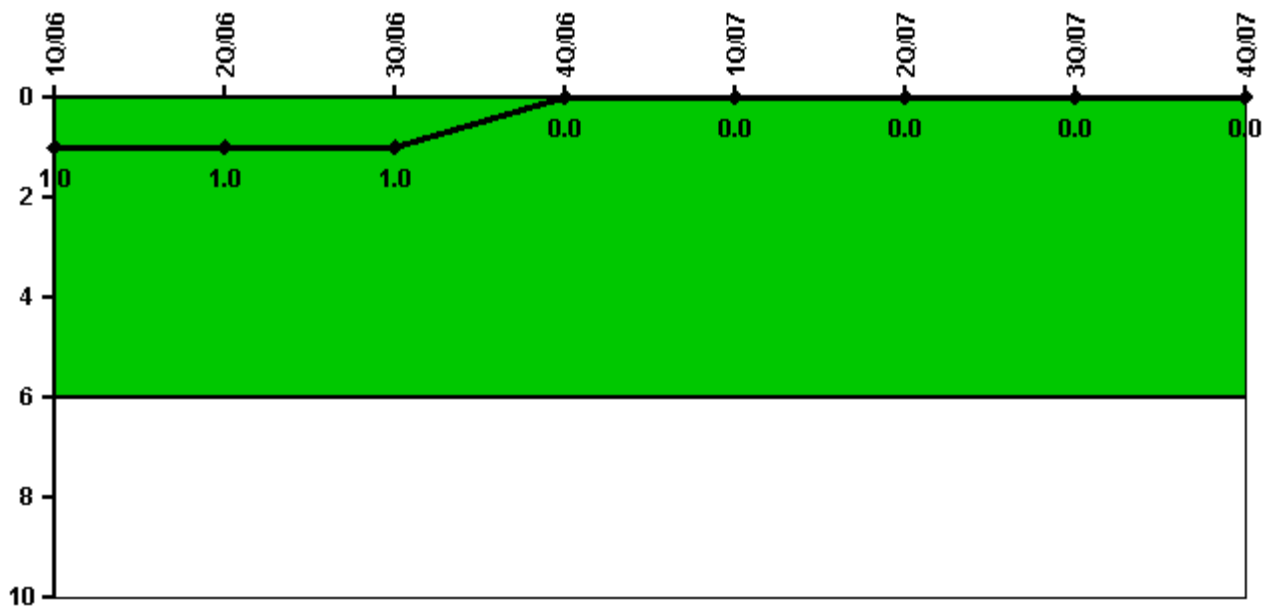


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	1	1	1	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

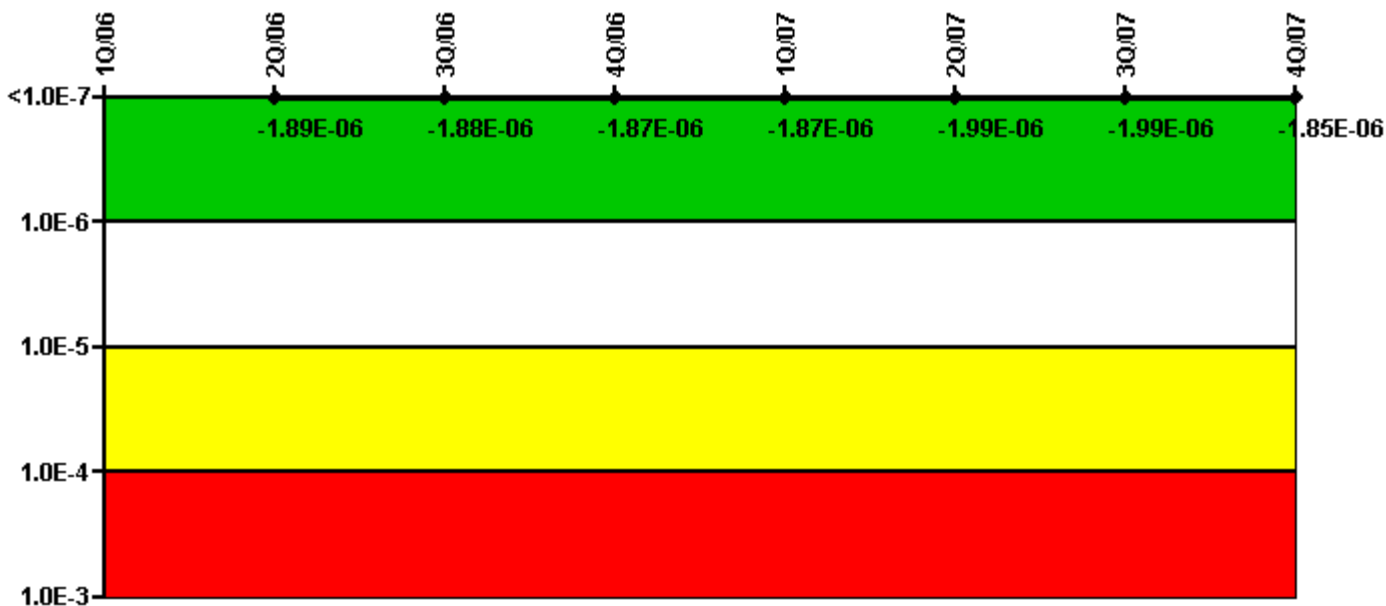


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		-1.90E-07	-1.80E-07	-1.70E-07	-1.70E-07	-2.90E-07	-2.90E-07	-1.50E-07
URI (Δ CDF)		-1.70E-06	-1.70E-06	-1.70E-06	-1.70E-06	-1.70E-06	-1.70E-06	-1.70E-06
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-1.89E-06	-1.88E-06	-1.87E-06	-1.87E-06	-1.99E-06	-1.99E-06	-1.85E-06

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

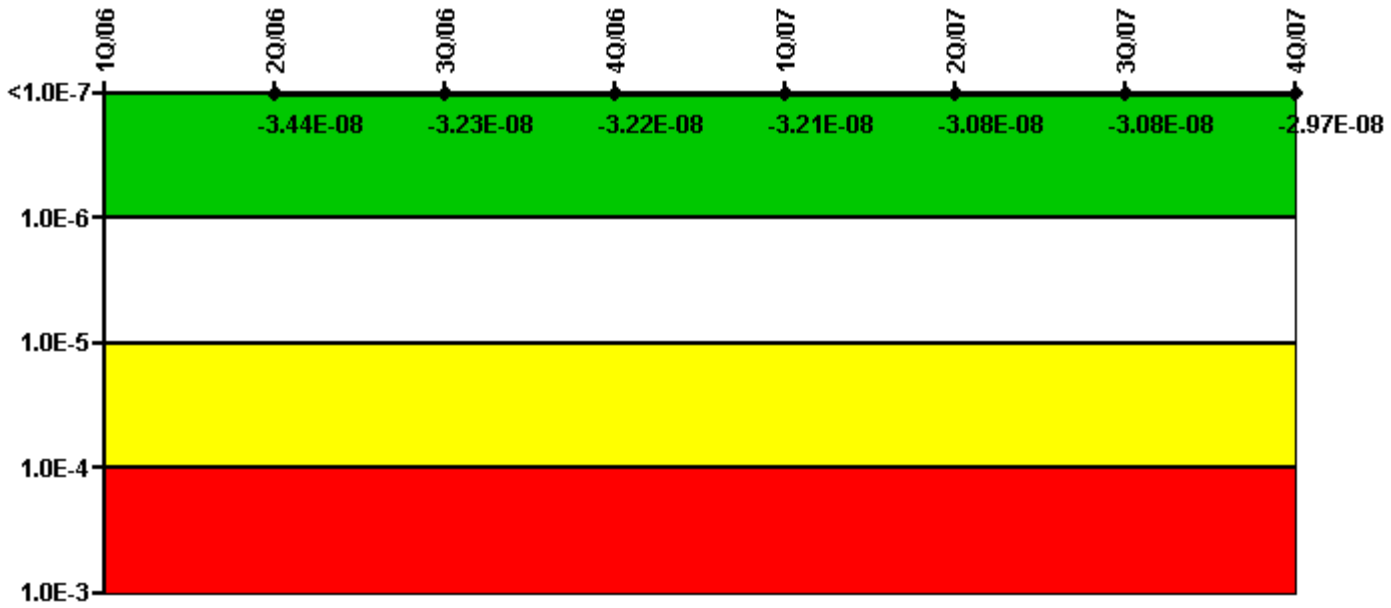


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		-3.00E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.70E-08	-2.70E-08	-2.60E-08
URI (Δ CDF)		-4.40E-09	-4.30E-09	-4.20E-09	-4.10E-09	-3.80E-09	-3.80E-09	-3.70E-09
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-3.44E-08	-3.23E-08	-3.22E-08	-3.21E-08	-3.08E-08	-3.08E-08	-2.97E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

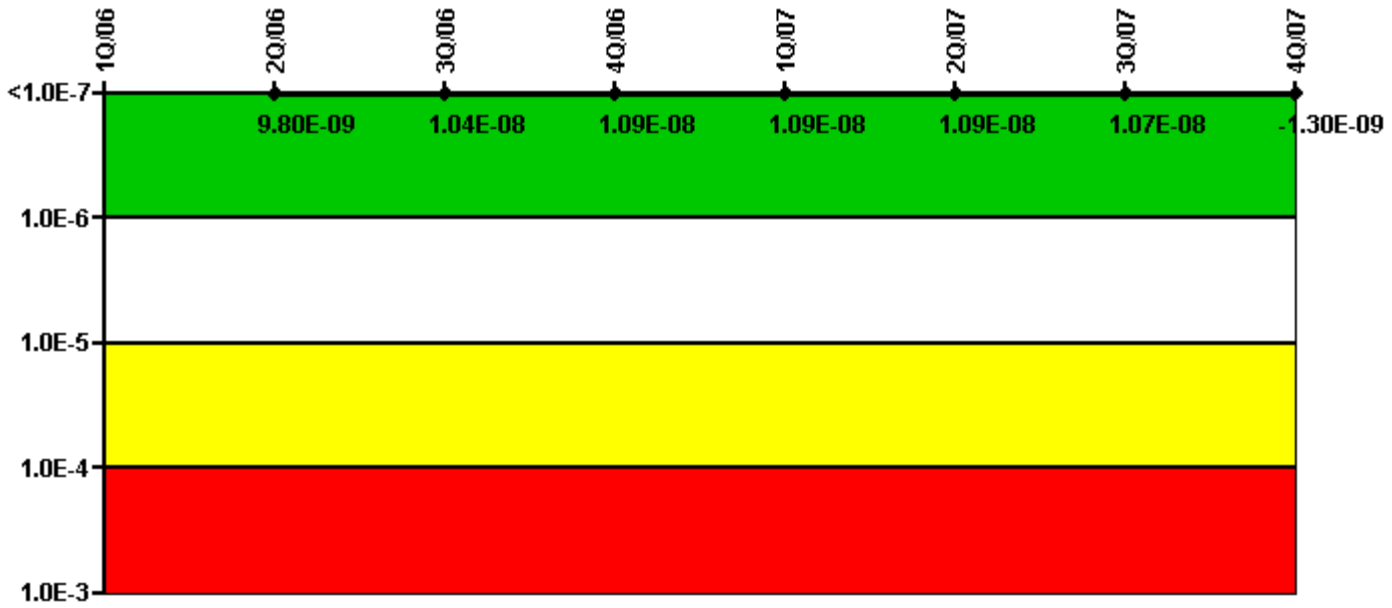


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		3.00E-09	3.00E-09	3.50E-09	3.50E-09	3.50E-09	3.50E-09	-1.20E-09
URI (Δ CDF)		6.80E-09	7.40E-09	7.40E-09	7.40E-09	7.40E-09	7.20E-09	-1.00E-10
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		9.80E-09	1.04E-08	1.09E-08	1.09E-08	1.09E-08	1.07E-08	-1.30E-09

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

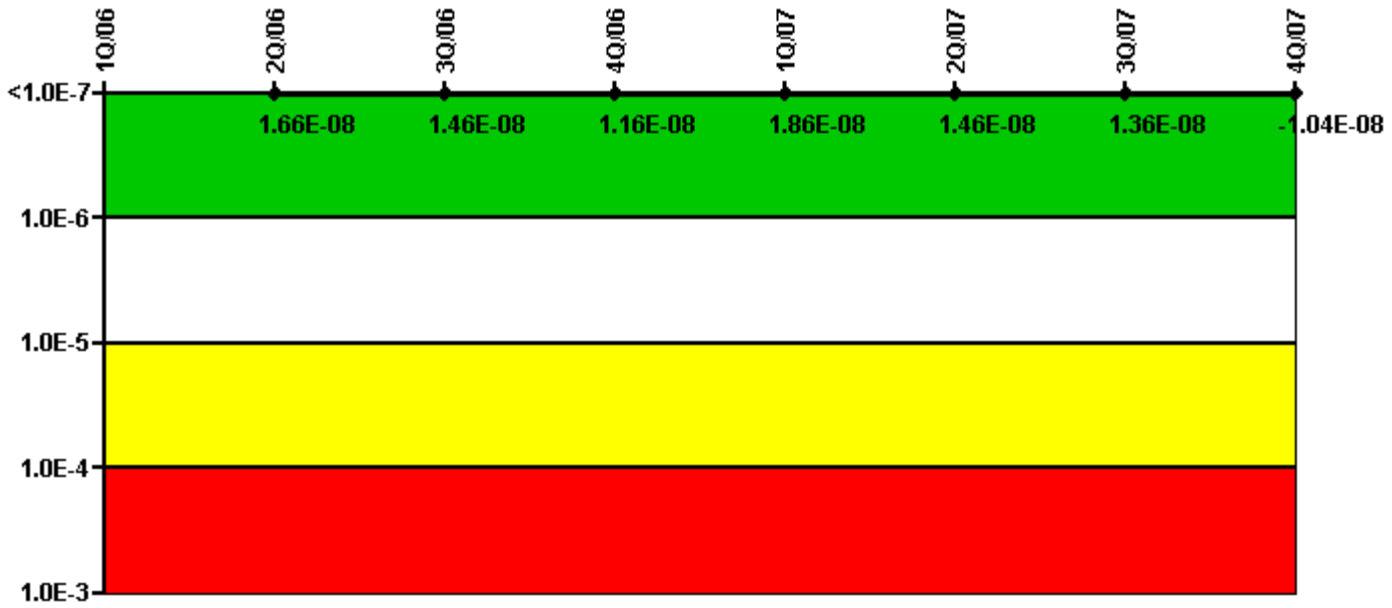


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		1.70E-08	1.50E-08	1.20E-08	1.90E-08	1.50E-08	1.40E-08	-1.00E-08
URI (ΔCDF)		-4.20E-10	-4.30E-10	-4.30E-10	-4.30E-10	-4.30E-10	-4.30E-10	-4.30E-10
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		1.66E-08	1.46E-08	1.16E-08	1.86E-08	1.46E-08	1.36E-08	-1.04E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

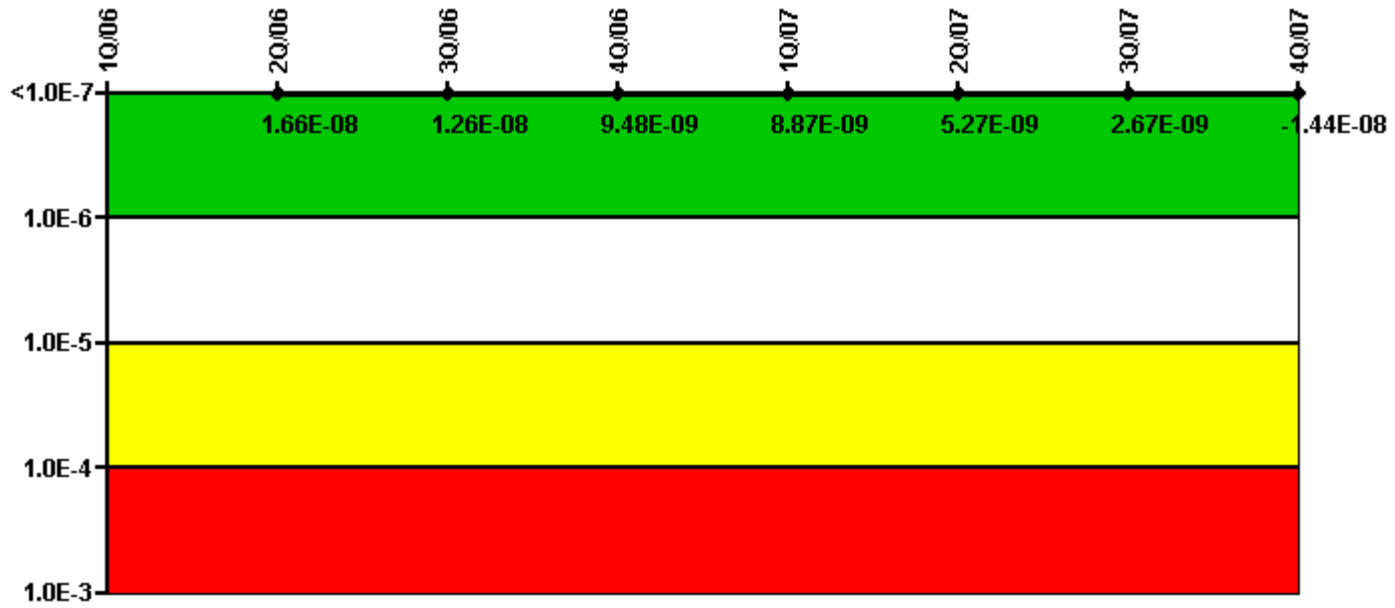


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		1.70E-08	1.30E-08	9.90E-09	9.30E-09	5.70E-09	3.10E-09	-1.40E-08
URI (ΔCDF)		-4.20E-10	-4.20E-10	-4.20E-10	-4.30E-10	-4.30E-10	-4.30E-10	-4.40E-10
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		1.66E-08	1.26E-08	9.48E-09	8.87E-09	5.27E-09	2.67E-09	-1.44E-08

Licensee Comments: none

Reactor Coolant System Activity

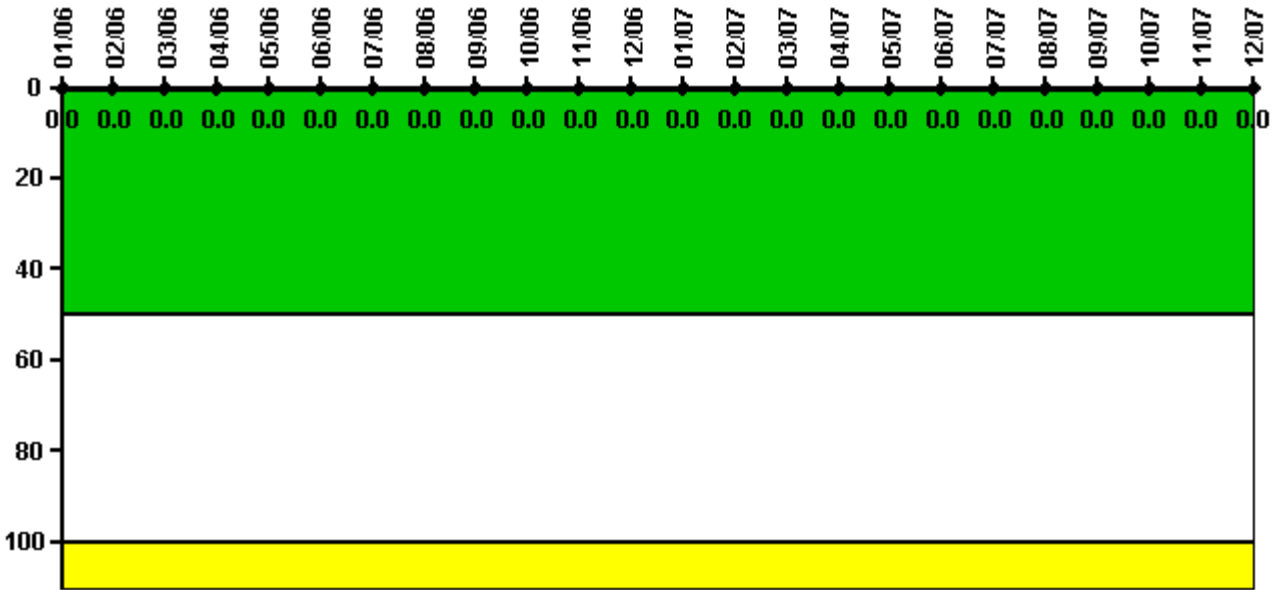

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum activity	0.000038	0.000042	0.000045	0.000049	0.000044	0.000047	0.000042	0.000053	0.000045	0.000040	0.000016	0.000020
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000021	0.000021	0.000018	0.000017	0.000018	0.000019	0.000016	0.000014	0.000013	0.000012	0.000015	0.000012
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

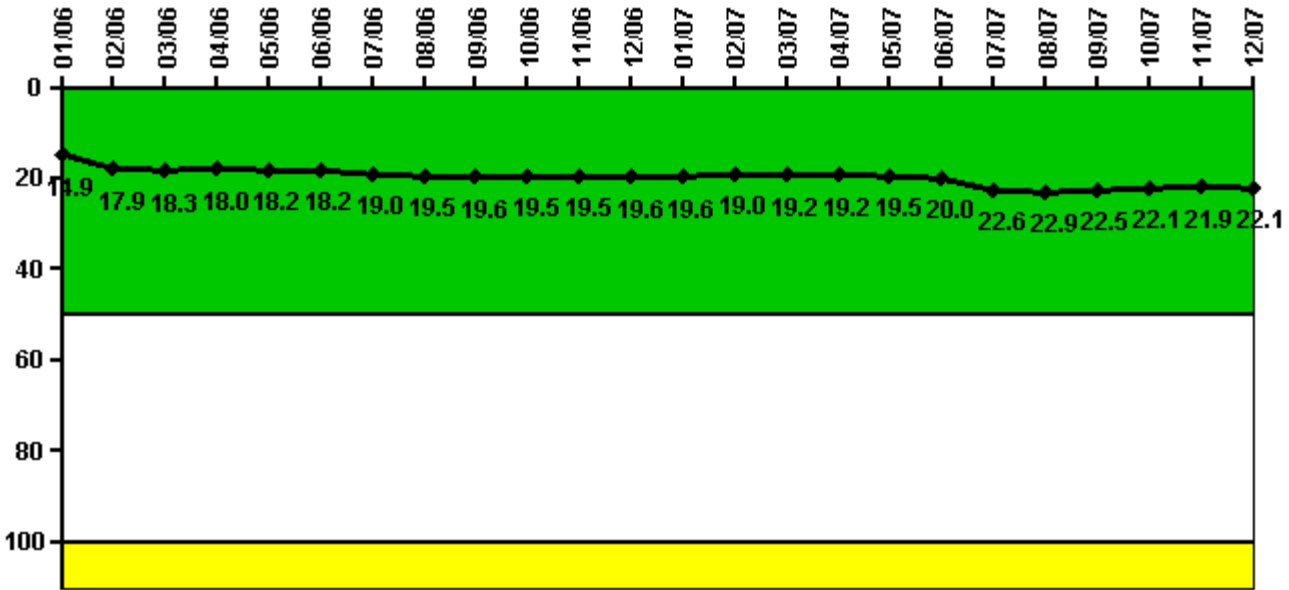

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum leakage	3.730	4.470	4.570	4.510	4.540	4.560	4.750	4.870	4.890	4.880	4.880	4.910
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	14.9	17.9	18.3	18.0	18.2	18.2	19.0	19.5	19.6	19.5	19.5	19.6

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	4.910	4.750	4.800	4.800	4.880	4.990	5.640	5.730	5.630	5.530	5.470	5.520
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	19.6	19.0	19.2	19.2	19.5	20.0	22.6	22.9	22.5	22.1	21.9	22.1

Licensee Comments: none

Drill/Exercise Performance

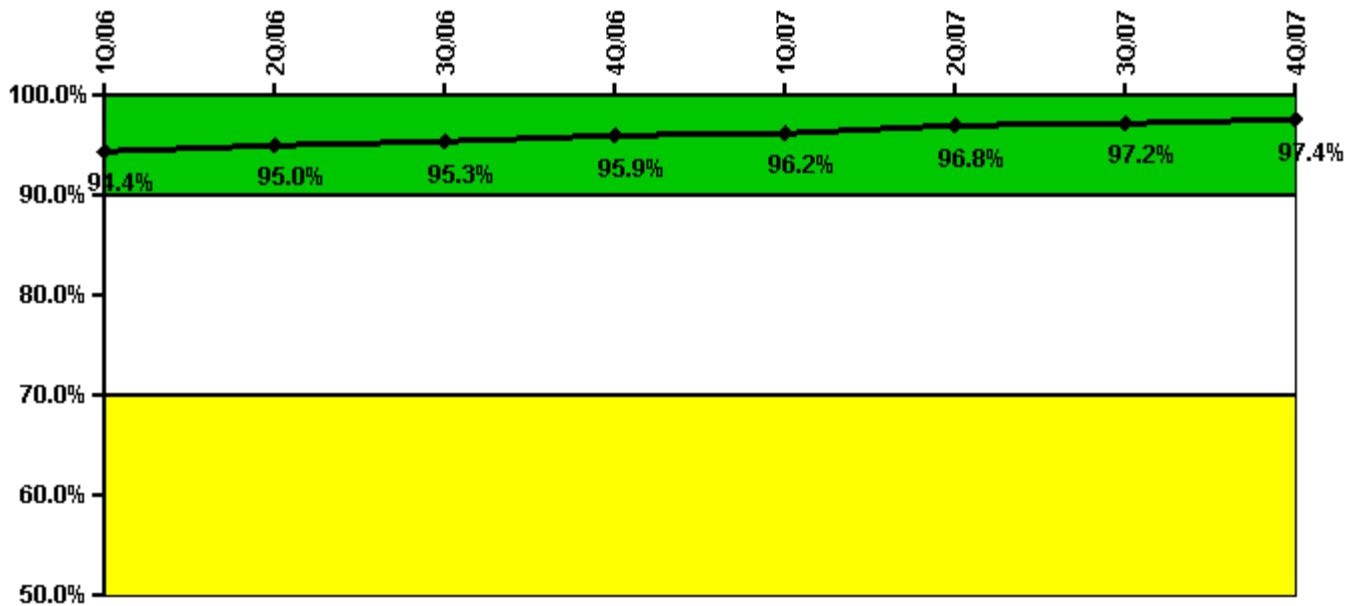

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful opportunities	37.0	107.0	29.0	42.0	44.0	87.0	23.0	46.0
Total opportunities	39.0	111.0	30.0	42.0	44.0	88.0	24.0	48.0
Indicator value	94.4%	95.0%	95.3%	95.9%	96.2%	96.8%	97.2%	97.4%

Licensee Comments:

3Q/06: One PAR opportunity during the 8/16/06 EP Drill is changed to unsuccessful due to a revised determination that the PAR notification was not timely. This change affects the previously reported quarterly PI Data for July 2006 through September 2007. There is NO change in PI color throughout the entire period that remains GREEN.

ERO Drill Participation

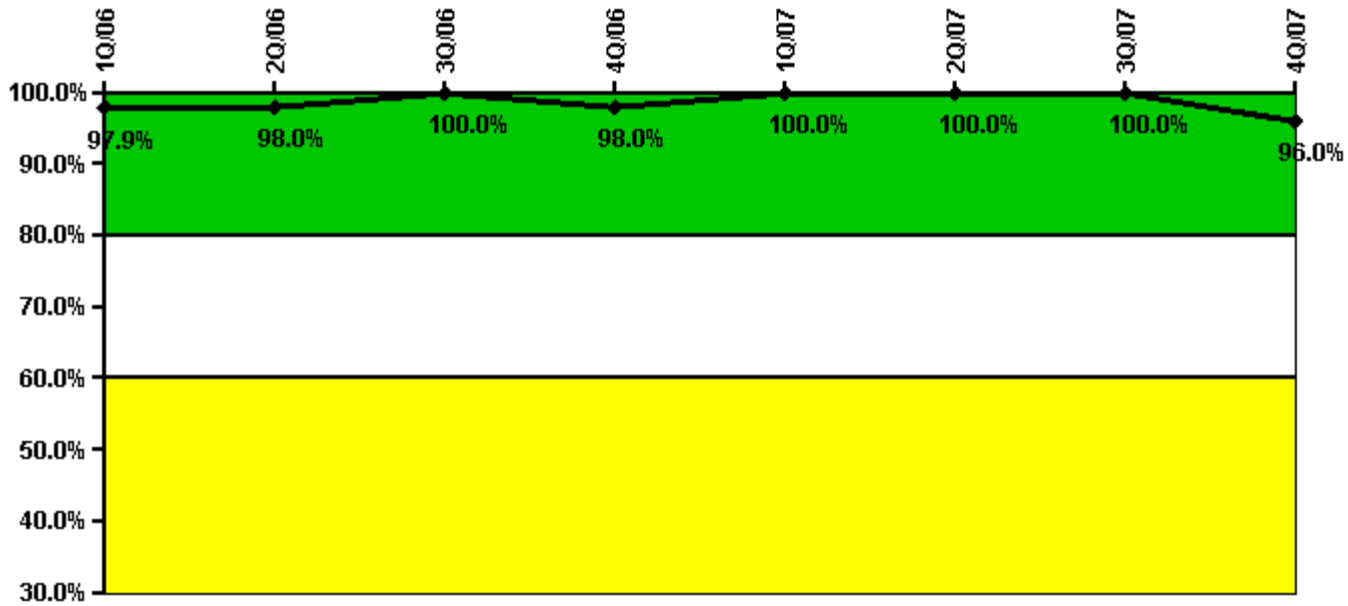


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Participating Key personnel	47.0	48.0	47.0	50.0	51.0	46.0	48.0	48.0
Total Key personnel	48.0	49.0	47.0	51.0	51.0	46.0	48.0	50.0
Indicator value	97.9%	98.0%	100.0%	98.0%	100.0%	100.0%	100.0%	96.0%

Licensee Comments: none

Alert & Notification System

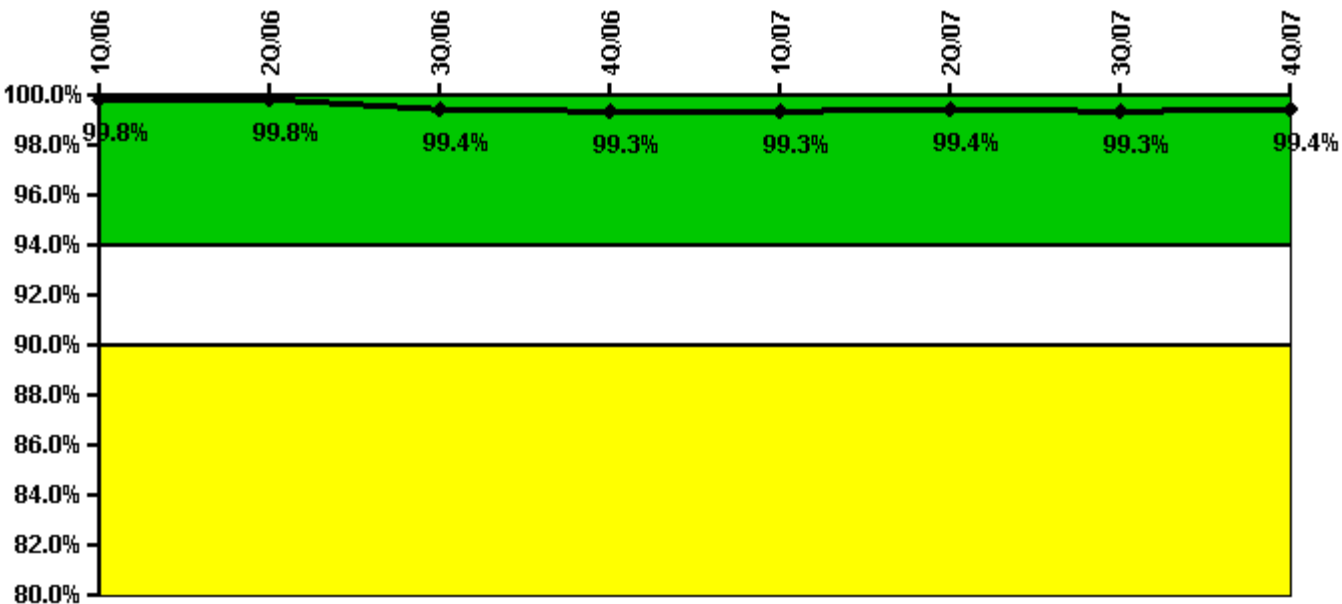


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful siren-tests	542	545	538	543	543	546	537	545
Total sirens-tests	546	546	546	546	546	546	546	546
Indicator value	99.8%	99.8%	99.4%	99.3%	99.3%	99.4%	99.3%	99.4%

Licensee Comments: none

Occupational Exposure Control Effectiveness

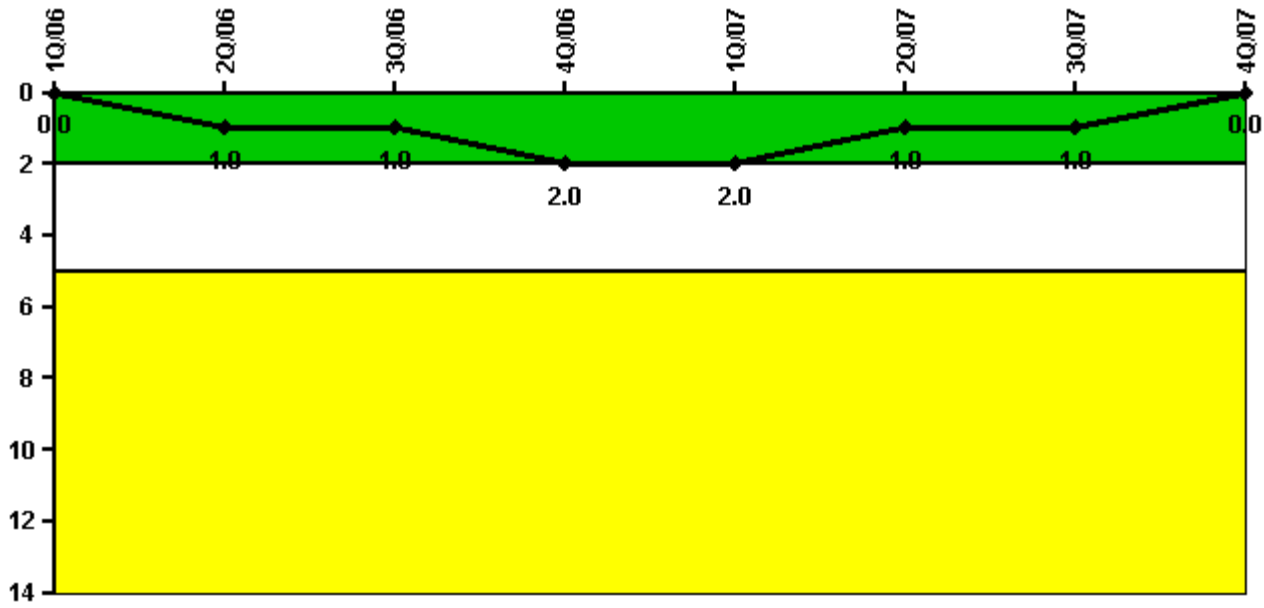

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
High radiation area occurrences	0	1	0	1	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	1	1	2	2	1	1	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.