


Point Beach 1

4Q/2007 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

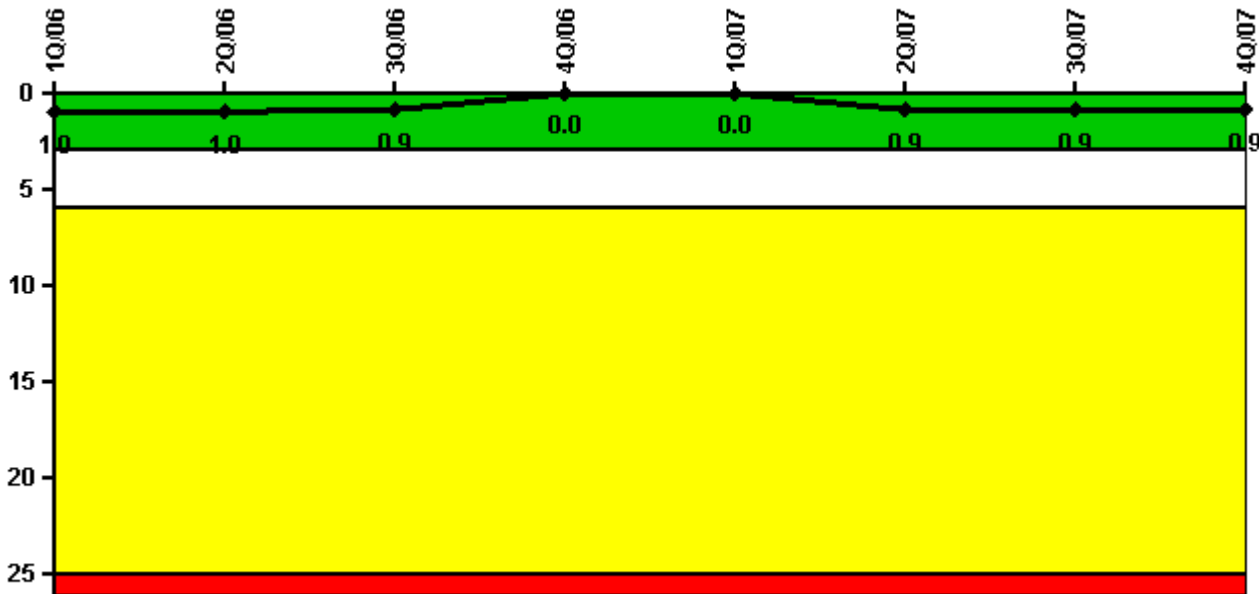

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned scrams	0	0	0	0	0	1.0	0	0
Critical hours	2160.0	2183.0	2208.0	2209.0	2157.7	1091.1	2208.0	2209.0
Indicator value	1.0	1.0	0.9	0	0	0.9	0.9	0.9

Licensee Comments:

2Q/07: June: Unit 1 forced shutdown - manual trip due to Unit 1 "B" Main Feedwater Valve Failure. Unit 1 controlled shutdown for 1P-029-T turbine-driven auxiliary feedwater pump thrust bearing issues.

Unplanned Power Changes per 7000 Critical Hrs

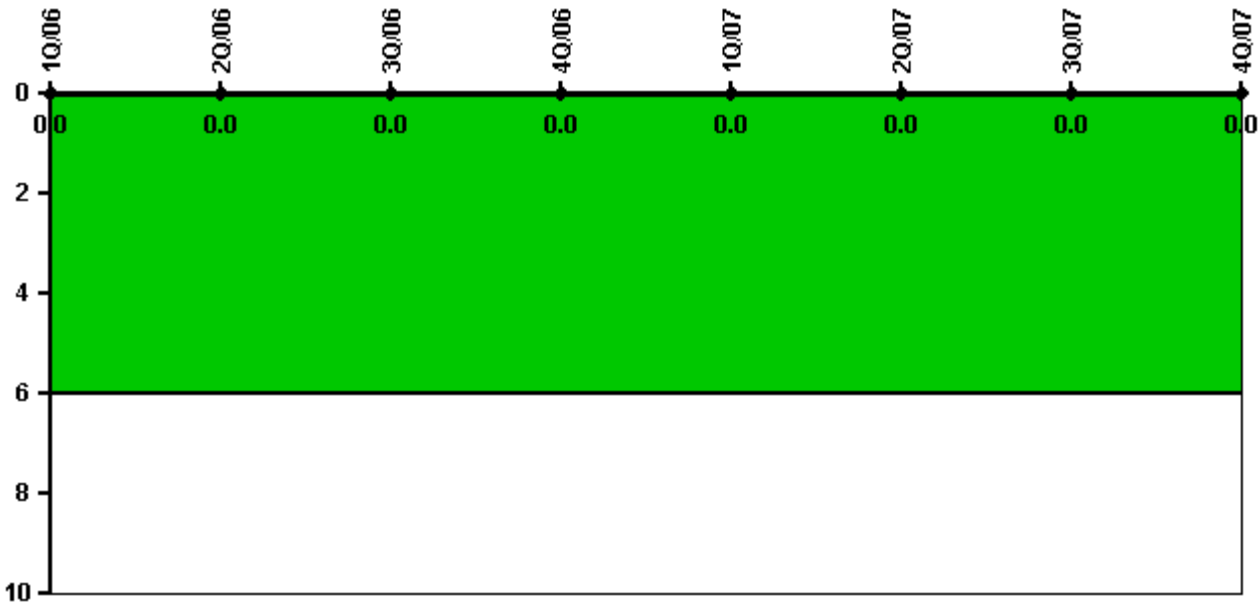

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2160.0	2183.0	2208.0	2209.0	2157.7	1091.1	2208.0	2209.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments:

2Q/07: June: Unit 1 unplanned controlled rampdown due to 1P-029-T turbine-driven auxiliary feedwater pump thrust bearing issues. Changed June 2007 Power Change to a Unit Shutdown for this issue.

Unplanned Scrams with Complications

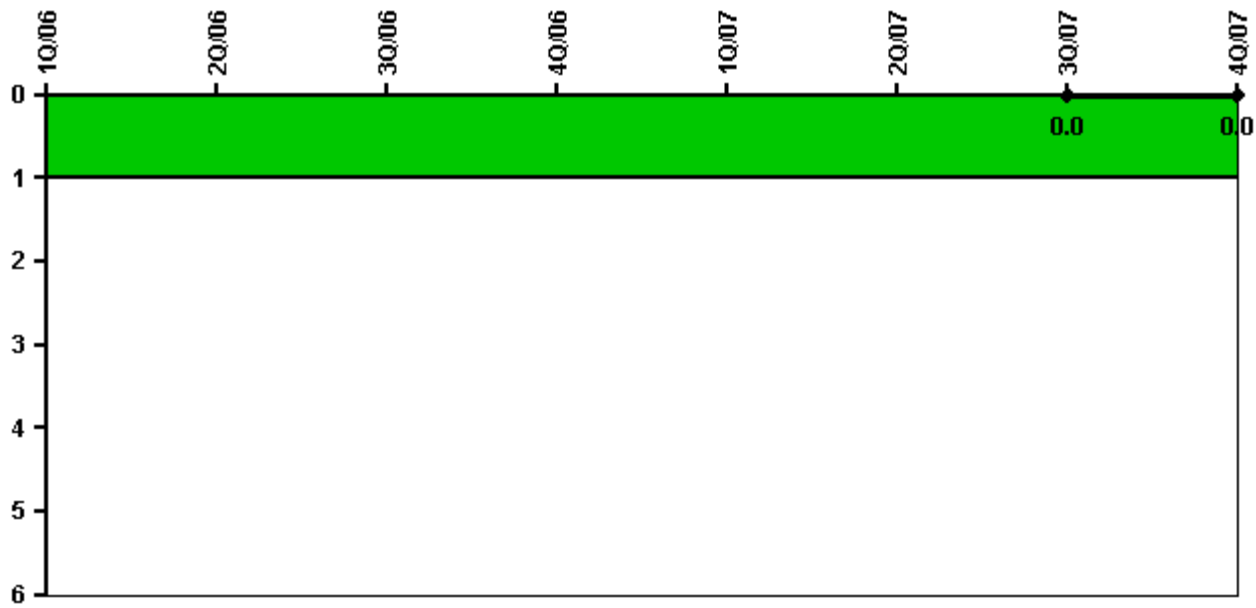


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Scrams with complications				0	0	0	0	0
Indicator value							0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

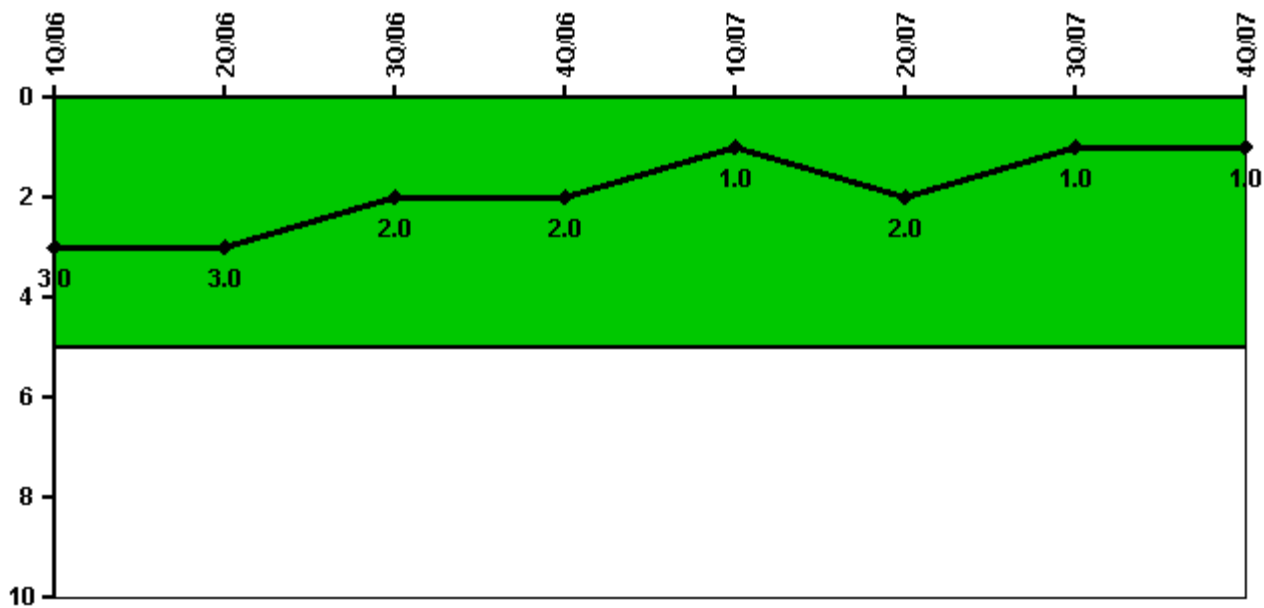


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Safety System Functional Failures	1	0	1	0	0	1	0	0
Indicator value	3	3	2	2	1	2	1	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

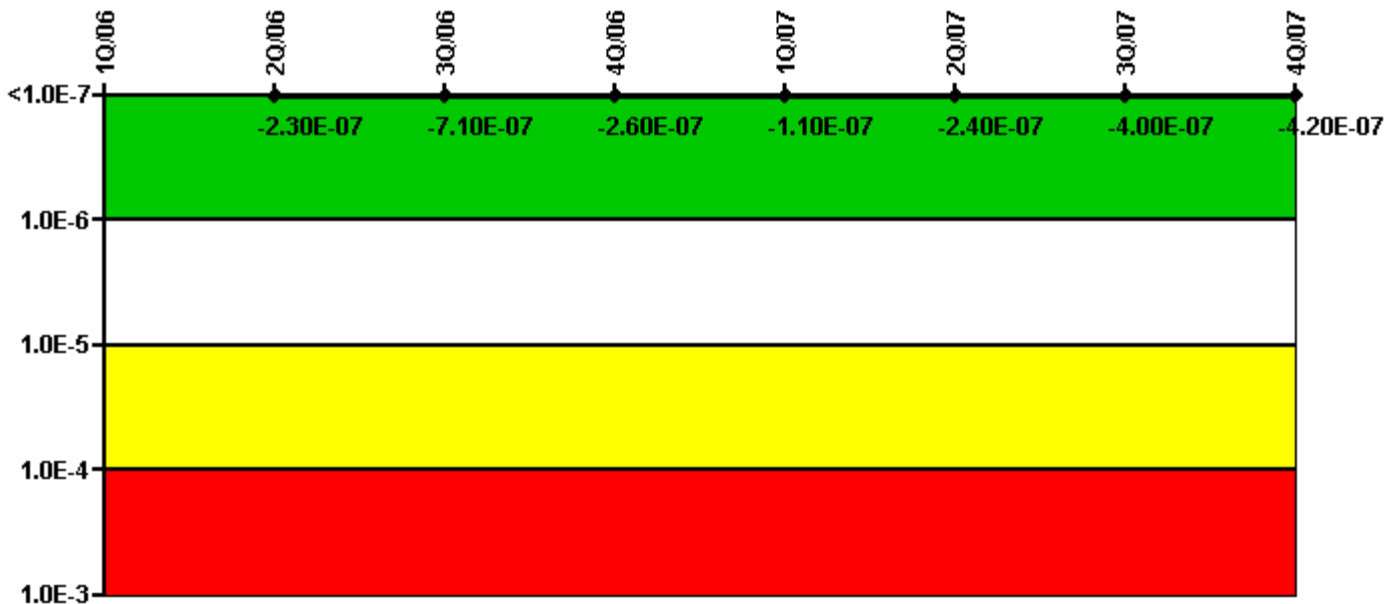

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		6.90E-07	3.90E-07	6.10E-07	7.60E-07	6.30E-07	4.70E-07	4.50E-07
URI (Δ CDF)		-9.20E-07	-1.10E-06	-8.70E-07	-8.70E-07	-8.70E-07	-8.70E-07	-8.70E-07
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-2.30E-07	-7.10E-07	-2.60E-07	-1.10E-07	-2.40E-07	-4.00E-07	-4.20E-07

Licensee Comments:

4Q/07: None.

3Q/07: Implementation of PRA Model Revision 3.18, dated 06/29/2007 (MSPI Basis Document Revision 7)

Mitigating Systems Performance Index, High Pressure Injection System

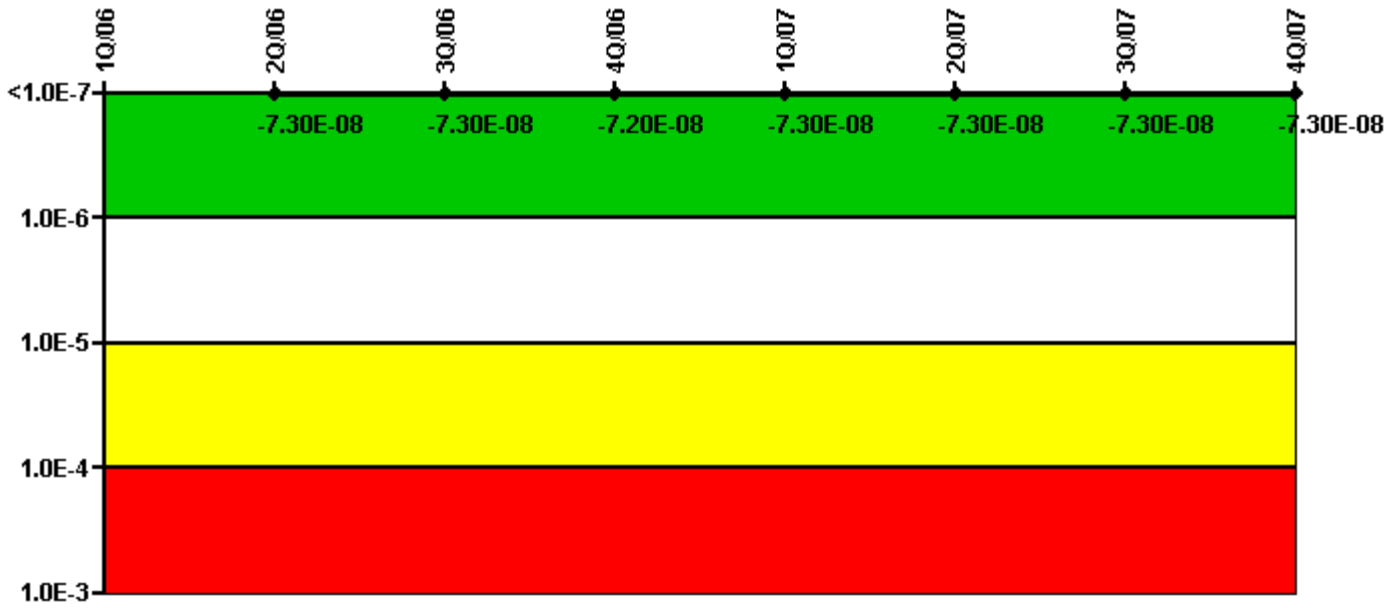

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		-2.70E-08	-2.70E-08	-2.60E-08	-2.70E-08	-2.70E-08	-2.70E-08	-2.70E-08
URI (Δ CDF)		-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-7.30E-08	-7.30E-08	-7.20E-08	-7.30E-08	-7.30E-08	-7.30E-08	-7.30E-08

Licensee Comments:

4Q/07: None.

Mitigating Systems Performance Index, Heat Removal System

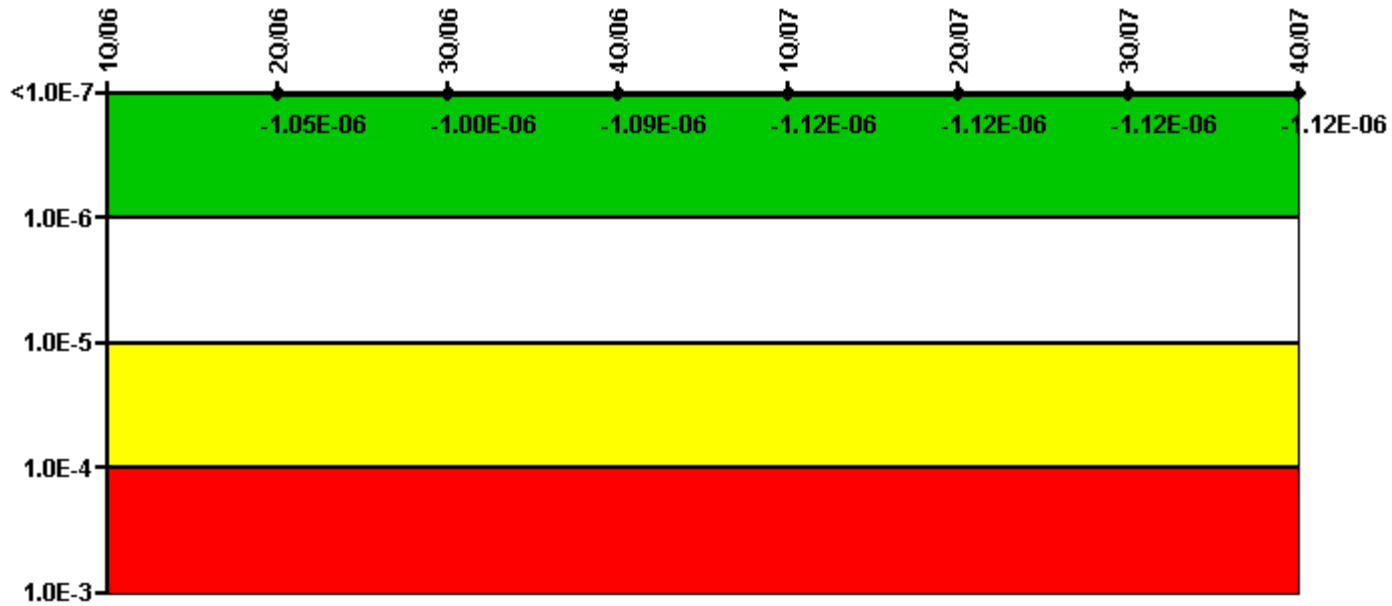

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		5.40E-08	1.00E-07	7.80E-09	-1.60E-08	-2.00E-08	-2.30E-08	-2.30E-08
URI (Δ CDF)		-1.10E-06	-1.10E-06	-1.10E-06	-1.10E-06	-1.10E-06	-1.10E-06	-1.10E-06
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-1.05E-06	-1.00E-06	-1.09E-06	-1.12E-06	-1.12E-06	-1.12E-06	-1.12E-06


Licensee Comments:

4Q/07: None.

3Q/07: Implementation of PRA Model Revision 3.18, dated 06/29/2007 (MSPI Basis Document Revision 7) Pending failure evaluation from 2Q07 for 1P-29, AR01097631-03 was determined to not be a failure.

2Q/07: Pending failure evaluation for 1P-29, AR01097631-03

Mitigating Systems Performance Index, Residual Heat Removal System

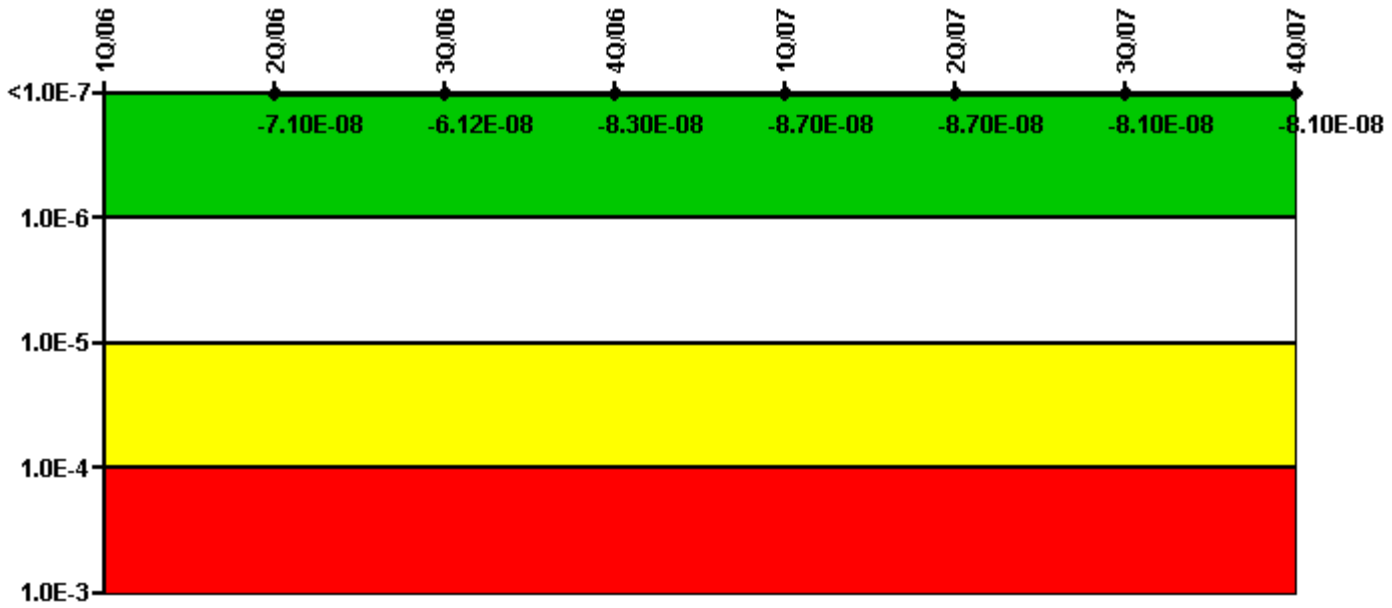

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		-3.00E-09	6.80E-09	-1.50E-08	-1.90E-08	-1.90E-08	-1.90E-08	-1.90E-08
URI (Δ CDF)		-6.80E-08	-6.80E-08	-6.80E-08	-6.80E-08	-6.80E-08	-6.20E-08	-6.20E-08
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-7.10E-08	-6.12E-08	-8.30E-08	-8.70E-08	-8.70E-08	-8.10E-08	-8.10E-08

Licensee Comments:

4Q/07: None.

Mitigating Systems Performance Index, Cooling Water Systems

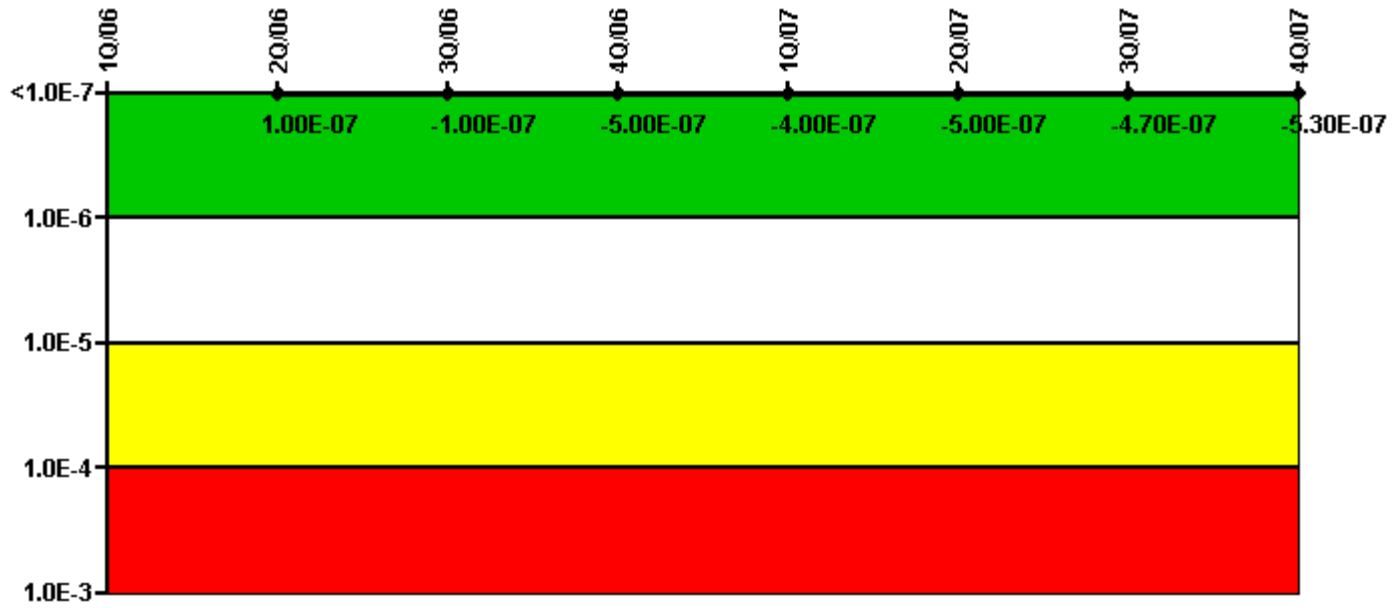

Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$


Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		$1.30E-06$	$1.10E-06$	$1.10E-06$	$1.20E-06$	$1.10E-06$	$4.50E-07$	$3.90E-07$
URI (ΔCDF)		$-1.20E-06$	$-1.20E-06$	$-1.60E-06$	$-1.60E-06$	$-1.60E-06$	$-9.20E-07$	$-9.20E-07$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$1.00E-07$	$-1.00E-07$	$-5.00E-07$	$-4.00E-07$	$-5.00E-07$	$-4.70E-07$	$-5.30E-07$

Licensee Comments:

4Q/07: None.

Reactor Coolant System Activity

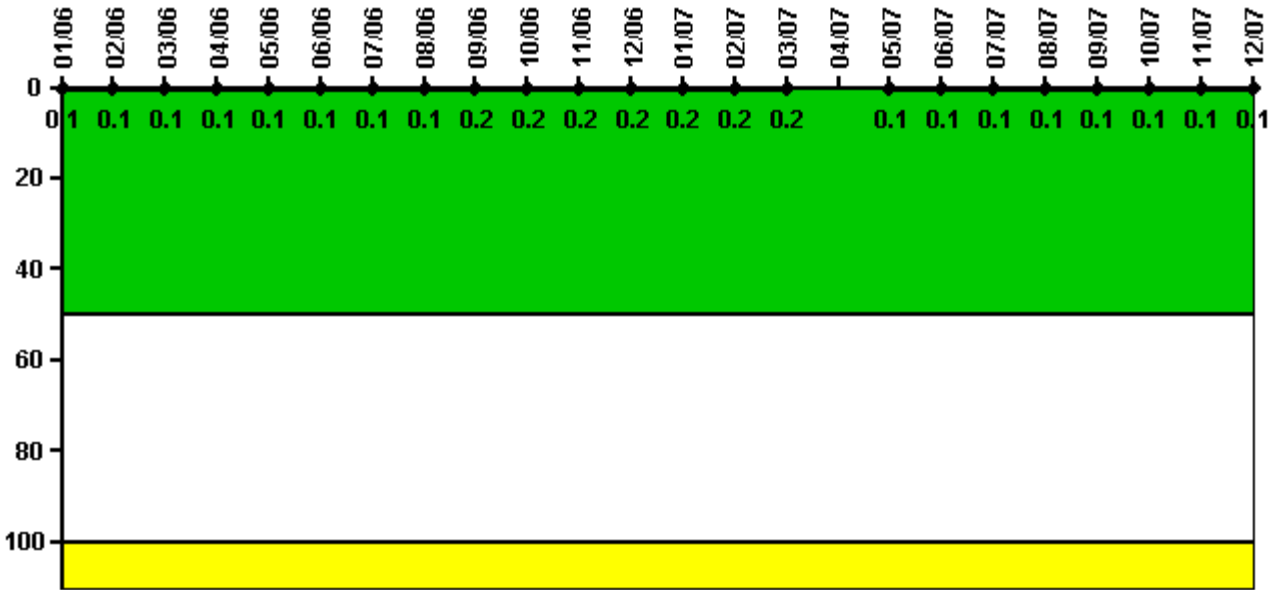

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum activity	0.000858	0.000903	0.000913	0.000956	0.001020	0.001020	0.001050	0.001100	0.001260	0.001220	0.001250	0.001260
Technical specification limit	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.001330	0.001320	0.001290	N/A	0.000724	0.000759	0.000825	0.000869	0.000870	0.000911	0.000942	0.000972
Technical specification limit	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
Indicator value	0.2	0.2	0.2	N/A	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

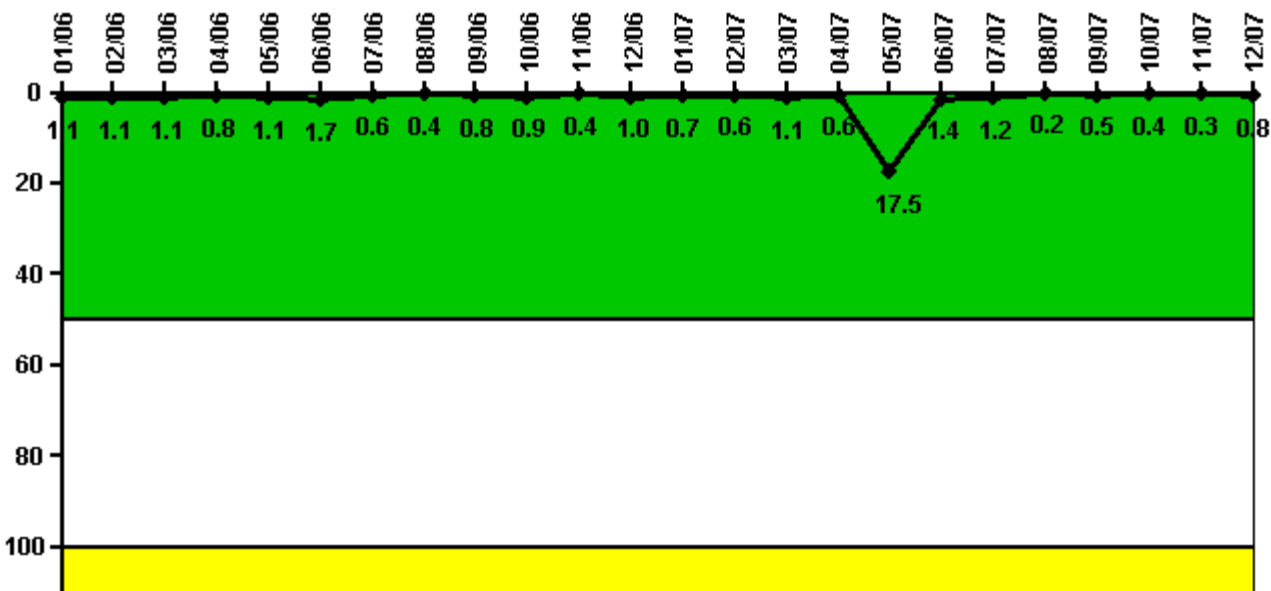

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum leakage	0.110	0.110	0.110	0.080	0.110	0.170	0.060	0.040	0.080	0.090	0.040	0.100
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.1	1.1	1.1	0.8	1.1	1.7	0.6	0.4	0.8	0.9	0.4	1.0

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	0.067	0.056	0.110	0.060	1.750	0.140	0.120	0.020	0.046	0.040	0.030	0.080
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	0.6	1.1	0.6	17.5	1.4	1.2	0.2	0.5	0.4	0.3	0.8

Licensee Comments: none

Drill/Exercise Performance

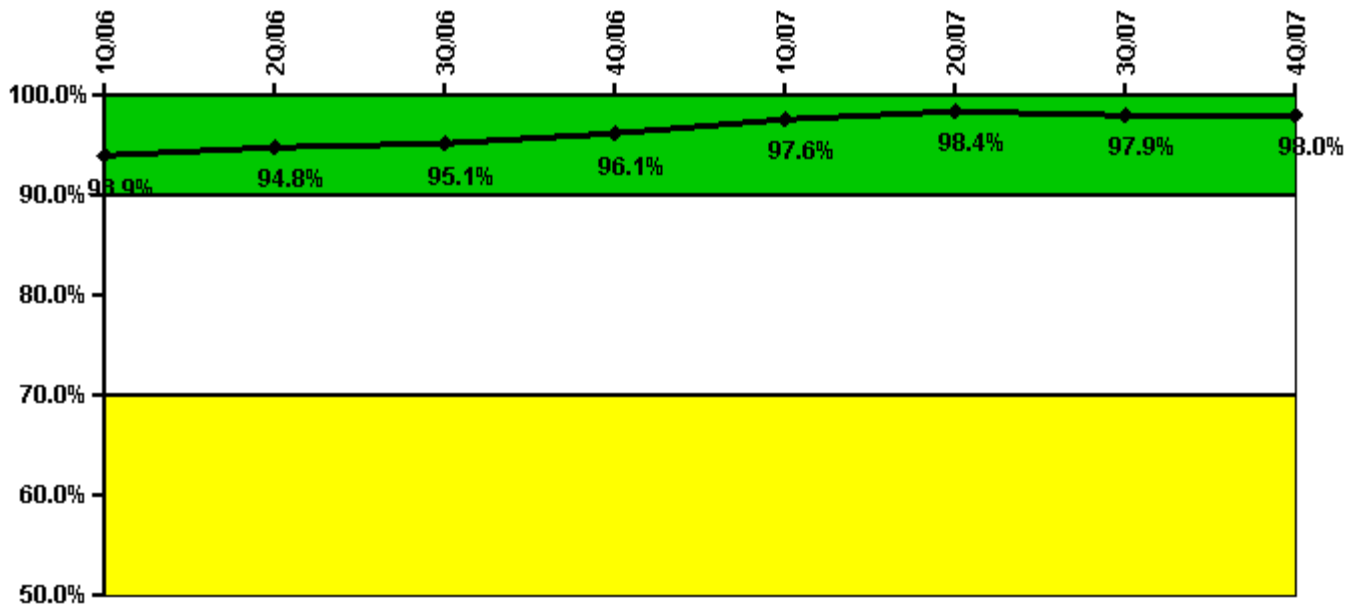


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful opportunities	34.0	44.0	37.0	24.0	49.0	22.0	33.0	3.0
Total opportunities	34.0	44.0	38.0	24.0	50.0	22.0	36.0	3.0
Indicator value	93.9%	94.8%	95.1%	96.1%	97.6%	98.4%	97.9%	98.0%

Licensee Comments: none

ERO Drill Participation

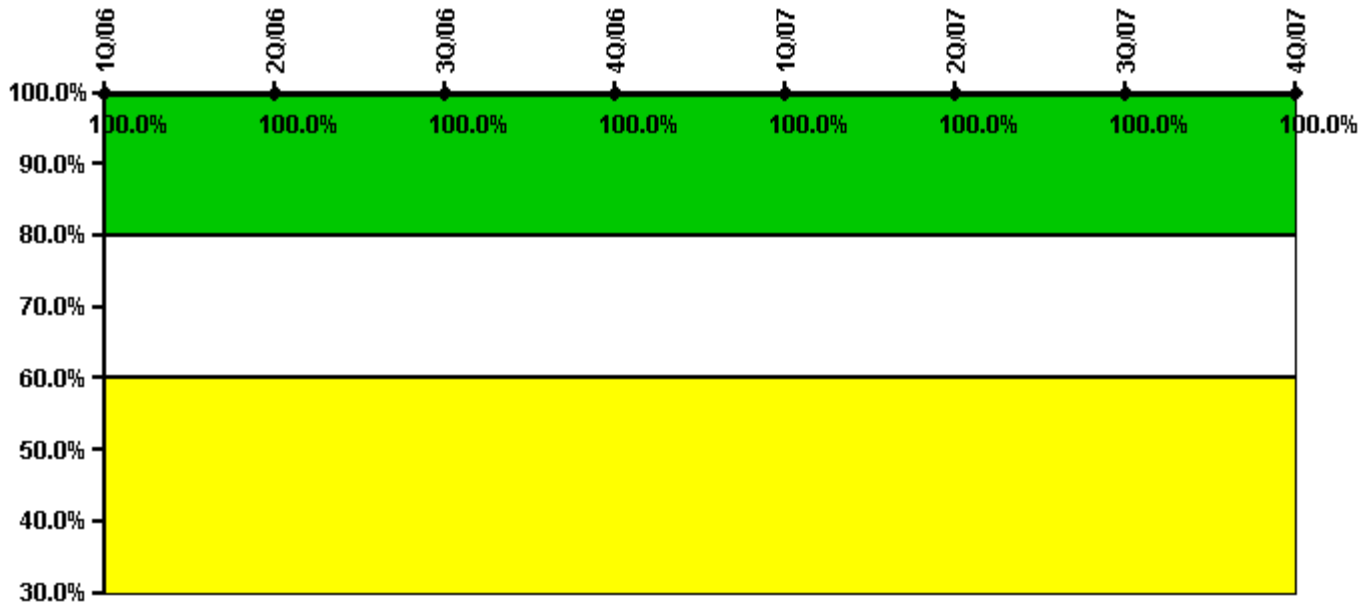


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Participating Key personnel	59.0	60.0	63.0	63.0	58.0	57.0	58.0	59.0
Total Key personnel	59.0	60.0	63.0	63.0	58.0	57.0	58.0	59.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

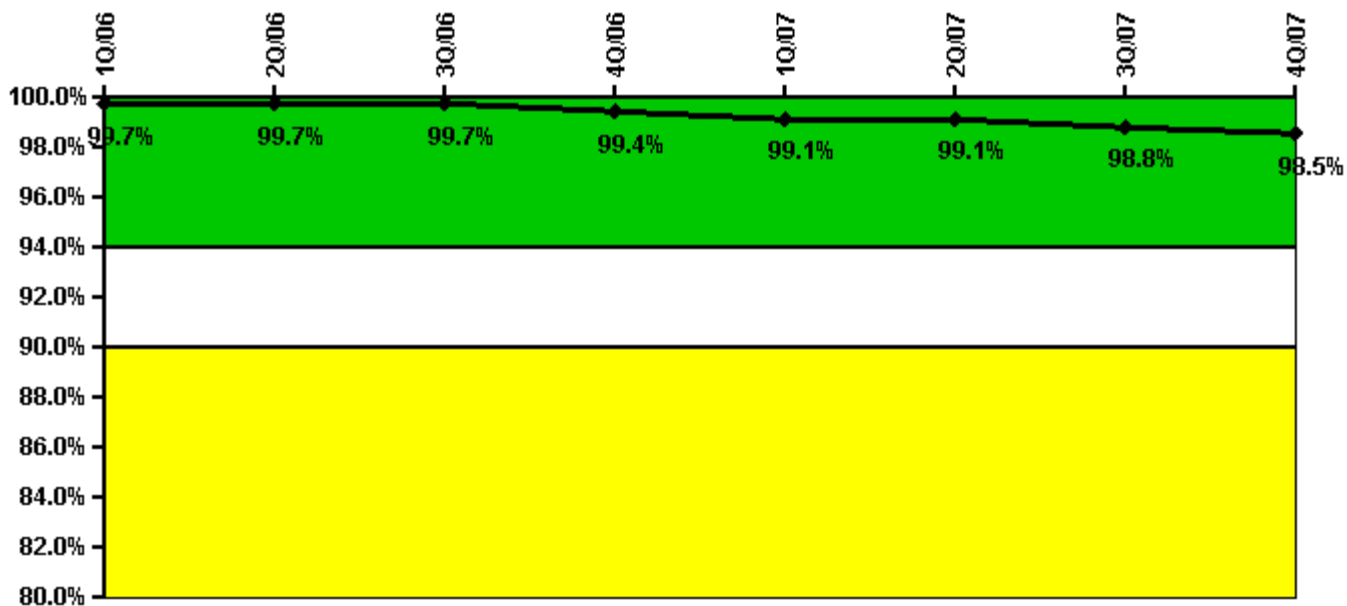


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful siren-tests	84	83	84	83	83	83	83	82
Total sirens-tests	84	84	84	84	84	84	84	84
Indicator value	99.7%	99.7%	99.7%	99.4%	99.1%	99.1%	98.8%	98.5%

Licensee Comments: none

Occupational Exposure Control Effectiveness

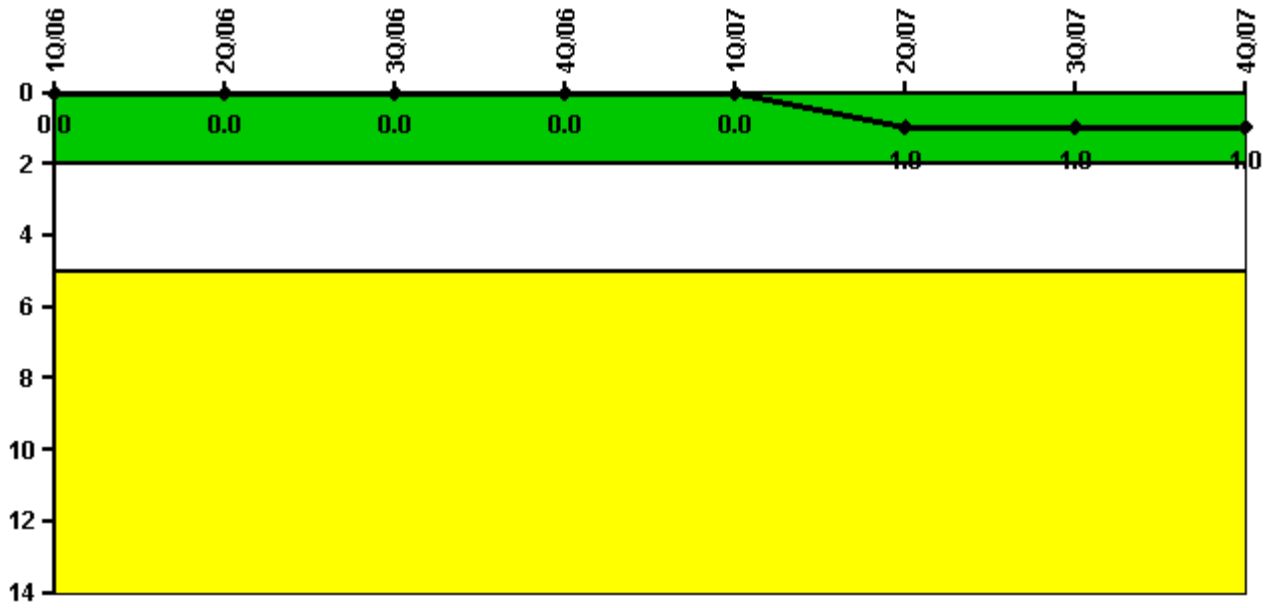


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
High radiation area occurrences	0	0	0	0	0	1	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent

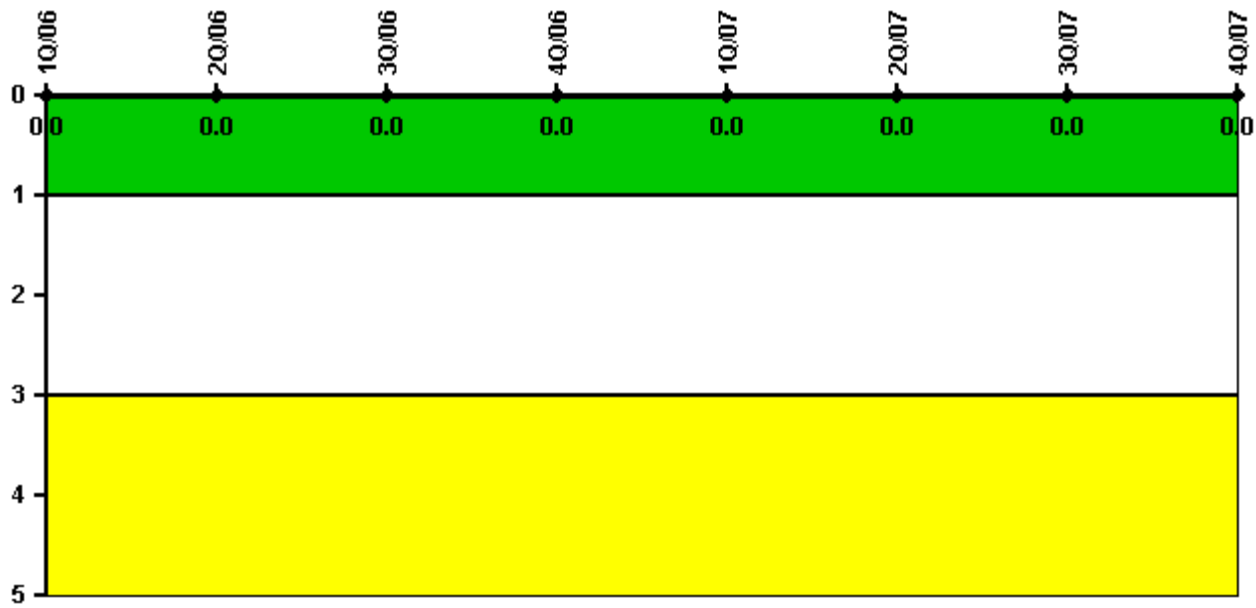

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: February 4, 2008