


Summer

4Q/2007 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

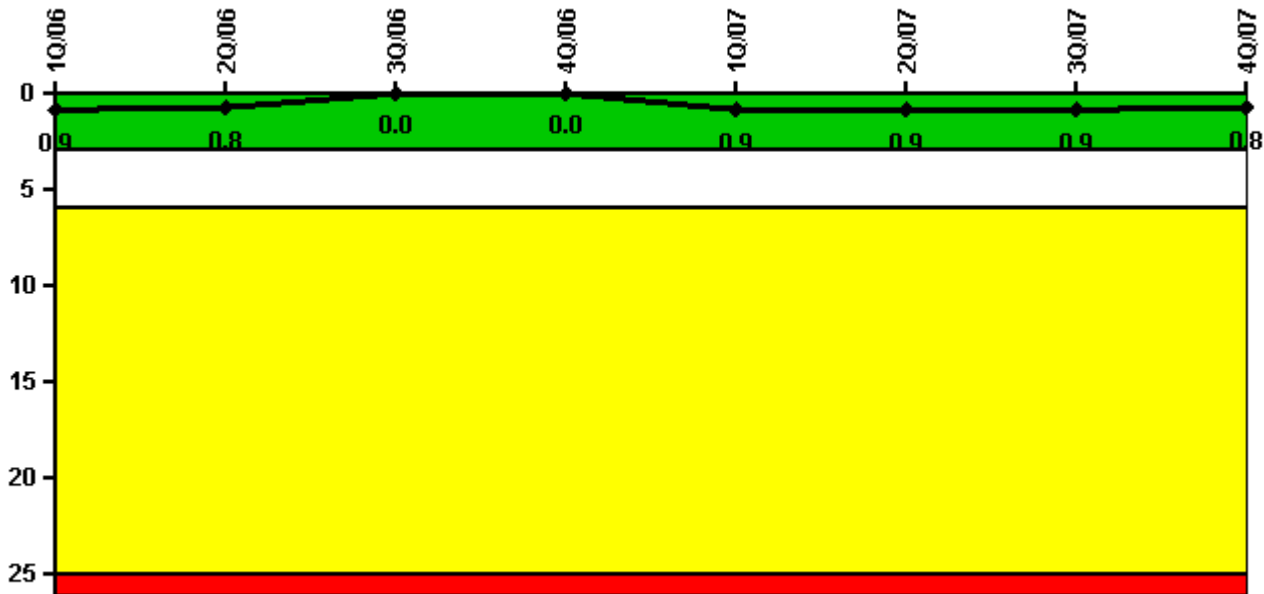


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned scrams	0	0	0	0	1.0	0	0	0
Critical hours	2160.0	2183.0	2208.0	1296.0	2126.5	2184.0	2208.0	2209.0
Indicator value	0.9	0.8	0	0	0.9	0.9	0.9	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

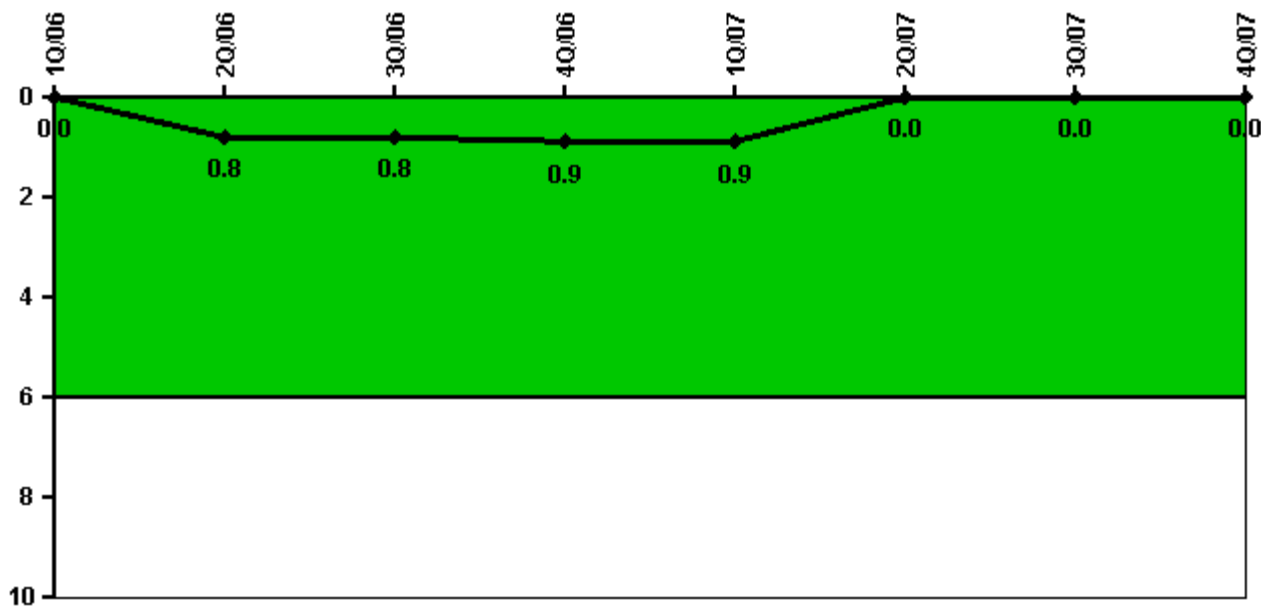


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned power changes	0	1.0	0	0	0	0	0	0
Critical hours	2160.0	2183.0	2208.0	1296.0	2126.5	2184.0	2208.0	2209.0
Indicator value	0	0.8	0.8	0.9	0.9	0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

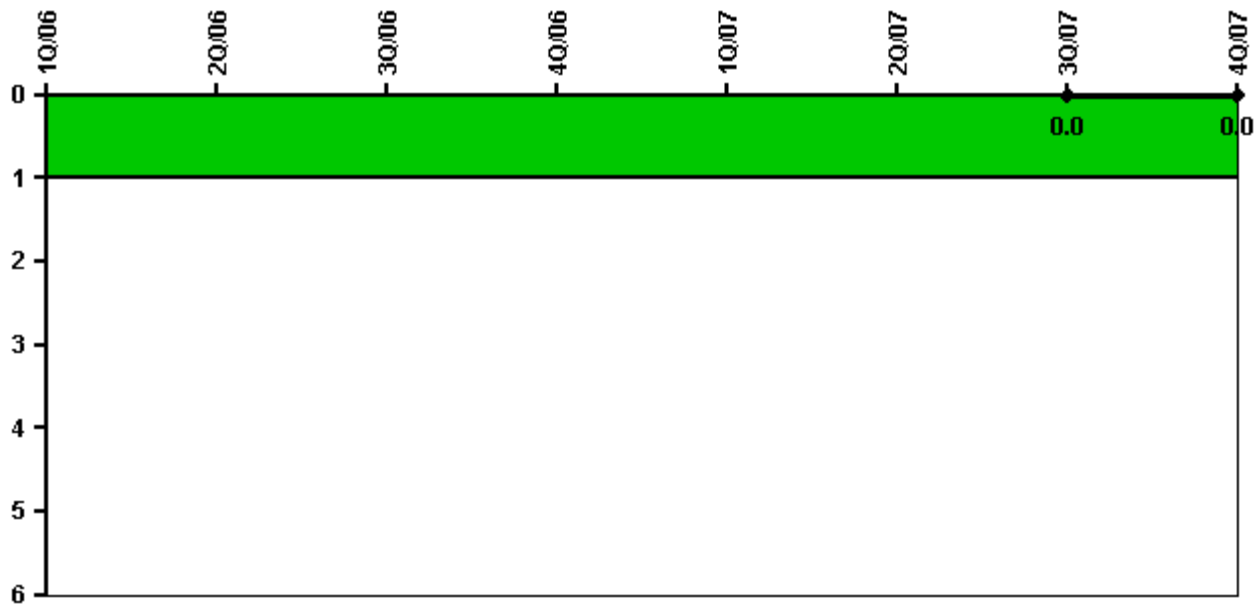


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Scrams with complications				0	0	0	0	0
Indicator value							0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

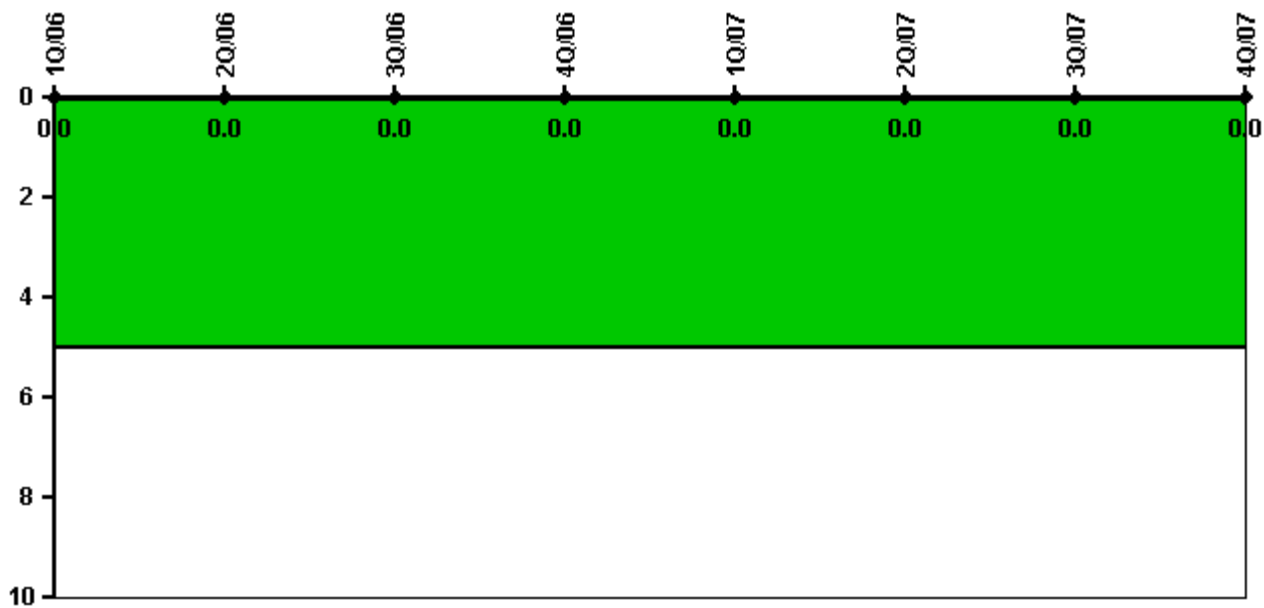


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

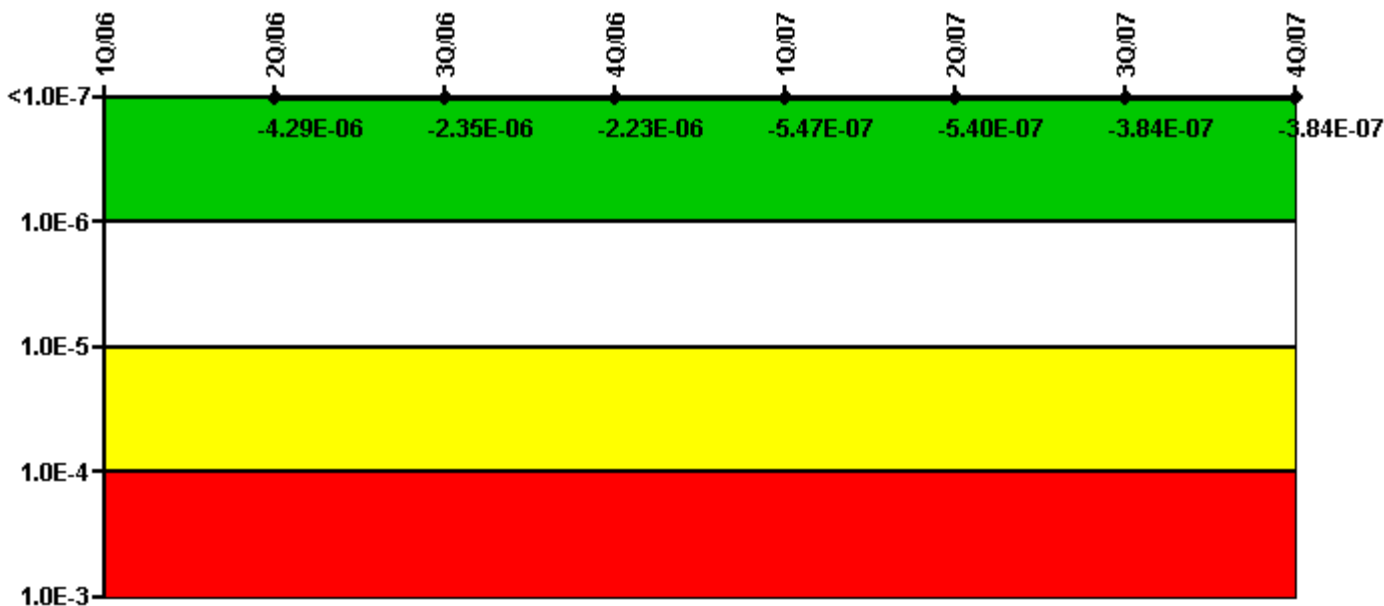

Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$


Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		$-9.40E-08$	$1.50E-07$	$2.70E-07$	$8.30E-08$	$8.00E-08$	$8.60E-08$	$8.60E-08$
URI (Δ CDF)		$-4.20E-06$	$-2.50E-06$	$-2.50E-06$	$-6.30E-07$	$-6.20E-07$	$-4.70E-07$	$-4.70E-07$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$-4.29E-06$	$-2.35E-06$	$-2.23E-06$	$-5.47E-07$	$-5.40E-07$	$-3.84E-07$	$-3.84E-07$

Licensee Comments:

4Q/07: Changed PRA Parameter(s). Minor changes to PRA parameters, based on PRA model revision 5a for improved modeling of a non-MSPI system and human reliability dependency multipliers.

Mitigating Systems Performance Index, High Pressure Injection System

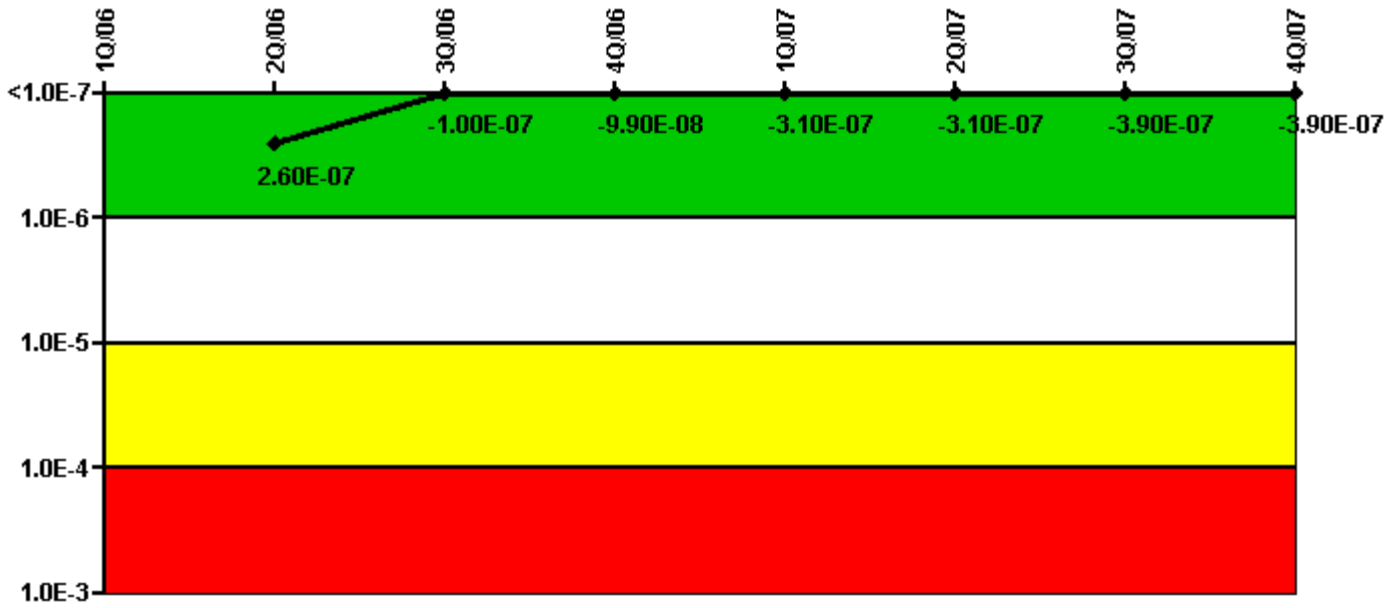

Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$


Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		$-2.00E-08$	$-2.90E-08$	$-2.90E-08$	$-2.00E-07$	$-2.00E-07$	$-1.50E-07$	$-1.50E-07$
URI (Δ CDF)		$2.80E-07$	$-7.10E-08$	$-7.00E-08$	$-1.10E-07$	$-1.10E-07$	$-2.40E-07$	$-2.40E-07$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$2.60E-07$	$-1.00E-07$	$-9.90E-08$	$-3.10E-07$	$-3.10E-07$	$-3.90E-07$	$-3.90E-07$

Licensee Comments:

4Q/07: Changed PRA Parameter(s). Minor changes to PRA parameters, based on PRA model revision 5a for improved modeling of a non-MSPI system and human reliability dependency multipliers.

Mitigating Systems Performance Index, Heat Removal System

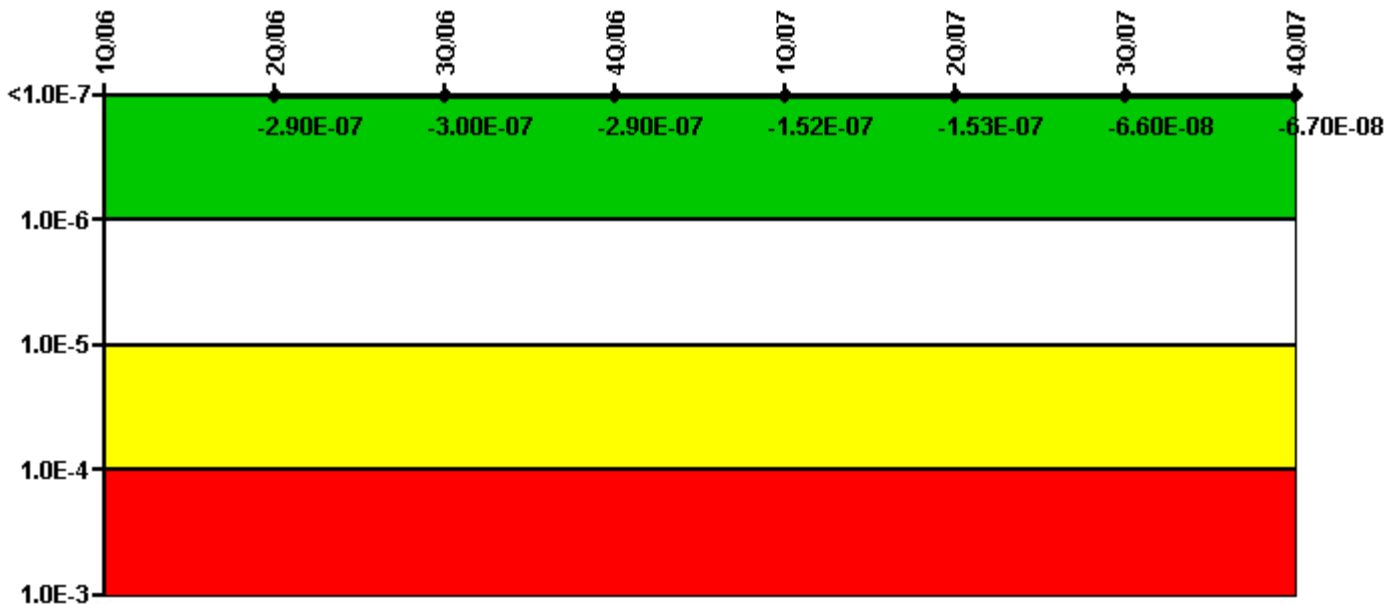

Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$


Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		$2.50E-07$	$2.50E-07$	$2.50E-07$	$5.80E-08$	$5.70E-08$	$3.40E-08$	$3.30E-08$
URI (Δ CDF)		$-5.40E-07$	$-5.50E-07$	$-5.40E-07$	$-2.10E-07$	$-2.10E-07$	$-1.00E-07$	$-1.00E-07$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$-2.90E-07$	$-3.00E-07$	$-2.90E-07$	$-1.52E-07$	$-1.53E-07$	$-6.60E-08$	$-6.70E-08$

Licensee Comments:

4Q/07: Changed PRA Parameter(s). Minor changes to PRA parameters, based on PRA model revision 5a for improved modeling of a non-MSPI system and human reliability dependency multipliers.

Mitigating Systems Performance Index, Residual Heat Removal System

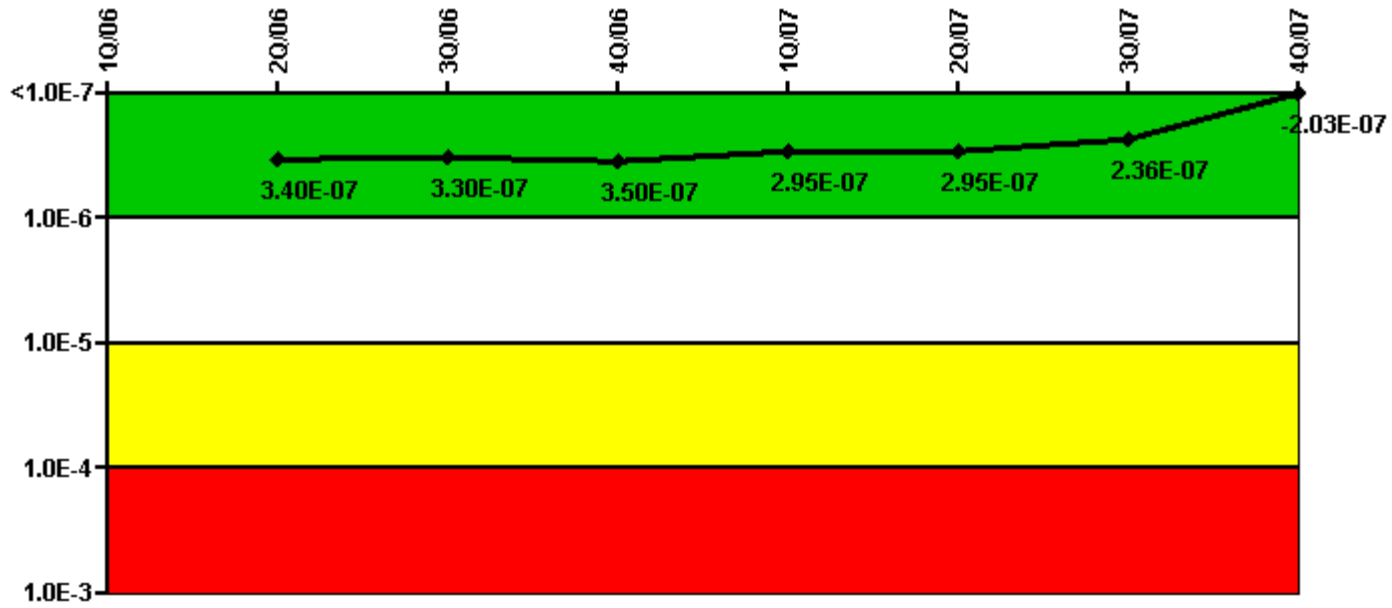

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		-2.00E-08	-2.00E-08	-2.00E-08	-1.50E-08	-1.50E-08	-1.40E-08	-2.30E-08
URI (ΔCDF)		3.60E-07	3.50E-07	3.70E-07	3.10E-07	3.10E-07	2.50E-07	-1.80E-07
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		3.40E-07	3.30E-07	3.50E-07	2.95E-07	2.95E-07	2.36E-07	-2.03E-07

Licensee Comments:

4Q/07: Minor changes to PRA parameters, based on PRA model revision 5a for improved modeling of a non-MSPI system and human reliability dependency multipliers.

Mitigating Systems Performance Index, Cooling Water Systems

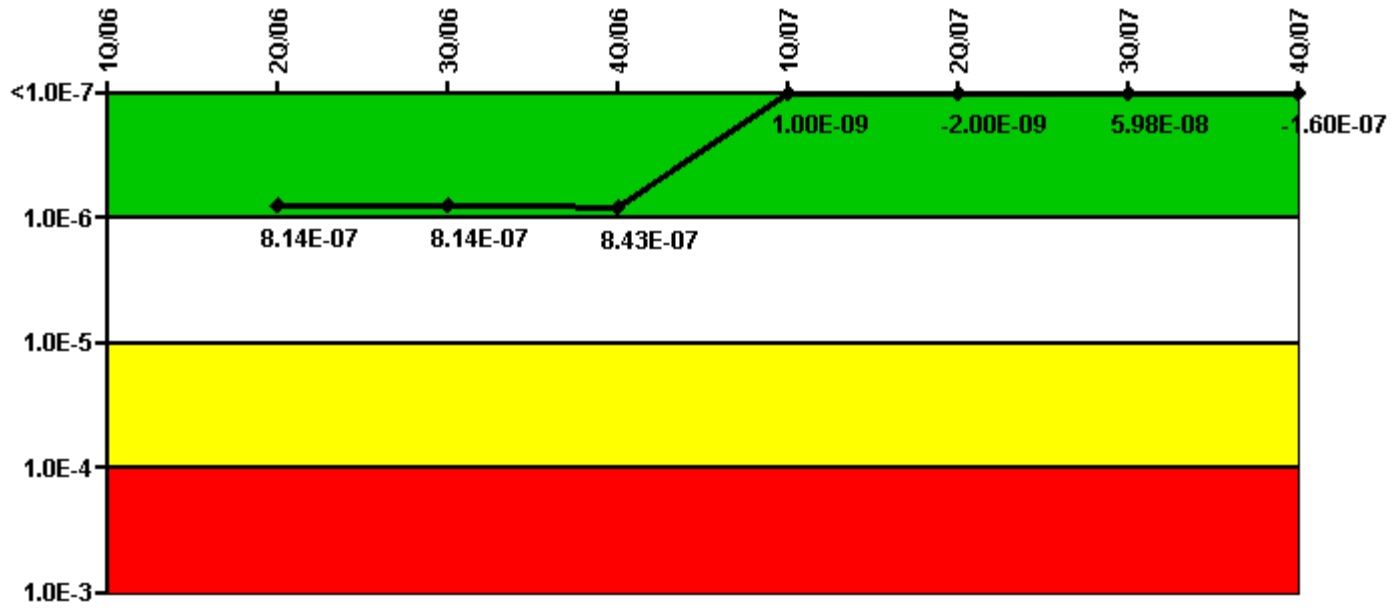

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		4.40E-08	4.40E-08	4.30E-08	3.90E-08	3.80E-08	9.80E-09	9.80E-09
URI (ΔCDF)		7.70E-07	7.70E-07	8.00E-07	-3.80E-08	-4.00E-08	5.00E-08	-1.70E-07
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		8.14E-07	8.14E-07	8.43E-07	1.00E-09	-2.00E-09	5.98E-08	-1.60E-07

Licensee Comments:

4Q/07: Changed PRA Parameter(s). Minor changes to PRA parameters, based on PRA model revision 5a for improved modeling of a non-MSPI system and human reliability dependency multipliers.

Reactor Coolant System Activity

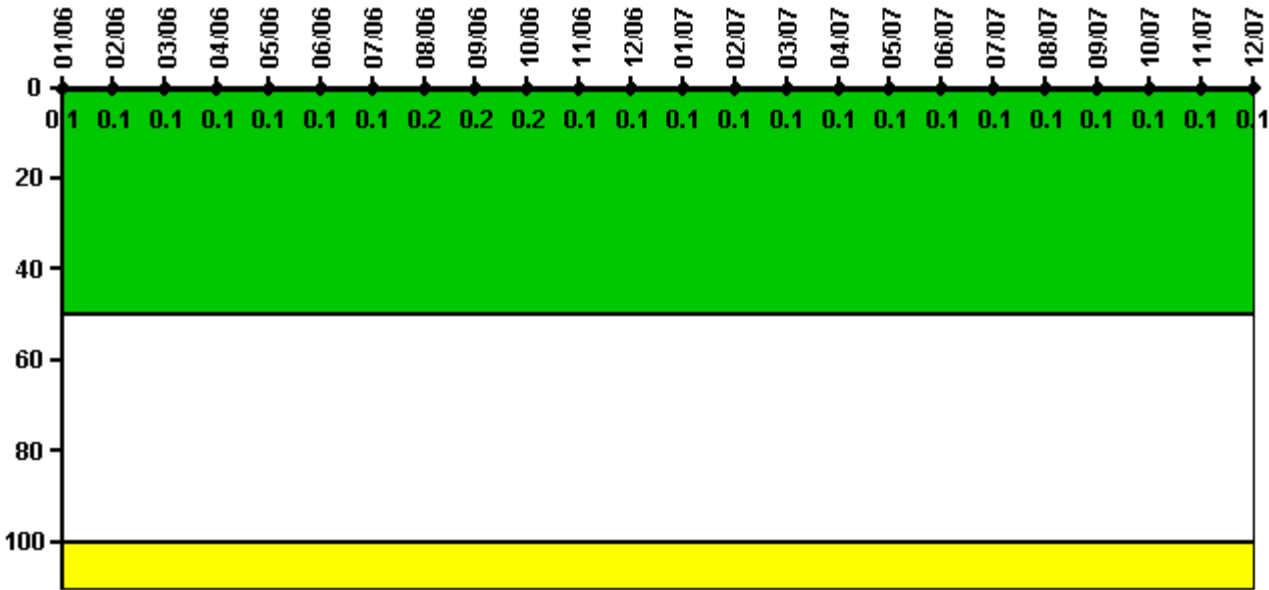

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum activity	0.001190	0.001240	0.001250	0.001270	0.001340	0.001410	0.001480	0.001600	0.001660	0.001640	0.000671	0.000782
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.1

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000820	0.000828	0.000862	0.000893	0.000907	0.000938	0.000973	0.001011	0.001100	0.001062	0.001097	0.001125
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

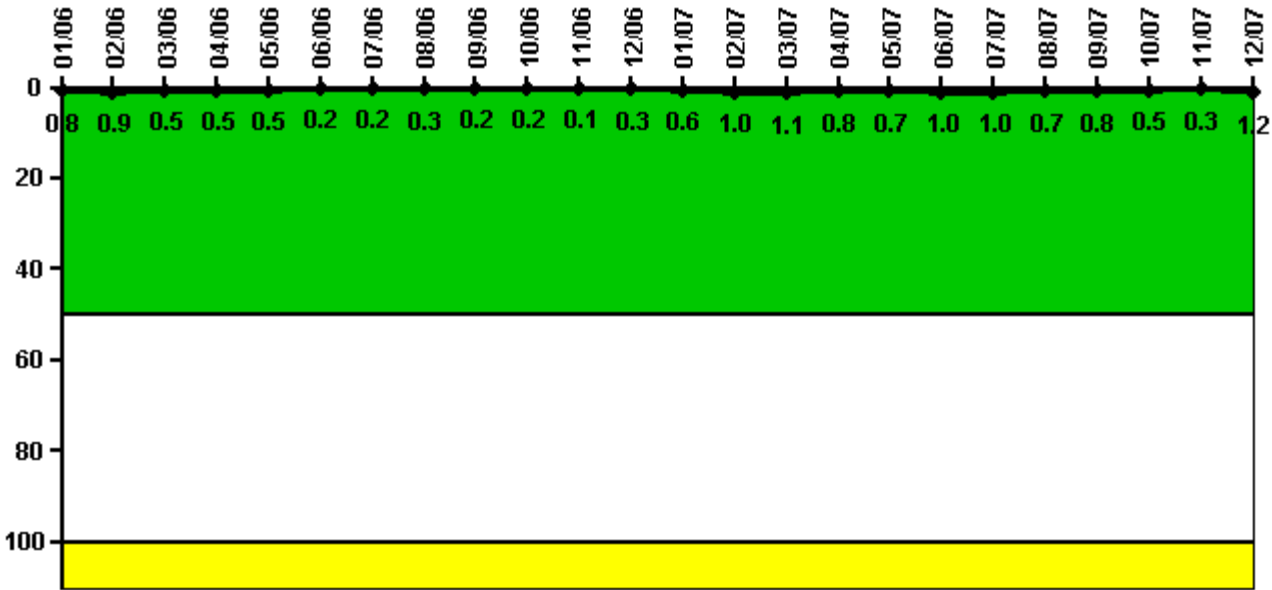

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum leakage	0.080	0.090	0.050	0.050	0.050	0.020	0.020	0.030	0.020	0.020	0.010	0.030
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.8	0.9	0.5	0.5	0.5	0.2	0.2	0.3	0.2	0.2	0.1	0.3

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	0.060	0.100	0.110	0.080	0.070	0.100	0.100	0.070	0.080	0.050	0.030	0.120
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.6	1.0	1.1	0.8	0.7	1.0	1.0	0.7	0.8	0.5	0.3	1.2

Licensee Comments: none

Drill/Exercise Performance

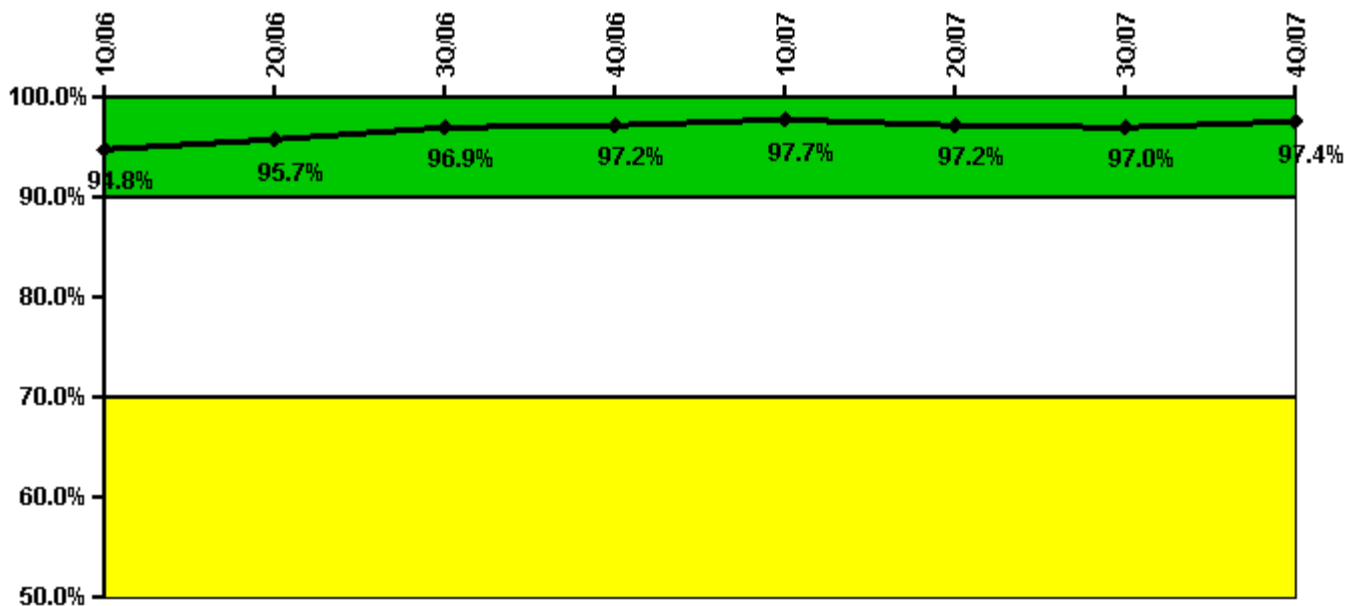


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful opportunities	57.0	38.0	29.0	0	31.0	22.0	36.0	8.0
Total opportunities	59.0	38.0	29.0	0	31.0	24.0	38.0	8.0
Indicator value	94.8%	95.7%	96.9%	97.2%	97.7%	97.2%	97.0%	97.4%

Licensee Comments: none

ERO Drill Participation

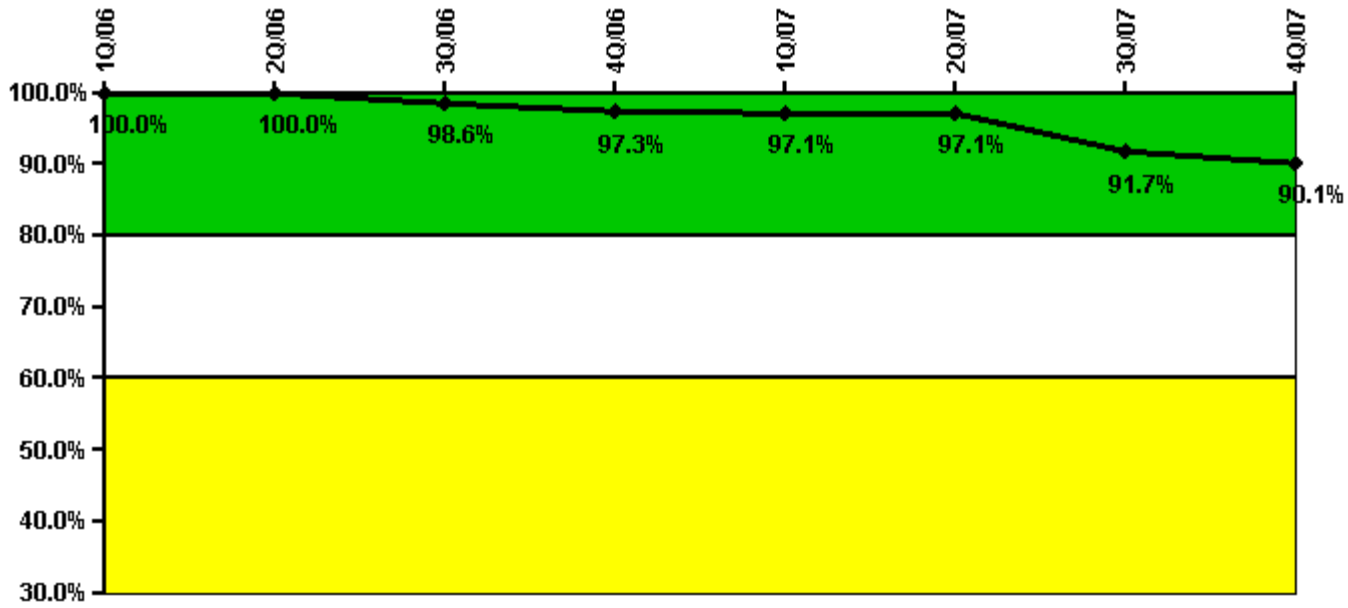


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Participating Key personnel	75.0	71.0	71.0	71.0	66.0	66.0	66.0	64.0
Total Key personnel	75.0	71.0	72.0	73.0	68.0	68.0	72.0	71.0
Indicator value	100.0%	100.0%	98.6%	97.3%	97.1%	97.1%	91.7%	90.1%

Licensee Comments: none

Alert & Notification System

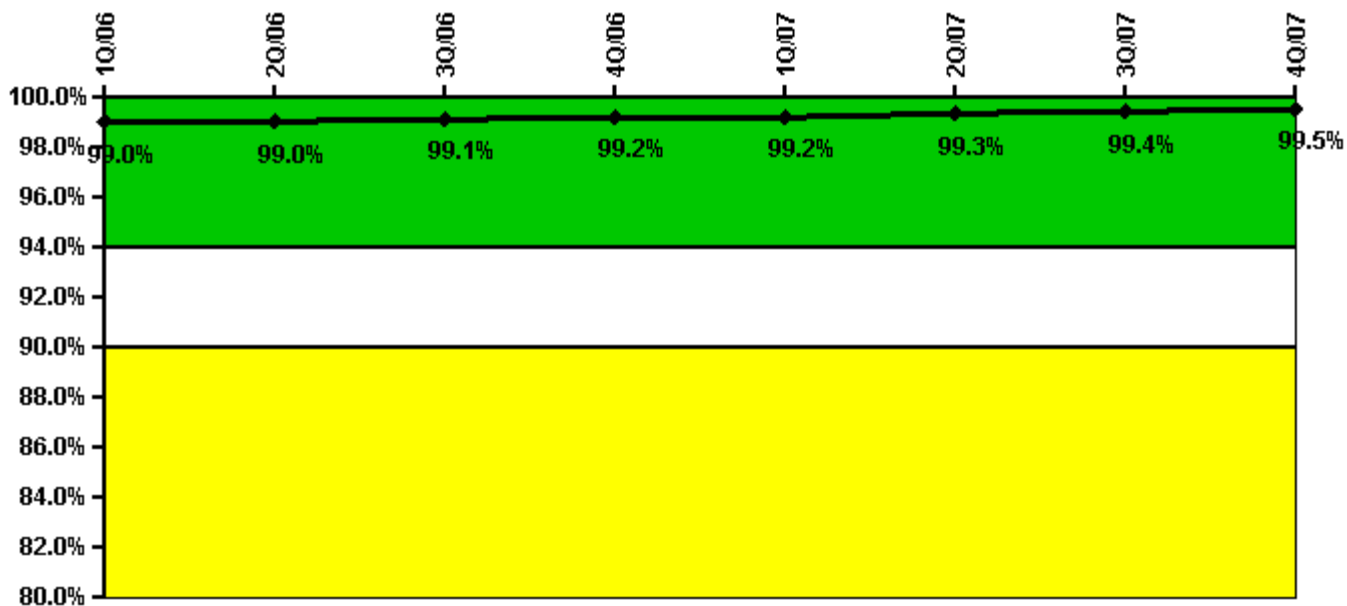

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful siren-tests	737	840	736	840	738	845	738	844
Total sirens-tests	742	848	742	848	742	848	742	848
Indicator value	99.0%	99.0%	99.1%	99.2%	99.2%	99.3%	99.4%	99.5%

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: February 4, 2008