


Turkey Point 3

4Q/2007 Performance Indicators

Licensee's General Comments: Unit 3 cycle 23 online date was 10/16/07. Unit 3 had a total unplanned outage extension from 10/8/07 to 10/16/07 of 209.03 hours. The outage extension occurred due to delays to the containment spray pump work due to the presence of FME in the CS piping, voltage regulator issues, and inclement weather (56.5 hours outside management control).

Unplanned Scrams per 7000 Critical Hrs

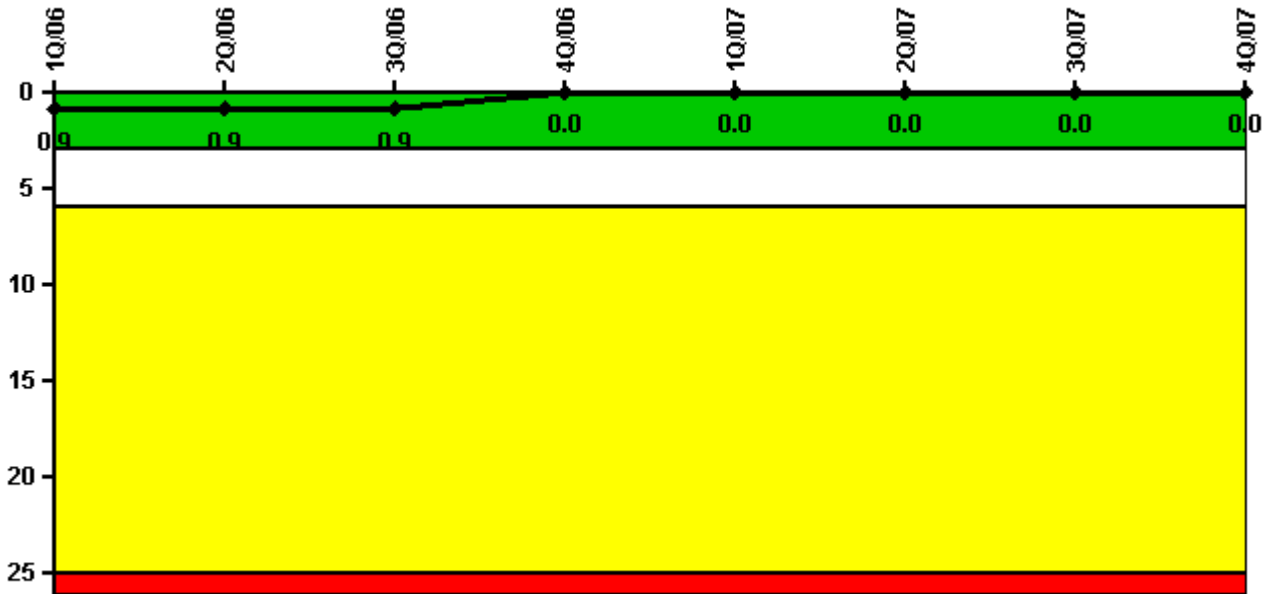


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1536.1	2015.5	2208.0	2209.0	2159.0	1835.1	1536.0	1922.8
Indicator value	0.9	0.9	0.9	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

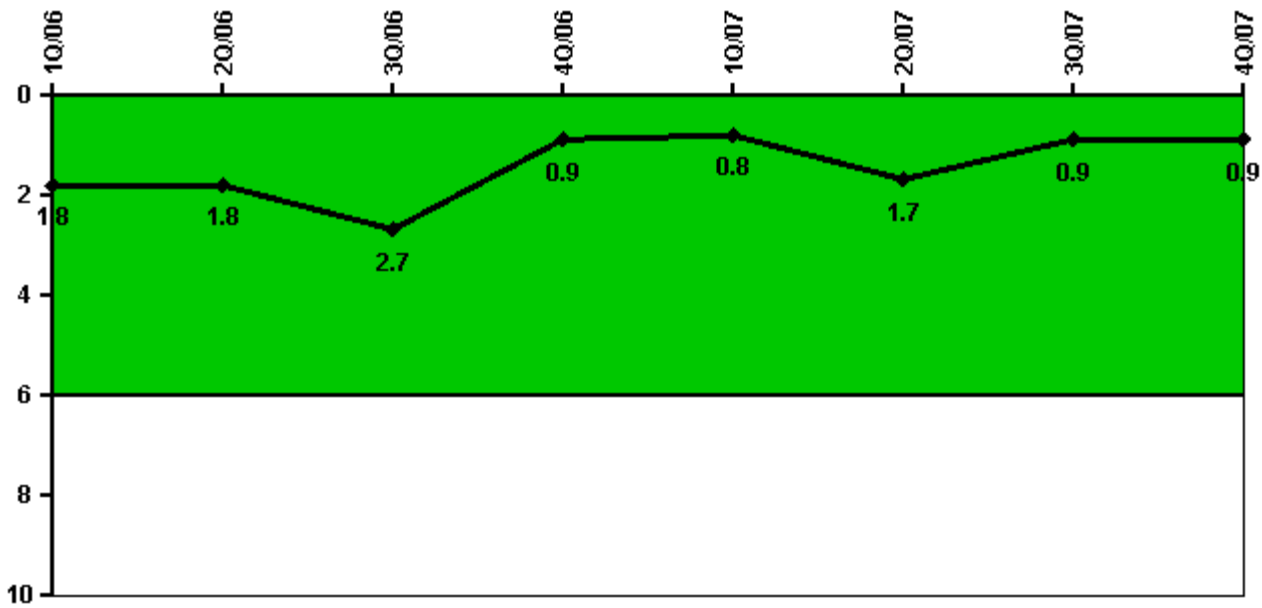


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned power changes	0	0	1.0	0	0	1.0	0	0
Critical hours	1536.1	2015.5	2208.0	2209.0	2159.0	1835.1	1536.0	1922.8
Indicator value	1.8	1.8	2.7	0.9	0.8	1.7	0.9	0.9

Licensee Comments: none

Unplanned Scrams with Complications

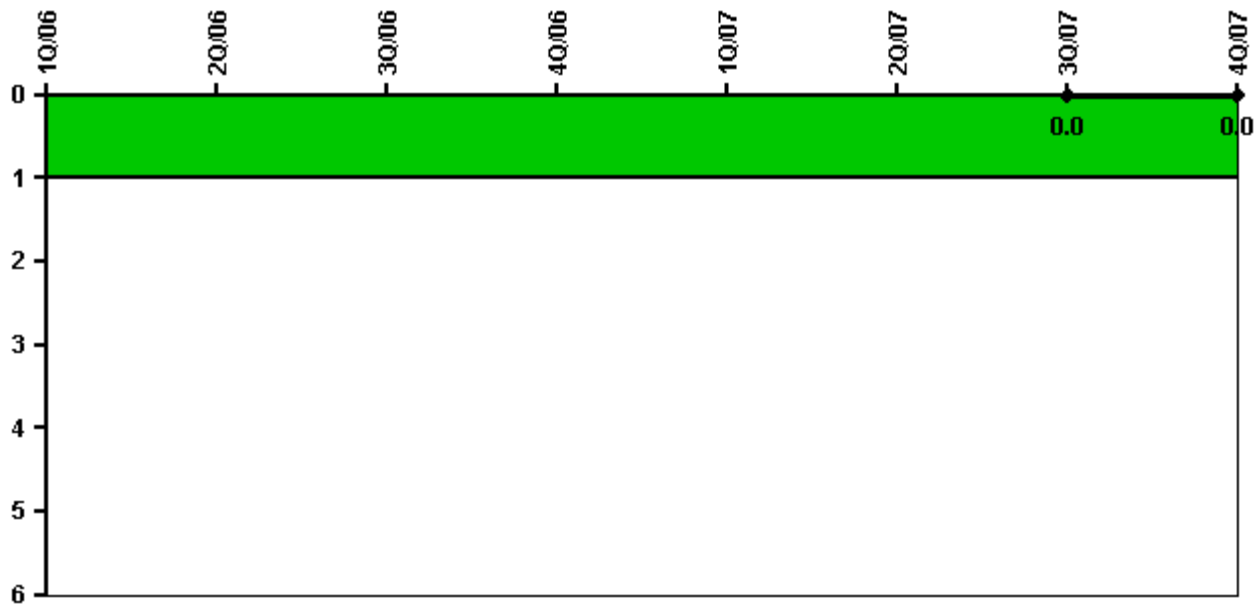


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Scrams with complications				0	0	0	0	0
Indicator value							0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

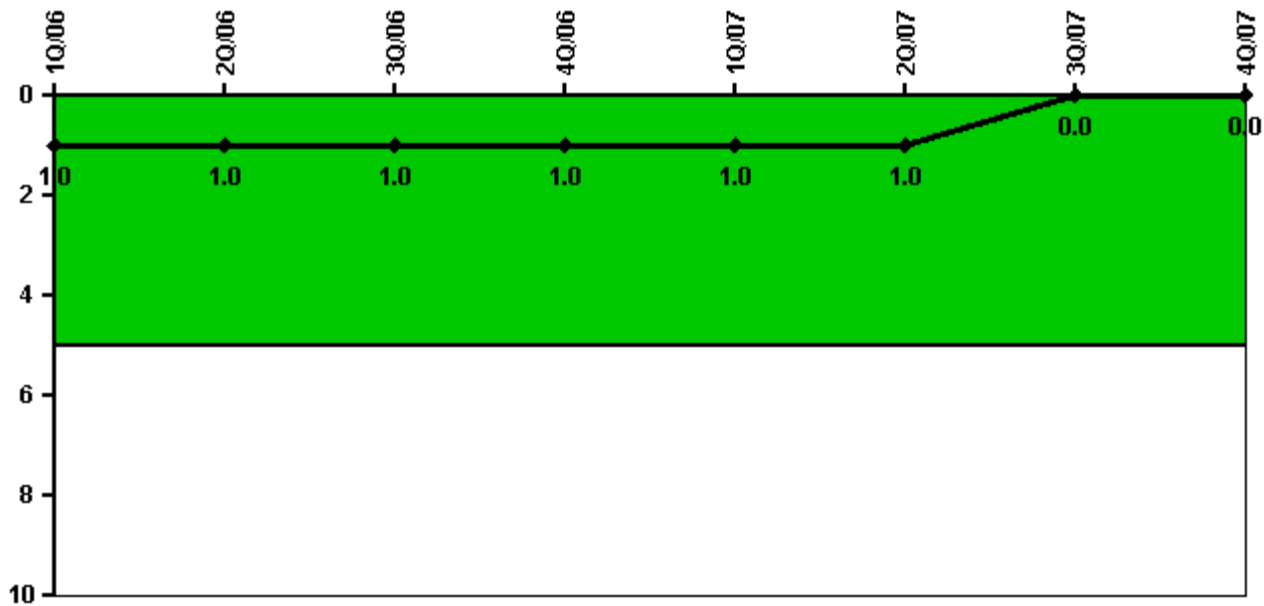


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Safety System Functional Failures	0	0	1	0	0	0	0	0
Indicator value	1	1	1	1	1	1	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

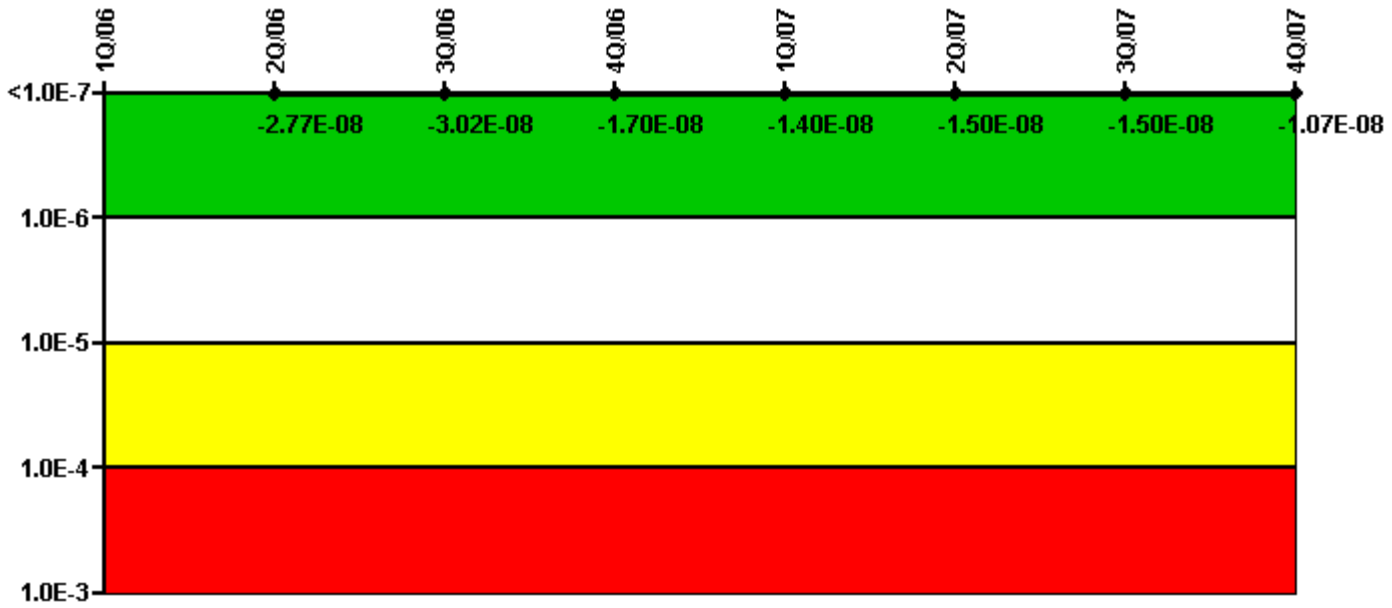


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		2.70E-10	-3.20E-09	1.00E-08	1.30E-08	1.30E-08	1.30E-08	2.30E-09
URI (Δ CDF)		-2.80E-08	-2.70E-08	-2.70E-08	-2.70E-08	-2.80E-08	-2.80E-08	-1.30E-08
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-2.77E-08	-3.02E-08	-1.70E-08	-1.40E-08	-1.50E-08	-1.50E-08	-1.07E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

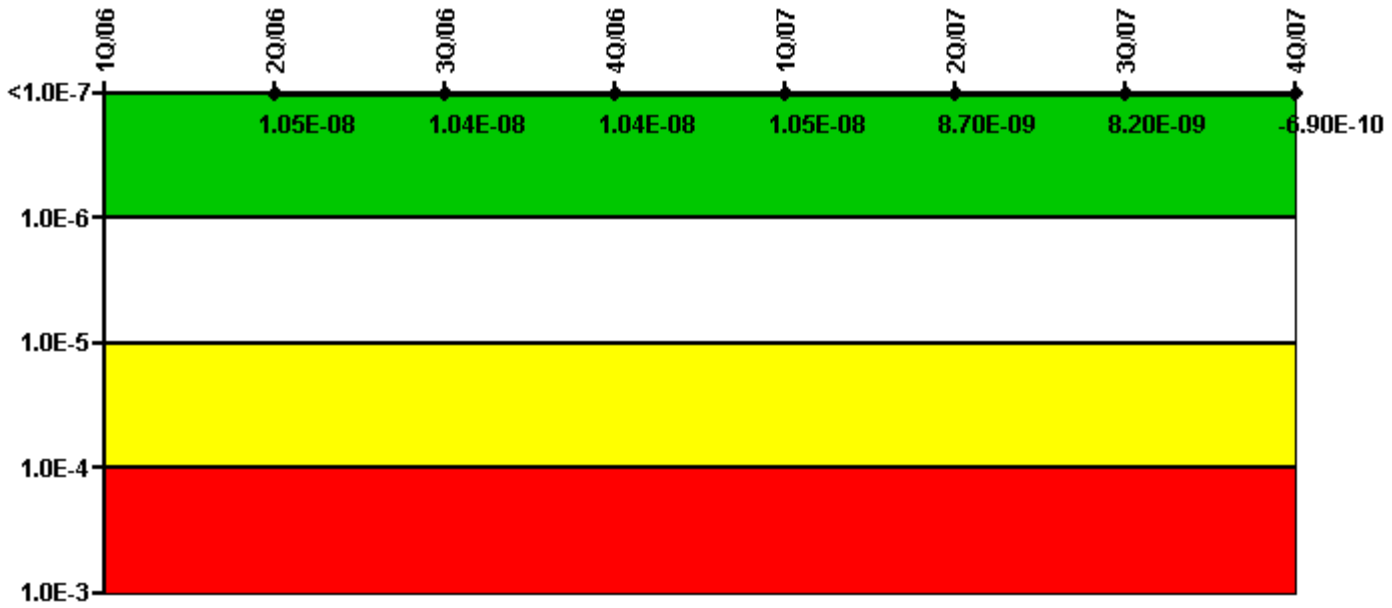


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ACDF)		-4.80E-10	-5.70E-10	-5.70E-10	-5.50E-10	-2.30E-09	-2.80E-09	-1.70E-10
URI (ACDF)		1.10E-08	1.10E-08	1.10E-08	1.10E-08	1.10E-08	1.10E-08	-5.20E-10
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		1.05E-08	1.04E-08	1.04E-08	1.05E-08	8.70E-09	8.20E-09	-6.90E-10

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

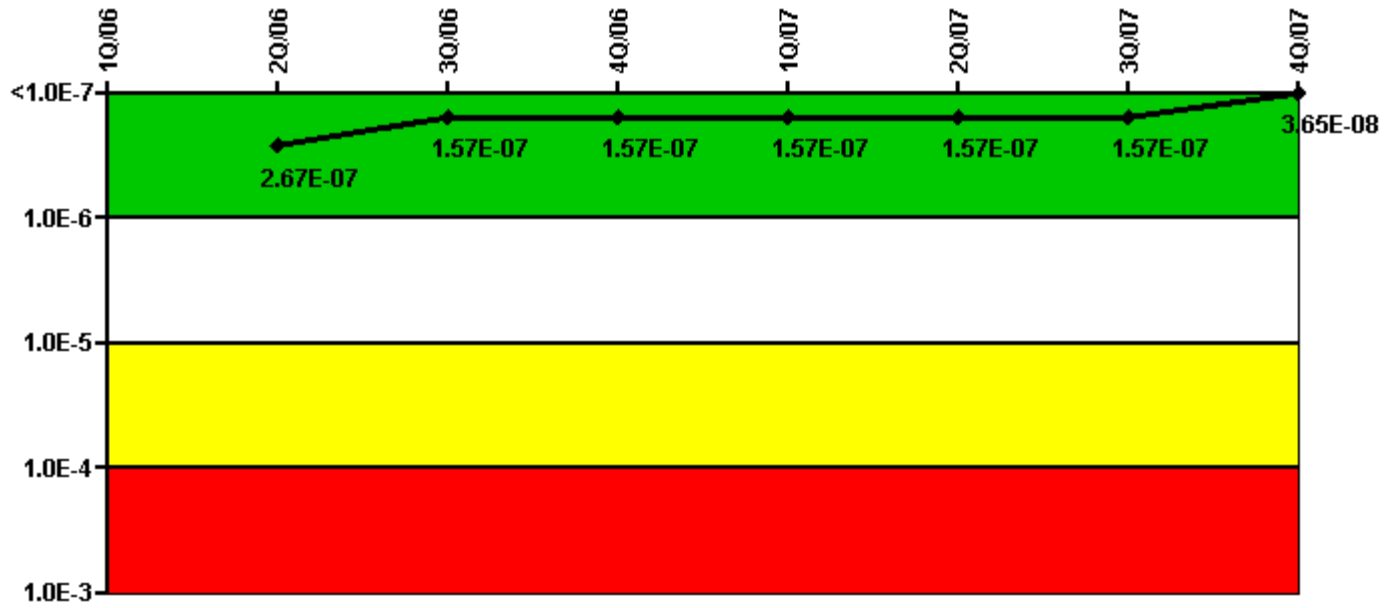


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.50E-09
URI (ΔCDF)		2.80E-07	1.70E-07	1.70E-07	1.70E-07	1.70E-07	1.70E-07	3.80E-08
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		2.67E-07	1.57E-07	1.57E-07	1.57E-07	1.57E-07	1.57E-07	3.65E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

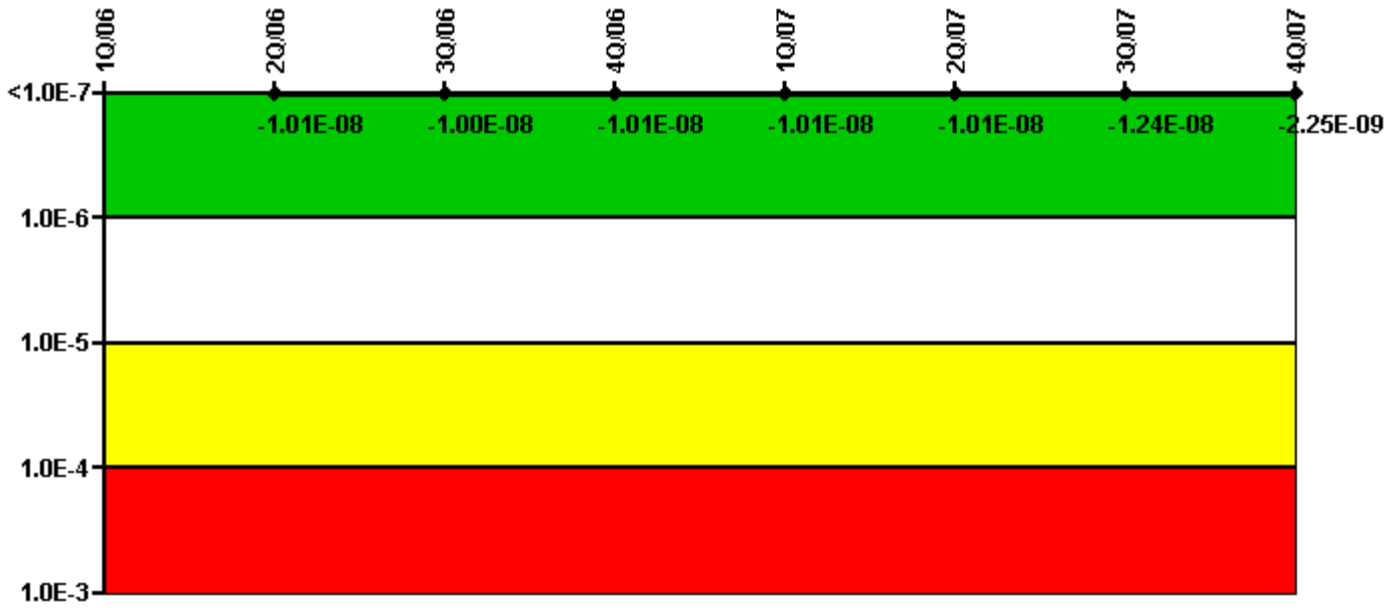


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (Δ CDF)		$1.90E-09$	$2.00E-09$	$1.90E-09$	$1.90E-09$	$1.90E-09$	$6.30E-10$	$-4.50E-10$
URI (Δ CDF)		$-1.20E-08$	$-1.20E-08$	$-1.20E-08$	$-1.20E-08$	$-1.20E-08$	$-1.30E-08$	$-1.80E-09$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$-1.01E-08$	$-1.00E-08$	$-1.01E-08$	$-1.01E-08$	$-1.01E-08$	$-1.24E-08$	$-2.25E-09$

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

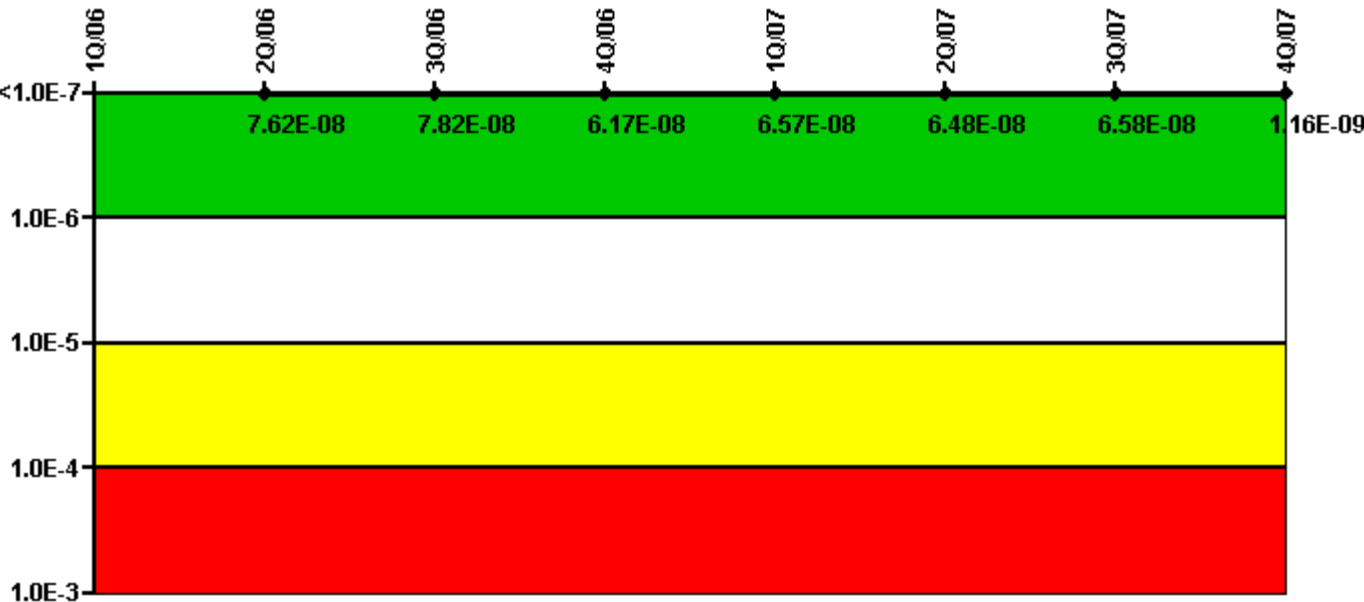


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		$7.10E-08$	$7.30E-08$	$6.00E-08$	$6.40E-08$	$6.30E-08$	$6.40E-08$	$1.20E-09$
URI (ΔCDF)		$5.20E-09$	$5.20E-09$	$1.70E-09$	$1.70E-09$	$1.80E-09$	$1.80E-09$	$-3.80E-11$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$7.62E-08$	$7.82E-08$	$6.17E-08$	$6.57E-08$	$6.48E-08$	$6.58E-08$	$1.16E-09$

Licensee Comments: none

Reactor Coolant System Activity

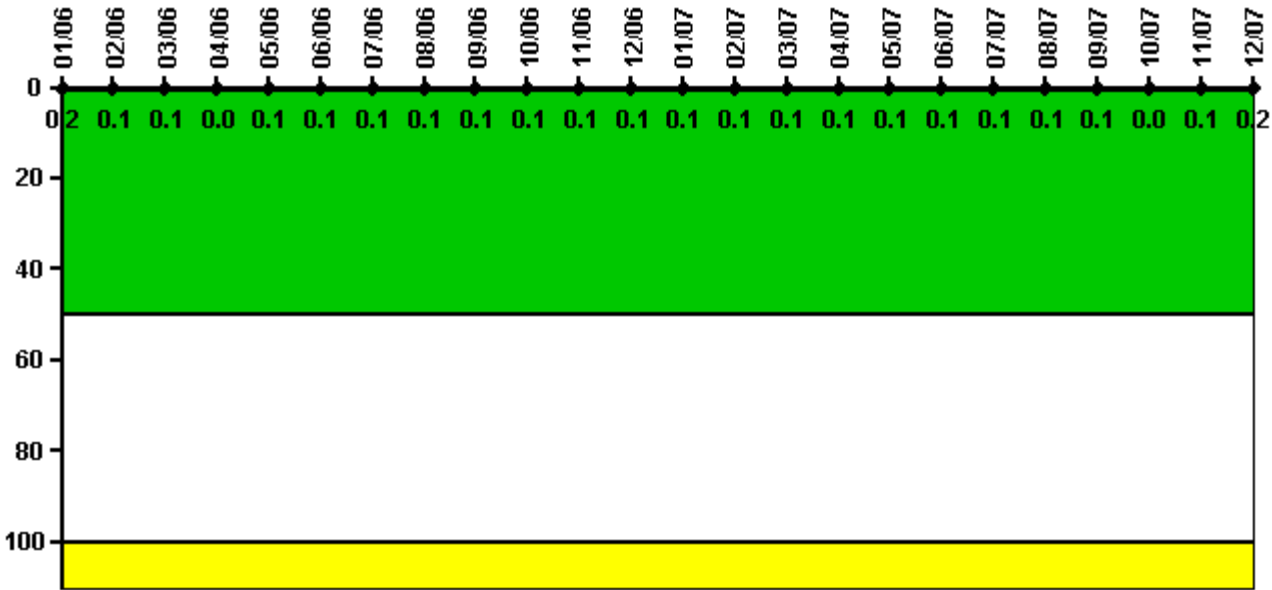

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum activity	0.001750	0.000926	0.001070	0.000468	0.000595	0.000501	0.000641	0.000702	0.000793	0.000610	0.000580	0.000824
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.1	0.1	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000671	0.000763	0.000824	0.000855	0.000946	0.000732	0.000885	0.001040	0.000763	0.000488	0.001160	0.001530
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0	0.1	0.2

Licensee Comments:

12/07: Radiochemistry data indicated a single fuel leaker about 22 days into the cycle.

Reactor Coolant System Leakage

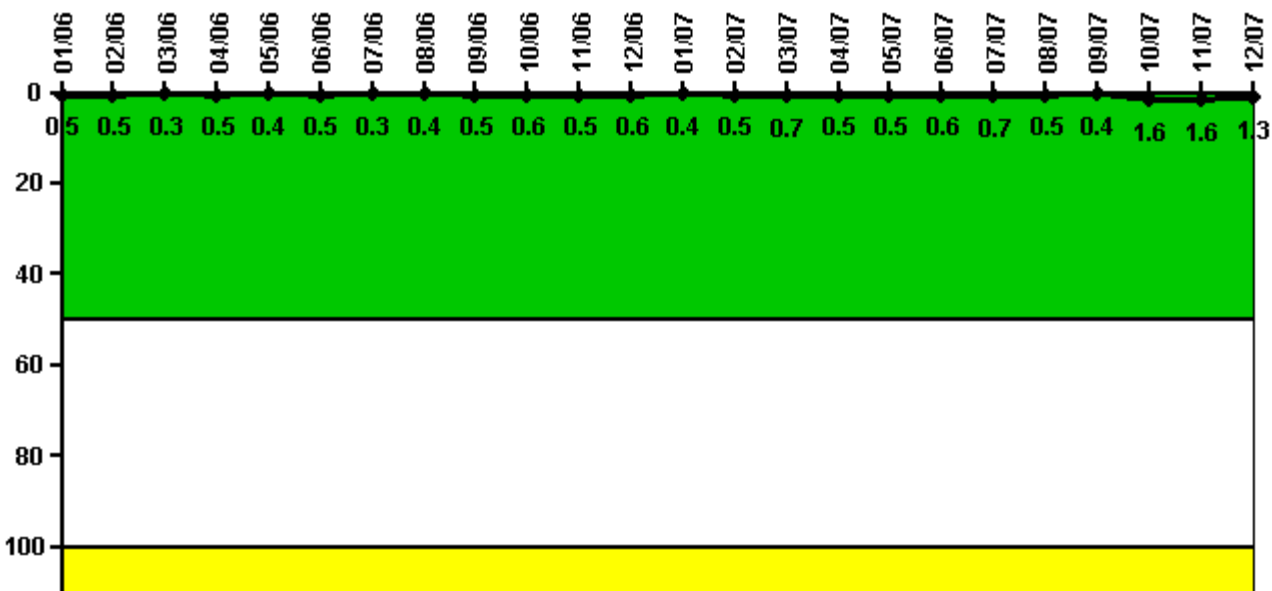


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum leakage	0.050	0.050	0.030	0.050	0.040	0.050	0.030	0.040	0.050	0.060	0.050	0.060
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.5	0.3	0.5	0.4	0.5	0.3	0.4	0.5	0.6	0.5	0.6
Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	0.040	0.050	0.070	0.050	0.050	0.060	0.070	0.050	0.040	0.160	0.160	0.130
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.4	0.5	0.7	0.5	0.5	0.6	0.7	0.5	0.4	1.6	1.6	1.3

Licensee Comments: none

Drill/Exercise Performance

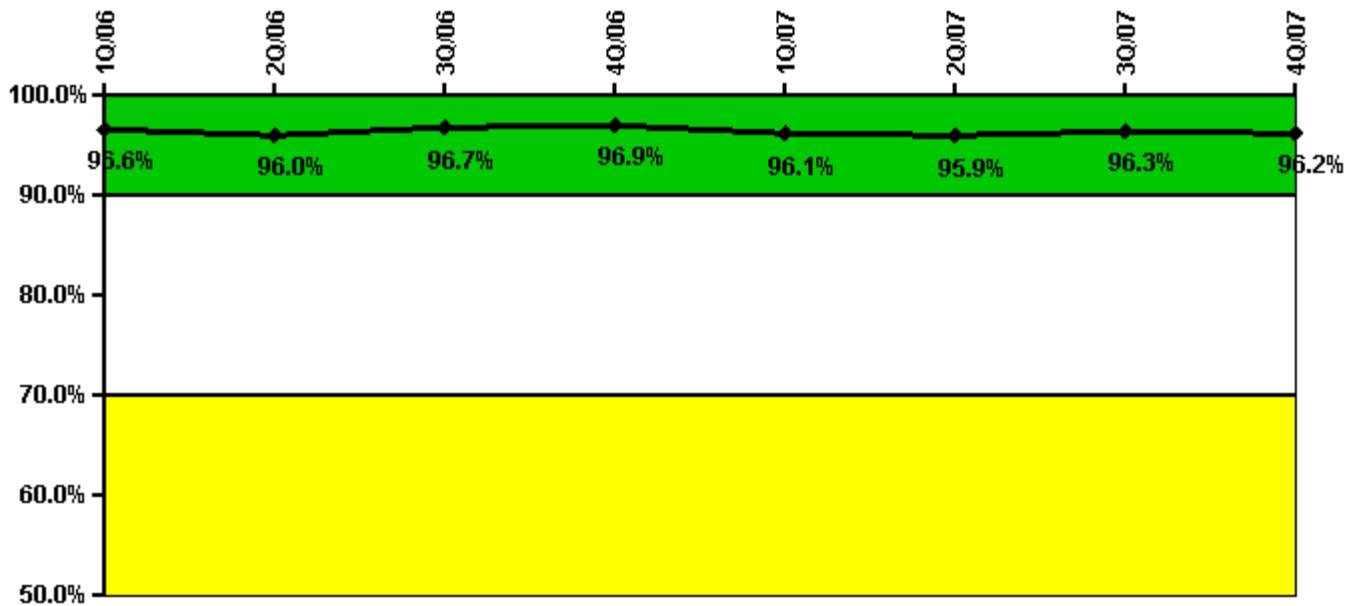


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful opportunities	75.0	38.0	50.0	22.0	72.0	34.0	30.0	36.0
Total opportunities	75.0	41.0	51.0	22.0	79.0	35.0	30.0	38.0
Indicator value	96.6%	96.0%	96.7%	96.9%	96.1%	95.9%	96.3%	96.2%

Licensee Comments: none

ERO Drill Participation

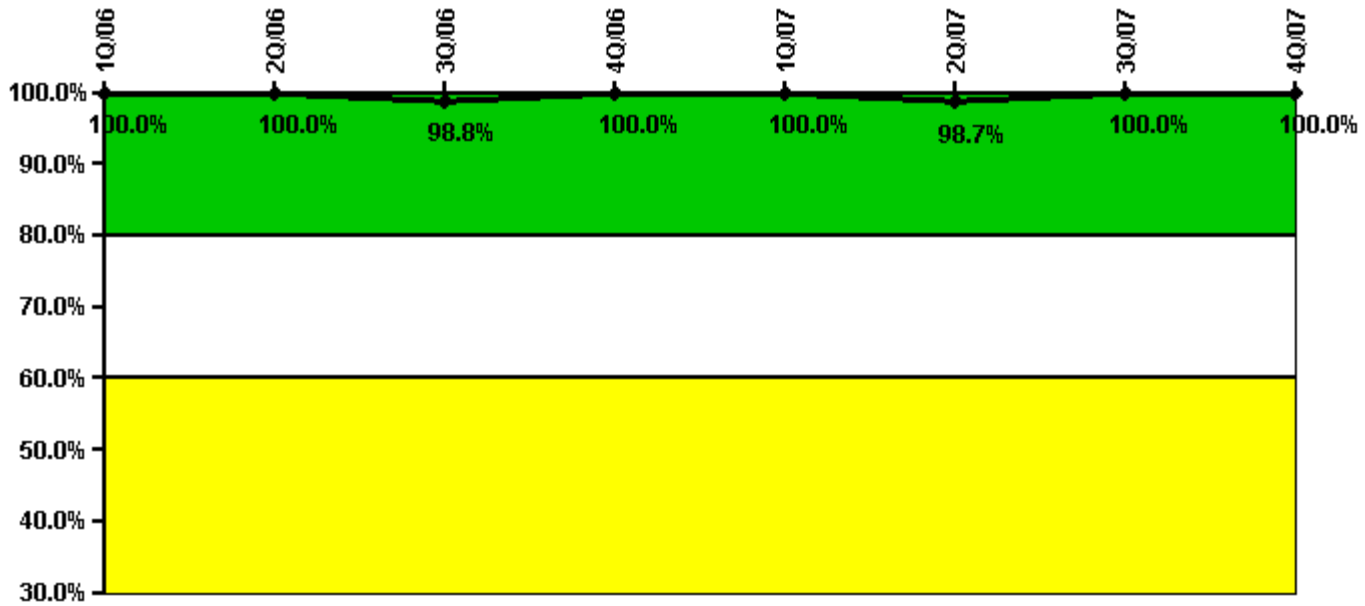


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Participating Key personnel	89.0	90.0	83.0	84.0	83.0	78.0	83.0	82.0
Total Key personnel	89.0	90.0	84.0	84.0	83.0	79.0	83.0	82.0
Indicator value	100.0%	100.0%	98.8%	100.0%	100.0%	98.7%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

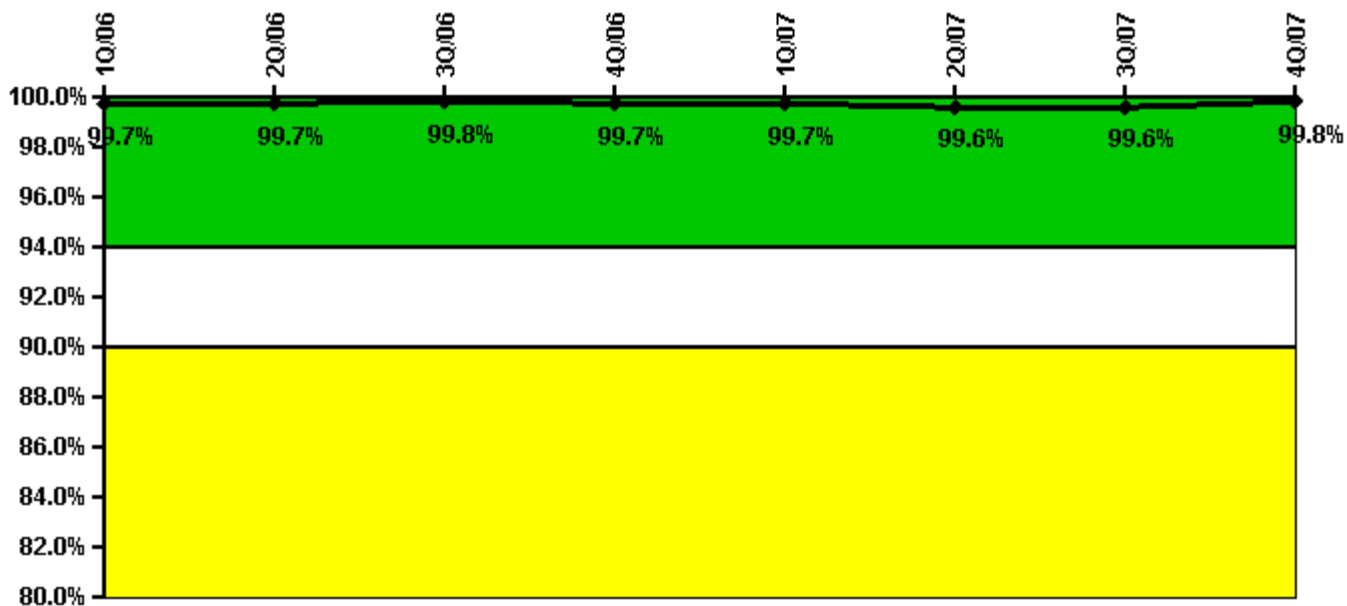

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful siren-tests	328	422	328	374	328	375	328	376
Total sirens-tests	329	423	329	376	329	376	329	376
Indicator value	99.7%	99.7%	99.8%	99.7%	99.7%	99.6%	99.6%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness




Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

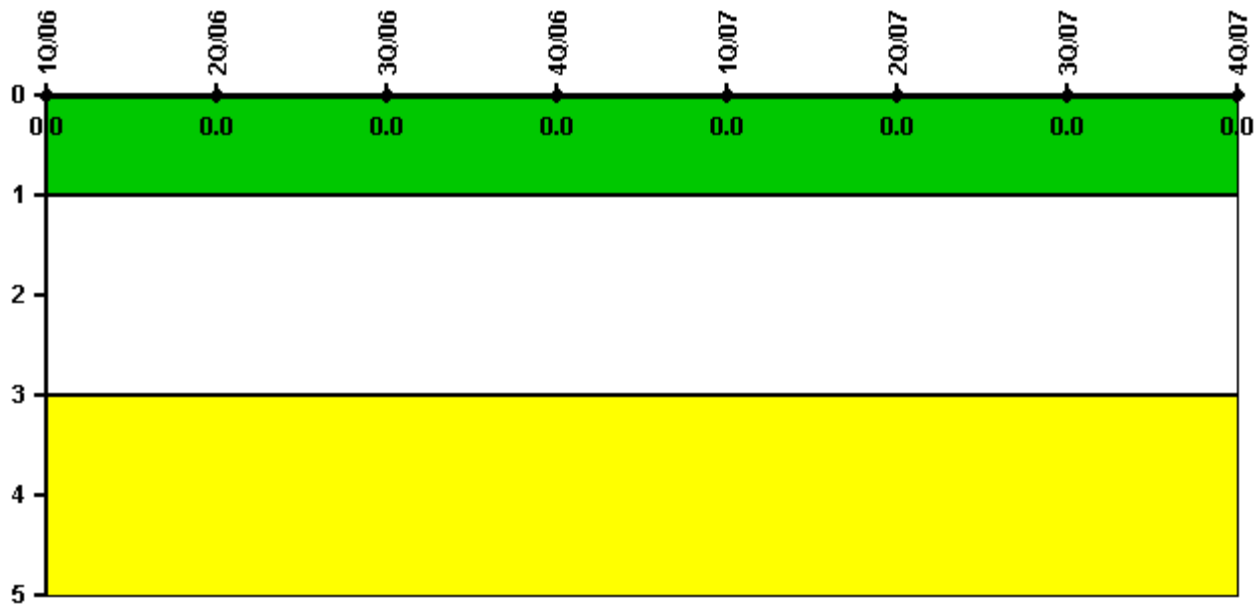

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.