


# Waterford 3

## 4Q/2007 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

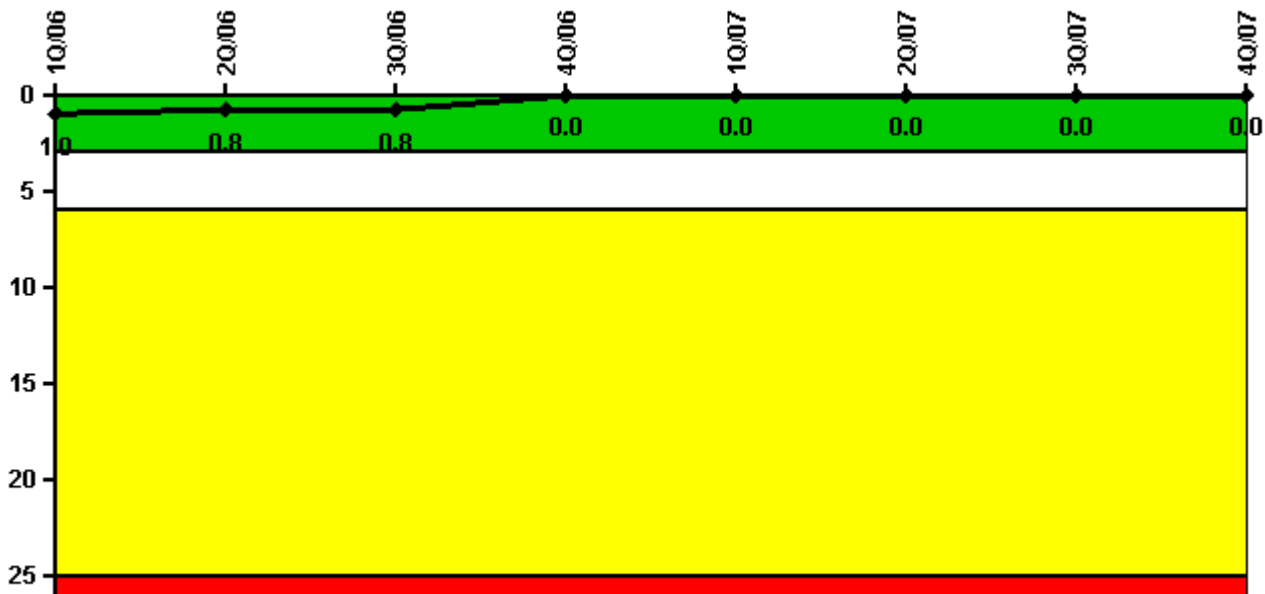


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2160.0	2183.0	2208.0	1464.3	2159.0	2184.0	2208.0	1878.8
Indicator value	1.0	0.8	0.8	0	0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

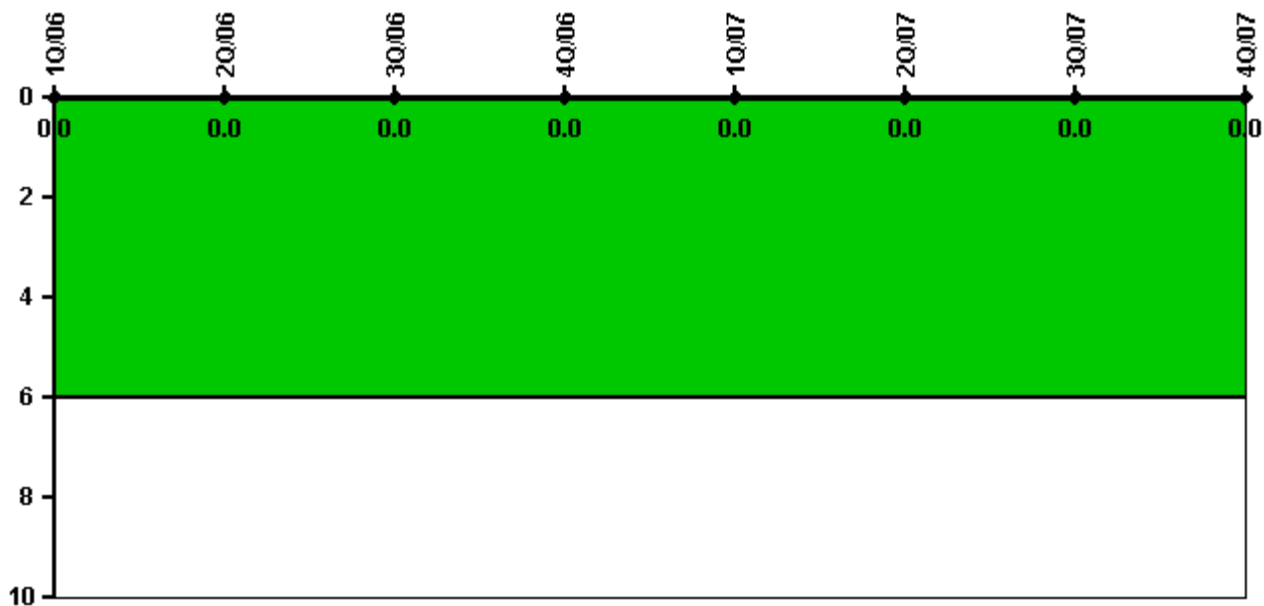


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2160.0	2183.0	2208.0	1464.3	2159.0	2184.0	2208.0	1878.8
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# Unplanned Scrams with Complications

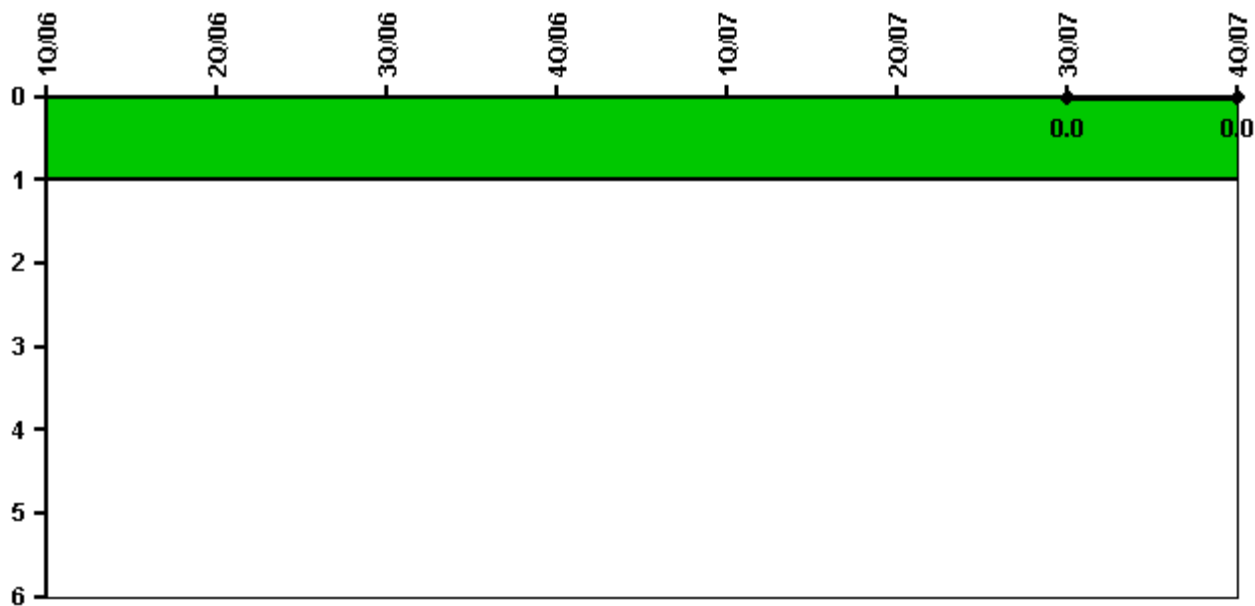


Thresholds: White > 1.0

## Notes

Unplanned Scrams with Complications	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Scrams with complications				0	0	0	0	0
<b>Indicator value</b>							<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

# Safety System Functional Failures (PWR)

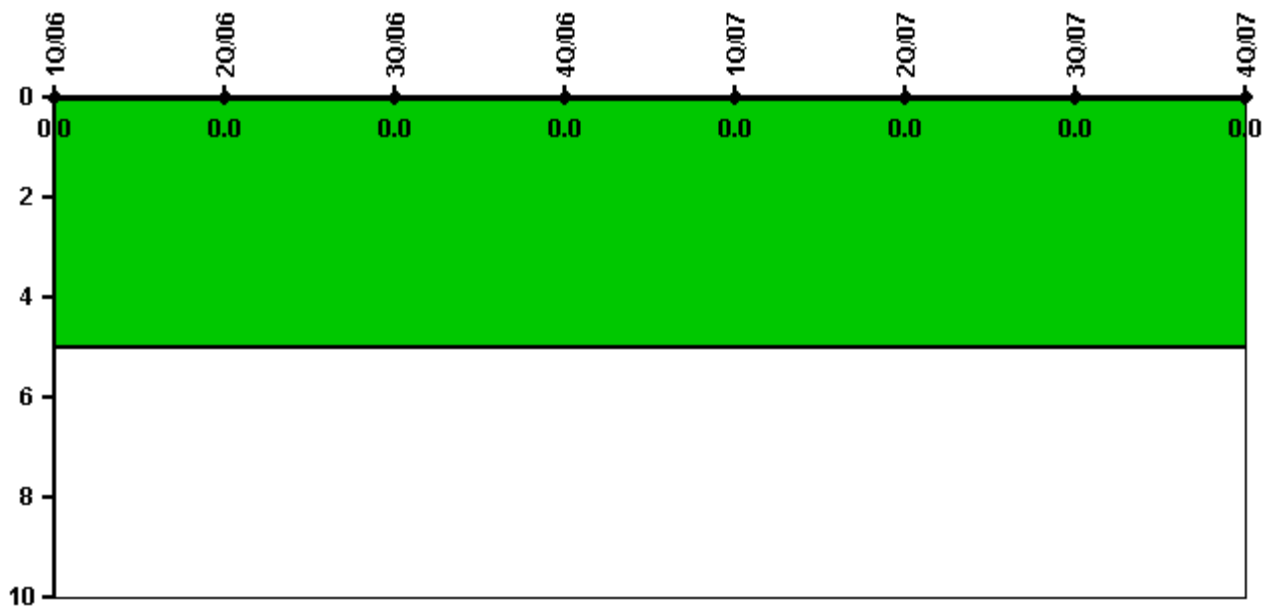


Thresholds: White > 5.0

## Notes

Safety System Functional Failures (PWR)	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

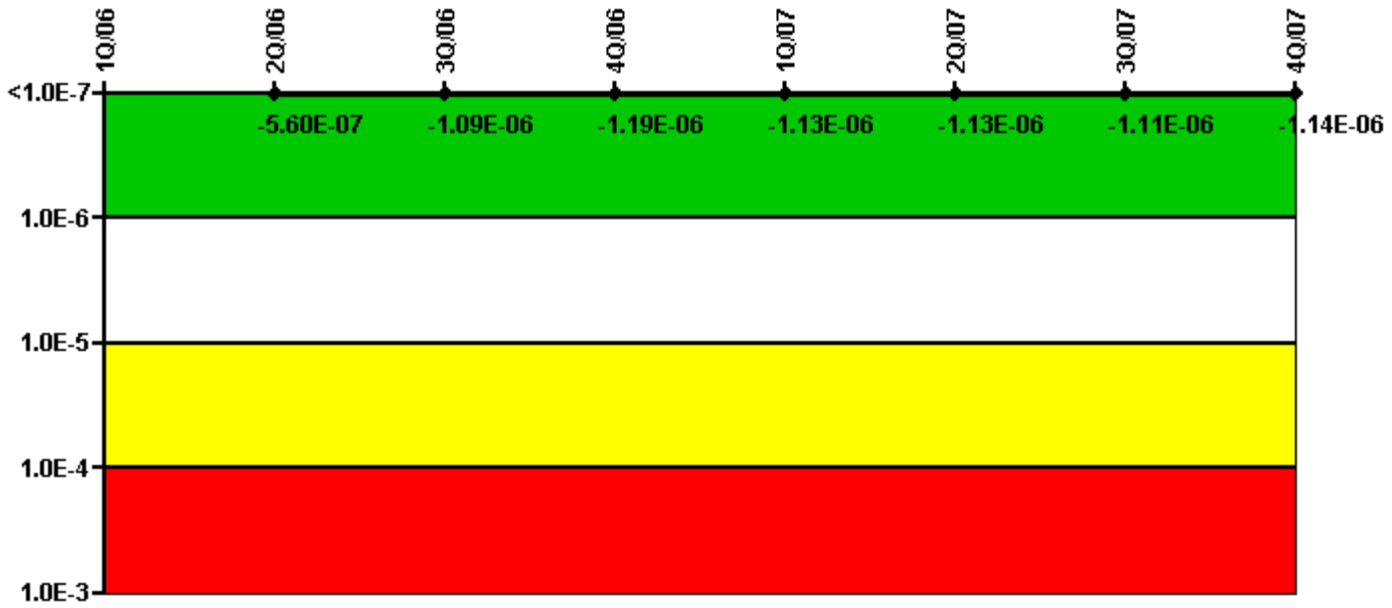


Thresholds: White >  $1.00E-6$  Yellow >  $1.00E-5$  Red >  $1.00E-4$

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		$2.50E-07$	$2.10E-07$	$2.10E-07$	$2.70E-07$	$2.70E-07$	$1.90E-07$	$1.60E-07$
URI ( $\Delta$ CDF)		$-8.10E-07$	$-1.30E-06$	$-1.40E-06$	$-1.40E-06$	$-1.40E-06$	$-1.30E-06$	$-1.30E-06$
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		$-5.60E-07$	$-1.09E-06$	$-1.19E-06$	$-1.13E-06$	$-1.13E-06$	$-1.11E-06$	$-1.14E-06$

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

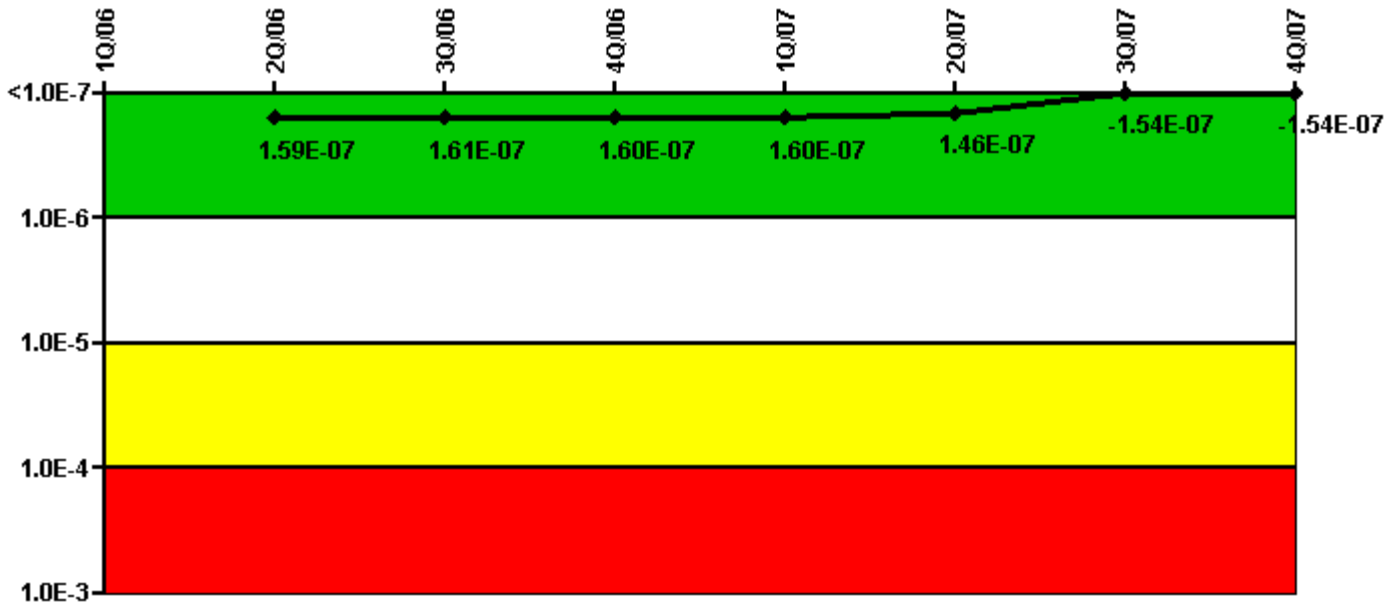


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		7.10E-08	7.30E-08	7.30E-08	7.30E-08	5.80E-08	-4.40E-09	-1.40E-08
URI ( $\Delta$ CDF)		8.80E-08	8.80E-08	8.70E-08	8.70E-08	8.80E-08	-1.50E-07	-1.40E-07
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		1.59E-07	1.61E-07	1.60E-07	1.60E-07	1.46E-07	-1.54E-07	-1.54E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

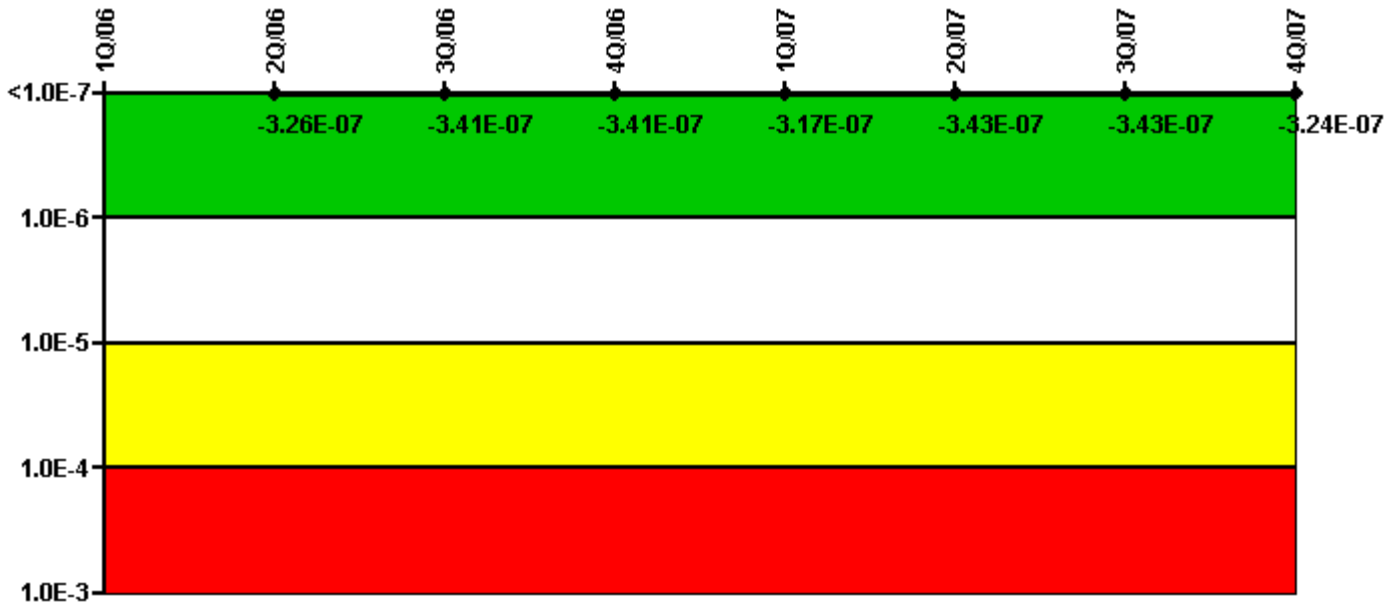


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		-4.60E-08	-6.10E-08	-6.10E-08	-3.70E-08	-6.30E-08	-6.30E-08	-4.40E-08
URI ( $\Delta$ CDF)		-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07	-2.80E-07
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		-3.26E-07	-3.41E-07	-3.41E-07	-3.17E-07	-3.43E-07	-3.43E-07	-3.24E-07

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

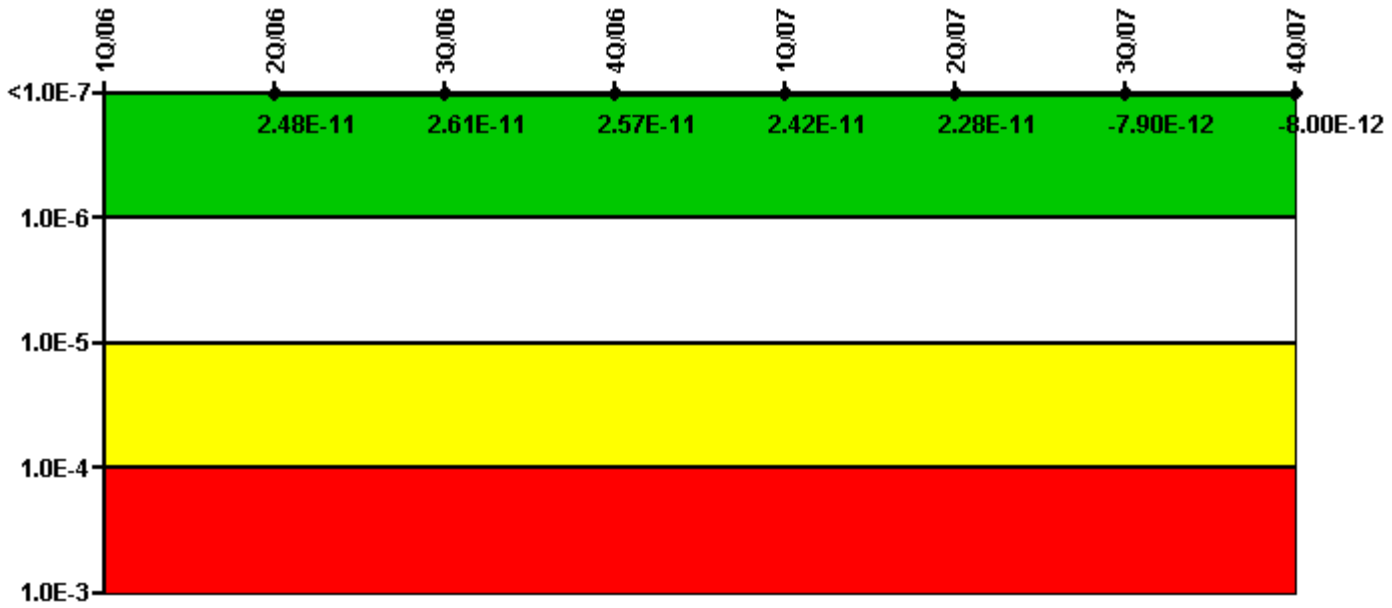

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI ( $\Delta$ CDF)		4.80E-12	6.10E-12	5.70E-12	4.20E-12	2.80E-12	-2.80E-12	-2.80E-12
URI ( $\Delta$ CDF)		2.00E-11	2.00E-11	2.00E-11	2.00E-11	2.00E-11	-5.10E-12	-5.20E-12
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		2.48E-11	2.61E-11	2.57E-11	2.42E-11	2.28E-11	-7.90E-12	-8.00E-12

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

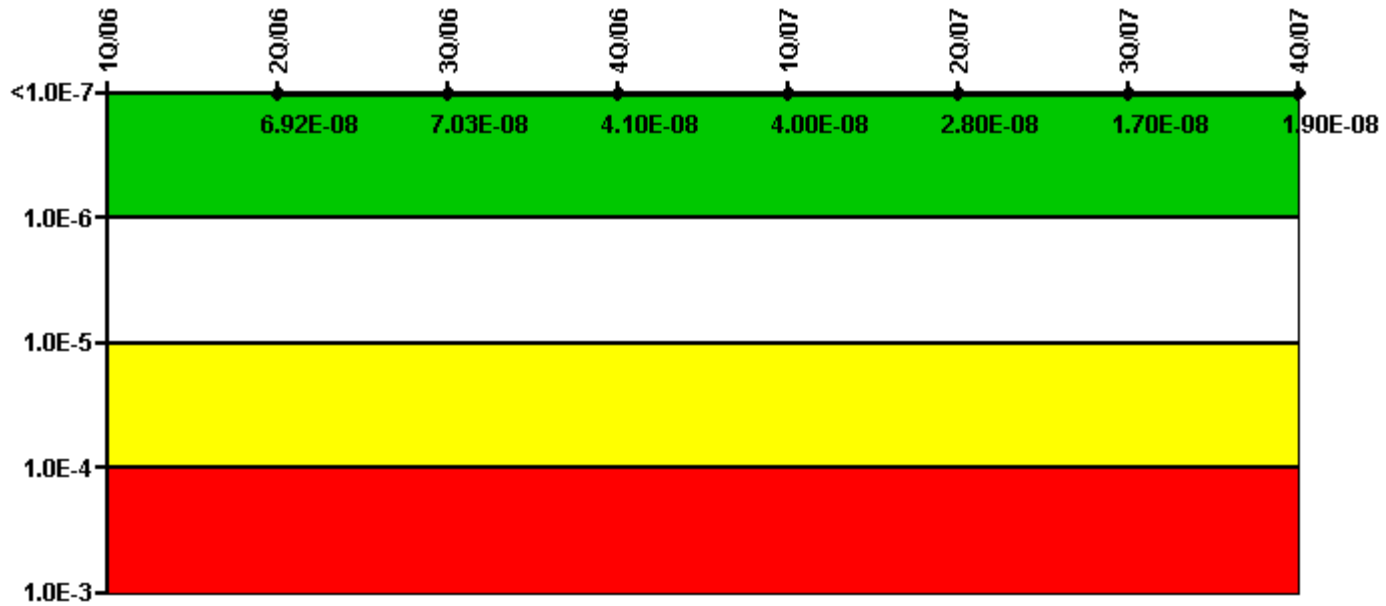

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
UAI (ΔCDF)		6.20E-08	6.40E-08	6.40E-08	6.40E-08	6.40E-08	6.30E-08	6.40E-08
URI (ΔCDF)		7.20E-09	6.30E-09	-2.30E-08	-2.40E-08	-3.60E-08	-4.60E-08	-4.50E-08
PLE		NO	NO	NO	NO	NO	NO	NO
Indicator value		6.92E-08	7.03E-08	4.10E-08	4.00E-08	2.80E-08	1.70E-08	1.90E-08

## Licensee Comments:

4Q/07: In October 2007, as documented in Condition Report CR-WF3-2007-03172, device record ACCMPMP0001A (Auxiliary Component Cooling Water Pump A) was changed to show the pump status at 100% power as "Operating" instead of "Standby." The status of this pump now conforms with the MSPI Basis Document. This change had minimal impact on the indicator value and the PI remains GREEN.

# Reactor Coolant System Activity

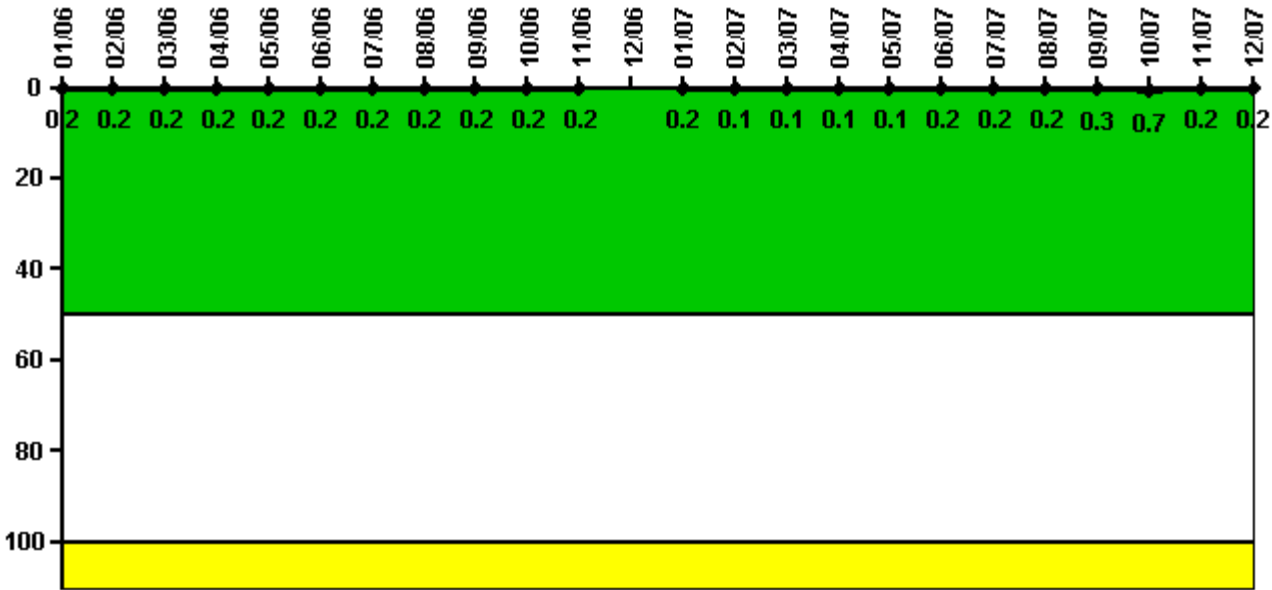

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Activity	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum activity	0.001850	0.001800	0.001680	0.002130	0.002310	0.002110	0.002050	0.002010	0.002190	0.002090	0.002150	N/A
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	N/A

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.001700	0.001210	0.001060	0.001230	0.001180	0.001870	0.001900	0.001990	0.002500	0.006940	0.001690	0.002050
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.3	0.7	0.2	0.2

Licensee Comments: none

# Reactor Coolant System Leakage

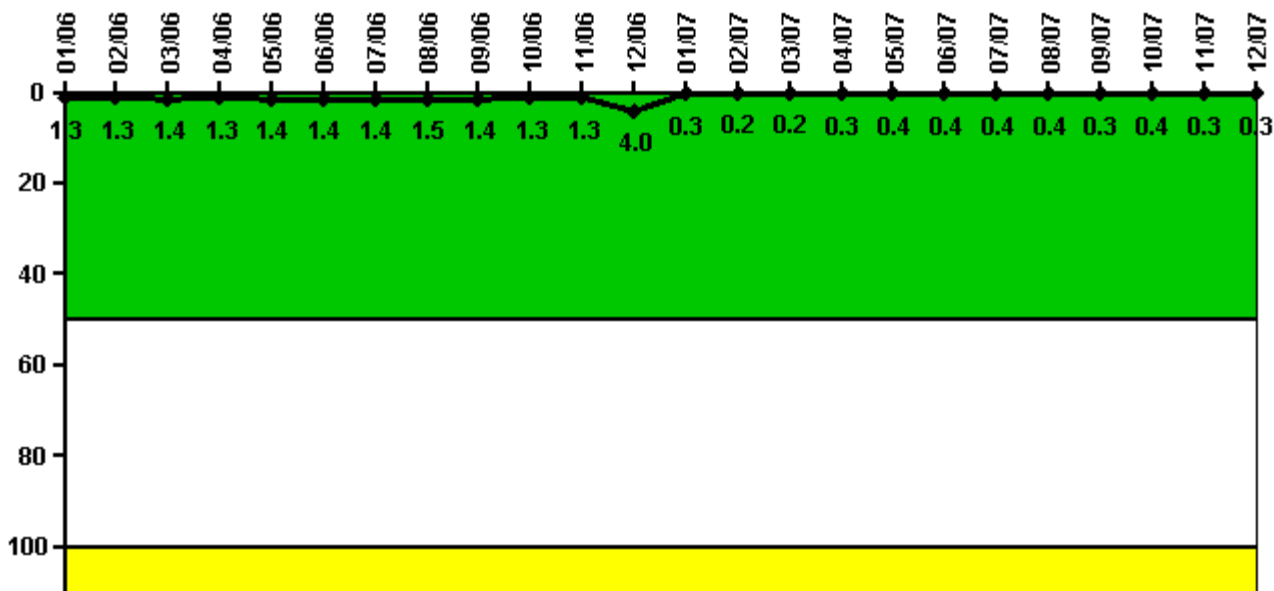

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Leakage	1/06	2/06	3/06	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06
Maximum leakage	0.132	0.132	0.136	0.133	0.140	0.141	0.136	0.150	0.140	0.130	0.130	0.396
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.3	1.3	1.4	1.3	1.4	1.4	1.4	1.5	1.4	1.3	1.3	4.0

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	0.030	0.020	0.020	0.030	0.040	0.040	0.038	0.040	0.030	0.040	0.030	0.030
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.2	0.2	0.3	0.4	0.4	0.4	0.4	0.3	0.4	0.3	0.3

Licensee Comments: none

## Drill/Exercise Performance

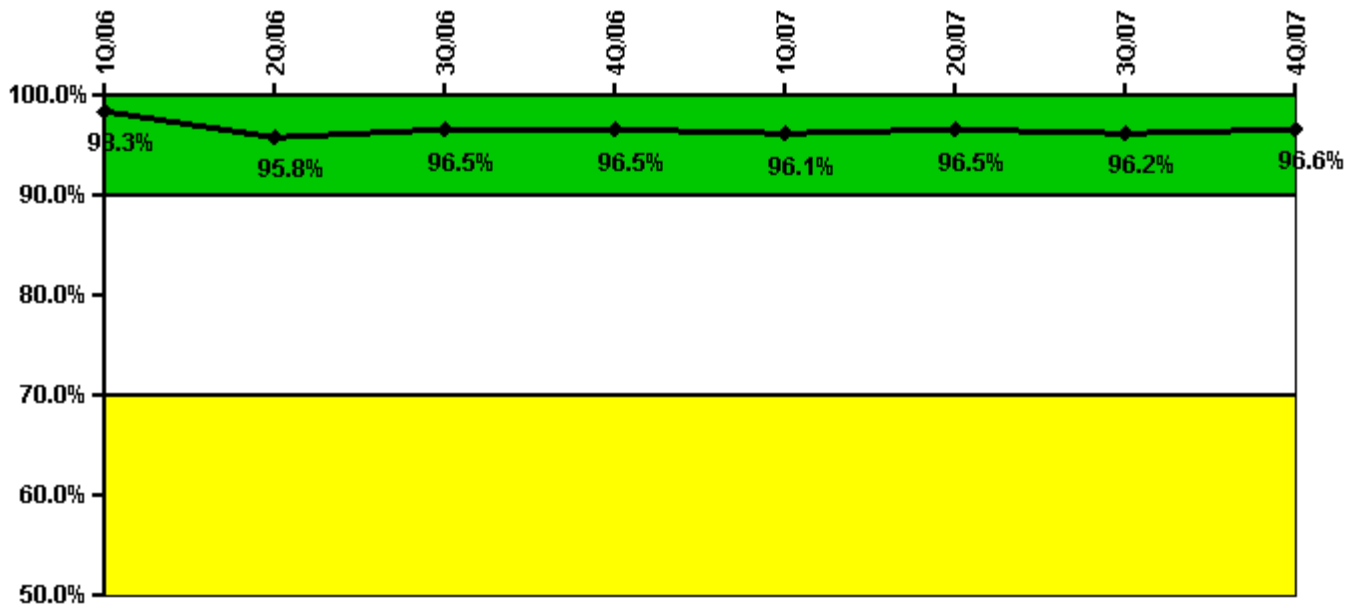


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful opportunities	6.0	44.0	67.0	12.0	25.0	28.0	26.0	20.0
Total opportunities	6.0	48.0	68.0	12.0	26.0	28.0	28.0	20.0
<b>Indicator value</b>	<b>98.3%</b>	<b>95.8%</b>	<b>96.5%</b>	<b>96.5%</b>	<b>96.1%</b>	<b>96.5%</b>	<b>96.2%</b>	<b>96.6%</b>

Licensee Comments: none

# ERO Drill Participation

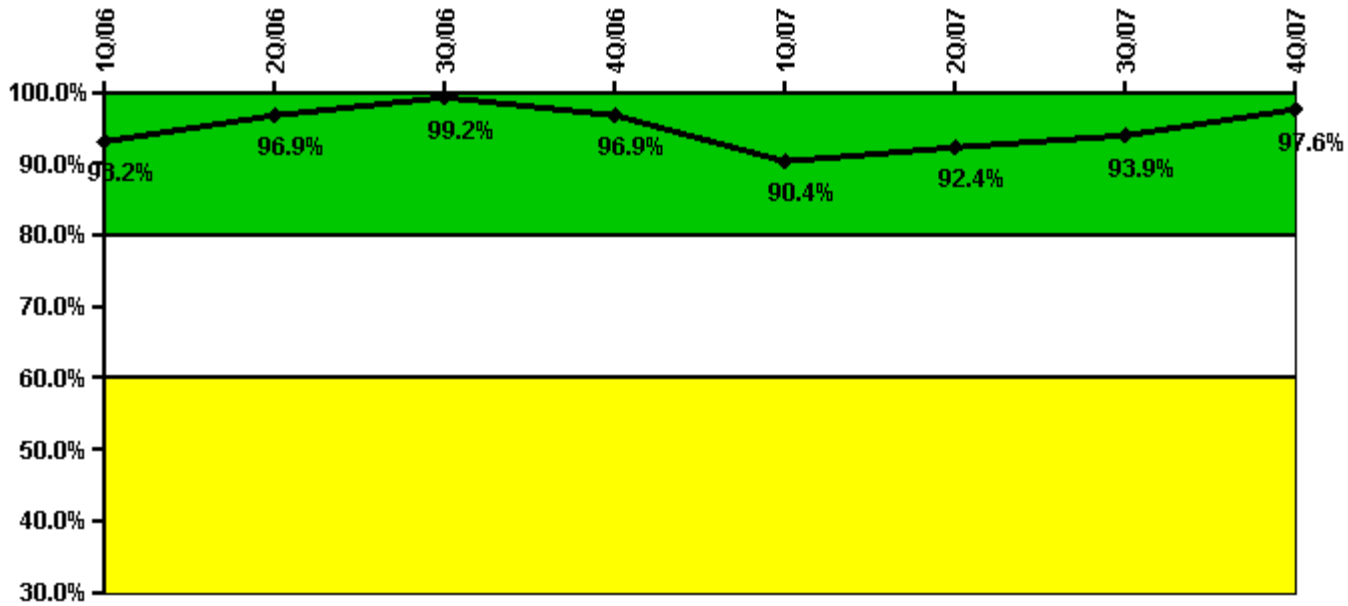


Thresholds: White < 80.0% Yellow < 60.0%

## Notes

ERO Drill Participation	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Participating Key personnel	123.0	125.0	125.0	125.0	123.0	122.0	123.0	120.0
Total Key personnel	132.0	129.0	126.0	129.0	136.0	132.0	131.0	123.0
<b>Indicator value</b>	<b>93.2%</b>	<b>96.9%</b>	<b>99.2%</b>	<b>96.9%</b>	<b>90.4%</b>	<b>92.4%</b>	<b>93.9%</b>	<b>97.6%</b>

Licensee Comments: none

# Alert & Notification System

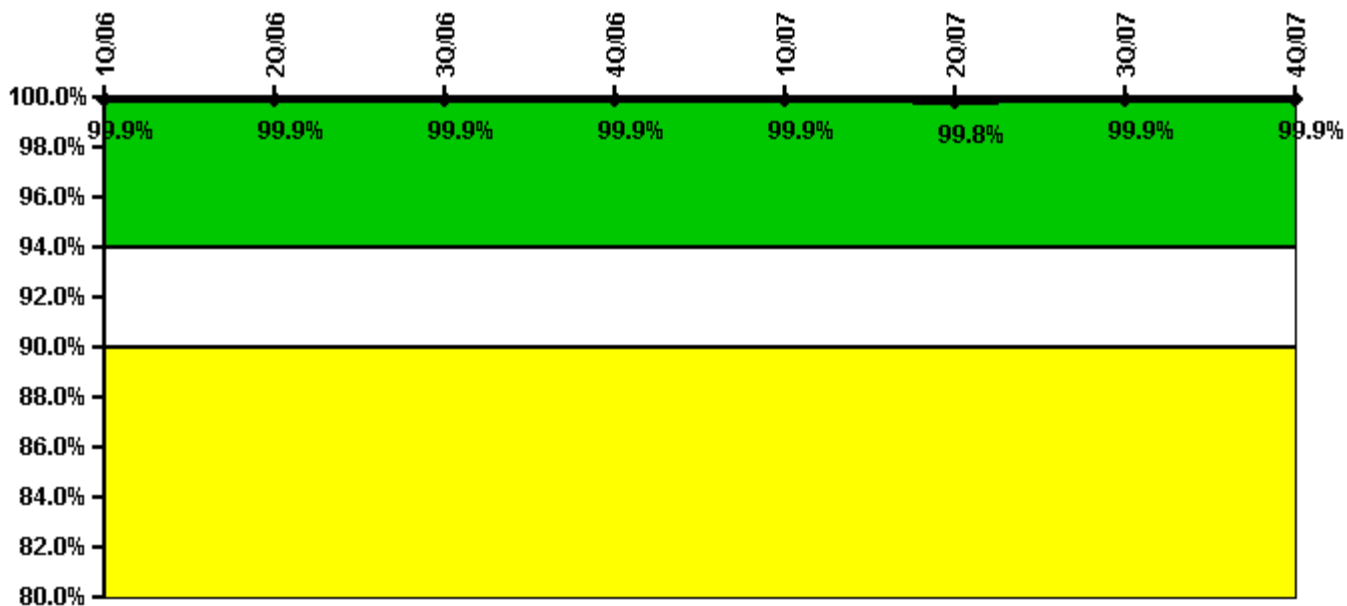


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
Successful siren-tests	432	432	431	431	432	431	432	432
Total sirens-tests	432	432	432	432	432	432	432	432
Indicator value	99.9%	99.9%	99.9%	99.9%	99.9%	99.8%	99.9%	99.9%

Licensee Comments: none

# Occupational Exposure Control Effectiveness

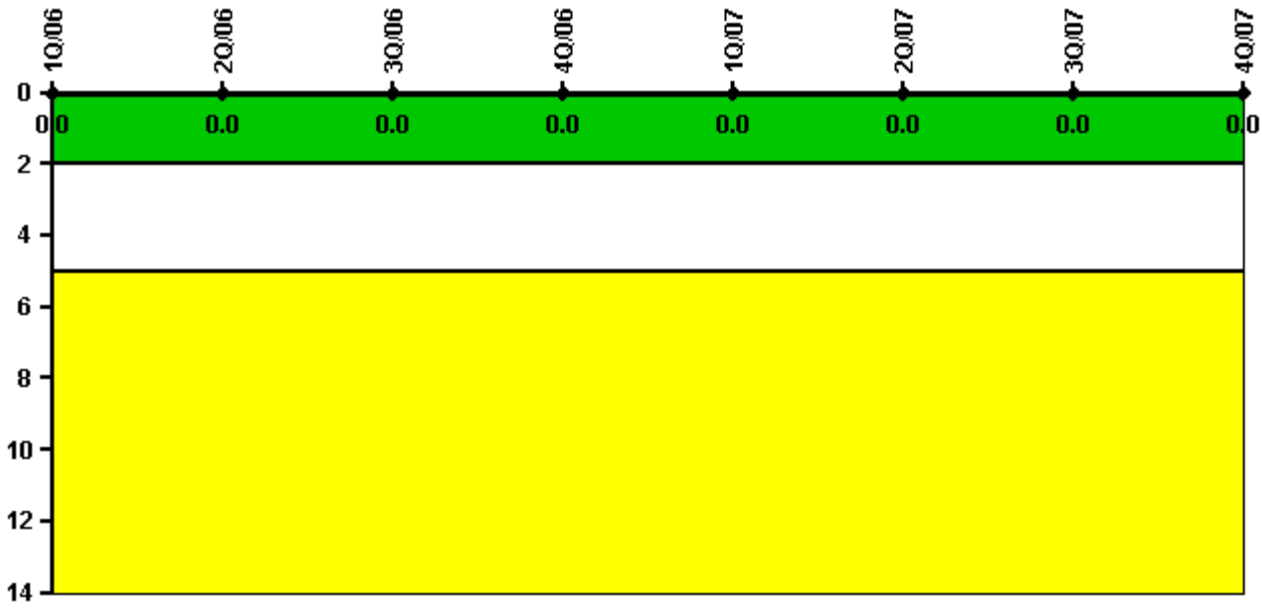


Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

# RETS/ODCM Radiological Effluent

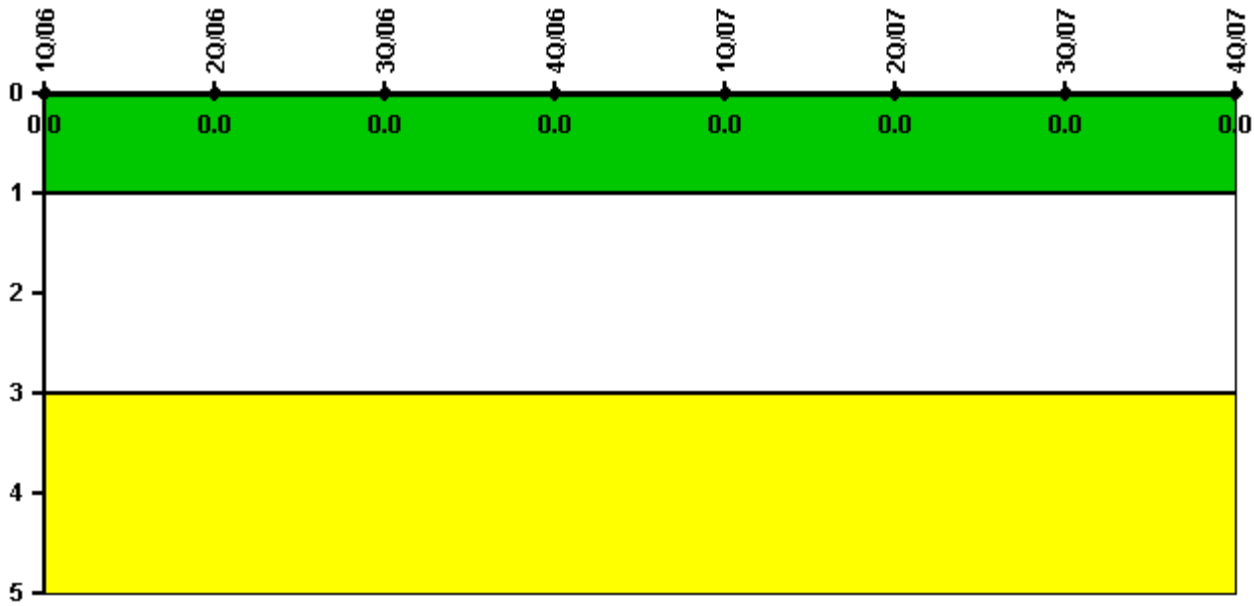

Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: February 4, 2008