


Vermont Yankee

1Q/2008 Performance Indicators

Licensee's General Comments: Based on reassessment of the NEI 99-02 guidance in response to an NRC inspector query to the licensee, a previously unreported February 2007 run time failure was entered for 1Q2007 and increased the URI value all subsequent reporting periods.

Unplanned Scrams per 7000 Critical Hrs

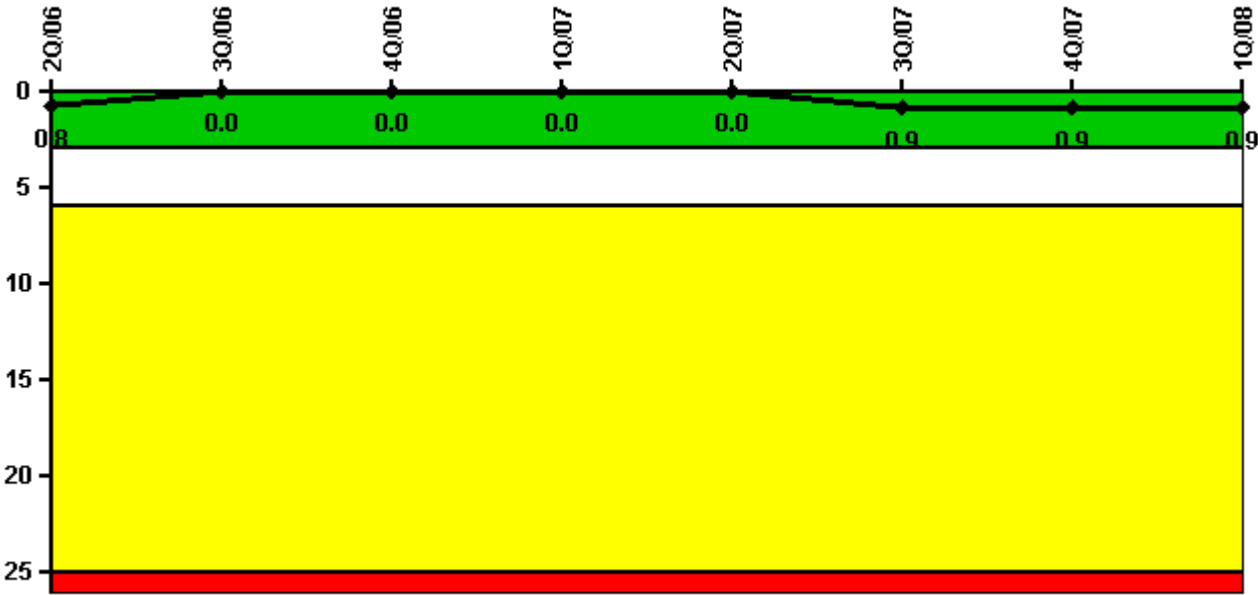


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Unplanned scrams	0	0	0	0	0	1.0	0	0
Critical hours	2183.0	2208.0	2209.0	2159.0	1621.0	2172.2	2209.0	2183.0
Indicator value	0.8	0	0	0	0	0.9	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

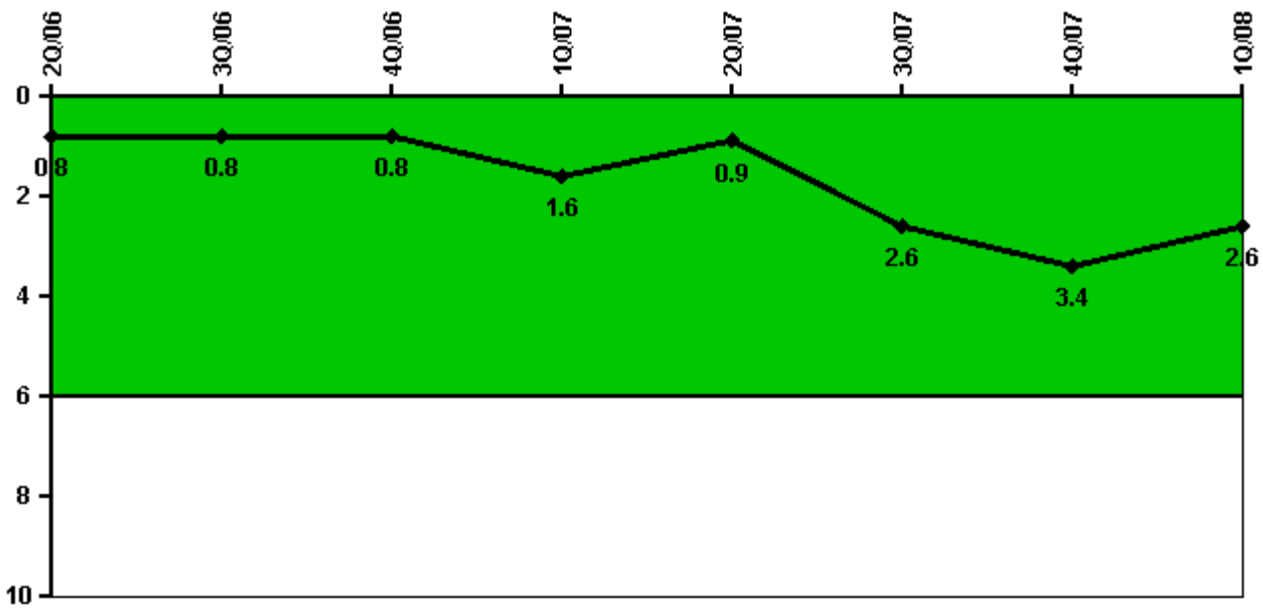

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Unplanned power changes	1.0	0	0	1.0	0	2.0	1.0	0
Critical hours	2183.0	2208.0	2209.0	2159.0	1621.0	2172.2	2209.0	2183.0
Indicator value	0.8	0.8	0.8	1.6	0.9	2.6	3.4	2.6

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Scrams with complications			0	0	0	0	0	0
Indicator value						0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

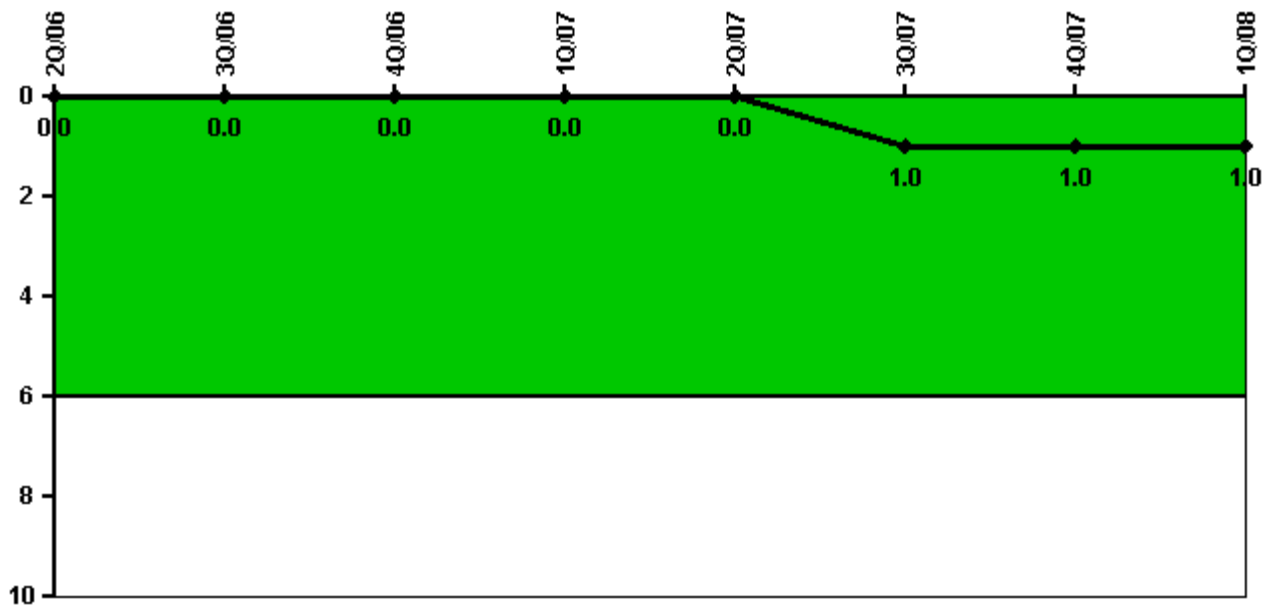


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Safety System Functional Failures	0	0	0	0	0	1	0	0
Indicator value	0	0	0	0	0	1	1	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

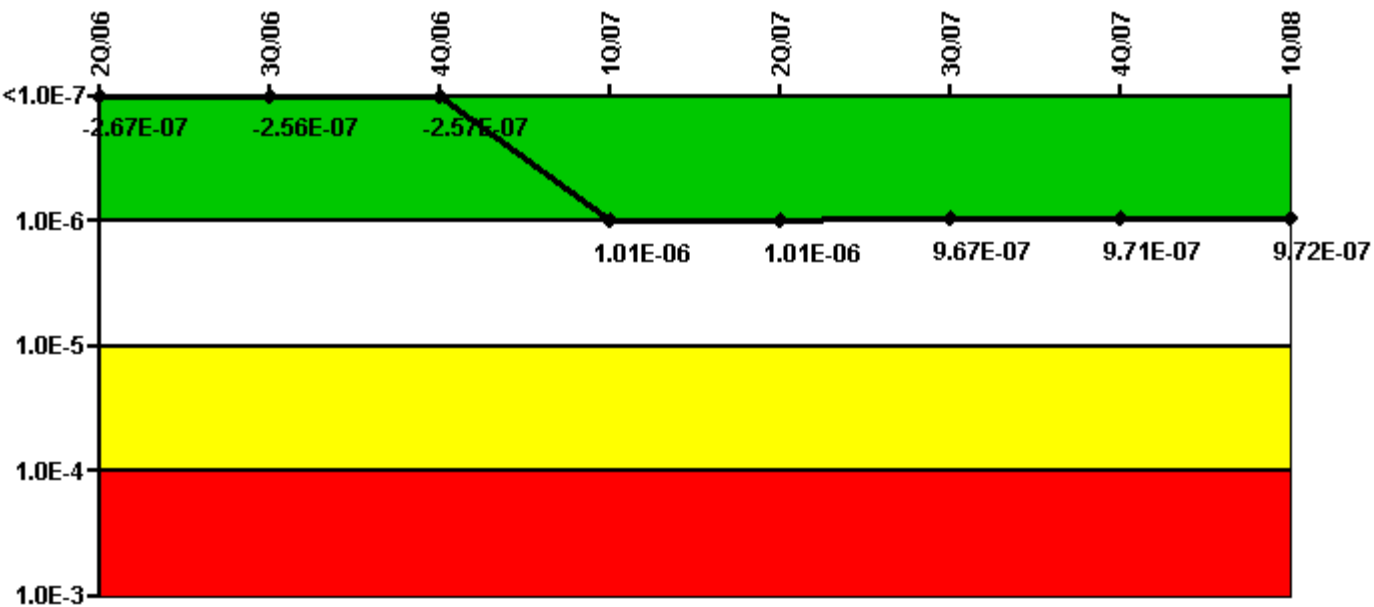

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (ΔCDF)	-1.70E-08	-1.60E-08	-1.70E-08	2.20E-08	1.40E-08	-3.30E-08	-2.90E-08	1.20E-08
URI (ΔCDF)	-2.50E-07	-2.40E-07	-2.40E-07	9.90E-07	1.00E-06	1.00E-06	1.00E-06	9.60E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.67E-07	-2.56E-07	-2.57E-07	1.01E-06	1.01E-06	9.67E-07	9.71E-07	9.72E-07

Licensee Comments:

1Q/07: Updated in April 2008 to record a previously unreported February 2007 run time failure.

Mitigating Systems Performance Index, High Pressure Injection System

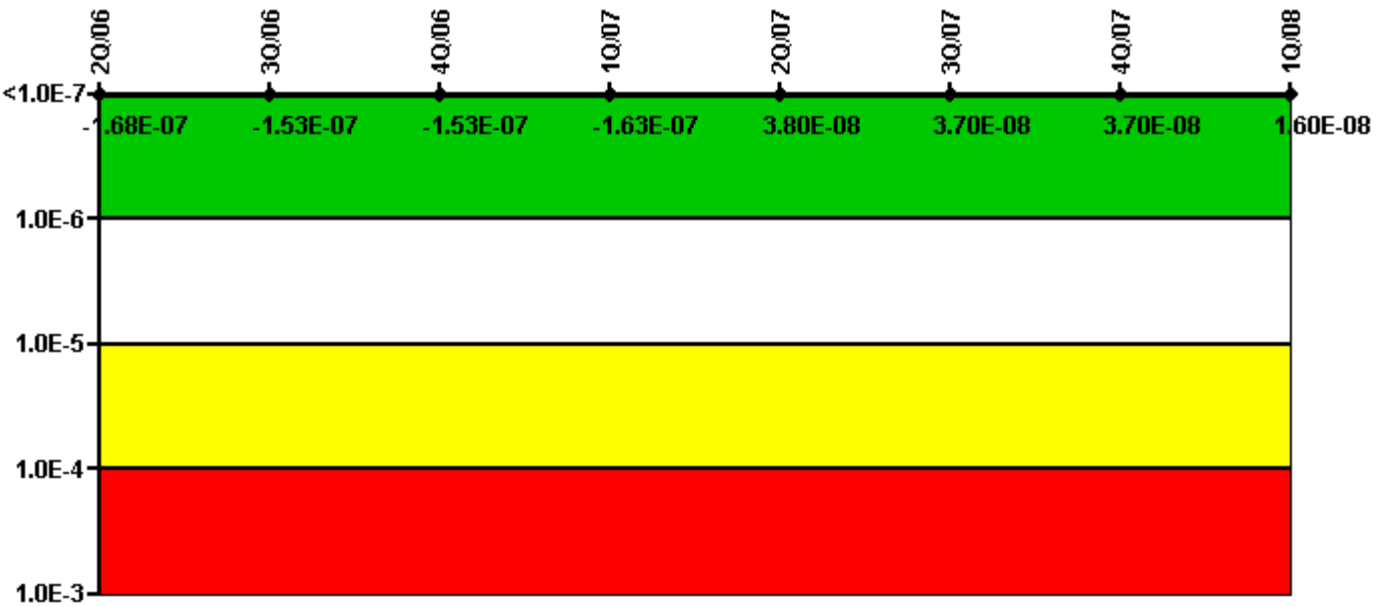


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	-7.00E-08	-5.30E-08	-5.30E-08	-5.30E-08	7.00E-08	6.90E-08	6.90E-08	9.00E-08
URI (Δ CDF)	-9.80E-08	-1.00E-07	-1.00E-07	-1.10E-07	-3.20E-08	-3.20E-08	-3.20E-08	-7.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.68E-07	-1.53E-07	-1.53E-07	-1.63E-07	3.80E-08	3.70E-08	3.70E-08	1.60E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

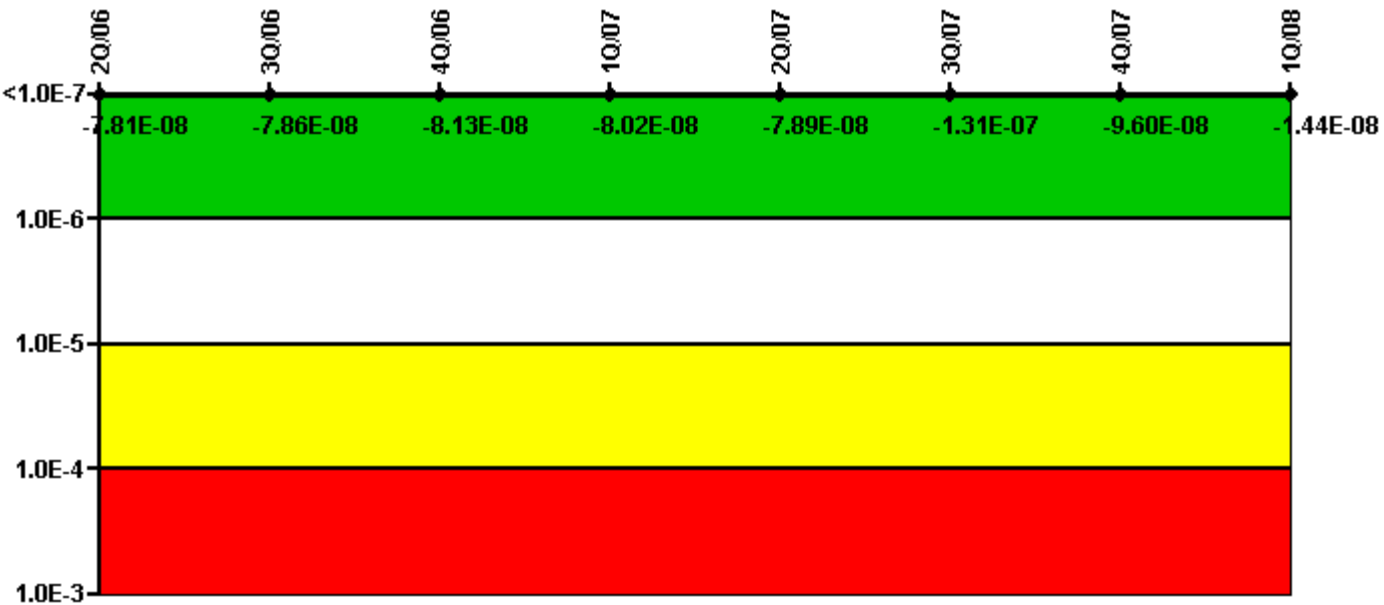


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	-1.00E-10	-3.60E-09	-6.30E-09	-6.20E-09	2.10E-09	-5.00E-08	-1.30E-08	-1.40E-09
URI (Δ CDF)	-7.80E-08	-7.50E-08	-7.50E-08	-7.40E-08	-8.10E-08	-8.10E-08	-8.30E-08	-1.30E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.81E-08	-7.86E-08	-8.13E-08	-8.02E-08	-7.89E-08	-1.31E-07	-9.60E-08	-1.44E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

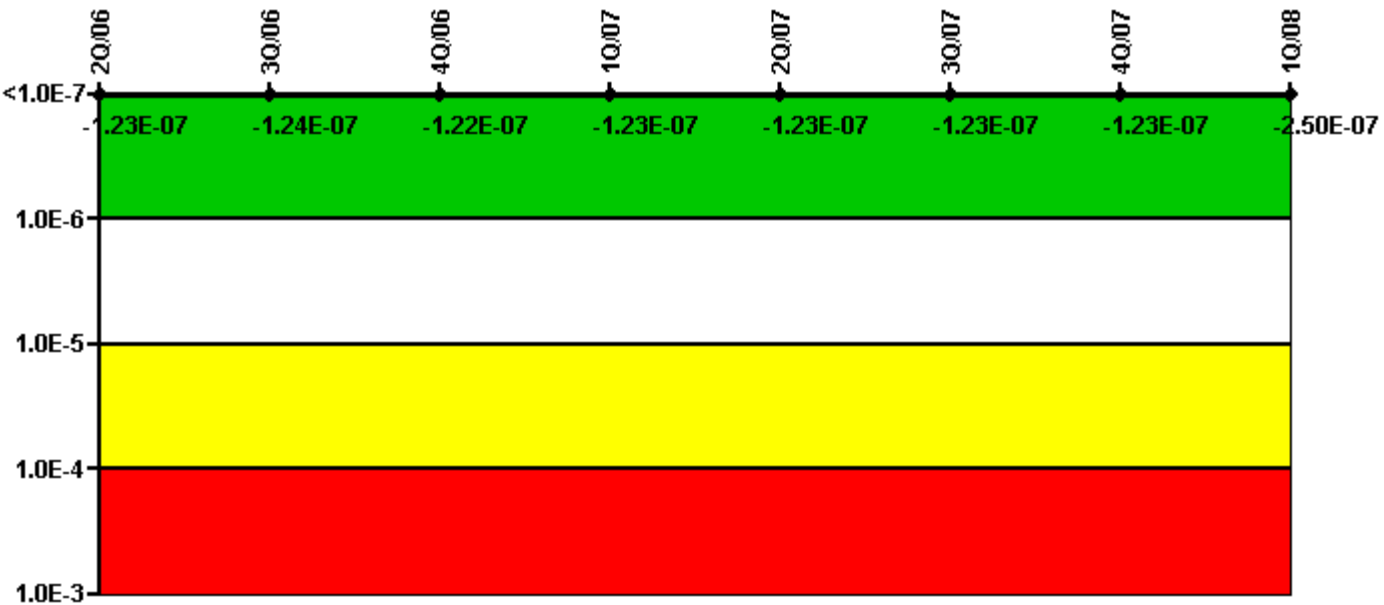


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	-2.60E-08	-2.60E-08	-2.30E-08	-2.30E-08	-2.30E-08	-2.30E-08	-2.30E-08	-4.00E-08
URI (Δ CDF)	-9.70E-08	-9.80E-08	-9.90E-08	-1.00E-07	-1.00E-07	-1.00E-07	-1.00E-07	-2.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.23E-07	-1.24E-07	-1.22E-07	-1.23E-07	-1.23E-07	-1.23E-07	-1.23E-07	-2.50E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

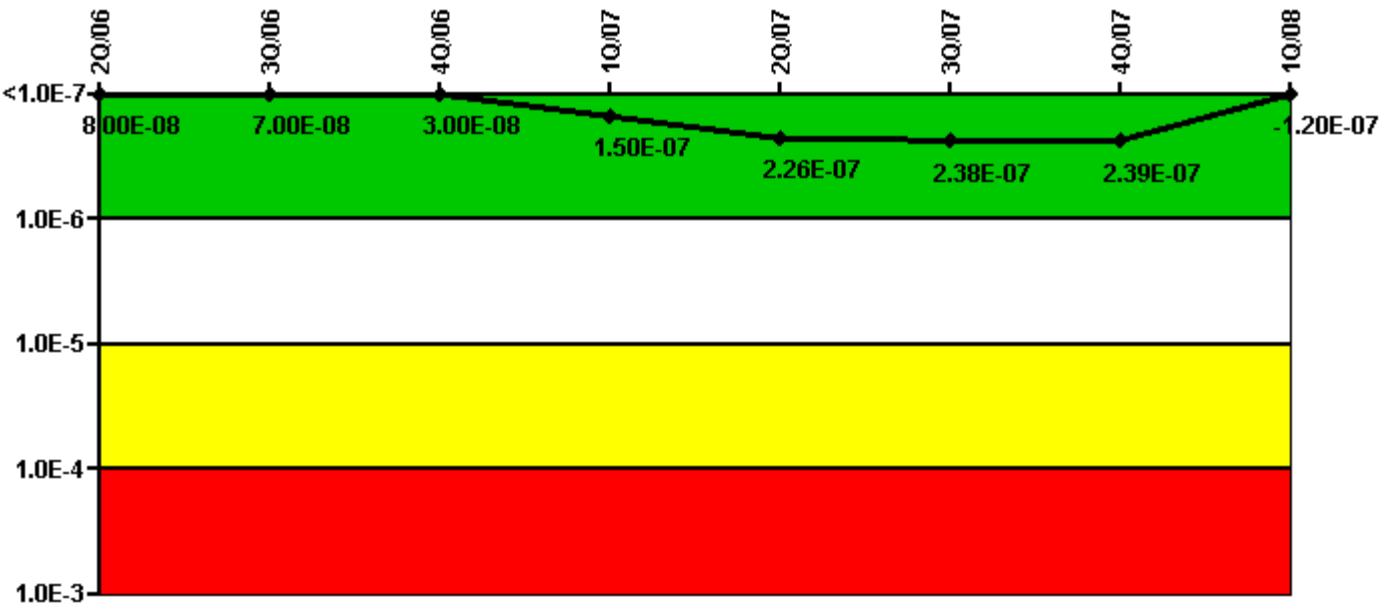


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (ΔCDF)	2.60E-07	2.60E-07	2.20E-07	3.00E-07	3.20E-07	3.30E-07	3.30E-07	1.80E-07
URI (ΔCDF)	-1.80E-07	-1.90E-07	-1.90E-07	-1.50E-07	-9.40E-08	-9.20E-08	-9.10E-08	-3.00E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	8.00E-08	7.00E-08	3.00E-08	1.50E-07	2.26E-07	2.38E-07	2.39E-07	-1.20E-07

Licensee Comments: none

Reactor Coolant System Activity

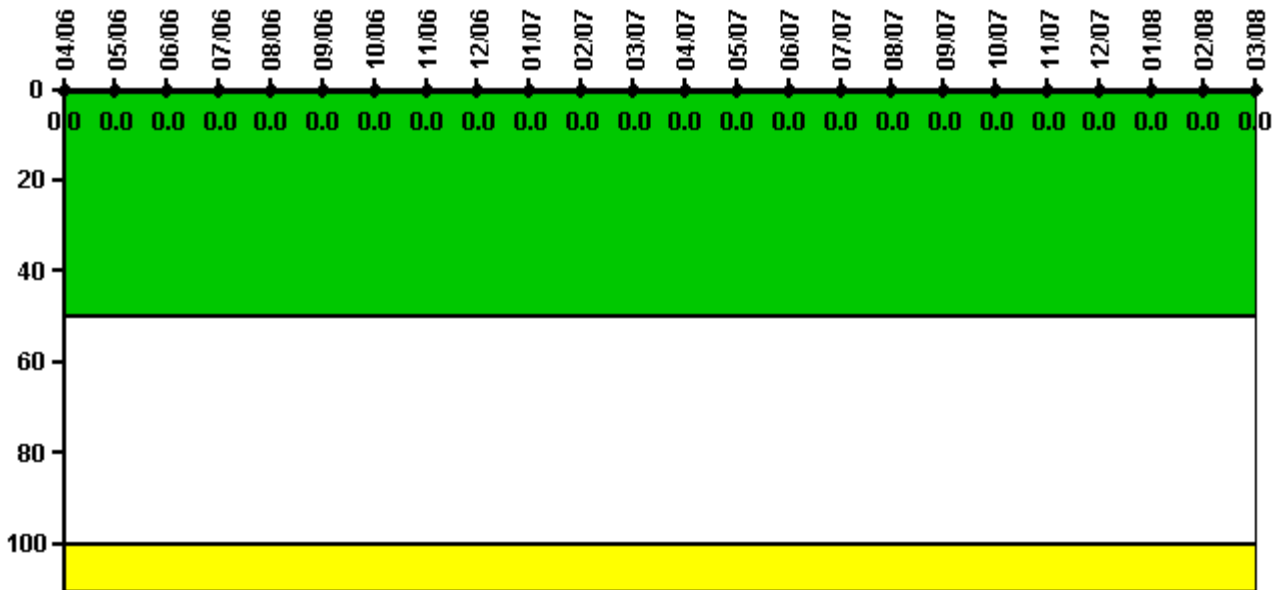


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	0.000020	0.000028	0.000020	0.000020	0.000016	0.000022	0.000017	0.000026	0.000024	0.000024	0.000025	0.000024
Technical specification limit	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum activity	0.000023	0.000038	0.000022	0.000023	0.000034	0.000046	0.000046	0.000032	0.000037	0.000034	0.000023	0.000027
Technical specification limit	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

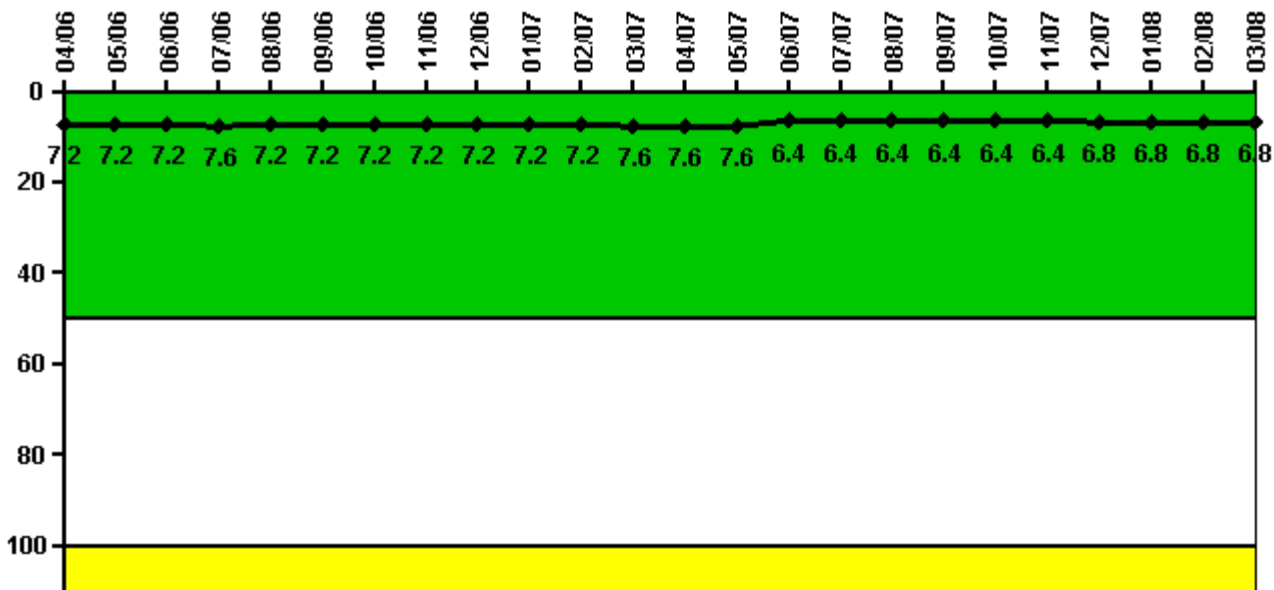

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	1.800	1.800	1.800	1.900	1.800	1.800	1.800	1.800	1.800	1.800	1.800	1.900
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.2	7.2	7.2	7.6	7.2	7.2	7.2	7.2	7.2	7.2	7.2	7.6

Reactor Coolant System Leakage	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum leakage	1.900	1.900	1.600	1.600	1.600	1.600	1.600	1.600	1.700	1.700	1.700	1.700
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.6	7.6	6.4	6.4	6.4	6.4	6.4	6.4	6.8	6.8	6.8	6.8

Licensee Comments: none

Drill/Exercise Performance

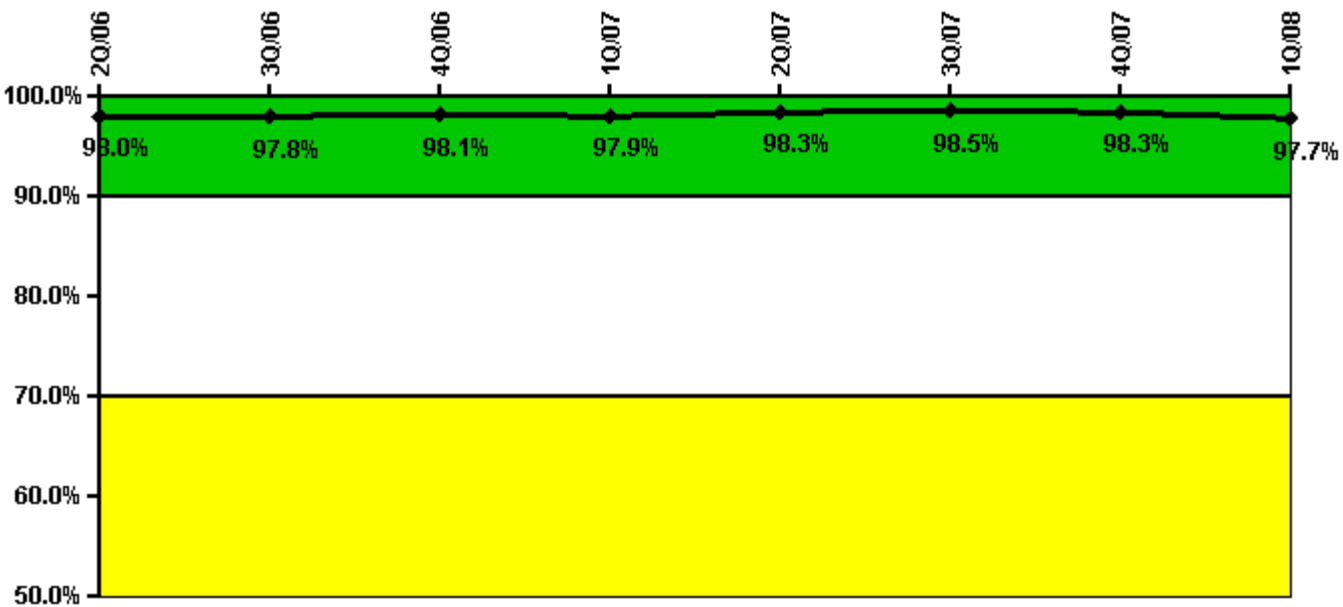


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Successful opportunities	49.0	52.0	36.0	13.0	23.0	58.0	27.0	40.0
Total opportunities	49.0	53.0	38.0	14.0	23.0	58.0	28.0	42.0
Indicator value	98.0%	97.8%	98.1%	97.9%	98.3%	98.5%	98.3%	97.7%

Licensee Comments: none

ERO Drill Participation

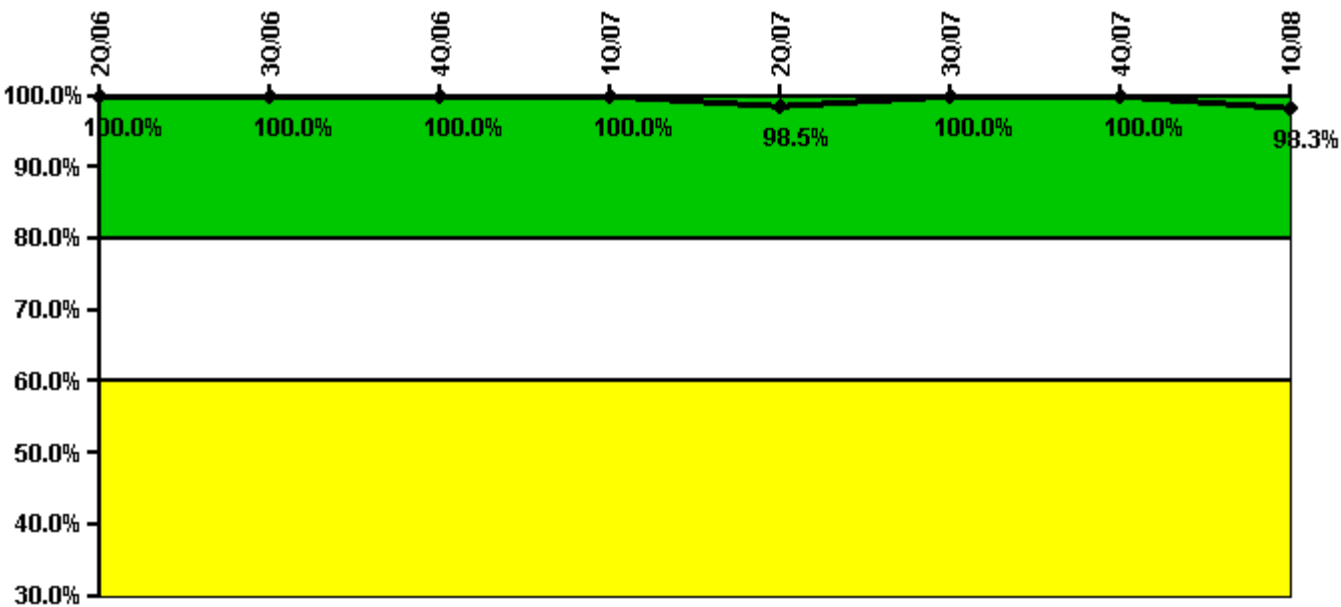


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Participating Key personnel	70.0	68.0	65.0	64.0	64.0	64.0	67.0	58.0
Total Key personnel	70.0	68.0	65.0	64.0	65.0	64.0	67.0	59.0
Indicator value	100.0%	100.0%	100.0%	100.0%	98.5%	100.0%	100.0%	98.3%

Licensee Comments: none

Alert & Notification System

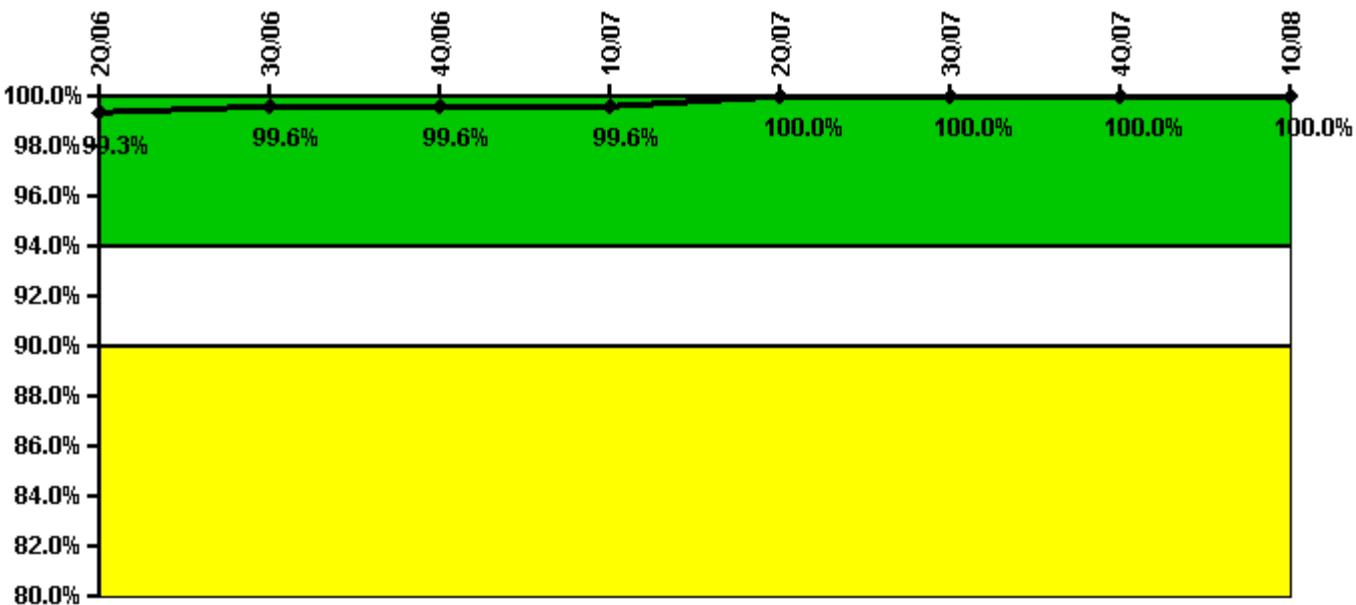


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Successful siren-tests	62	63	84	63	63	63	63	63
Total sirens-tests	63	63	84	63	63	63	63	63
Indicator value	99.3%	99.6%	99.6%	99.6%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

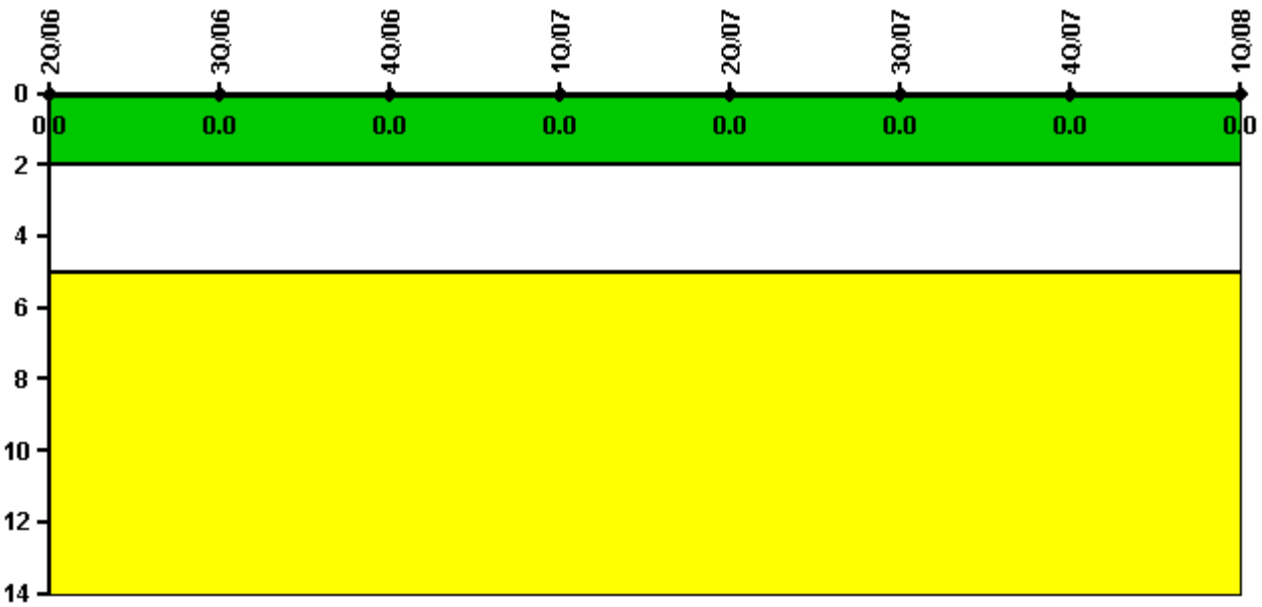

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 30, 2008