


# Salem 2

## 2Q/2008 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

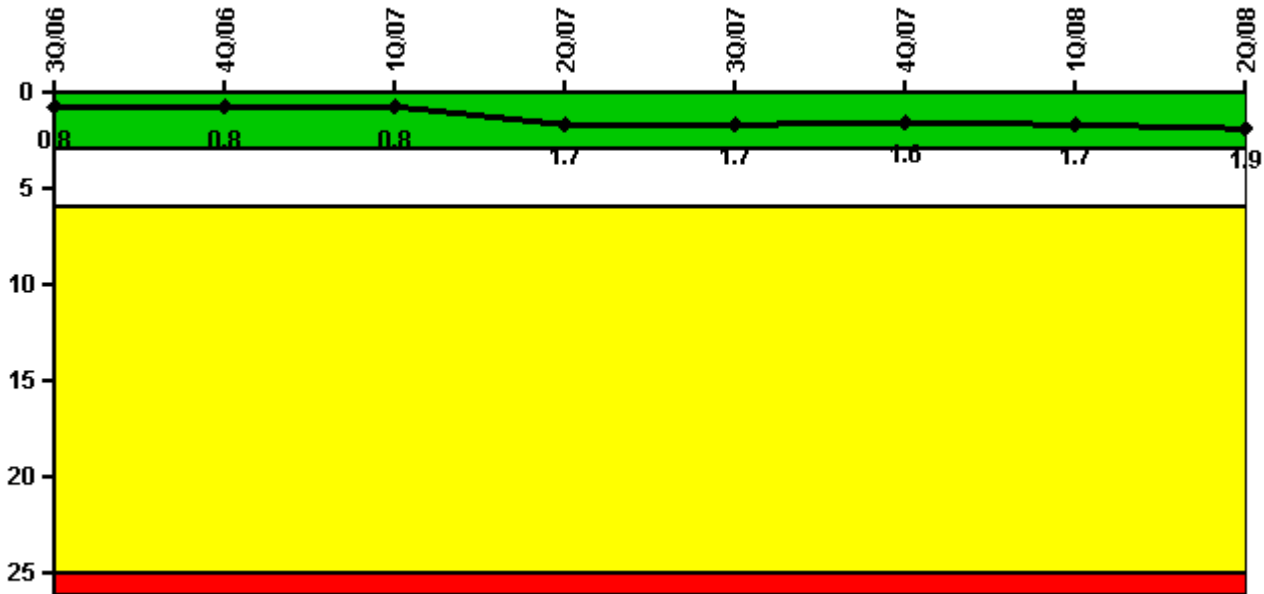


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Unplanned scrams	1.0	0	0	1.0	1.0	0	0	1.0
Critical hours	2192.5	1708.2	2159.0	2072.7	2193.6	2209.0	1699.0	1228.5
Indicator value	0.8	0.8	0.8	1.7	1.7	1.6	1.7	1.9

Licensee Comments: none

# Unplanned Power Changes per 7000 Critical Hrs

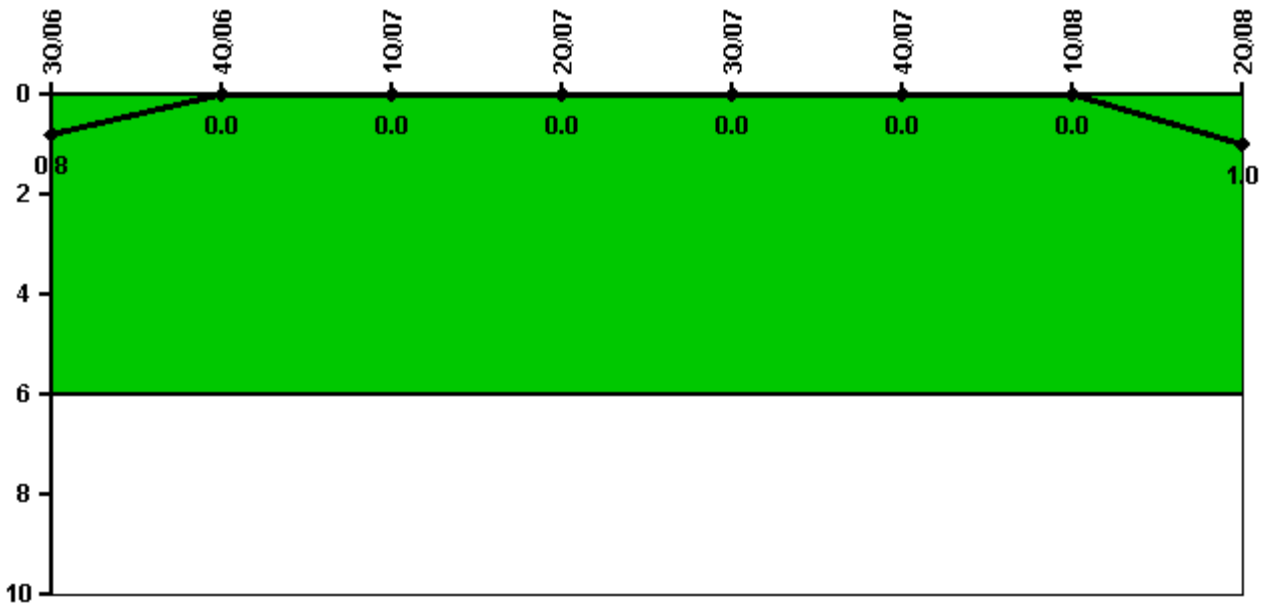


Thresholds: White > 6.0

## Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Unplanned power changes	0	0	0	0	0	0	0	1.0
Critical hours	2192.5	1708.2	2159.0	2072.7	2193.6	2209.0	1699.0	1228.5
Indicator value	0.8	0	0	0	0	0	0	1.0

Licensee Comments: none

# Unplanned Scrams with Complications

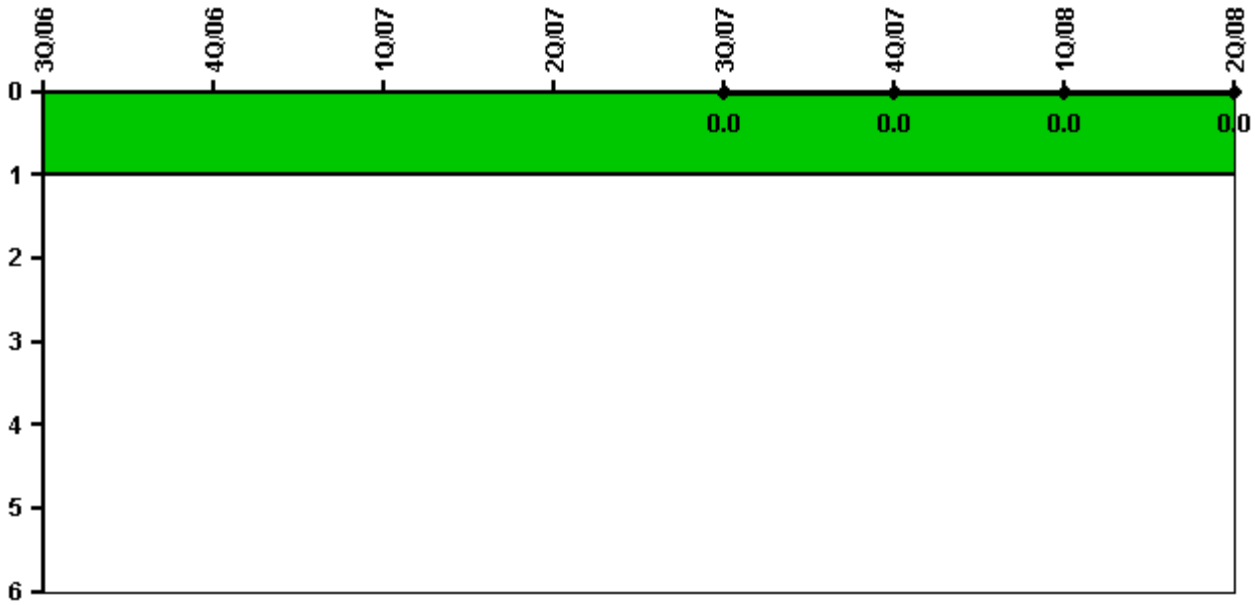


Thresholds: White > 1.0

## Notes

Unplanned Scrams with Complications	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Scrams with complications		0	0	0	0	0	0	0
Indicator value					0.0	0.0	0.0	0.0

Licensee Comments: none

# Safety System Functional Failures (PWR)

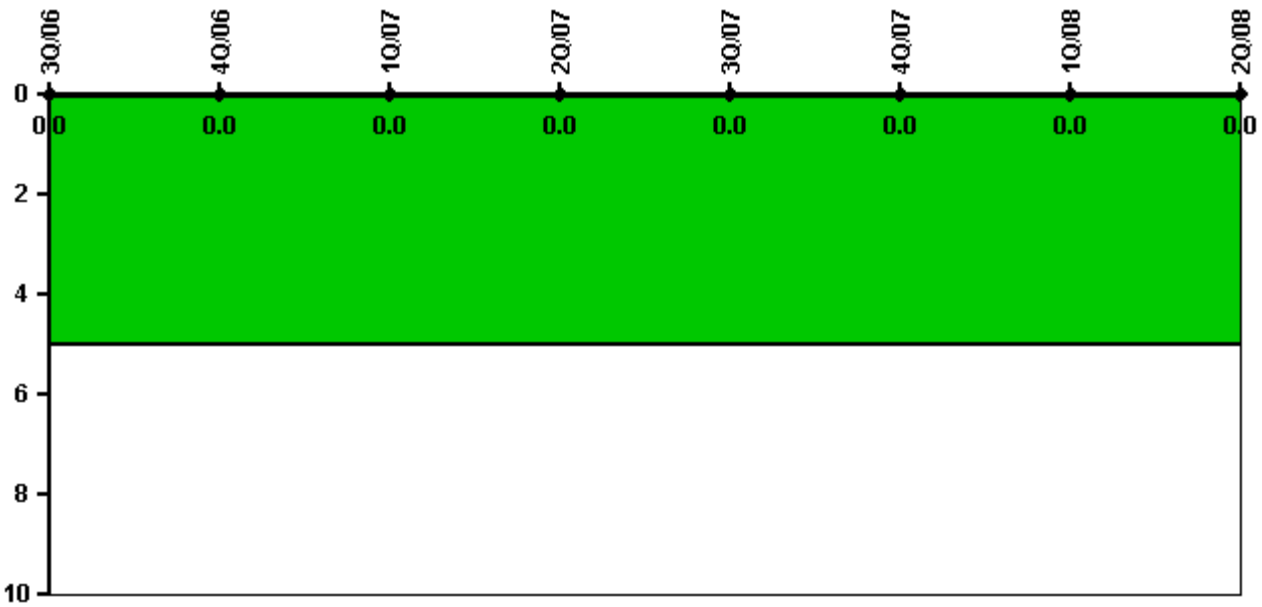


Thresholds: White > 5.0

## Notes

Safety System Functional Failures (PWR)	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

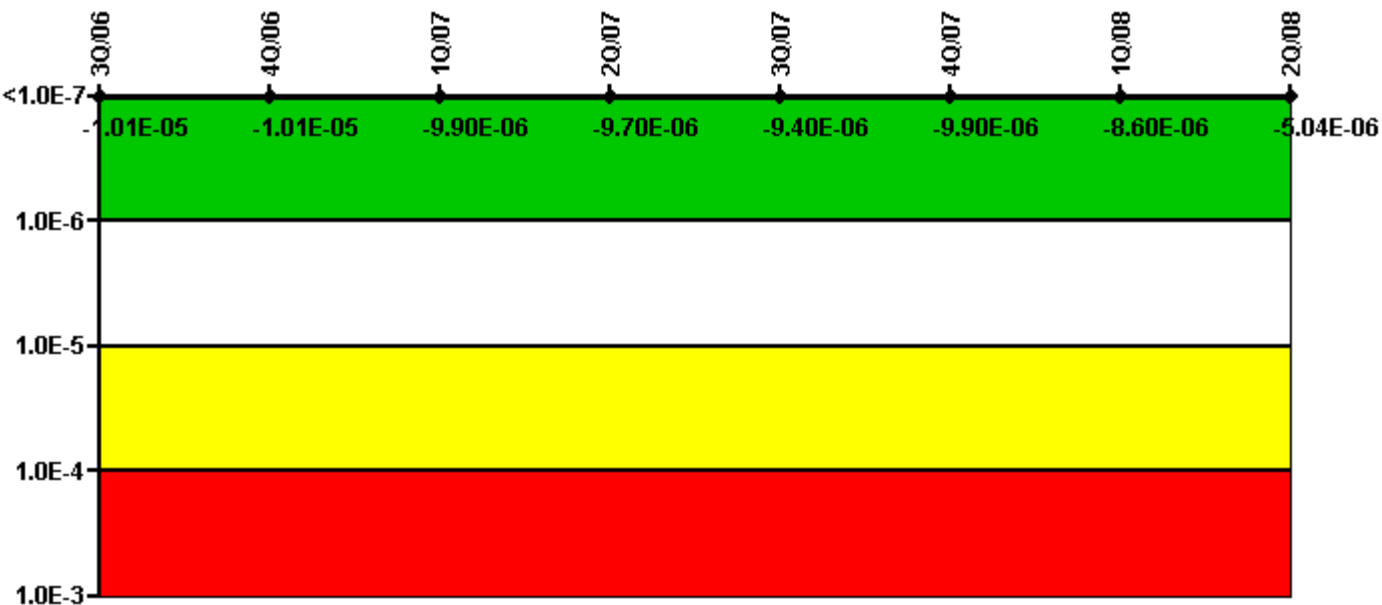

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI ( $\Delta$ CDF)	-1.00E-06	-1.00E-06	-1.00E-06	-1.00E-06	-1.00E-06	-1.00E-06	-1.00E-06	-4.40E-07
URI ( $\Delta$ CDF)	-9.10E-06	-9.10E-06	-8.90E-06	-8.70E-06	-8.40E-06	-8.90E-06	-7.60E-06	-4.60E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.01E-05	-1.01E-05	-9.90E-06	-9.70E-06	-9.40E-06	-9.90E-06	-8.60E-06	-5.04E-06

Licensee Comments:

2Q/08: Changed PRA Parameter(s). Changed MSPI coefficients based on revisions to PRA and MSPI Basis Document, effective 2Q08.

# Mitigating Systems Performance Index, High Pressure Injection System

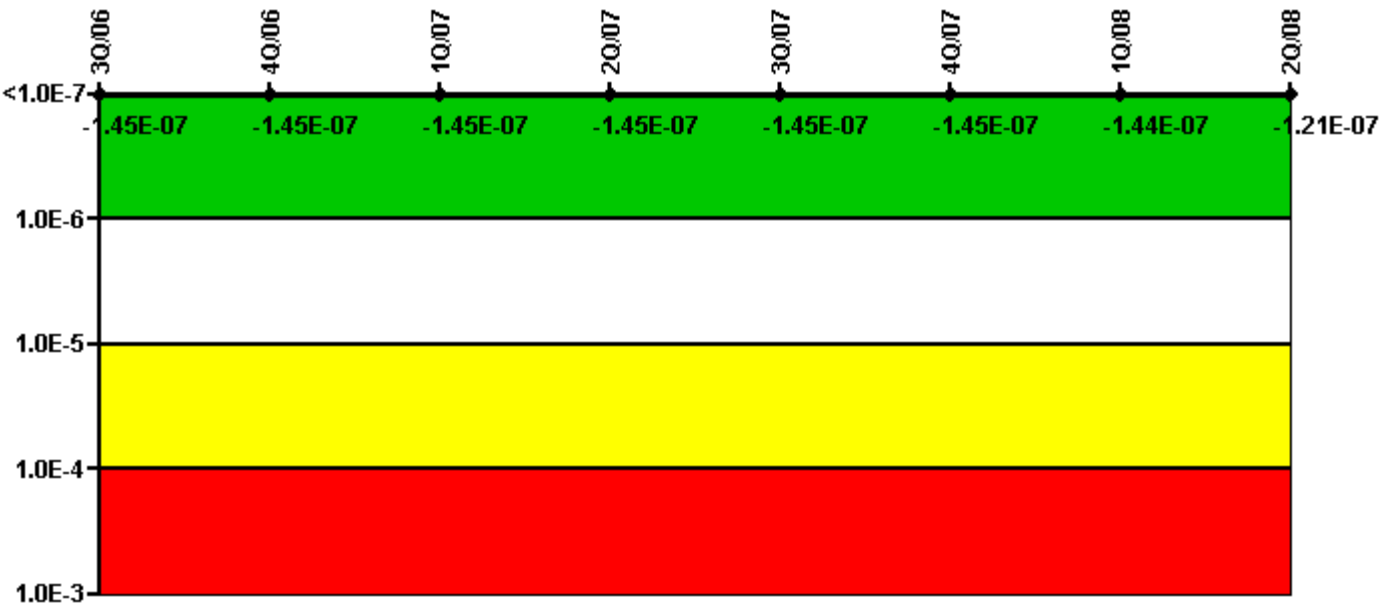

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI ( $\Delta$ CDF)	-9.80E-08	-9.80E-08	-9.80E-08	-9.80E-08	-9.80E-08	-9.80E-08	-9.80E-08	-7.10E-10
URI ( $\Delta$ CDF)	-4.70E-08	-4.70E-08	-4.70E-08	-4.70E-08	-4.70E-08	-4.70E-08	-4.60E-08	-1.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.45E-07	-1.45E-07	-1.45E-07	-1.45E-07	-1.45E-07	-1.45E-07	-1.44E-07	-1.21E-07

Licensee Comments:

2Q/08: Changed PRA Parameter(s). Changed MSPI coefficients based on revisions to PRA and MSPI Basis Document, effective 2Q08.

# Mitigating Systems Performance Index, Heat Removal System

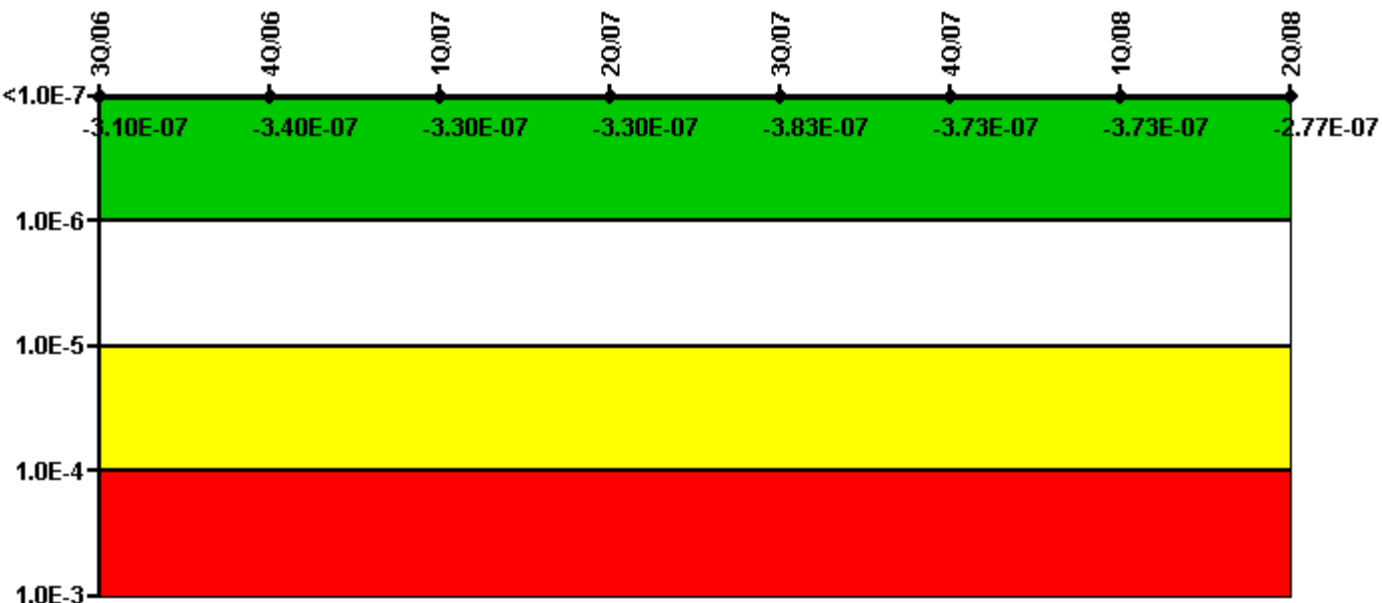

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI ( $\Delta$ CDF)	-8.00E-08	-8.00E-08	-8.00E-08	-8.00E-08	-8.30E-08	-8.30E-08	-8.30E-08	-4.70E-08
URI ( $\Delta$ CDF)	-2.30E-07	-2.60E-07	-2.50E-07	-2.50E-07	-3.00E-07	-2.90E-07	-2.90E-07	-2.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.10E-07	-3.40E-07	-3.30E-07	-3.30E-07	-3.83E-07	-3.73E-07	-3.73E-07	-2.77E-07

Licensee Comments:

2Q/08: Changed PRA Parameter(s). Changed MSPI coefficients based on revisions to PRA and MSPI Basis Document, effective 2Q08.

# Mitigating Systems Performance Index, Residual Heat Removal System

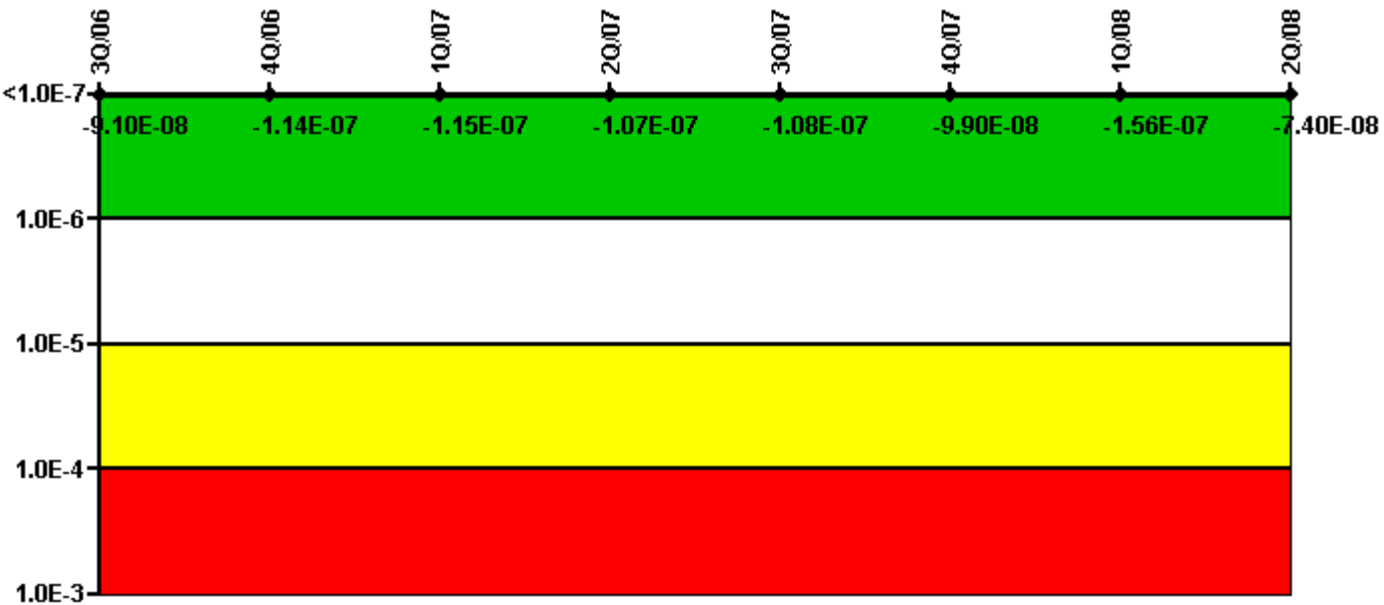

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes


Mitigating Systems Performance Index, Residual Heat Removal System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI ( $\Delta$ CDF)	1.90E-08	1.60E-08	1.50E-08	1.30E-08	1.20E-08	1.10E-08	-3.60E-08	-1.50E-08
URI ( $\Delta$ CDF)	-1.10E-07	-1.30E-07	-1.30E-07	-1.20E-07	-1.20E-07	-1.10E-07	-1.20E-07	-5.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.10E-08	-1.14E-07	-1.15E-07	-1.07E-07	-1.08E-07	-9.90E-08	-1.56E-07	-7.40E-08

Licensee Comments:

2Q/08: Changed PRA Parameter(s). Changed MSPI coefficients based on revisions to PRA and MSPI Basis Document, effective 2Q08.



# Mitigating Systems Performance Index, Cooling Water Systems

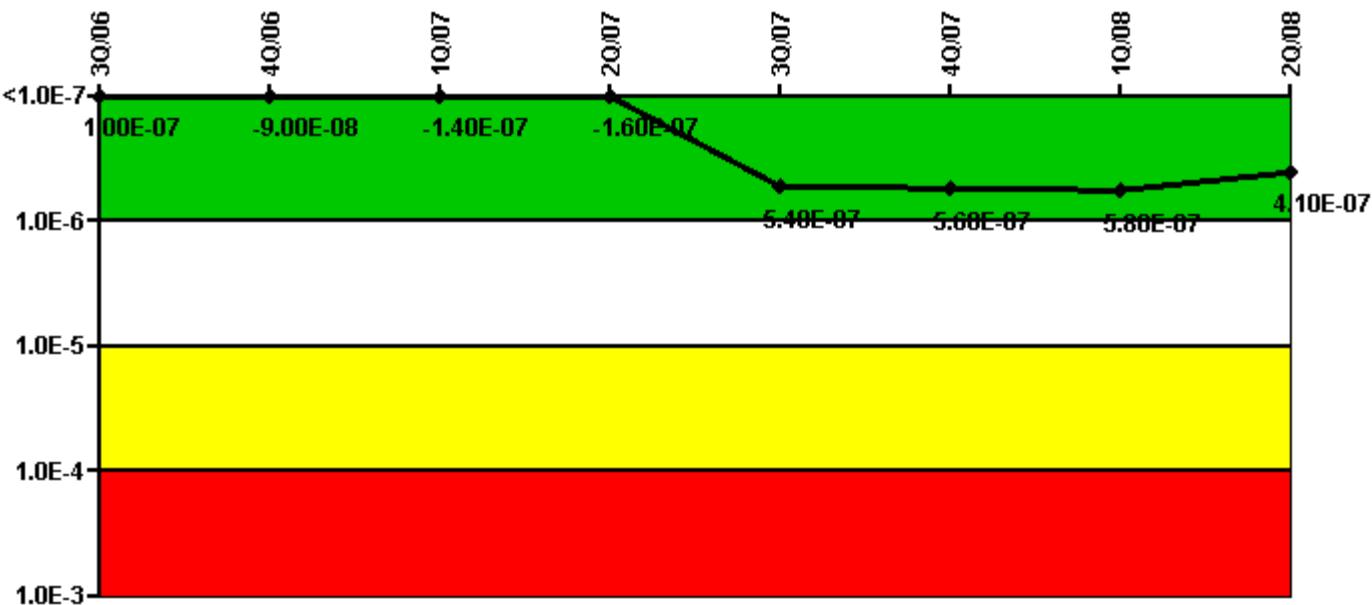

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI ( $\Delta$ CDF)	1.10E-06	9.10E-07	8.60E-07	8.40E-07	8.20E-07	8.40E-07	8.60E-07	-1.00E-07
URI ( $\Delta$ CDF)	-1.00E-06	-1.00E-06	-1.00E-06	-1.00E-06	-2.80E-07	-2.80E-07	-2.80E-07	5.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.00E-07	-9.00E-08	-1.40E-07	-1.60E-07	5.40E-07	5.60E-07	5.80E-07	4.10E-07

Licensee Comments:

2Q/08: Changed PRA Parameter(s). Changed MSPI coefficients based on revisions to PRA and MSPI Basis Document, effective 2Q08.

# Reactor Coolant System Activity

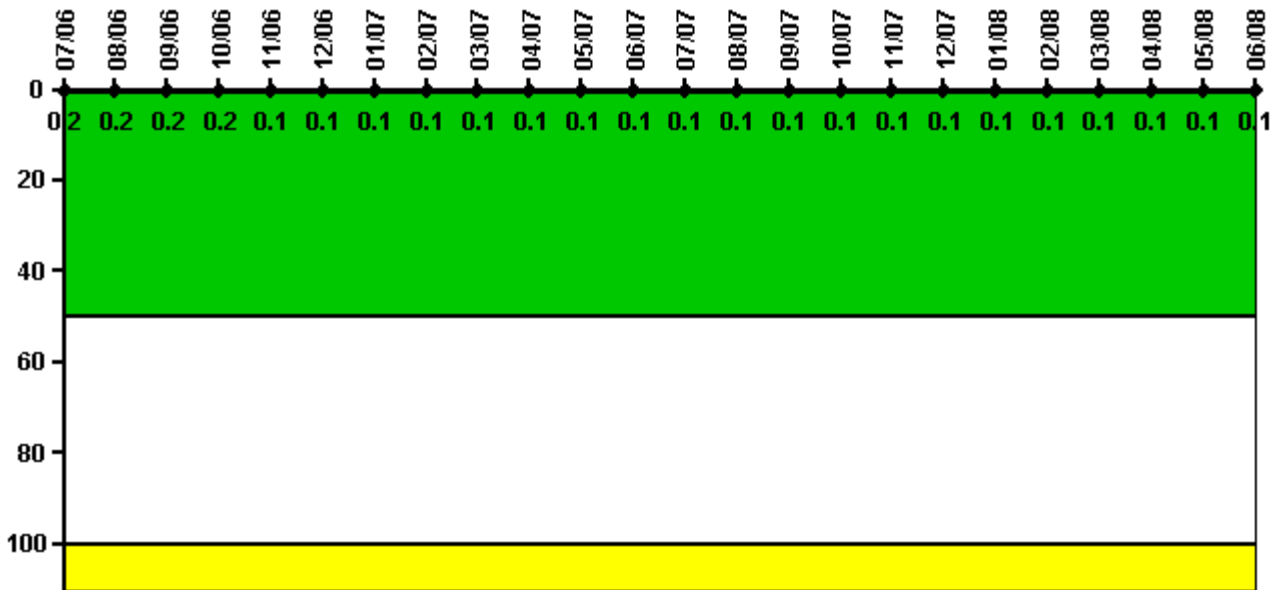


Thresholds: White > 50.0 Yellow > 100.0

## Notes

Reactor Coolant System Activity	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07
Maximum activity	0.002280	0.002270	0.002249	0.002006	0.001196	0.000720	0.000780	0.001123	0.000861	0.000862	0.001130	0.000906
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Reactor Coolant System Activity	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum activity	0.000963	0.001030	0.001060	0.001075	0.001144	0.001109	0.001260	0.001320	0.001110	0.001110	0.001110	0.000549
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

# Reactor Coolant System Leakage

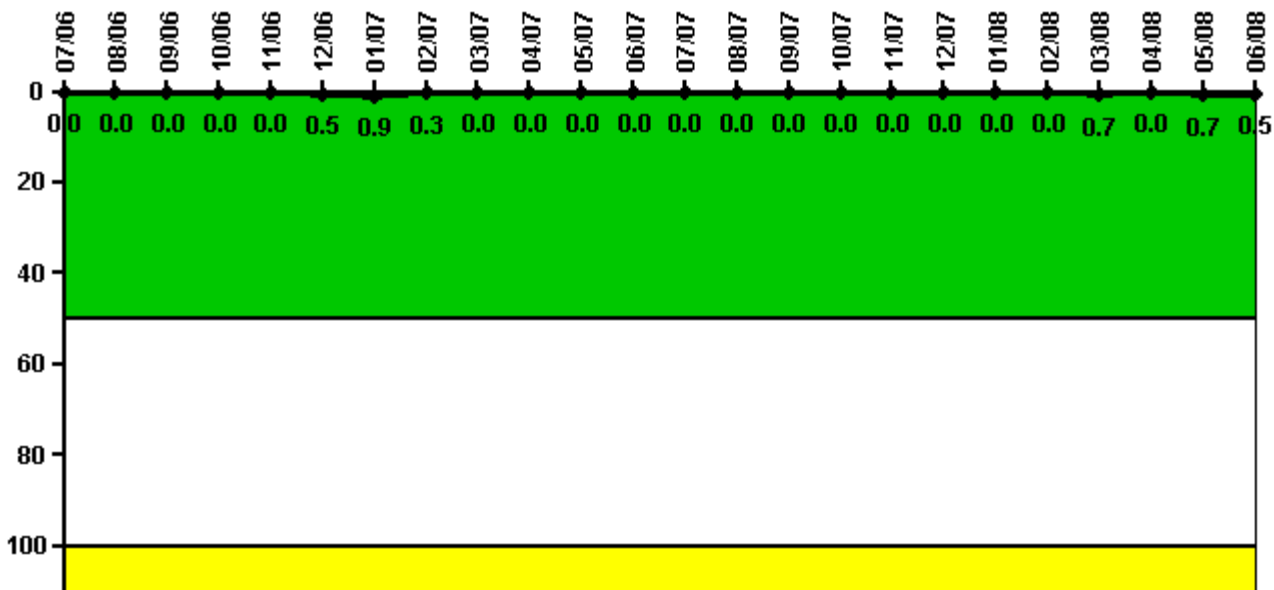

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Leakage	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07
Maximum leakage	0	0	0	0	0	0.045	0.090	0.030	0	0	0	0
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0	0	0	0	0	0.5	0.9	0.3	0	0	0	0

Reactor Coolant System Leakage	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum leakage	0	0	0	0	0	0	0	0	0.066	0	0.070	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0	0	0	0	0	0	0	0	0.7	0	0.7	0.5

Licensee Comments: none

# Drill/Exercise Performance

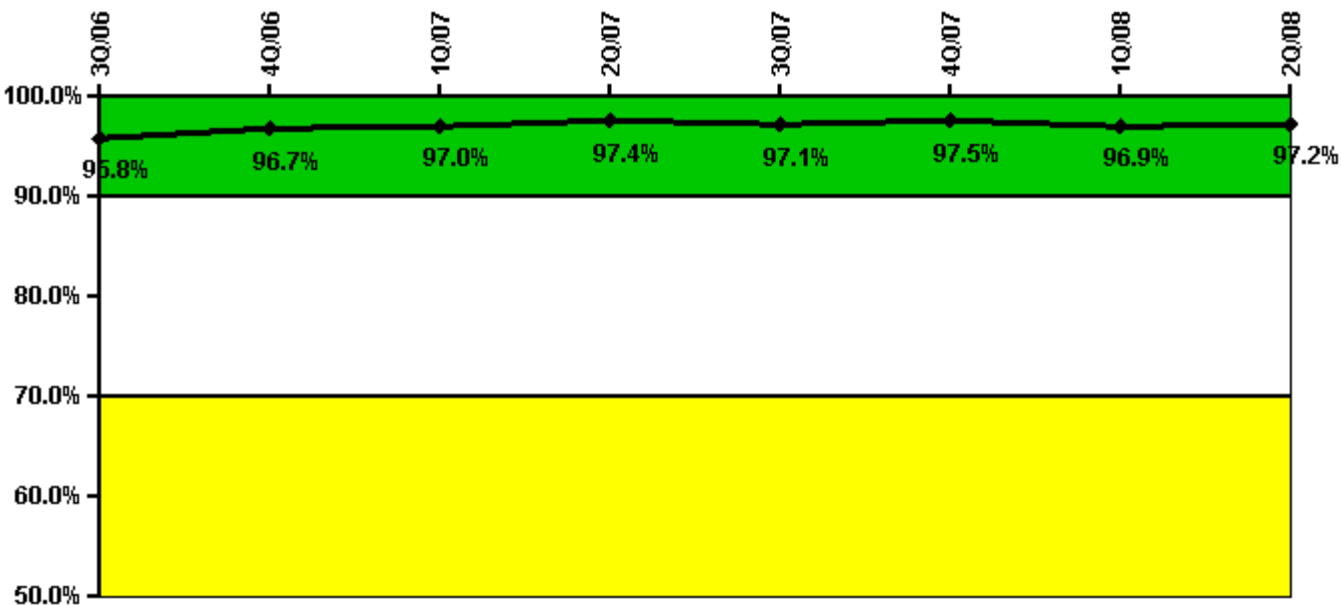


Thresholds: White < 90.0% Yellow < 70.0%

## Notes

Drill/Exercise Performance	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Successful opportunities	49.0	88.0	24.0	20.0	50.0	47.0	32.0	35.0
Total opportunities	50.0	91.0	24.0	20.0	52.0	48.0	34.0	36.0
Indicator value	95.8%	96.7%	97.0%	97.4%	97.1%	97.5%	96.9%	97.2%

Licensee Comments: none

# ERO Drill Participation

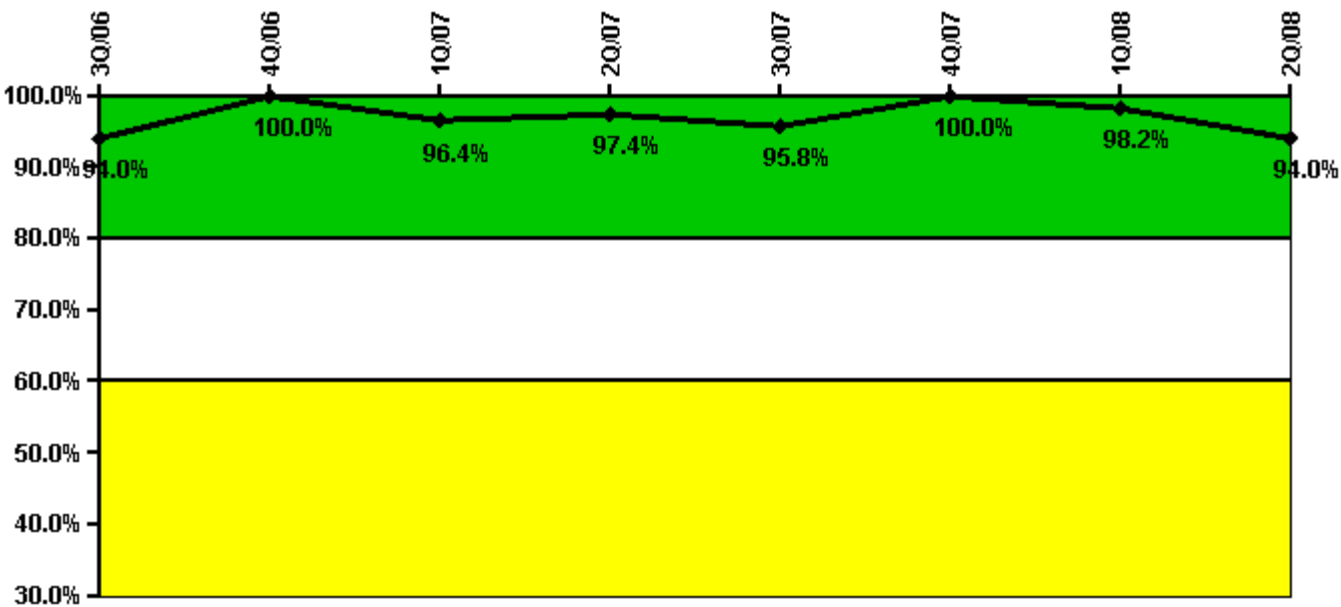


Thresholds: White < 80.0% Yellow < 60.0%

## Notes

ERO Drill Participation	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Participating Key personnel	110.0	112.0	106.0	113.0	113.0	115.0	109.0	109.0
Total Key personnel	117.0	112.0	110.0	116.0	118.0	115.0	111.0	116.0
Indicator value	94.0%	100.0%	96.4%	97.4%	95.8%	100.0%	98.2%	94.0%

Licensee Comments: none

# Alert & Notification System

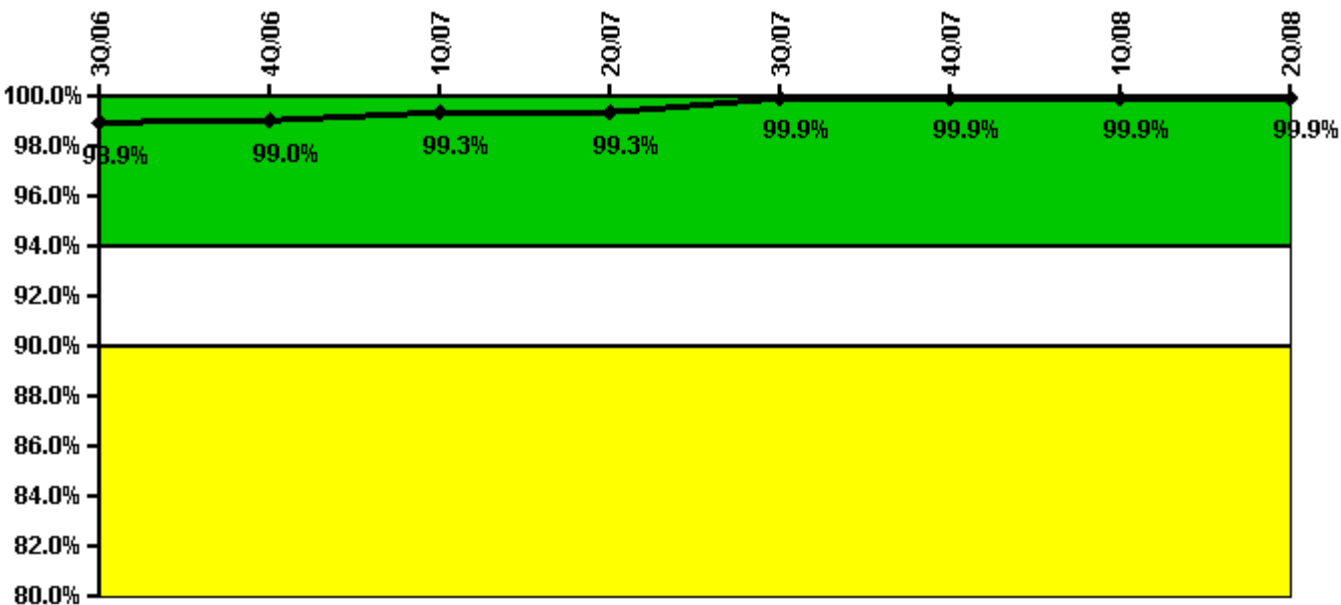


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Successful siren-tests	485	496	497	497	496	497	497	497
Total sirens-tests	497	497	497	497	497	497	497	497
Indicator value	98.9%	99.0%	99.3%	99.3%	99.9%	99.9%	99.9%	99.9%

Licensee Comments: none

# Occupational Exposure Control Effectiveness

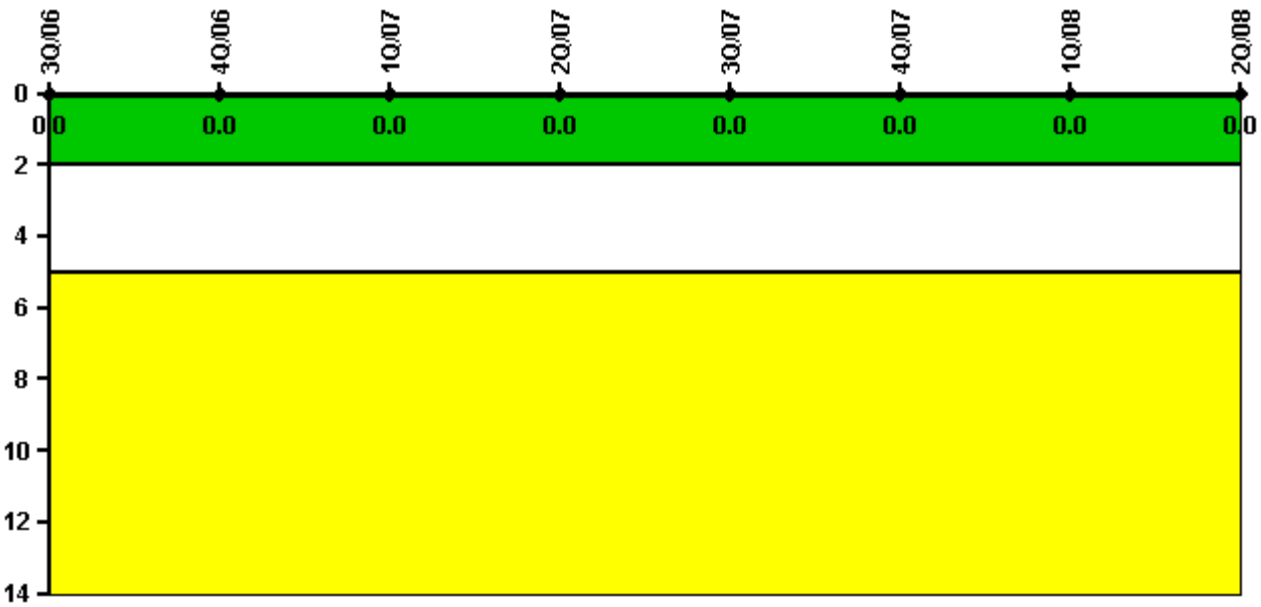


Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# RETS/ODCM Radiological Effluent

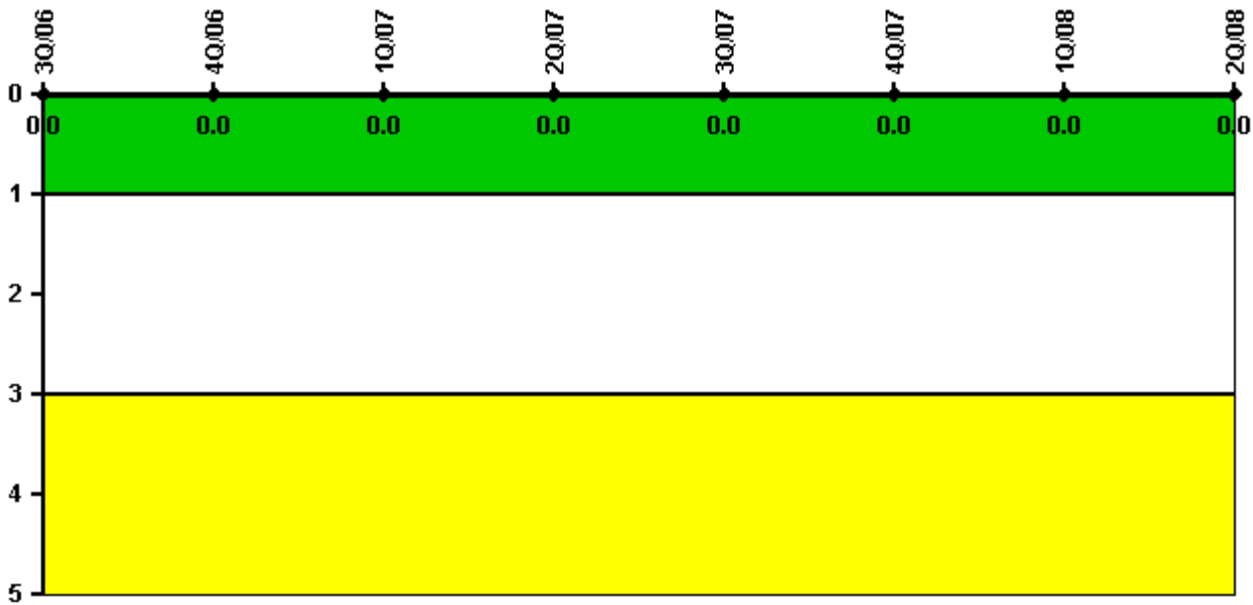

Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: August 4, 2008