


Callaway

3Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

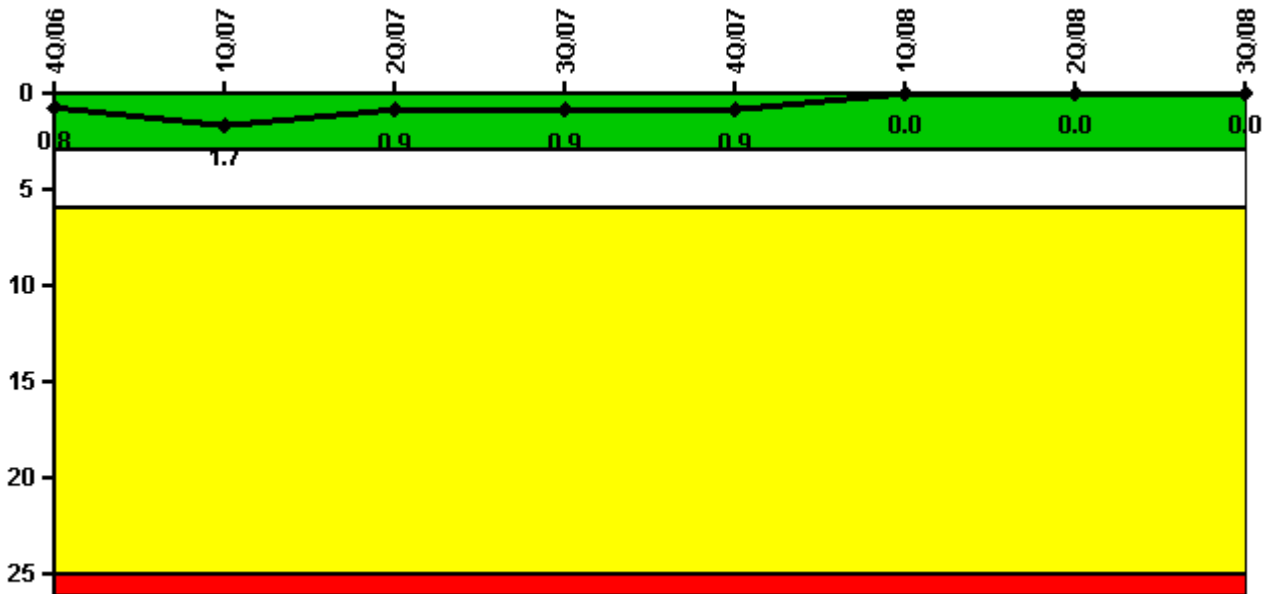


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned scrams	0	1.0	0	0	0	0	0	0
Critical hours	2209.0	2081.3	1314.3	2208.0	2209.0	2183.0	2184.0	2208.0
Indicator value	0.8	1.7	0.9	0.9	0.9	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

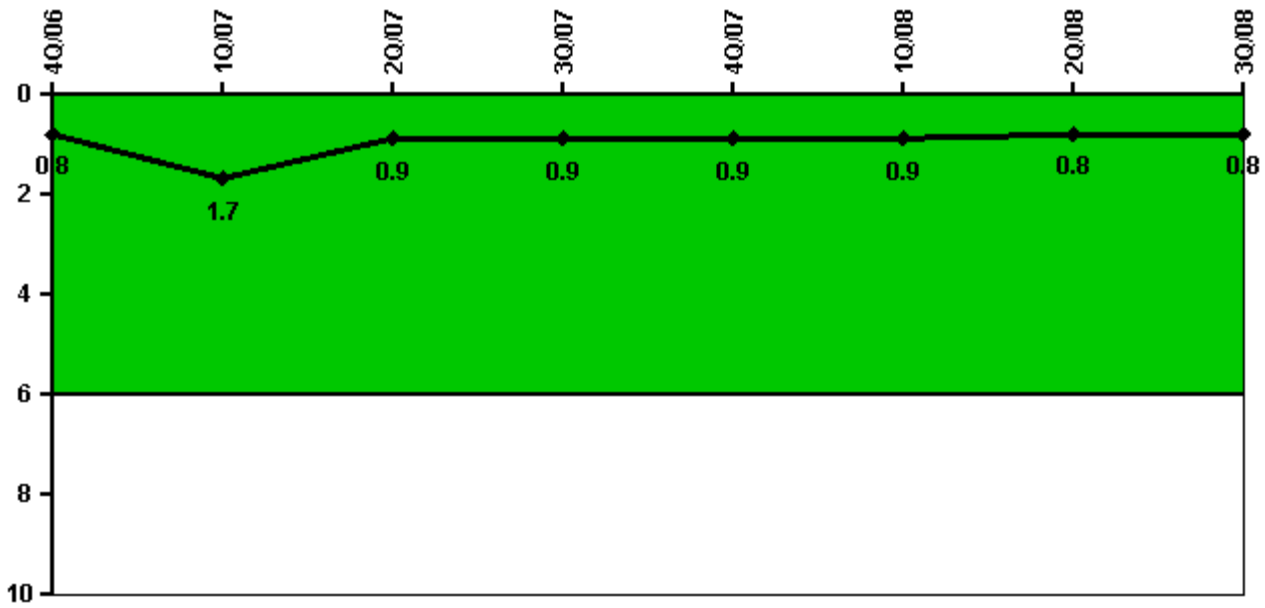


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned power changes	0	1.0	0	0	0	1.0	0	0
Critical hours	2209.0	2081.3	1314.3	2208.0	2209.0	2183.0	2184.0	2208.0
Indicator value	0.8	1.7	0.9	0.9	0.9	0.9	0.8	0.8

Licensee Comments: none

Unplanned Scrams with Complications

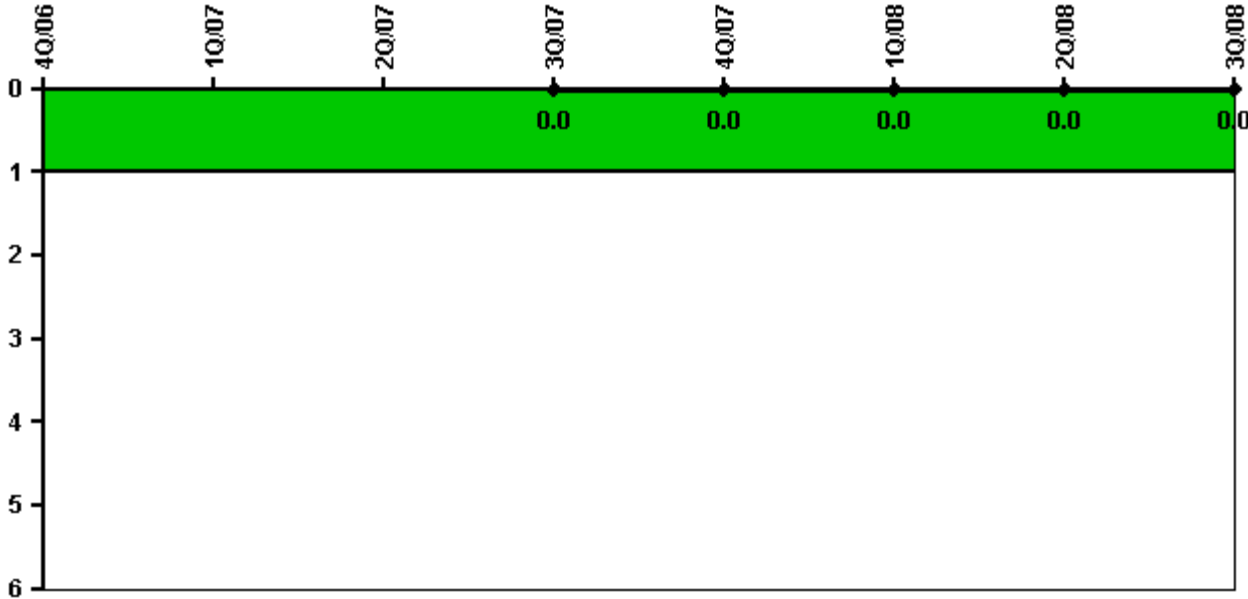


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value				0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

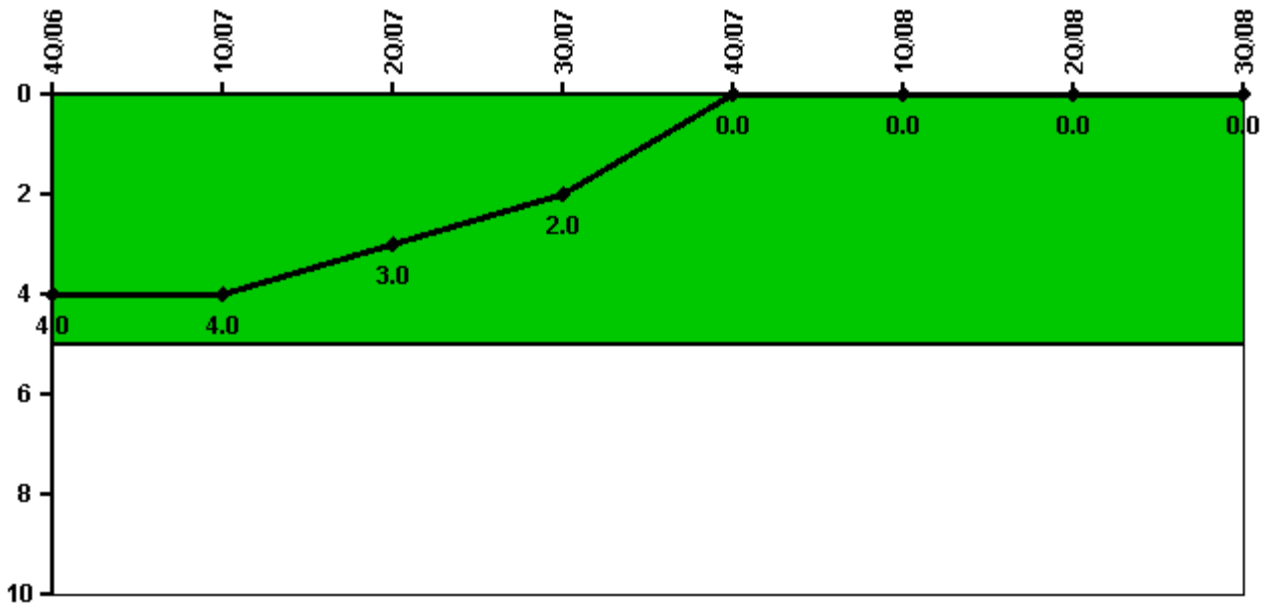


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Safety System Functional Failures	2	0	0	0	0	0	0	0
Indicator value	4	4	3	2	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

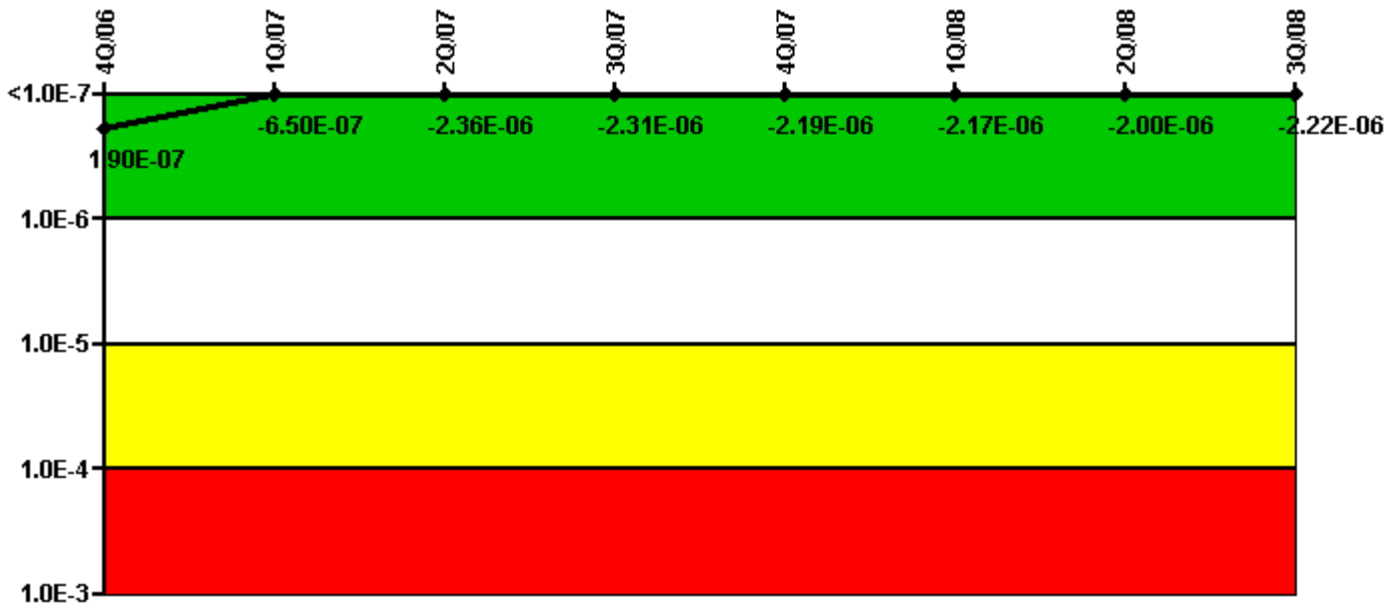


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (ΔCDF)	8.00E-07	4.50E-07	3.40E-07	3.90E-07	5.10E-07	5.30E-07	7.00E-07	4.80E-07
URI (ΔCDF)	-6.10E-07	-1.10E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.70E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.90E-07	-6.50E-07	-2.36E-06	-2.31E-06	-2.19E-06	-2.17E-06	-2.00E-06	-2.22E-06

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

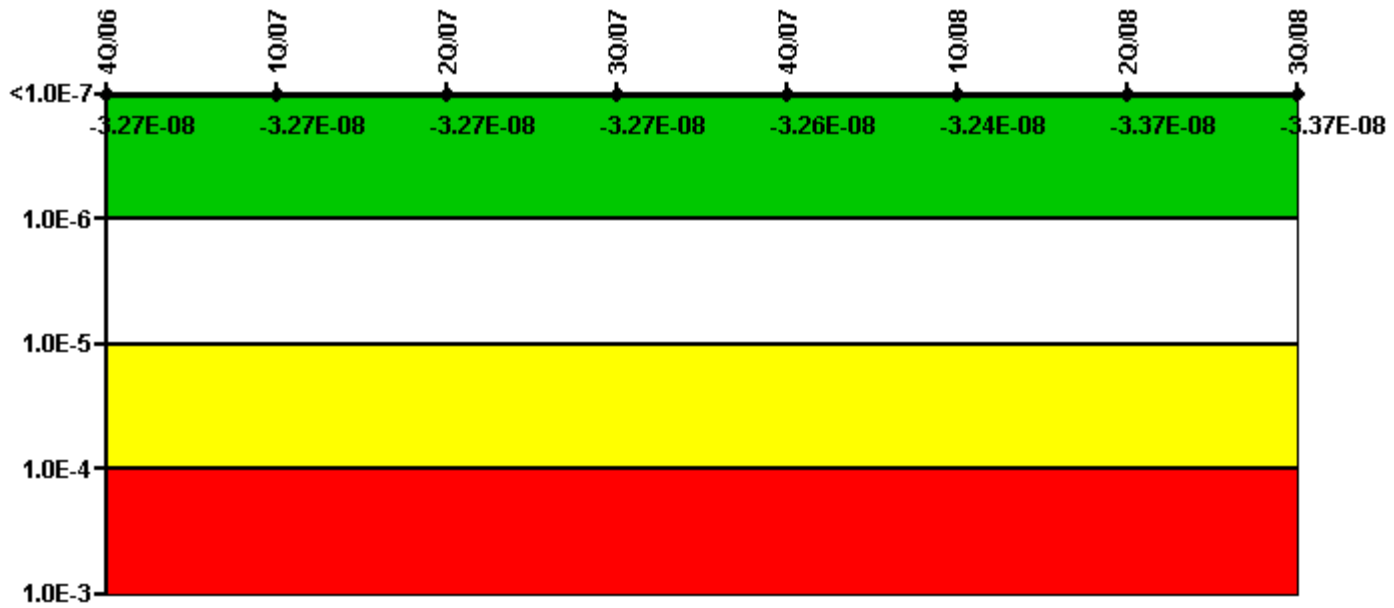


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-4.70E-09	-4.70E-09	-4.70E-09	-4.70E-09	-4.60E-09	-4.40E-09	-4.70E-09	-4.70E-09
URI (Δ CDF)	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.90E-08	-2.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.27E-08	-3.27E-08	-3.27E-08	-3.27E-08	-3.26E-08	-3.24E-08	-3.37E-08	-3.37E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

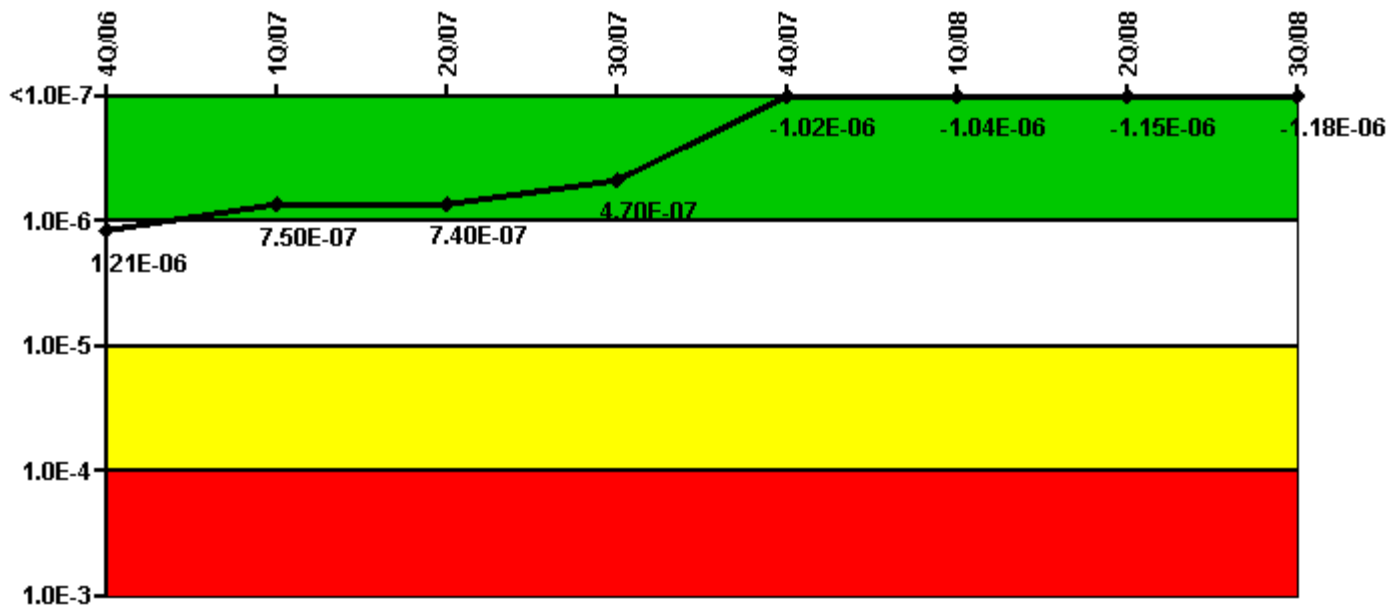


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (ΔCDF)	4.40E-07	4.20E-07	4.10E-07	1.70E-07	-1.90E-08	6.00E-08	-5.00E-08	-8.40E-08
URI (ΔCDF)	7.70E-07	3.30E-07	3.30E-07	3.00E-07	-1.00E-06	-1.10E-06	-1.10E-06	-1.10E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.21E-06	7.50E-07	7.40E-07	4.70E-07	-1.02E-06	-1.04E-06	-1.15E-06	-1.18E-06

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

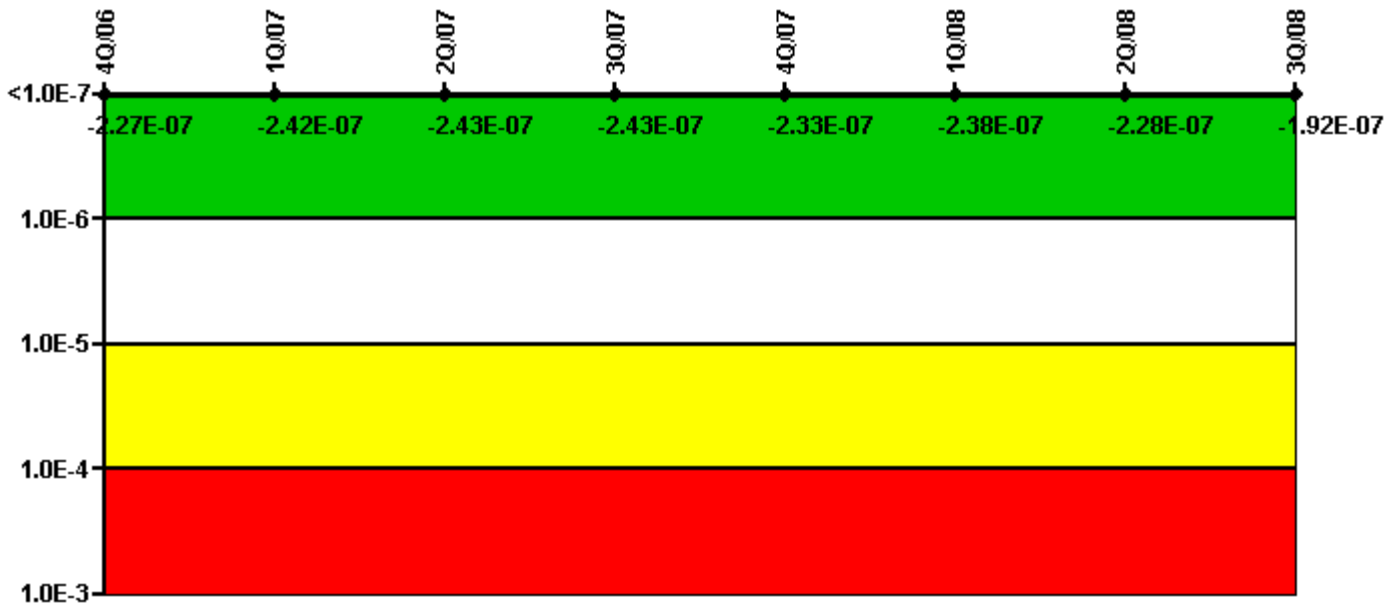


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-6.90E-09	-2.20E-08	-2.30E-08	-2.30E-08	-1.30E-08	-1.80E-08	-1.80E-08	1.80E-08
URI (Δ CDF)	-2.20E-07	-2.20E-07	-2.20E-07	-2.20E-07	-2.20E-07	-2.20E-07	-2.10E-07	-2.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.27E-07	-2.42E-07	-2.43E-07	-2.43E-07	-2.33E-07	-2.38E-07	-2.28E-07	-1.92E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

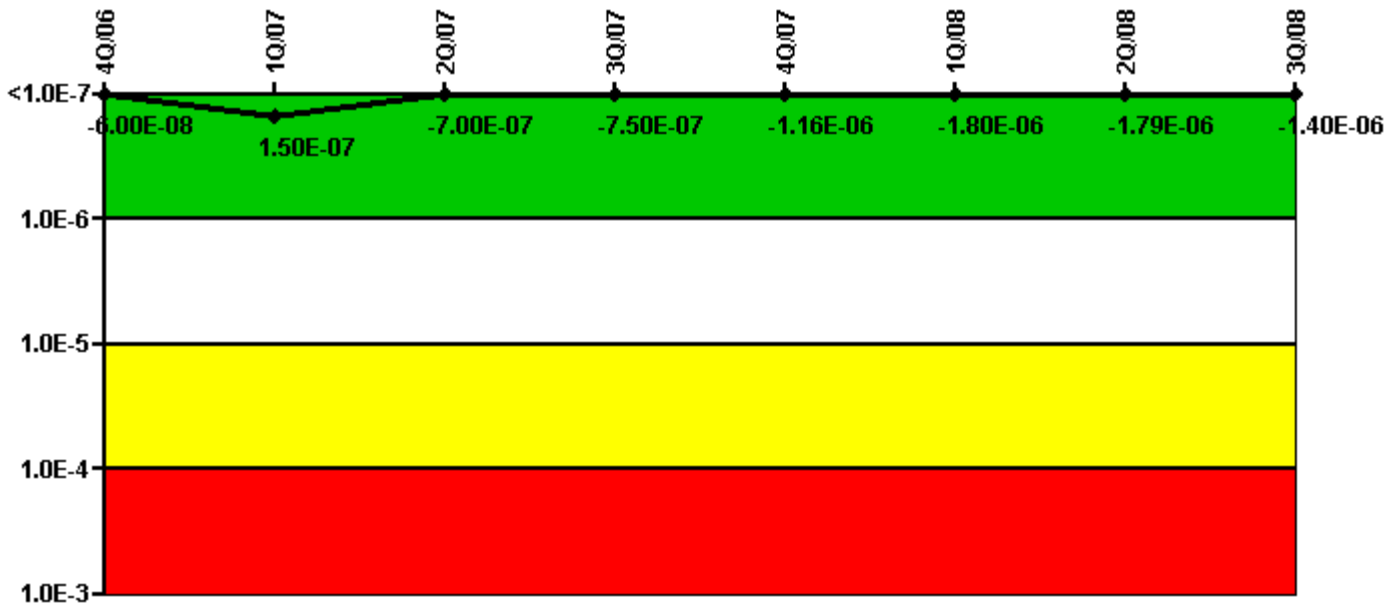


Thresholds: White > $1.00E-6$ Yellow > $1.00E-5$ Red > $1.00E-4$

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	$5.90E-07$	$8.00E-07$	$4.00E-07$	$3.50E-07$	$-6.30E-08$	$-6.00E-07$	$-5.90E-07$	$-2.00E-07$
URI (Δ CDF)	$-6.50E-07$	$-6.50E-07$	$-1.10E-06$	$-1.10E-06$	$-1.10E-06$	$-1.20E-06$	$-1.20E-06$	$-1.20E-06$
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	$-6.00E-08$	$1.50E-07$	$-7.00E-07$	$-7.50E-07$	$-1.16E-06$	$-1.80E-06$	$-1.79E-06$	$-1.40E-06$

Licensee Comments: none

Reactor Coolant System Activity

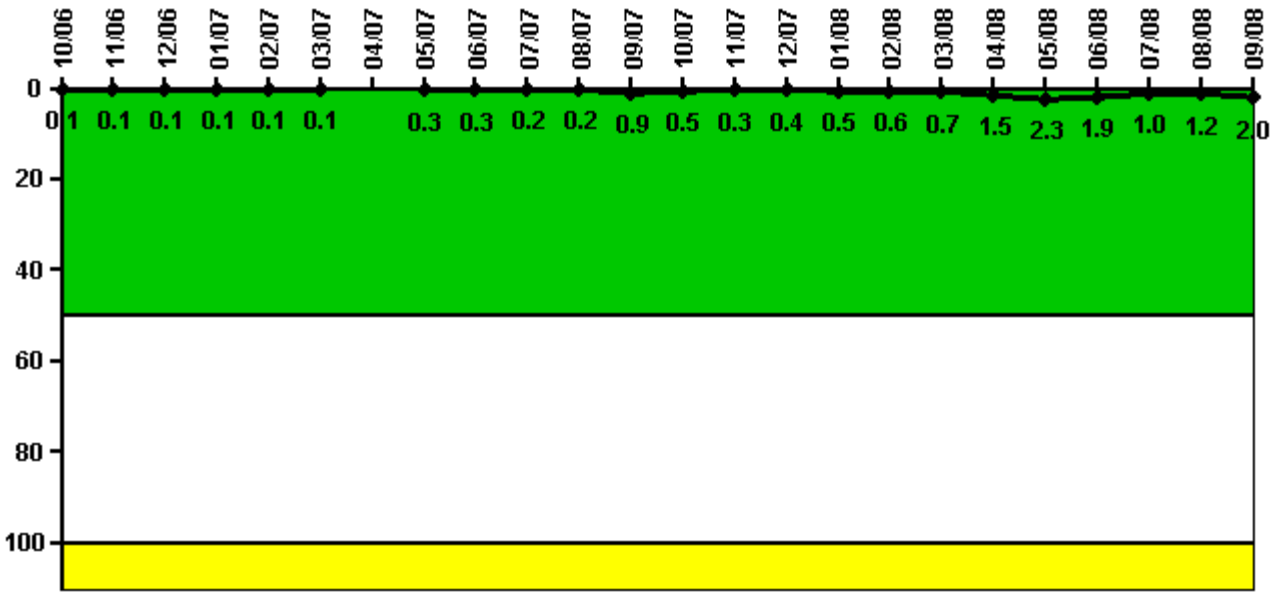

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum activity	0.000654	0.000675	0.000670	0.000978	0.000831	0.001050	N/A	0.002530	0.002730	0.002440	0.002240	0.008790
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	N/A	0.3	0.3	0.2	0.2	0.9

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.005370	0.003410	0.004370	0.005010	0.005510	0.006980	0.014900	0.022600	0.018500	0.009950	0.012100	0.020400
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.5	0.3	0.4	0.5	0.6	0.7	1.5	2.3	1.9	1.0	1.2	2.0

Licensee Comments: none

Reactor Coolant System Leakage

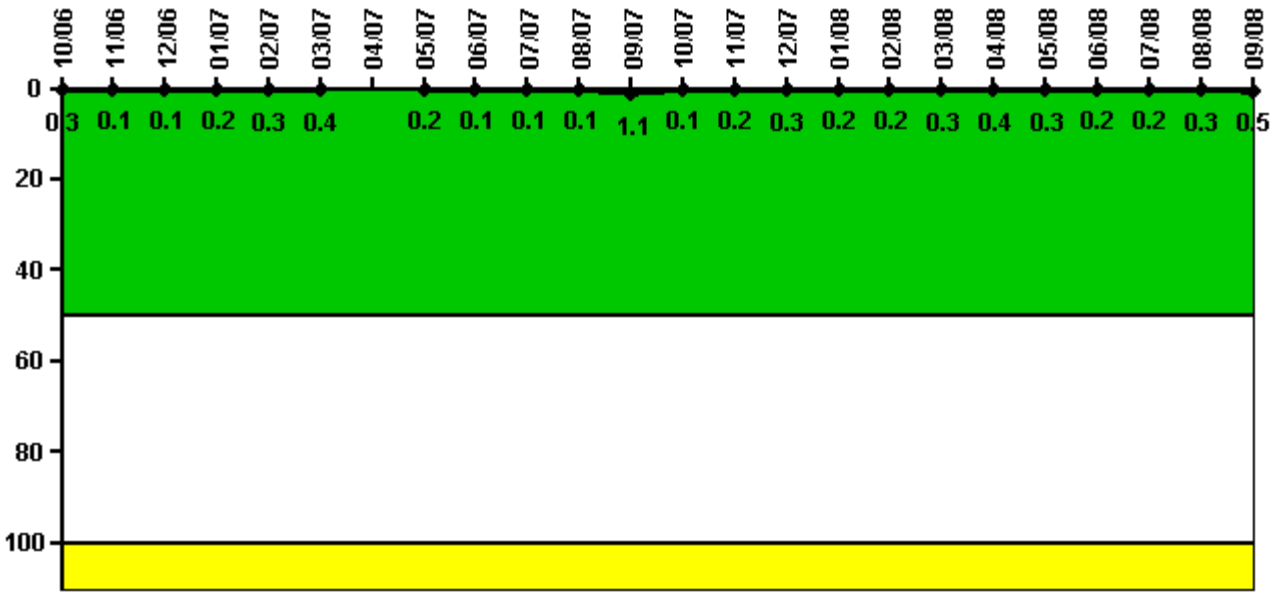


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum leakage	0.028	0.013	0.014	0.016	0.025	0.037	N/A	0.016	0.013	0.013	0.013	0.105
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.1	0.1	0.2	0.3	0.4	N/A	0.2	0.1	0.1	0.1	1.1
Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	0.007	0.018	0.025	0.019	0.021	0.027	0.036	0.028	0.019	0.015	0.030	0.048
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.2	0.3	0.2	0.2	0.3	0.4	0.3	0.2	0.2	0.3	0.5

Licensee Comments: none

Drill/Exercise Performance

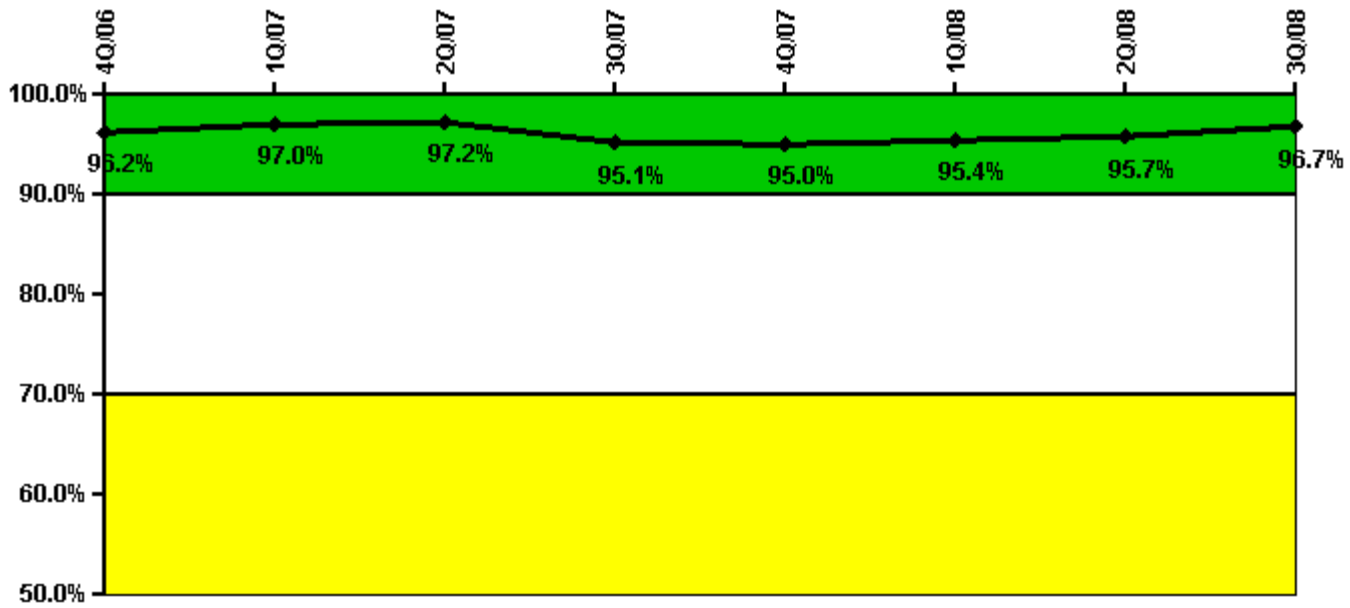

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful opportunities	31.0	18.0	14.0	47.0	17.0	52.0	64.0	20.0
Total opportunities	32.0	18.0	14.0	52.0	18.0	52.0	66.0	20.0
Indicator value	96.2%	97.0%	97.2%	95.1%	95.0%	95.4%	95.7%	96.7%

Licensee Comments:

4Q/07: Drill and Exercise data was revised based on NRC Inspector identified administrative correction during EP Inspection (2008-004). Original data reported was 16/17. This correction did not change the PI color

ERO Drill Participation

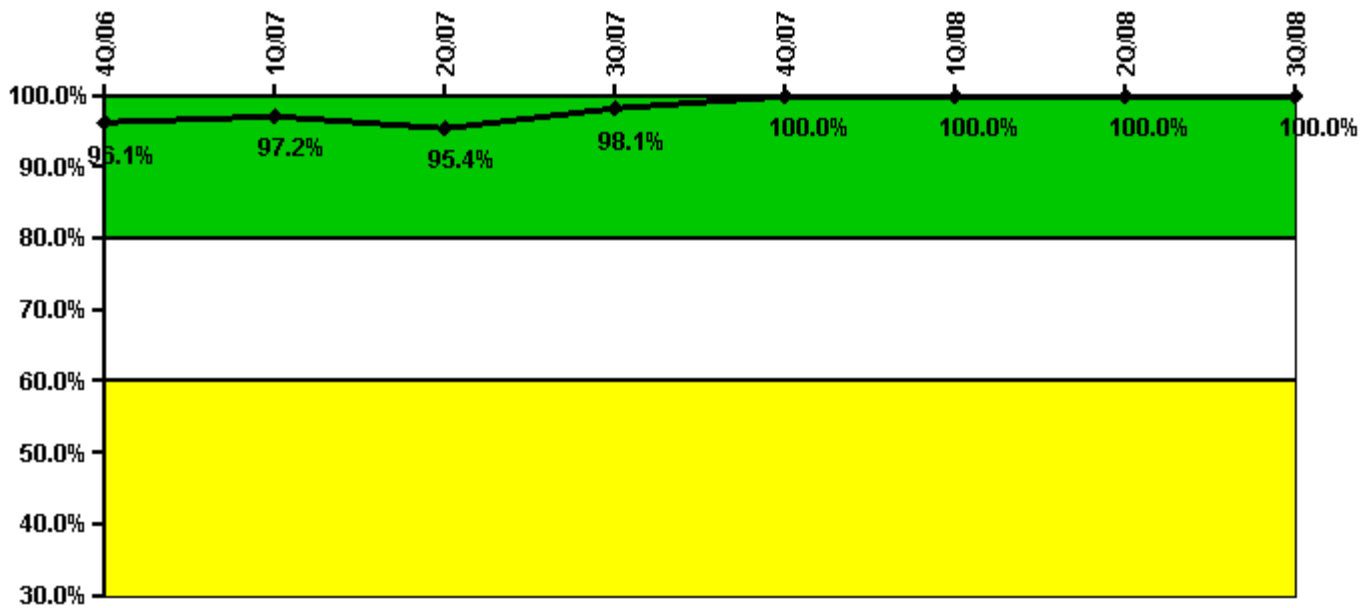

Thresholds: White < 80.0% Yellow < 60.0%

Notes


ERO Drill Participation	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Participating Key personnel	99.0	105.0	103.0	102.0	107.0	100.0	112.0	103.0
Total Key personnel	103.0	108.0	108.0	104.0	107.0	100.0	112.0	103.0
Indicator value	96.1%	97.2%	95.4%	98.1%	100.0%	100.0%	100.0%	100.0%

Licensee Comments:

2Q/08: ERO Participation data was revised based on NRC Inspector identified administrative correction during EP Inspection (2008-004). Original data reported was 100/100. This correction did not change the PI color.

3Q/07: ERO Participation data was revised based on NRC Inspector identified administrative correction during EP Inspection (2008-004). Original data reported was 103/105. This correction did not change the PI color

Alert & Notification System

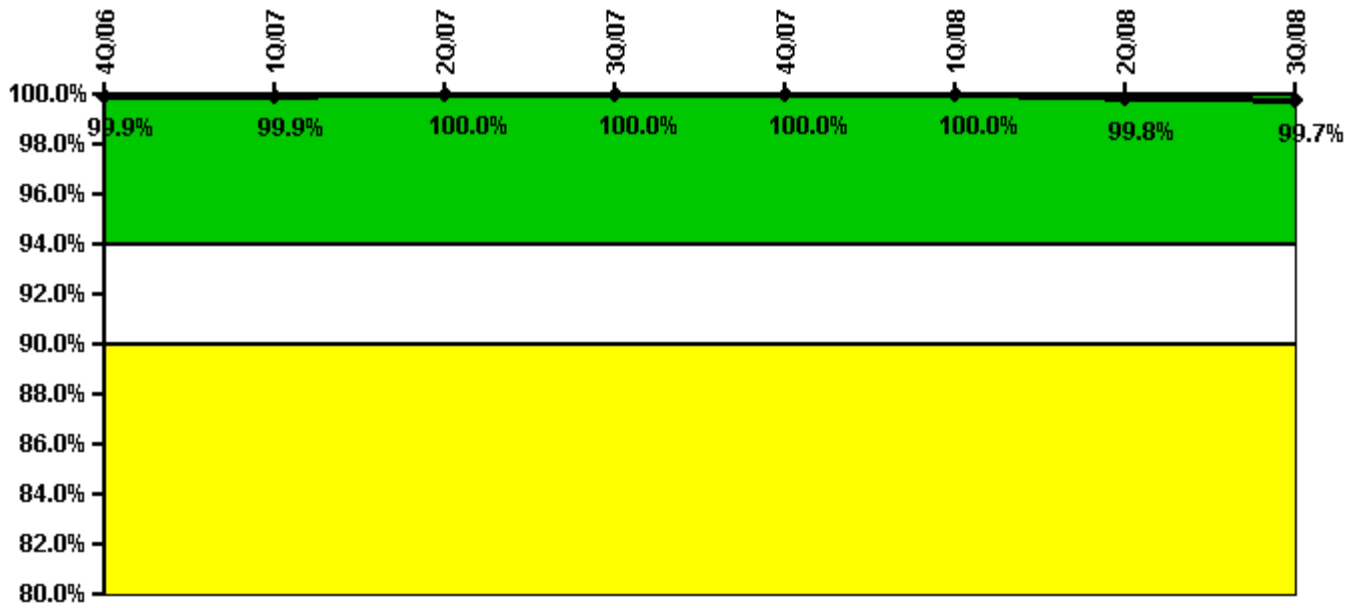


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful siren-tests	377	377	377	377	377	377	374	405
Total sirens-tests	377	377	377	377	377	377	377	406
Indicator value	99.9%	99.9%	100.0%	100.0%	100.0%	100.0%	99.8%	99.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness

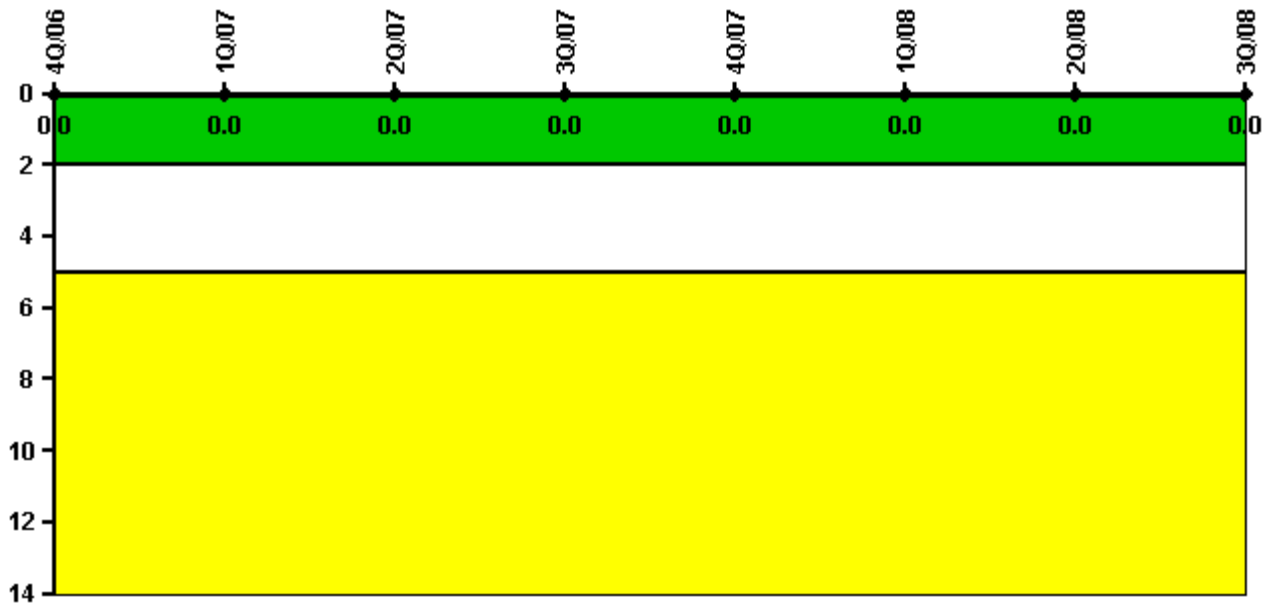


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

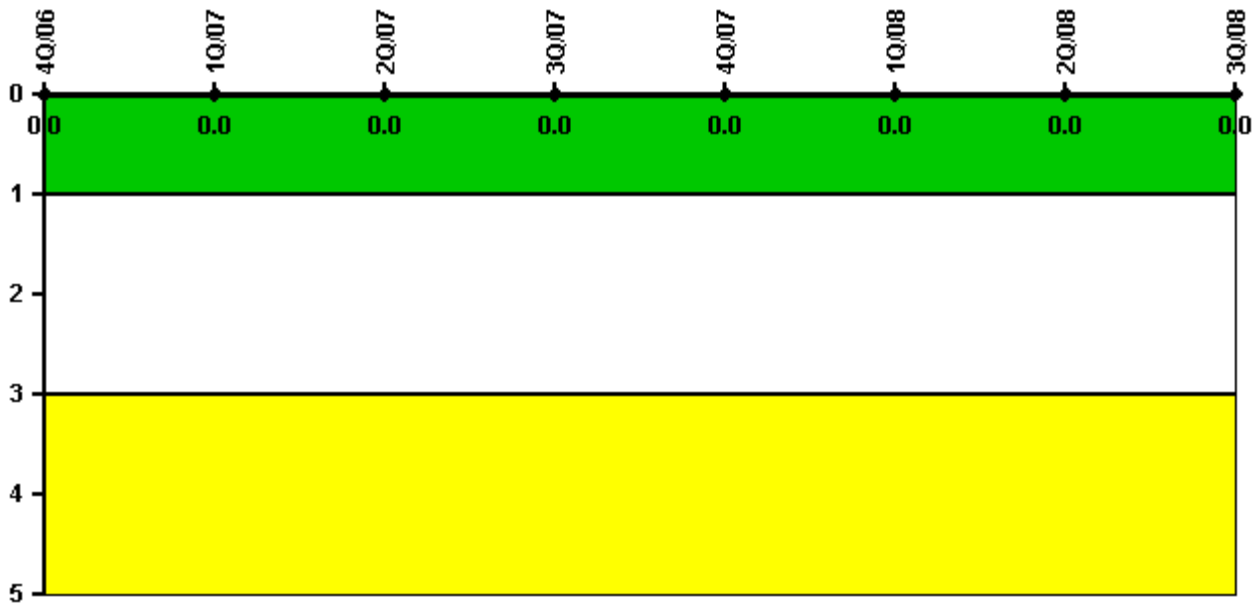

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Security information not publicly available.