


# Dresden 3

## 3Q/2008 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

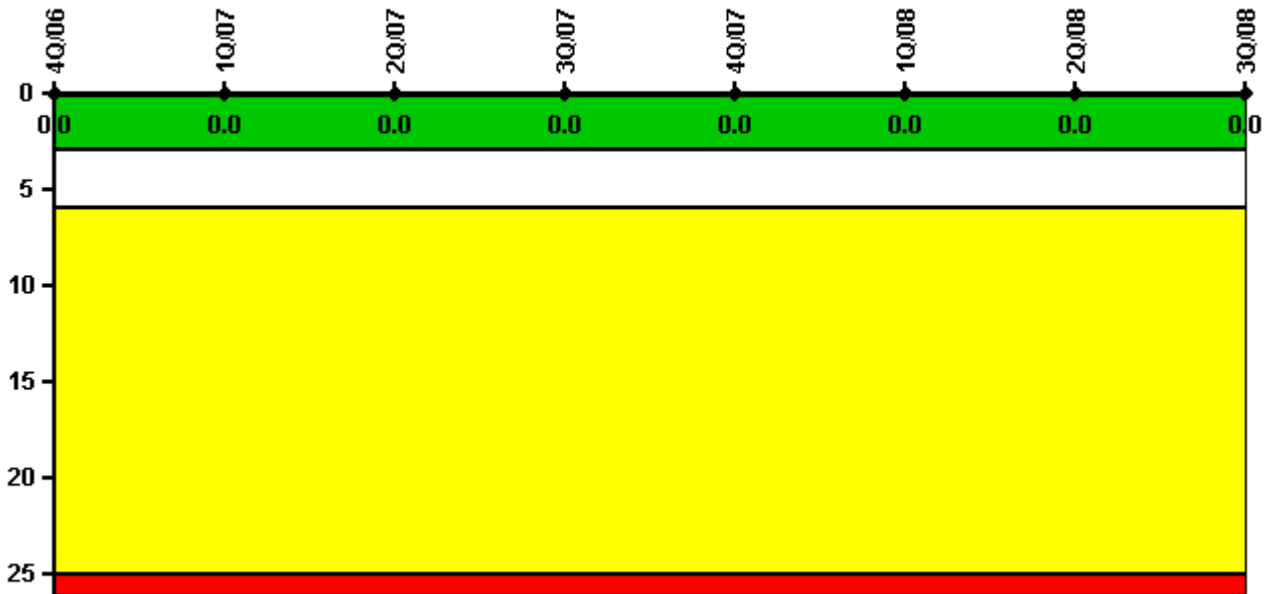


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1770.1	2159.0	2184.0	2185.5	2209.0	1983.8	2184.0	2208.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

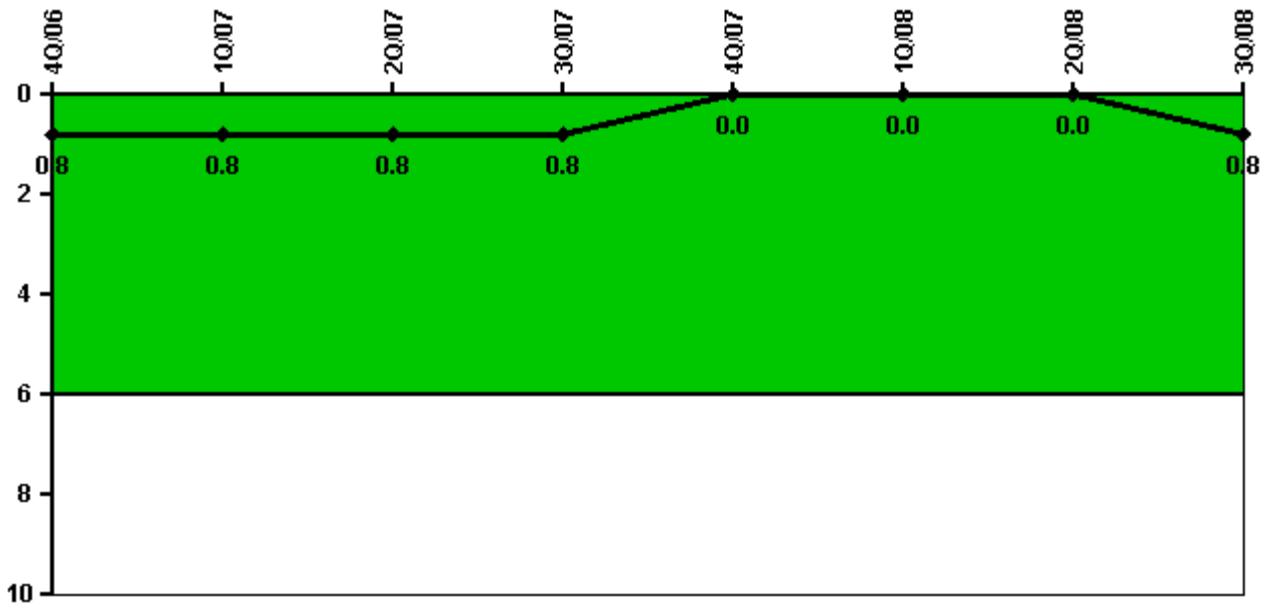

Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned power changes	1.0	0	0	0	0	0	0	1.0
Critical hours	1770.1	2159.0	2184.0	2185.5	2209.0	1983.8	2184.0	2208.0
Indicator value	0.8	0.8	0.8	0.8	0	0	0	0.8

Licensee Comments:

3Q/08: On August 17, 2008, the NRC granted an NOED, which averted reactor shutdown due to a Drywell Floor Drain Sump pumping issue. However, a power reduction was necessary for Drywell entry to address this issue.

# Unplanned Scrams with Complications




Thresholds: White > 1.0

**Notes**

Unplanned Scrams with Complications	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value				0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

## Safety System Functional Failures (BWR)

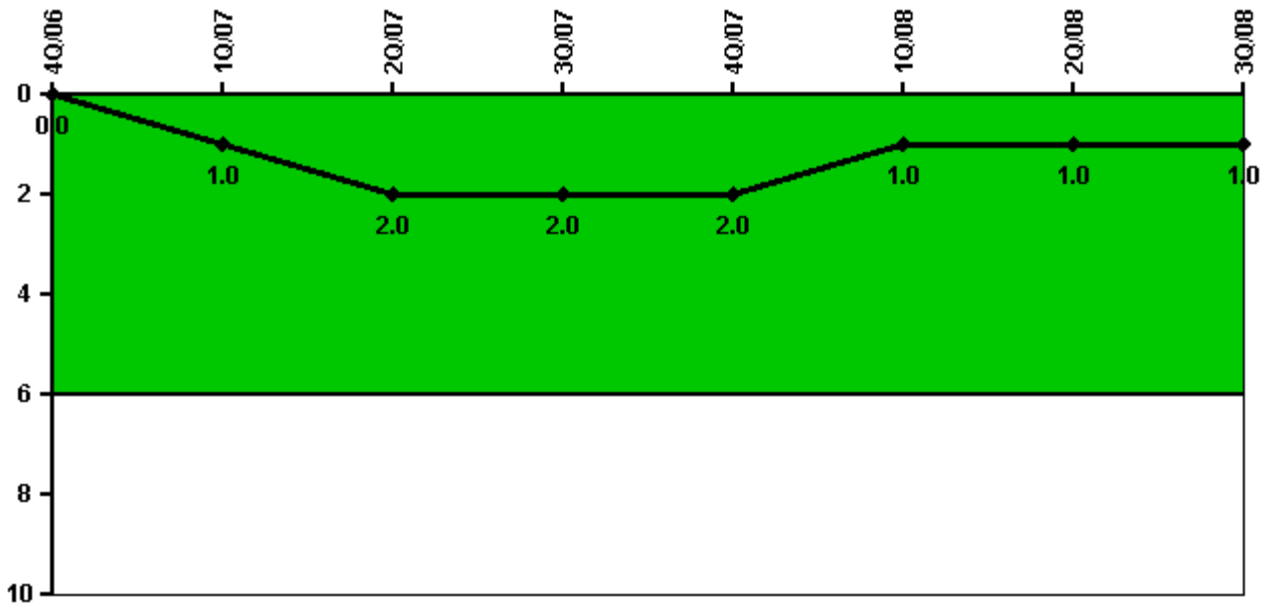


Thresholds: White > 6.0

### Notes

Safety System Functional Failures (BWR)	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Safety System Functional Failures	0	1	1	0	0	0	1	0
Indicator value	0	1	2	2	2	1	1	1

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

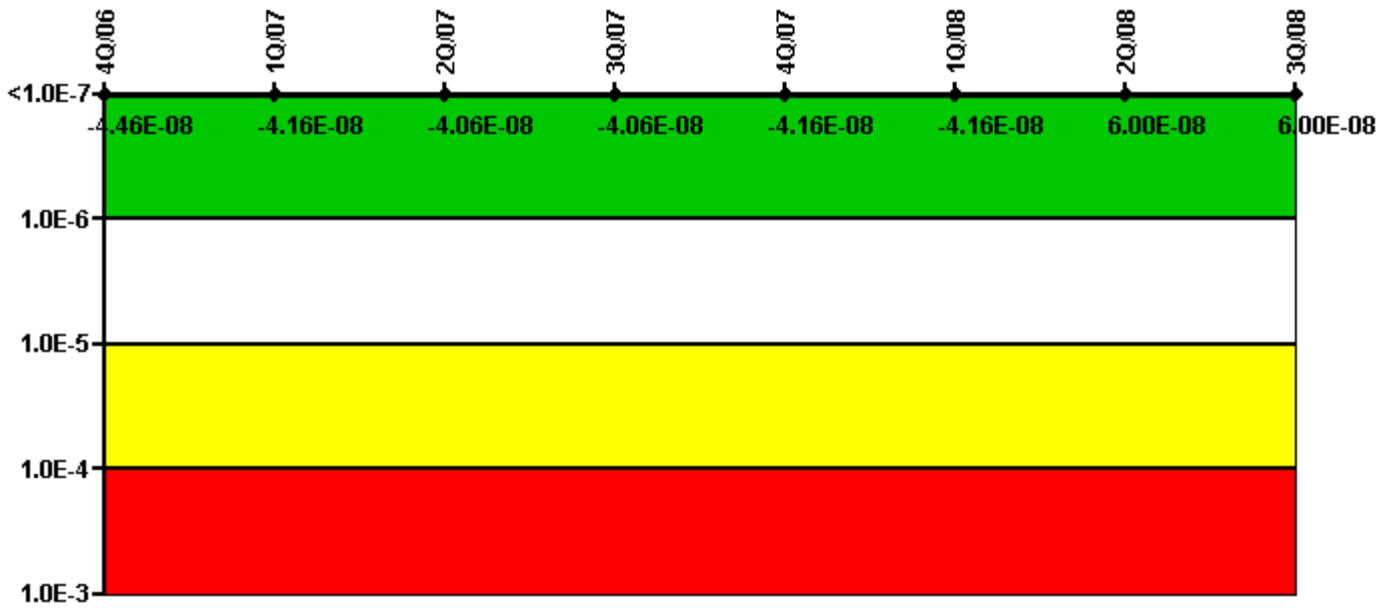


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI ( $\Delta$ CDF)	-4.60E-09	-4.60E-09	-4.60E-09	-4.60E-09	-4.60E-09	-4.60E-09	-4.00E-09	-4.00E-09
URI ( $\Delta$ CDF)	-4.00E-08	-3.70E-08	-3.60E-08	-3.60E-08	-3.70E-08	-3.70E-08	6.40E-08	6.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.46E-08	-4.16E-08	-4.06E-08	-4.06E-08	-4.16E-08	-4.16E-08	6.00E-08	6.00E-08

Licensee Comments: none

# Mitigating Systems Performance Index, High Pressure Injection System

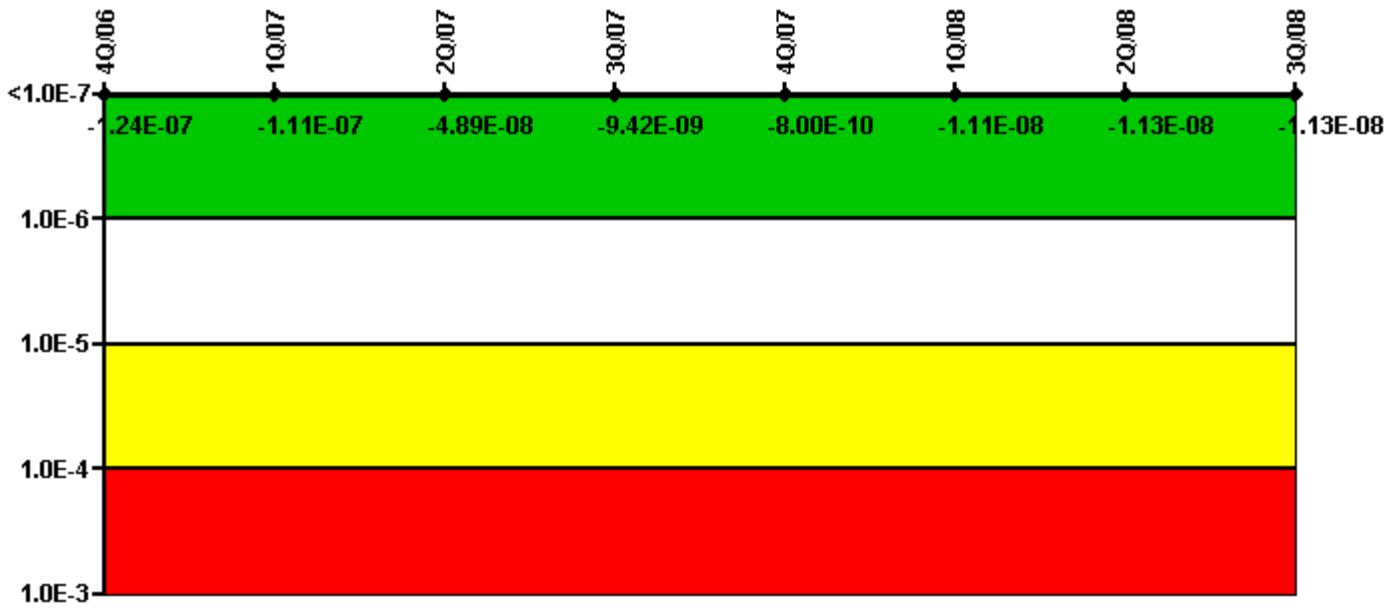


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI ( $\Delta$ CDF)	-5.20E-08	-3.90E-08	-3.90E-08	4.80E-10	9.10E-09	-1.20E-09	-1.40E-09	-1.40E-09
URI ( $\Delta$ CDF)	-7.20E-08	-7.20E-08	-9.90E-09	-9.90E-09	-9.90E-09	-9.90E-09	-9.90E-09	-9.90E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.24E-07	-1.11E-07	-4.89E-08	-9.42E-09	-8.00E-10	-1.11E-08	-1.13E-08	-1.13E-08

Licensee Comments: none

# Mitigating Systems Performance Index, Heat Removal System

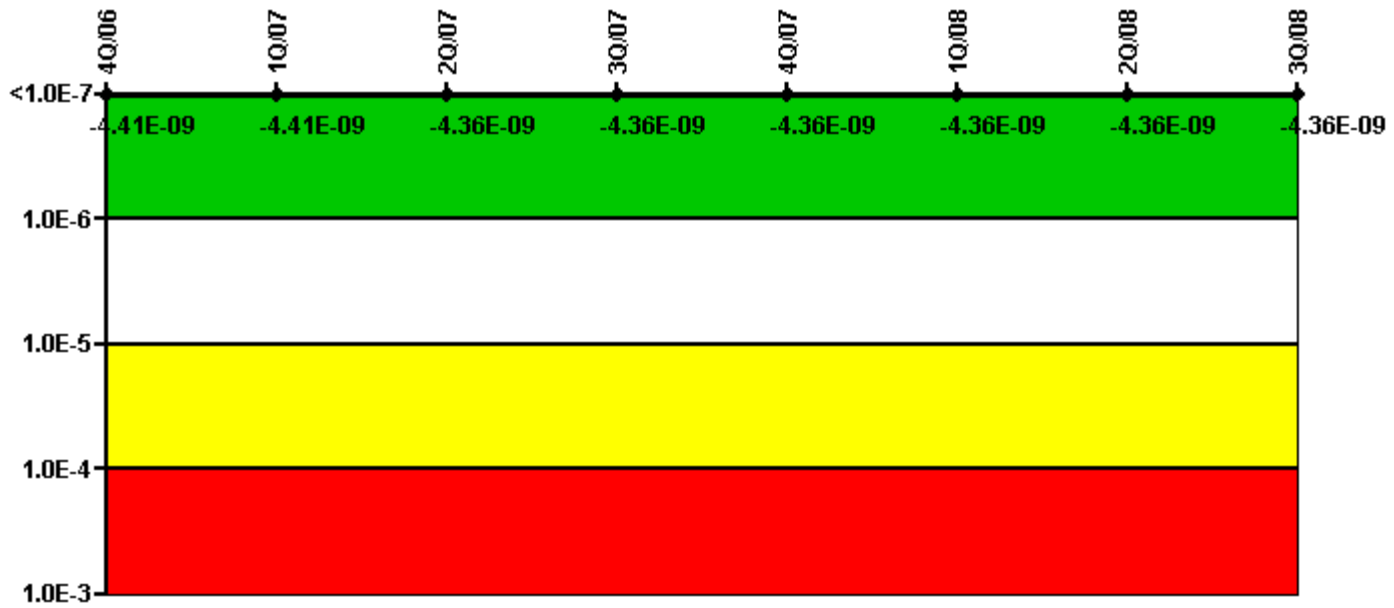


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI ( $\Delta$ CDF)	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09	-4.30E-09
URI ( $\Delta$ CDF)	-1.10E-10	-1.10E-10	-6.00E-11	-6.00E-11	-6.00E-11	-6.00E-11	-6.00E-11	-6.00E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-4.41E-09	-4.41E-09	-4.36E-09	-4.36E-09	-4.36E-09	-4.36E-09	-4.36E-09	-4.36E-09

Licensee Comments: none

# Mitigating Systems Performance Index, Residual Heat Removal System

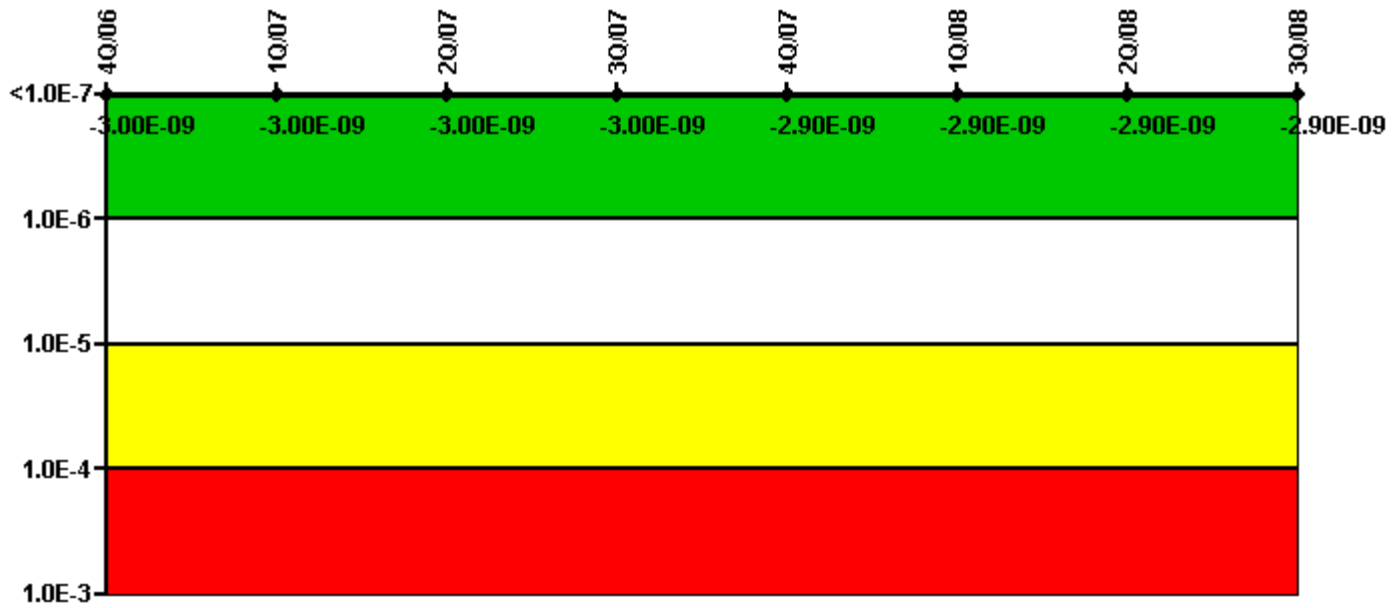

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI ( $\Delta$ CDF)	-1.30E-09	-1.30E-09	-1.30E-09	-1.30E-09	-1.30E-09	-1.30E-09	-1.30E-09	-1.30E-09
URI ( $\Delta$ CDF)	-1.70E-09	-1.70E-09	-1.70E-09	-1.70E-09	-1.60E-09	-1.60E-09	-1.60E-09	-1.60E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.00E-09	-3.00E-09	-3.00E-09	-3.00E-09	-2.90E-09	-2.90E-09	-2.90E-09	-2.90E-09

Licensee Comments: none



# Mitigating Systems Performance Index, Cooling Water Systems

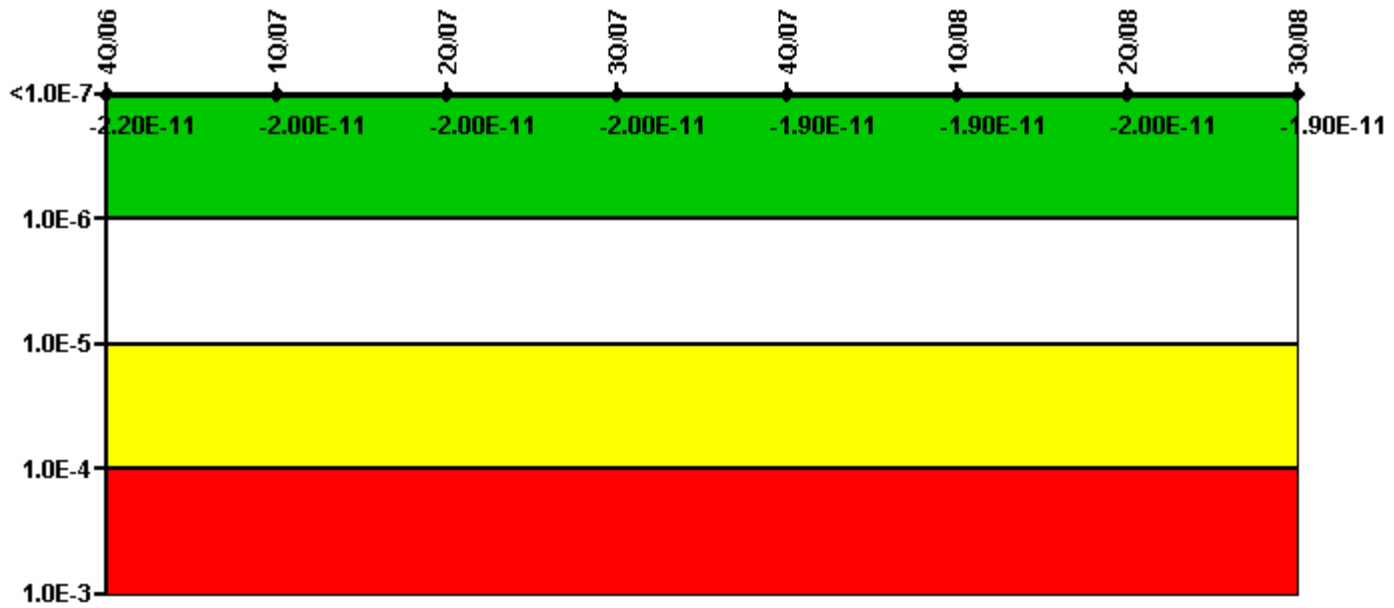


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI ( $\Delta$ CDF)	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
URI ( $\Delta$ CDF)	-2.20E-11	-2.00E-11	-2.00E-11	-2.00E-11	-1.90E-11	-1.90E-11	-2.00E-11	-1.90E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.20E-11	-2.00E-11	-2.00E-11	-2.00E-11	-1.90E-11	-1.90E-11	-2.00E-11	-1.90E-11

Licensee Comments: none

# Reactor Coolant System Activity

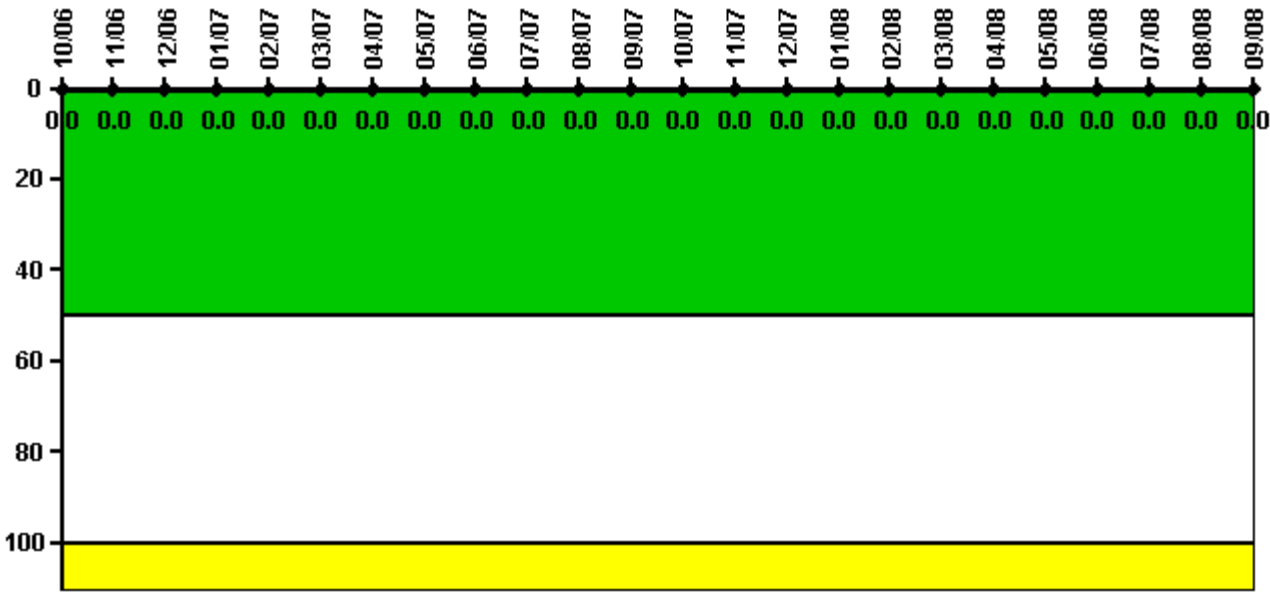

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Activity	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum activity	0.000003	0.000015	0.000015	0.000015	0.000022	0.000020	0.000023	0.000023	0.000024	0.000029	0.000018	0.000020
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.000023	0.000030	0.000032	0.000020	0.000004	0.000019	0.000032	0.000033	0.000016	0.000028	0.000028	0.000034
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

## Reactor Coolant System Leakage

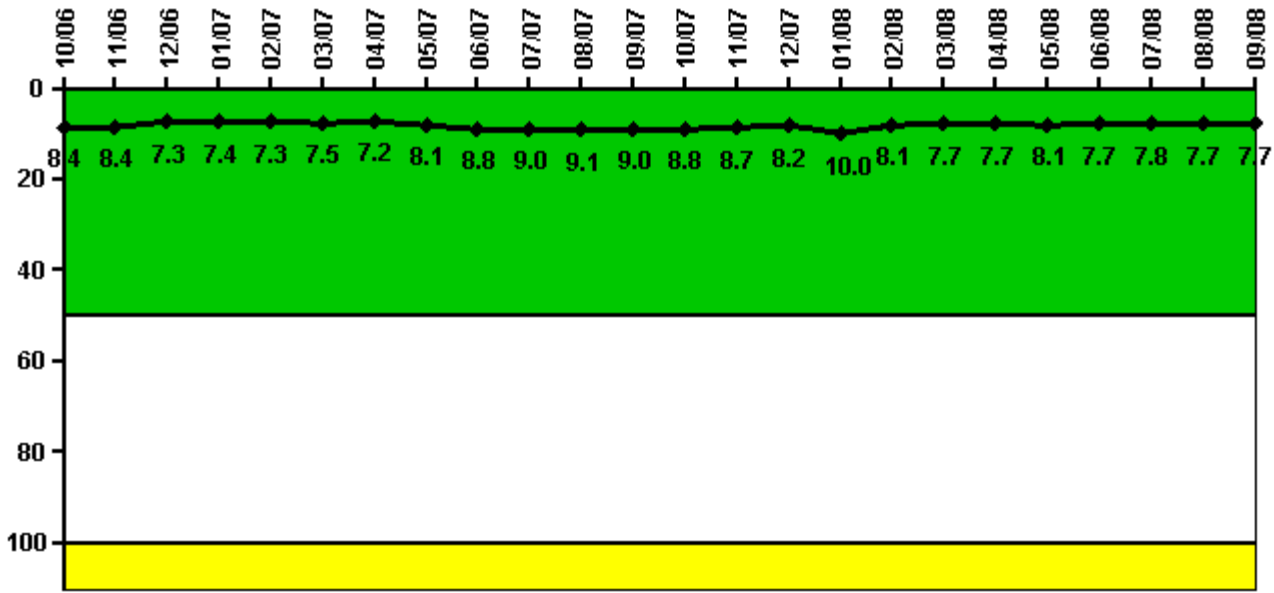


Thresholds: White > 50.0 Yellow > 100.0

### Notes

Reactor Coolant System Leakage	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum leakage	2.092	2.110	1.820	1.840	1.828	1.863	1.808	2.015	2.205	2.242	2.265	2.242
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	8.4	8.4	7.3	7.4	7.3	7.5	7.2	8.1	8.8	9.0	9.1	9.0
Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	2.192	2.180	2.043	2.490	2.018	1.933	1.918	2.018	1.937	1.942	1.922	1.935
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	8.8	8.7	8.2	10.0	8.1	7.7	7.7	8.1	7.7	7.8	7.7	7.7

Licensee Comments: none

## Drill/Exercise Performance

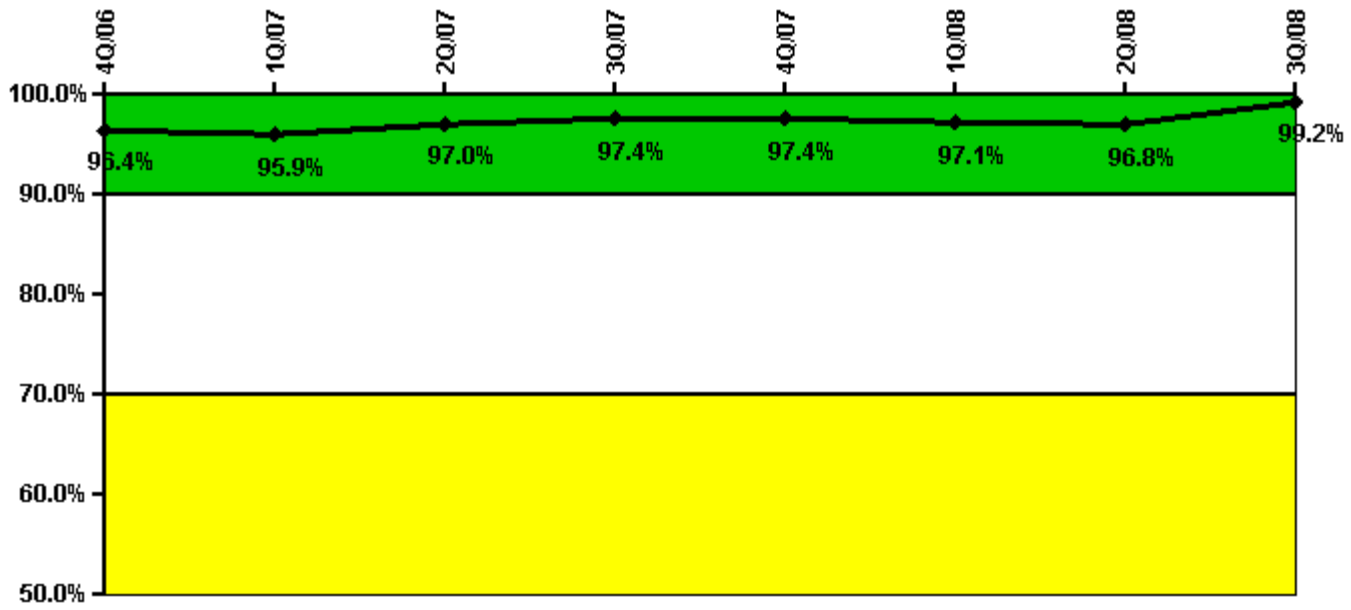


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful opportunities	12.0	50.0	54.0	40.0	2.0	24.0	16.0	40.0
Total opportunities	12.0	52.0	54.0	40.0	2.0	24.0	16.0	40.0
Indicator value	96.4%	95.9%	97.0%	97.4%	97.4%	97.1%	96.8%	99.2%

Licensee Comments: none

## ERO Drill Participation

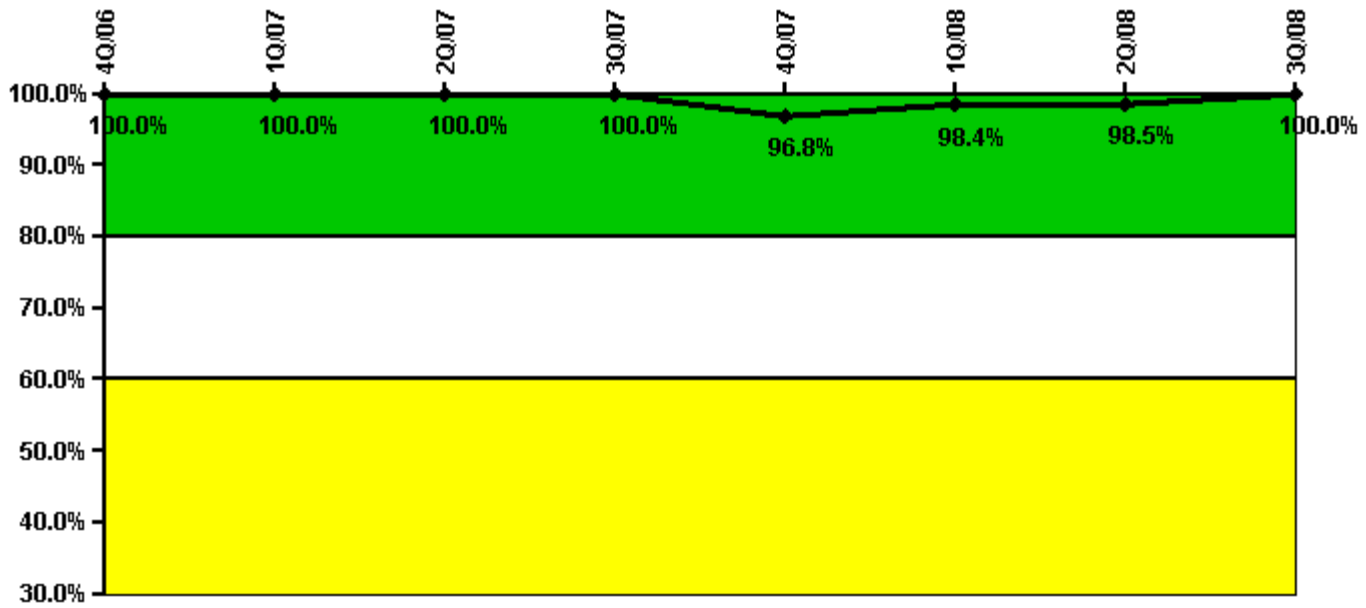


**Thresholds:** White < 80.0% Yellow < 60.0%

### Notes

ERO Drill Participation	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Participating Key personnel	66.0	63.0	65.0	63.0	60.0	62.0	67.0	64.0
Total Key personnel	66.0	63.0	65.0	63.0	62.0	63.0	68.0	64.0
Indicator value	100.0%	100.0%	100.0%	100.0%	96.8%	98.4%	98.5%	100.0%

Licensee Comments: none

## Alert & Notification System

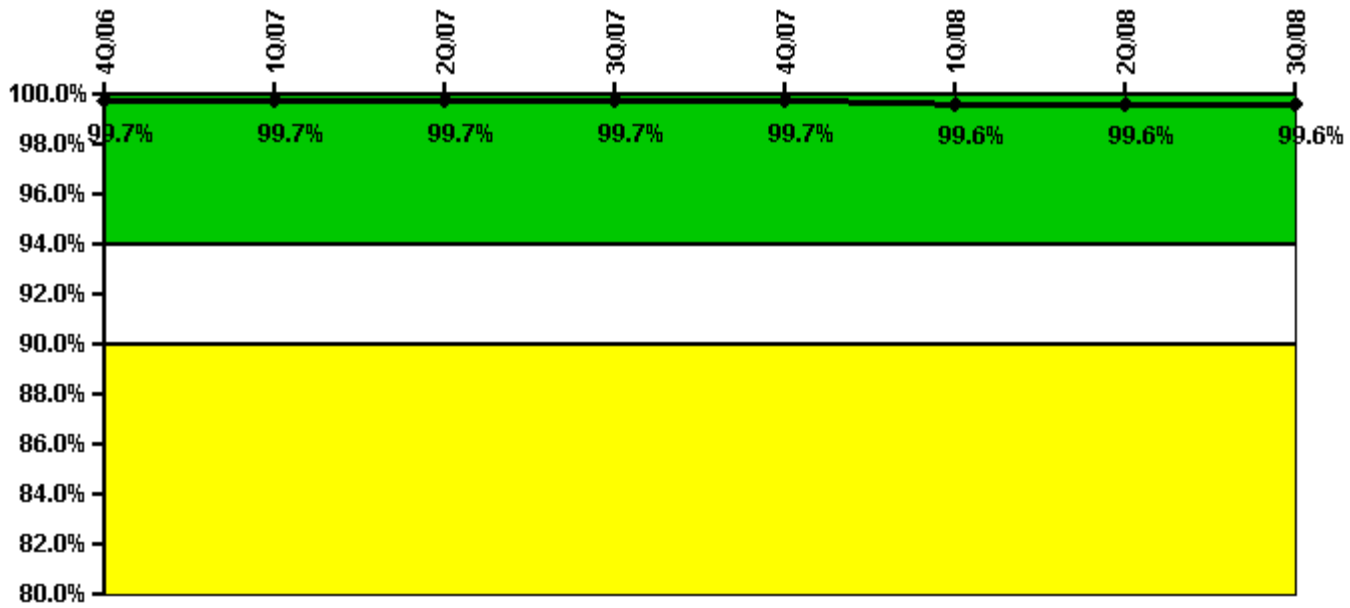

**Thresholds:** White < 94.0% Yellow < 90.0%

### Notes

Alert & Notification System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful siren-tests	4902	4985	4977	4961	4982	4970	4972	5037
Total sirens-tests	4914	4992	4990	4992	4992	4992	4992	5070
Indicator value	99.7%	99.7%	99.7%	99.7%	99.7%	99.6%	99.6%	99.6%

Licensee Comments: none

# Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

## RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

### Notes

RETS/ODCM Radiological Effluent	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: November 26, 2008