


Harris 1

3Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

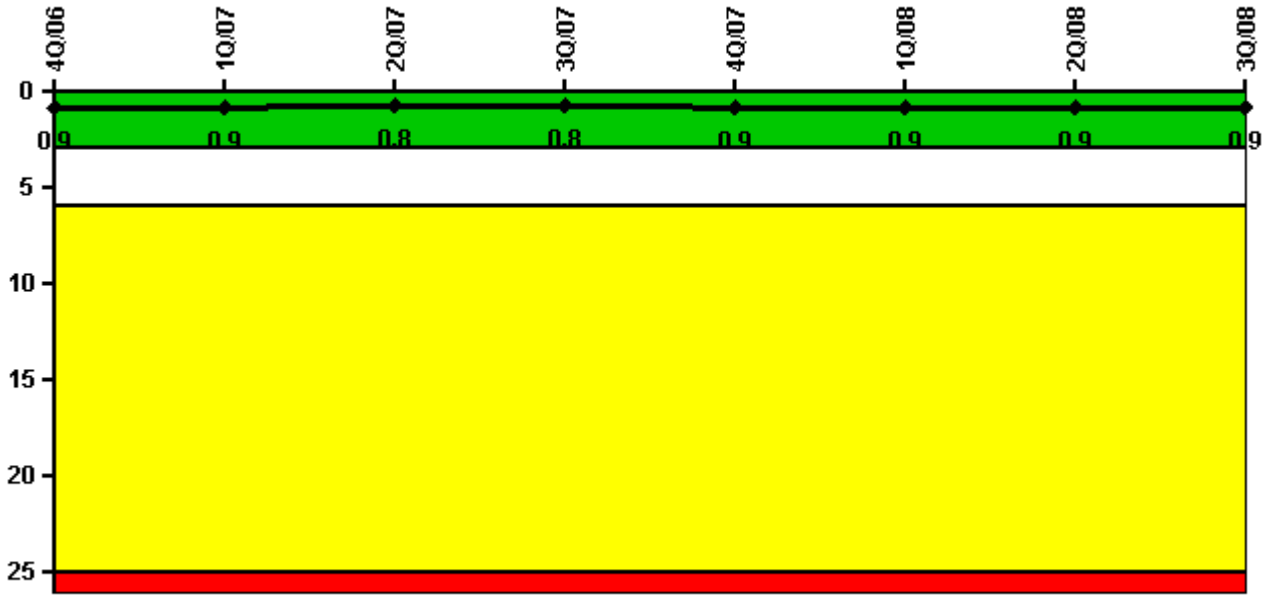


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned scrams	0	0	0	1.0	0	0	0	1.0
Critical hours	2209.0	2159.0	2184.0	2158.5	1688.1	2183.0	2184.0	1975.9
Indicator value	0.9	0.9	0.8	0.8	0.9	0.9	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

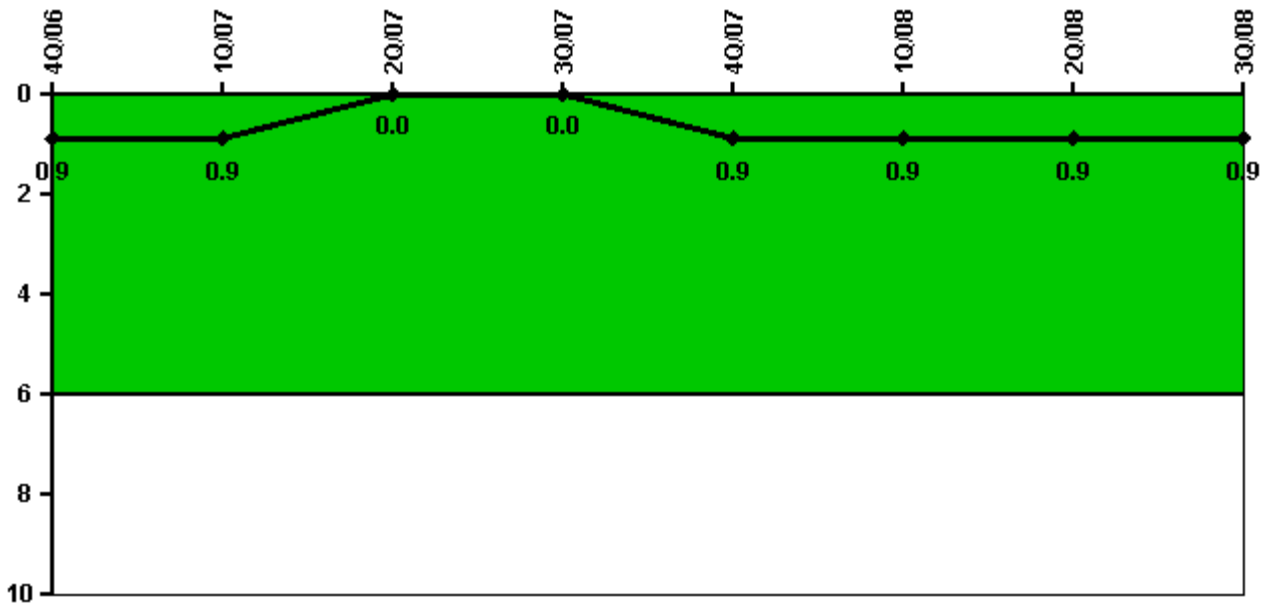

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned power changes	0	0	0	0	1.0	0	0	0
Critical hours	2209.0	2159.0	2184.0	2158.5	1688.1	2183.0	2184.0	1975.9
Indicator value	0.9	0.9	0	0	0.9	0.9	0.9	0.9

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value				0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

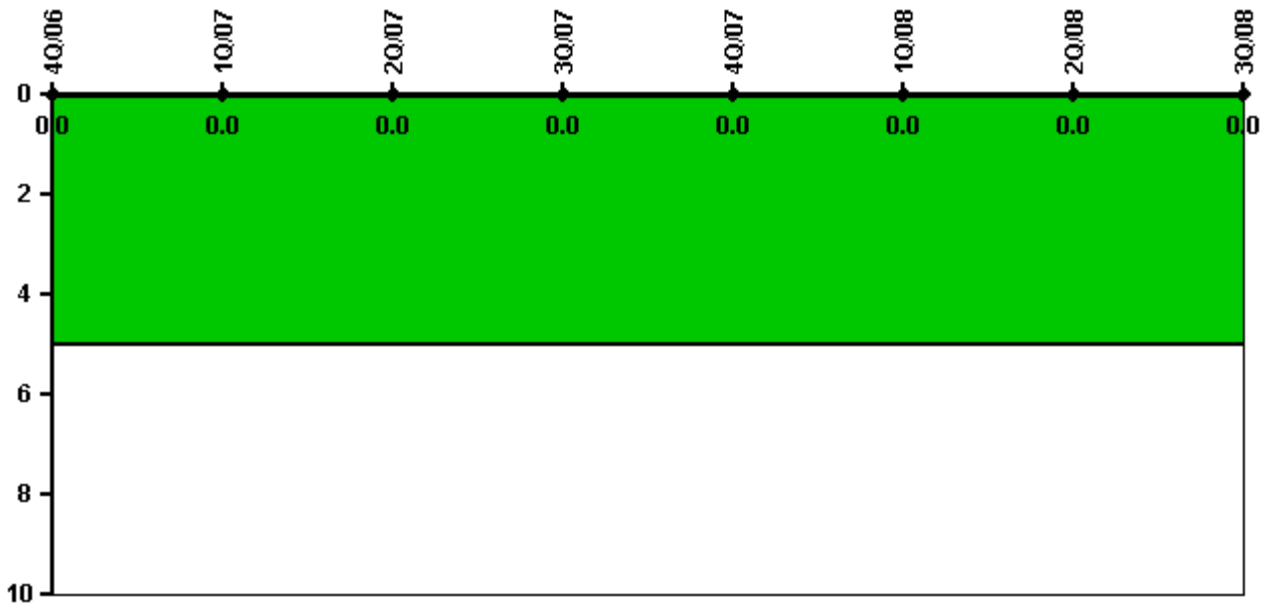


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

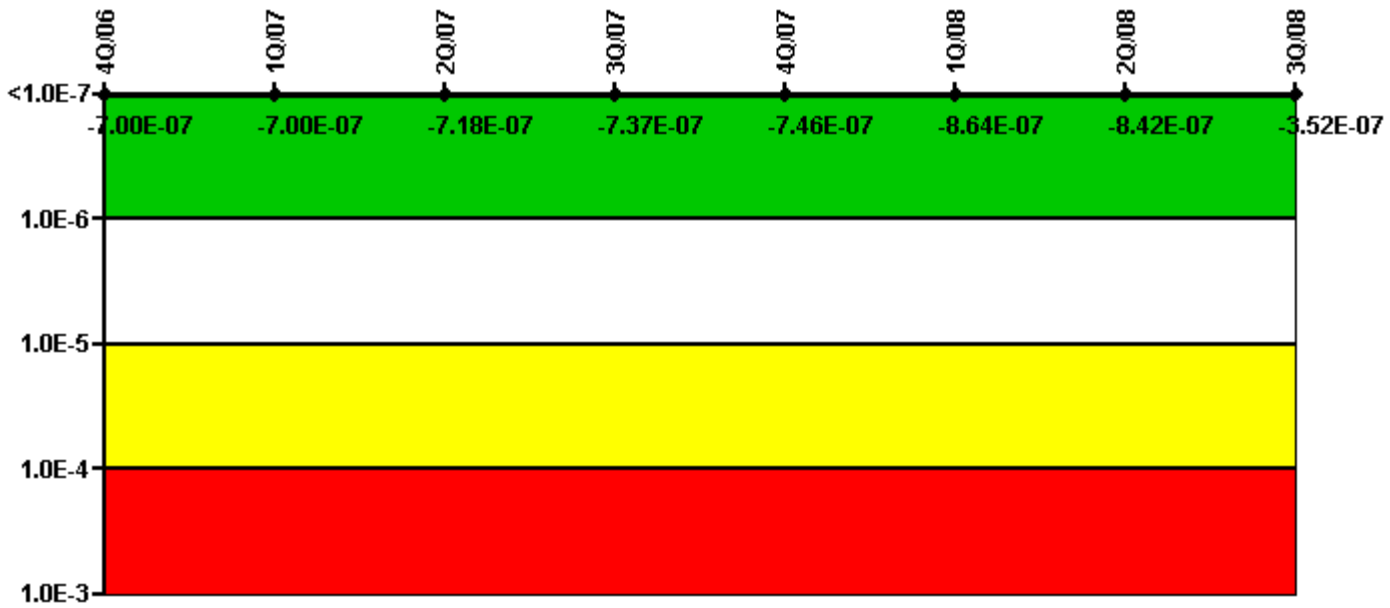

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	1.10E-07	1.10E-07	9.20E-08	8.30E-08	7.40E-08	-4.40E-08	-2.20E-08	-2.10E-09
URI (Δ CDF)	-8.10E-07	-8.10E-07	-8.10E-07	-8.20E-07	-8.20E-07	-8.20E-07	-8.20E-07	-3.50E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.00E-07	-7.00E-07	-7.18E-07	-7.37E-07	-7.46E-07	-8.64E-07	-8.42E-07	-3.52E-07

Licensee Comments:

3Q/08: MSPI Basis Document updated to reflect 2007 PRA Model of Record.

Mitigating Systems Performance Index, High Pressure Injection System

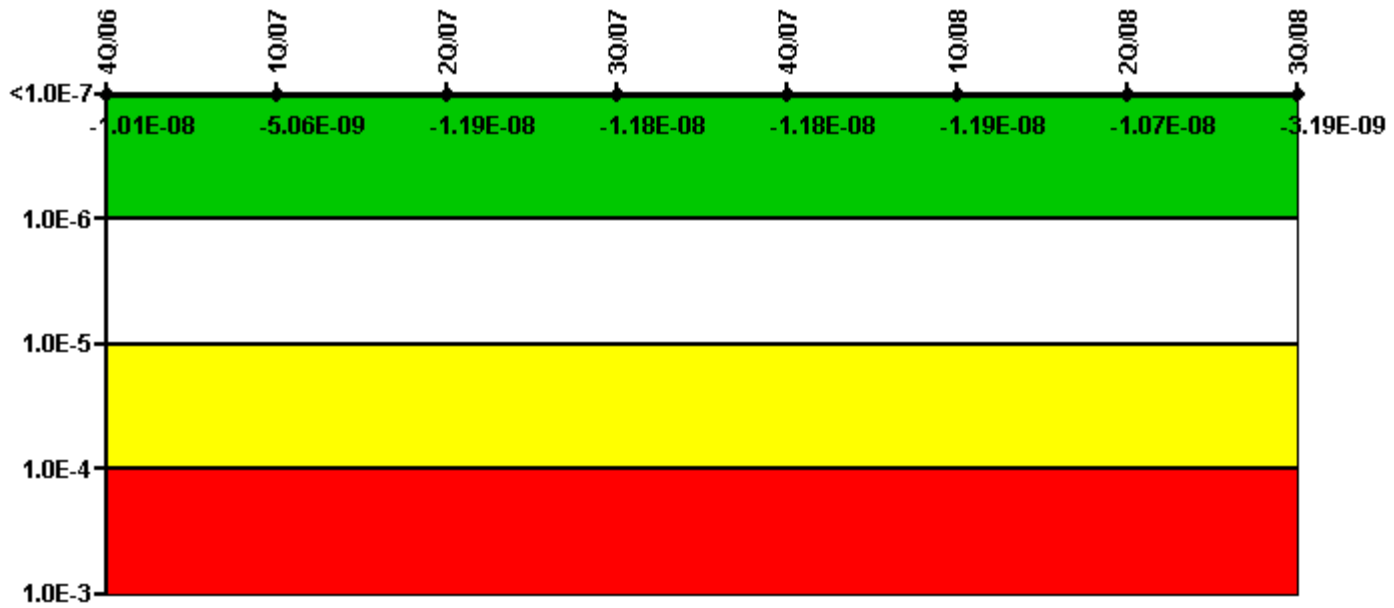

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-1.20E-09	-8.60E-10	-8.80E-10	-7.80E-10	-8.40E-10	-8.50E-10	3.10E-10	-8.70E-11
URI (Δ CDF)	-8.90E-09	-4.20E-09	-1.10E-08	-1.10E-08	-1.10E-08	-1.10E-08	-1.10E-08	-3.10E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.01E-08	-5.06E-09	-1.19E-08	-1.18E-08	-1.18E-08	-1.19E-08	-1.07E-08	-3.19E-09

Licensee Comments:

3Q/08: MSPi Basis Document updated to reflect 2007 PRA Model of Record.

Mitigating Systems Performance Index, Heat Removal System

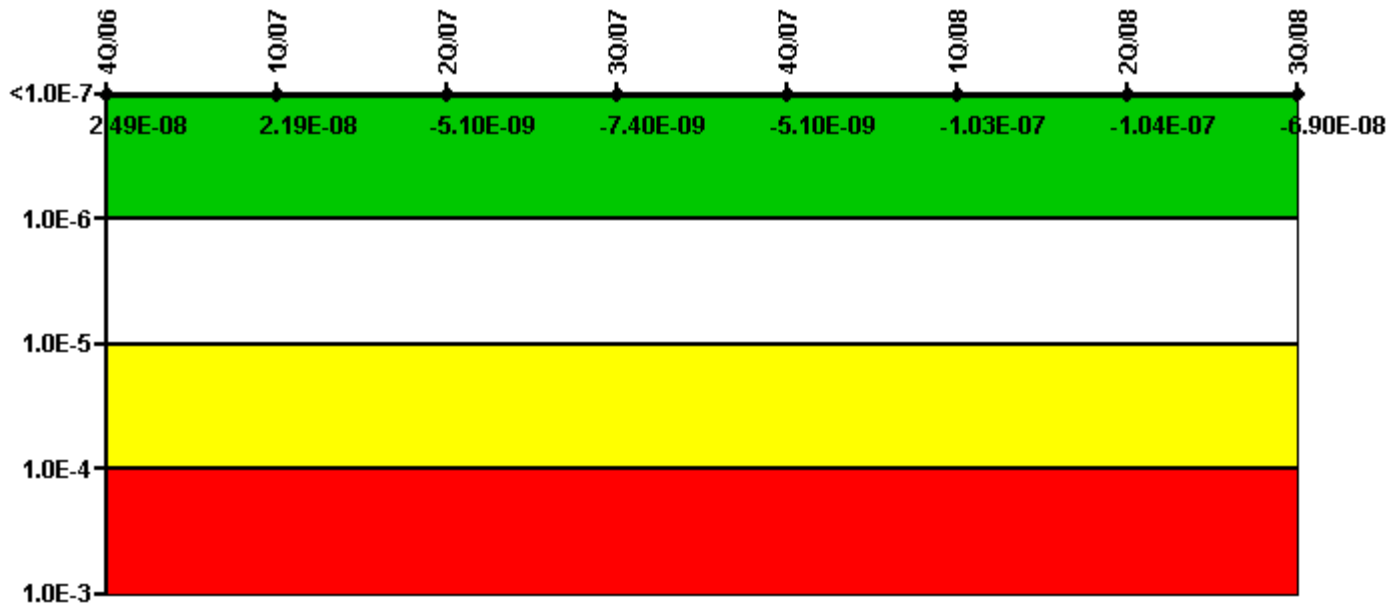

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	1.90E-08	1.60E-08	-1.20E-08	-1.20E-08	-9.70E-09	-2.40E-08	-2.50E-08	-1.80E-08
URI (Δ CDF)	5.90E-09	5.90E-09	6.90E-09	4.60E-09	4.60E-09	-7.90E-08	-7.90E-08	-5.10E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.49E-08	2.19E-08	-5.10E-09	-7.40E-09	-5.10E-09	-1.03E-07	-1.04E-07	-6.90E-08

Licensee Comments:

3Q/08: MSPi Basis Document updated to reflect 2007 PRA Model of Record.

Mitigating Systems Performance Index, Residual Heat Removal System

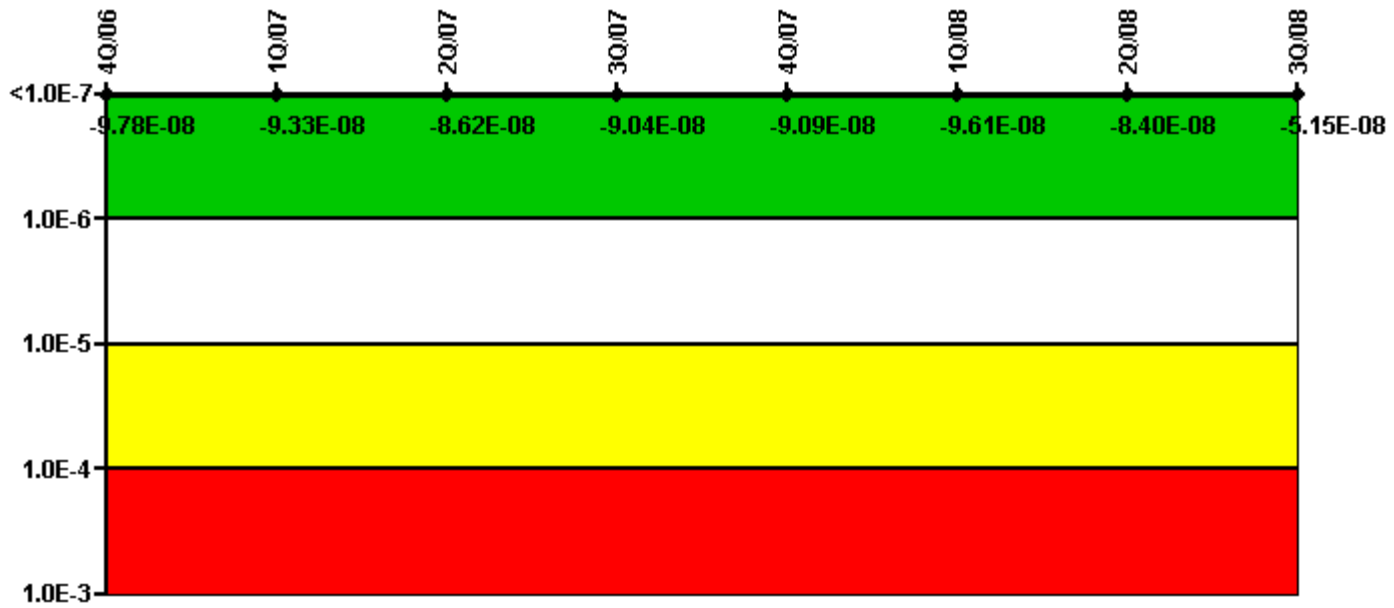

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-1.80E-09	2.70E-09	9.80E-09	5.60E-09	5.10E-09	-7.50E-11	1.20E-08	-1.50E-09
URI (Δ CDF)	-9.60E-08	-9.60E-08	-9.60E-08	-9.60E-08	-9.60E-08	-9.60E-08	-9.60E-08	-5.00E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.78E-08	-9.33E-08	-8.62E-08	-9.04E-08	-9.09E-08	-9.61E-08	-8.40E-08	-5.15E-08

Licensee Comments:

3Q/08: MSPi Basis Document updated to reflect 2007 PRA Model of Record.

Mitigating Systems Performance Index, Cooling Water Systems

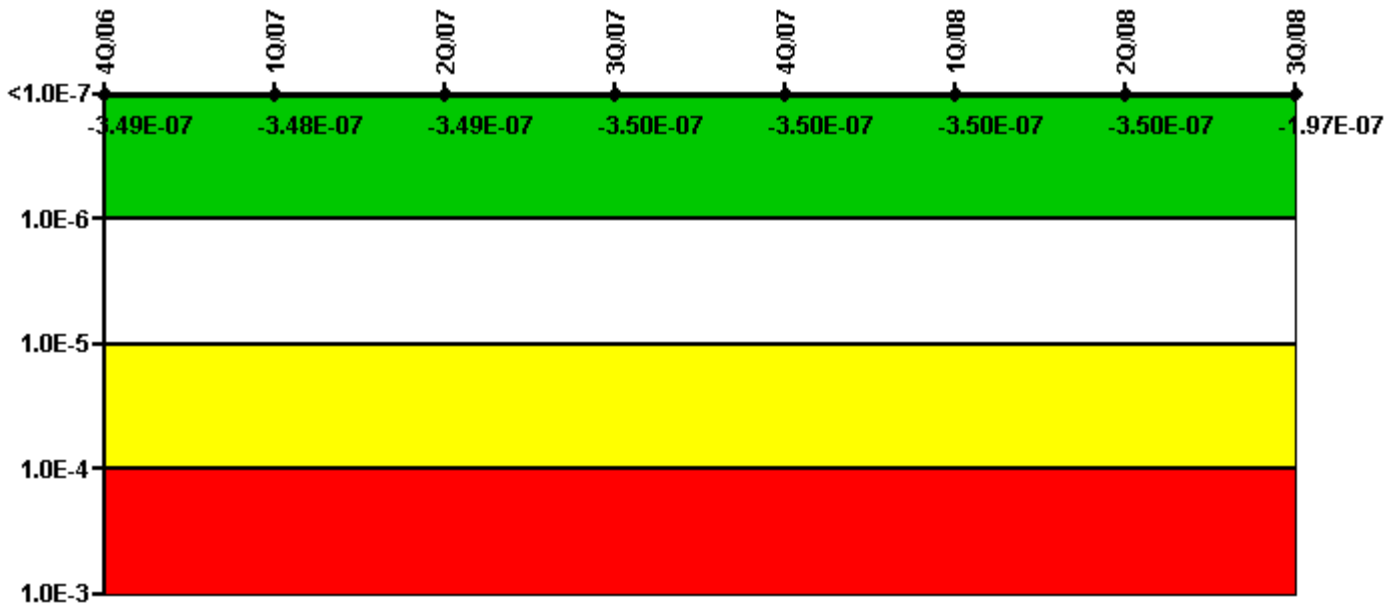

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	1.10E-09	2.30E-09	7.20E-10	1.30E-10	3.40E-10	3.40E-10	3.40E-10	3.30E-08
URI (Δ CDF)	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-2.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.49E-07	-3.48E-07	-3.49E-07	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-1.97E-07

Licensee Comments:

3Q/08: MSPI Basis Document updated to reflect 2007 PRA Model of Record. Added two new monitored components: 1SW-39 and 1SW-40.

Reactor Coolant System Activity

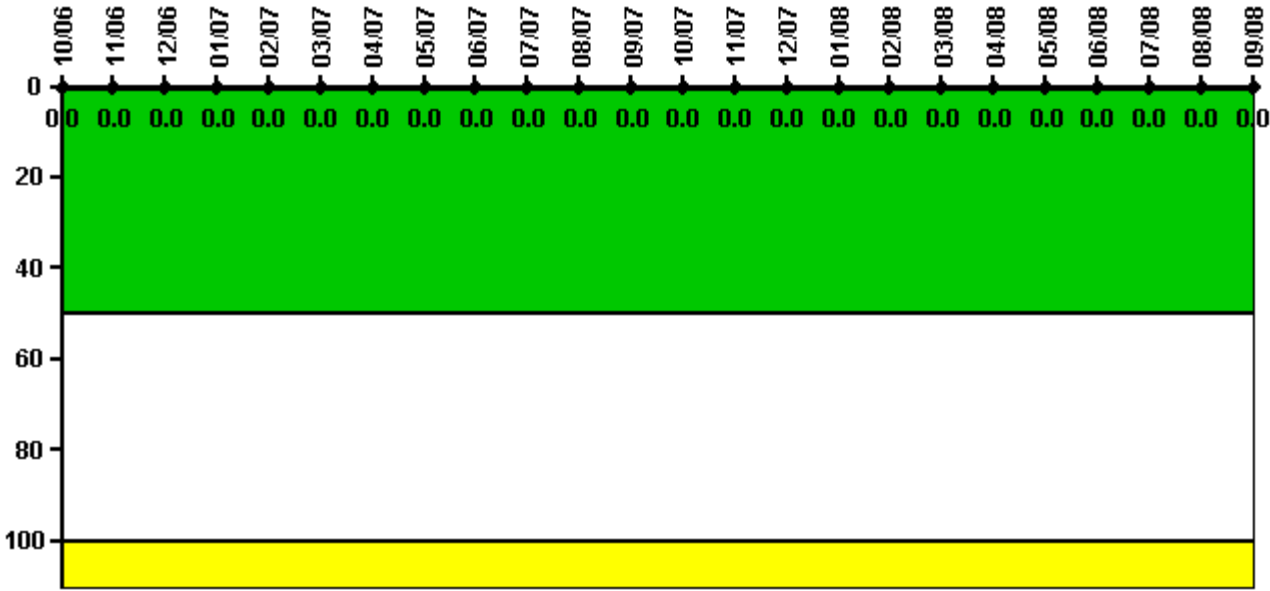


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum activity	0.000054	0.000057	0.000059	0.000064	0.000066	0.000067	0.000068	0.000123	0.000074	0.000077	0.000079	0.000116
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.000033	0.000041	0.000127	0.000045	0.000081	0.000054	0.000054	0.000056	0.000060	0.000061	0.000066	0.000068
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

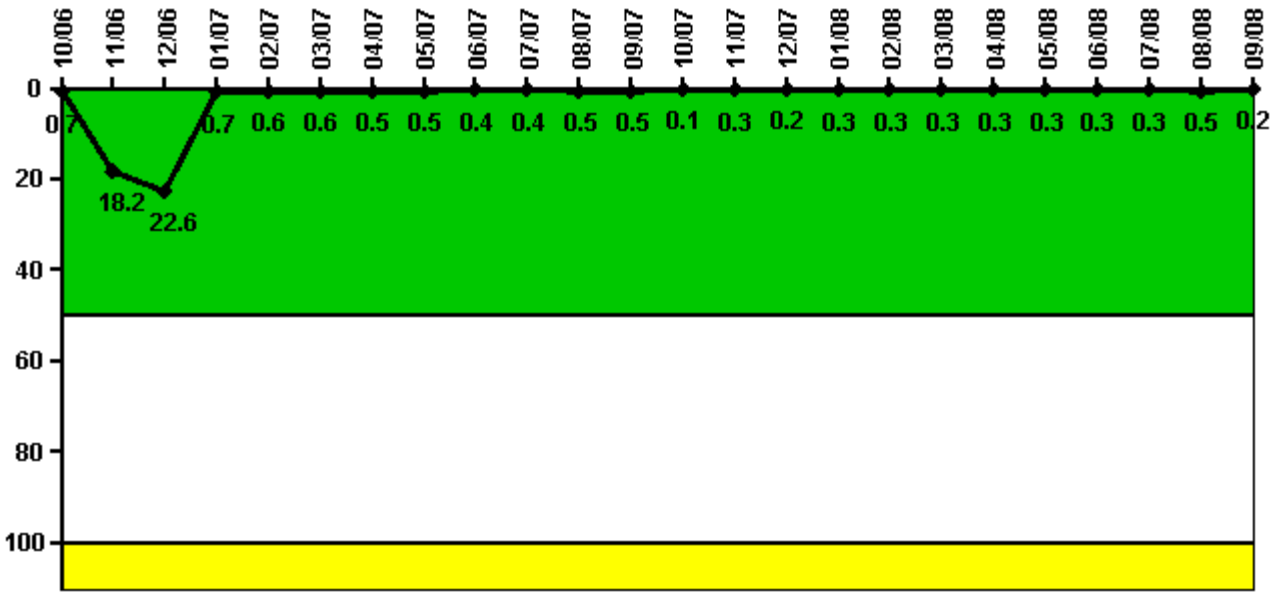


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum leakage	0.070	1.820	2.260	0.070	0.060	0.060	0.050	0.050	0.040	0.040	0.050	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.7	18.2	22.6	0.7	0.6	0.6	0.5	0.5	0.4	0.4	0.5	0.5
Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	0.010	0.030	0.020	0.030	0.030	0.030	0.030	0.030	0.030	0.030	0.050	0.020
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.1	0.3	0.2	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.5	0.2

Licensee Comments: none

Drill/Exercise Performance

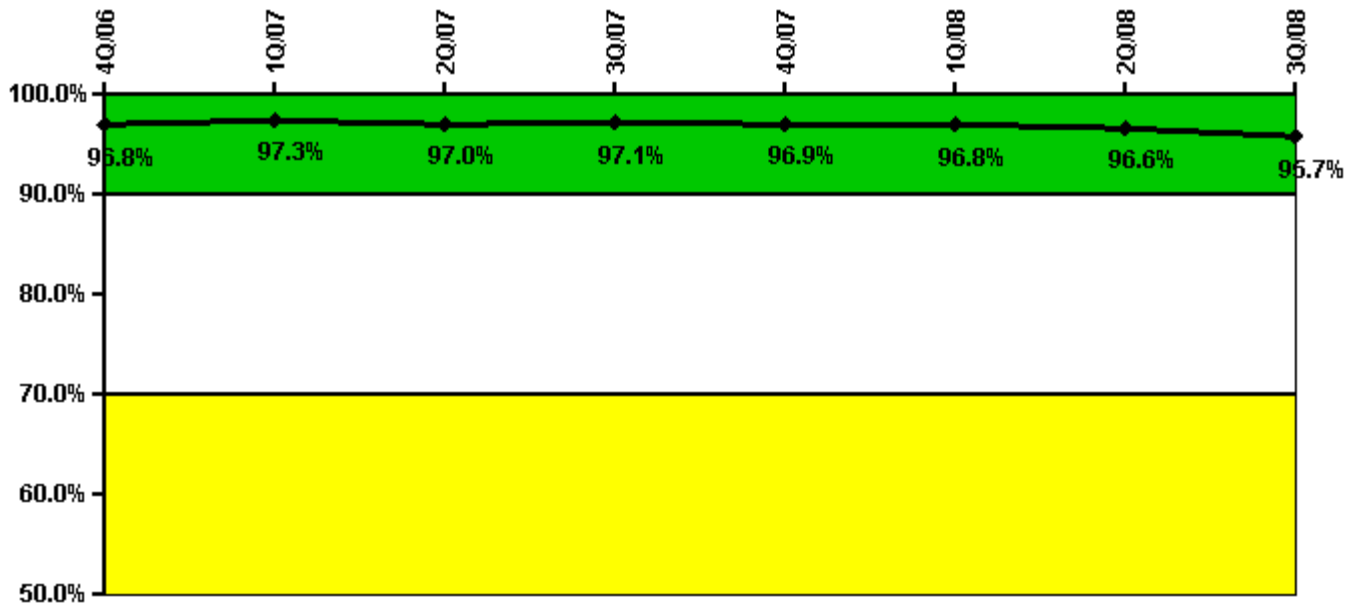


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful opportunities	13.0	20.0	38.0	9.0	21.0	6.0	31.0	17.0
Total opportunities	13.0	20.0	40.0	10.0	22.0	6.0	33.0	18.0
Indicator value	96.8%	97.3%	97.0%	97.1%	96.9%	96.8%	96.6%	95.7%

Licensee Comments: none

ERO Drill Participation

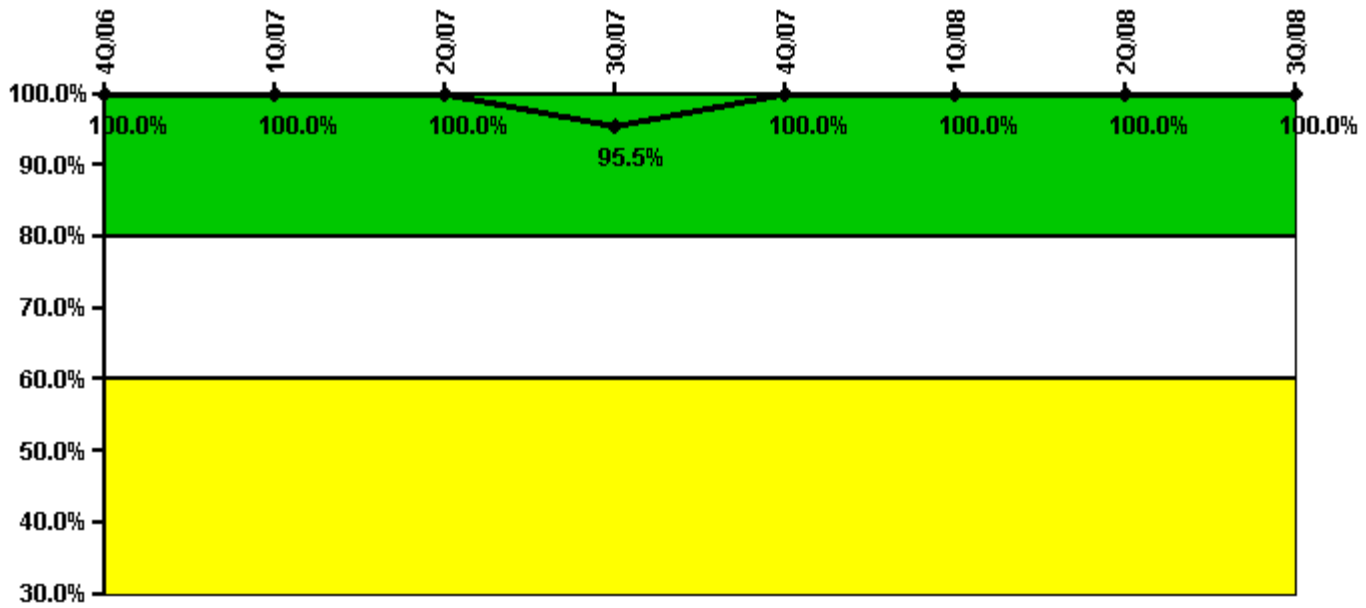


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Participating Key personnel	45.0	43.0	44.0	42.0	43.0	42.0	42.0	45.0
Total Key personnel	45.0	43.0	44.0	44.0	43.0	42.0	42.0	45.0
Indicator value	100.0%	100.0%	100.0%	95.5%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

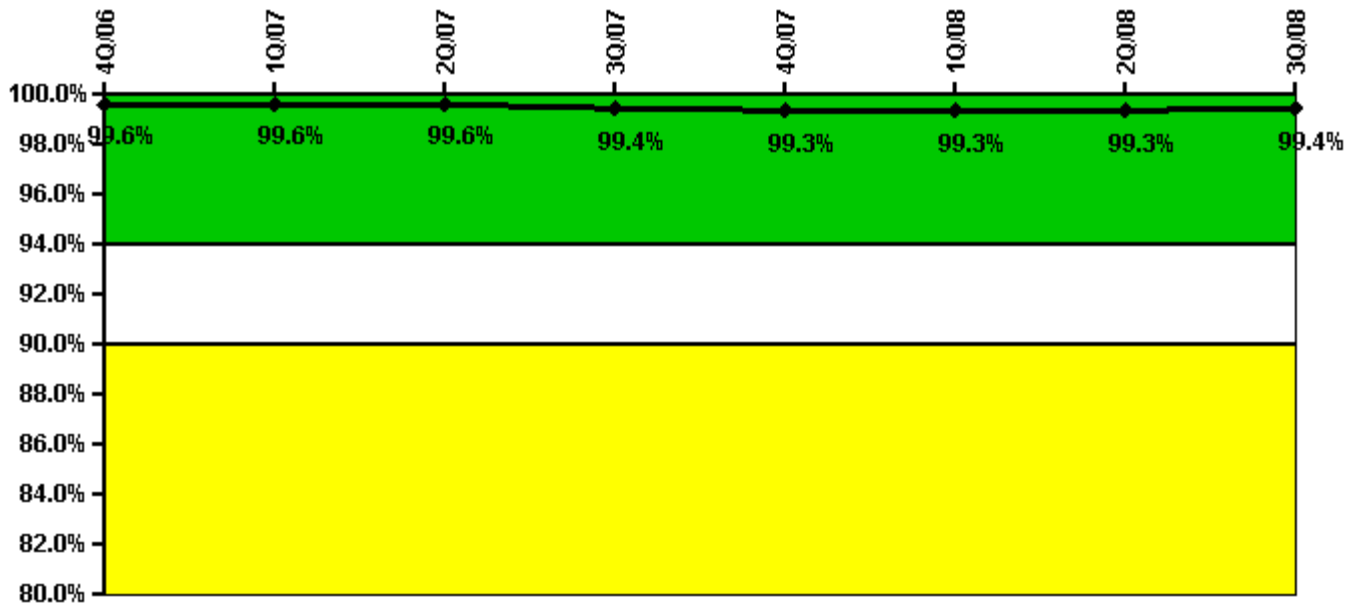


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful siren-tests	646	565	647	637	563	565	663	657
Total sirens-tests	648	567	648	648	567	567	664	664
Indicator value	99.6%	99.6%	99.6%	99.4%	99.3%	99.3%	99.3%	99.4%

Licensee Comments: none

Occupational Exposure Control Effectiveness

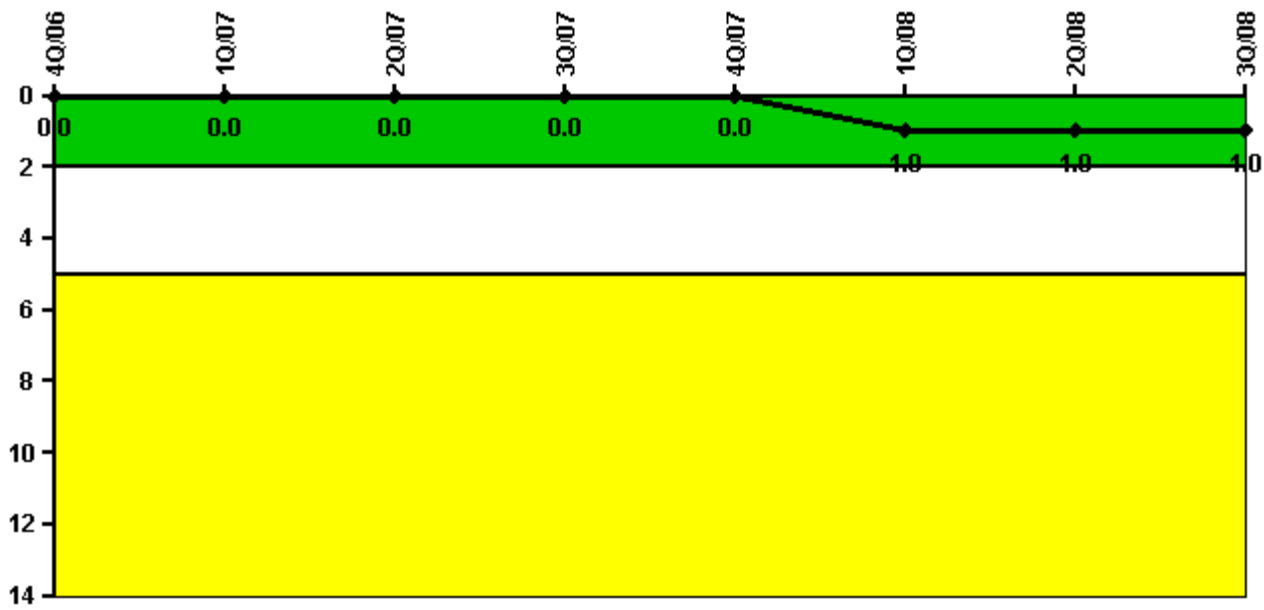

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
High radiation area occurrences	0	0	0	0	0	1	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.