


Perry 1

3Q/2008 Performance Indicators

Licensee's General Comments: The June 2008, Emergency Response Organization Drill Participation indicator, EP02, was corrected to credit a missed drill participant.

Unplanned Scrams per 7000 Critical Hrs

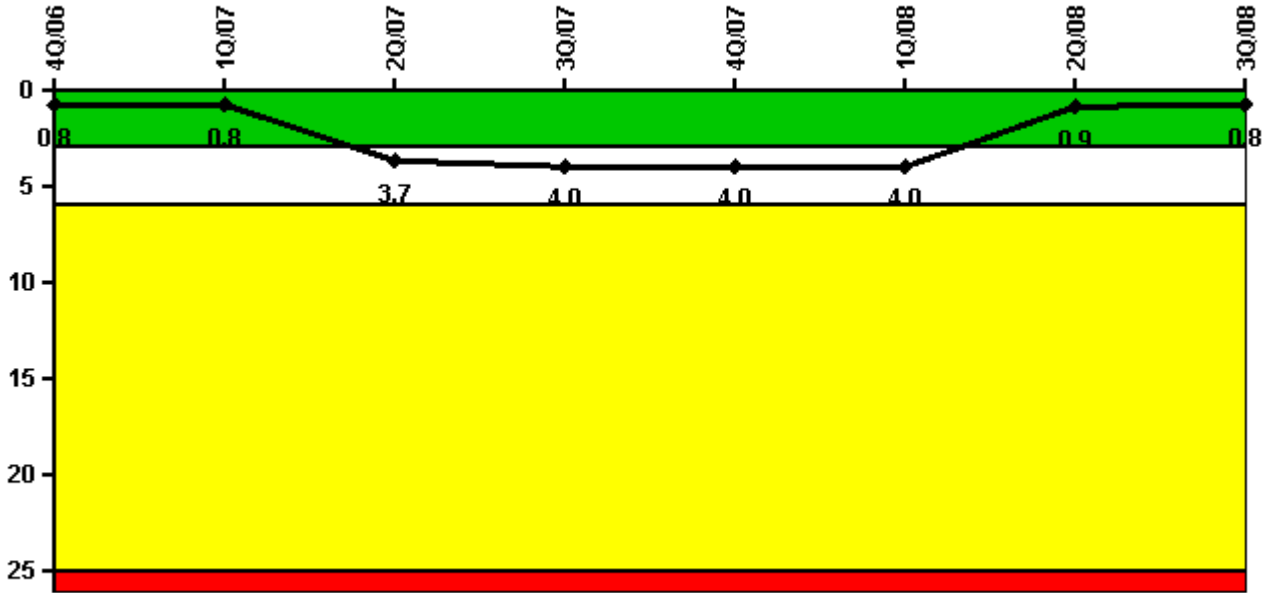


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned scrams	1.0	0	3.0	0	1.0	0	0	0
Critical hours	2080.3	2159.0	1106.2	1659.2	2000.8	2183.0	2000.9	2208.0
Indicator value	0.8	0.8	3.7	4.0	4.0	4.0	0.9	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

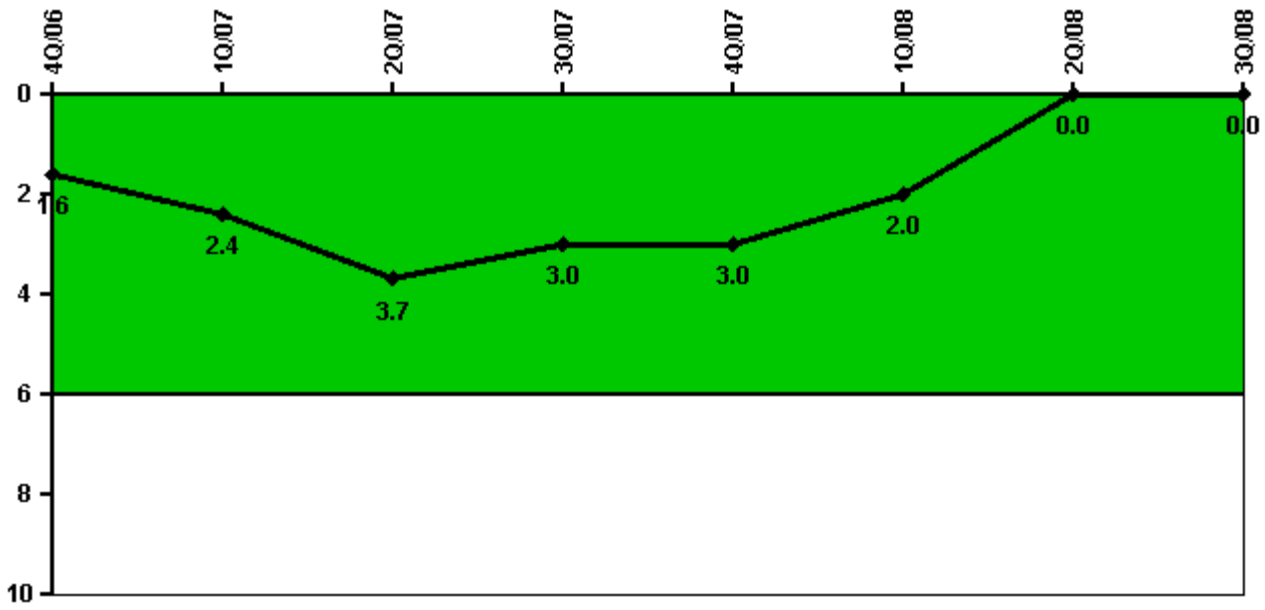


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned power changes	0	1.0	2.0	0	0	0	0	0
Critical hours	2080.3	2159.0	1106.2	1659.2	2000.8	2183.0	2000.9	2208.0
Indicator value	1.6	2.4	3.7	3.0	3.0	2.0	0	0

Licensee Comments: none

Unplanned Scrams with Complications

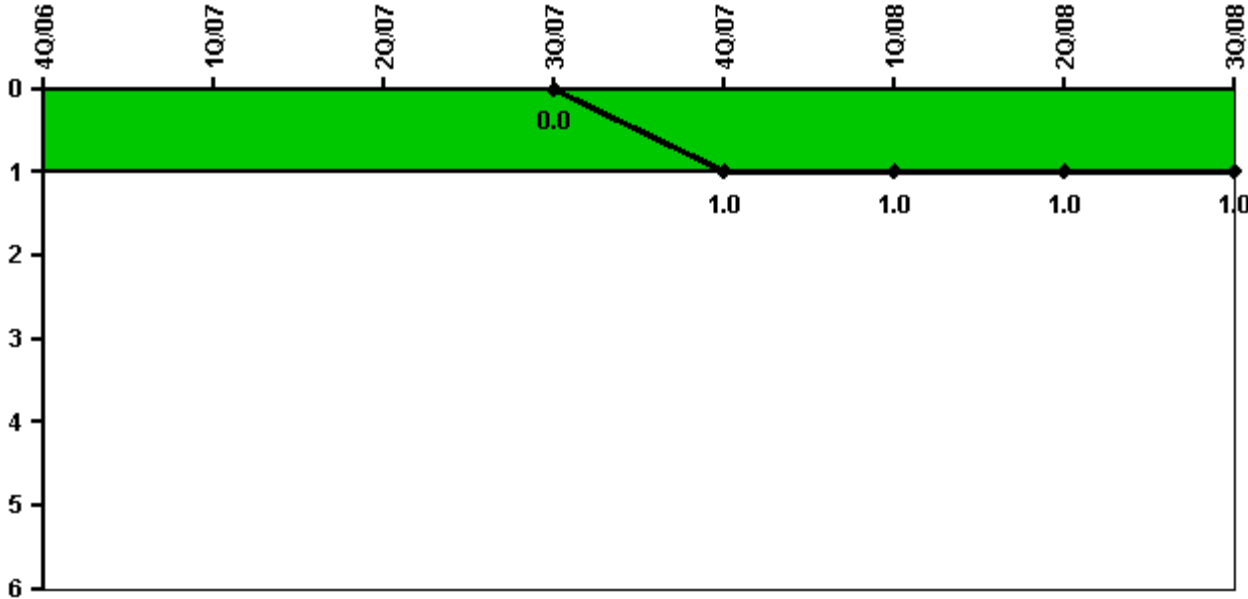


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Scrams with complications	0	0	0	0	1.0	0	0	0
Indicator value				0.0	1.0	1.0	1.0	1.0

Licensee Comments: none

Safety System Functional Failures (BWR)

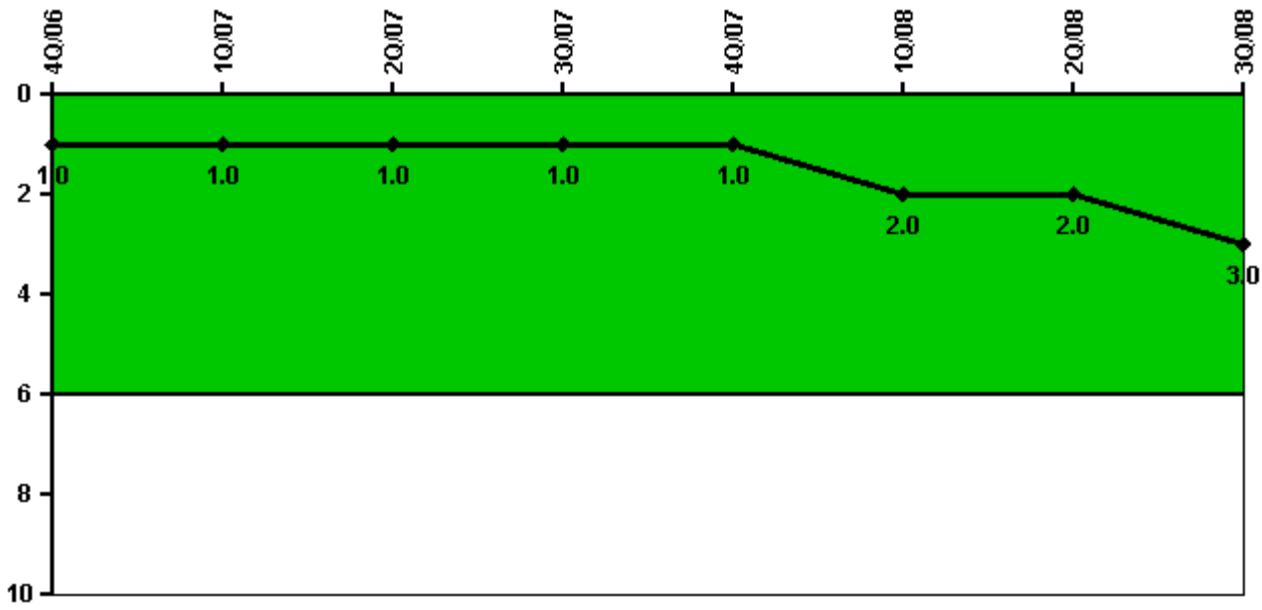

Thresholds: White > 6.0


Notes

Safety System Functional Failures (BWR)	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Safety System Functional Failures	1	0	0	0	1	1	0	1
Indicator value	1	1	1	1	1	2	2	3

Licensee Comments:

3Q/08: LER 2008-003

Mitigating Systems Performance Index, Emergency AC Power System

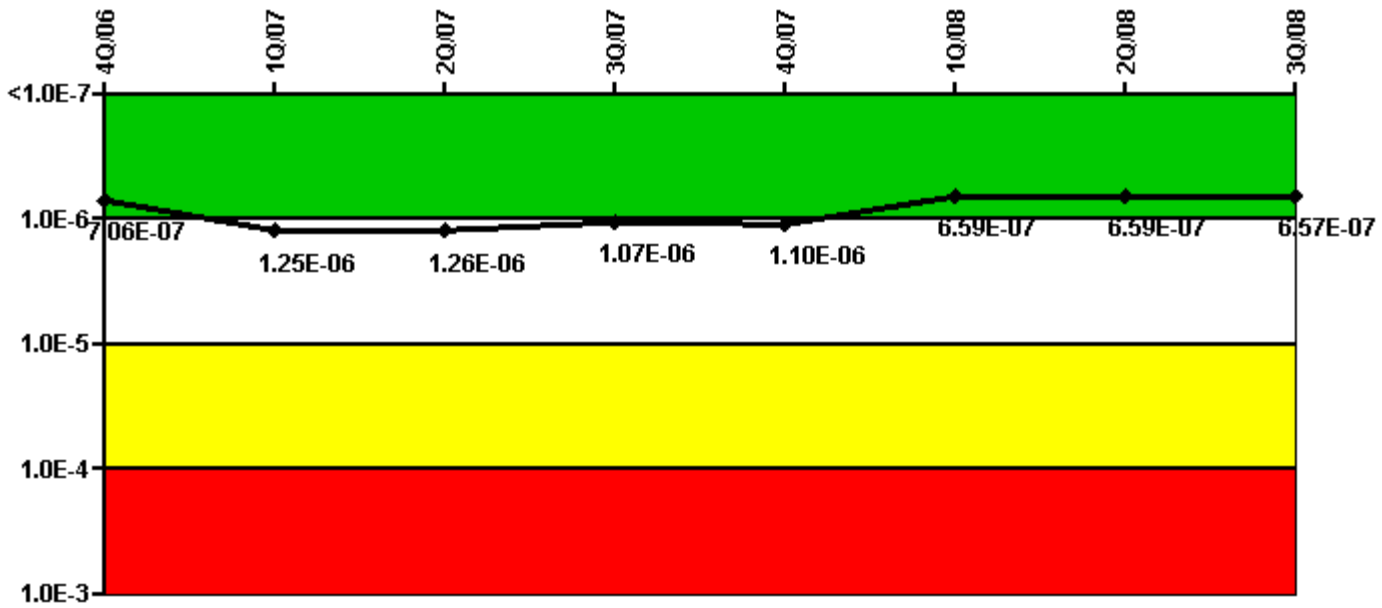

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	5.60E-08	4.90E-08	5.80E-08	7.00E-08	9.80E-08	4.90E-08	4.90E-08	4.70E-08
URI (Δ CDF)	6.50E-07	1.20E-06	1.20E-06	1.00E-06	1.00E-06	6.10E-07	6.10E-07	6.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.06E-07	1.25E-06	1.26E-06	1.07E-06	1.10E-06	6.59E-07	6.59E-07	6.57E-07

Licensee Comments:

3Q/08: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

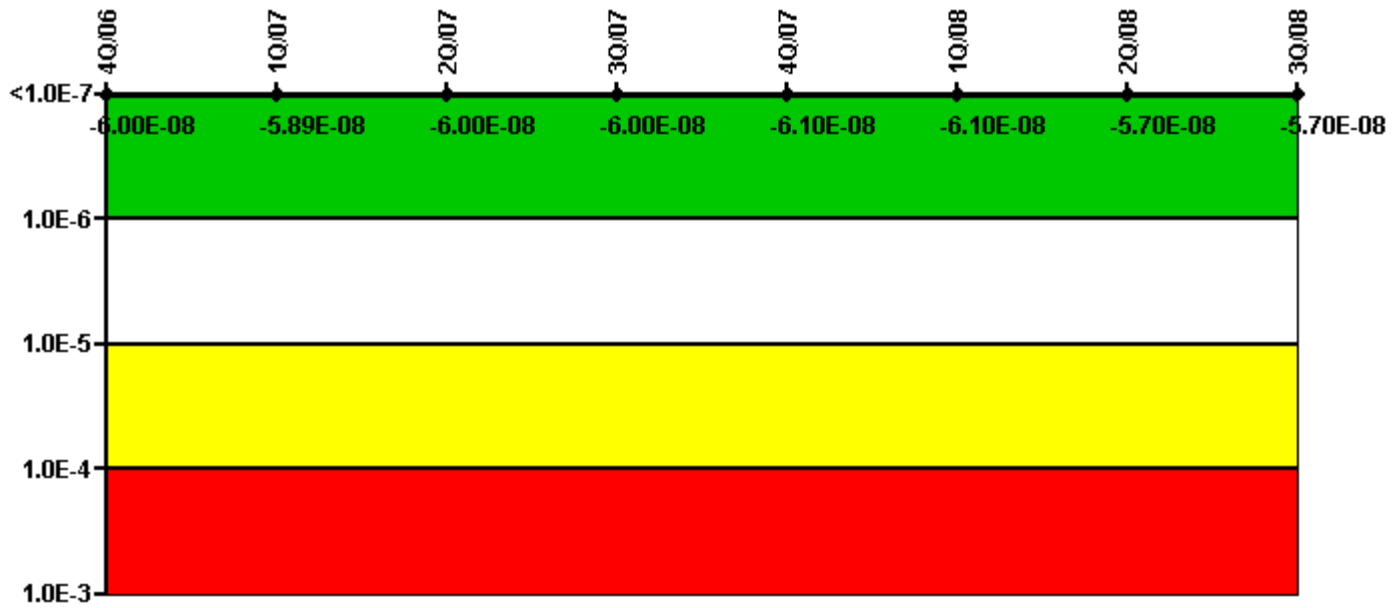


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-4.00E-09	-2.90E-09	-4.00E-09	-4.00E-09	-4.00E-09	-4.00E-09	1.20E-12	1.20E-12
URI (Δ CDF)	-5.60E-08	-5.60E-08	-5.60E-08	-5.60E-08	-5.70E-08	-5.70E-08	-5.70E-08	-5.70E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.00E-08	-5.89E-08	-6.00E-08	-6.00E-08	-6.10E-08	-6.10E-08	-5.70E-08	-5.70E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

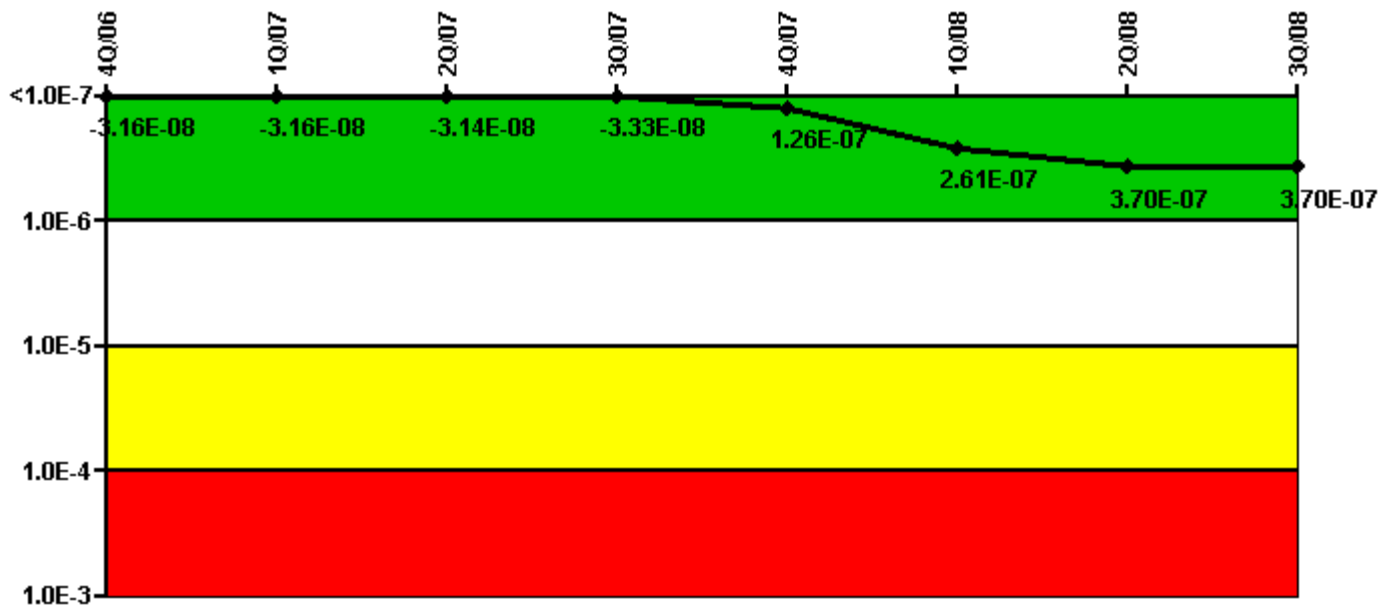


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-3.60E-09	-3.60E-09	-3.40E-09	-5.30E-09	3.80E-08	5.10E-08	5.00E-08	5.00E-08
URI (Δ CDF)	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	8.80E-08	2.10E-07	3.20E-07	3.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.16E-08	-3.16E-08	-3.14E-08	-3.33E-08	1.26E-07	2.61E-07	3.70E-07	3.70E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

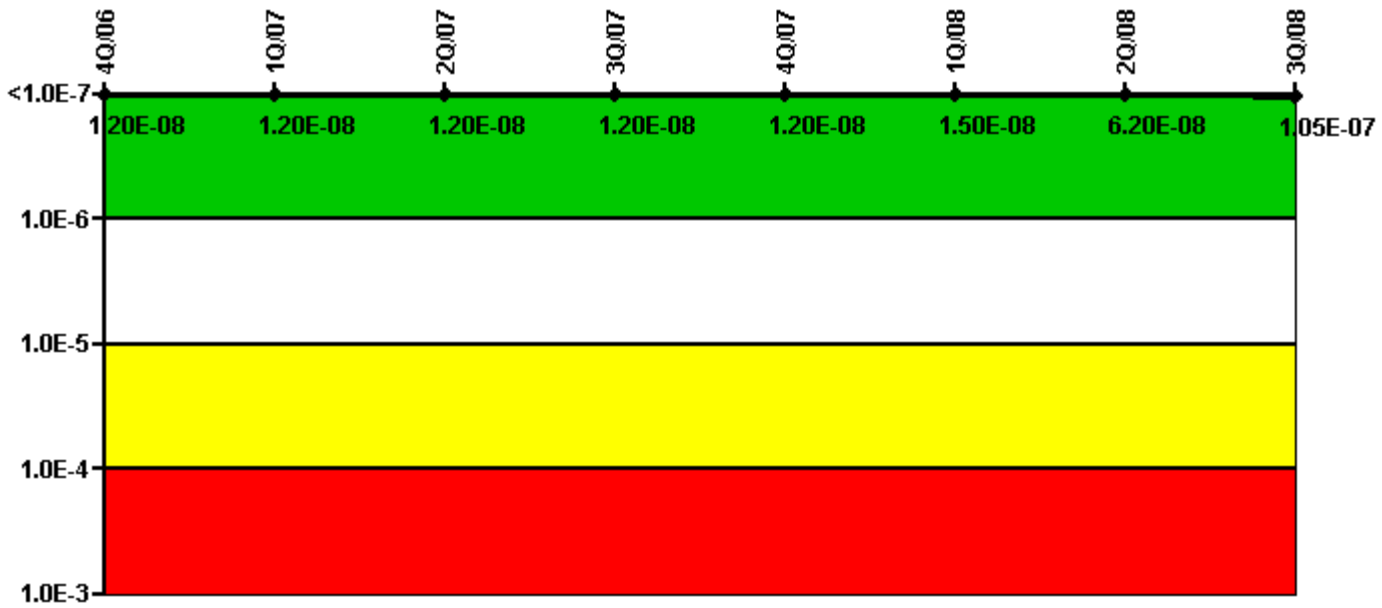


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-7.10E-08	-7.10E-08	-7.10E-08	-7.10E-08	-7.10E-08	-6.80E-08	-2.10E-08	2.20E-08
URI (Δ CDF)	8.30E-08	8.30E-08	8.30E-08	8.30E-08	8.30E-08	8.30E-08	8.30E-08	8.30E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.20E-08	1.20E-08	1.20E-08	1.20E-08	1.20E-08	1.50E-08	6.20E-08	1.05E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

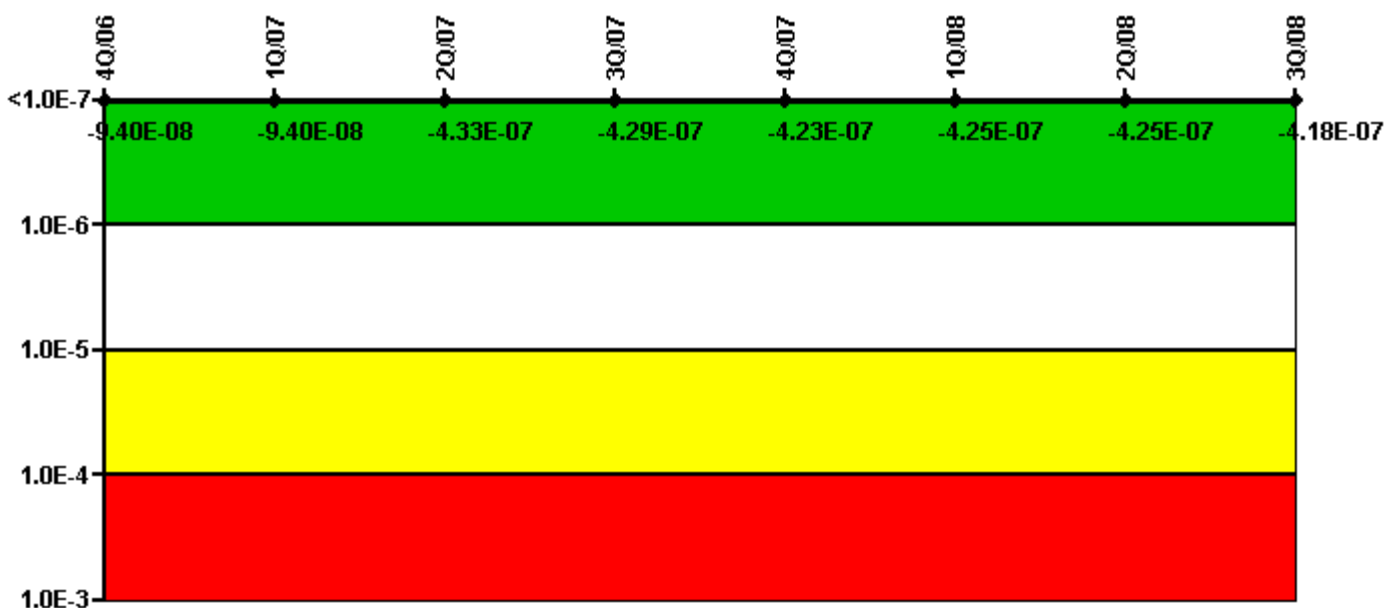


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (ΔCDF)	-5.80E-08	-5.80E-08	-8.30E-08	-7.90E-08	-7.30E-08	-7.50E-08	-7.50E-08	-6.80E-08
URI (ΔCDF)	-3.60E-08	-3.60E-08	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07	-3.50E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-9.40E-08	-9.40E-08	-4.33E-07	-4.29E-07	-4.23E-07	-4.25E-07	-4.25E-07	-4.18E-07

Licensee Comments: none

Reactor Coolant System Activity

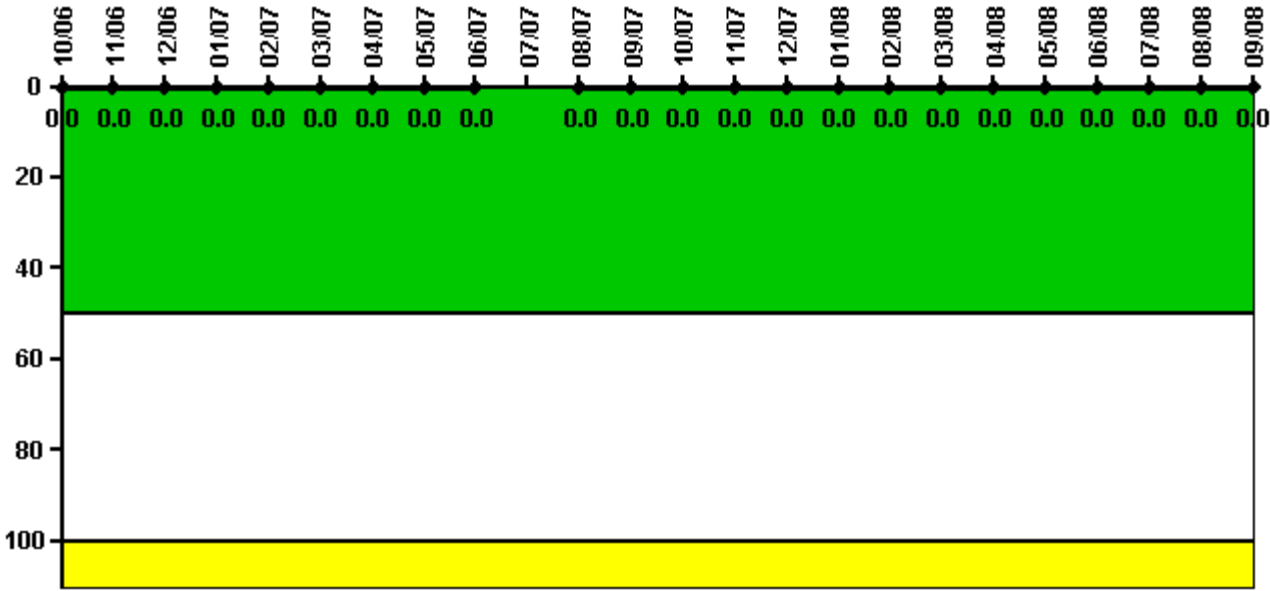

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum activity	0.000048	0.000035	0.000041	0.000047	0.000043	0.000046	0.000009	0.000016	0.000018	N/A	0.000014	0.000015
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	N/A	0	0

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.000016	0.000017	0.000017	0.000017	0.000018	0.000018	0.000024	0.000023	0.000023	0.000021	0.000022	0.000033
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

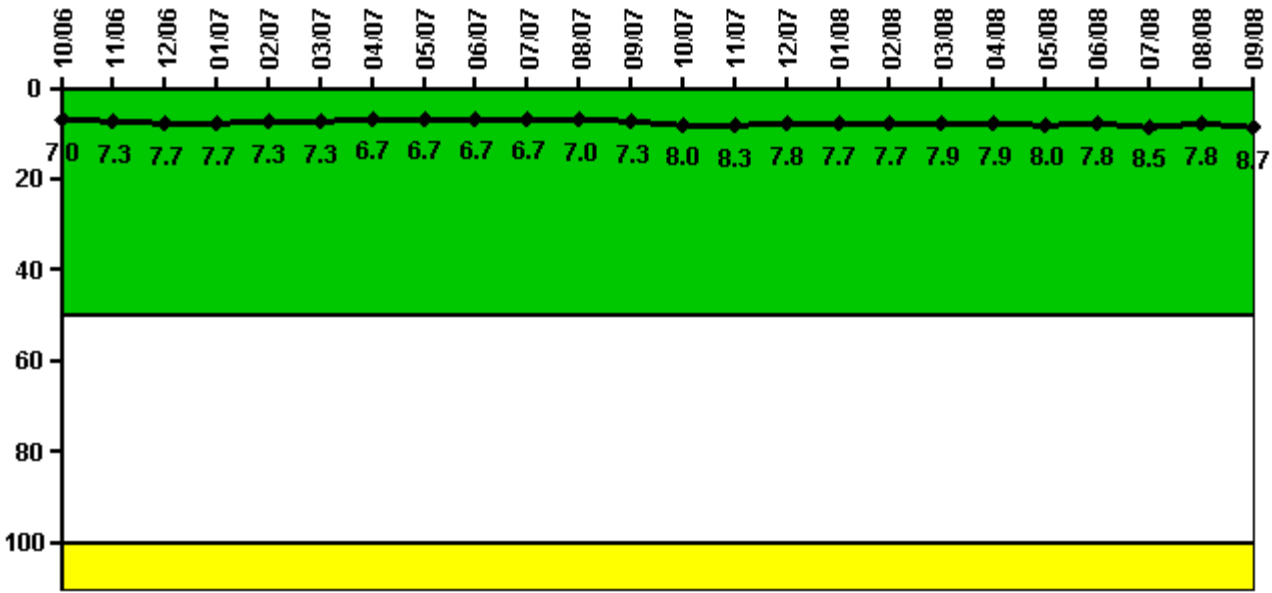


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum leakage	2.100	2.200	2.300	2.300	2.200	2.200	2.000	2.000	2.000	2.000	2.100	2.200
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	7.0	7.3	7.7	7.7	7.3	7.3	6.7	6.7	6.7	6.7	7.0	7.3
Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	2.400	2.500	2.340	2.320	2.310	2.380	2.370	2.410	2.340	2.540	2.350	2.620
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	8.0	8.3	7.8	7.7	7.7	7.9	7.9	8.0	7.8	8.5	7.8	8.7

Licensee Comments: none

Drill/Exercise Performance

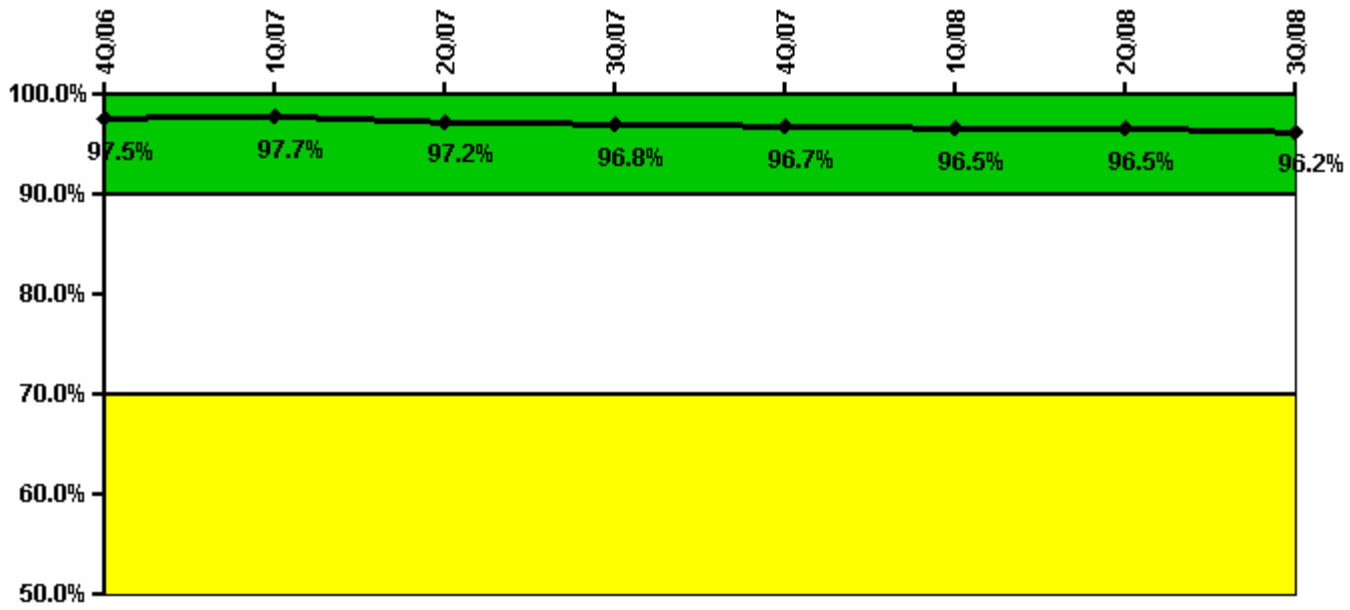


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful opportunities	54.0	10.0	19.0	11.0	36.0	16.0	22.0	36.0
Total opportunities	56.0	10.0	20.0	12.0	37.0	16.0	22.0	39.0
Indicator value	97.5%	97.7%	97.2%	96.8%	96.7%	96.5%	96.5%	96.2%

Licensee Comments: none

ERO Drill Participation

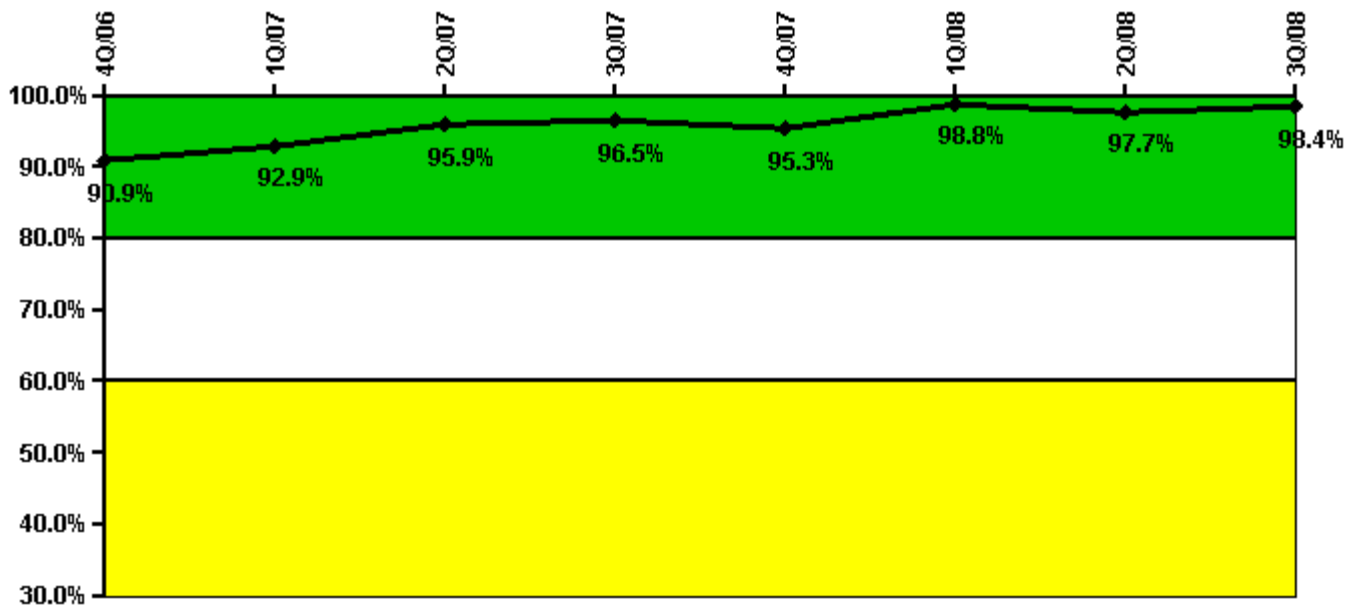


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Participating Key personnel	149.0	157.0	162.0	166.0	161.0	168.0	172.0	181.0
Total Key personnel	164.0	169.0	169.0	172.0	169.0	170.0	176.0	184.0
Indicator value	90.9%	92.9%	95.9%	96.5%	95.3%	98.8%	97.7%	98.4%

Licensee Comments: none

Alert & Notification System

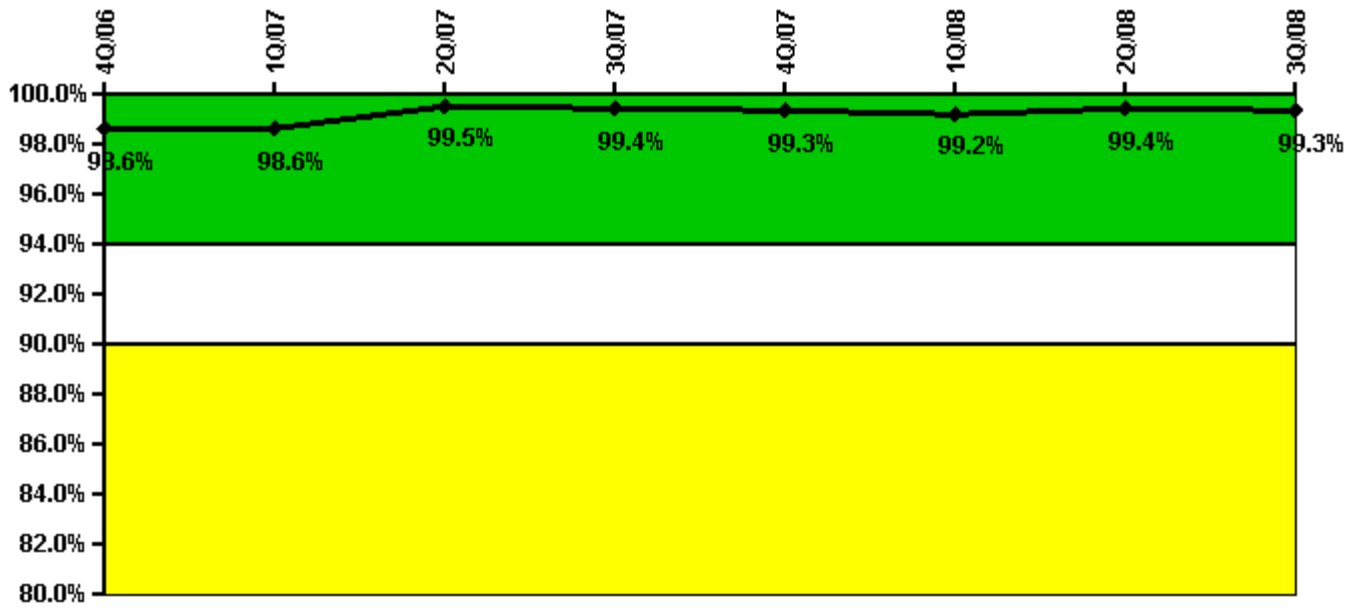


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful siren-tests	531	528	527	529	530	601	456	602
Total sirens-tests	532	532	532	532	532	608	456	608
Indicator value	98.6%	98.6%	99.5%	99.4%	99.3%	99.2%	99.4%	99.3%

Licensee Comments: none

Occupational Exposure Control Effectiveness

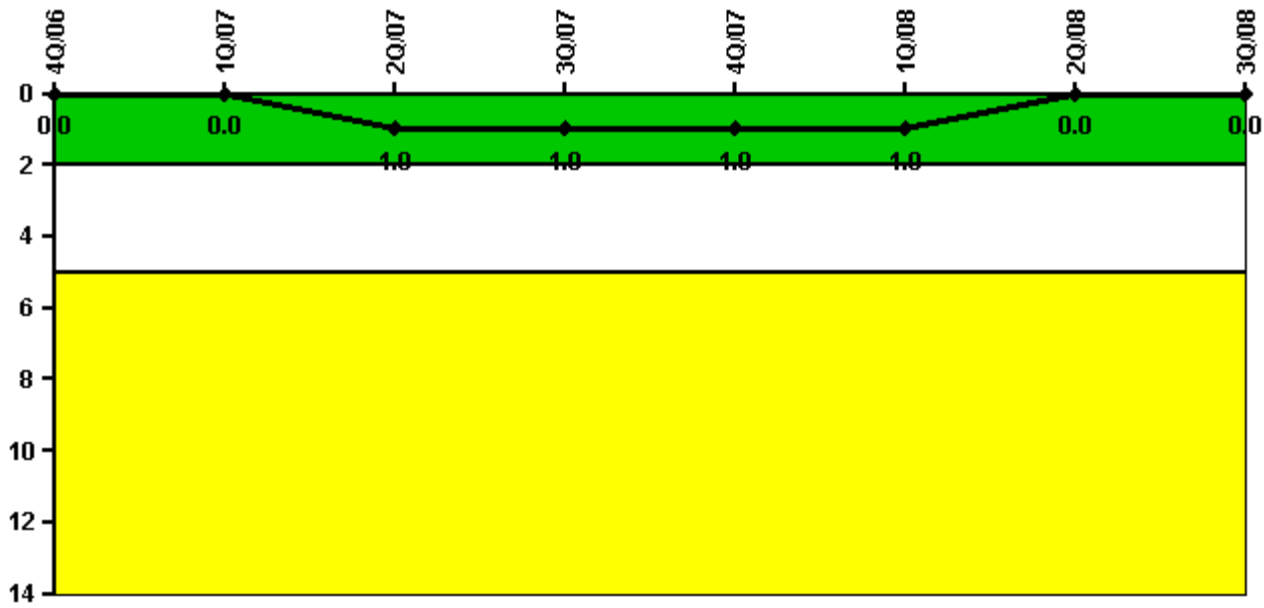

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
High radiation area occurrences	0	0	1	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	1	1	1	1	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.