


South Texas 1

3Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

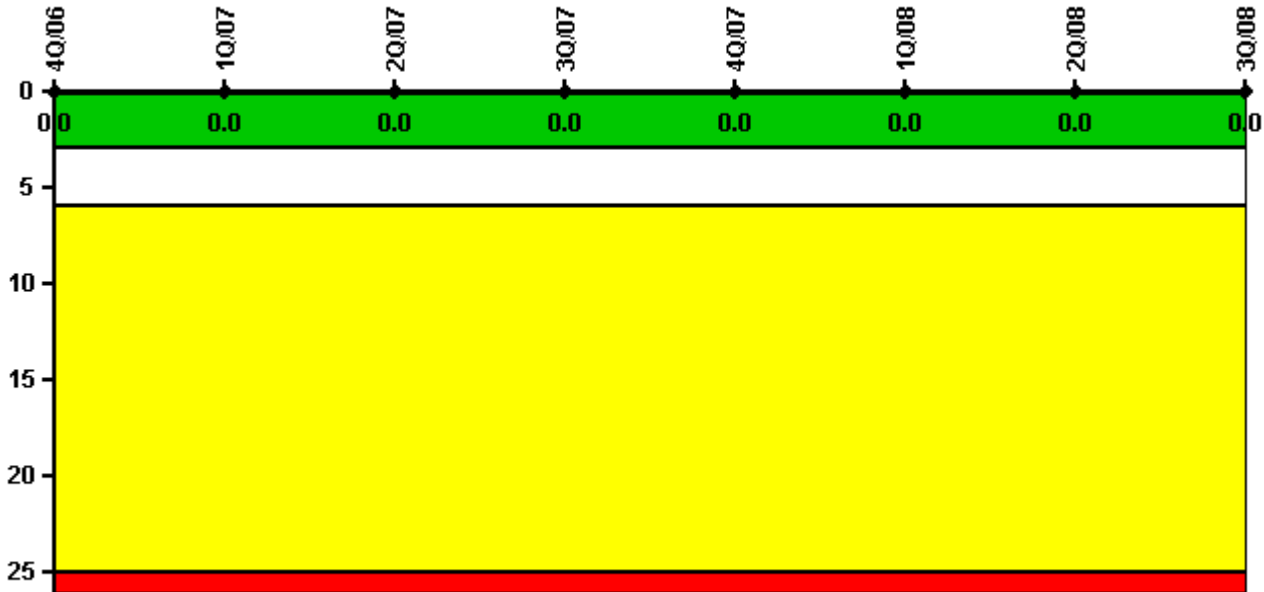


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 1411.8 | 2159.0 | 2184.0 | 2208.0 | 2209.0 | 2134.1 | 1594.6 | 2208.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

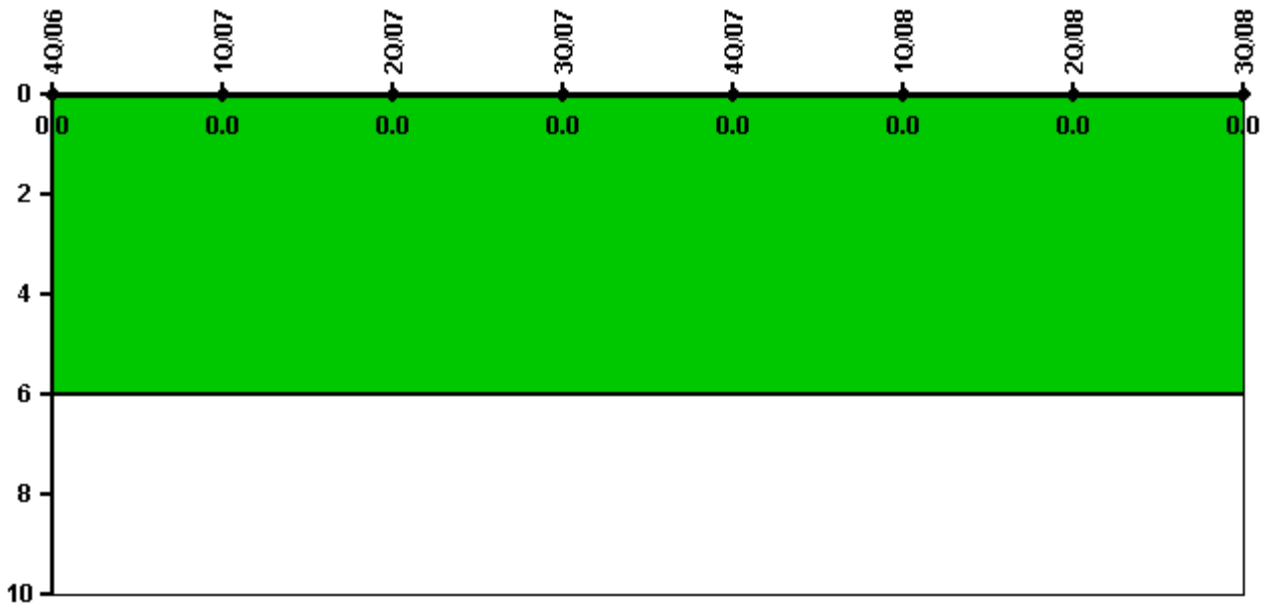

Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Critical hours | 1411.8 | 2159.0 | 2184.0 | 2208.0 | 2209.0 | 2134.1 | 1594.6 | 2208.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|-------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | | | | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (PWR)

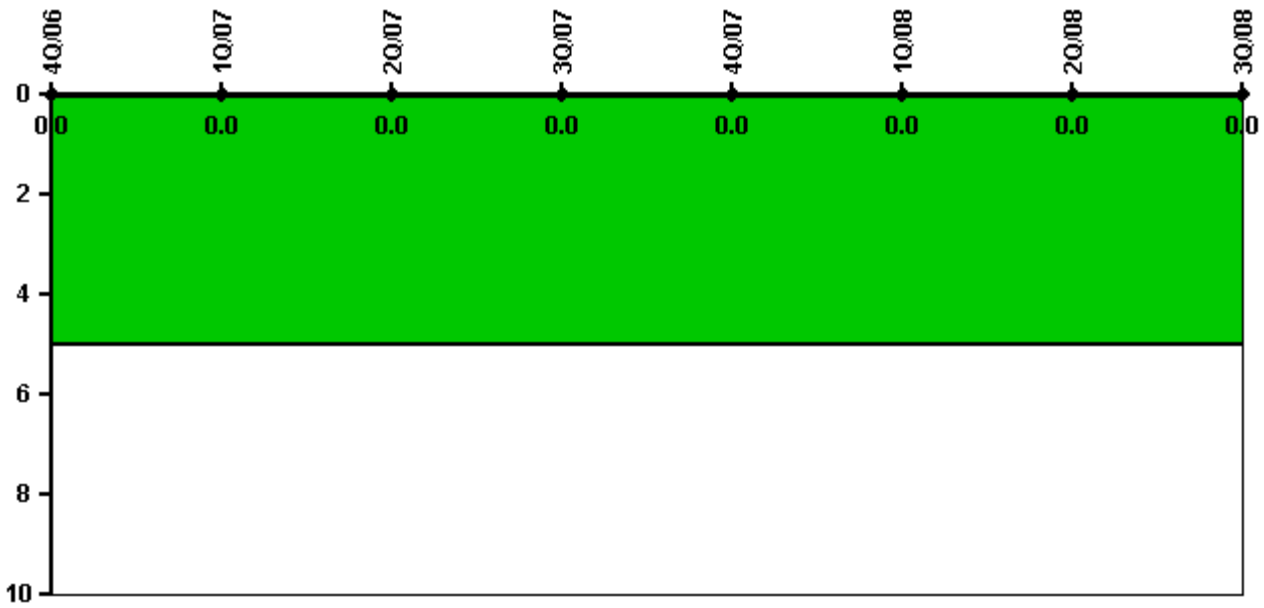


Thresholds: White > 5.0

Notes

| Safety System Functional Failures (PWR) | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

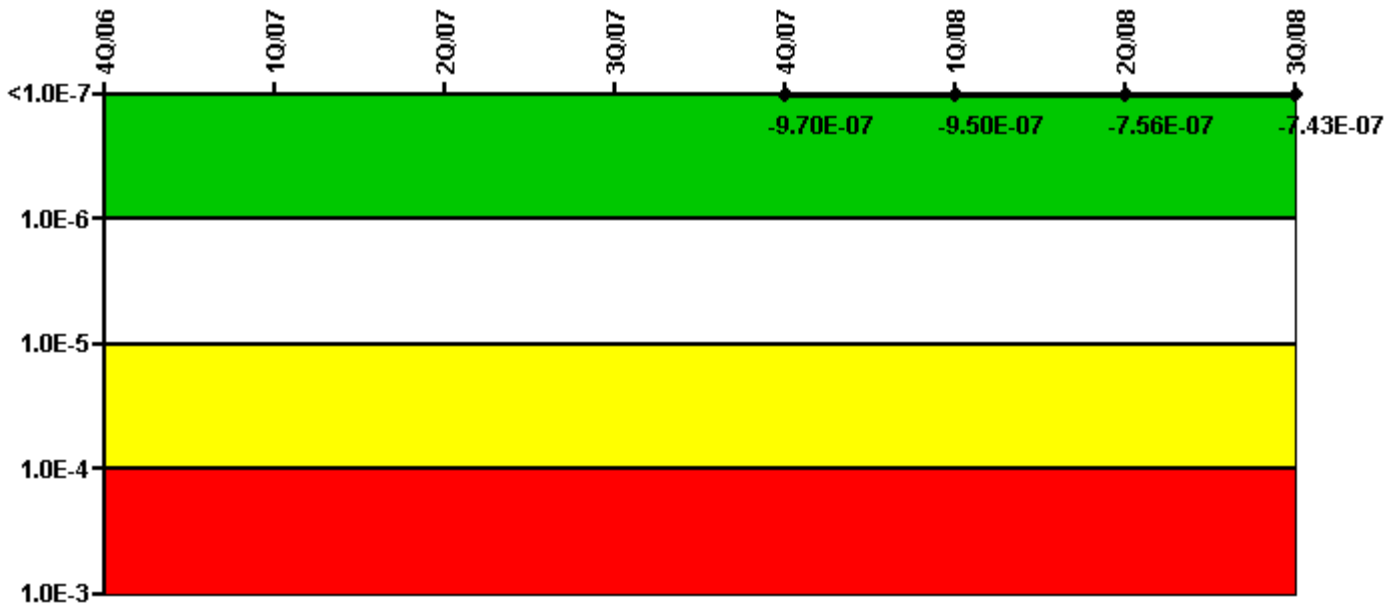

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-----------|----------|----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.60E-07 | 1.30E-07 | 5.50E-08 | -2.20E-07 | -2.30E-07 | -2.30E-07 | -4.60E-08 | -4.30E-08 |
| URI (Δ CDF) | | | | | -7.40E-07 | -7.20E-07 | -7.10E-07 | -7.00E-07 |
| PLE | N/A | N/A | N/A | N/A | NO | NO | NO | NO |
| Indicator value | | | | | -9.70E-07 | -9.50E-07 | -7.56E-07 | -7.43E-07 |

Licensee Comments:

3Q/08: Change notices created due to deletion of 3Q151MDG0234-GEN in EPIX. Component information was re-entered to correct deletion.

Mitigating Systems Performance Index, High Pressure Injection System

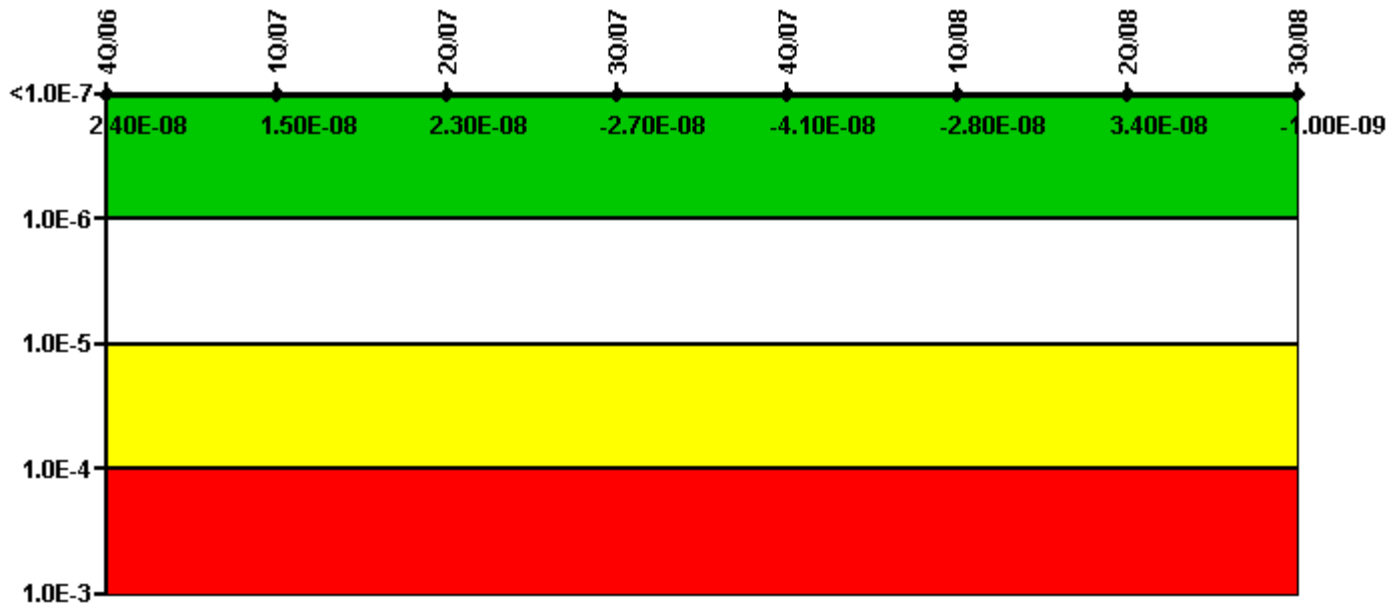


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 3.80E-08 | 2.90E-08 | 3.70E-08 | -1.30E-08 | -2.70E-08 | -1.40E-08 | 4.80E-08 | 1.30E-08 |
| URI (Δ CDF) | -1.40E-08 | -1.40E-08 | -1.40E-08 | -1.40E-08 | -1.40E-08 | -1.40E-08 | -1.40E-08 | -1.40E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 2.40E-08 | 1.50E-08 | 2.30E-08 | -2.70E-08 | -4.10E-08 | -2.80E-08 | 3.40E-08 | -1.00E-09 |

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

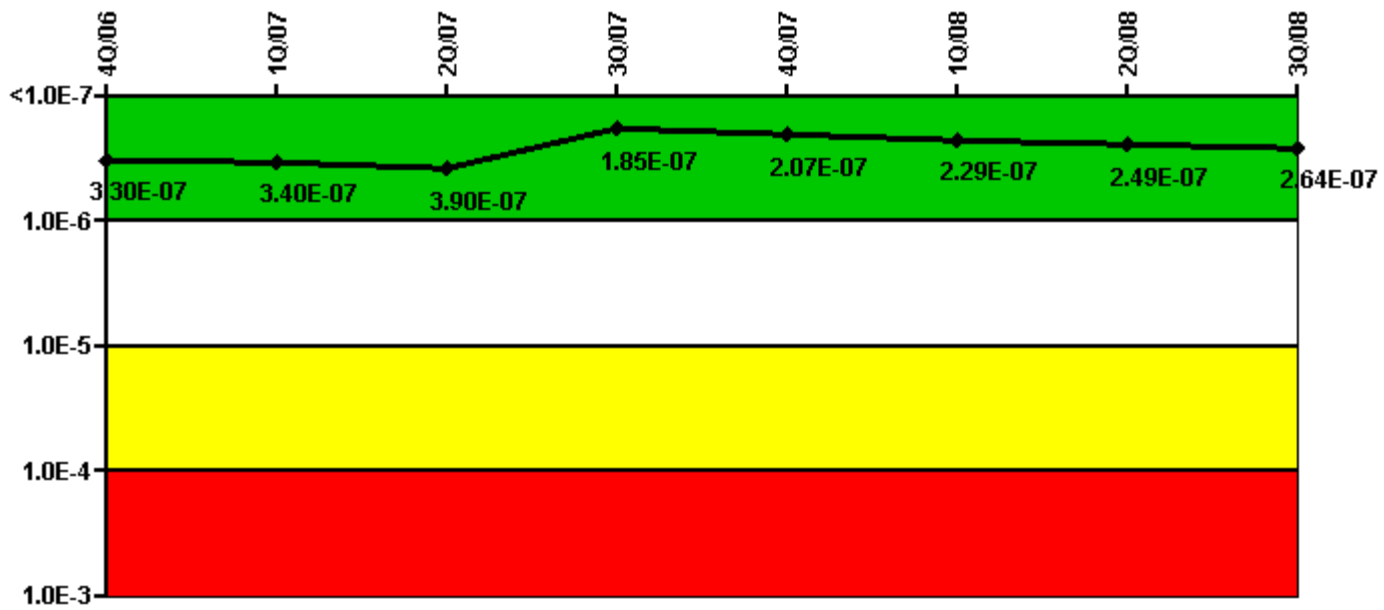


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Heat Removal System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| UAI (Δ CDF) | 1.60E-07 | 1.70E-07 | 2.20E-07 | 1.50E-08 | 3.70E-08 | 5.90E-08 | 7.90E-08 | 9.40E-08 |
| URI (Δ CDF) | 1.70E-07 | 1.70E-07 | 1.70E-07 | 1.70E-07 | 1.70E-07 | 1.70E-07 | 1.70E-07 | 1.70E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 3.30E-07 | 3.40E-07 | 3.90E-07 | 1.85E-07 | 2.07E-07 | 2.29E-07 | 2.49E-07 | 2.64E-07 |

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

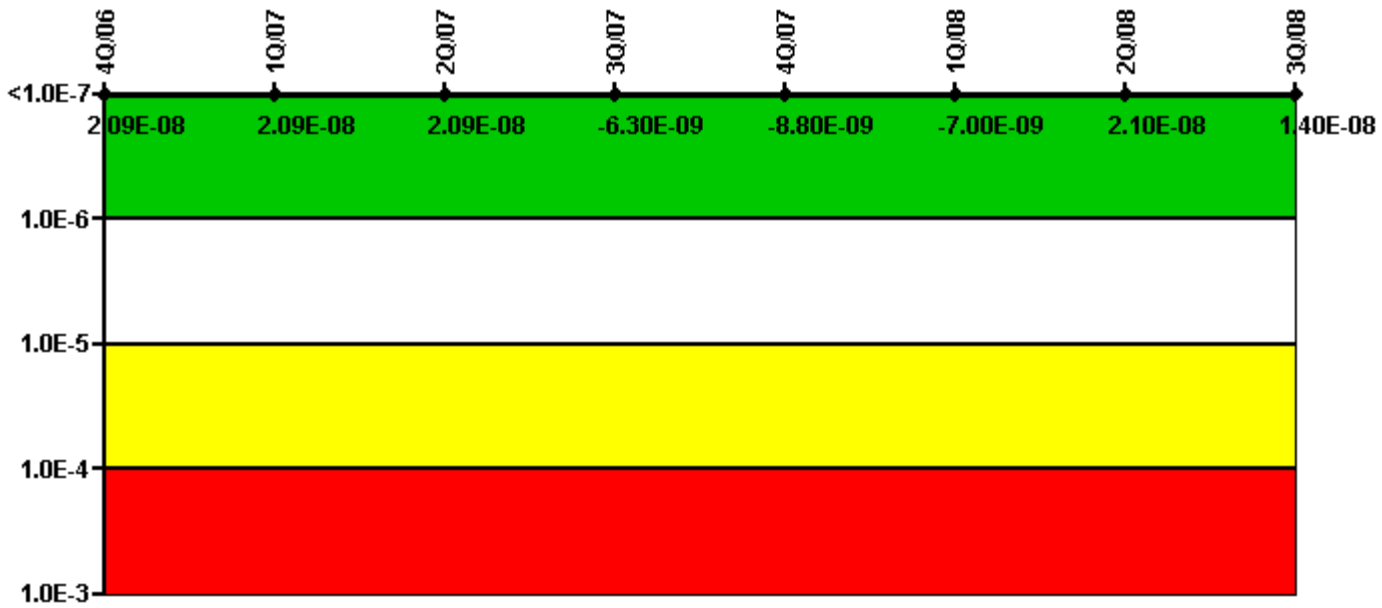


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | 2.40E-08 | 2.40E-08 | 2.40E-08 | -3.20E-09 | -5.70E-09 | -4.00E-09 | 2.40E-08 | 1.70E-08 |
| URI (Δ CDF) | -3.10E-09 | -3.10E-09 | -3.10E-09 | -3.10E-09 | -3.10E-09 | -3.00E-09 | -3.00E-09 | -3.00E-09 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 2.09E-08 | 2.09E-08 | 2.09E-08 | -6.30E-09 | -8.80E-09 | -7.00E-09 | 2.10E-08 | 1.40E-08 |

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

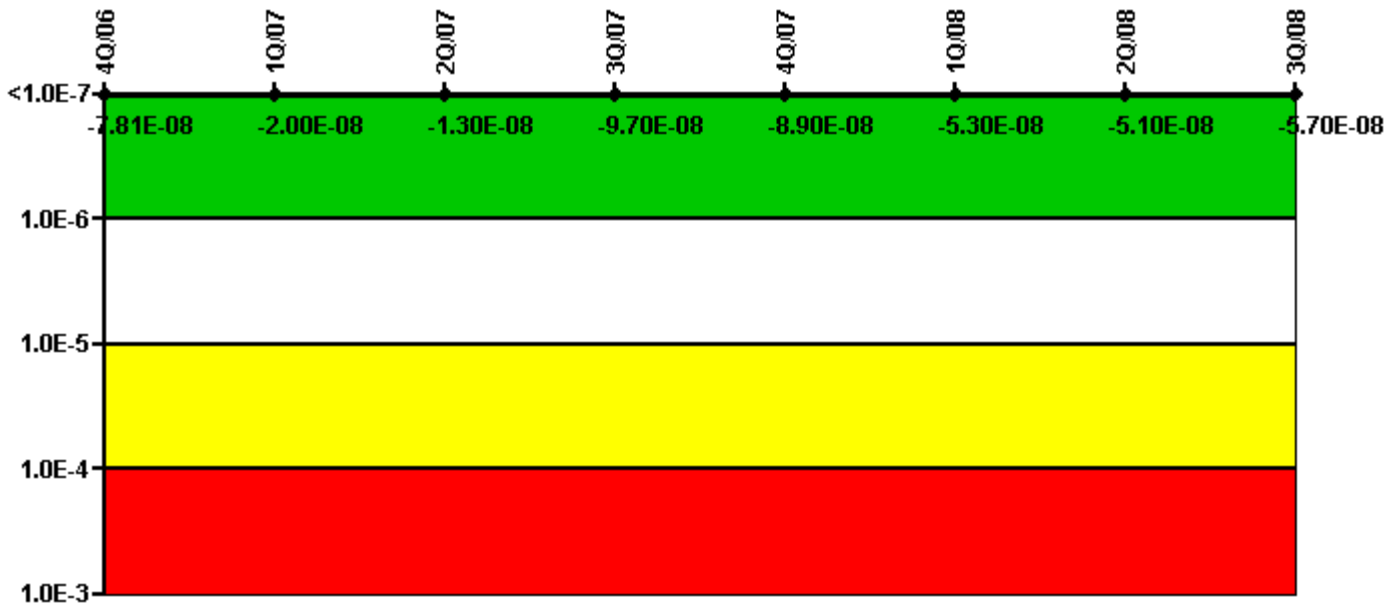


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -1.10E-09 | 5.70E-08 | 6.40E-08 | -2.00E-08 | -1.40E-08 | 2.10E-08 | 2.20E-08 | 1.40E-08 |
| URI (Δ CDF) | -7.70E-08 | -7.70E-08 | -7.70E-08 | -7.70E-08 | -7.50E-08 | -7.40E-08 | -7.30E-08 | -7.10E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -7.81E-08 | -2.00E-08 | -1.30E-08 | -9.70E-08 | -8.90E-08 | -5.30E-08 | -5.10E-08 | -5.70E-08 |

Licensee Comments: none

Reactor Coolant System Activity

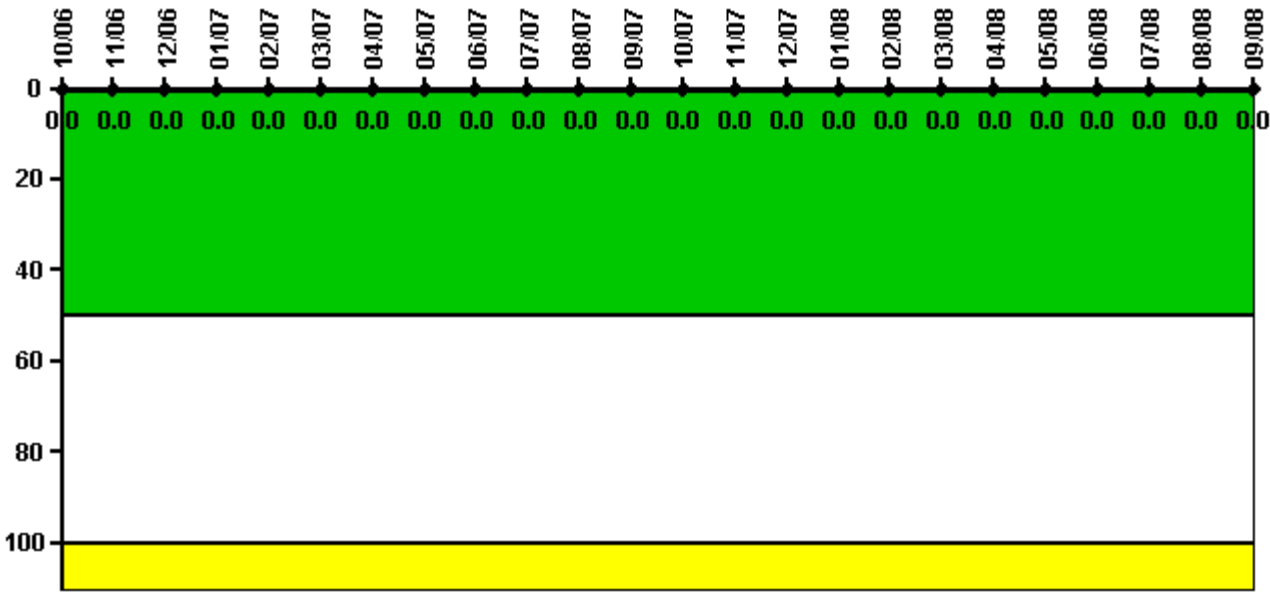

Thresholds: White > 50.0 Yellow > 100.0

Notes


| Reactor Coolant System Activity | 10/06 | 11/06 | 12/06 | 1/07 | 2/07 | 3/07 | 4/07 | 5/07 | 6/07 | 7/07 | 8/07 | 9/07 |
|---------------------------------|-------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0 | 0.000036 | 0.000037 | 0.000042 | 0.000042 | 0.000047 | 0.000042 | 0.000040 | 0.000049 | 0.000046 | 0.000047 | 0.000047 |
| Technical specification limit | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

| Reactor Coolant System Activity | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 |
|---------------------------------|----------|----------|----------|----------|----------|----------|------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000050 | 0.000051 | 0.000051 | 0.000051 | 0.000052 | 0.000050 | 0 | 0.000035 | 0.000032 | 0.000039 | 0.000041 | 0.000045 |
| Technical specification limit | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 | 1.0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments:

9/08: Corrected data for 4Q07 due to data entry error.

Reactor Coolant System Leakage

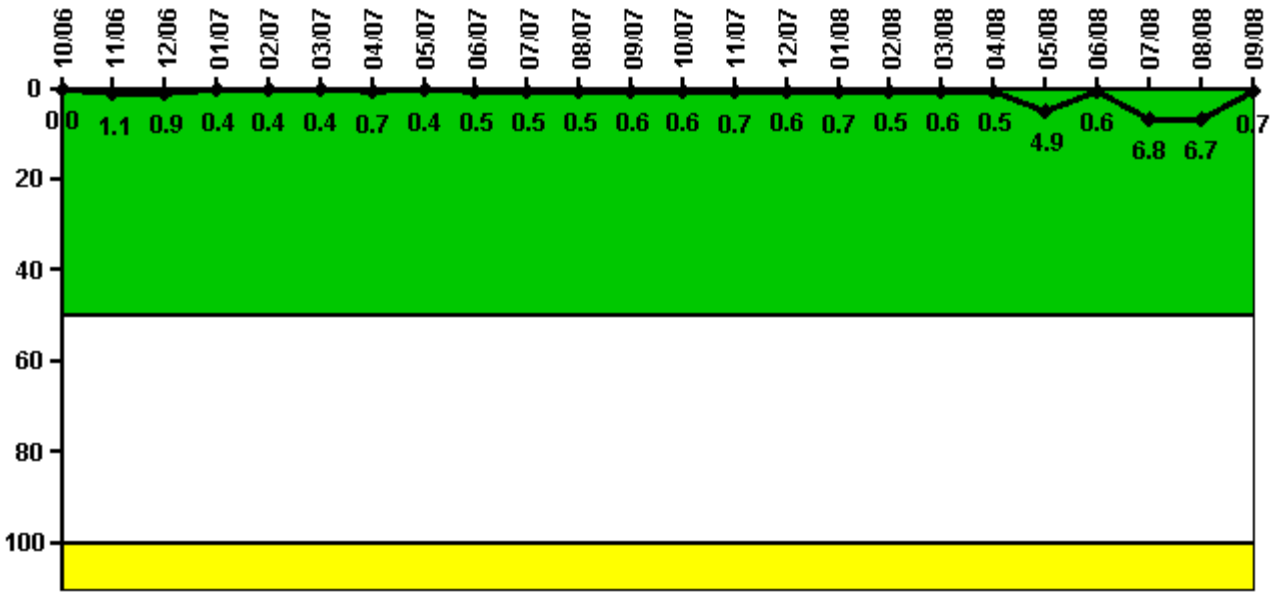


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Leakage | 10/06 | 11/06 | 12/06 | 1/07 | 2/07 | 3/07 | 4/07 | 5/07 | 6/07 | 7/07 | 8/07 | 9/07 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 0 | 0.114 | 0.093 | 0.042 | 0.041 | 0.043 | 0.065 | 0.043 | 0.052 | 0.047 | 0.053 | 0.056 |
| Technical specification limit | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 |
| Indicator value | 0 | 1.1 | 0.9 | 0.4 | 0.4 | 0.4 | 0.7 | 0.4 | 0.5 | 0.5 | 0.5 | 0.6 |
| Reactor Coolant System Leakage | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 |
| Maximum leakage | 0.058 | 0.069 | 0.061 | 0.074 | 0.052 | 0.056 | 0.045 | 0.494 | 0.060 | 0.677 | 0.674 | 0.069 |
| Technical specification limit | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 | 10.0 |
| Indicator value | 0.6 | 0.7 | 0.6 | 0.7 | 0.5 | 0.6 | 0.5 | 4.9 | 0.6 | 6.8 | 6.7 | 0.7 |

Licensee Comments: none

Drill/Exercise Performance

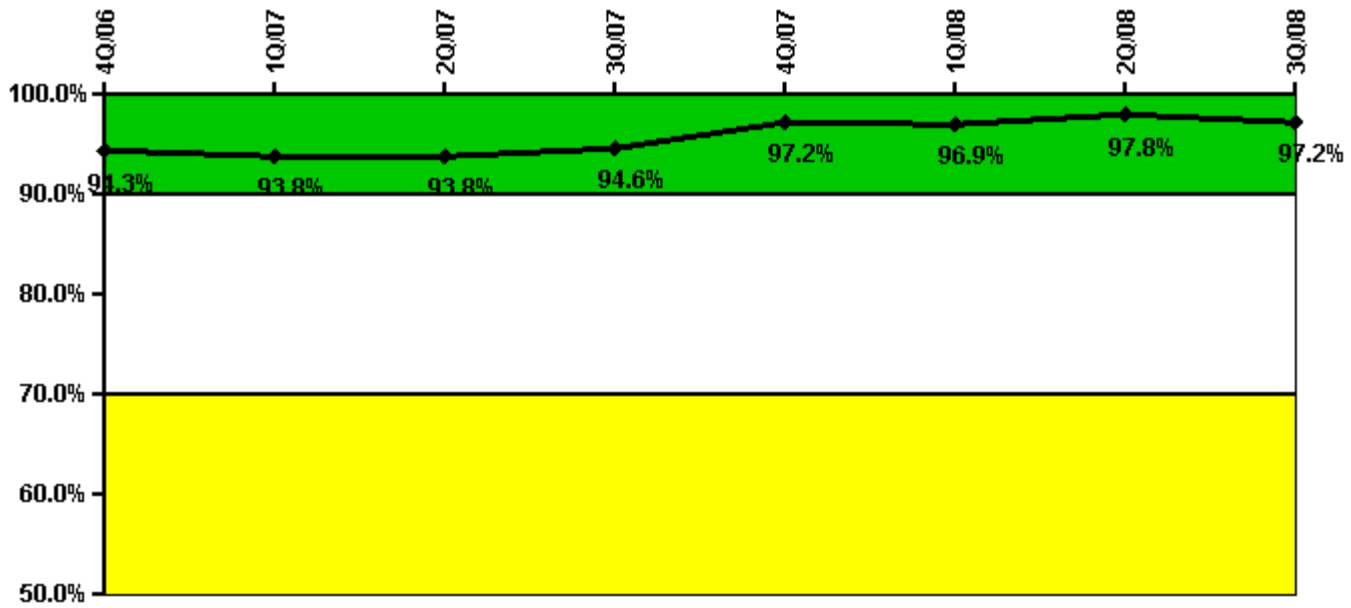


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 0 | 4.0 | 11.0 | 44.0 | 86.0 | 0 | 23.0 | 41.0 |
| Total opportunities | 0 | 6.0 | 12.0 | 44.0 | 86.0 | 0 | 23.0 | 44.0 |
| Indicator value | 94.3% | 93.8% | 93.8% | 94.6% | 97.2% | 96.9% | 97.8% | 97.2% |

Licensee Comments: none

ERO Drill Participation

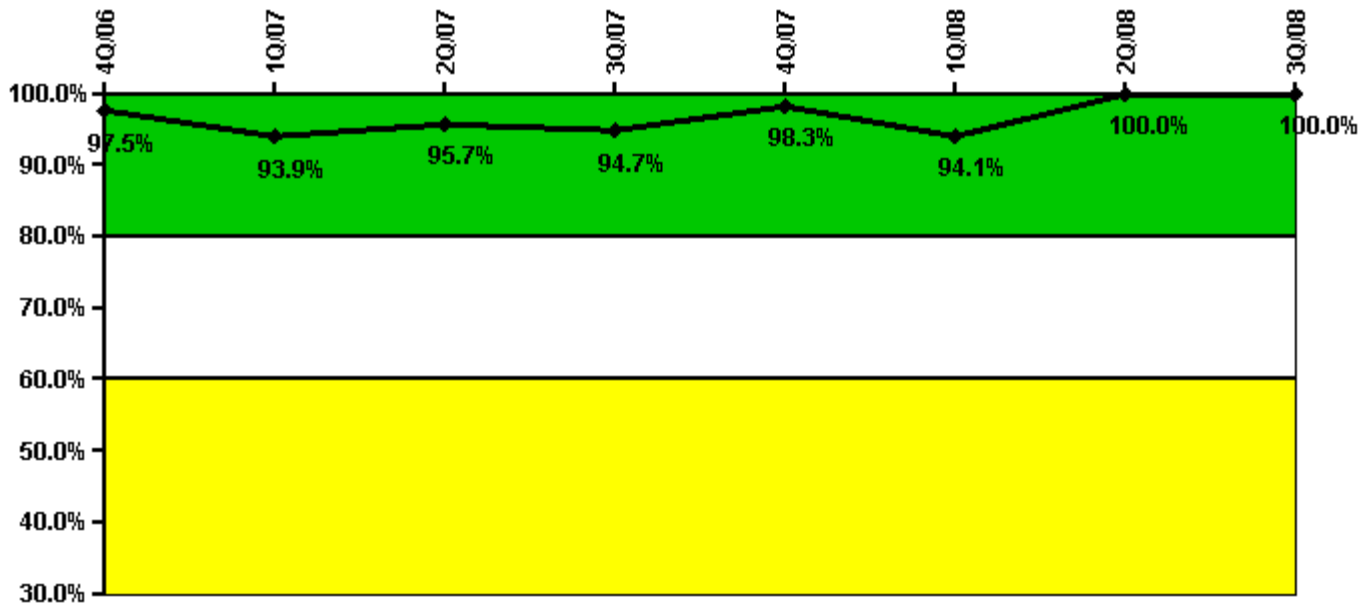


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|-----------------------------|-------|-------|-------|-------|-------|-------|--------|--------|
| Participating Key personnel | 115.0 | 108.0 | 111.0 | 108.0 | 118.0 | 112.0 | 118.0 | 109.0 |
| Total Key personnel | 118.0 | 115.0 | 116.0 | 114.0 | 120.0 | 119.0 | 118.0 | 109.0 |
| Indicator value | 97.5% | 93.9% | 95.7% | 94.7% | 98.3% | 94.1% | 100.0% | 100.0% |

Licensee Comments: none

Alert & Notification System

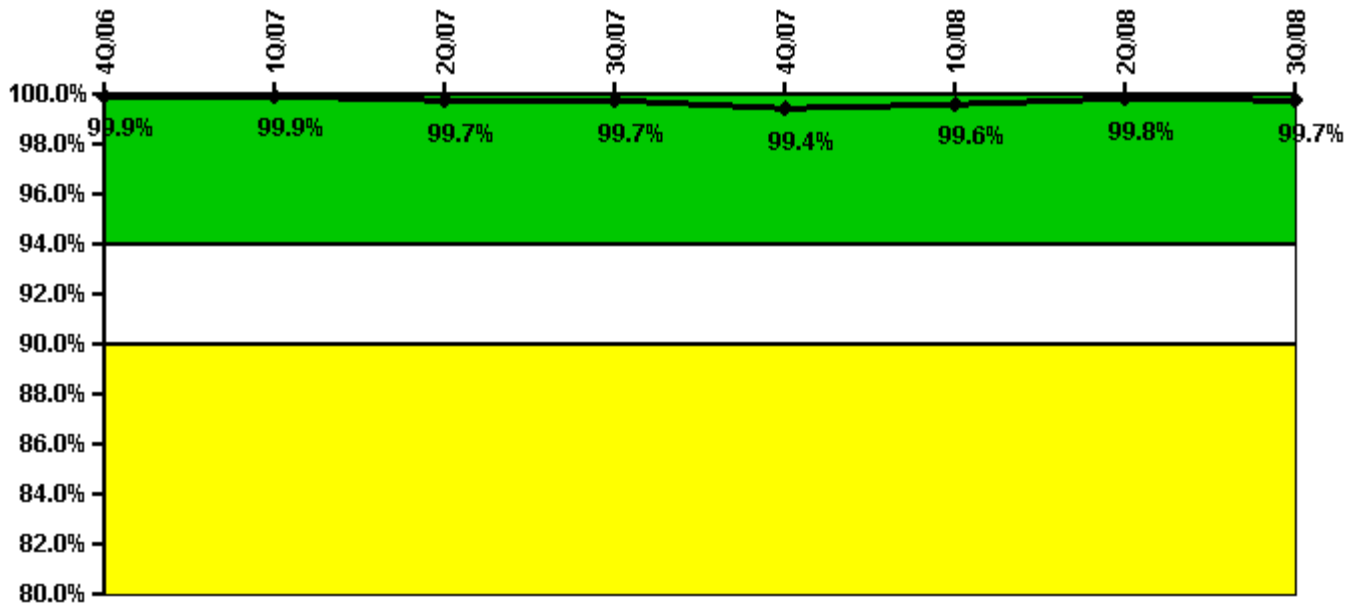

Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests | 224 | 223 | 222 | 192 | 222 | 256 | 256 | 223 |
| Total sirens-tests | 224 | 224 | 224 | 192 | 224 | 256 | 256 | 224 |
| Indicator value | 99.9% | 99.9% | 99.7% | 99.7% | 99.4% | 99.6% | 99.8% | 99.7% |

Licensee Comments:

3Q/08: Corrected 1Q08 and 2Q08 ANS Siren Tests data.

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Security information not publicly available.