


Vermont Yankee

3Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

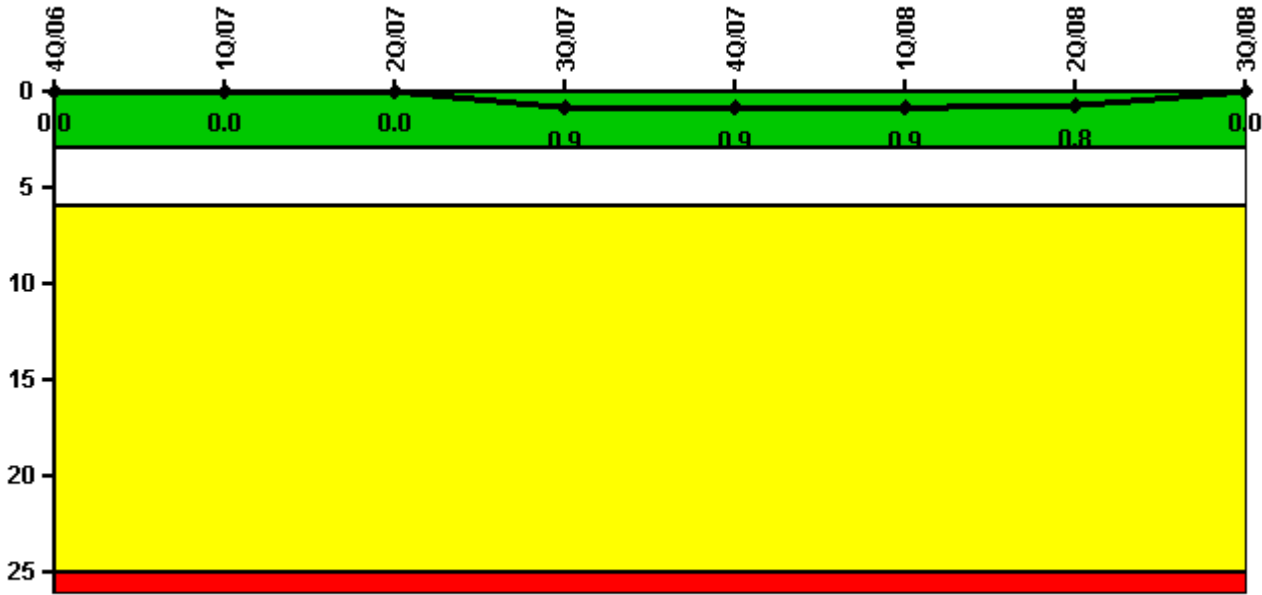


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

| Unplanned Scrams per 7000 Critical Hrs | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams | 0 | 0 | 0 | 1.0 | 0 | 0 | 0 | 0 |
| Critical hours | 2209.0 | 2159.0 | 1621.0 | 2172.2 | 2209.0 | 2183.0 | 2184.0 | 2208.0 |
| Indicator value | 0 | 0 | 0 | 0.9 | 0.9 | 0.9 | 0.8 | 0 |

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

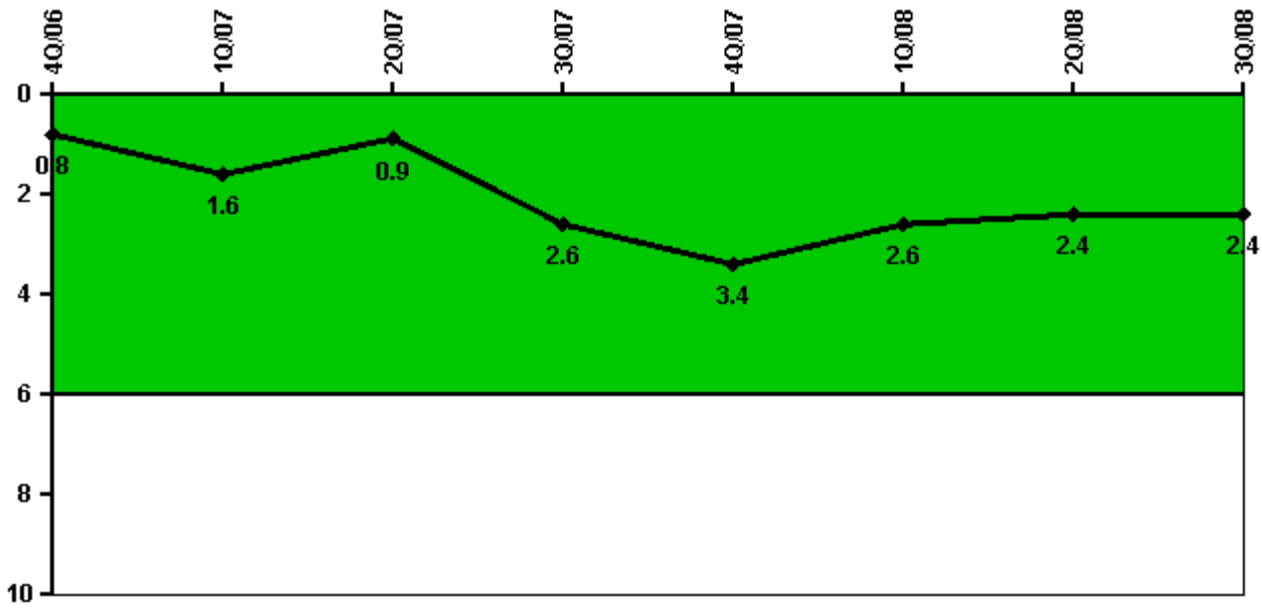

Thresholds: White > 6.0

Notes

| Unplanned Power Changes per 7000 Critical Hrs | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes | 0 | 1.0 | 0 | 2.0 | 1.0 | 0 | 0 | 2.0 |
| Critical hours | 2209.0 | 2159.0 | 1621.0 | 2172.2 | 2209.0 | 2183.0 | 2184.0 | 2208.0 |
| Indicator value | 0.8 | 1.6 | 0.9 | 2.6 | 3.4 | 2.6 | 2.4 | 2.4 |

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

| Unplanned Scrams with Complications | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|-------------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams with complications | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | | | | | | | | |
| Indicator value | | | | 0.0 | 0.0 | 0.0 | 0.0 | 0.0 |

Licensee Comments: none

Safety System Functional Failures (BWR)

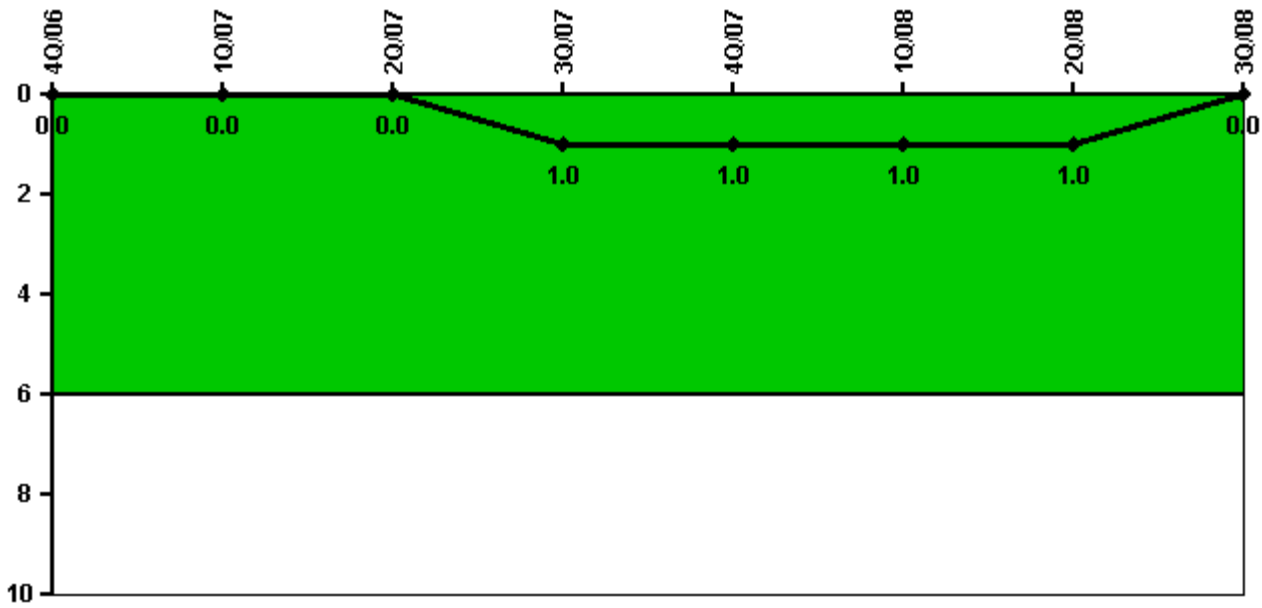

Thresholds: White > 6.0


Notes

| Safety System Functional Failures (BWR) | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures | 0 | 0 | 0 | 1 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 1 | 1 | 1 | 1 | 0 |

Licensee Comments:

3Q/08: In the first quarter 2008 Vermont Yankee Nuclear Power Station approved a revision to its probability risk assessment (PRA) for the mitigating systems. The revised PRA recovered margin for the PIs and changed the values reported to the NRC. This changes was effective in the 1Q08 data submittal.

Mitigating Systems Performance Index, Emergency AC Power System

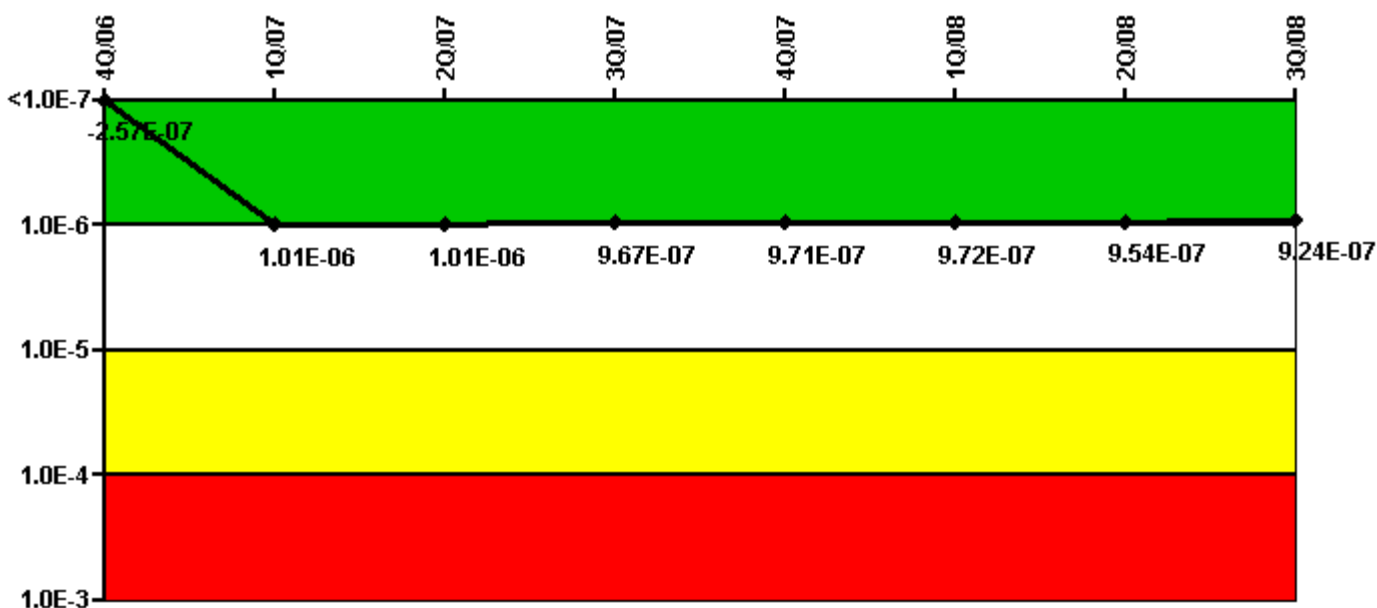

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Emergency AC Power System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-----------|----------|----------|-----------|-----------|----------|----------|----------|
| UAI (Δ CDF) | -1.70E-08 | 2.20E-08 | 1.40E-08 | -3.30E-08 | -2.90E-08 | 1.20E-08 | 1.40E-08 | 1.40E-08 |
| URI (Δ CDF) | -2.40E-07 | 9.90E-07 | 1.00E-06 | 1.00E-06 | 1.00E-06 | 9.60E-07 | 9.40E-07 | 9.10E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -2.57E-07 | 1.01E-06 | 1.01E-06 | 9.67E-07 | 9.71E-07 | 9.72E-07 | 9.54E-07 | 9.24E-07 |

Licensee Comments:

3Q/08: In the first quarter 2008 Vermont Yankee Nuclear Power Station approved a revision to its probability risk assessment (PRA) for the mitigating systems. The revised PRA recovered margin for the PIs and changed the values reported to the NRC. This changes was effective in the 1Q08 data submittal.

Mitigating Systems Performance Index, High Pressure Injection System

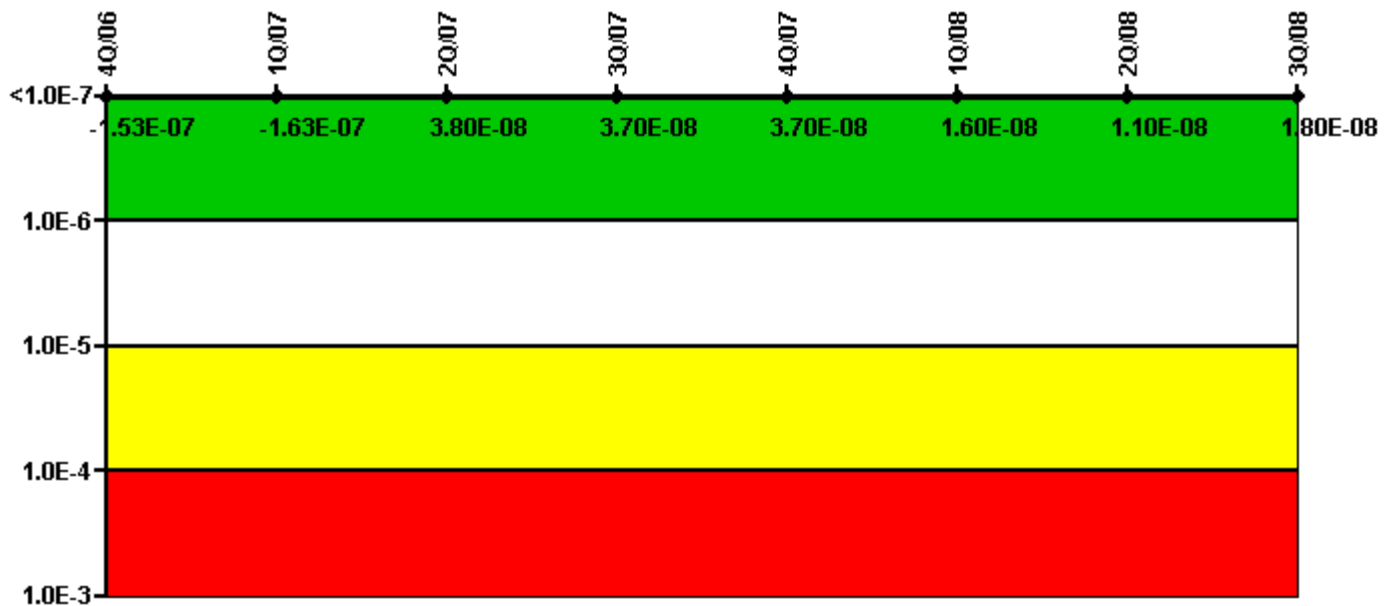

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, High Pressure Injection System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (ΔCDF) | -5.30E-08 | -5.30E-08 | 7.00E-08 | 6.90E-08 | 6.90E-08 | 9.00E-08 | 8.90E-08 | 8.80E-08 |
| URI (ΔCDF) | -1.00E-07 | -1.10E-07 | -3.20E-08 | -3.20E-08 | -3.20E-08 | -7.40E-08 | -7.80E-08 | -7.00E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.53E-07 | -1.63E-07 | 3.80E-08 | 3.70E-08 | 3.70E-08 | 1.60E-08 | 1.10E-08 | 1.80E-08 |

Licensee Comments:

3Q/08: In the first quarter 2008 Vermont Yankee Nuclear Power Station approved a revision to its probability risk assessment (PRA) for the mitigating systems. The revised PRA recovered margin for the PIs and changed the values reported to the NRC. This changes was effective in the 1Q08 data submittal.

Mitigating Systems Performance Index, Heat Removal System

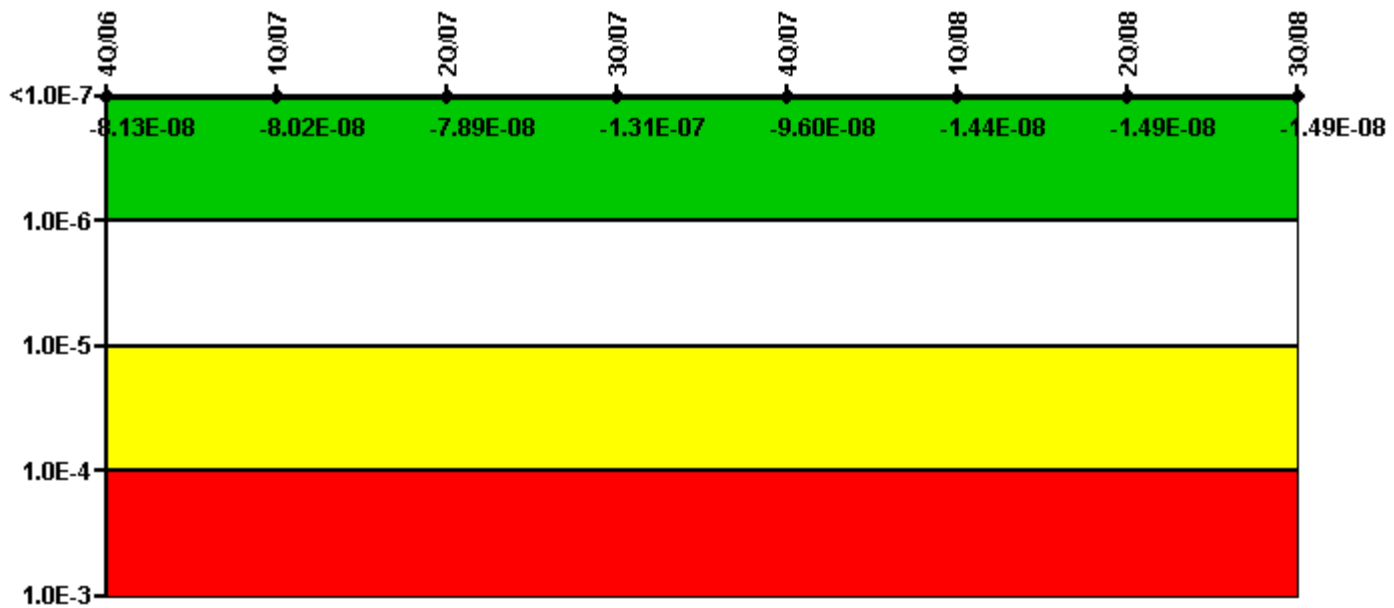

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Heat Removal System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (ΔCDF) | -6.30E-09 | -6.20E-09 | 2.10E-09 | -5.00E-08 | -1.30E-08 | -1.40E-09 | -1.90E-09 | -1.90E-09 |
| URI (ΔCDF) | -7.50E-08 | -7.40E-08 | -8.10E-08 | -8.10E-08 | -8.30E-08 | -1.30E-08 | -1.30E-08 | -1.30E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -8.13E-08 | -8.02E-08 | -7.89E-08 | -1.31E-07 | -9.60E-08 | -1.44E-08 | -1.49E-08 | -1.49E-08 |

Licensee Comments:

3Q/08: In the first quarter 2008 Vermont Yankee Nuclear Power Station approved a revision to its probability risk assessment (PRA) for the mitigating systems. The revised PRA recovered margin for the PIs and changed the values reported to the NRC. This changes was effective in the 1Q08 data submittal.

Mitigating Systems Performance Index, Residual Heat Removal System

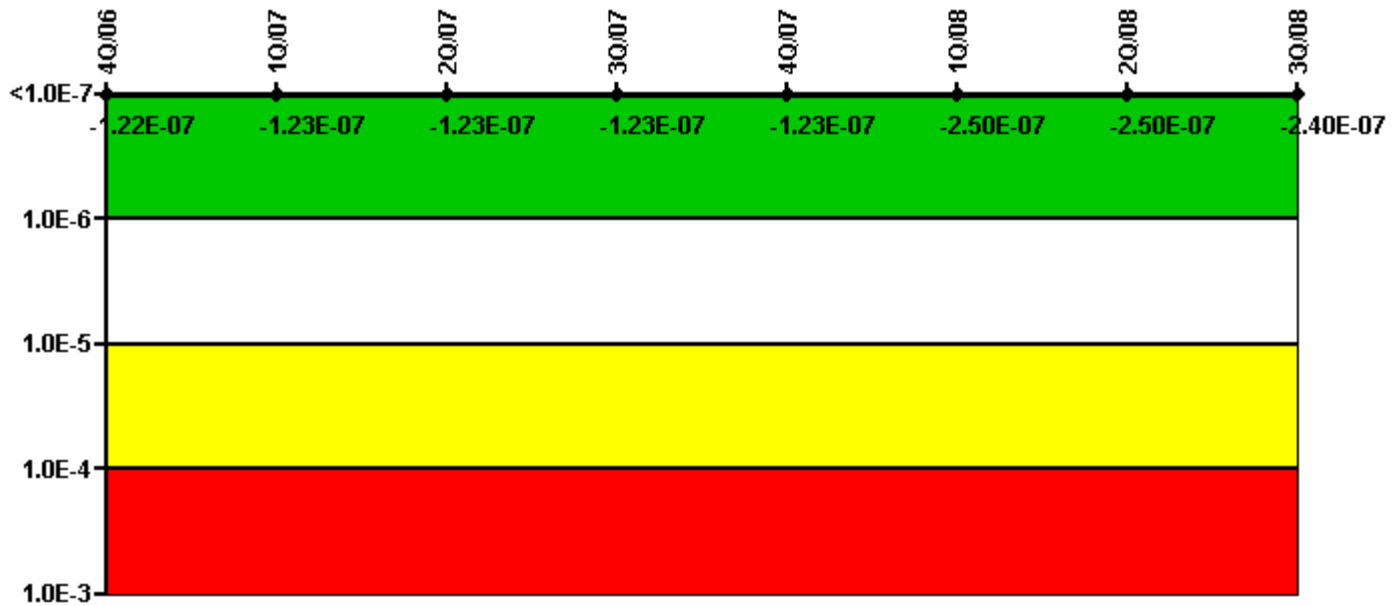

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Residual Heat Removal System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|--|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| UAI (Δ CDF) | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -2.30E-08 | -4.00E-08 | -4.00E-08 | -4.00E-08 |
| URI (Δ CDF) | -9.90E-08 | -1.00E-07 | -1.00E-07 | -1.00E-07 | -1.00E-07 | -2.10E-07 | -2.10E-07 | -2.00E-07 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | -1.22E-07 | -1.23E-07 | -1.23E-07 | -1.23E-07 | -1.23E-07 | -2.50E-07 | -2.50E-07 | -2.40E-07 |

Licensee Comments:

3Q/08: In the first quarter 2008 Vermont Yankee Nuclear Power Station approved a revision to its probability risk assessment (PRA) for the mitigating systems. The revised PRA recovered margin for the PIs and changed the values reported to the NRC. This changes was effective in the 1Q08 data submittal.

Mitigating Systems Performance Index, Cooling Water Systems

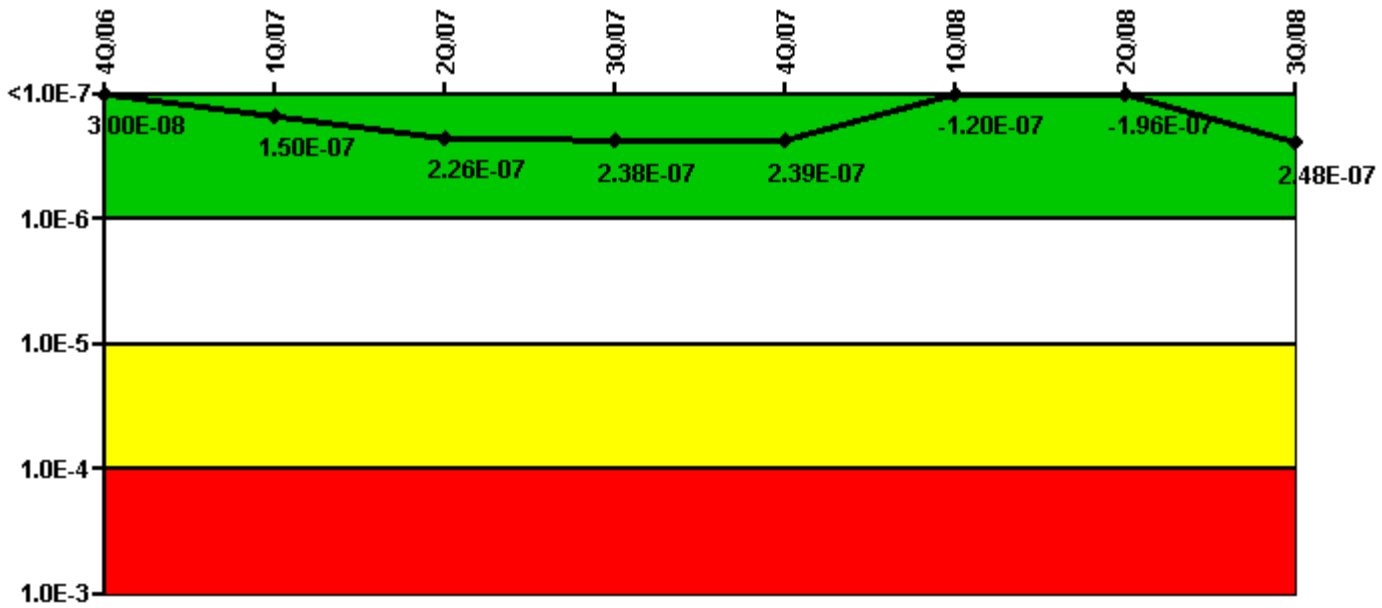

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

| Mitigating Systems Performance Index, Cooling Water Systems | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|-----------|-----------|-----------|-----------|-----------|-----------|-----------|----------|
| UAI (Δ CDF) | 2.20E-07 | 3.00E-07 | 3.20E-07 | 3.30E-07 | 3.30E-07 | 1.80E-07 | 8.40E-08 | 1.90E-07 |
| URI (Δ CDF) | -1.90E-07 | -1.50E-07 | -9.40E-08 | -9.20E-08 | -9.10E-08 | -3.00E-07 | -2.80E-07 | 5.80E-08 |
| PLE | NO | NO | NO | NO | NO | NO | NO | NO |
| Indicator value | 3.00E-08 | 1.50E-07 | 2.26E-07 | 2.38E-07 | 2.39E-07 | -1.20E-07 | -1.96E-07 | 2.48E-07 |

Licensee Comments:

3Q/08: In the first quarter 2008 Vermont Yankee Nuclear Power Station approved a revision to its probability risk assessment (PRA) for the mitigating systems. The revised PRA recovered margin for the PIs and changed the values reported to the NRC. This changes was effective in the 1Q08 data submittal.

Reactor Coolant System Activity

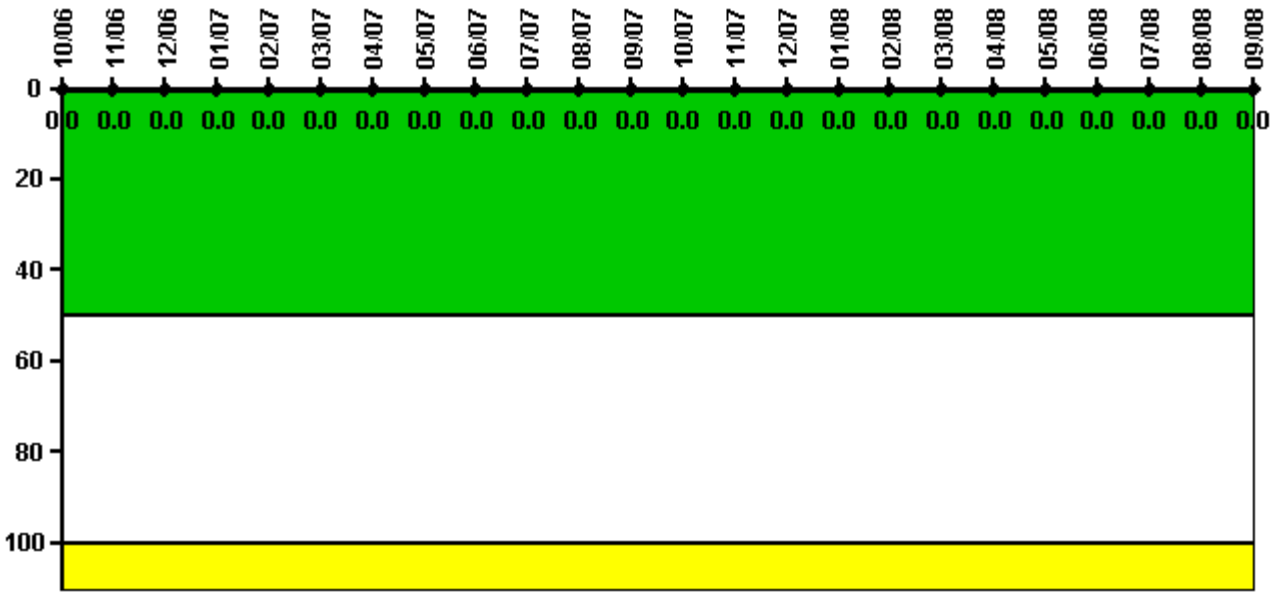

Thresholds: White > 50.0 Yellow > 100.0


Notes

| Reactor Coolant System Activity | 10/06 | 11/06 | 12/06 | 1/07 | 2/07 | 3/07 | 4/07 | 5/07 | 6/07 | 7/07 | 8/07 | 9/07 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000017 | 0.000026 | 0.000024 | 0.000024 | 0.000025 | 0.000024 | 0.000023 | 0.000038 | 0.000022 | 0.000023 | 0.000034 | 0.000046 |
| Technical specification limit | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

| Reactor Coolant System Activity | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity | 0.000046 | 0.000032 | 0.000037 | 0.000034 | 0.000023 | 0.000027 | 0.000031 | 0.000037 | 0.000030 | 0.000054 | 0.000047 | 0.000030 |
| Technical specification limit | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 | 1.1 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

Reactor Coolant System Leakage

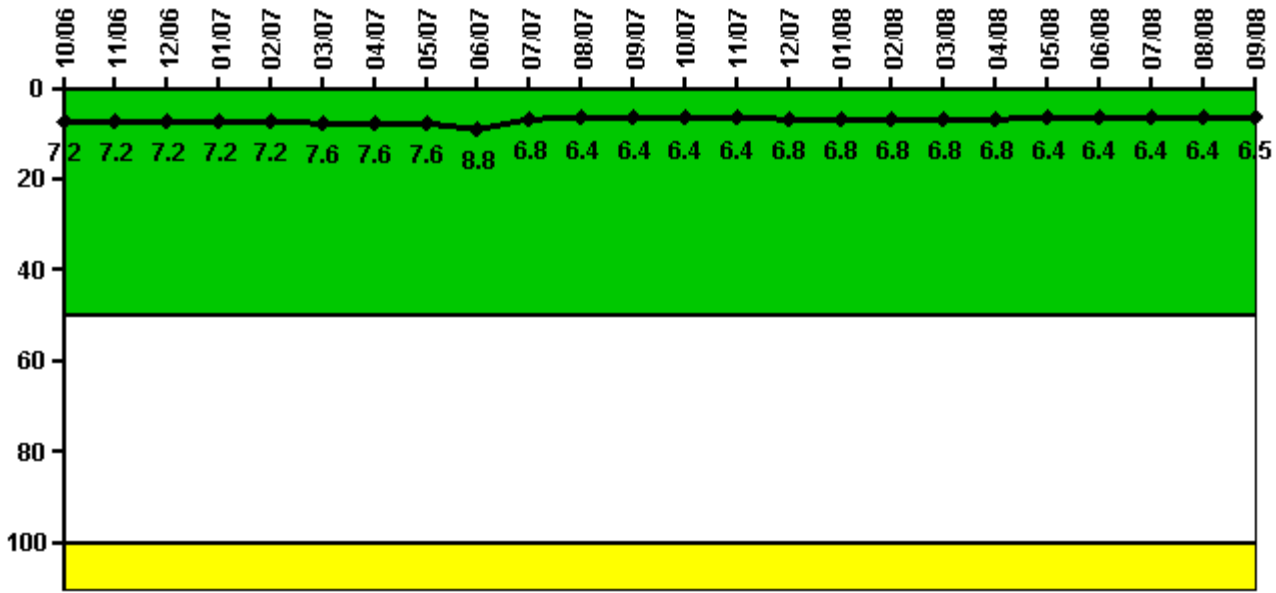


Thresholds: White > 50.0 Yellow > 100.0

Notes

| Reactor Coolant System Leakage | 10/06 | 11/06 | 12/06 | 1/07 | 2/07 | 3/07 | 4/07 | 5/07 | 6/07 | 7/07 | 8/07 | 9/07 |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage | 1.800 | 1.800 | 1.800 | 1.800 | 1.800 | 1.900 | 1.900 | 1.900 | 2.200 | 1.700 | 1.600 | 1.600 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 7.2 | 7.2 | 7.2 | 7.2 | 7.2 | 7.6 | 7.6 | 7.6 | 8.8 | 6.8 | 6.4 | 6.4 |
| Reactor Coolant System Leakage | 10/07 | 11/07 | 12/07 | 1/08 | 2/08 | 3/08 | 4/08 | 5/08 | 6/08 | 7/08 | 8/08 | 9/08 |
| Maximum leakage | 1.600 | 1.600 | 1.700 | 1.700 | 1.700 | 1.700 | 1.700 | 1.600 | 1.600 | 1.600 | 1.600 | 1.630 |
| Technical specification limit | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 | 25.0 |
| Indicator value | 6.4 | 6.4 | 6.8 | 6.8 | 6.8 | 6.8 | 6.8 | 6.4 | 6.4 | 6.4 | 6.4 | 6.5 |

Licensee Comments: none

Drill/Exercise Performance

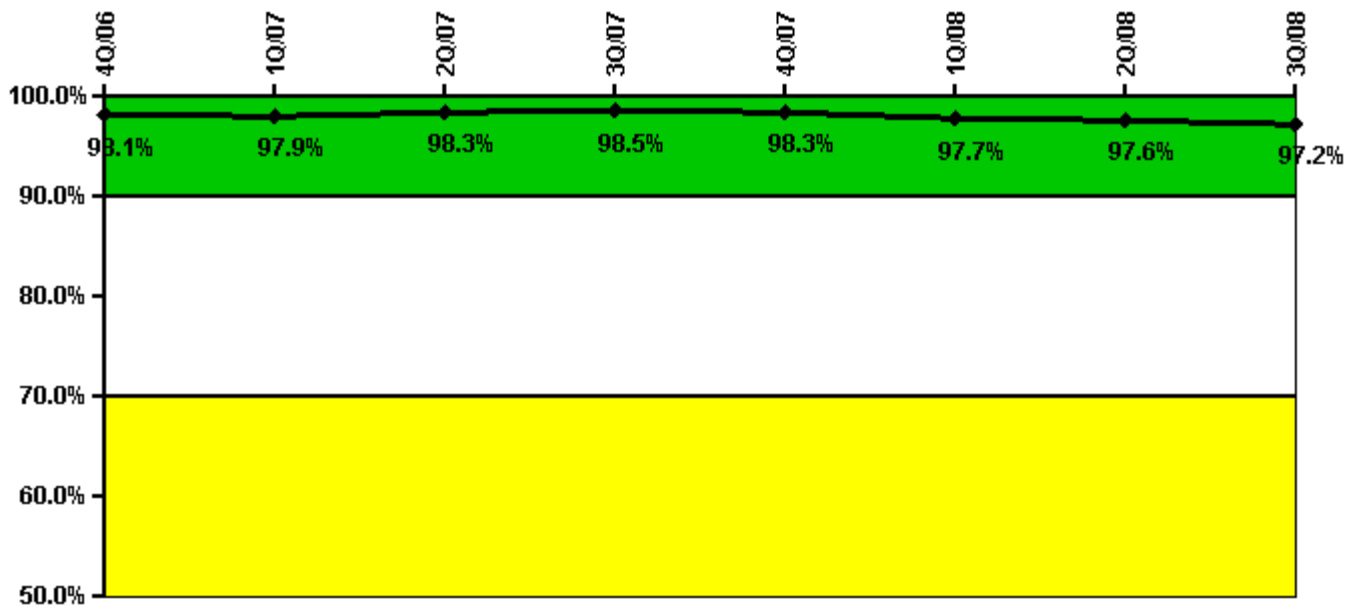


Thresholds: White < 90.0% Yellow < 70.0%

Notes

| Drill/Exercise Performance | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful opportunities | 36.0 | 13.0 | 23.0 | 58.0 | 27.0 | 40.0 | 36.0 | 75.0 |
| Total opportunities | 38.0 | 14.0 | 23.0 | 58.0 | 28.0 | 42.0 | 36.0 | 78.0 |
| | | | | | | | | |
| Indicator value | 98.1% | 97.9% | 98.3% | 98.5% | 98.3% | 97.7% | 97.6% | 97.2% |

Licensee Comments: none

ERO Drill Participation

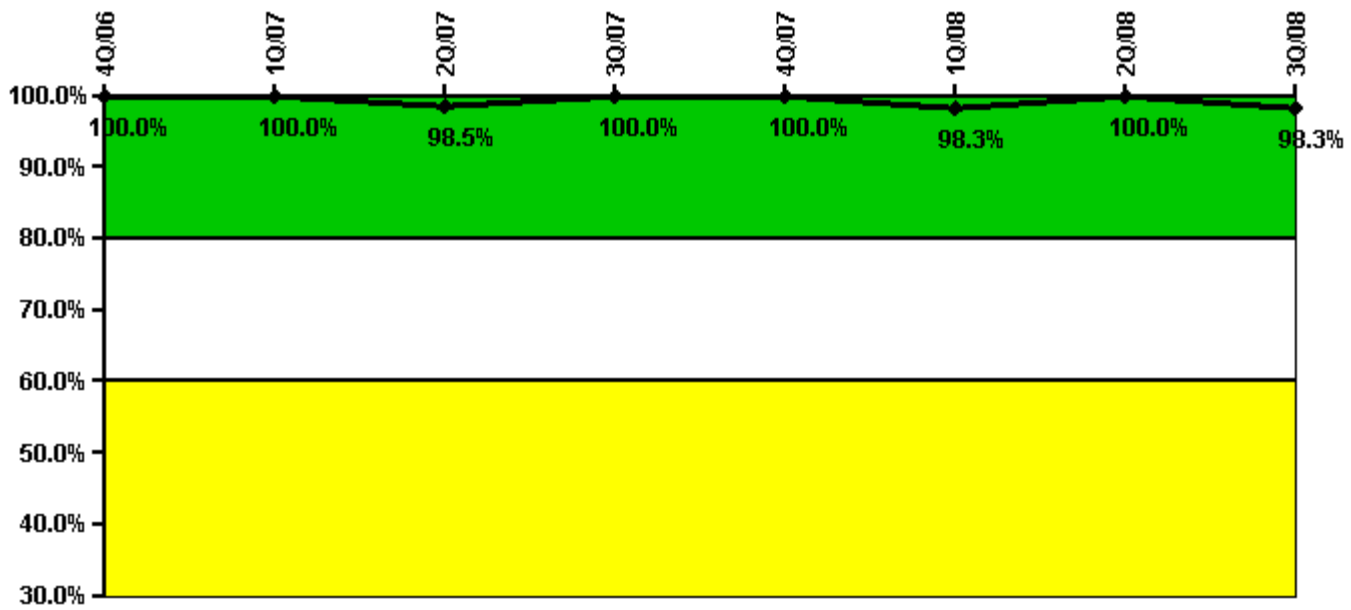


Thresholds: White < 80.0% Yellow < 60.0%

Notes

| ERO Drill Participation | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|-----------------------------|--------|--------|-------|--------|--------|-------|--------|-------|
| Participating Key personnel | 65.0 | 64.0 | 64.0 | 64.0 | 67.0 | 58.0 | 62.0 | 59.0 |
| Total Key personnel | 65.0 | 64.0 | 65.0 | 64.0 | 67.0 | 59.0 | 62.0 | 60.0 |
| | | | | | | | | |
| Indicator value | 100.0% | 100.0% | 98.5% | 100.0% | 100.0% | 98.3% | 100.0% | 98.3% |

Licensee Comments: none

Alert & Notification System

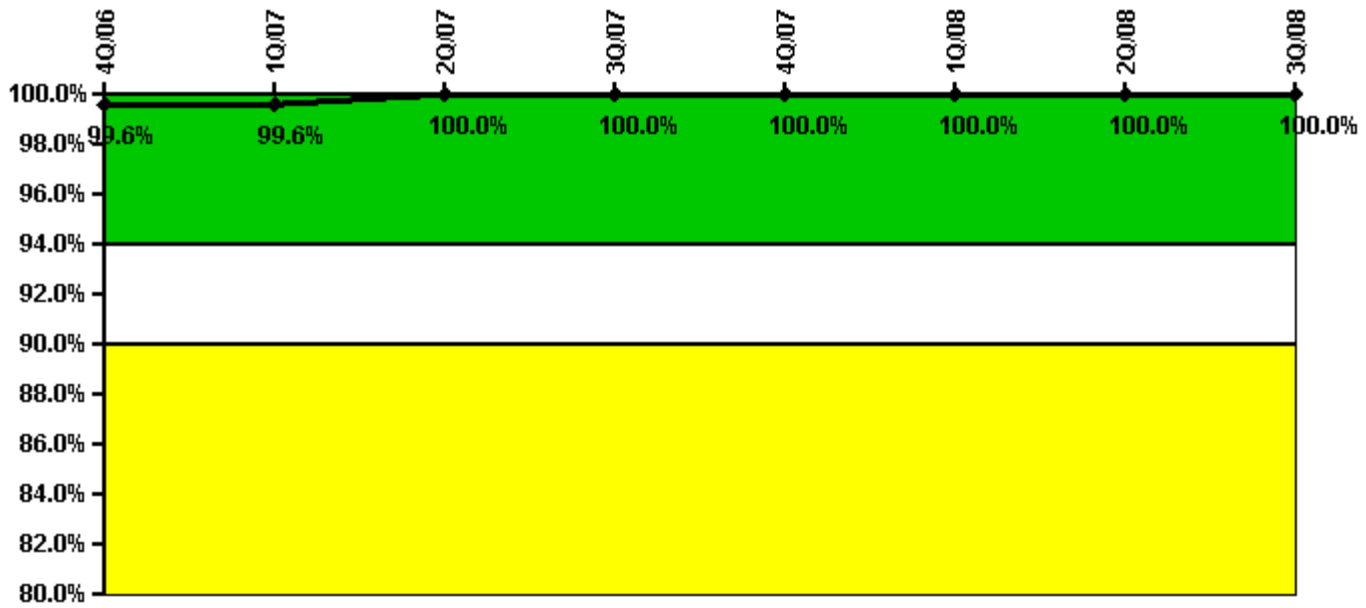

Thresholds: White < 94.0% Yellow < 90.0%

Notes

| Alert & Notification System | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|-----------------------------|-------|-------|--------|--------|--------|--------|--------|--------|
| Successful siren-tests | 84 | 63 | 63 | 63 | 63 | 63 | 63 | 63 |
| Total sirens-tests | 84 | 63 | 63 | 63 | 63 | 63 | 63 | 63 |
| Indicator value | 99.6% | 99.6% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% | 100.0% |

Licensee Comments: none

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

| Occupational Exposure Control Effectiveness | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---|----------|----------|----------|----------|----------|----------|----------|----------|
| High radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Very high radiation area occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Unintended exposure occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

| RETS/ODCM Radiological Effluent | 4Q/06 | 1Q/07 | 2Q/07 | 3Q/07 | 4Q/07 | 1Q/08 | 2Q/08 | 3Q/08 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Indicator value | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |

Licensee Comments: none

[Security](#) information not publicly available.