


Wolf Creek 1

3Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

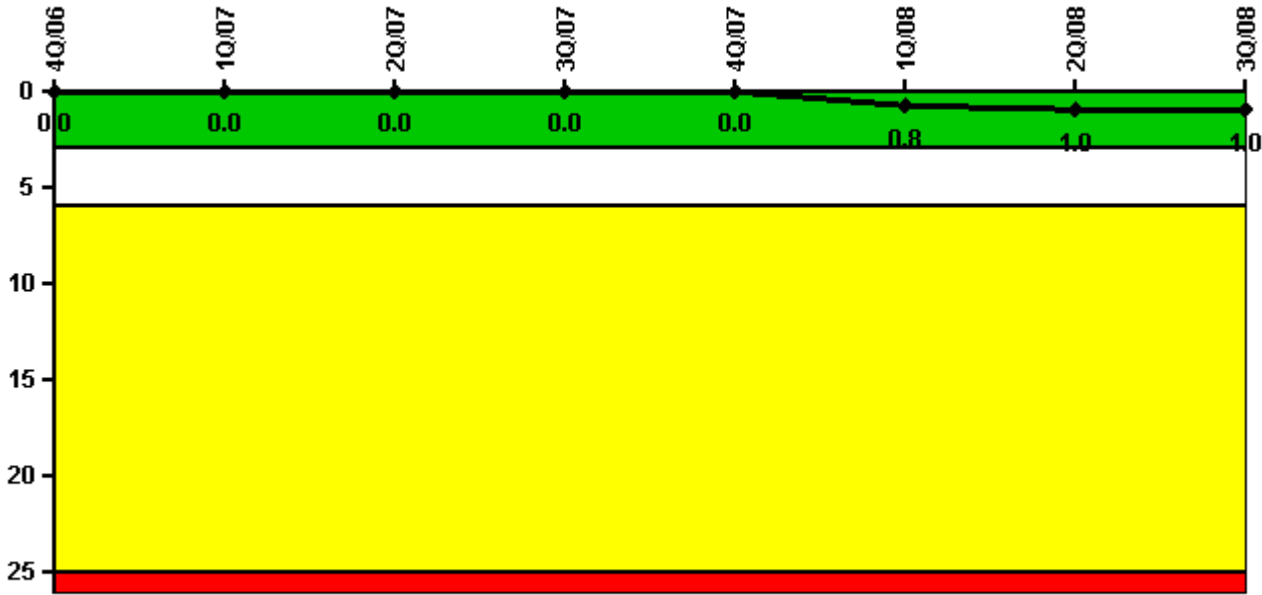

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned scrams	0	0	0	0	0	1.0	0	0
Critical hours	1405.1	2159.0	2184.0	2208.0	2209.0	1733.8	1150.0	2208.0
Indicator value	0	0	0	0	0	0.8	1.0	1.0

Licensee Comments:

1Q/08: Failed to classify the scram correctly during 1Q08. Corrected in 2Q08.

Unplanned Power Changes per 7000 Critical Hrs

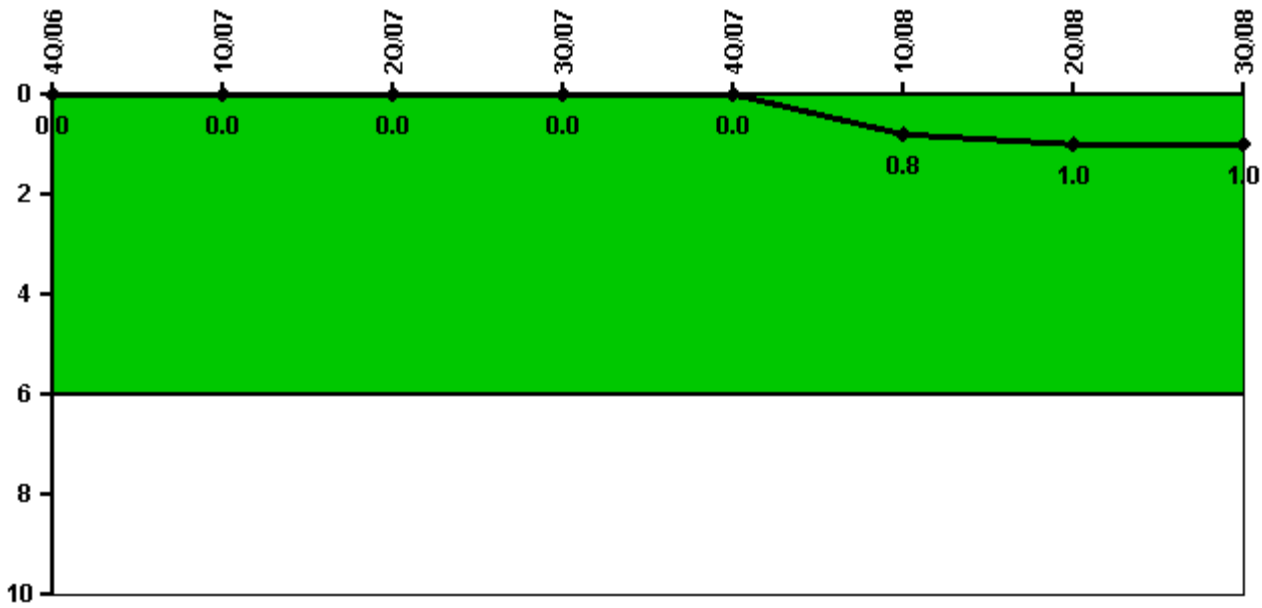

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Unplanned power changes	0	0	0	0	0	1.0	0	0
Critical hours	1405.1	2159.0	2184.0	2208.0	2209.0	1733.8	1150.0	2208.0
Indicator value	0	0	0	0	0	0.8	1.0	1.0

Licensee Comments:

1Q/08: Corrected from scram event to unplanned shutdown

Unplanned Scrams with Complications

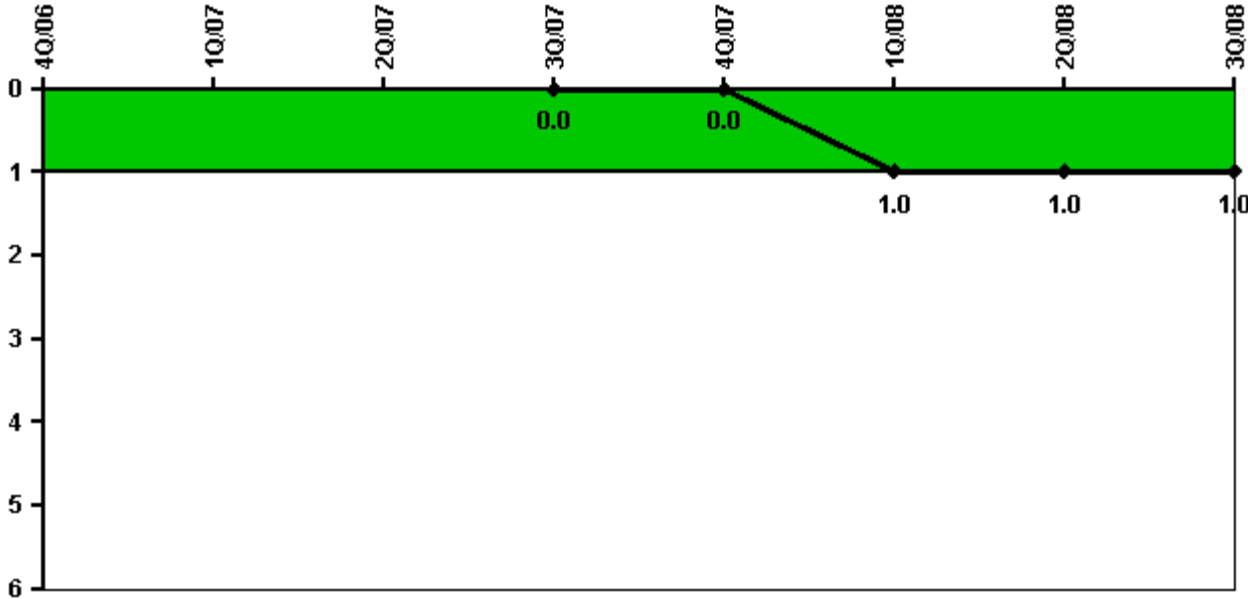


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Scrams with complications	0	0	0	0	0	1.0	0	0
Indicator value				0.0	0.0	1.0	1.0	1.0

Licensee Comments: none

Safety System Functional Failures (PWR)

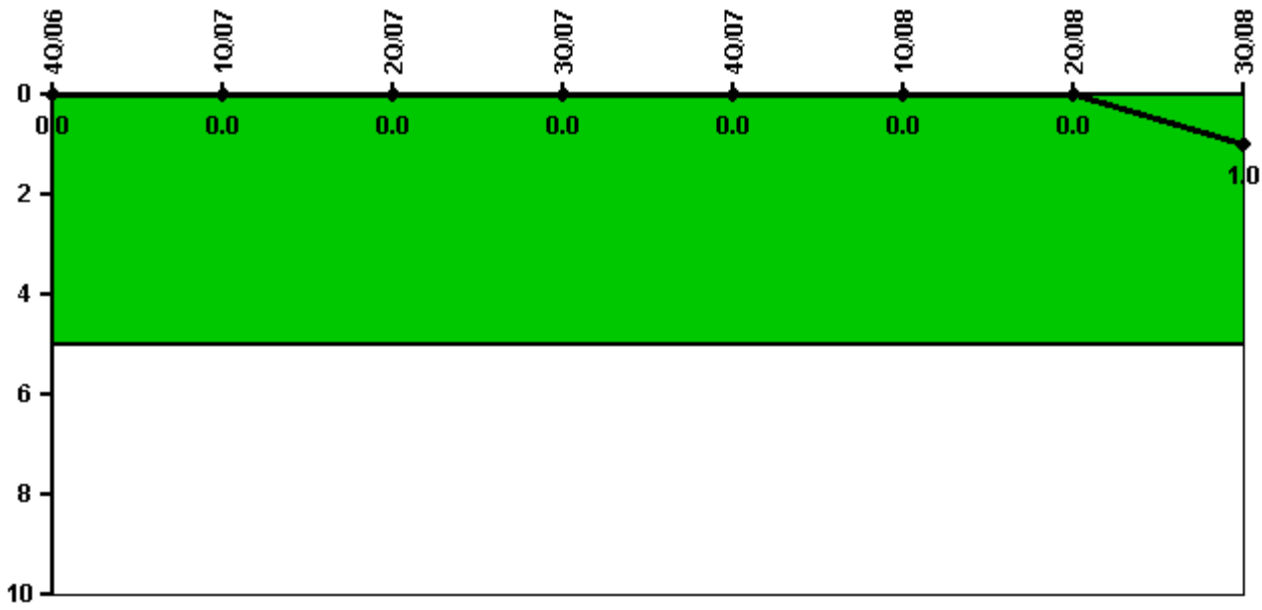


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Safety System Functional Failures	0	0	0	0	0	0	0	1
Indicator value	0	0	0	0	0	0	0	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

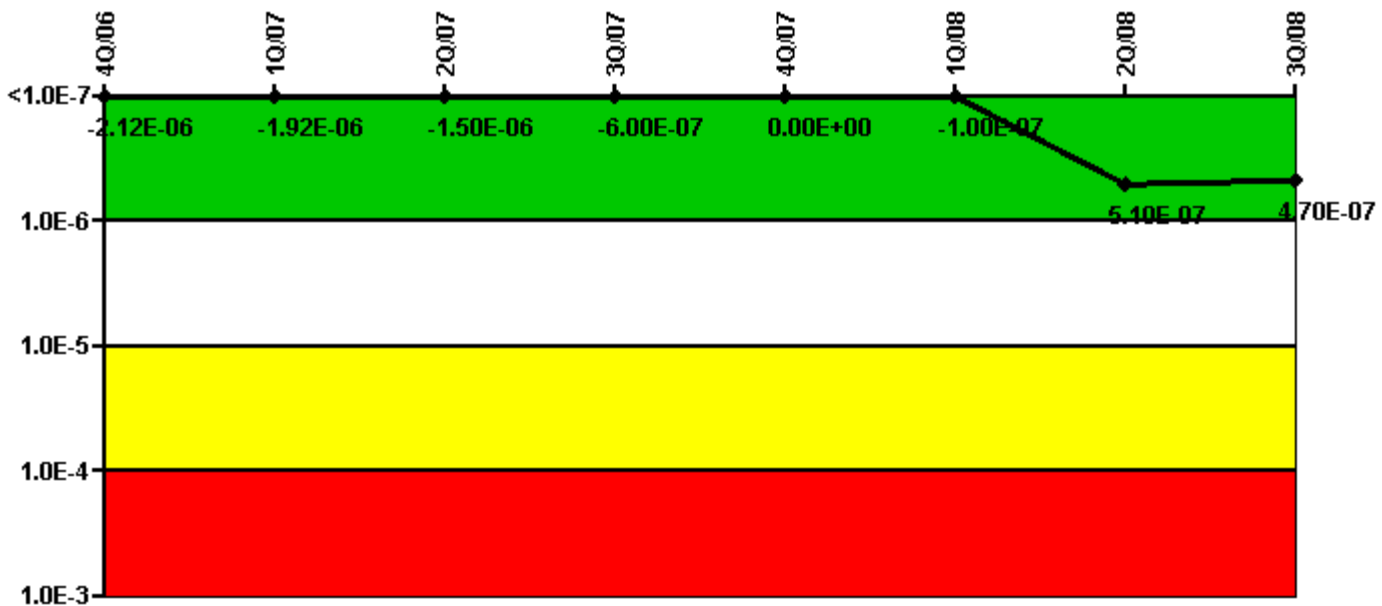

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	6.80E-07	6.80E-07	9.00E-07	1.60E-06	1.90E-06	1.40E-06	1.20E-06	1.20E-06
URI (Δ CDF)	-2.80E-06	-2.60E-06	-2.40E-06	-2.20E-06	-1.90E-06	-1.50E-06	-6.90E-07	-7.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.12E-06	-1.92E-06	-1.50E-06	-6.00E-07	0.00E+00	-1.00E-07	5.10E-07	4.70E-07

Licensee Comments:

2Q/06: Notified by INPO on 10/2/06 tha the CDF current value was going to be altered due to data conversion from MSPI calculator to CDE. Calculator allowed an additional decimal place. This conversion altered the CDF value.

Mitigating Systems Performance Index, High Pressure Injection System

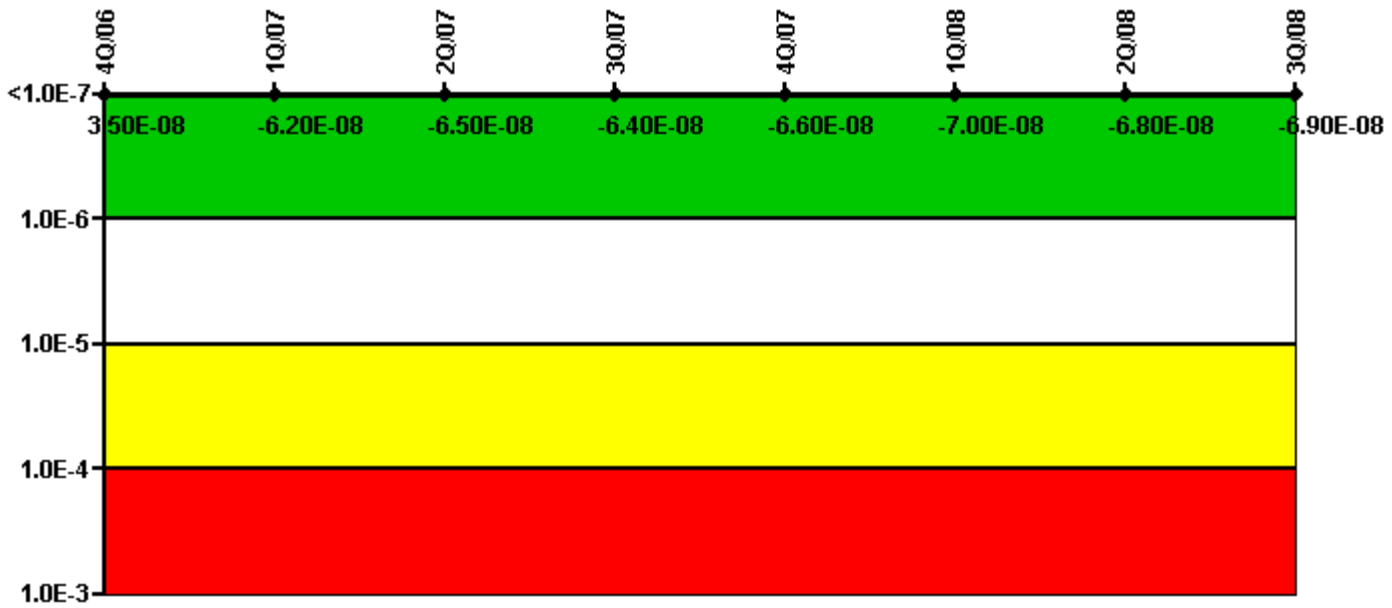


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (ΔCDF)	1.20E-07	1.70E-08	1.70E-08	1.70E-08	1.50E-08	1.50E-08	1.70E-08	1.60E-08
URI (ΔCDF)	-8.50E-08	-7.90E-08	-8.20E-08	-8.10E-08	-8.10E-08	-8.50E-08	-8.50E-08	-8.50E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.50E-08	-6.20E-08	-6.50E-08	-6.40E-08	-6.60E-08	-7.00E-08	-6.80E-08	-6.90E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

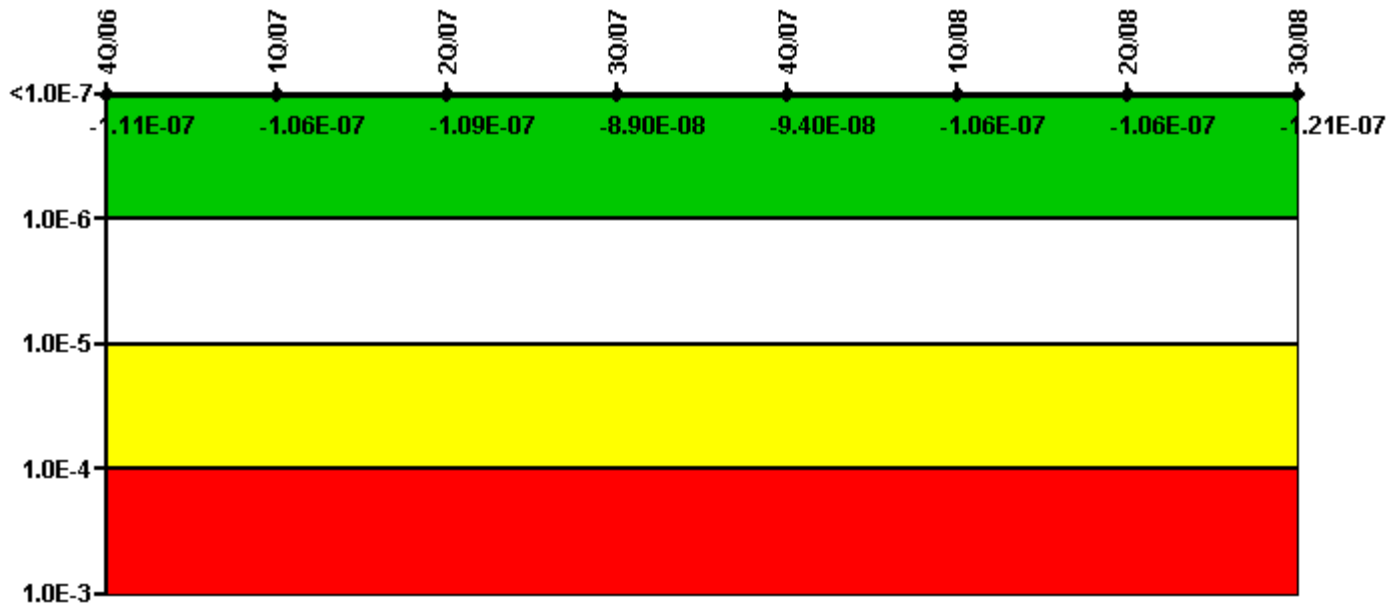


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	5.90E-08	6.40E-08	6.10E-08	8.10E-08	6.60E-08	5.40E-08	5.40E-08	3.90E-08
URI (Δ CDF)	-1.70E-07	-1.70E-07	-1.70E-07	-1.70E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.11E-07	-1.06E-07	-1.09E-07	-8.90E-08	-9.40E-08	-1.06E-07	-1.06E-07	-1.21E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

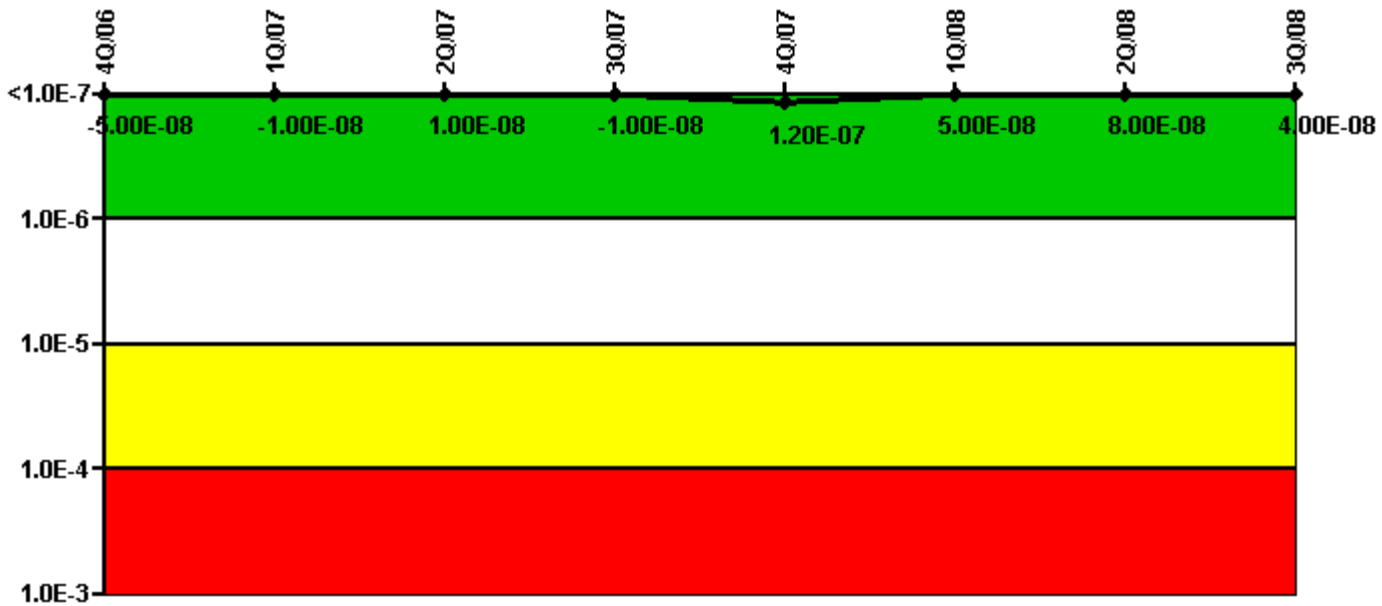


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	2.10E-07	2.60E-07	2.70E-07	2.60E-07	3.80E-07	3.50E-07	3.60E-07	3.30E-07
URI (Δ CDF)	-2.60E-07	-2.70E-07	-2.60E-07	-2.70E-07	-2.60E-07	-3.00E-07	-2.80E-07	-2.90E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.00E-08	-1.00E-08	1.00E-08	-1.00E-08	1.20E-07	5.00E-08	8.00E-08	4.00E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

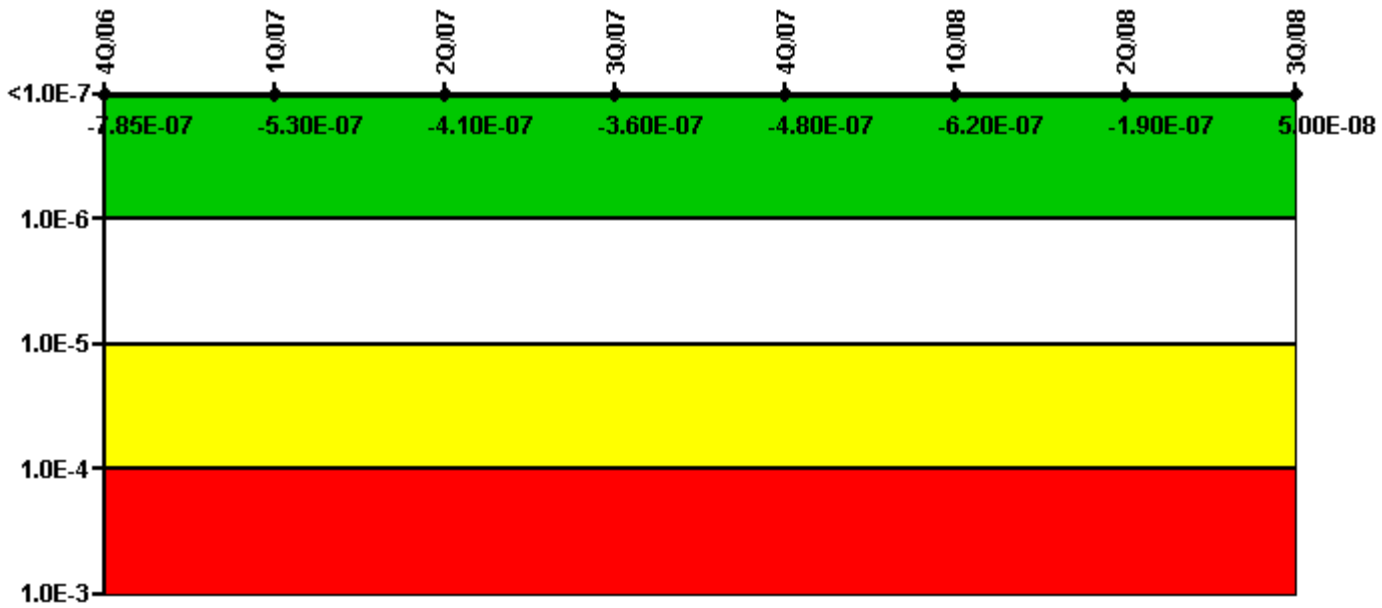

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
UAI (Δ CDF)	-3.50E-08	2.00E-07	3.20E-07	3.70E-07	2.40E-07	1.20E-07	5.40E-07	7.80E-07
URI (Δ CDF)	-7.50E-07	-7.30E-07	-7.30E-07	-7.30E-07	-7.20E-07	-7.40E-07	-7.30E-07	-7.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-7.85E-07	-5.30E-07	-4.10E-07	-3.60E-07	-4.80E-07	-6.20E-07	-1.90E-07	5.00E-08

Licensee Comments:

3Q/08: Changed PRA Parameter(s).

2Q/08: Changed PRA Parameter(s).

1Q/08: Changed PRA Parameter(s).

4Q/07: Changed PRA Parameter(s).

3Q/07: Changed PRA Parameter(s).

2Q/07: Changed PRA Parameter(s).


1Q/07: Changed PRA Parameter(s).

4Q/06: Changed PRA Parameter(s).

3Q/06: Changed PRA Parameter(s).

2Q/06: Changed PRA Parameter(s).

Reactor Coolant System Activity

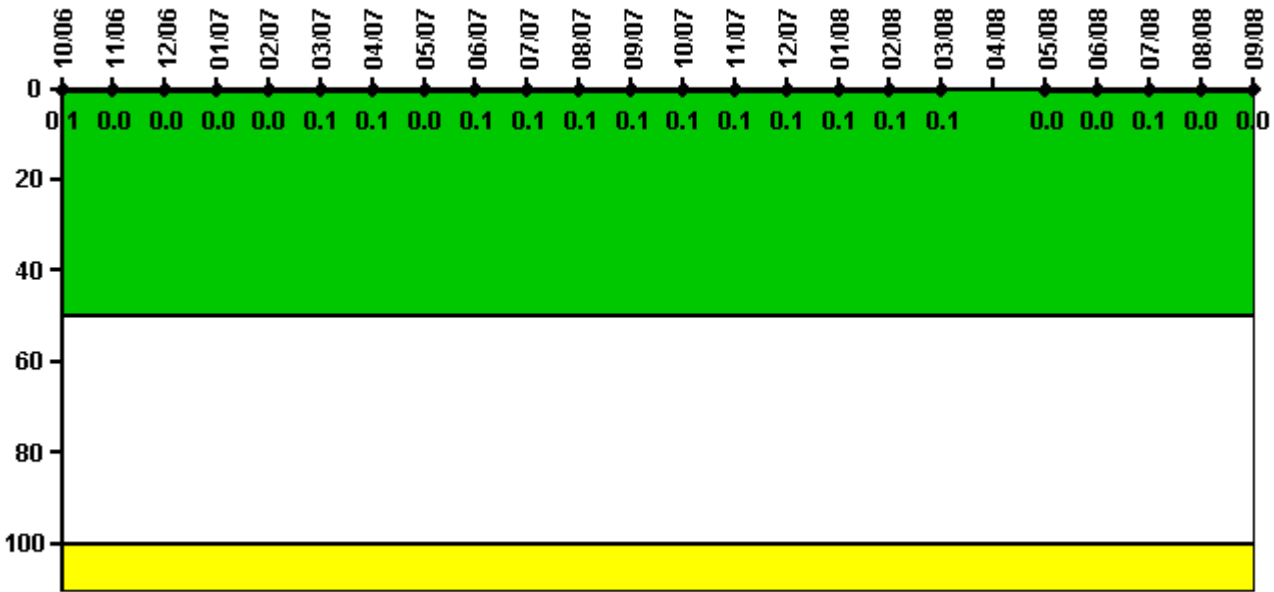

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum activity	0.000800	0.000300	0.000300	0.000400	0.000400	0.000500	0.000600	0.000400	0.000500	0.000600	0.000700	0.000600
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0	0	0	0	0.1	0.1	0	0.1	0.1	0.1	0.1

Reactor Coolant System Activity	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum activity	0.000700	0.000800	0.000600	0.000700	0.000700	0.000800	N/A	0.000300	0.000300	0.000700	0.000300	0.000300
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	N/A	0	0	0.1	0	0

Licensee Comments: none

Reactor Coolant System Leakage

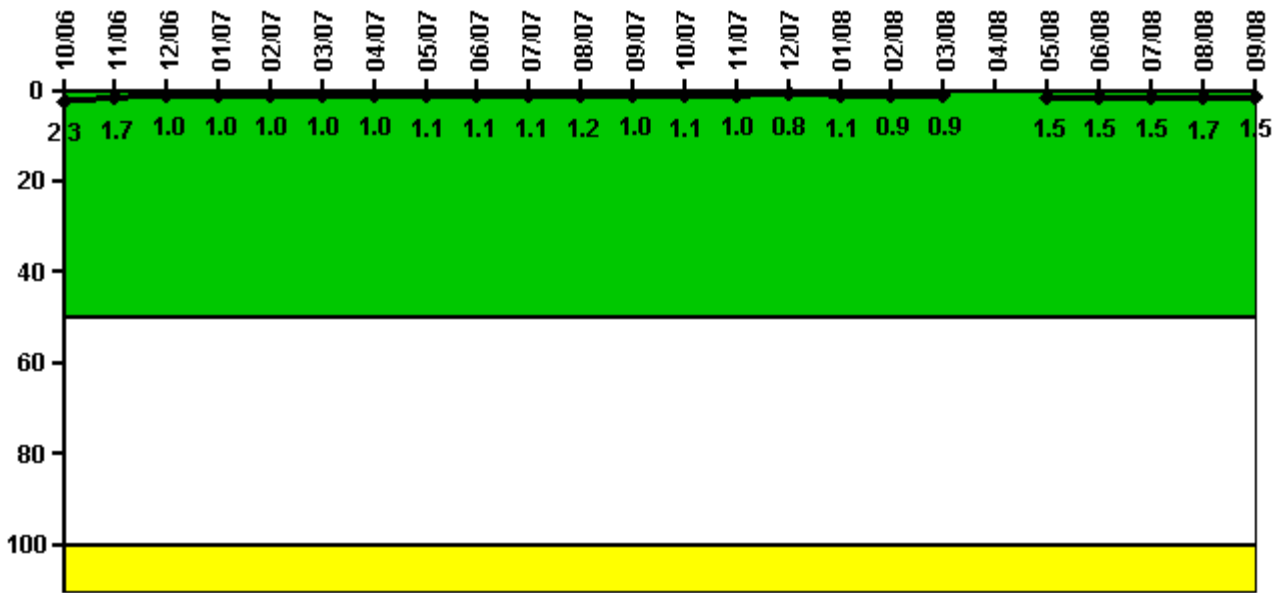


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07
Maximum leakage	0.230	0.170	0.100	0.100	0.100	0.100	0.100	0.110	0.110	0.110	0.120	0.100
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.3	1.7	1.0	1.0	1.0	1.0	1.0	1.1	1.1	1.1	1.2	1.0
Reactor Coolant System Leakage	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08
Maximum leakage	0.110	0.100	0.080	0.110	0.090	0.090	N/A	0.150	0.150	0.150	0.170	0.150
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.1	1.0	0.8	1.1	0.9	0.9	N/A	1.5	1.5	1.5	1.7	1.5

Licensee Comments: none

Drill/Exercise Performance

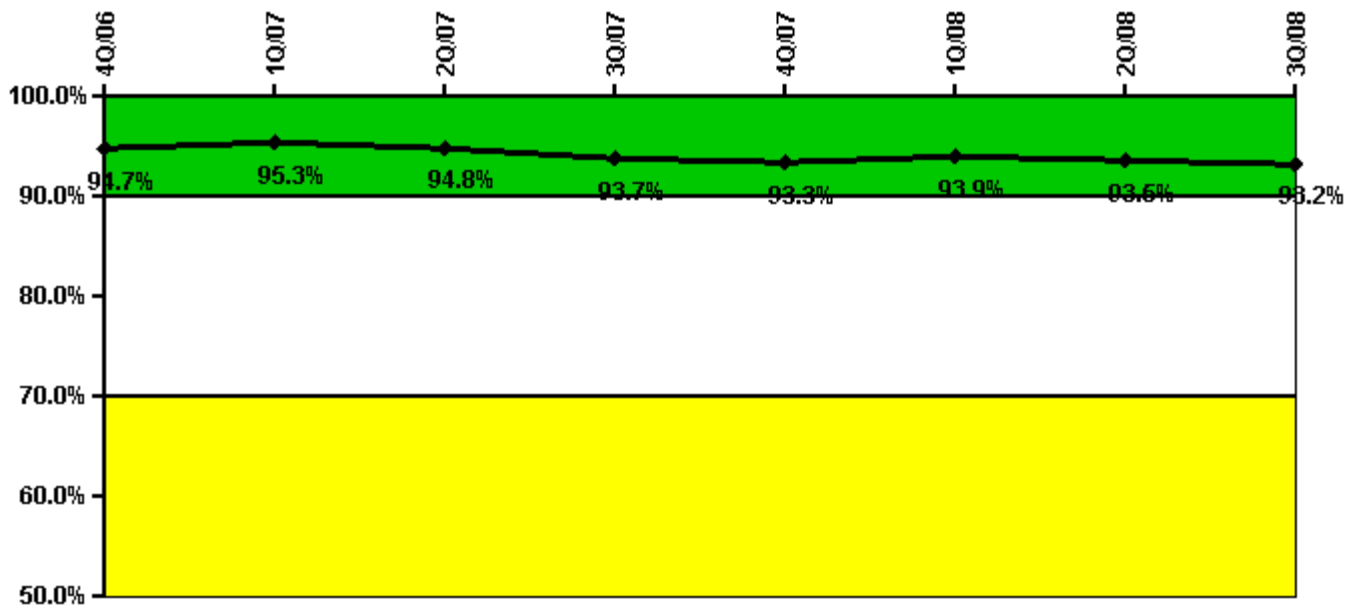


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful opportunities	39.0	21.0	39.0	41.0	75.0	22.0	2.0	49.0
Total opportunities	39.0	22.0	43.0	45.0	80.0	22.0	2.0	56.0
Indicator value	94.7%	95.3%	94.8%	93.7%	93.3%	93.9%	93.5%	93.2%

Licensee Comments: none

ERO Drill Participation

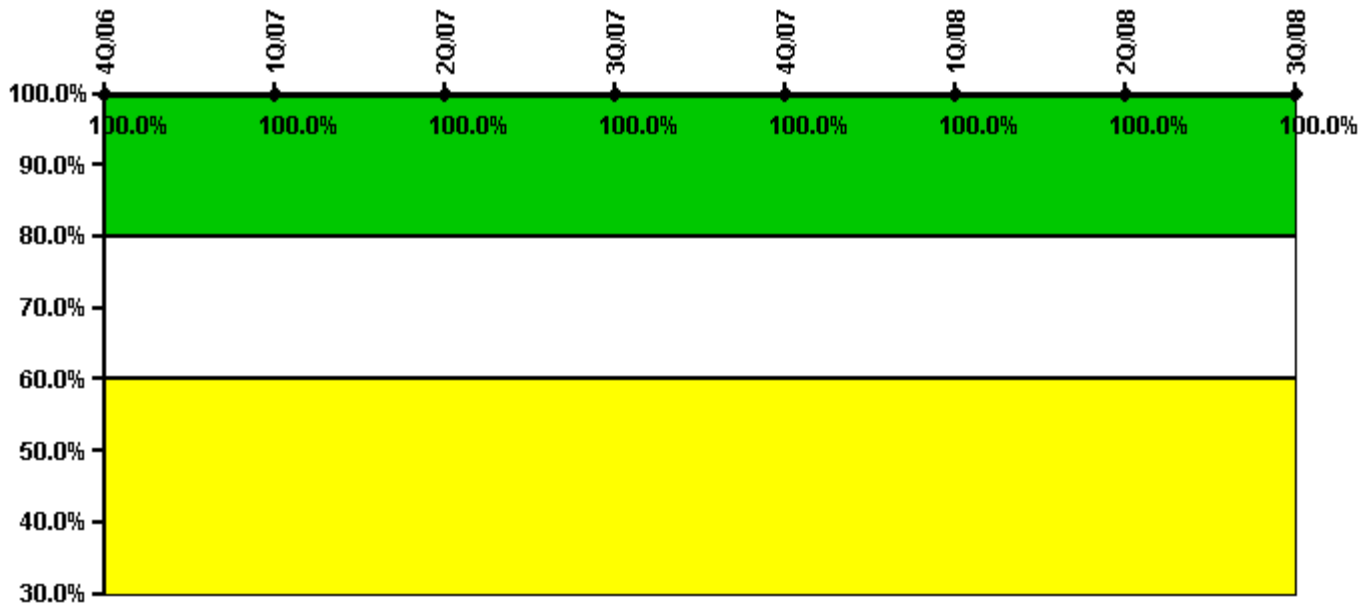


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Participating Key personnel	70.0	69.0	68.0	68.0	67.0	68.0	62.0	65.0
Total Key personnel	70.0	69.0	68.0	68.0	67.0	68.0	62.0	65.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

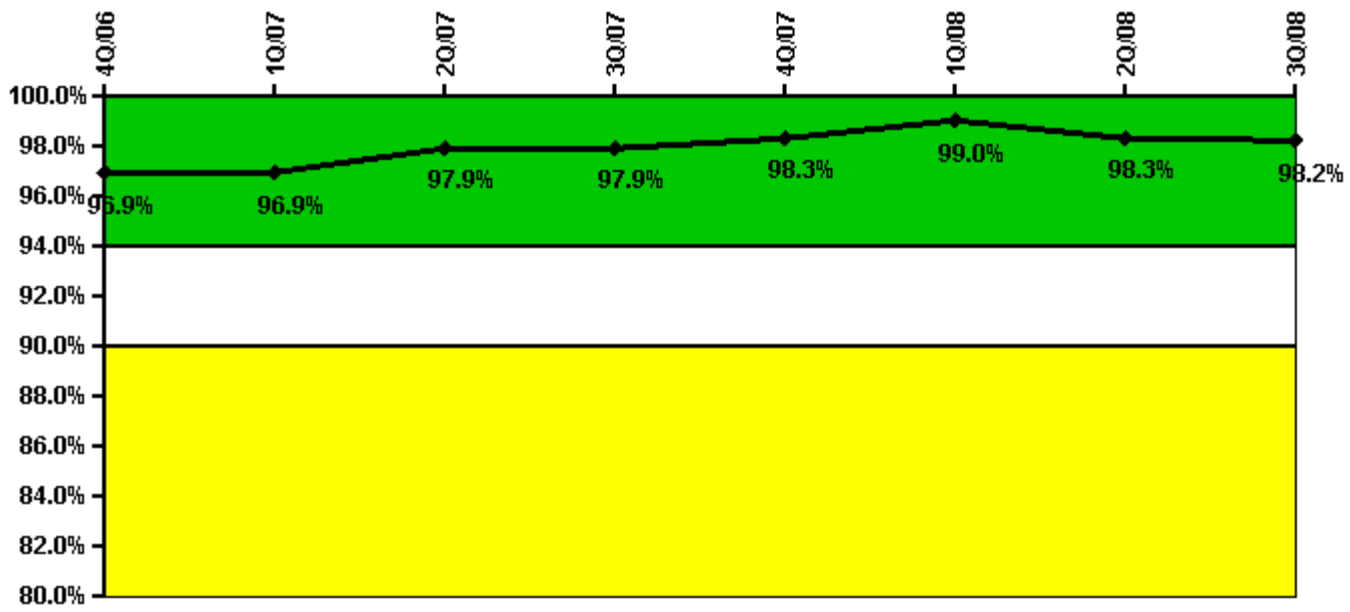


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
Successful siren-tests	64	74	66	76	65	76	64	65
Total sirens-tests	66	77	66	77	66	77	66	66
Indicator value	96.9%	96.9%	97.9%	97.9%	98.3%	99.0%	98.3%	98.2%

Licensee Comments: none

Occupational Exposure Control Effectiveness

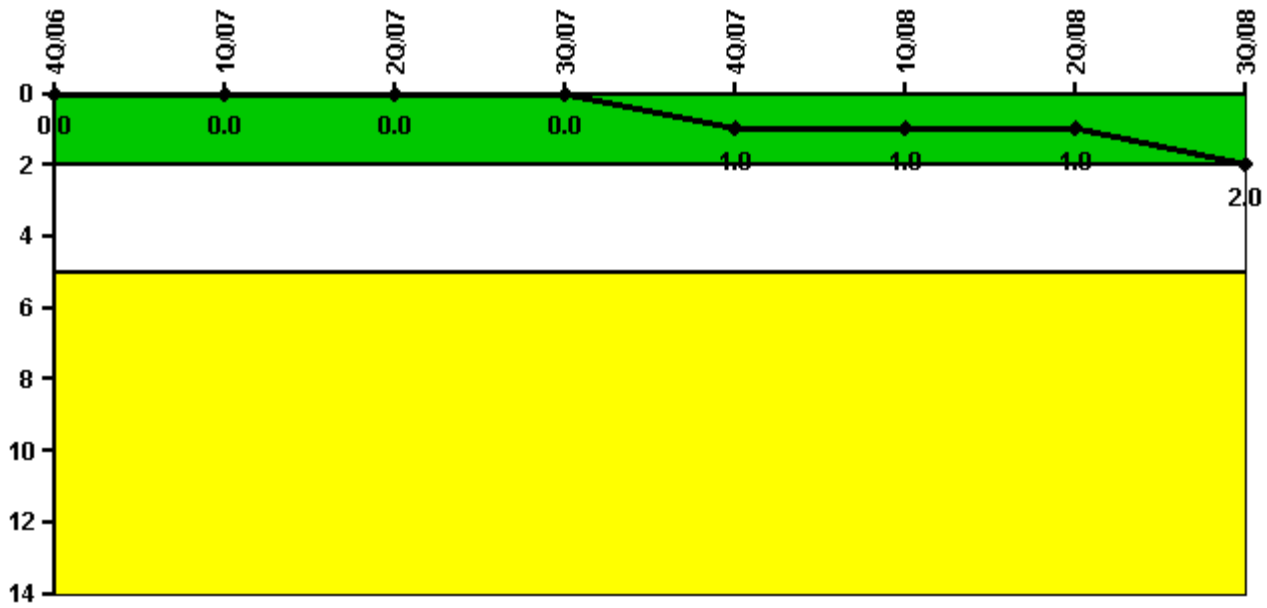

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
High radiation area occurrences	0	0	0	0	1	0	0	1
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	1	1	1	2

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Security information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: November 26, 2008