


Callaway

4Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

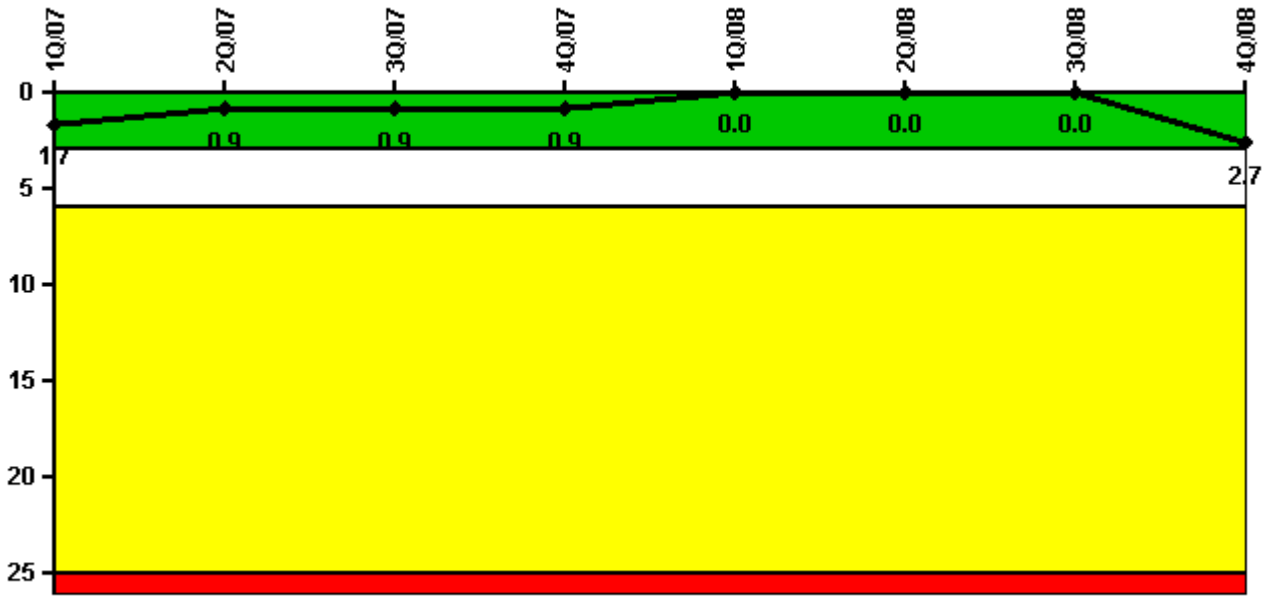


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned scrams	1.0	0	0	0	0	0	0	3.0
Critical hours	2081.3	1314.3	2208.0	2209.0	2183.0	2184.0	2208.0	1311.6
Indicator value	1.7	0.9	0.9	0.9	0	0	0	2.7

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

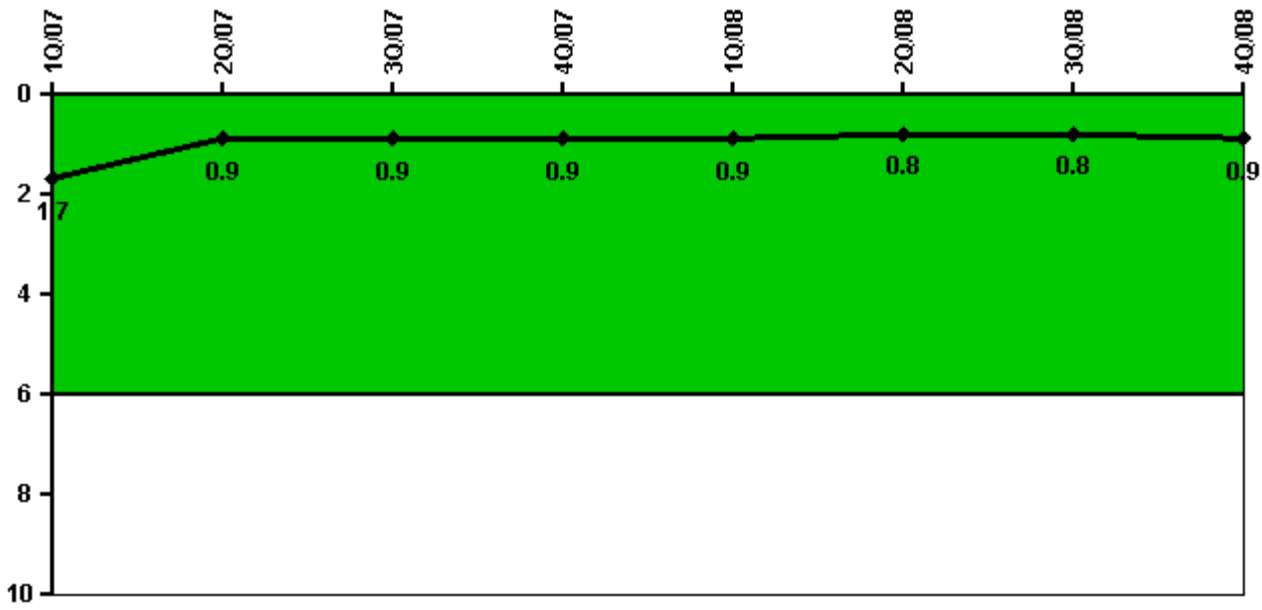


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned power changes	1.0	0	0	0	1.0	0	0	0
Critical hours	2081.3	1314.3	2208.0	2209.0	2183.0	2184.0	2208.0	1311.6
Indicator value	1.7	0.9	0.9	0.9	0.9	0.8	0.8	0.9

Licensee Comments: none

Unplanned Scrams with Complications

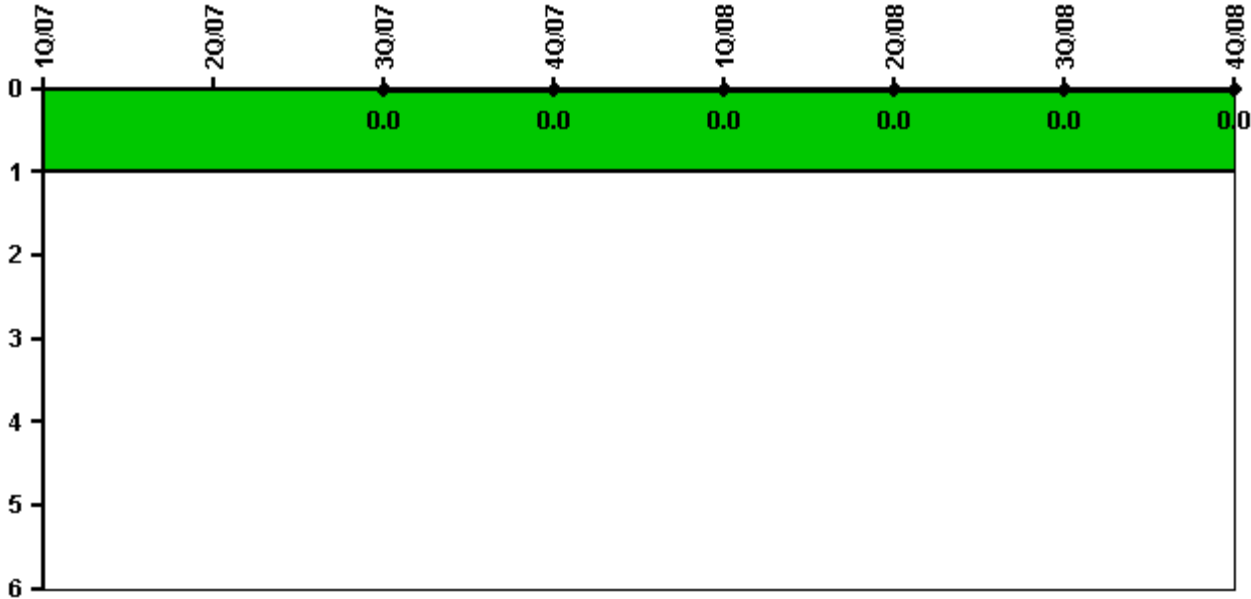


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value			0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (PWR)

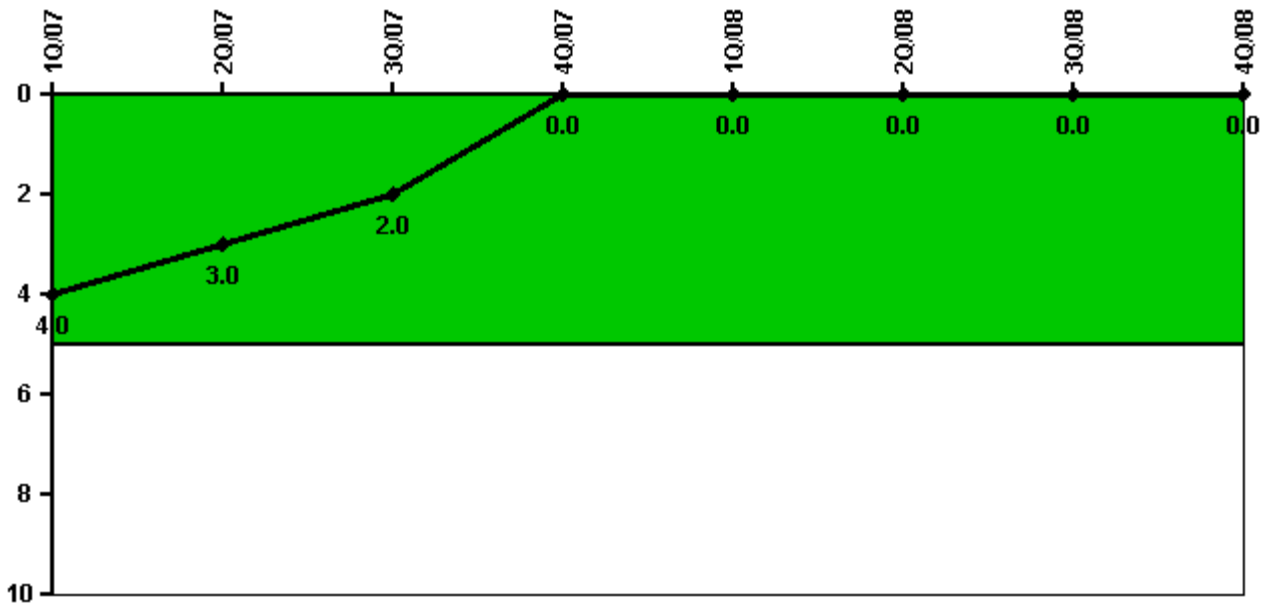


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	4	3	2	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

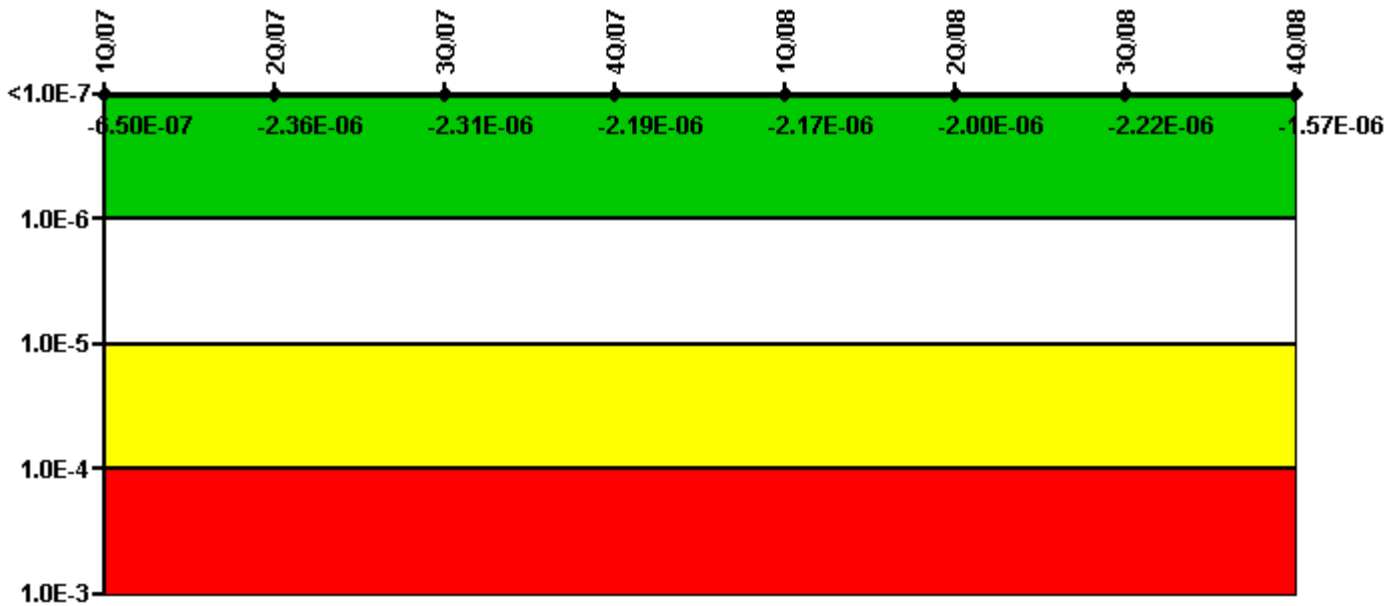

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	4.50E-07	3.40E-07	3.90E-07	5.10E-07	5.30E-07	7.00E-07	4.80E-07	6.30E-07
URI (Δ CDF)	-1.10E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.70E-06	-2.20E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.50E-07	-2.36E-06	-2.31E-06	-2.19E-06	-2.17E-06	-2.00E-06	-2.22E-06	-1.57E-06

Licensee Comments:

4Q/08: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

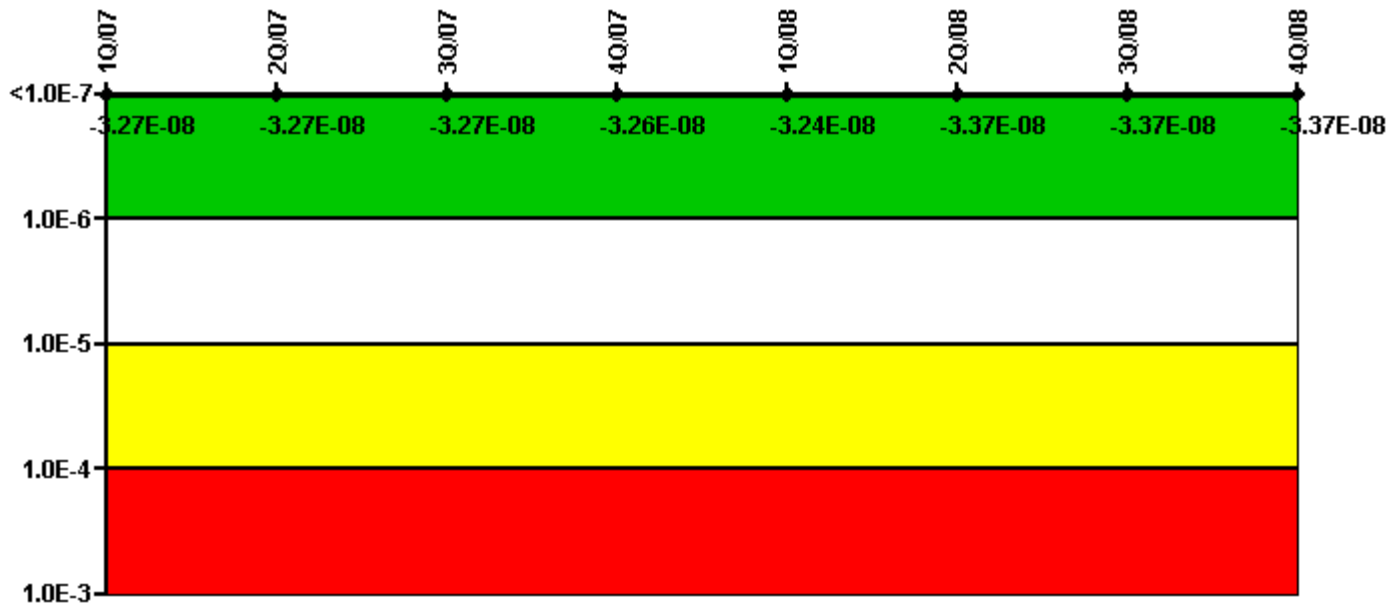


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (ΔCDF)	-4.70E-09	-4.70E-09	-4.70E-09	-4.60E-09	-4.40E-09	-4.70E-09	-4.70E-09	-4.70E-09
URI (ΔCDF)	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.80E-08	-2.90E-08	-2.90E-08	-2.90E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.27E-08	-3.27E-08	-3.27E-08	-3.26E-08	-3.24E-08	-3.37E-08	-3.37E-08	-3.37E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

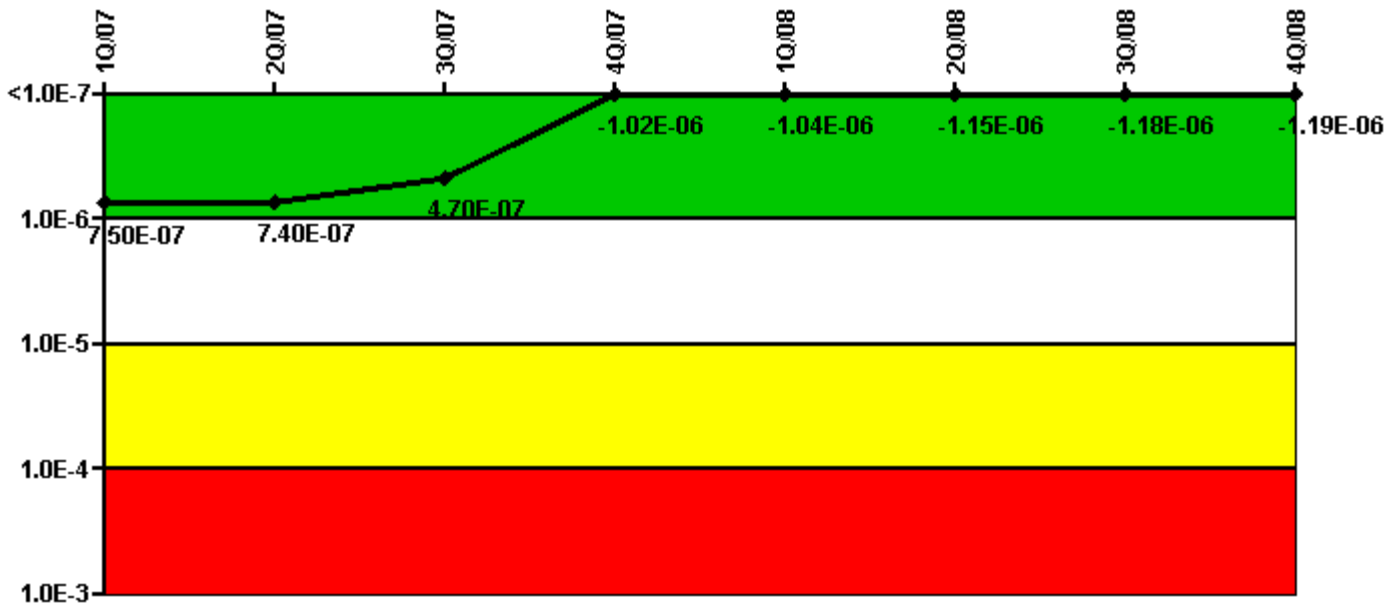


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	4.20E-07	4.10E-07	1.70E-07	-1.90E-08	6.00E-08	-5.00E-08	-8.40E-08	-8.50E-08
URI (Δ CDF)	3.30E-07	3.30E-07	3.00E-07	-1.00E-06	-1.10E-06	-1.10E-06	-1.10E-06	-1.10E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	7.50E-07	7.40E-07	4.70E-07	-1.02E-06	-1.04E-06	-1.15E-06	-1.18E-06	-1.19E-06

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

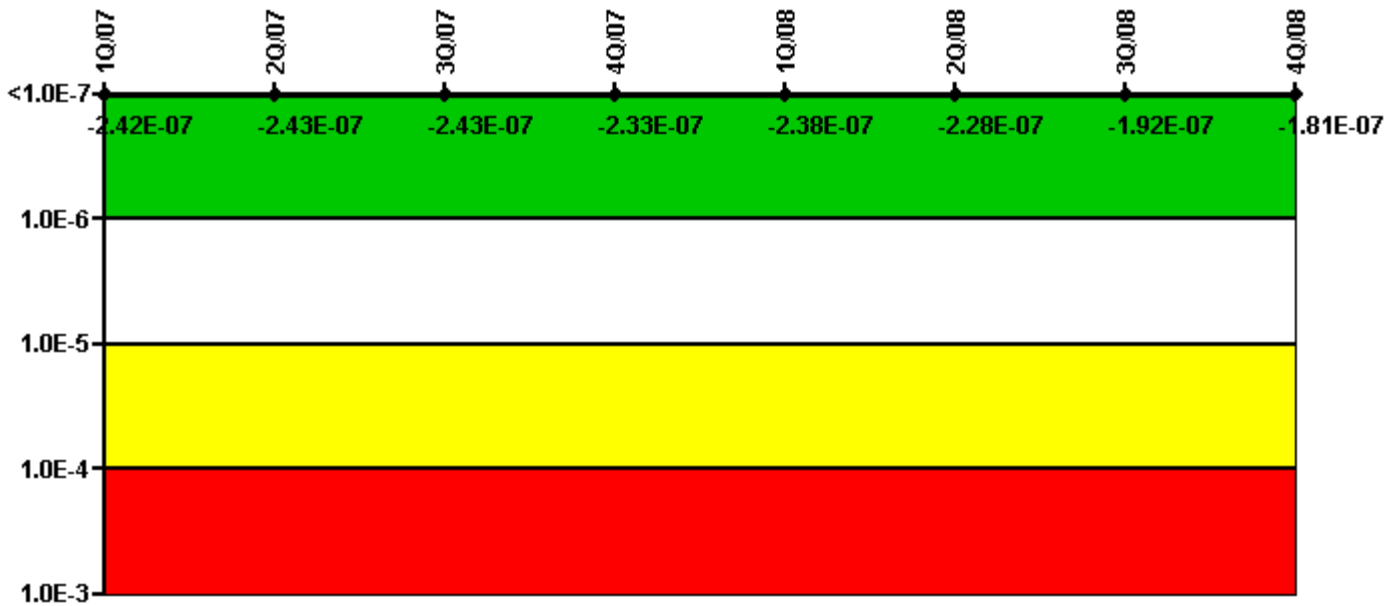


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (ΔCDF)	-2.20E-08	-2.30E-08	-2.30E-08	-1.30E-08	-1.80E-08	-1.80E-08	1.80E-08	2.90E-08
URI (ΔCDF)	-2.20E-07	-2.20E-07	-2.20E-07	-2.20E-07	-2.20E-07	-2.10E-07	-2.10E-07	-2.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.42E-07	-2.43E-07	-2.43E-07	-2.33E-07	-2.38E-07	-2.28E-07	-1.92E-07	-1.81E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

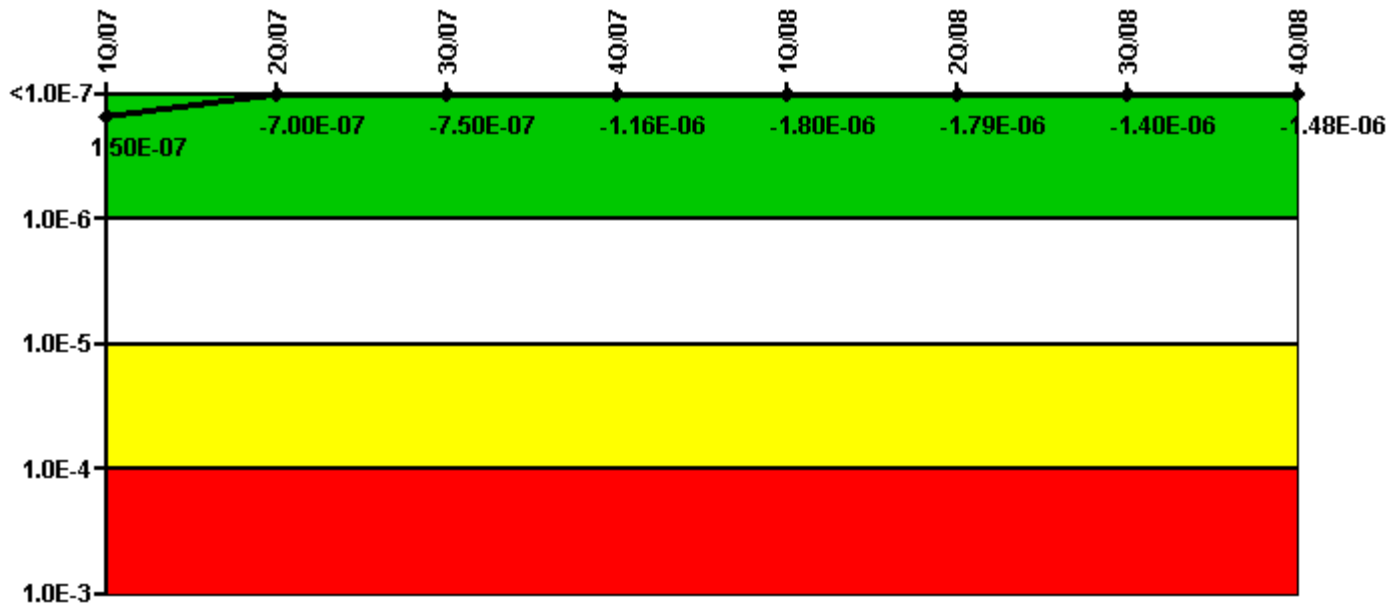


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	8.00E-07	4.00E-07	3.50E-07	-6.30E-08	-6.00E-07	-5.90E-07	-2.00E-07	-2.80E-07
URI (Δ CDF)	-6.50E-07	-1.10E-06	-1.10E-06	-1.10E-06	-1.20E-06	-1.20E-06	-1.20E-06	-1.20E-06
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.50E-07	-7.00E-07	-7.50E-07	-1.16E-06	-1.80E-06	-1.79E-06	-1.40E-06	-1.48E-06

Licensee Comments: none

Reactor Coolant System Activity

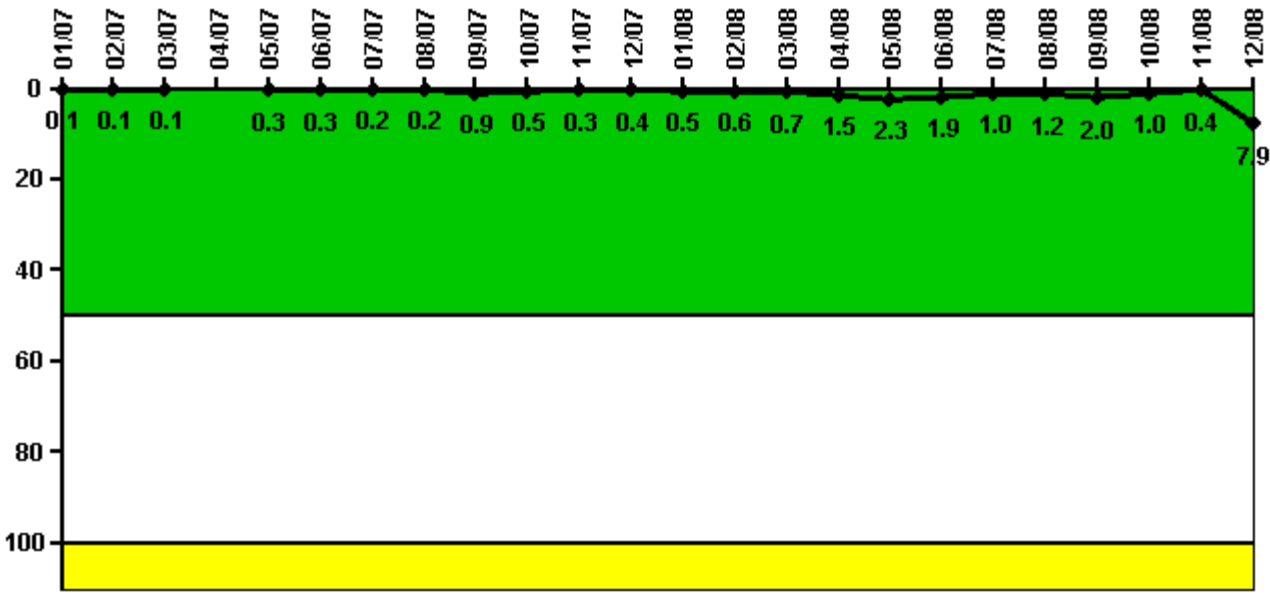

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000978	0.000831	0.001050	N/A	0.002530	0.002730	0.002440	0.002240	0.008790	0.005370	0.003410	0.004370
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	N/A	0.3	0.3	0.2	0.2	0.9	0.5	0.3	0.4

Reactor Coolant System Activity	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum activity	0.005010	0.005510	0.006980	0.014900	0.022600	0.018500	0.009950	0.012100	0.020400	0.010400	0.003600	0.078600
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.5	0.6	0.7	1.5	2.3	1.9	1.0	1.2	2.0	1.0	0.4	7.9

Licensee Comments: none

Reactor Coolant System Leakage

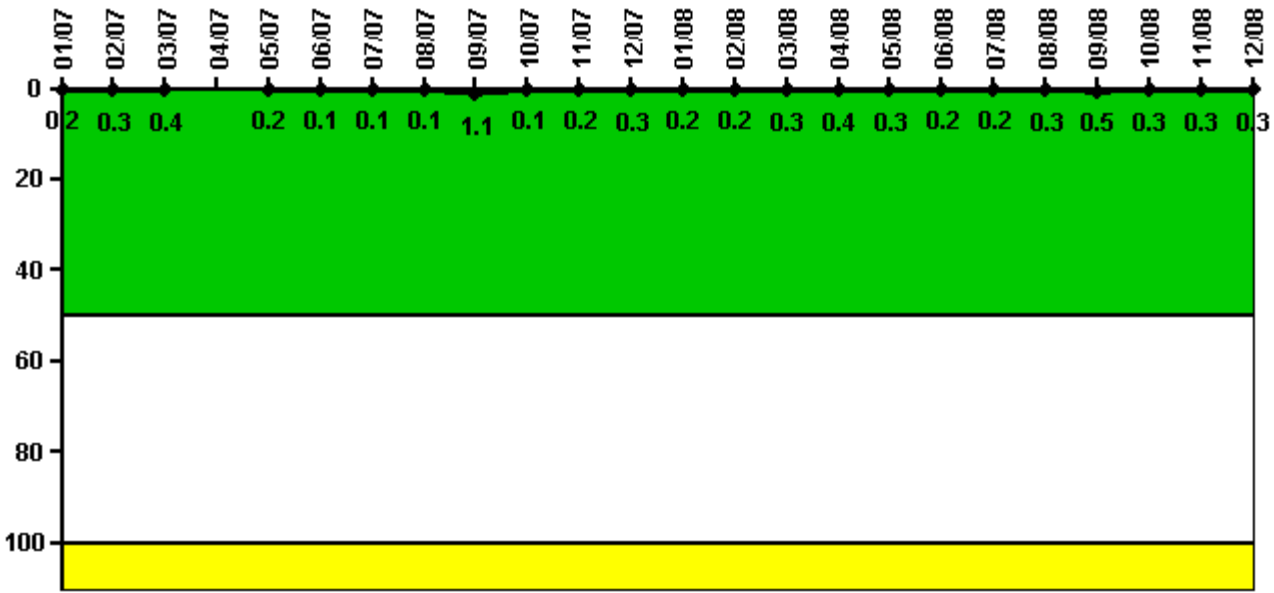

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	0.016	0.025	0.037	N/A	0.016	0.013	0.013	0.013	0.105	0.007	0.018	0.025
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.3	0.4	N/A	0.2	0.1	0.1	0.1	1.1	0.1	0.2	0.3

Reactor Coolant System Leakage	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum leakage	0.019	0.021	0.027	0.036	0.028	0.019	0.015	0.030	0.048	0.026	0.033	0.033
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.2	0.3	0.4	0.3	0.2	0.2	0.3	0.5	0.3	0.3	0.3

Licensee Comments: none

Drill/Exercise Performance

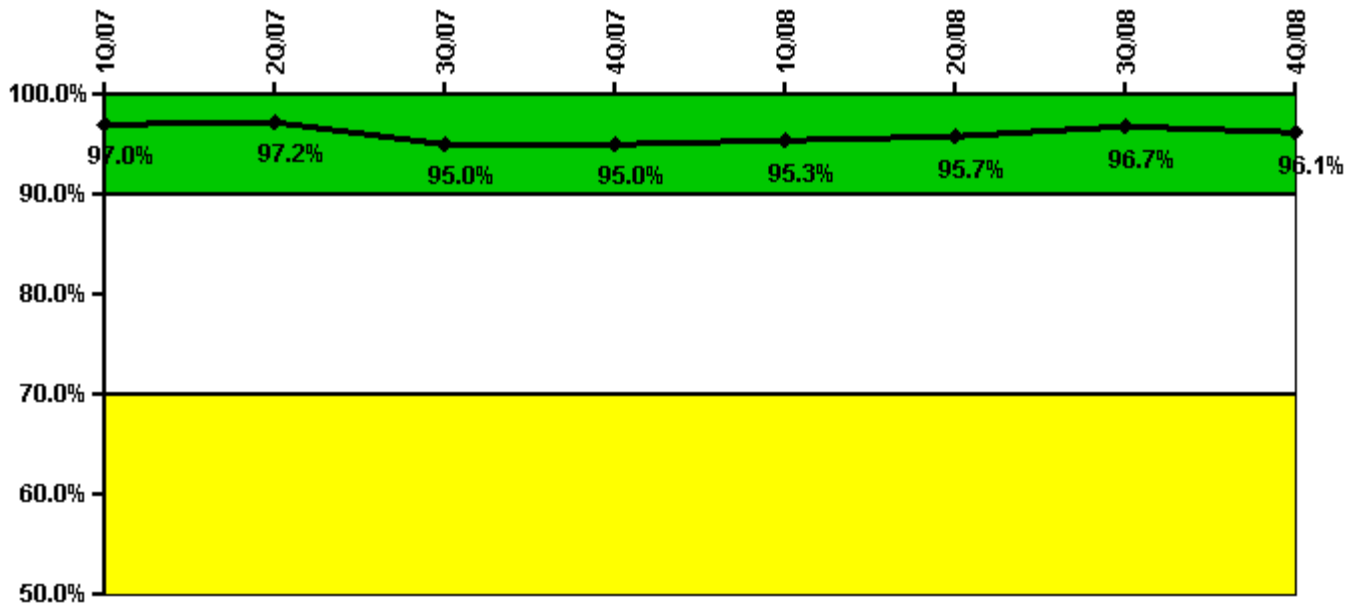

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful opportunities	18.0	14.0	46.0	17.0	52.0	64.0	20.0	18.0
Total opportunities	18.0	14.0	51.0	18.0	52.0	66.0	20.0	20.0
Indicator value	97.0%	97.2%	95.0%	95.0%	95.3%	95.7%	96.7%	96.1%

Licensee Comments:

3Q/07: EP DEP data is being changed to include information from a retracted, actual event declaration which was initially omitted from third quarter 2007 data. DEP data for the third quarter 2007 is corrected from 46 of 50 opportunities to 47 of 52 opportunities. This revision did not result in a change to the color of the indicator. 20090120 - EP DEP data is being revised to eliminate a simultaneous PAR. Data is revised from 47/52 to 46/51. Per NRC inspection. This revision did not result in a change to the color of the indicator.

ERO Drill Participation

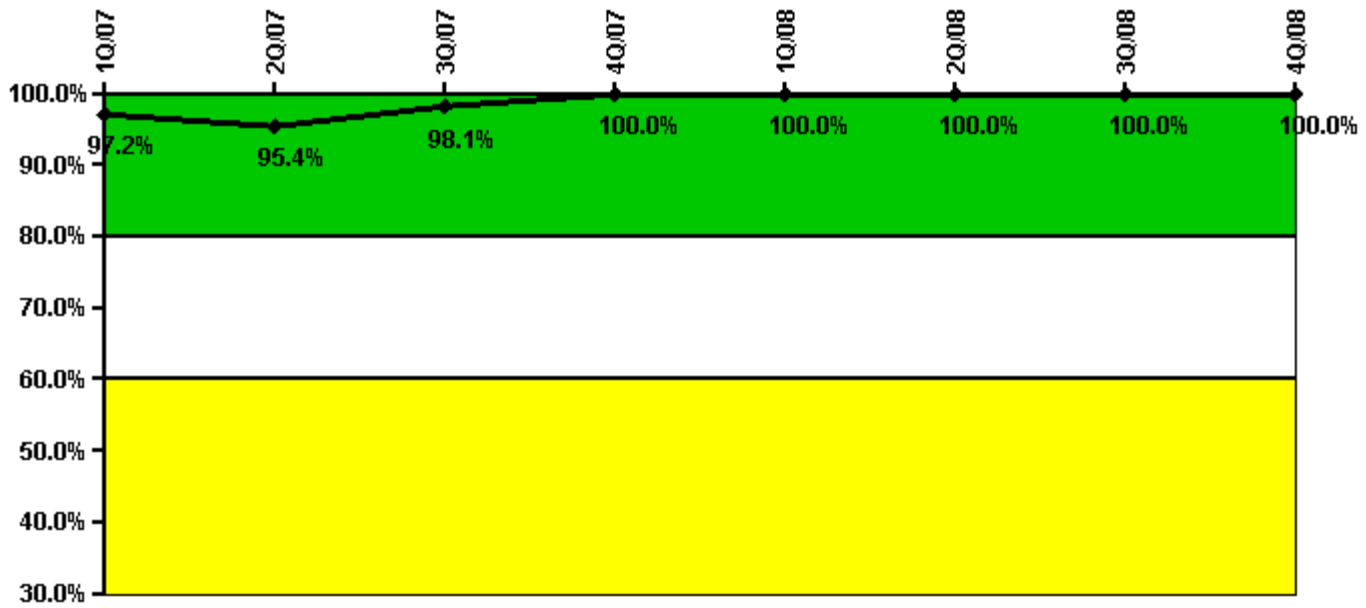


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Participating Key personnel	105.0	103.0	102.0	107.0	100.0	112.0	103.0	100.0
Total Key personnel	108.0	108.0	104.0	107.0	100.0	112.0	103.0	100.0
Indicator value	97.2%	95.4%	98.1%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

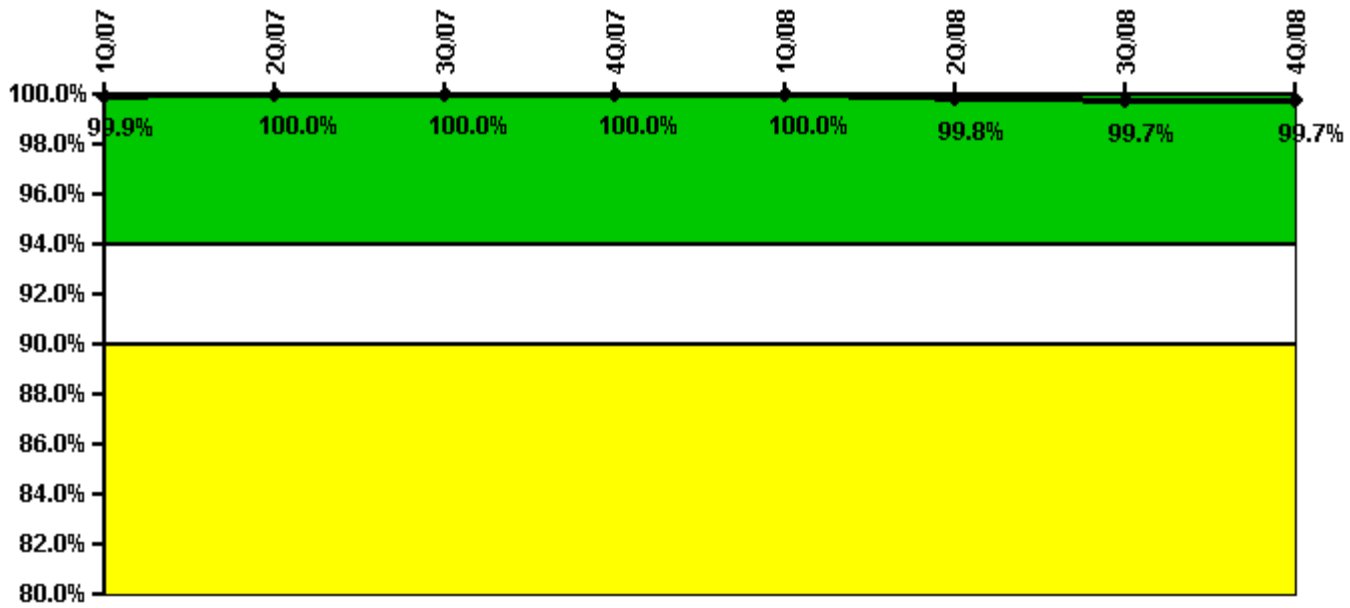

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful siren-tests	377	377	377	377	377	374	405	377
Total sirens-tests	377	377	377	377	377	377	406	377
Indicator value	99.9%	100.0%	100.0%	100.0%	100.0%	99.8%	99.7%	99.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness




Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

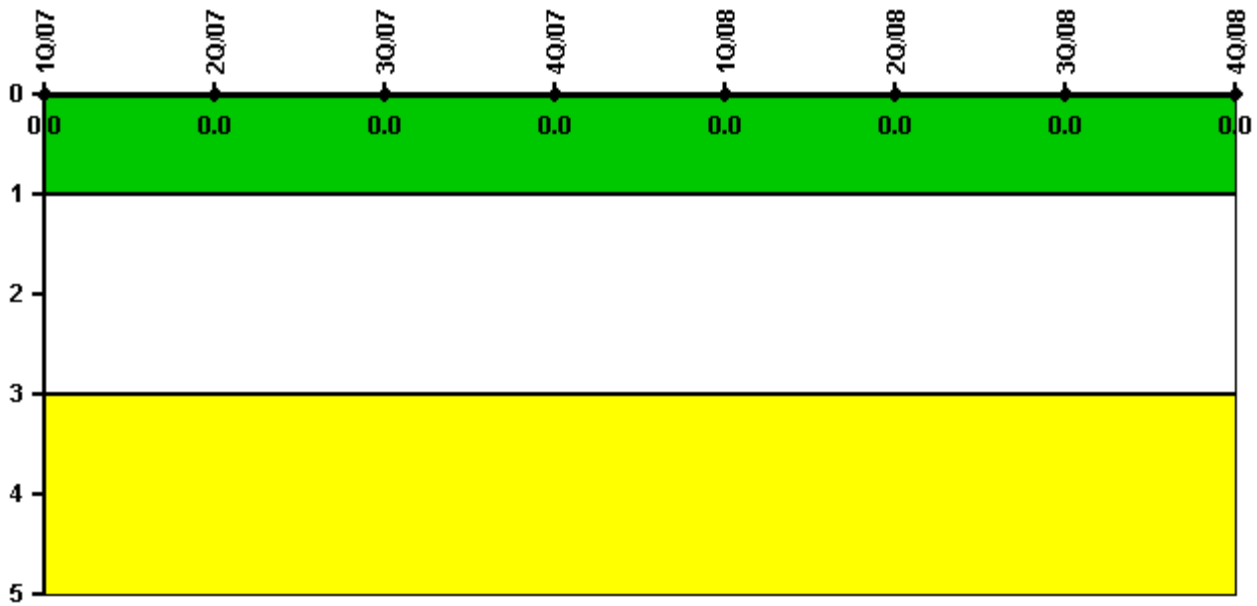

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.