


Cooper

4Q/2008 Performance Indicators

Licensee's General Comments: After review of drill data against NEI-9902 guidelines and FAQ it was determined that additional drill opportunities existed for August 2007 November 2007. August 2008 data was erroneously cahnged on January 12, 2008 to August 2007 values and needs to be changed back to original August 2008 values.

Unplanned Scrams per 7000 Critical Hrs

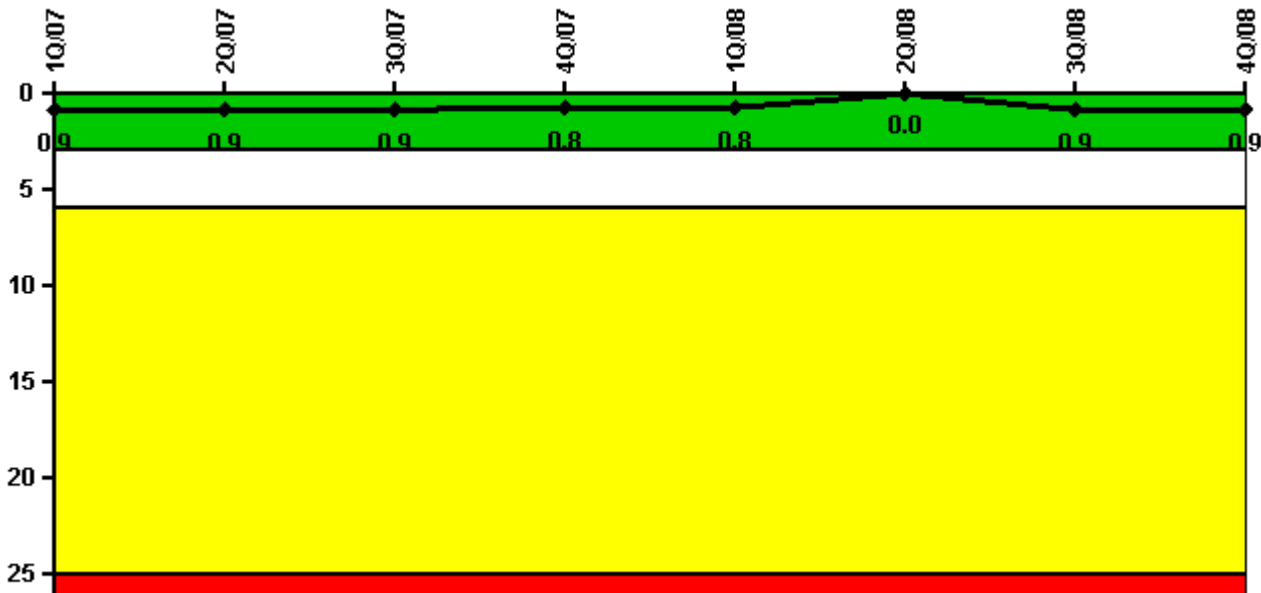


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned scrams	0	1.0	0	0	0	0	1.0	0
Critical hours	2159.0	2123.7	2208.0	2209.0	2183.0	1354.8	2153.9	2209.0
Indicator value	0.9	0.9	0.9	0.8	0.8	0	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

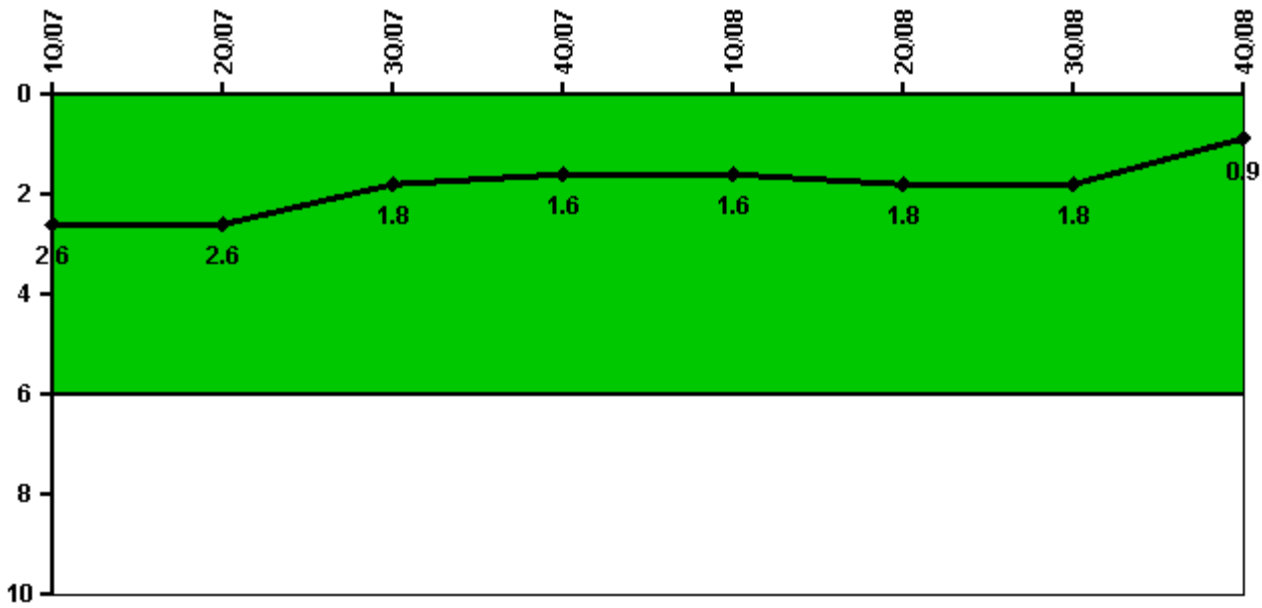

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Unplanned power changes	1.0	0	0	1.0	1.0	0	0	0
Critical hours	2159.0	2123.7	2208.0	2209.0	2183.0	1354.8	2153.9	2209.0
Indicator value	2.6	2.6	1.8	1.6	1.6	1.8	1.8	0.9

Licensee Comments: none

Unplanned Scrams with Complications




Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value			0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

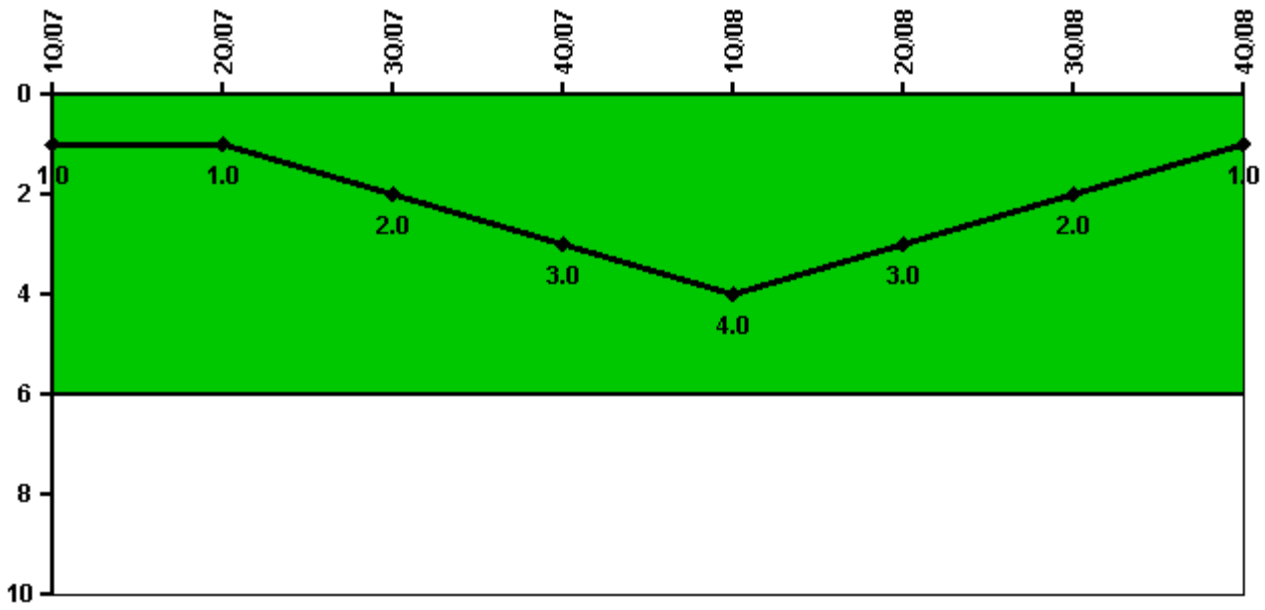


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Safety System Functional Failures	0	1	1	1	1	0	0	0
Indicator value	1	1	2	3	4	3	2	1

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

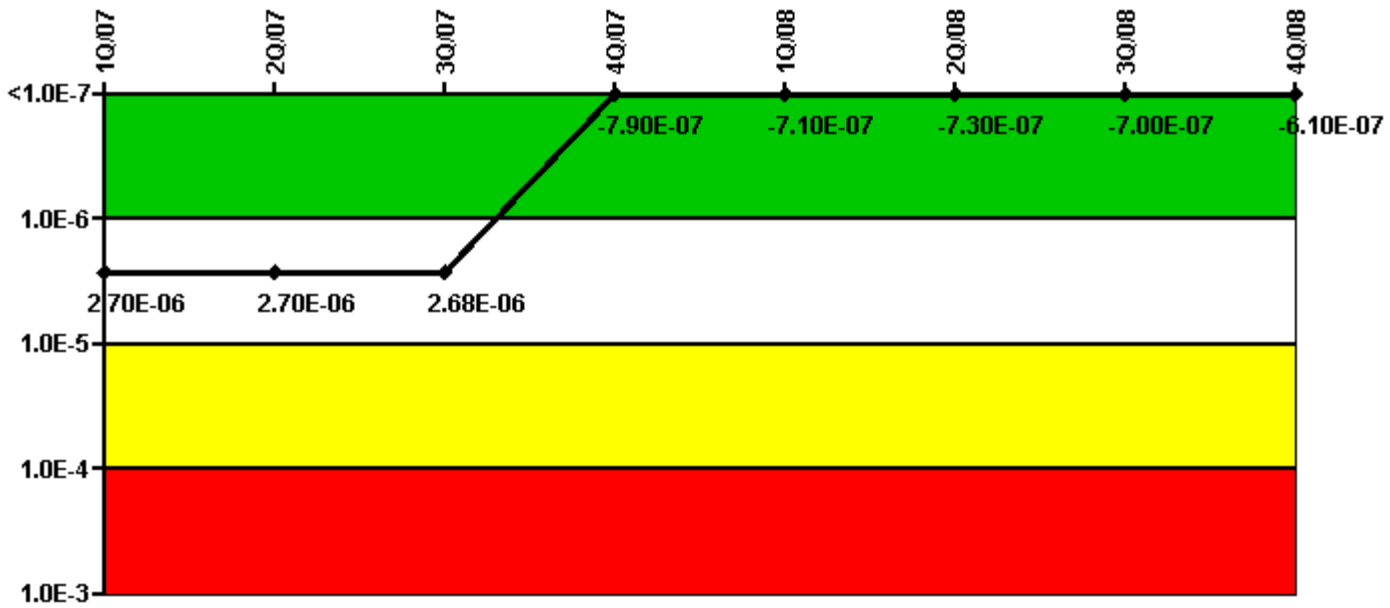

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	1.00E-07	1.00E-07	1.80E-07	1.10E-07	1.50E-07	1.60E-07	2.00E-07	3.20E-07
URI (Δ CDF)	2.60E-06	2.60E-06	2.50E-06	-9.00E-07	-8.60E-07	-8.90E-07	-9.00E-07	-9.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.70E-06	2.70E-06	2.68E-06	-7.90E-07	-7.10E-07	-7.30E-07	-7.00E-07	-6.10E-07

Licensee Comments:

4Q/08: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

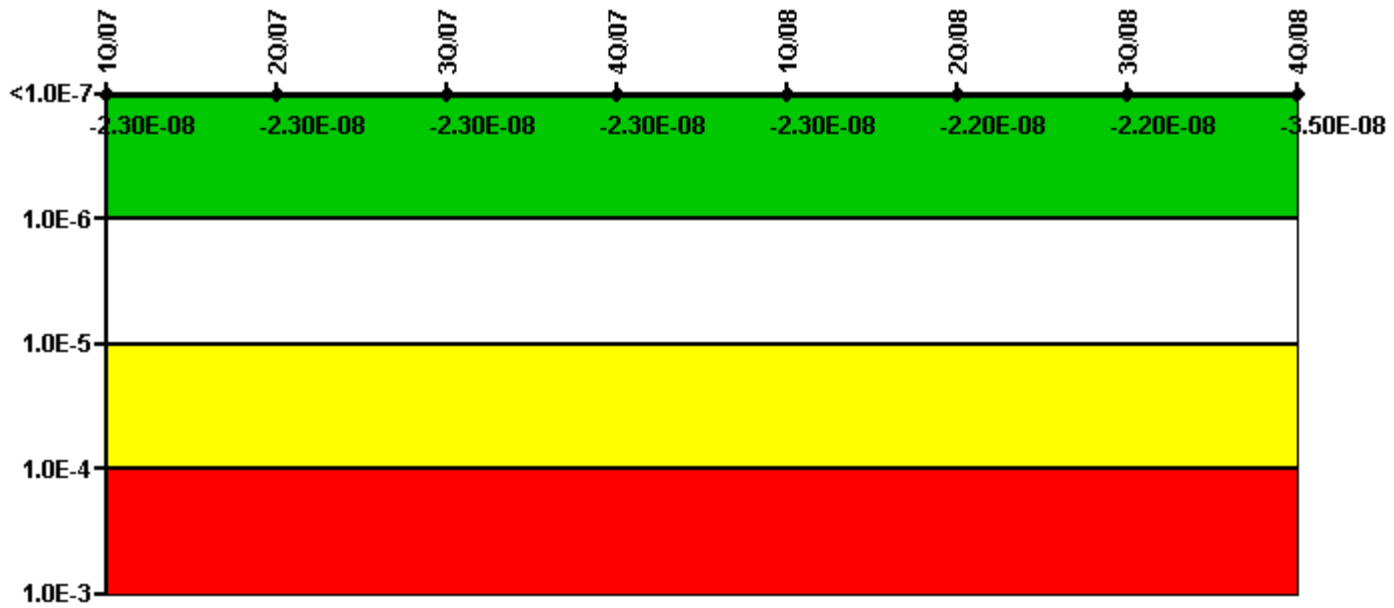


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.00E-08	-1.10E-08
URI (Δ CDF)	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.20E-08	-1.20E-08	-2.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-2.30E-08	-2.30E-08	-2.30E-08	-2.30E-08	-2.30E-08	-2.20E-08	-2.20E-08	-3.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

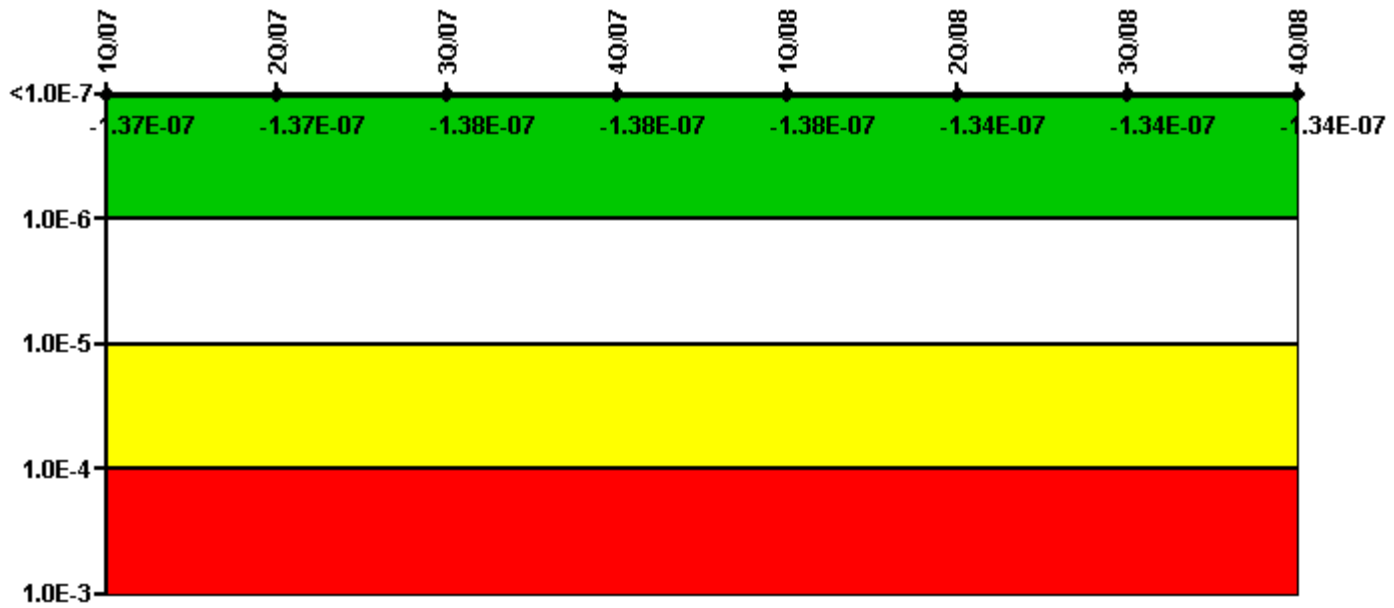


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	-4.50E-08	-4.50E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08	-4.60E-08
URI (Δ CDF)	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-9.20E-08	-8.80E-08	-8.80E-08	-8.80E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.37E-07	-1.37E-07	-1.38E-07	-1.38E-07	-1.38E-07	-1.34E-07	-1.34E-07	-1.34E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

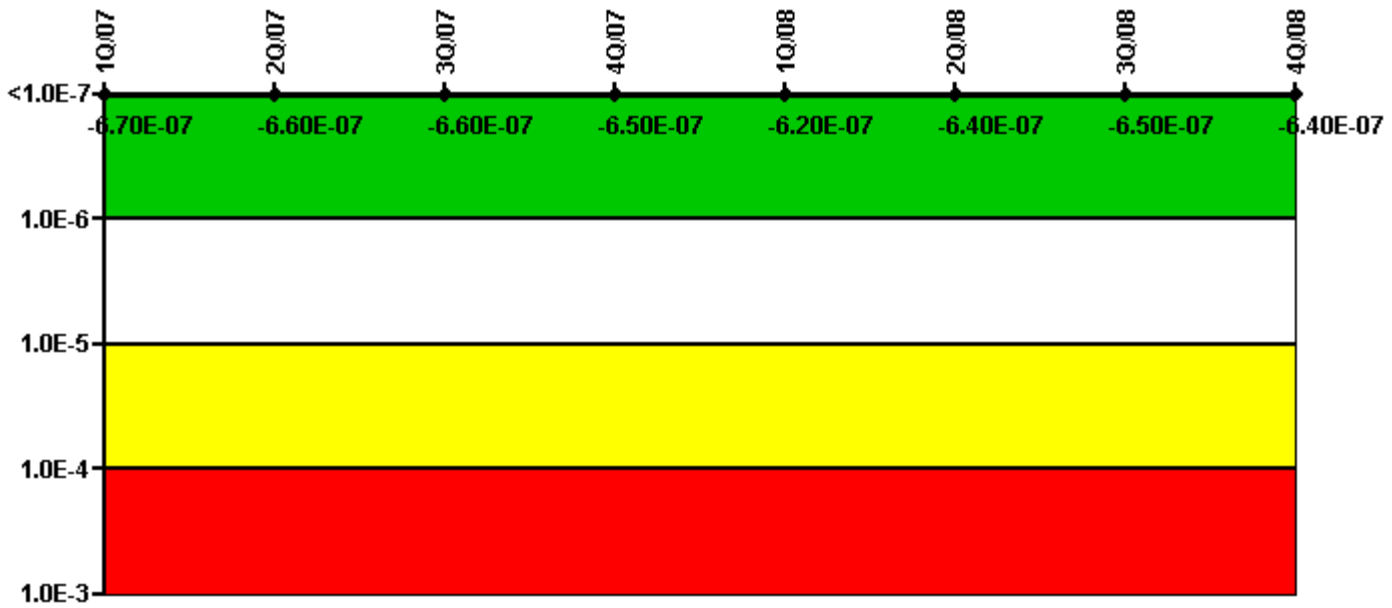


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (Δ CDF)	-1.20E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.10E-07	-1.00E-07	-1.10E-07	-1.10E-07
URI (Δ CDF)	-5.50E-07	-5.50E-07	-5.50E-07	-5.40E-07	-5.10E-07	-5.40E-07	-5.40E-07	-5.30E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.70E-07	-6.60E-07	-6.60E-07	-6.50E-07	-6.20E-07	-6.40E-07	-6.50E-07	-6.40E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

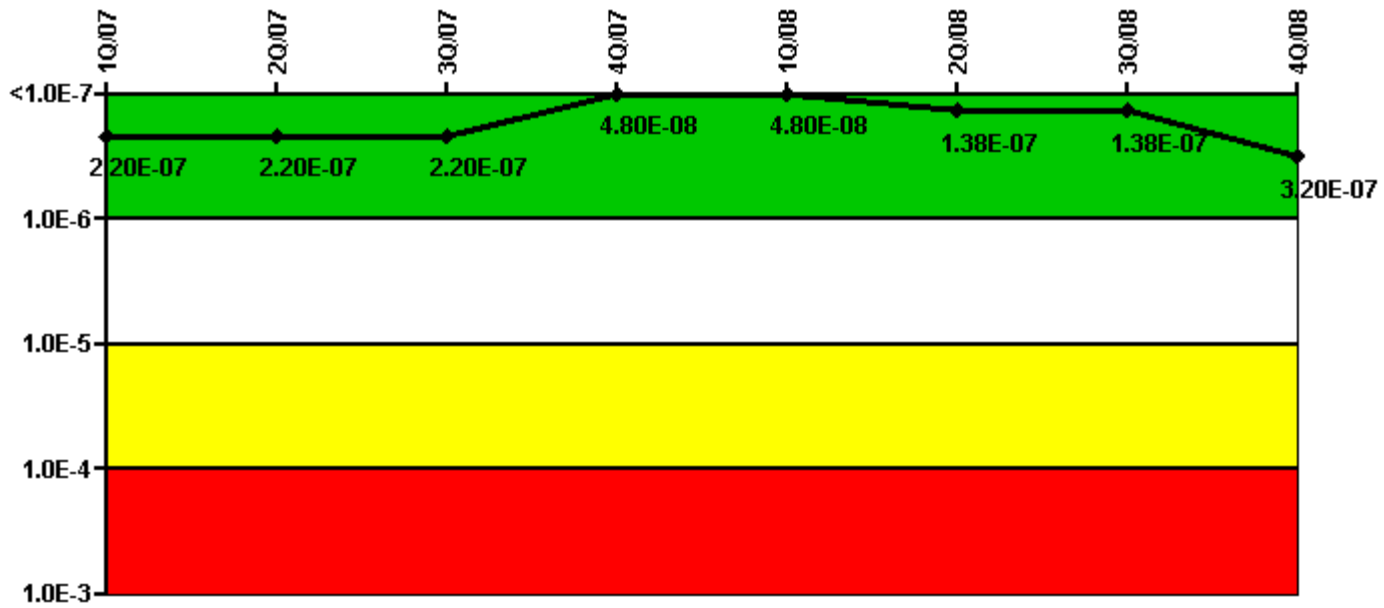


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
UAI (ΔCDF)	1.10E-07	1.10E-07	1.10E-07	1.10E-07	1.10E-07	2.00E-07	2.00E-07	2.00E-07
URI (ΔCDF)	1.10E-07	1.10E-07	1.10E-07	-6.20E-08	-6.20E-08	-6.20E-08	-6.20E-08	1.20E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.20E-07	2.20E-07	2.20E-07	4.80E-08	4.80E-08	1.38E-07	1.38E-07	3.20E-07

Licensee Comments: none

Reactor Coolant System Activity

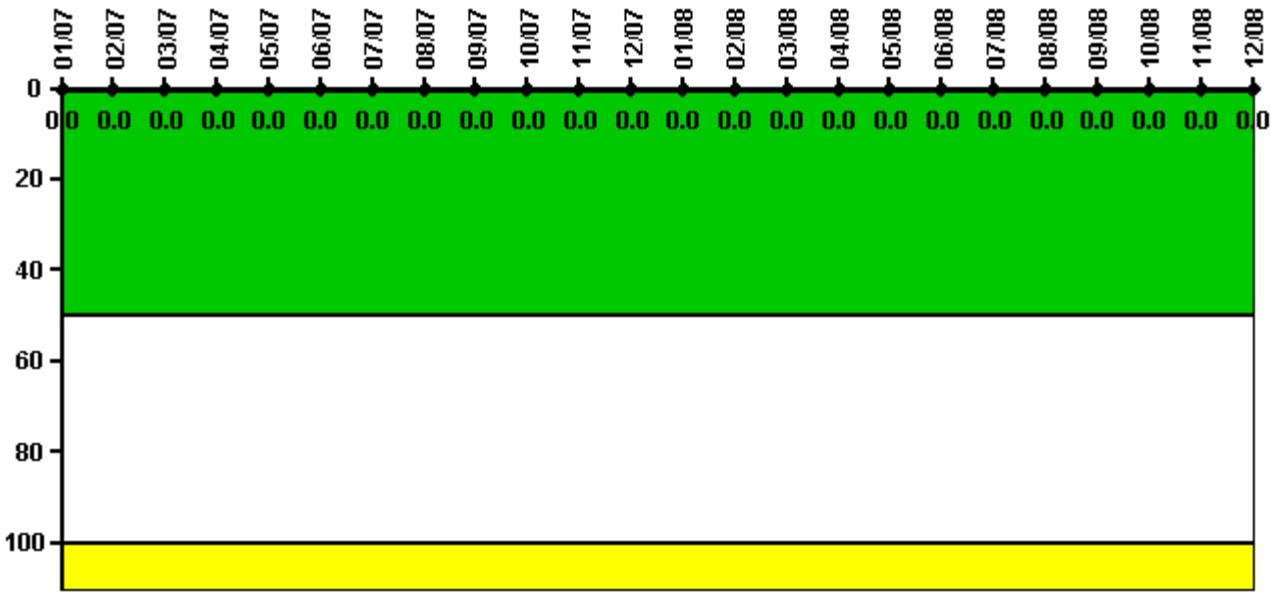

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum activity	0.000026	0.000021	0.000018	0.000026	0.000026	0.000016	0.000017	0.000017	0.000016	0.000017	0.000021	0.000018
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum activity	0.000017	0.000018	0.000021	0.000017	0.000028	0.000017	0.000019	0.000017	0.000017	0.000015	0.000016	0.000017
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

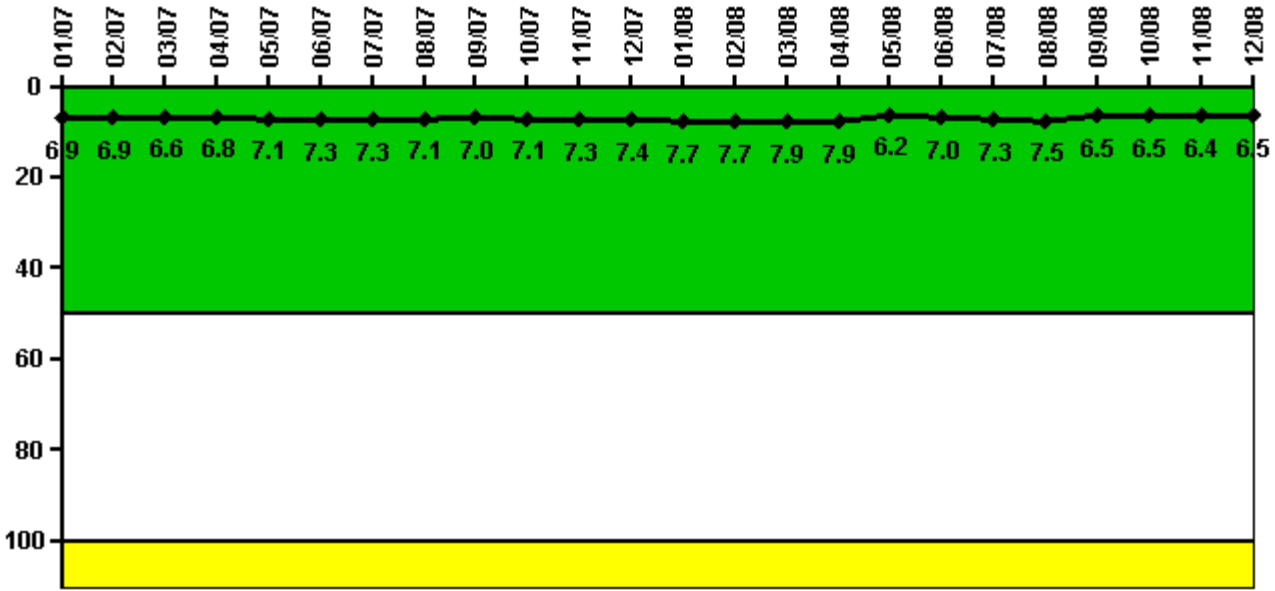


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/07	2/07	3/07	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07
Maximum leakage	2.060	2.060	1.973	2.028	2.134	2.201	2.184	2.131	2.110	2.117	2.187	2.219
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	6.9	6.9	6.6	6.8	7.1	7.3	7.3	7.1	7.0	7.1	7.3	7.4
Reactor Coolant System Leakage	1/08	2/08	3/08	4/08	5/08	6/08	7/08	8/08	9/08	10/08	11/08	12/08
Maximum leakage	2.300	2.312	2.358	2.360	1.846	2.090	2.201	2.263	1.940	1.947	1.919	1.935
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	7.7	7.7	7.9	7.9	6.2	7.0	7.3	7.5	6.5	6.5	6.4	6.5

Licensee Comments: none

Drill/Exercise Performance

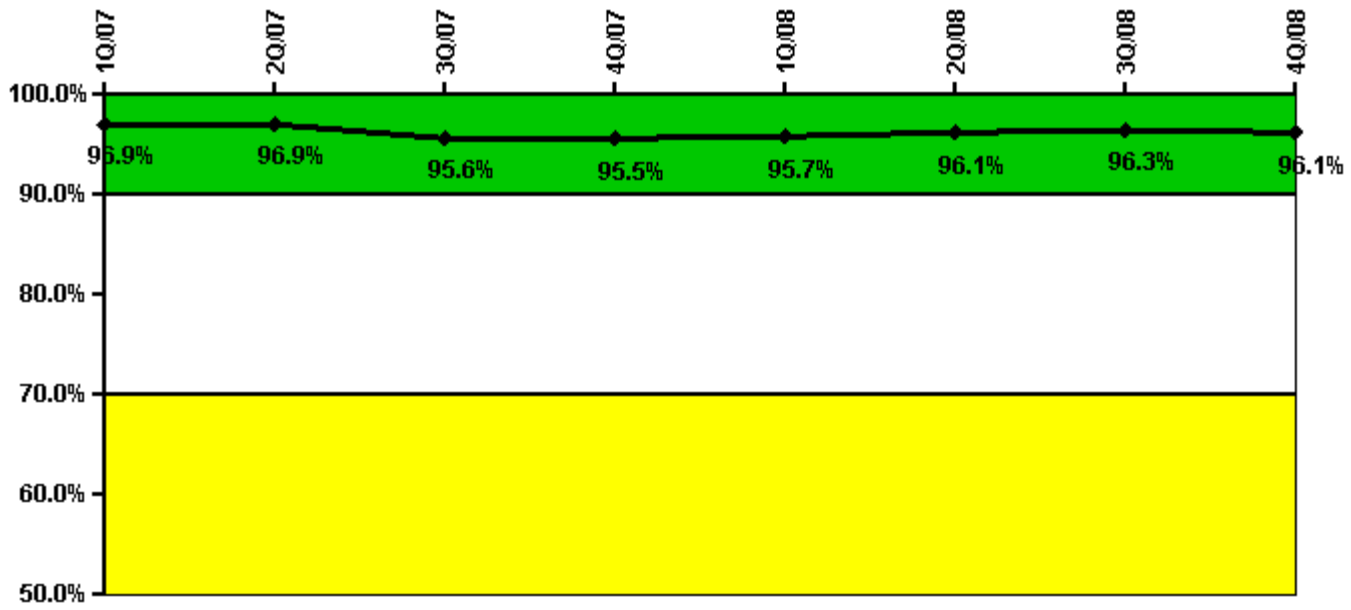


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful opportunities	72.0	59.0	29.0	31.0	50.0	52.0	27.0	28.0
Total opportunities	76.0	61.0	33.0	32.0	51.0	52.0	28.0	29.0
Indicator value	96.9%	96.9%	95.6%	95.5%	95.7%	96.1%	96.3%	96.1%

Licensee Comments: none

ERO Drill Participation

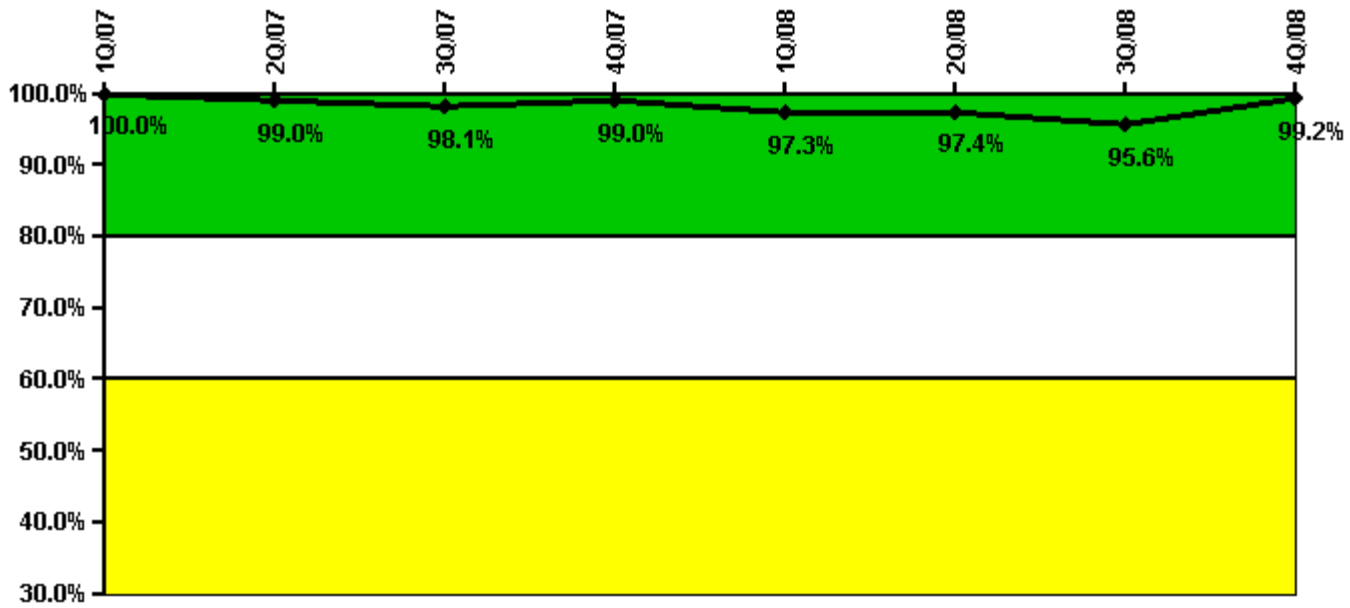


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Participating Key personnel	108.0	100.0	101.0	99.0	107.0	113.0	108.0	125.0
Total Key personnel	108.0	101.0	103.0	100.0	110.0	116.0	113.0	126.0
Indicator value	100.0%	99.0%	98.1%	99.0%	97.3%	97.4%	95.6%	99.2%

Licensee Comments: none

Alert & Notification System

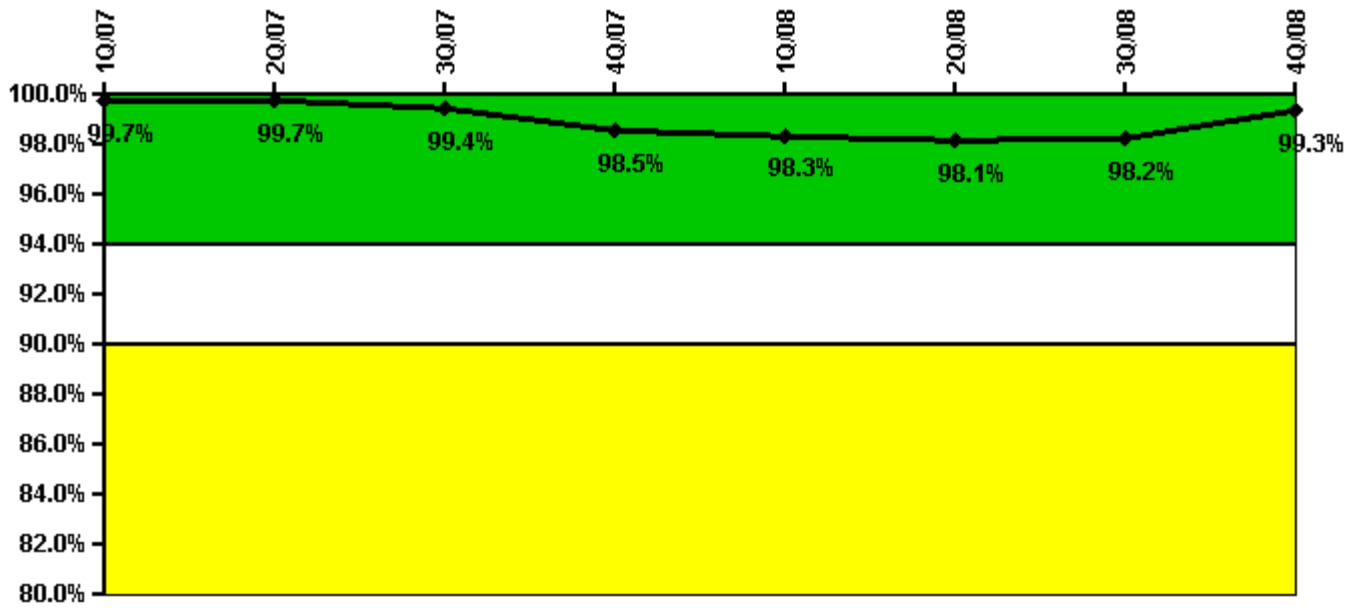


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
Successful siren-tests	288	287	285	298	286	285	286	311
Total sirens-tests	288	288	288	312	288	288	288	312
Indicator value	99.7%	99.7%	99.4%	98.5%	98.3%	98.1%	98.2%	99.3%

Licensee Comments: none

Occupational Exposure Control Effectiveness

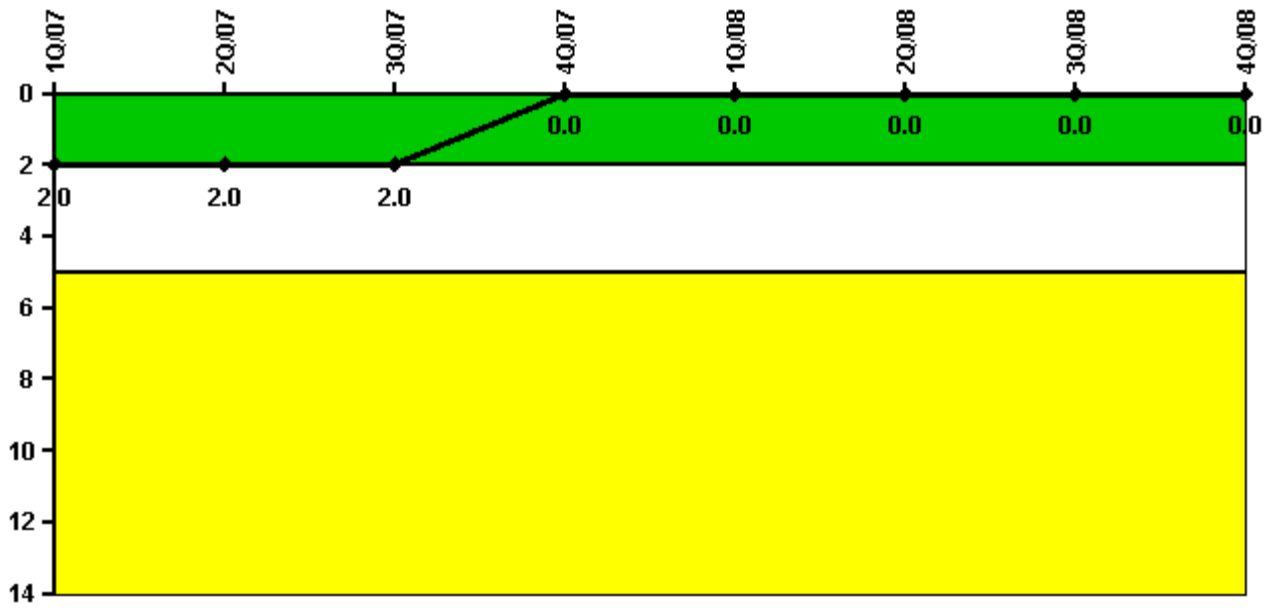

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	2	2	2	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08	3Q/08	4Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Security](#) information not publicly available.